


# Hope Creek 1

## 4Q/2008 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

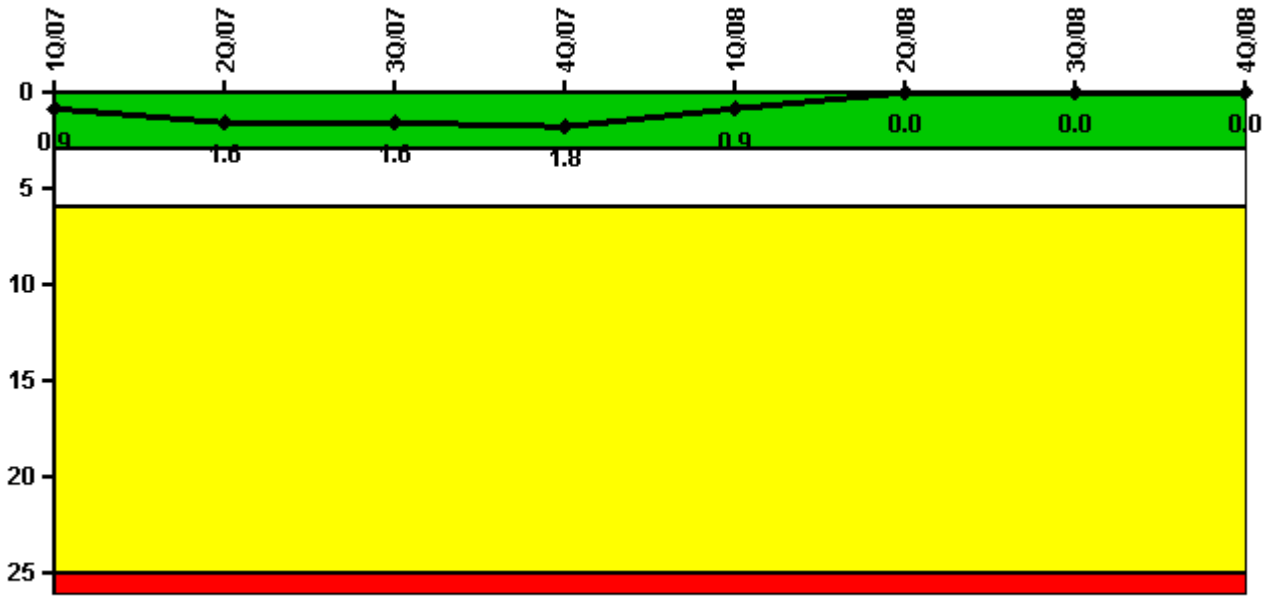


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned scrams	1.0	1.0	0	0	0	0	0	0
Critical hours	2078.3	2136.5	2208.0	1556.4	2183.0	2184.0	2208.0	2209.0
Indicator value	0.9	1.6	1.6	1.8	0.9	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

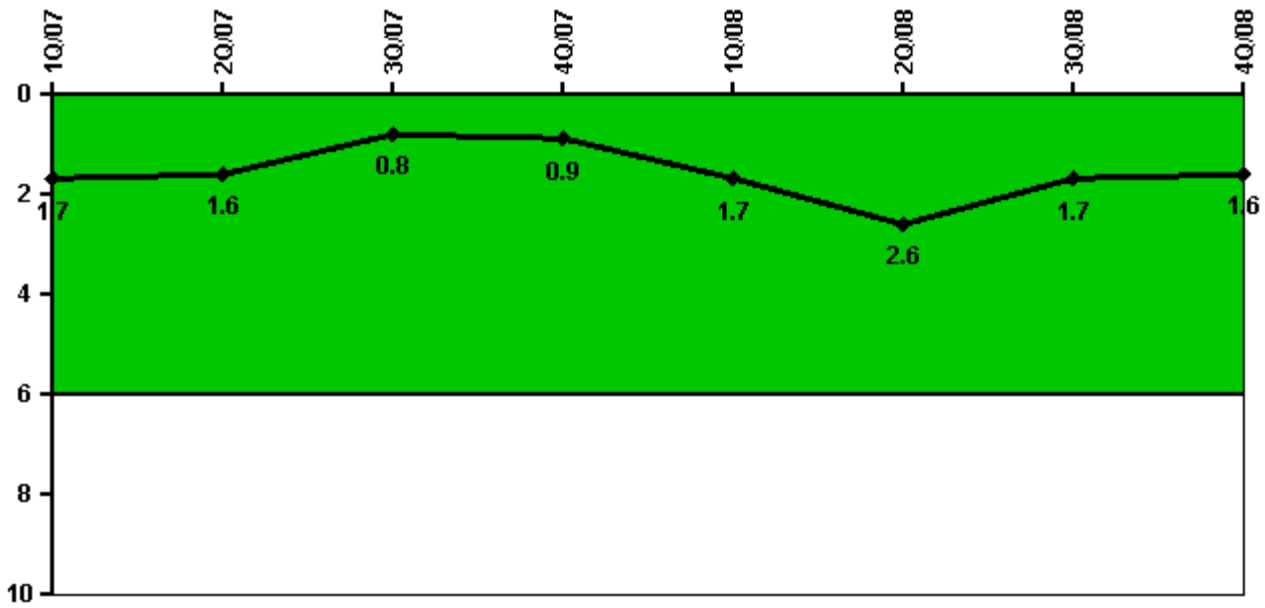

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned power changes	0	0	1.0	0	1.0	1.0	0	0
Critical hours	2078.3	2136.5	2208.0	1556.4	2183.0	2184.0	2208.0	2209.0
Indicator value	1.7	1.6	0.8	0.9	1.7	2.6	1.7	1.6

Licensee Comments: none

# Unplanned Scrams with Complications




Thresholds: White > 1.0

**Notes**

Unplanned Scrams with Complications	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value			0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (BWR)

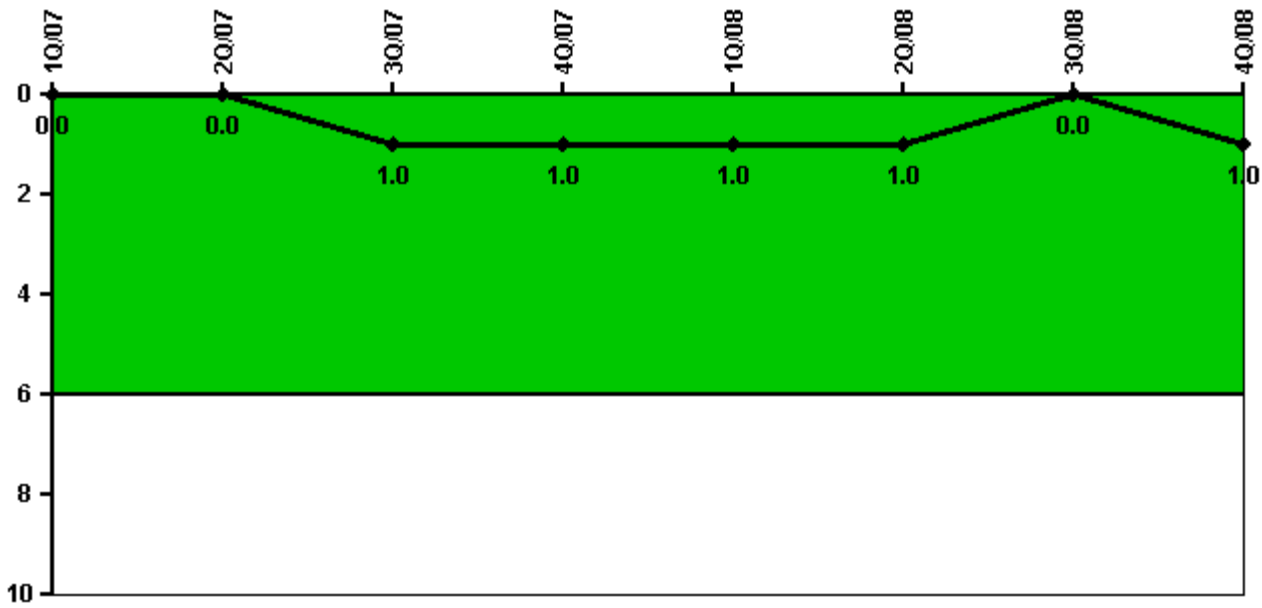

Thresholds: White > 6.0


### Notes

Safety System Functional Failures (BWR)	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Safety System Functional Failures	0	0	1	0	0	0	0	1
Indicator value	0	0	1	1	1	1	0	1

Licensee Comments:

4Q/08: LER 2008-003 was submitted in December. The LER included report of a SSFF, specifically a Nuclear Measurement Analysis and Control (NUMAC) drawer failure in the HPCI steam leak detection system.

# Mitigating Systems Performance Index, Emergency AC Power System

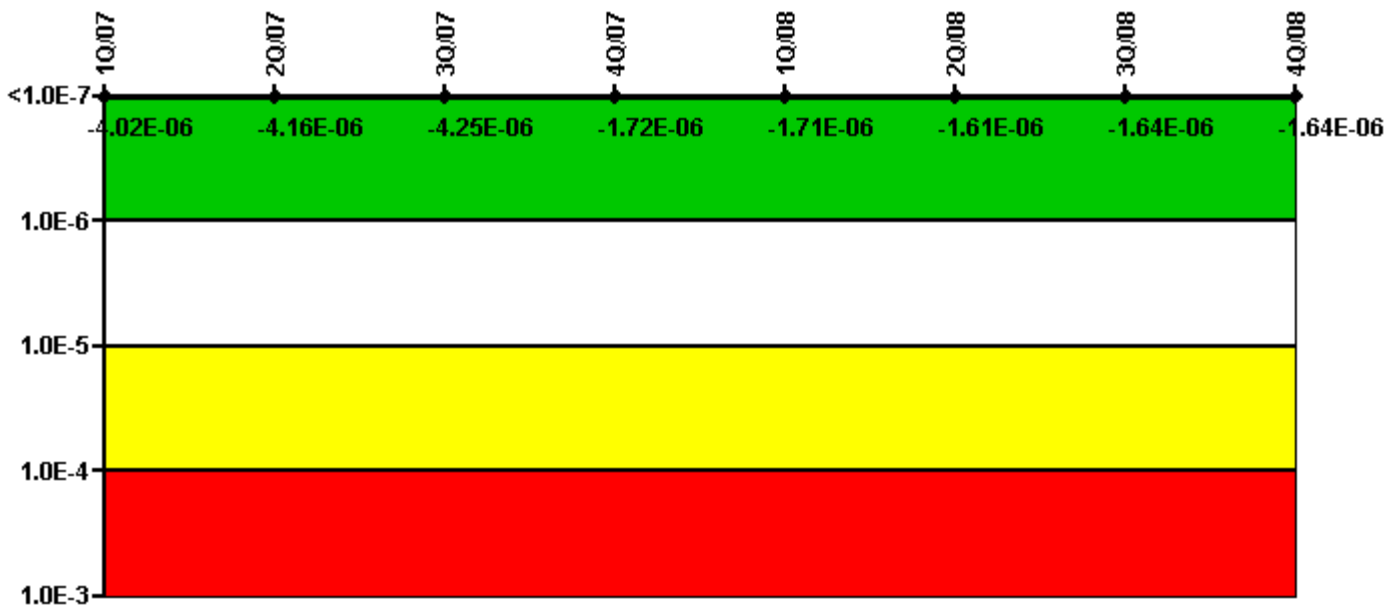

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI ( $\Delta$ CDF)	-2.40E-08	-5.70E-08	-2.50E-07	-1.20E-07	-1.10E-07	-1.10E-07	-1.40E-07	-1.40E-07
URI ( $\Delta$ CDF)	-4.00E-06	-4.10E-06	-4.00E-06	-1.60E-06	-1.60E-06	-1.50E-06	-1.50E-06	-1.50E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.02E-06	-4.16E-06	-4.25E-06	-1.72E-06	-1.71E-06	-1.61E-06	-1.64E-06	-1.64E-06

Licensee Comments:

4Q/08: Changed PRA Parameter(s). PRA parameters were changed due to anticipated MSPI Basis Document update. The basis document was NOT updated for the fourth quarter of 2008 and the PRA parameters were restored to match those in place from the third quarter of 2008.

# Mitigating Systems Performance Index, High Pressure Injection System

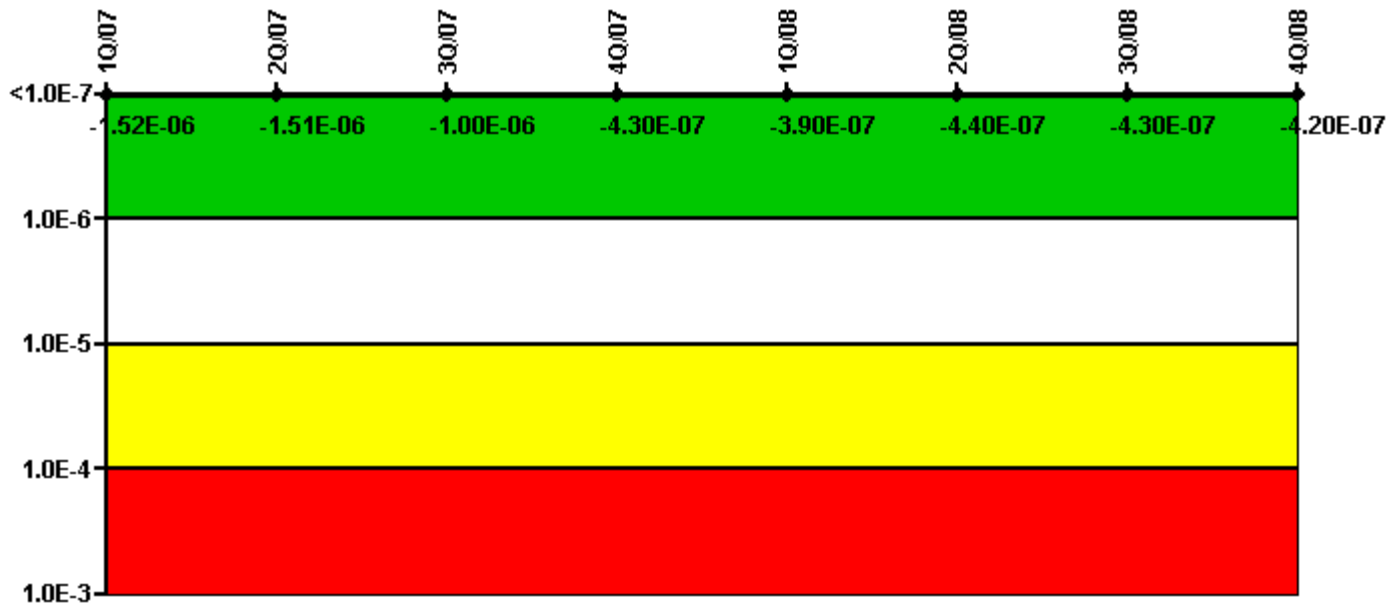

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI ( $\Delta$ CDF)	-5.20E-07	-5.10E-07	-3.30E-07	-1.40E-07	-1.40E-07	-1.40E-07	-1.60E-07	-1.50E-07
URI ( $\Delta$ CDF)	-1.00E-06	-1.00E-06	-6.70E-07	-2.90E-07	-2.50E-07	-3.00E-07	-2.70E-07	-2.70E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.52E-06	-1.51E-06	-1.00E-06	-4.30E-07	-3.90E-07	-4.40E-07	-4.30E-07	-4.20E-07

Licensee Comments:

4Q/08: Changed PRA Parameter(s). PRA parameters were changed due to anticipated MSPI Basis Document update. The basis document was NOT updated for the fourth quarter of 2008 and the PRA parameters were restored to match those in place from the third quarter of 2008.

## Mitigating Systems Performance Index, Heat Removal System

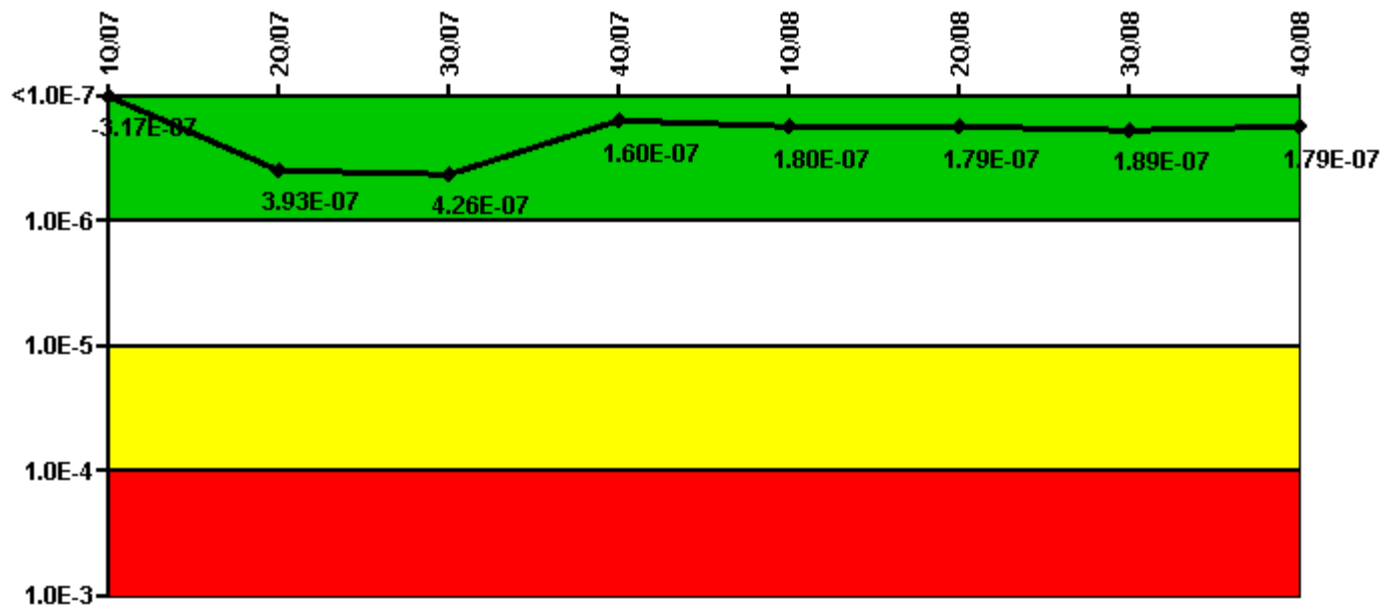

Thresholds: White >  $1.00E-6$  Yellow >  $1.00E-5$  Red >  $1.00E-4$


### Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI ( $\Delta$ CDF)	$-7.70E-08$	$-7.70E-08$	$-4.40E-08$	$-2.00E-08$	$-2.00E-08$	$-2.10E-08$	$-2.10E-08$	$-2.10E-08$
URI ( $\Delta$ CDF)	$-2.40E-07$	$4.70E-07$	$4.70E-07$	$1.80E-07$	$2.00E-07$	$2.00E-07$	$2.10E-07$	$2.00E-07$
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	$-3.17E-07$	$3.93E-07$	$4.26E-07$	$1.60E-07$	$1.80E-07$	$1.79E-07$	$1.89E-07$	$1.79E-07$

Licensee Comments:

4Q/08: Changed PRA Parameter(s). PRA parameters were changed due to anticipated MSPI Basis Document update. The basis document was NOT updated for the fourth quarter of 2008 and the PRA parameters were restored to match those in place from the third quarter of 2008.

## Mitigating Systems Performance Index, Residual Heat Removal System

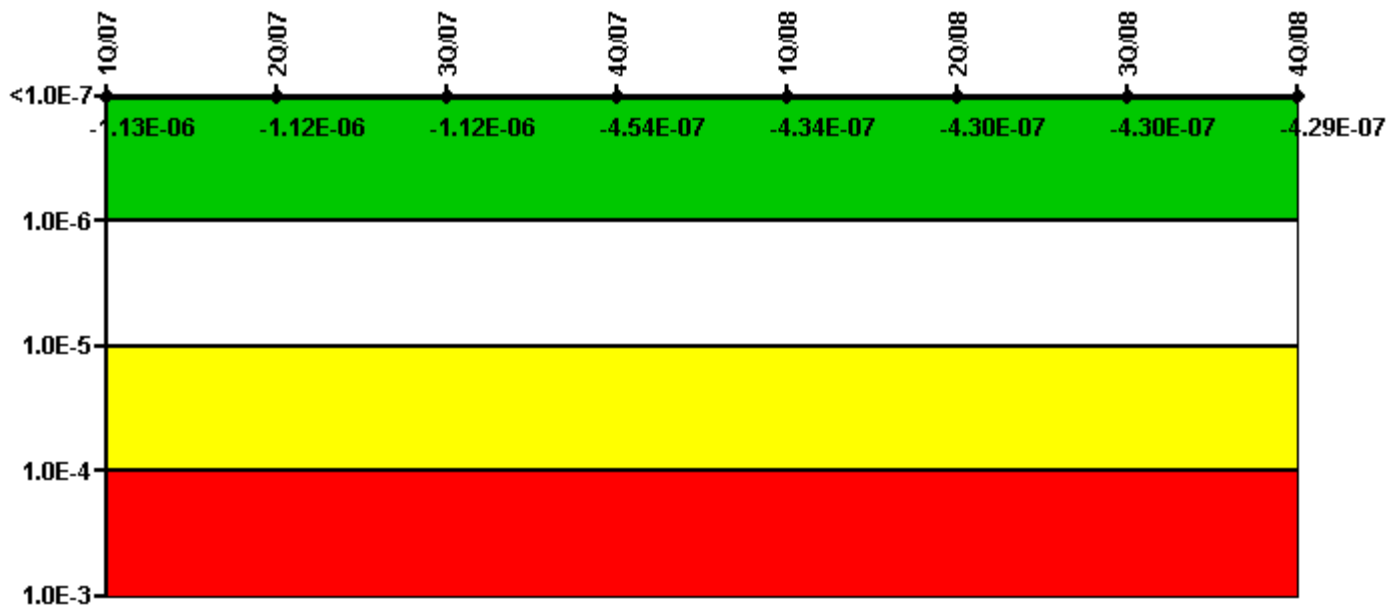

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

### Notes


Mitigating Systems Performance Index, Residual Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI ( $\Delta$ CDF)	-2.10E-07	-2.10E-07	-2.10E-07	-8.40E-08	-8.40E-08	-9.00E-08	-9.00E-08	-9.90E-08
URI ( $\Delta$ CDF)	-9.20E-07	-9.10E-07	-9.10E-07	-3.70E-07	-3.50E-07	-3.40E-07	-3.40E-07	-3.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.13E-06	-1.12E-06	-1.12E-06	-4.54E-07	-4.34E-07	-4.30E-07	-4.30E-07	-4.29E-07

Licensee Comments:

4Q/08: Changed PRA Parameter(s). PRA parameters were changed due to anticipated MSPI Basis Document update. The basis document was NOT updated for the fourth quarter of 2008 and the PRA parameters were restored to match those in place from the third quarter of 2008.



# Mitigating Systems Performance Index, Cooling Water Systems

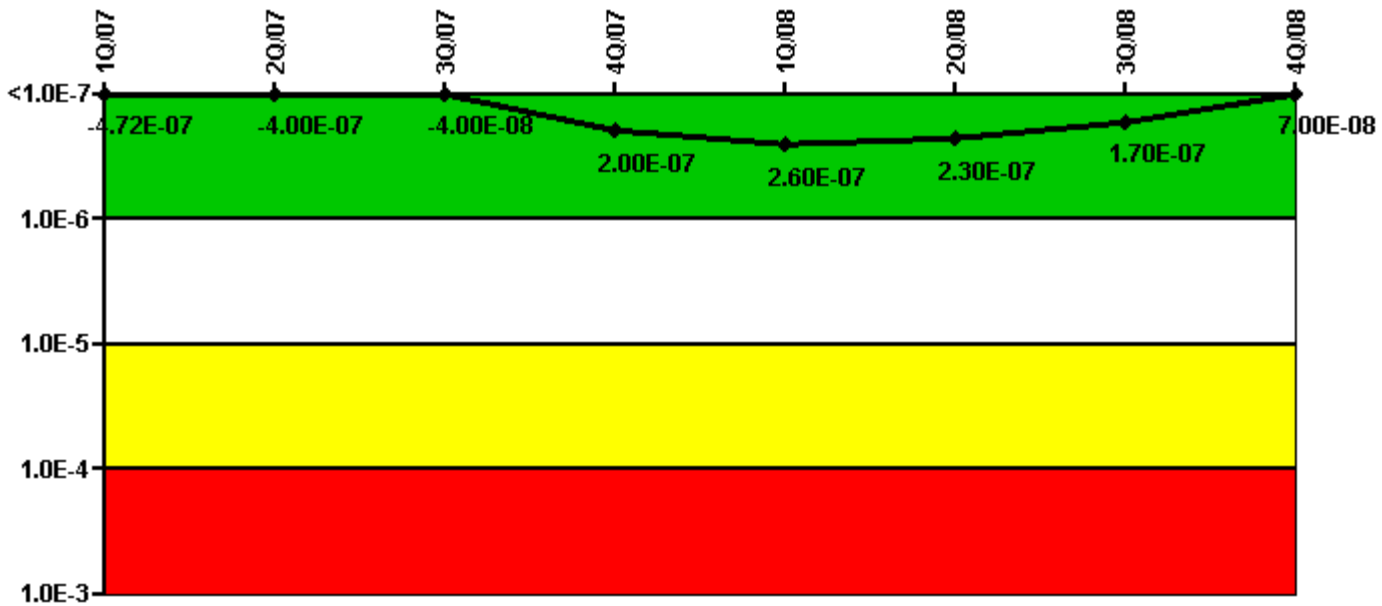

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (ΔCDF)	-3.20E-08	1.60E-07	6.60E-07	4.90E-07	5.60E-07	5.20E-07	4.70E-07	3.70E-07
URI (ΔCDF)	-4.40E-07	-5.60E-07	-7.00E-07	-2.90E-07	-3.00E-07	-2.90E-07	-3.00E-07	-3.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.72E-07	-4.00E-07	-4.00E-08	2.00E-07	2.60E-07	2.30E-07	1.70E-07	7.00E-08

Licensee Comments:

4Q/08: Changed PRA Parameter(s). PRA parameters were changed due to anticipated MSPI Basis Document update. The basis document was NOT updated for the fourth quarter of 2008 and the PRA parameters were restored to match those in place from the third quarter of 2008.

## Reactor Coolant System Activity

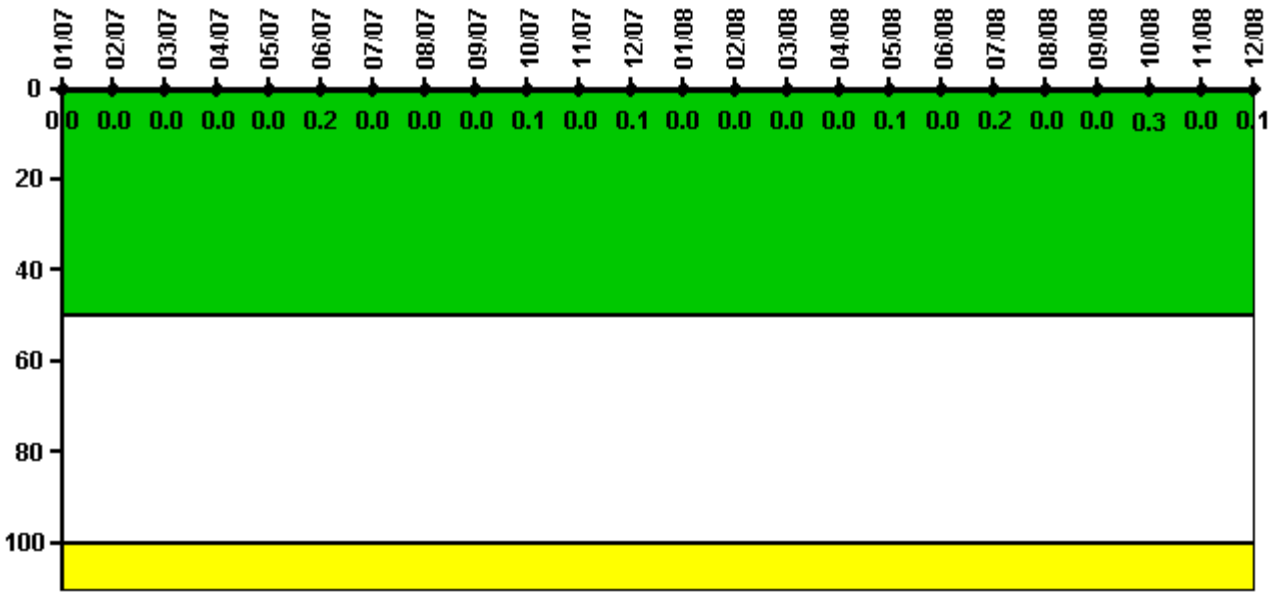

Thresholds: White > 50.0 Yellow > 100.0

### Notes


Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000044	0.000050	0.000049	0.000083	0.000055	0.000406	0.000094	0.000064	0.000074	0.000143	0.000069	0.000101
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0.2	0	0	0	0.1	0	0.1

Reactor Coolant System Activity	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum activity	0.000068	0.000061	0.000074	0.000075	0.000116	0.000076	0.000403	0.000087	0.000076	0.000570	0.000076	0.000133
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0.1	0	0.2	0	0	0.3	0	0.1

Licensee Comments: none

## Reactor Coolant System Leakage

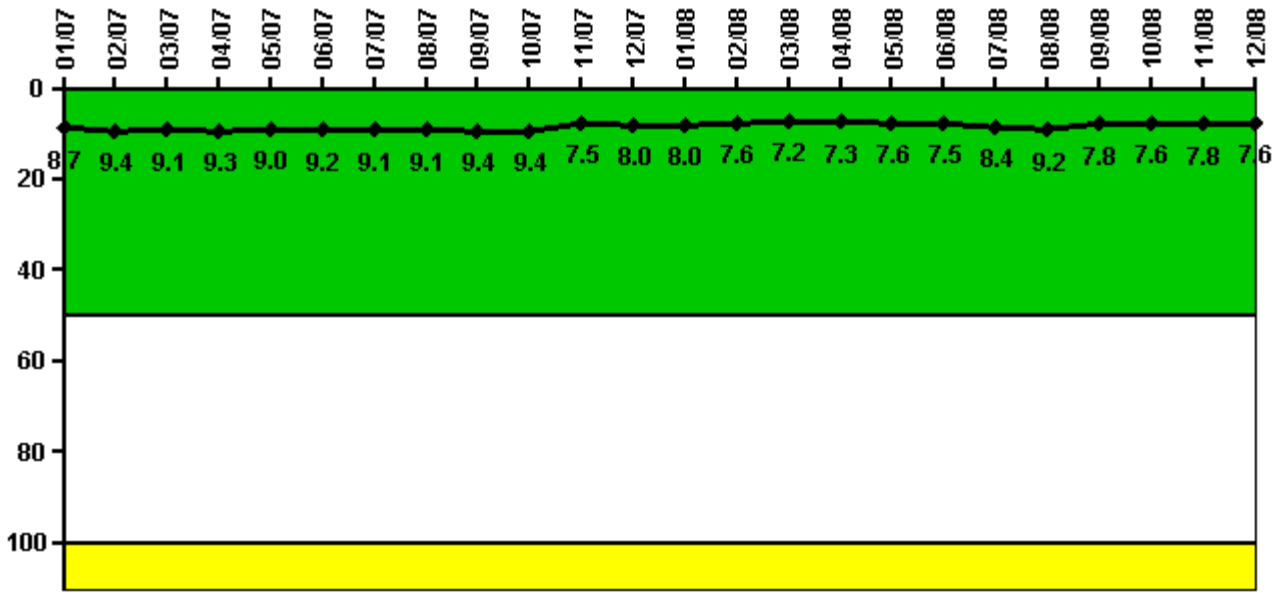


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	2.177	2.350	2.270	2.327	2.240	2.300	2.287	2.277	2.360	2.360	1.870	2.010
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	8.7	9.4	9.1	9.3	9.0	9.2	9.1	9.1	9.4	9.4	7.5	8.0
Reactor Coolant System Leakage	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum leakage	1.990	1.890	1.800	1.820	1.900	1.880	2.100	2.310	1.950	1.900	1.940	1.910
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	8.0	7.6	7.2	7.3	7.6	7.5	8.4	9.2	7.8	7.6	7.8	7.6

Licensee Comments: none

## Drill/Exercise Performance

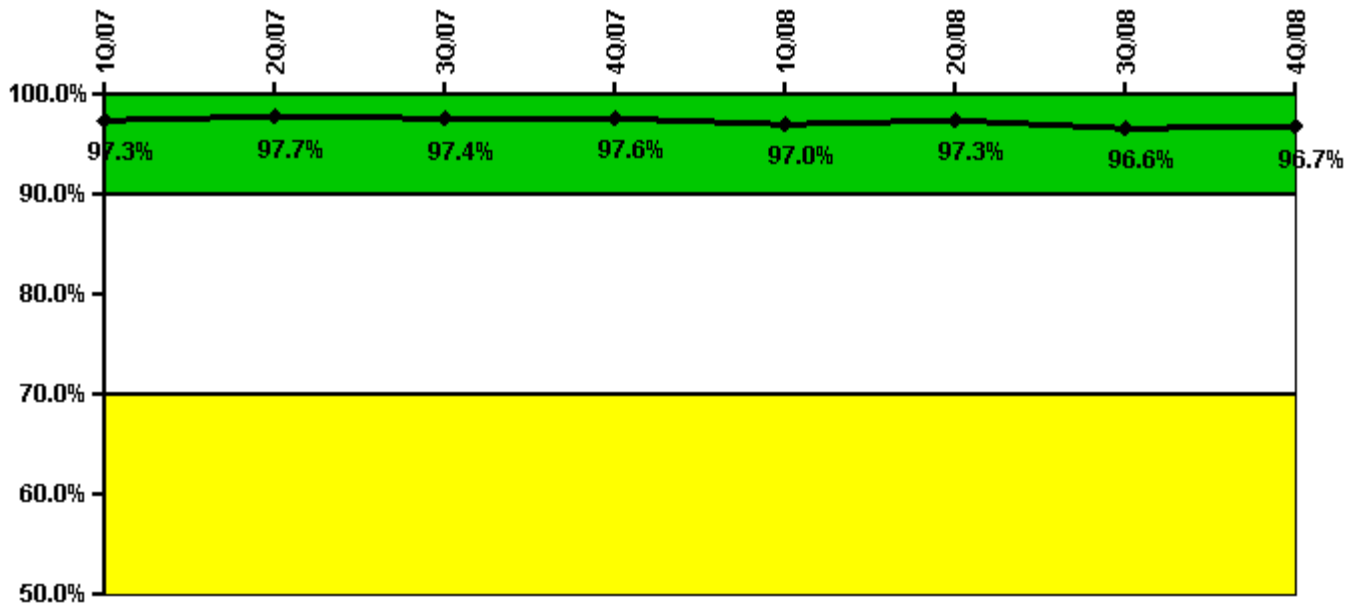


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful opportunities	24.0	20.0	50.0	56.0	32.0	35.0	67.0	72.0
Total opportunities	24.0	20.0	52.0	58.0	34.0	36.0	70.0	74.0
Indicator value	97.3%	97.7%	97.4%	97.6%	97.0%	97.3%	96.6%	96.7%

Licensee Comments: none

## ERO Drill Participation

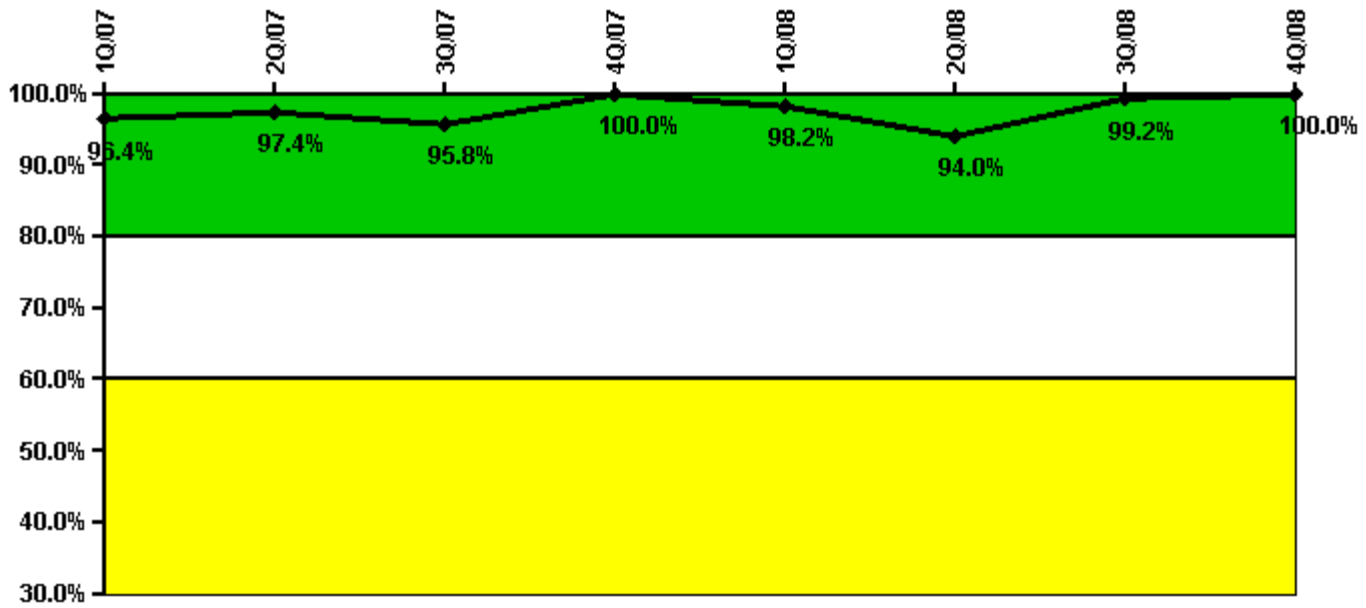


**Thresholds:** White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Participating Key personnel	106.0	113.0	113.0	115.0	109.0	109.0	120.0	123.0
Total Key personnel	110.0	116.0	118.0	115.0	111.0	116.0	121.0	123.0
Indicator value	96.4%	97.4%	95.8%	100.0%	98.2%	94.0%	99.2%	100.0%

Licensee Comments: none

## Alert & Notification System

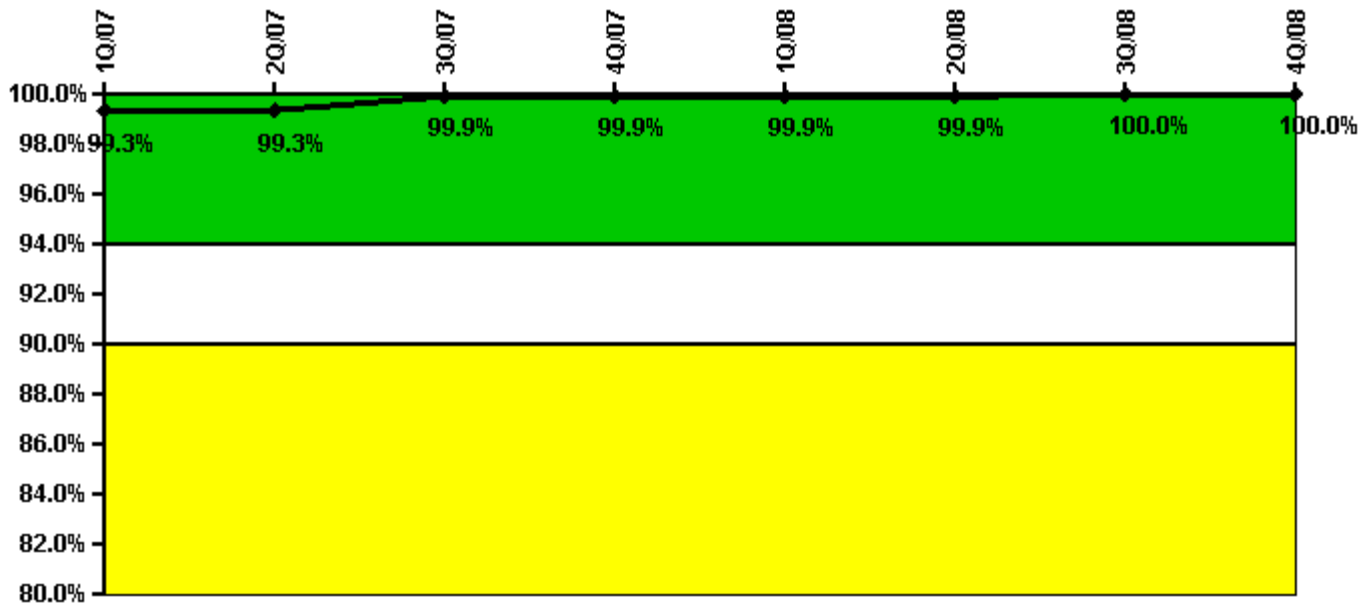

Thresholds: White < 94.0% Yellow < 90.0%

### Notes

Alert & Notification System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful siren-tests	497	497	496	497	497	497	497	497
Total sirens-tests	497	497	497	497	497	497	497	497
Indicator value	99.3%	99.3%	99.9%	99.9%	99.9%	99.9%	100.0%	100.0%

Licensee Comments: none

## Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

### Notes

Occupational Exposure Control Effectiveness	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.