


Nine Mile Point 1

4Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

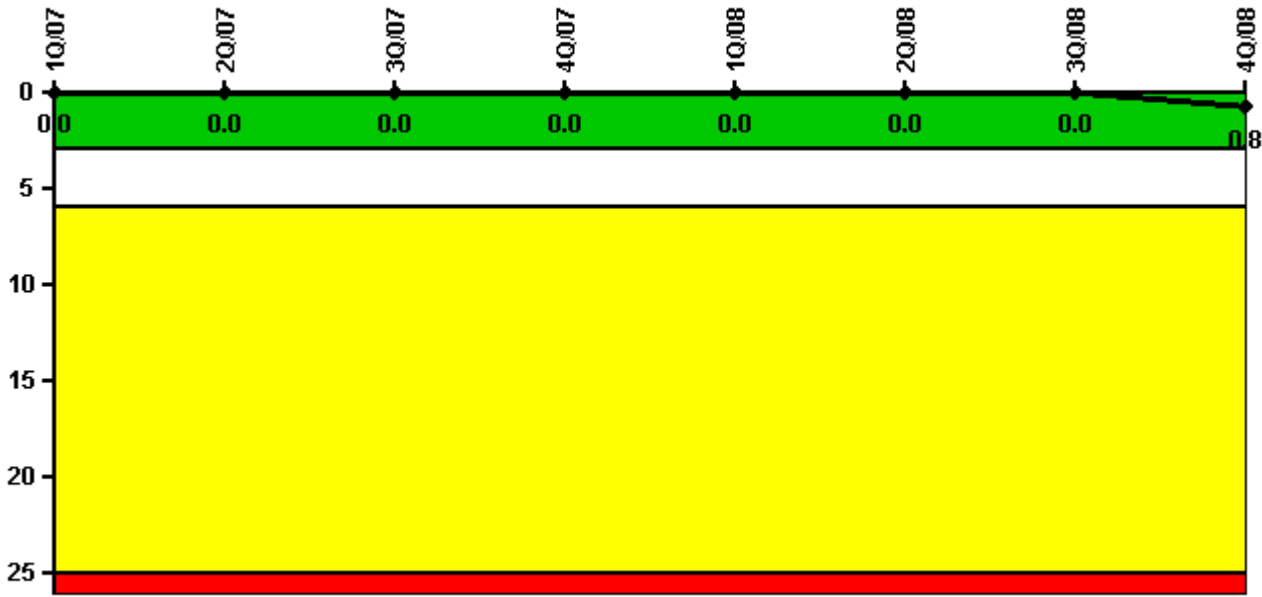


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned scrams	0	0	0	0	0	0	0	1.0
Critical hours	1801.6	1740.3	2208.0	2209.0	2183.0	2184.0	2208.0	2149.7
Indicator value	0	0	0	0	0	0	0	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

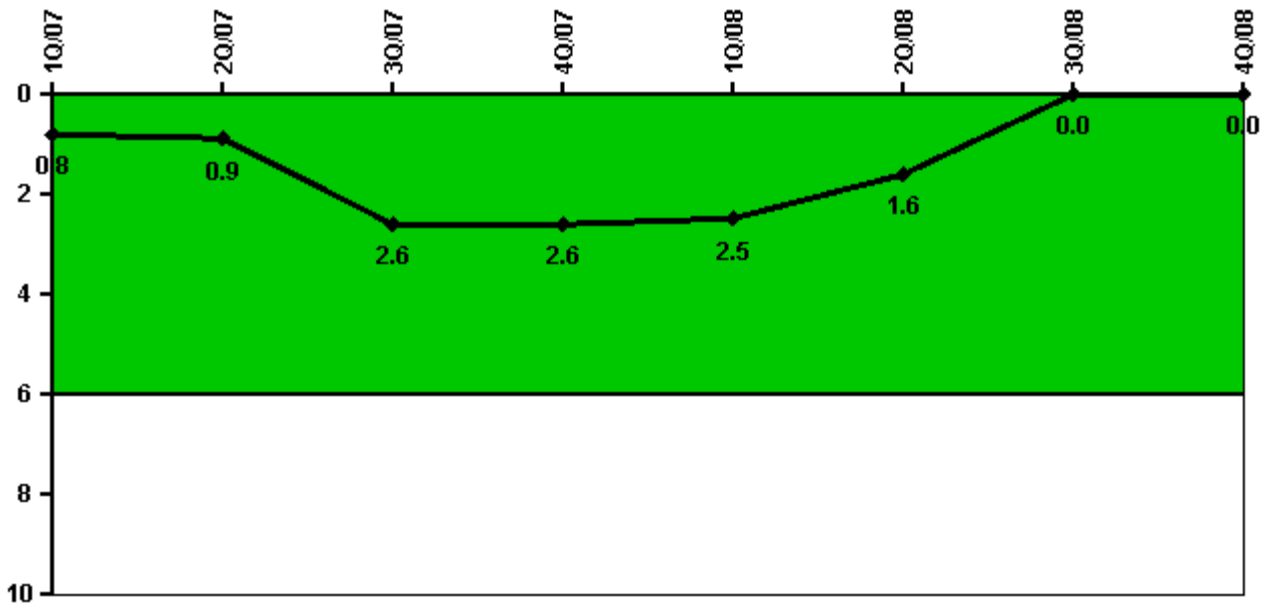


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned power changes	0	1.0	2.0	0	0	0	0	0
Critical hours	1801.6	1740.3	2208.0	2209.0	2183.0	2184.0	2208.0	2149.7
Indicator value	0.8	0.9	2.6	2.6	2.5	1.6	0	0

Licensee Comments: none

Unplanned Scrams with Complications

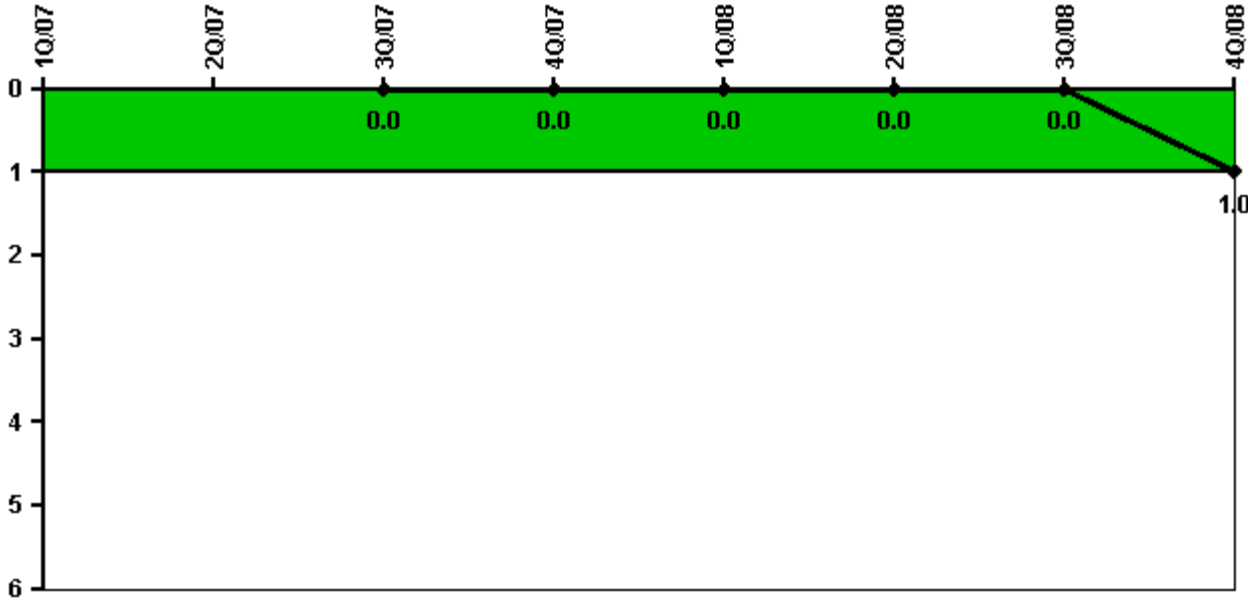


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Scrams with complications	0	0	0	0	0	0	0	1.0
Indicator value			0.0	0.0	0.0	0.0	0.0	1.0

Licensee Comments: none

Safety System Functional Failures (BWR)

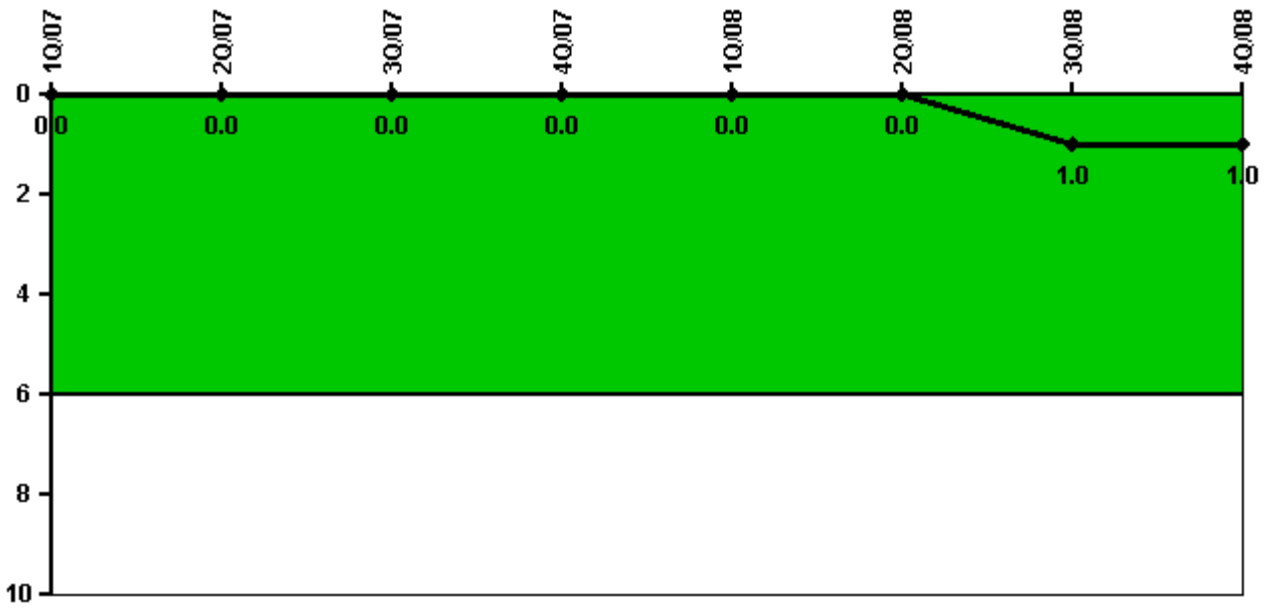


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Safety System Functional Failures	0	0	0	0	0	0	1	0
Indicator value	0	0	0	0	0	0	1	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

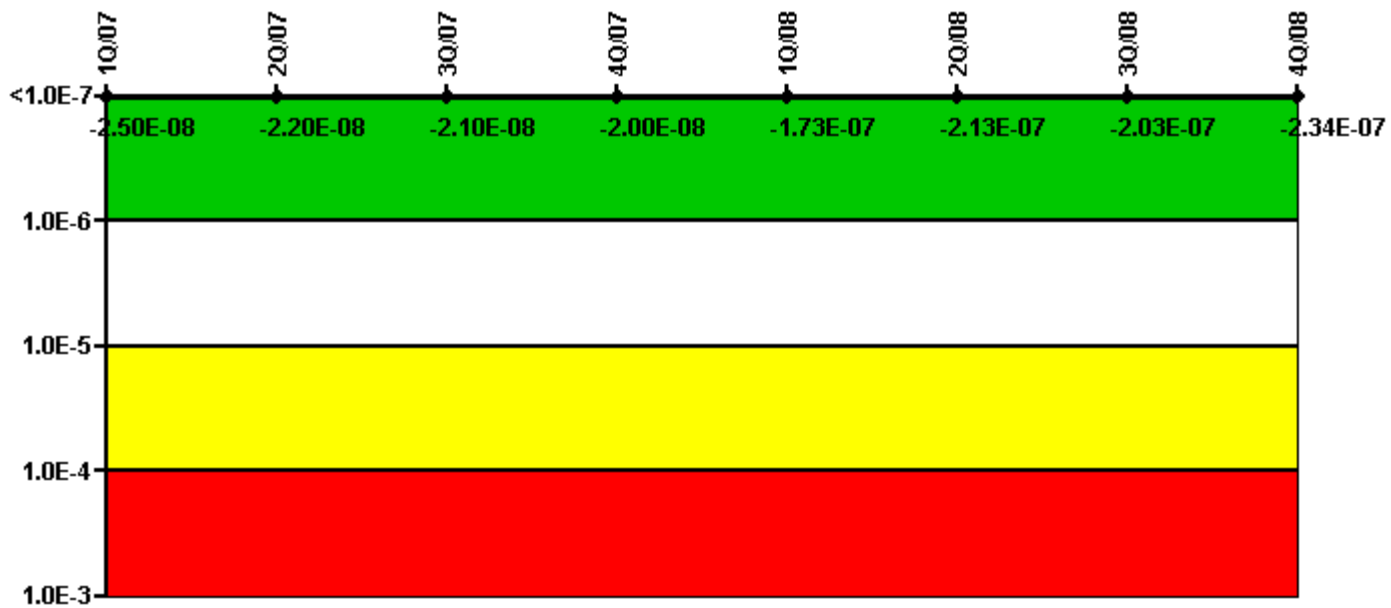

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	4.40E-08	4.50E-08	4.50E-08	4.50E-08	3.70E-08	-3.00E-09	-3.00E-09	-4.40E-08
URI (Δ CDF)	-6.90E-08	-6.70E-08	-6.60E-08	-6.50E-08	-2.10E-07	-2.10E-07	-2.00E-07	-1.90E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-08	-2.20E-08	-2.10E-08	-2.00E-08	-1.73E-07	-2.13E-07	-2.03E-07	-2.34E-07

Licensee Comments:

3Q/06: PRA change for the 4th Quarter 2006 was incorrectly applied to the 3rd Quarter 2006. Correction does not alter PI color.

2Q/06: PRA change for the 4th Quarter 2006 was incorrectly applied to the 2nd Quarter 2006. Correction does not alter PI color.

Mitigating Systems Performance Index, High Pressure Injection System

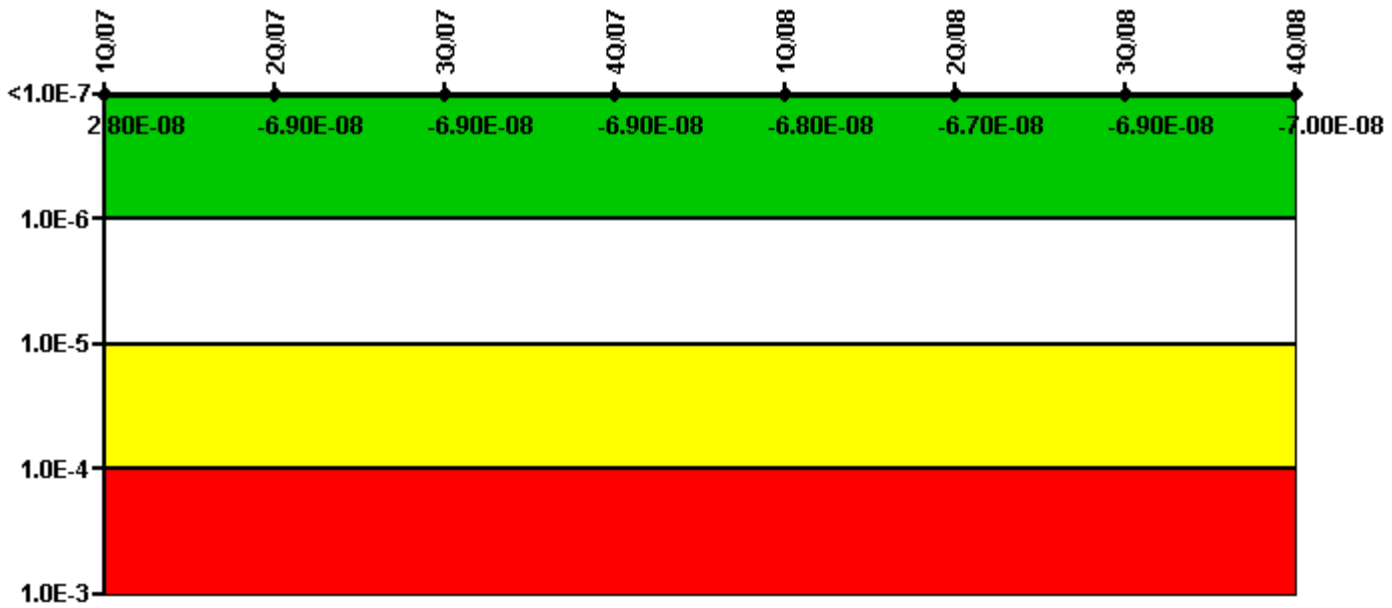


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	$-4.10E-08$	$-5.20E-08$	$-5.20E-08$	$-5.20E-08$	$-5.20E-08$	$-5.30E-08$	$-5.60E-08$	$-5.60E-08$
URI (Δ CDF)	$6.90E-08$	$-1.70E-08$	$-1.70E-08$	$-1.70E-08$	$-1.60E-08$	$-1.40E-08$	$-1.30E-08$	$-1.40E-08$
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	$2.80E-08$	$-6.90E-08$	$-6.90E-08$	$-6.90E-08$	$-6.80E-08$	$-6.70E-08$	$-6.90E-08$	$-7.00E-08$

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

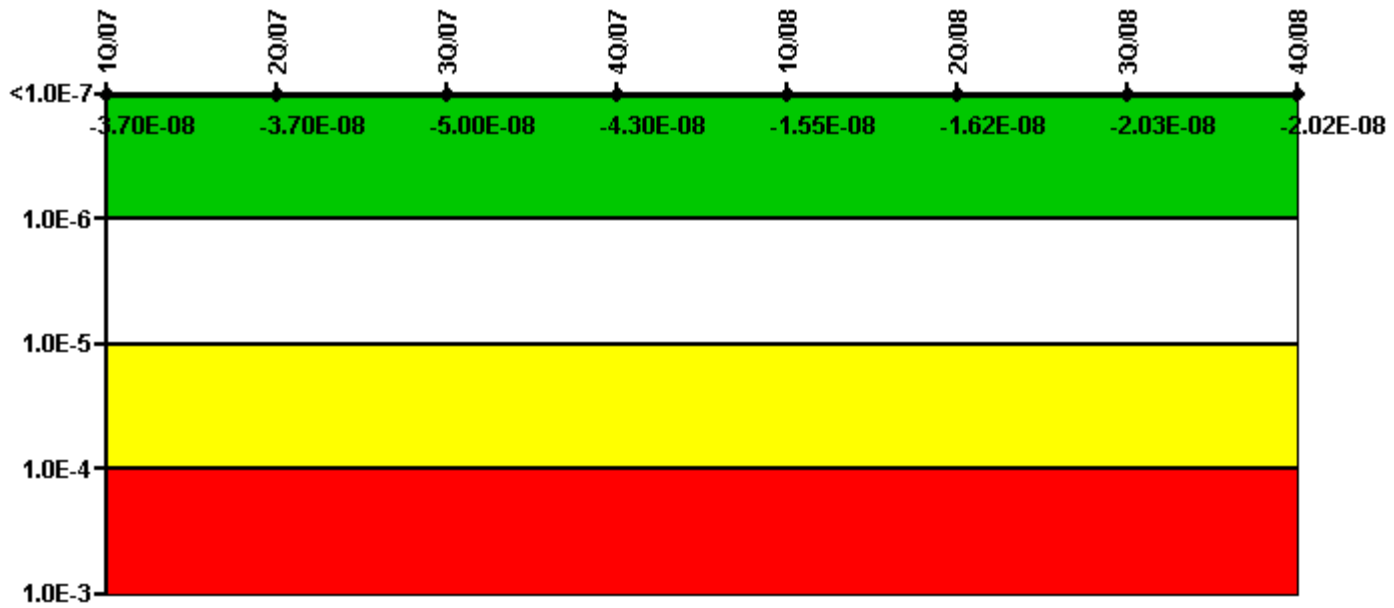


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	-2.40E-08	-2.40E-08	-3.70E-08	-3.00E-08	-2.50E-09	-4.20E-09	-8.30E-09	-8.20E-09
URI (Δ CDF)	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.20E-08	-1.20E-08	-1.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.70E-08	-3.70E-08	-5.00E-08	-4.30E-08	-1.55E-08	-1.62E-08	-2.03E-08	-2.02E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

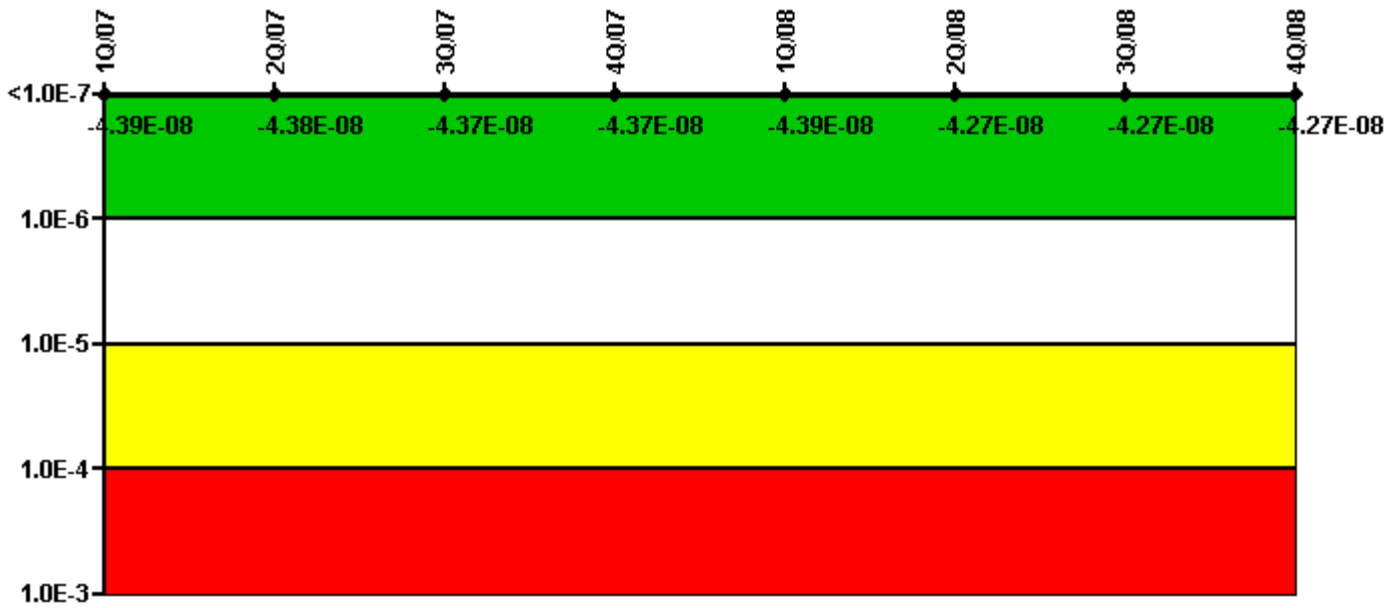


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (ΔCDF)	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08
URI (ΔCDF)	-8.90E-09	-8.80E-09	-8.70E-09	-8.70E-09	-8.90E-09	-7.70E-09	-7.70E-09	-7.70E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.39E-08	-4.38E-08	-4.37E-08	-4.37E-08	-4.39E-08	-4.27E-08	-4.27E-08	-4.27E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

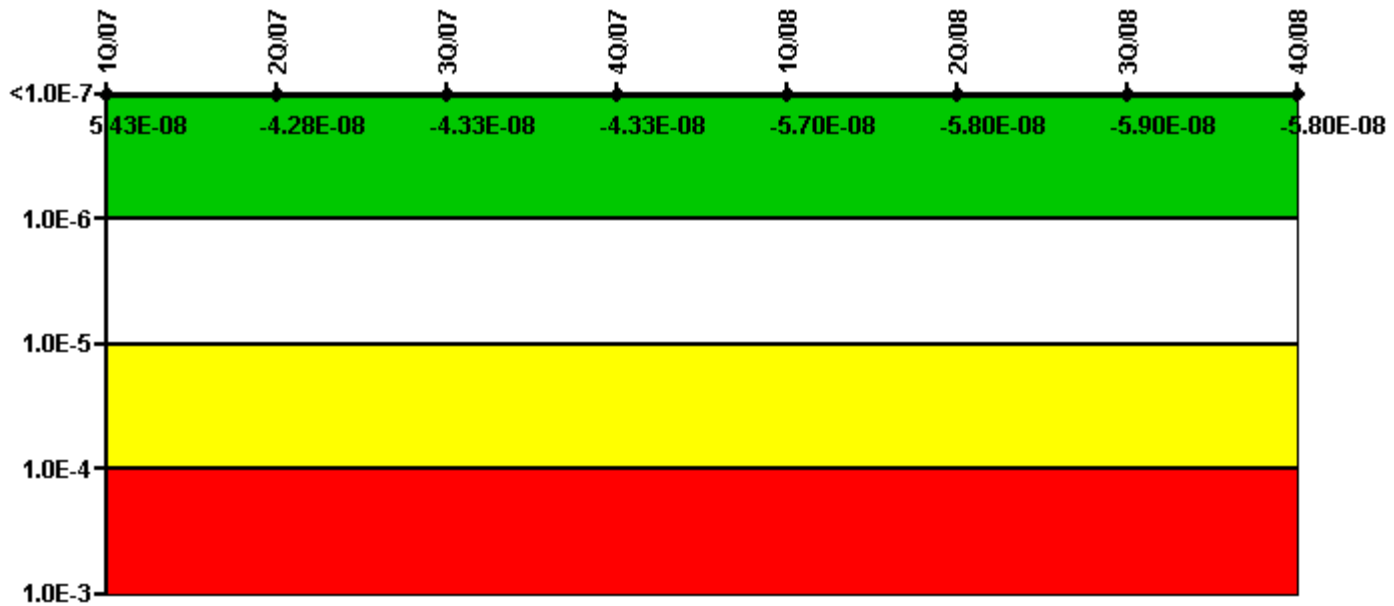


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	6.30E-09	-5.80E-09	-6.30E-09	-6.30E-09	-2.00E-08	-2.30E-08	-2.40E-08	-2.30E-08
URI (Δ CDF)	4.80E-08	-3.70E-08	-3.70E-08	-3.70E-08	-3.70E-08	-3.50E-08	-3.50E-08	-3.50E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	5.43E-08	-4.28E-08	-4.33E-08	-4.33E-08	-5.70E-08	-5.80E-08	-5.90E-08	-5.80E-08

Licensee Comments: none

Reactor Coolant System Activity

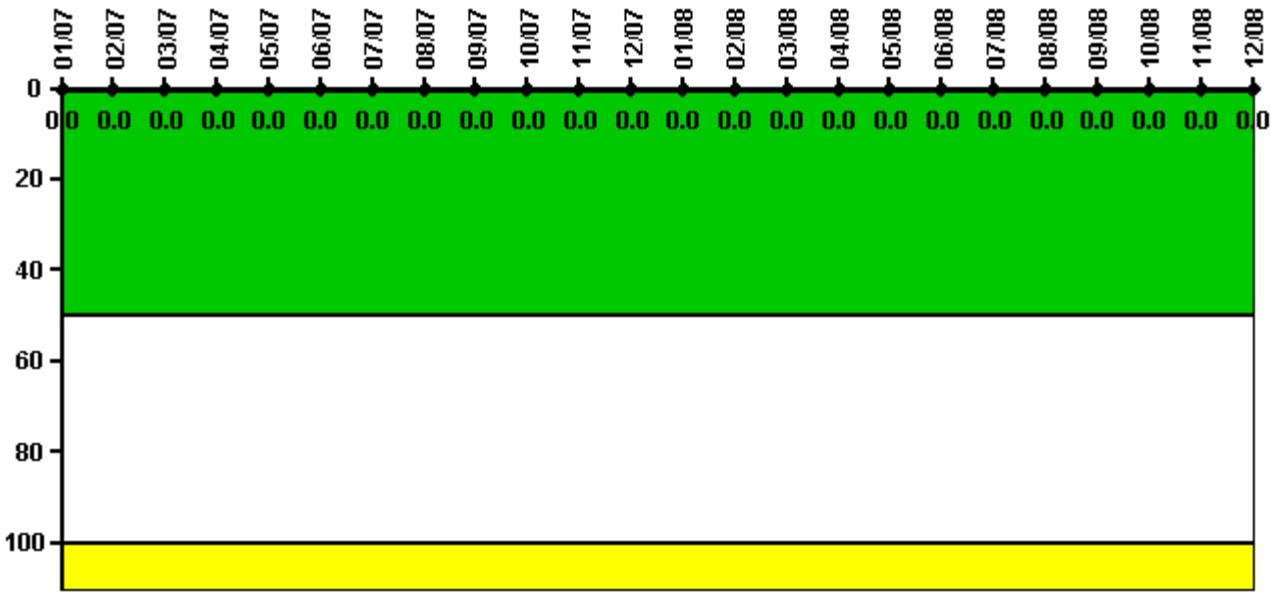

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000117	0.000152	0.000080	0.000138	0.000069	0.000067	0.000053	0.000080	0.000147	0.000179	0.000156	0.000161
Technical specification limit	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum activity	0.000172	0.000124	0.000177	0.000199	0.000012	0.000008	0.000007	0.000008	0.000012	0.000010	0.000007	0.000006
Technical specification limit	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

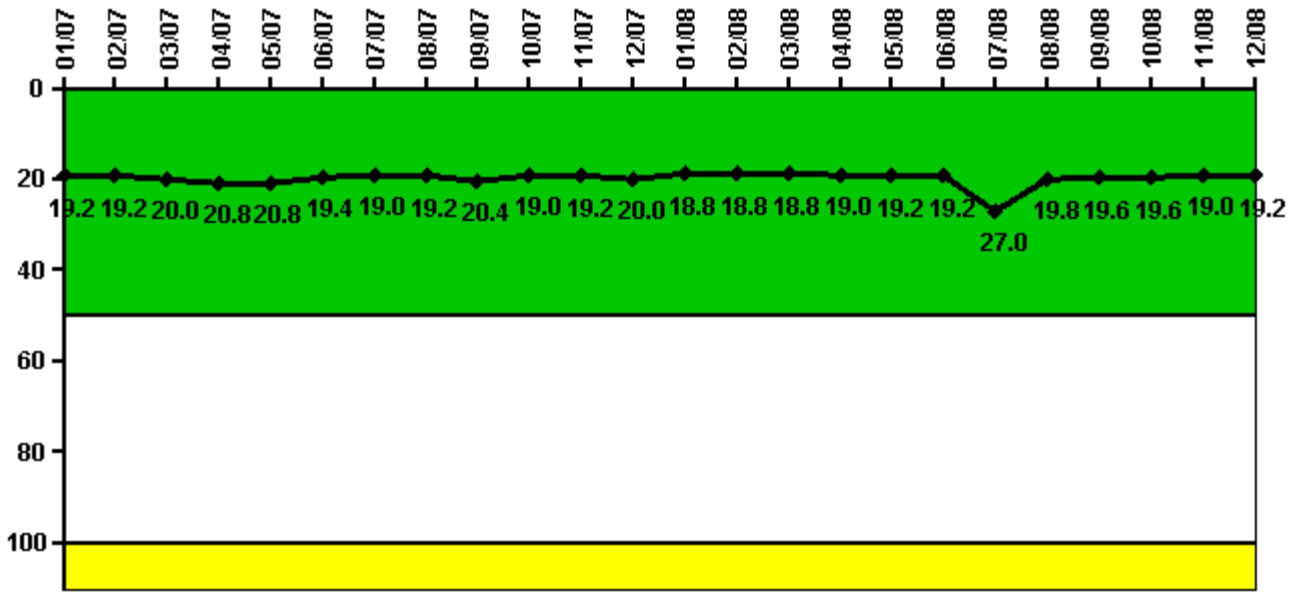

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	4.800	4.800	5.000	5.200	5.200	4.850	4.750	4.800	5.100	4.750	4.800	5.000
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	19.2	19.2	20.0	20.8	20.8	19.4	19.0	19.2	20.4	19.0	19.2	20.0

Reactor Coolant System Leakage	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum leakage	4.700	4.700	4.700	4.750	4.800	4.800	6.750	4.950	4.900	4.900	4.750	4.800
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	18.8	18.8	18.8	19.0	19.2	19.2	27.0	19.8	19.6	19.6	19.0	19.2

Licensee Comments: none

Drill/Exercise Performance

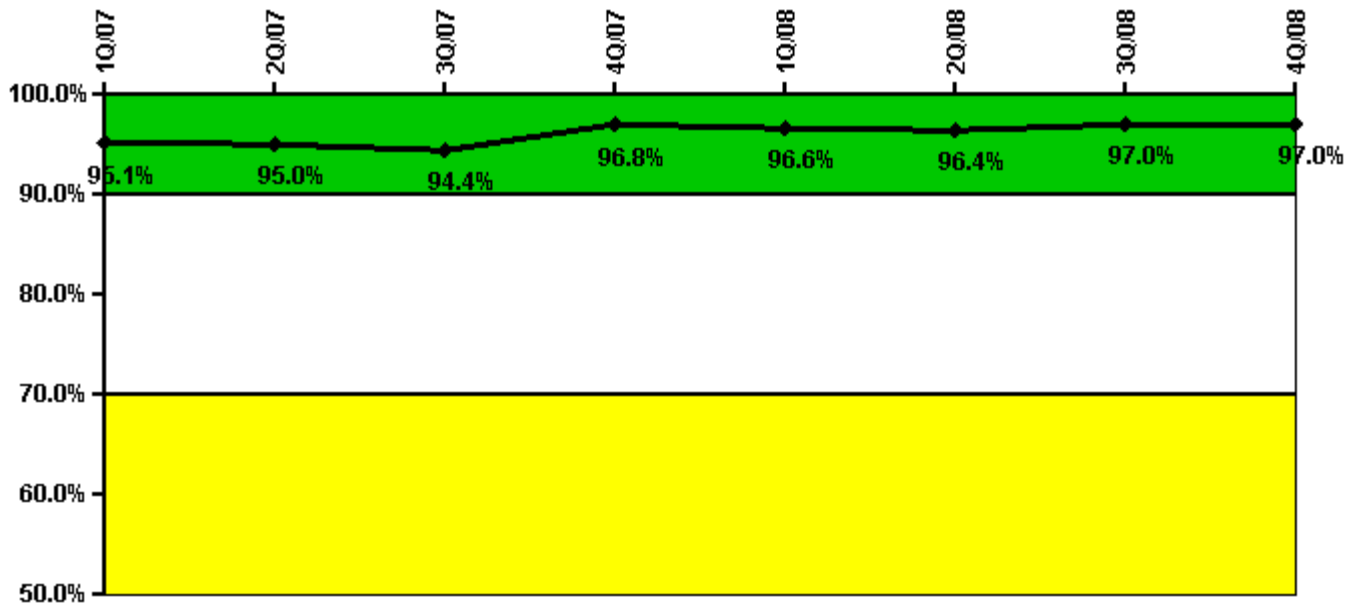


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful opportunities	41.0	27.0	35.0	318.0	31.0	38.0	75.0	117.0
Total opportunities	43.0	30.0	39.0	318.0	34.0	40.0	78.0	121.0
Indicator value	95.1%	95.0%	94.4%	96.8%	96.6%	96.4%	97.0%	97.0%

Licensee Comments: none

ERO Drill Participation

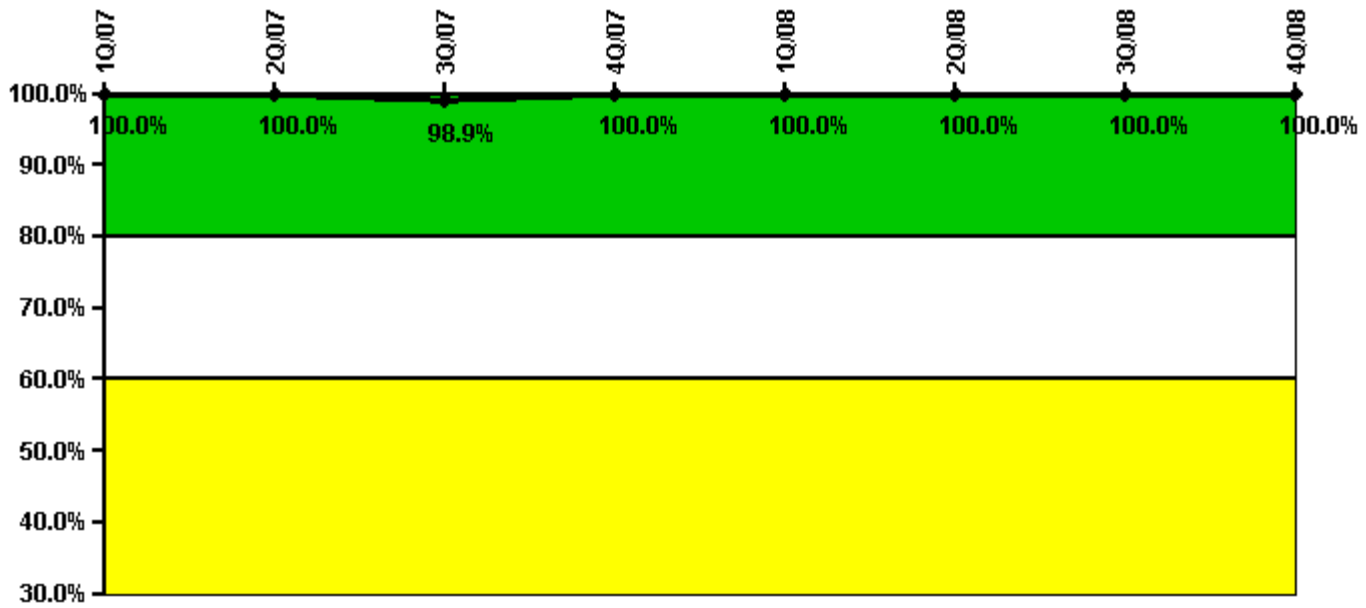


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Participating Key personnel	97.0	97.0	94.0	93.0	90.0	91.0	95.0	93.0
Total Key personnel	97.0	97.0	95.0	93.0	90.0	91.0	95.0	93.0
Indicator value	100.0%	100.0%	98.9%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

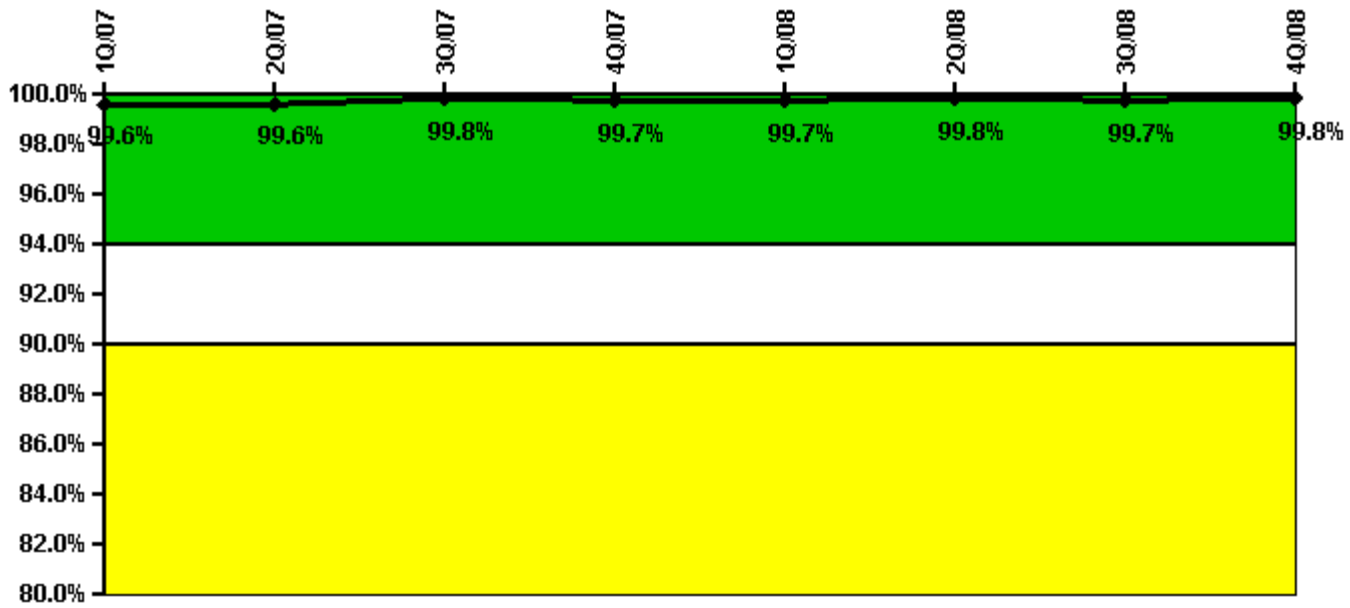

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful siren-tests	296	221	296	257	296	222	295	295
Total sirens-tests	296	222	296	259	296	222	296	296
Indicator value	99.6%	99.6%	99.8%	99.7%	99.7%	99.8%	99.7%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.