


La Salle 2

1Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

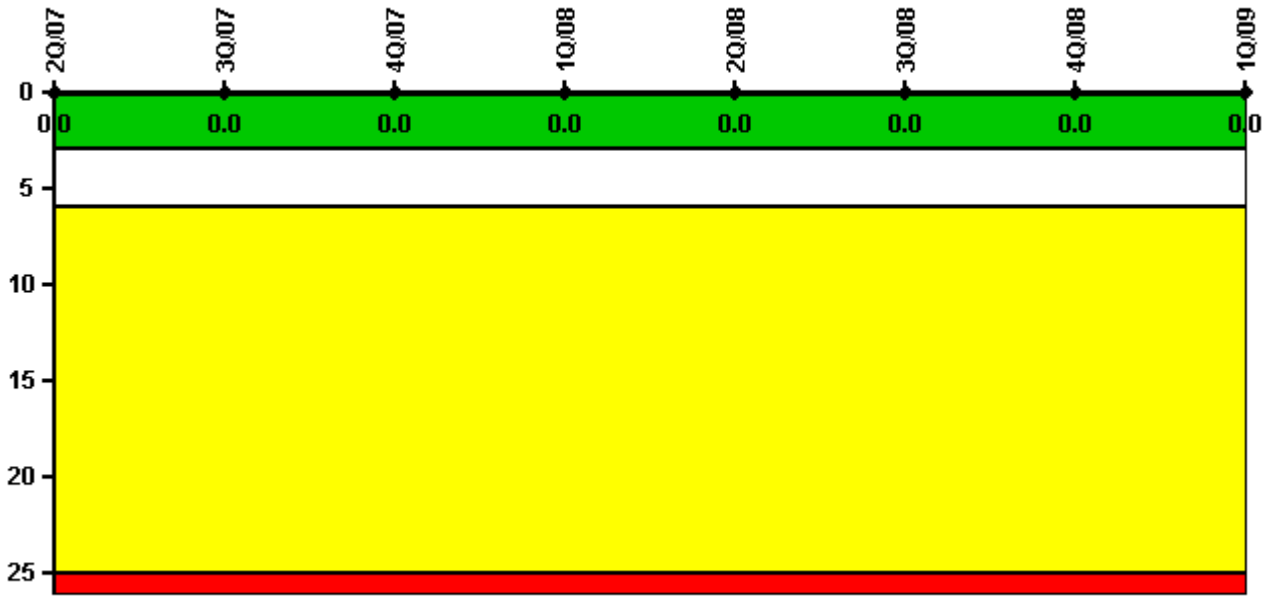


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2208.0 | 2209.0 | 2183.0 | 2184.0 | 2208.0 | 2209.0 | 1653.2 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

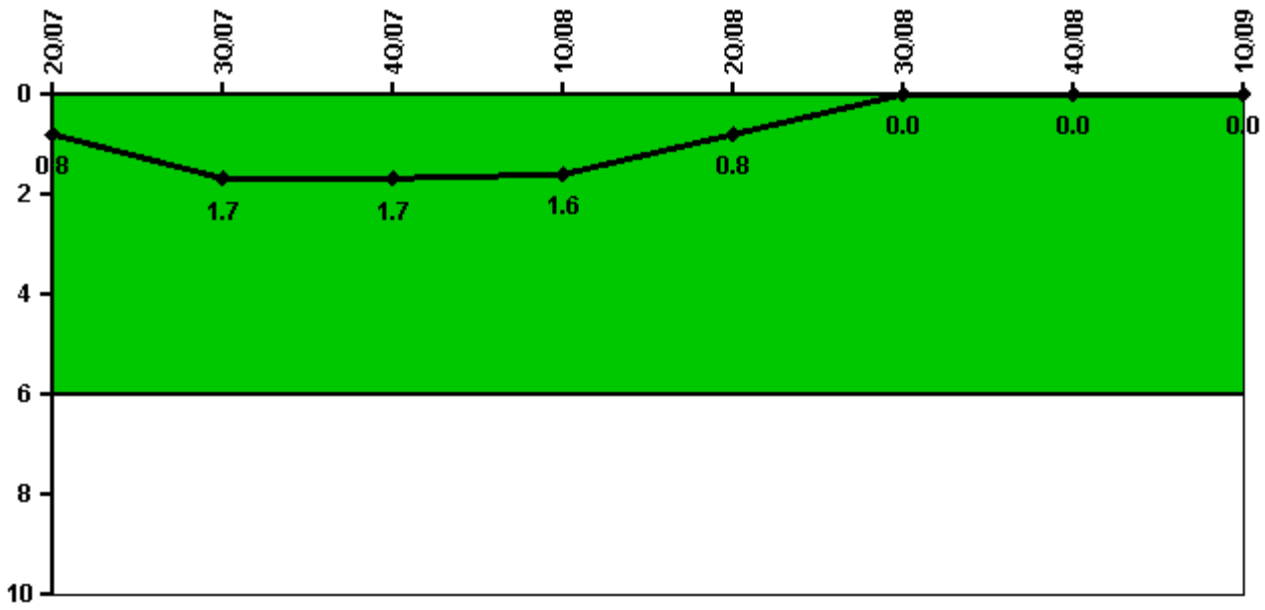


Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 1.0 | 1.0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2208.0 | 2209.0 | 2183.0 | 2184.0 | 2208.0 | 2209.0 | 1653.2 |
| Indicator value | 0.8 | 1.7 | 1.7 | 1.6 | 0.8 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Scrams with Complications

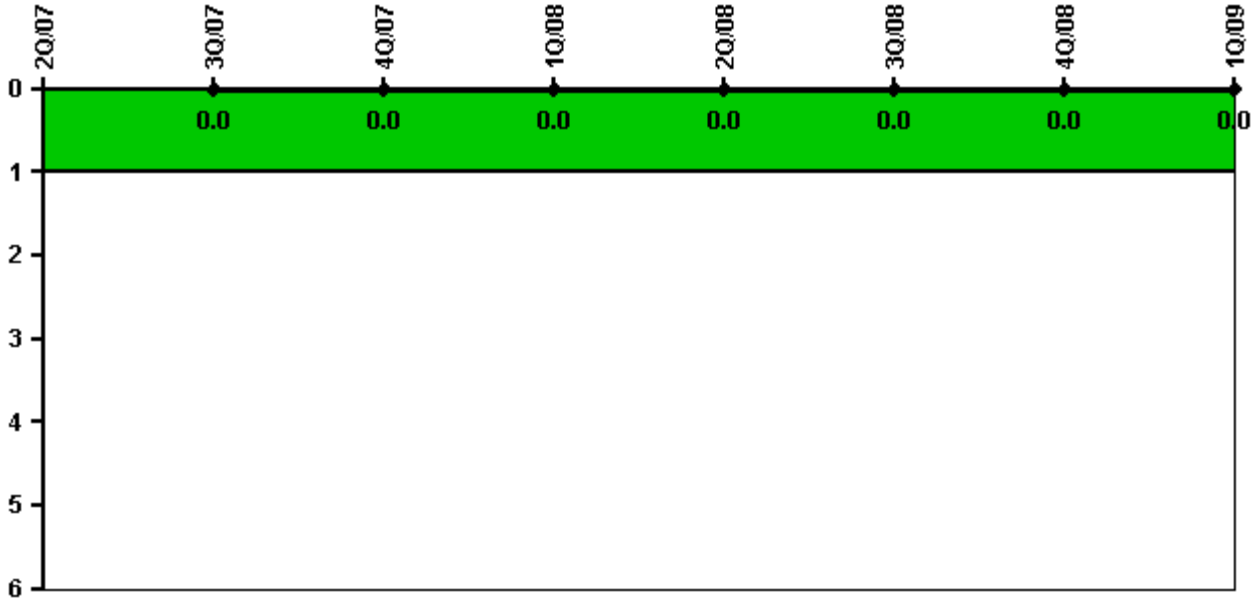


Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|-------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (BWR)

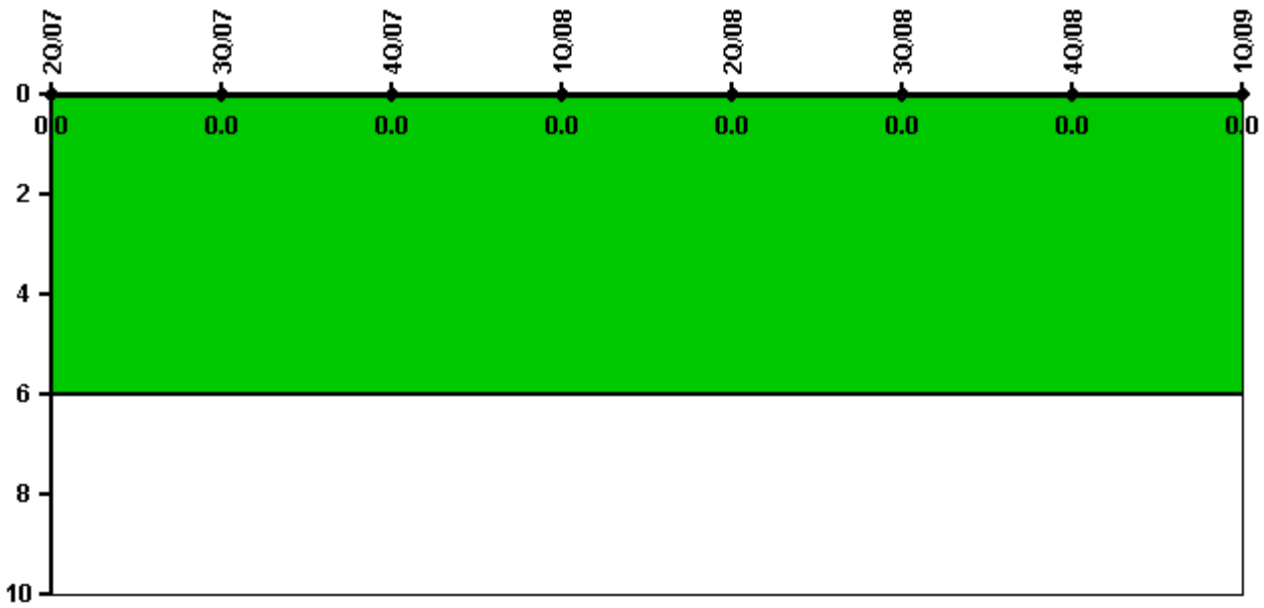


Thresholds: White > 6.0

Notes

| Safety System Functional Failures (BWR) | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

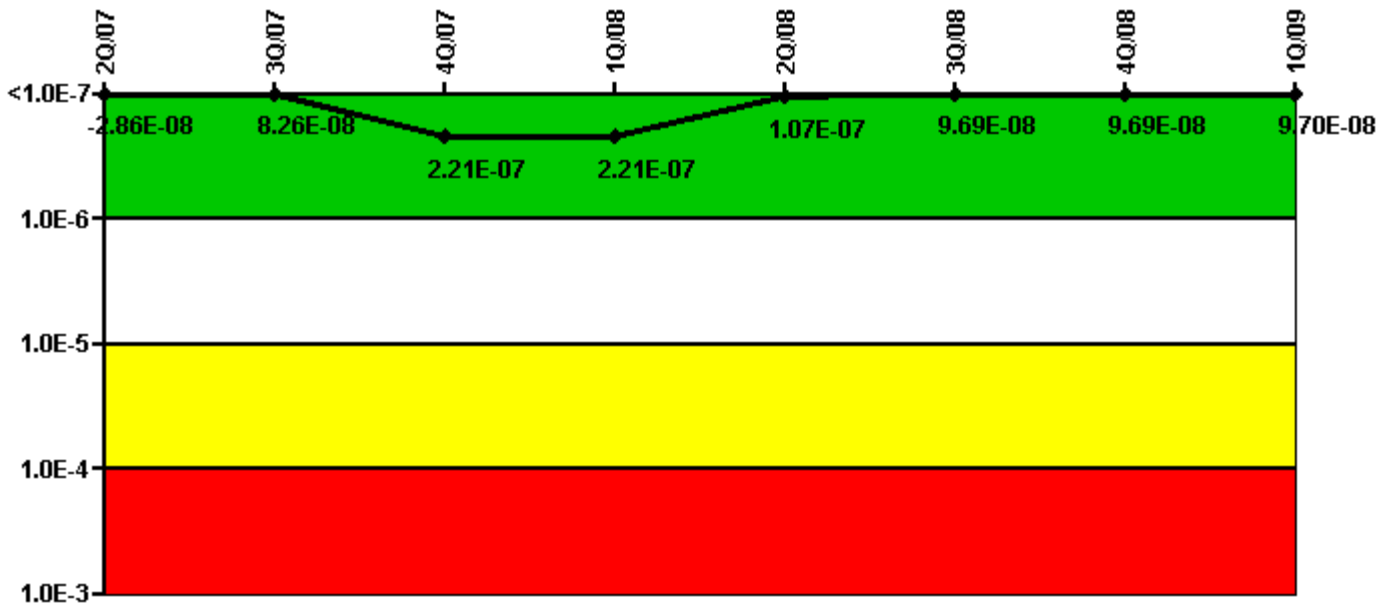


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (ΔCDF) | -2.60E-09 | -2.40E-09 | -9.00E-09 | -9.30E-09 | -3.10E-09 | -3.10E-09 | -3.10E-09 | -3.00E-09 |
| URI (ΔCDF) | -2.60E-08 | 8.50E-08 | 2.30E-07 | 2.30E-07 | 1.10E-07 | 1.00E-07 | 1.00E-07 | 1.00E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.86E-08 | 8.26E-08 | 2.21E-07 | 2.21E-07 | 1.07E-07 | 9.69E-08 | 9.69E-08 | 9.70E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

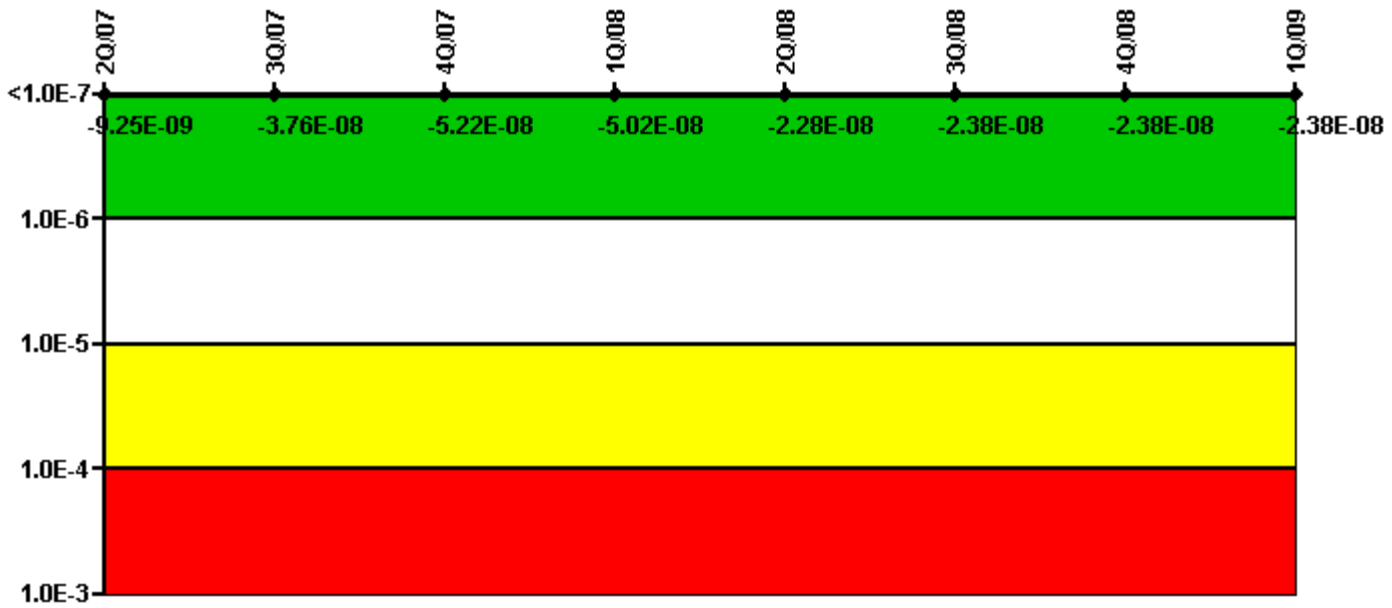


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -2.50E-10 | -4.60E-09 | -8.20E-09 | -8.20E-09 | -2.80E-09 | -2.80E-09 | -2.80E-09 | -2.80E-09 |
| URI (Δ CDF) | -9.00E-09 | -3.30E-08 | -4.40E-08 | -4.20E-08 | -2.00E-08 | -2.10E-08 | -2.10E-08 | -2.10E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -9.25E-09 | -3.76E-08 | -5.22E-08 | -5.02E-08 | -2.28E-08 | -2.38E-08 | -2.38E-08 | -2.38E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

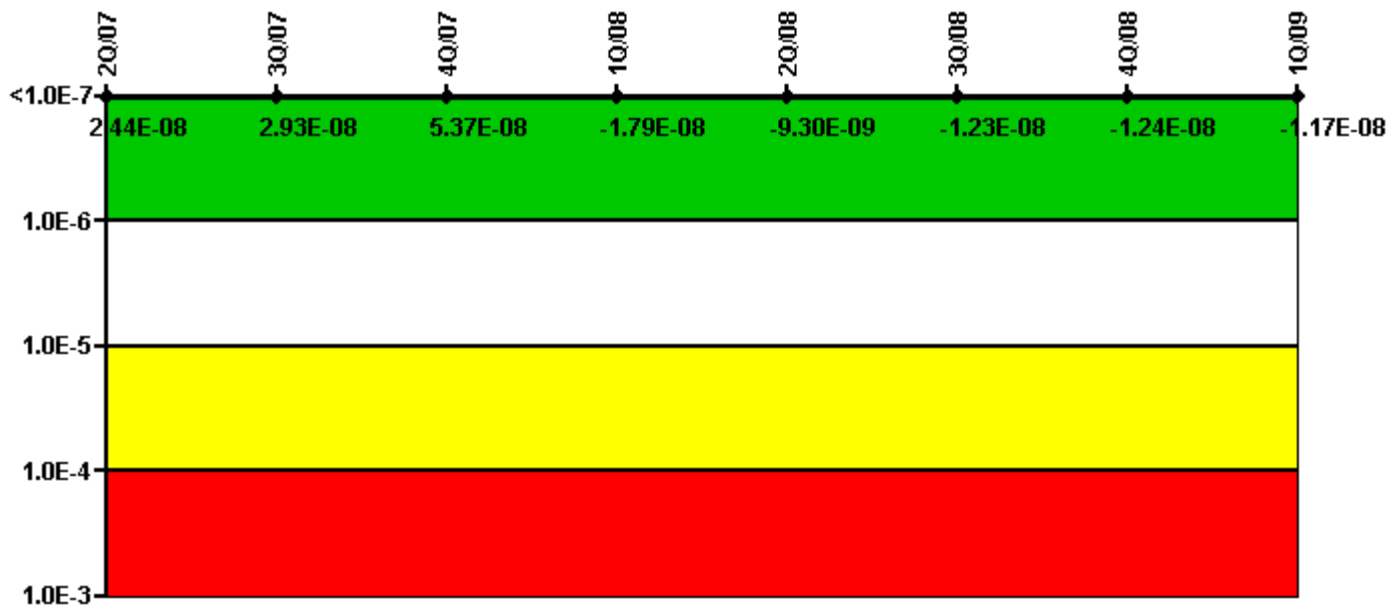


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -5.80E-10 | -6.70E-10 | -1.30E-09 | -2.90E-09 | -2.40E-09 | -5.40E-09 | -5.40E-09 | -4.70E-09 |
| URI (Δ CDF) | 2.50E-08 | 3.00E-08 | 5.50E-08 | -1.50E-08 | -6.90E-09 | -6.90E-09 | -7.00E-09 | -7.00E-09 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 2.44E-08 | 2.93E-08 | 5.37E-08 | -1.79E-08 | -9.30E-09 | -1.23E-08 | -1.24E-08 | -1.17E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

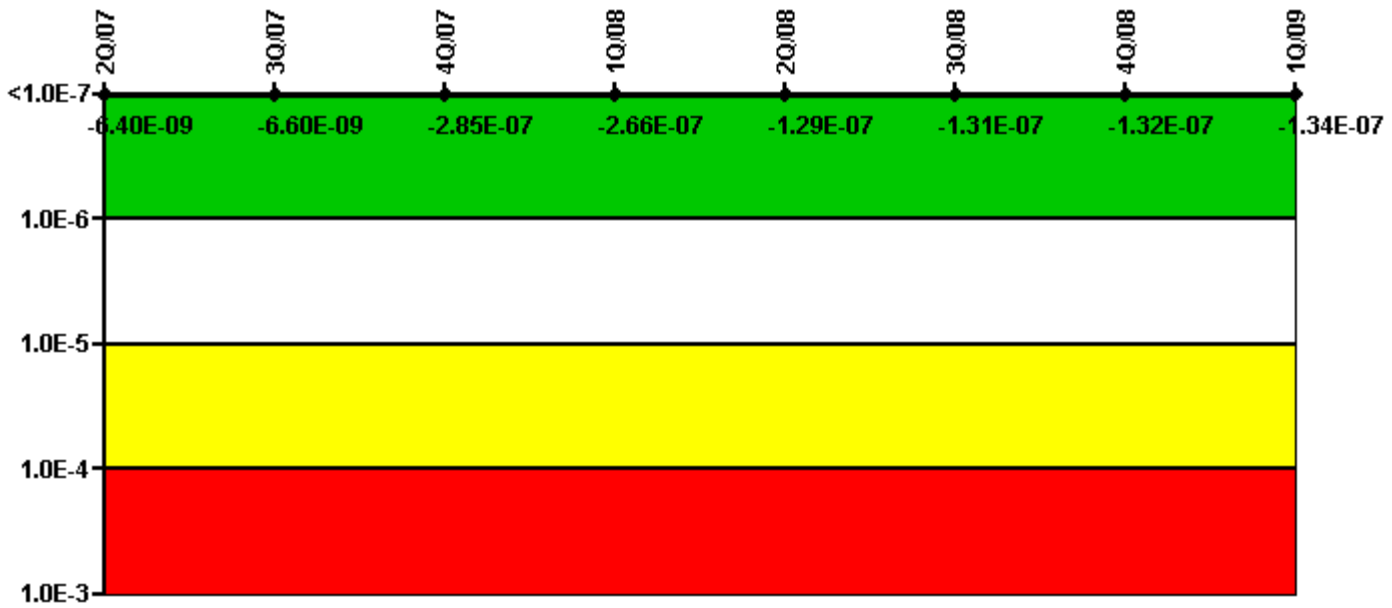


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.90E-09 | -1.90E-09 | -9.50E-08 | -9.60E-08 | -4.90E-08 | -4.90E-08 | -4.90E-08 | -4.90E-08 |
| URI (Δ CDF) | -4.50E-09 | -4.70E-09 | -1.90E-07 | -1.70E-07 | -8.00E-08 | -8.20E-08 | -8.30E-08 | -8.50E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -6.40E-09 | -6.60E-09 | -2.85E-07 | -2.66E-07 | -1.29E-07 | -1.31E-07 | -1.32E-07 | -1.34E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

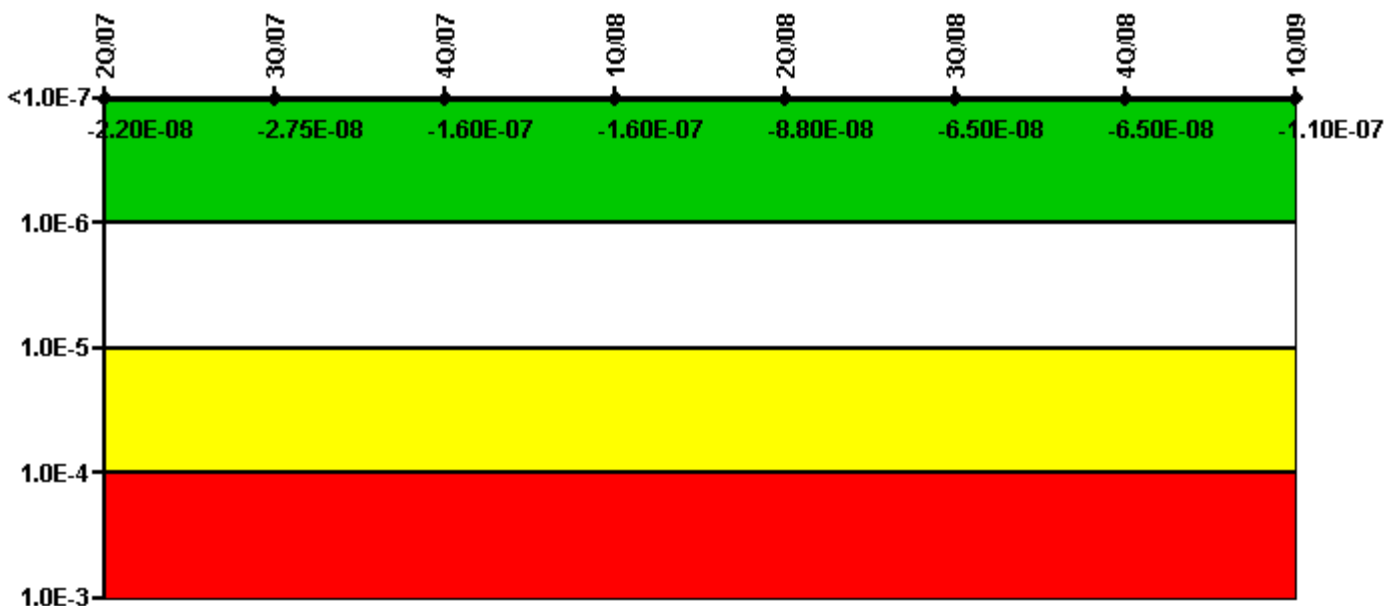


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 2.00E-09 | 1.50E-09 | 1.20E-07 | 1.10E-07 | 2.20E-08 | 4.50E-08 | 4.50E-08 | 0.00E+00 |
| URI (Δ CDF) | -2.40E-08 | -2.90E-08 | -2.80E-07 | -2.70E-07 | -1.10E-07 | -1.10E-07 | -1.10E-07 | -1.10E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.20E-08 | -2.75E-08 | -1.60E-07 | -1.60E-07 | -8.80E-08 | -6.50E-08 | -6.50E-08 | -1.10E-07 |

Licensee Comments: none

Reactor Coolant System Activity

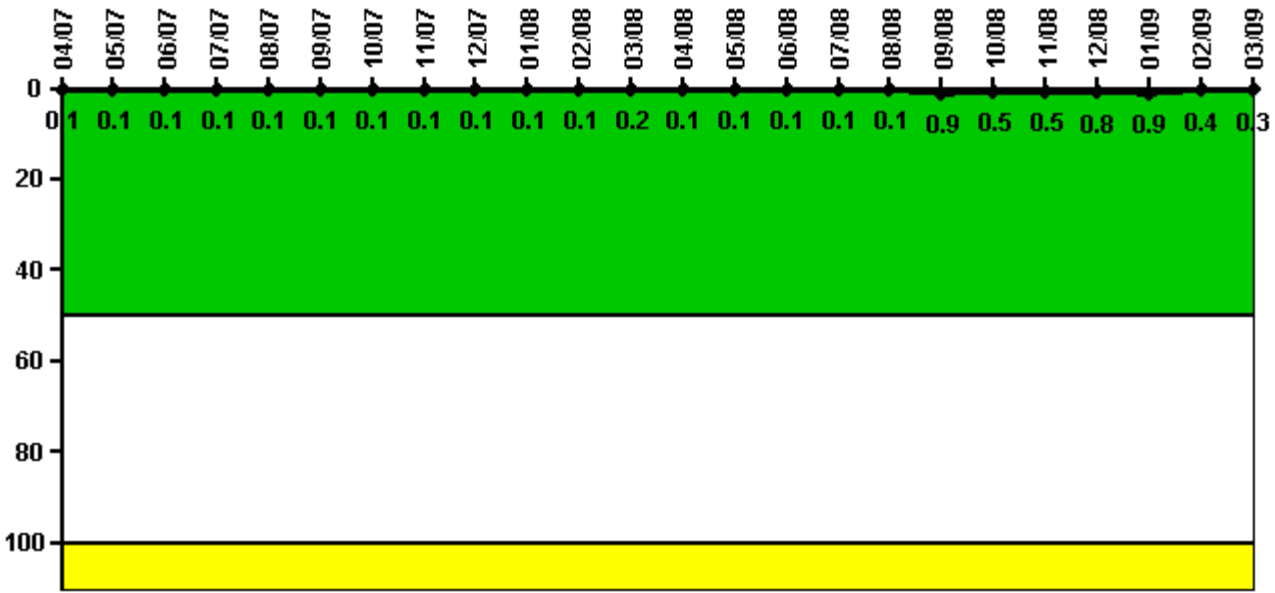

Thresholds: White > 50.0 Yellow > 100.0


Notes

| Reactor Coolant System Activity | 4/07 | 5/07 | 6/07 | 7/07 | 8/07 | 9/07 | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000281 | 0.000236 | 0.000195 | 0.000197 | 0.000165 | 0.000172 | 0.000161 | 0.000159 | 0.000181 | 0.000213 | 0.000245 | 0.000300 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.2 |

| Reactor Coolant System Activity | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 | 10/08 | 11/08 | 12/08 | 1/09 | 2/09 | 3/09 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000295 | 0.000254 | 0.000285 | 0.000299 | 0.000263 | 0.001700 | 0.000961 | 0.000973 | 0.001540 | 0.001800 | 0.000796 | 0.000646 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.9 | 0.5 | 0.5 | 0.8 | 0.9 | 0.4 | 0.3 |

Licensee Comments: none

Reactor Coolant System Leakage

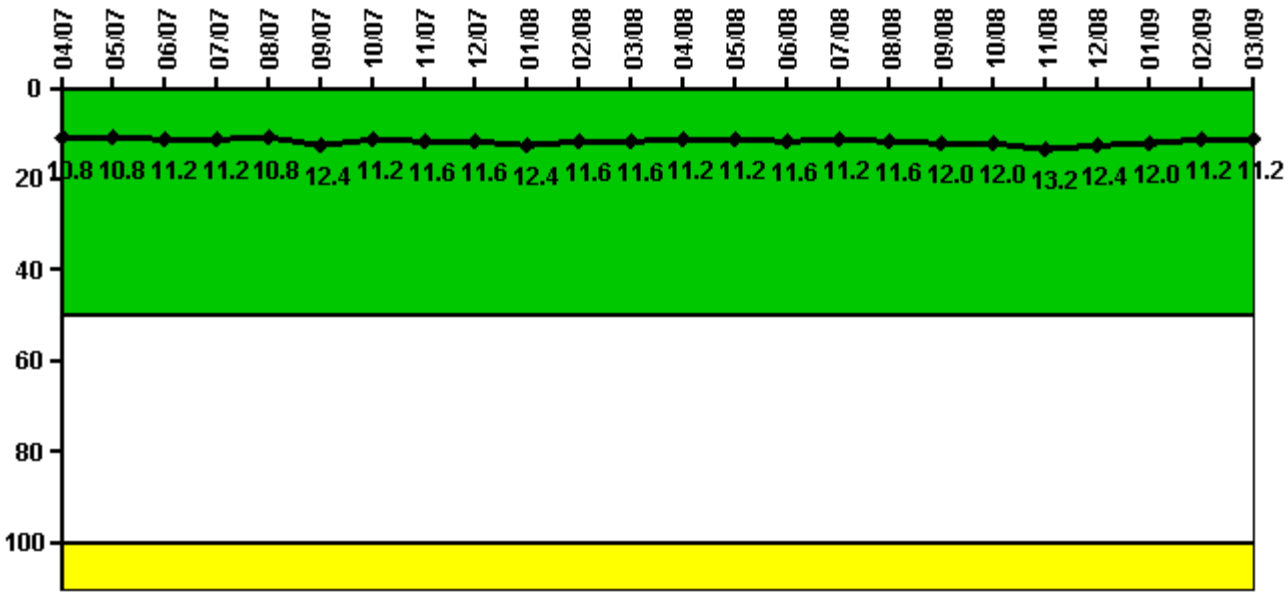


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Leakage | 4/07 | 5/07 | 6/07 | 7/07 | 8/07 | 9/07 | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 2.700 | 2.700 | 2.800 | 2.800 | 2.700 | 3.100 | 2.800 | 2.900 | 2.900 | 3.100 | 2.900 | 2.900 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 10.8 | 10.8 | 11.2 | 11.2 | 10.8 | 12.4 | 11.2 | 11.6 | 11.6 | 12.4 | 11.6 | 11.6 |
| Reactor Coolant System Leakage | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 | 10/08 | 11/08 | 12/08 | 1/09 | 2/09 | 3/09 |
| Maximum leakage | 2.800 | 2.800 | 2.900 | 2.800 | 2.900 | 3.000 | 3.000 | 3.300 | 3.100 | 3.000 | 2.800 | 2.800 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 11.2 | 11.2 | 11.6 | 11.2 | 11.6 | 12.0 | 12.0 | 13.2 | 12.4 | 12.0 | 11.2 | 11.2 |

Licensee Comments: none

Drill/Exercise Performance

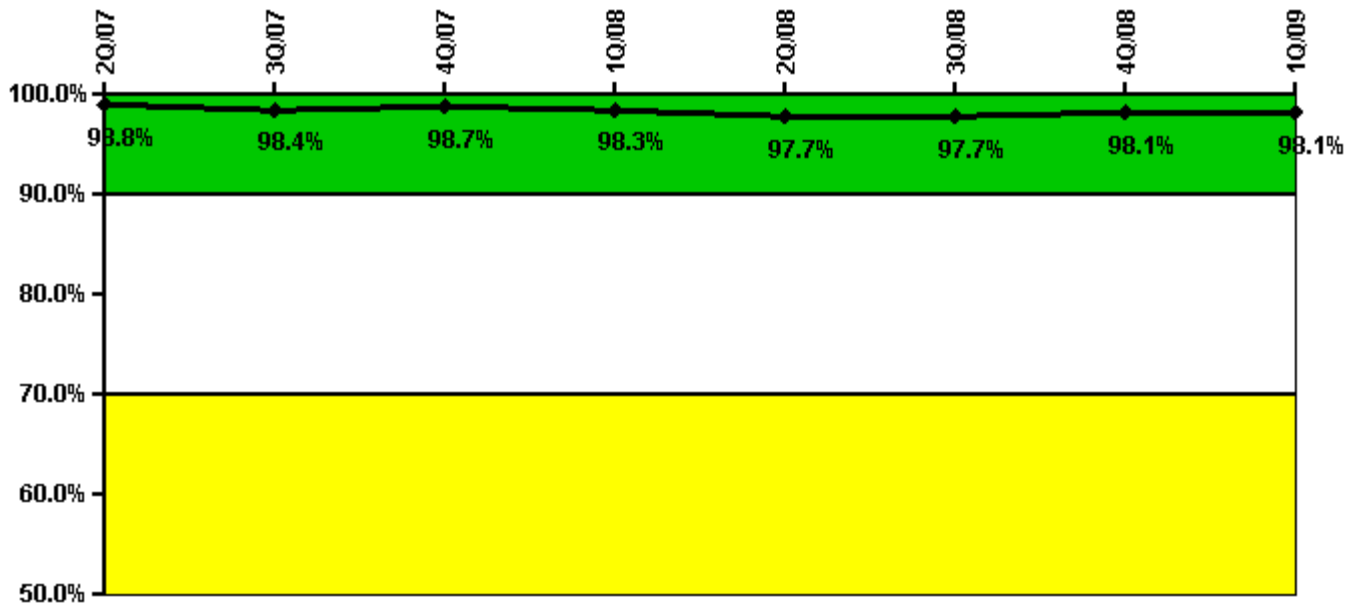


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 44.0 | 50.0 | 50.0 | 7.0 | 49.0 | 36.0 | 50.0 | 20.0 |
| Total opportunities | 44.0 | 52.0 | 50.0 | 8.0 | 52.0 | 36.0 | 50.0 | 20.0 |
| | | | | | | | | |
| Indicator value | 98.8% | 98.4% | 98.7% | 98.3% | 97.7% | 97.7% | 98.1% | 98.1% |

Licensee Comments: none

ERO Drill Participation

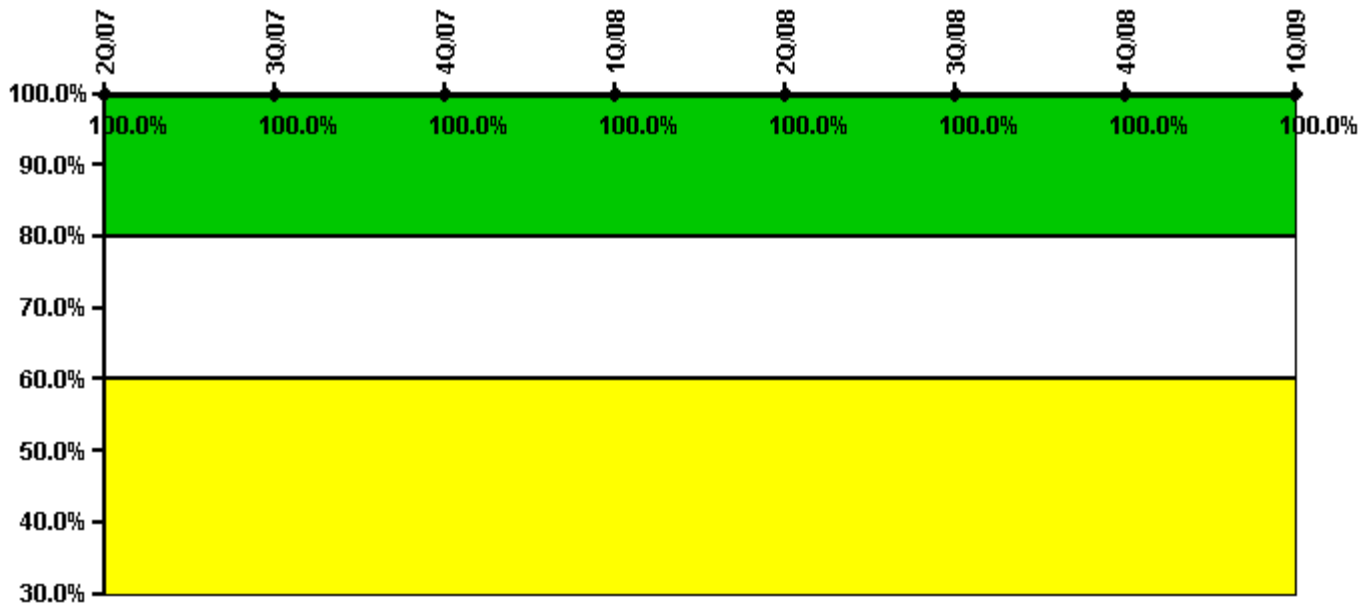


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|-----------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| Participating Key personnel | 65.0 | 68.0 | 65.0 | 63.0 | 67.0 | 67.0 | 68.0 | 65.0 |
| Total Key personnel | 65.0 | 68.0 | 65.0 | 63.0 | 67.0 | 67.0 | 68.0 | 65.0 |
| Indicator value | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% |

Licensee Comments: none

Alert & Notification System

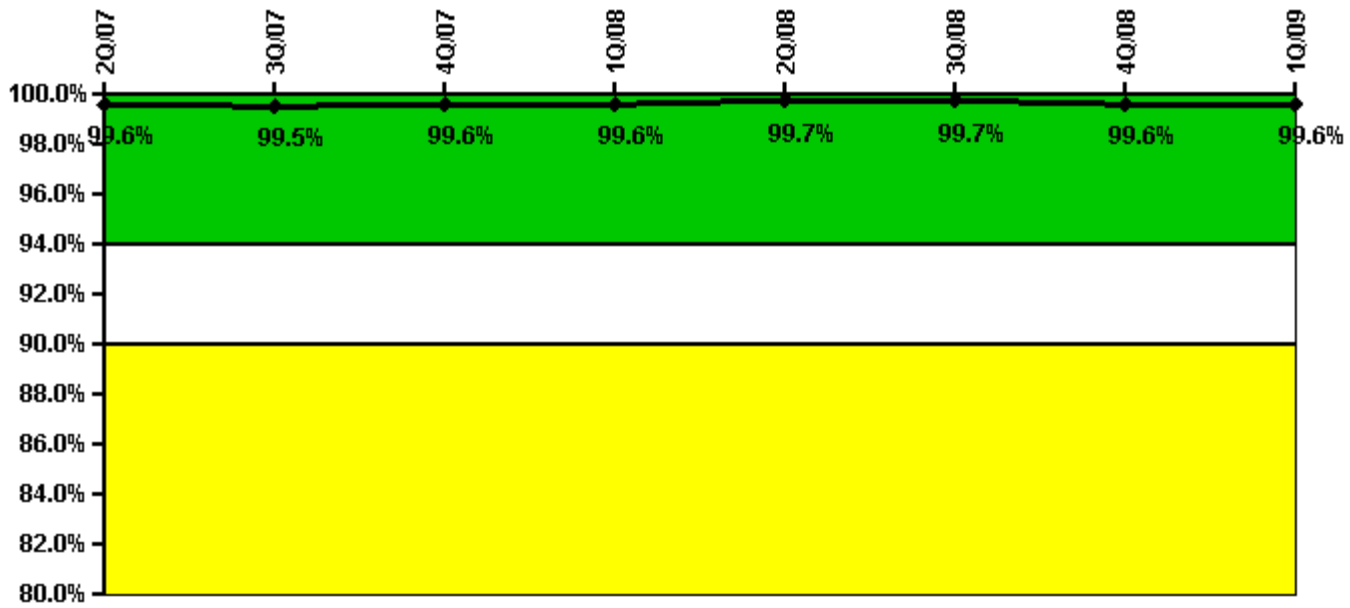


Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 3188 | 3182 | 3191 | 3191 | 3196 | 3235 | 3169 | 3144 |
| Total sirens-tests | 3200 | 3200 | 3200 | 3200 | 3200 | 3246 | 3200 | 3150 |
| | | | | | | | | |
| Indicator value | 99.6% | 99.5% | 99.6% | 99.6% | 99.7% | 99.7% | 99.6% | 99.6% |

Licensee Comments: none

Occupational Exposure Control Effectiveness

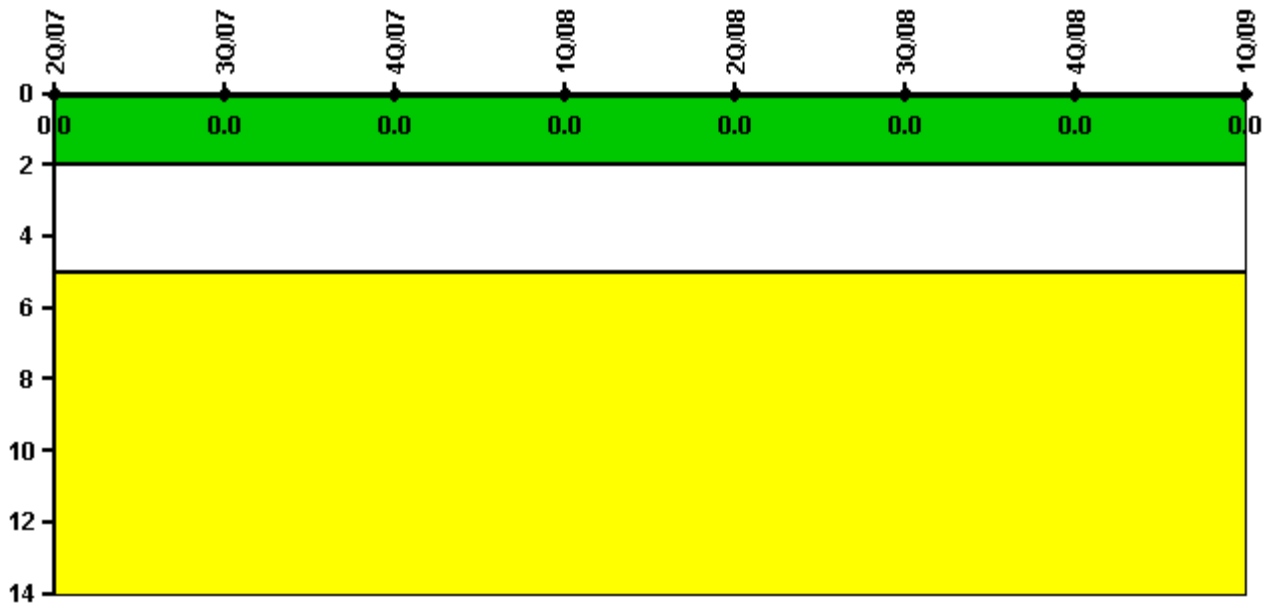


Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent

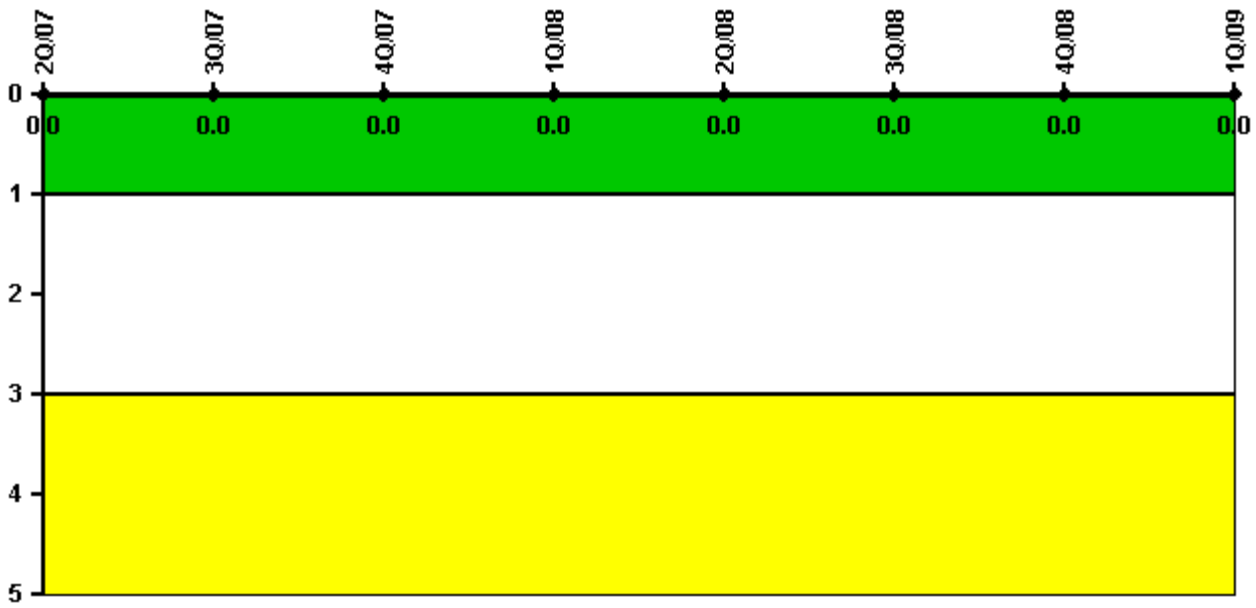

Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

[Security](#) information not publicly available.