


# Quad Cities 1

## 1Q/2009 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

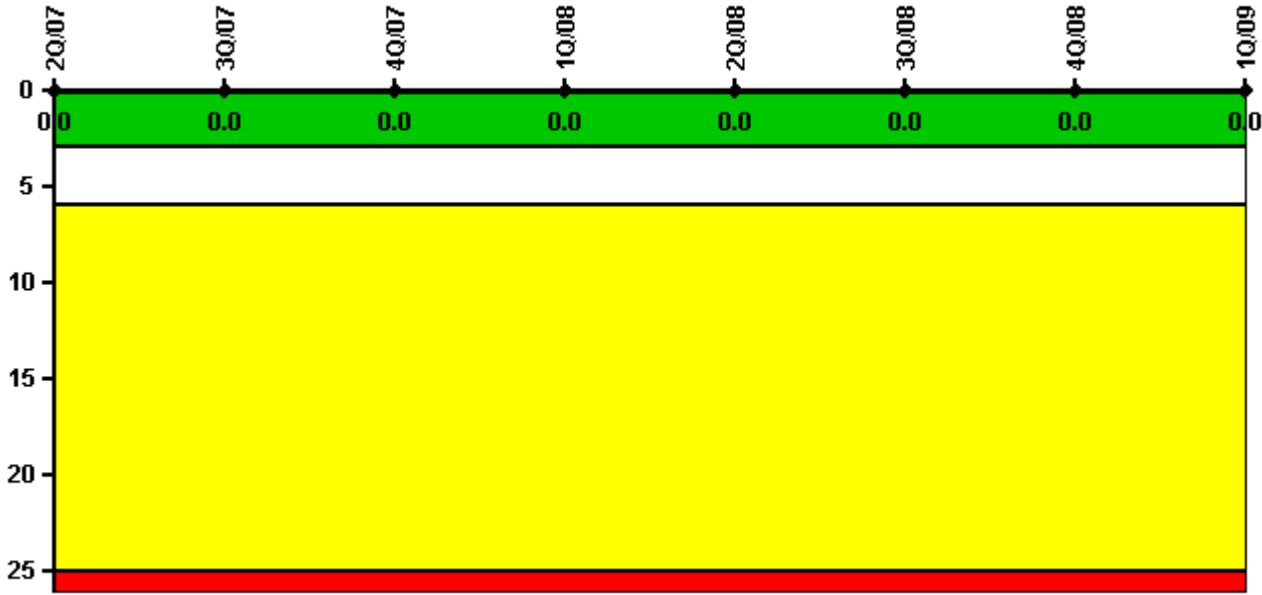


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1755.3	2139.0	2209.0	2183.0	2184.0	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

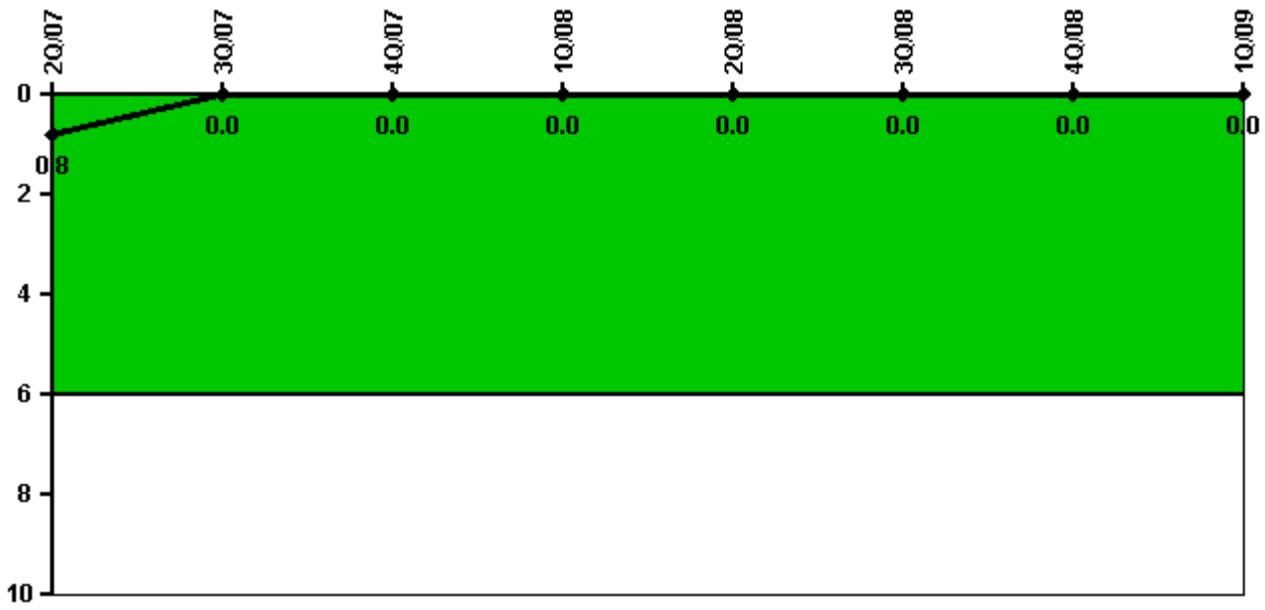

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1755.3	2139.0	2209.0	2183.0	2184.0	2208.0	2209.0	2159.0
Indicator value	0.8	0	0	0	0	0	0	0

Licensee Comments: none

# Unplanned Scrams with Complications




Thresholds: White > 1.0

**Notes**

Unplanned Scrams with Complications	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value		0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (BWR)

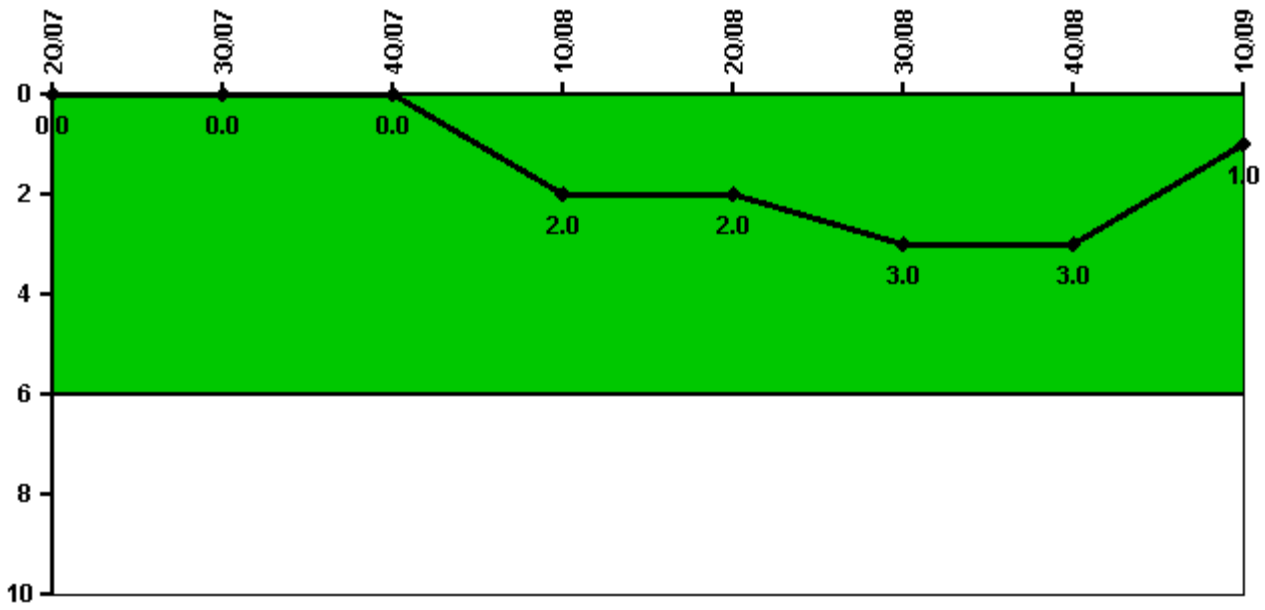


Thresholds: White > 6.0

### Notes

Safety System Functional Failures (BWR)	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Safety System Functional Failures	0	0	0	2	0	1	0	0
Indicator value	0	0	0	2	2	3	3	1

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

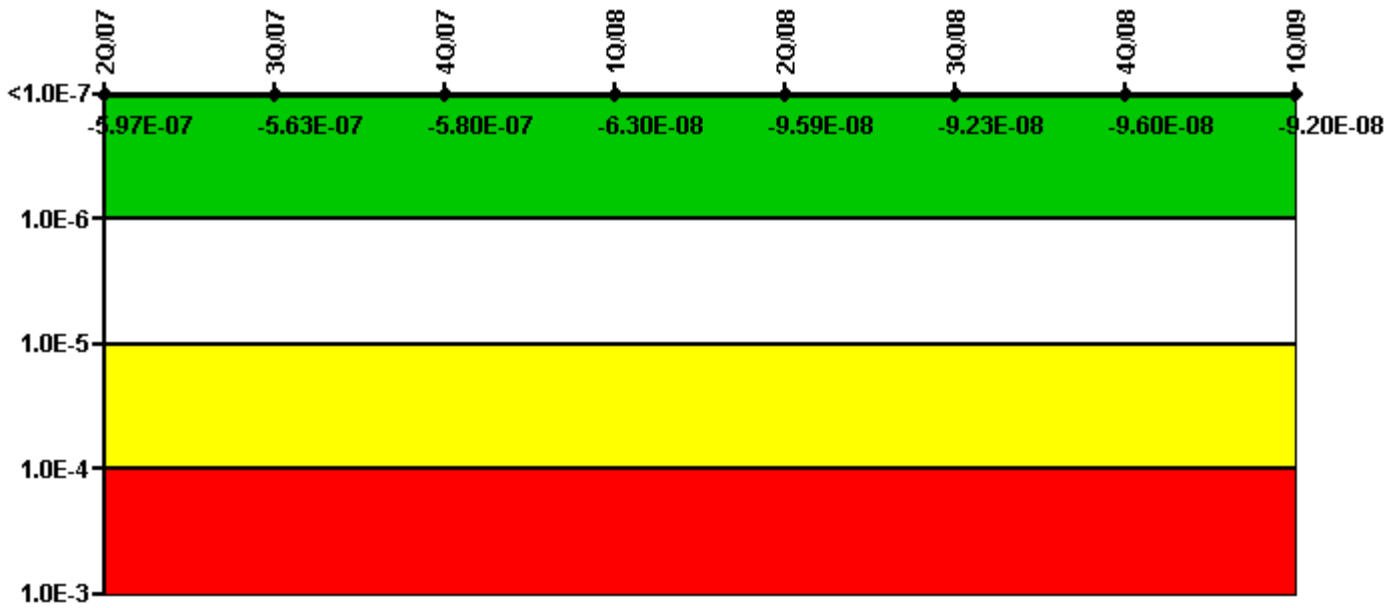


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI ( $\Delta$ CDF)	-5.70E-08	-3.30E-08	-7.00E-08	4.70E-08	9.90E-11	4.70E-09	5.40E-08	6.80E-08
URI ( $\Delta$ CDF)	-5.40E-07	-5.30E-07	-5.10E-07	-1.10E-07	-9.60E-08	-9.70E-08	-1.50E-07	-1.60E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.97E-07	-5.63E-07	-5.80E-07	-6.30E-08	-9.59E-08	-9.23E-08	-9.60E-08	-9.20E-08

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

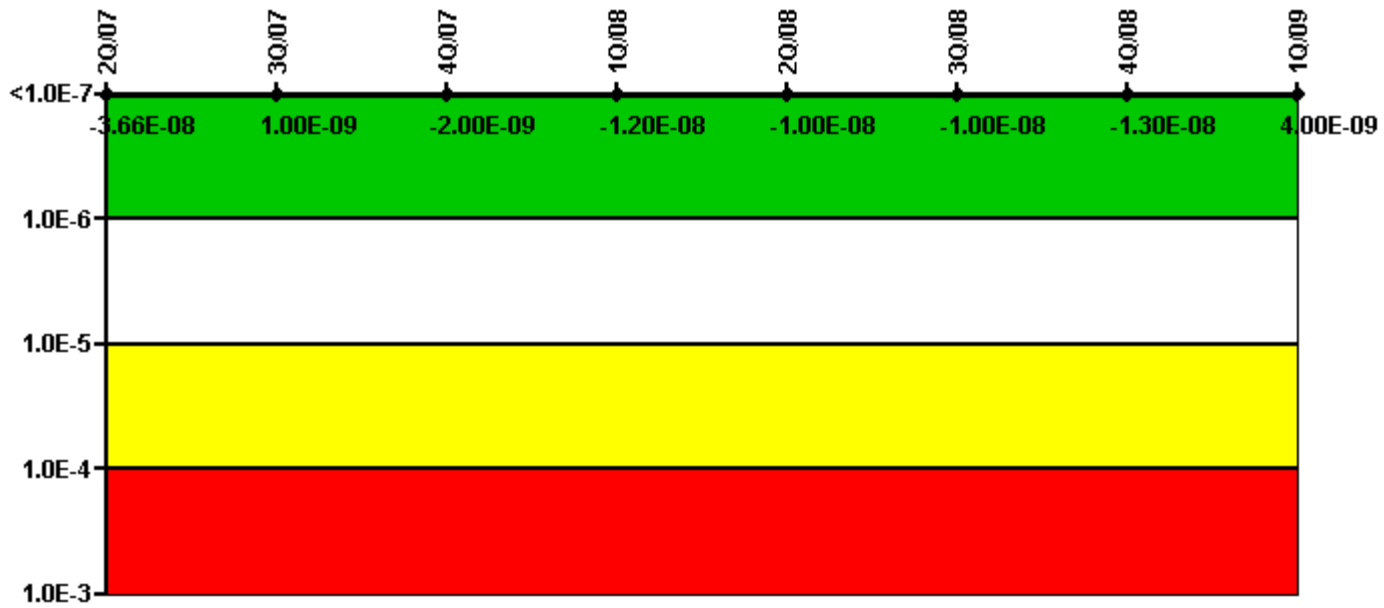


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI ( $\Delta$ CDF)	6.40E-09	4.40E-08	4.00E-08	2.40E-08	2.40E-08	2.40E-08	2.10E-08	3.80E-08
URI ( $\Delta$ CDF)	-4.30E-08	-4.30E-08	-4.20E-08	-3.60E-08	-3.40E-08	-3.40E-08	-3.40E-08	-3.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.66E-08	1.00E-09	-2.00E-09	-1.20E-08	-1.00E-08	-1.00E-08	-1.30E-08	4.00E-09

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

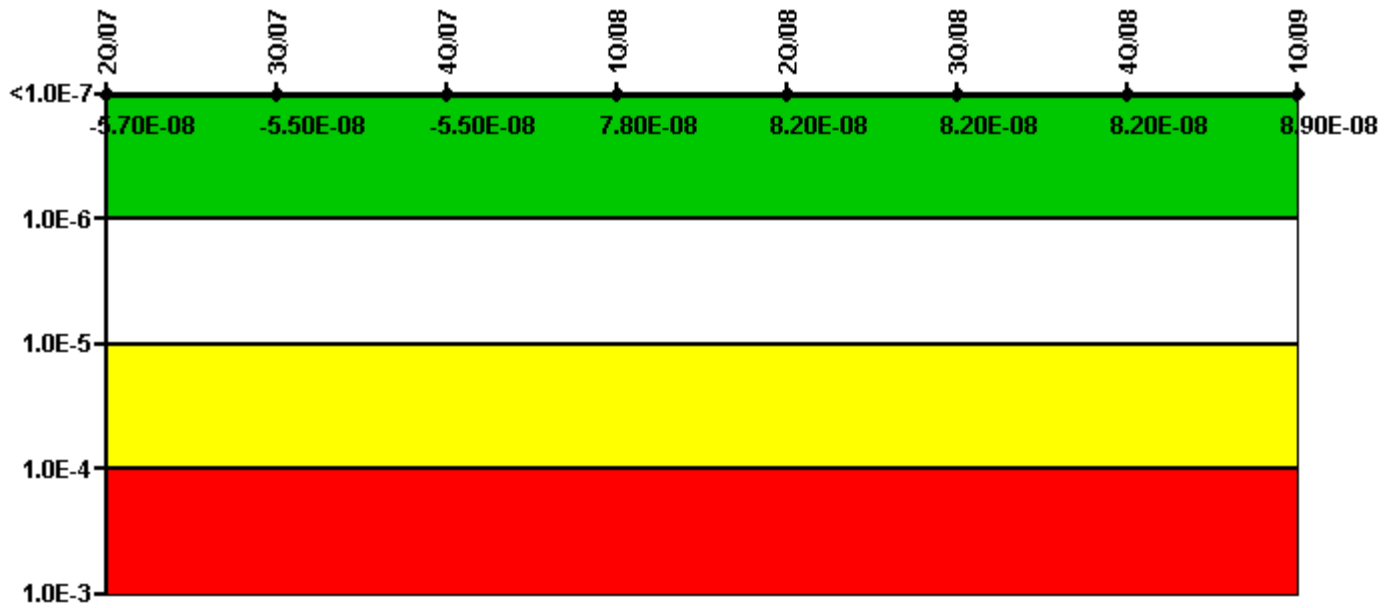


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI ( $\Delta$ CDF)	-2.30E-08	-2.10E-08	-2.10E-08	-1.70E-08	-1.70E-08	-1.70E-08	-1.70E-08	-1.00E-08
URI ( $\Delta$ CDF)	-3.40E-08	-3.40E-08	-3.40E-08	9.50E-08	9.90E-08	9.90E-08	9.90E-08	9.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.70E-08	-5.50E-08	-5.50E-08	7.80E-08	8.20E-08	8.20E-08	8.20E-08	8.90E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

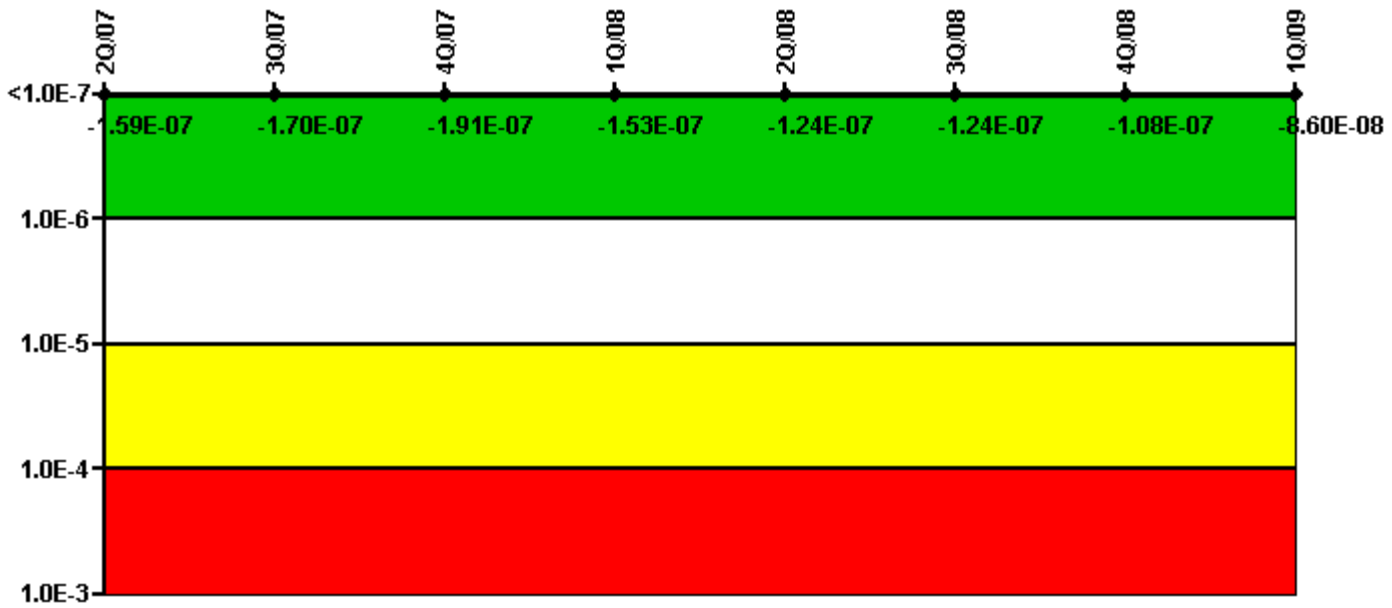

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI ( $\Delta$ CDF)	-3.90E-08	-5.00E-08	-7.10E-08	-5.60E-08	-2.70E-08	-2.70E-08	-1.10E-08	1.10E-08
URI ( $\Delta$ CDF)	-1.20E-07	-1.20E-07	-1.20E-07	-9.70E-08	-9.70E-08	-9.70E-08	-9.70E-08	-9.70E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.59E-07	-1.70E-07	-1.91E-07	-1.53E-07	-1.24E-07	-1.24E-07	-1.08E-07	-8.60E-08

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

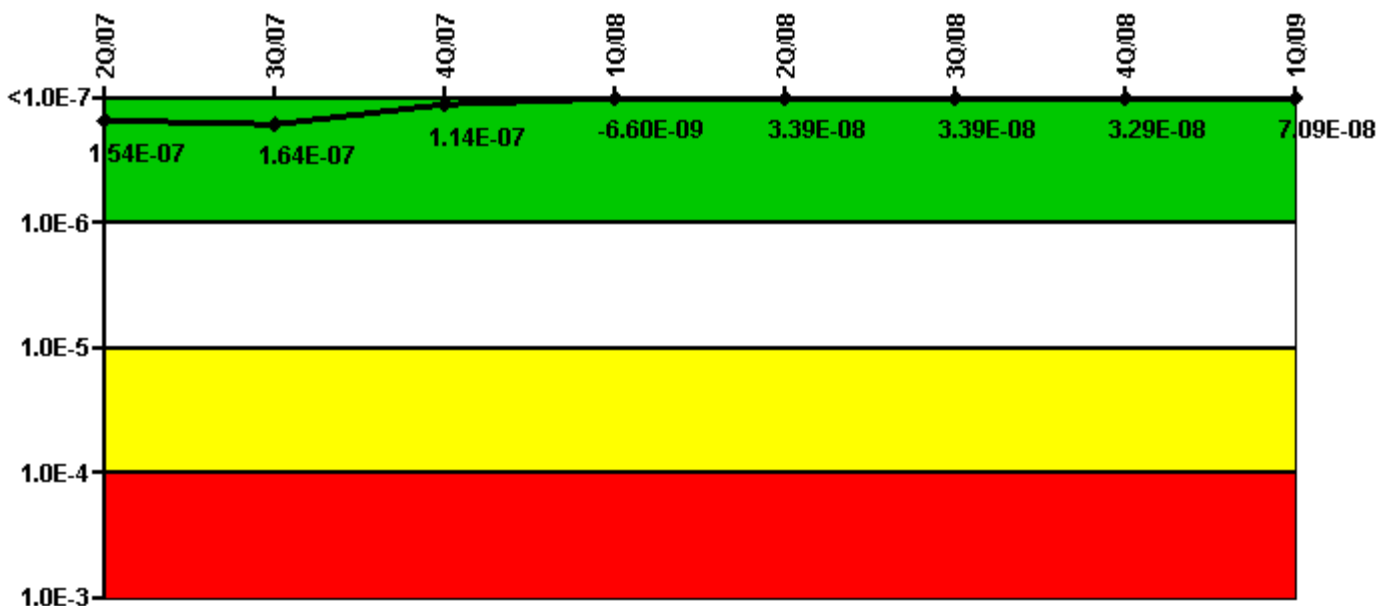


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (ΔCDF)	1.50E-07	1.60E-07	1.10E-07	-9.40E-09	3.20E-08	3.20E-08	3.10E-08	6.90E-08
URI (ΔCDF)	4.20E-09	4.20E-09	4.20E-09	2.80E-09	1.90E-09	1.90E-09	1.90E-09	1.90E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.54E-07	1.64E-07	1.14E-07	-6.60E-09	3.39E-08	3.39E-08	3.29E-08	7.09E-08

Licensee Comments: none

## Reactor Coolant System Activity

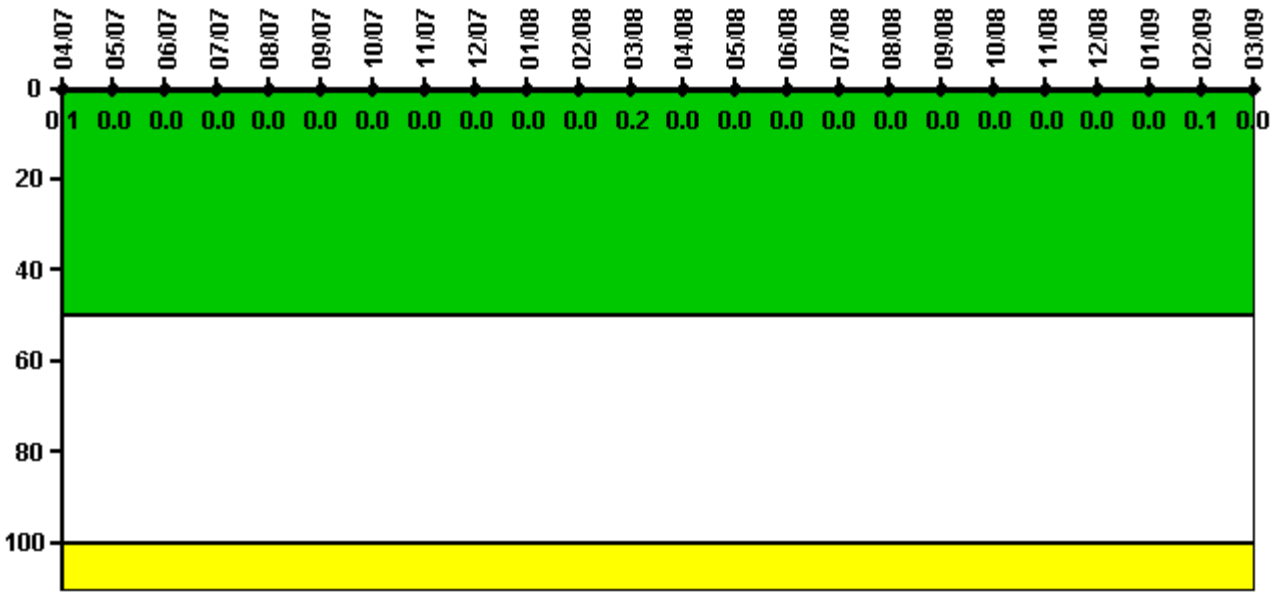

Thresholds: White > 50.0 Yellow > 100.0

### Notes


Reactor Coolant System Activity	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum activity	0.000106	0.000053	0.000081	0.000054	0.000063	0.000046	0.000052	0.000099	0.000063	0.000055	0.000062	0.000393
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0	0	0	0	0	0	0	0	0	0	0.2

Reactor Coolant System Activity	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum activity	0.000031	0.000041	0.000042	0.000052	0.000072	0.000053	0.000059	0.000027	0.000084	0.000035	0.000145	0.000040
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0.1	0

Licensee Comments: none

## Reactor Coolant System Leakage

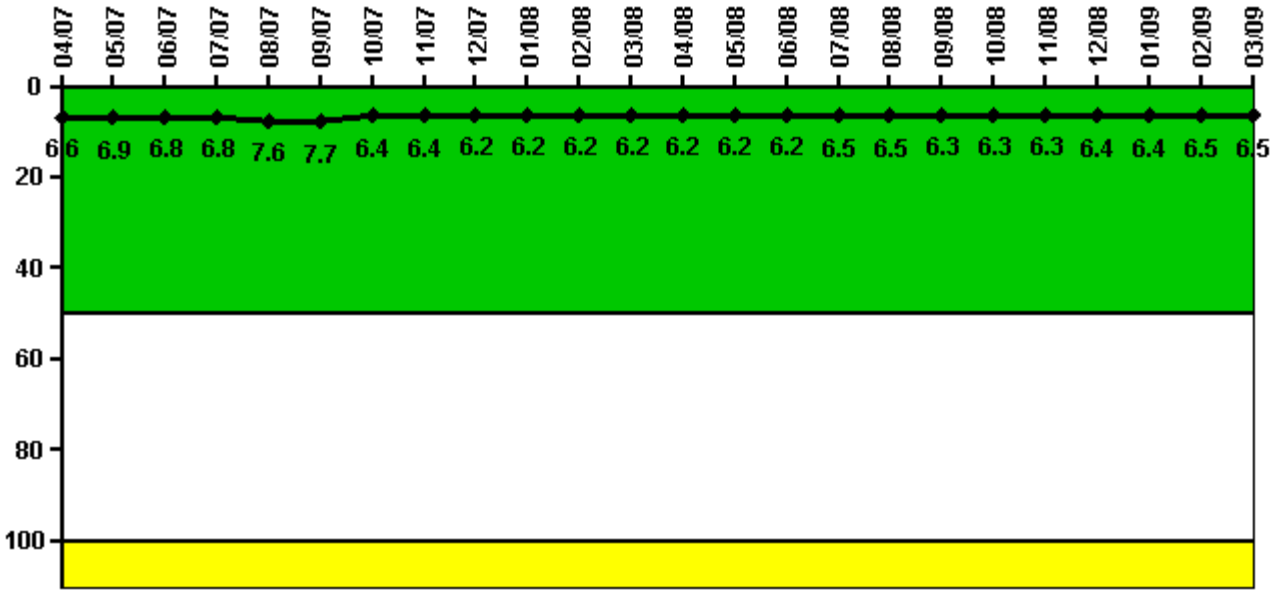


Thresholds: White > 50.0 Yellow > 100.0

### Notes

<b>Reactor Coolant System Leakage</b>	<b>4/07</b>	<b>5/07</b>	<b>6/07</b>	<b>7/07</b>	<b>8/07</b>	<b>9/07</b>	<b>10/07</b>	<b>11/07</b>	<b>12/07</b>	<b>1/08</b>	<b>2/08</b>	<b>3/08</b>
Maximum leakage	1.650	1.720	1.710	1.690	1.910	1.920	1.600	1.590	1.560	1.560	1.560	1.540
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.6	6.9	6.8	6.8	7.6	7.7	6.4	6.4	6.2	6.2	6.2	6.2
<b>Reactor Coolant System Leakage</b>	<b>4/08</b>	<b>5/08</b>	<b>6/08</b>	<b>7/08</b>	<b>8/08</b>	<b>9/08</b>	<b>10/08</b>	<b>11/08</b>	<b>12/08</b>	<b>1/09</b>	<b>2/09</b>	<b>3/09</b>
Maximum leakage	1.550	1.550	1.550	1.620	1.620	1.570	1.570	1.570	1.610	1.610	1.630	1.620
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.2	6.2	6.2	6.5	6.5	6.3	6.3	6.3	6.4	6.4	6.5	6.5

Licensee Comments: none

## Drill/Exercise Performance

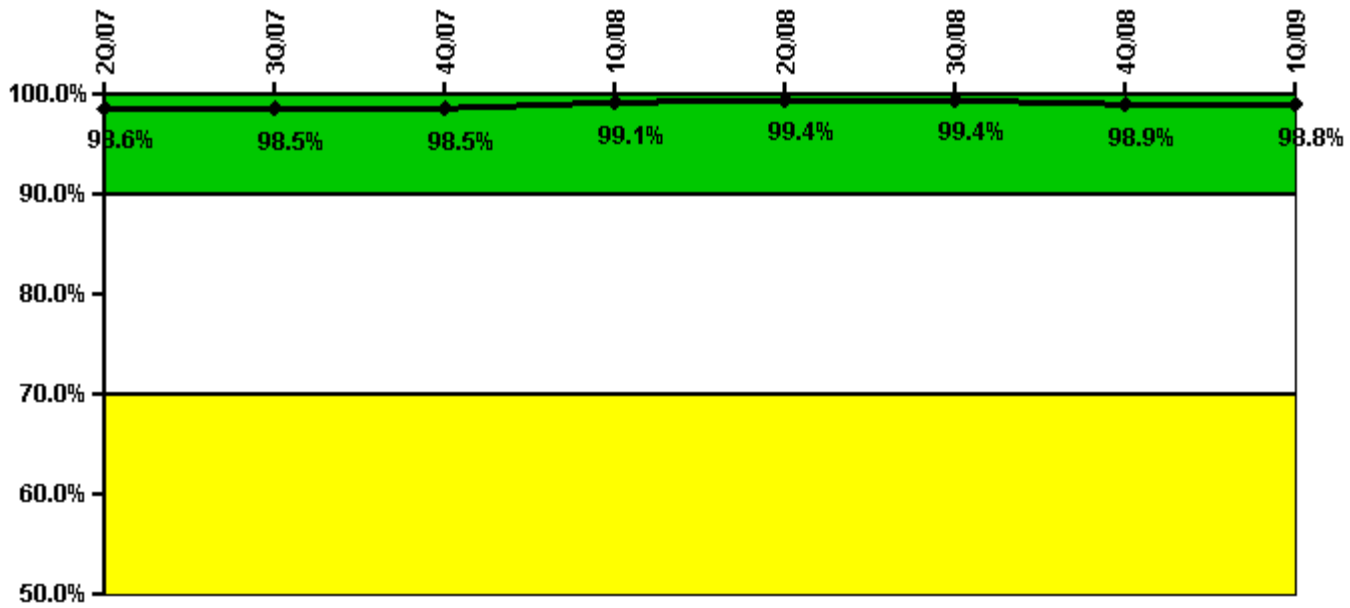


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Successful opportunities	23.0	42.0	41.0	30.0	32.0	24.0	47.0	15.0
Total opportunities	23.0	42.0	42.0	30.0	32.0	24.0	49.0	15.0
Indicator value	98.6%	98.5%	98.5%	99.1%	99.4%	99.4%	98.9%	98.8%

Licensee Comments: none

## ERO Drill Participation

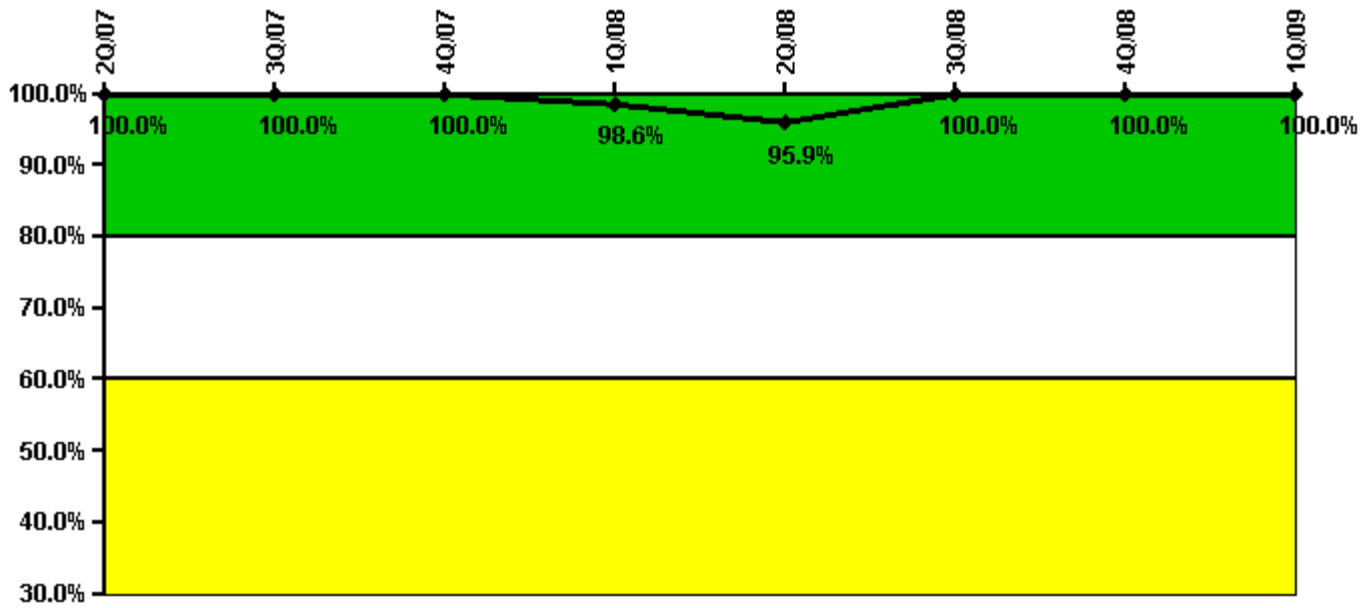


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Participating Key personnel	74.0	72.0	70.0	69.0	70.0	69.0	64.0	69.0
Total Key personnel	74.0	72.0	70.0	70.0	73.0	69.0	64.0	69.0
Indicator value	100.0%	100.0%	100.0%	98.6%	95.9%	100.0%	100.0%	100.0%

Licensee Comments: none

## Alert & Notification System

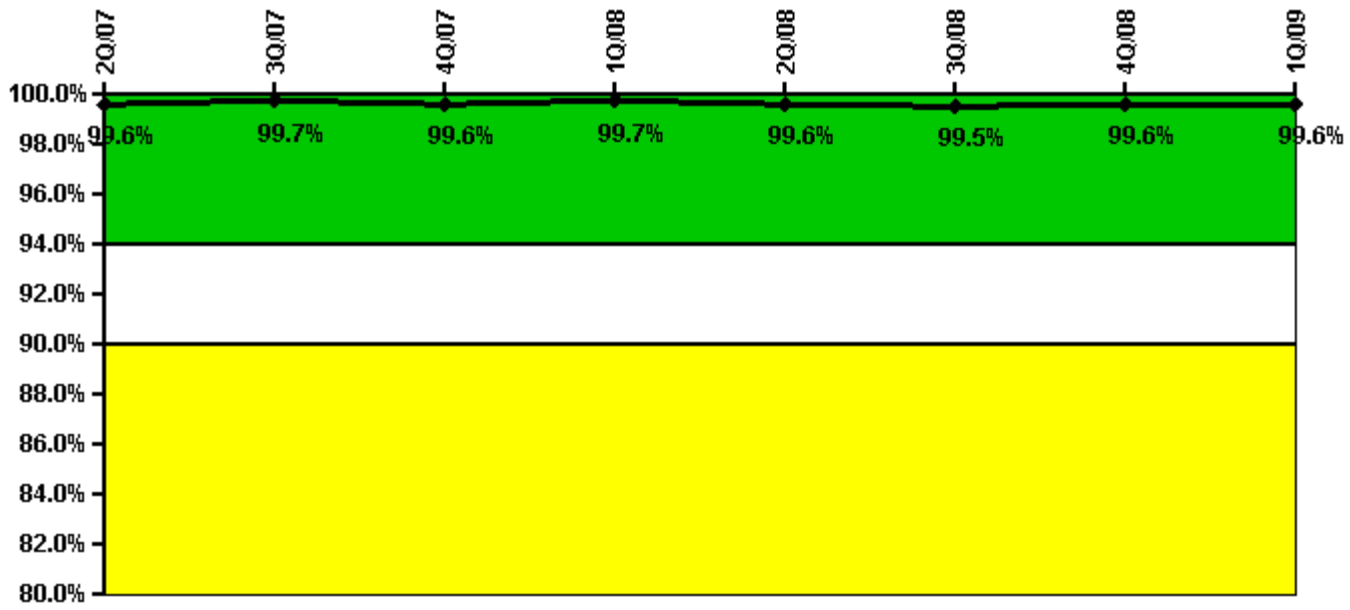


Thresholds: White < 94.0% Yellow < 90.0%

### Notes

Alert & Notification System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Successful siren-tests	3316	3320	3312	3312	3284	3367	3315	3269
Total sirens-tests	3328	3328	3328	3319	3309	3380	3328	3276
Indicator value	99.6%	99.7%	99.6%	99.7%	99.6%	99.5%	99.6%	99.6%

Licensee Comments: none

# Occupational Exposure Control Effectiveness

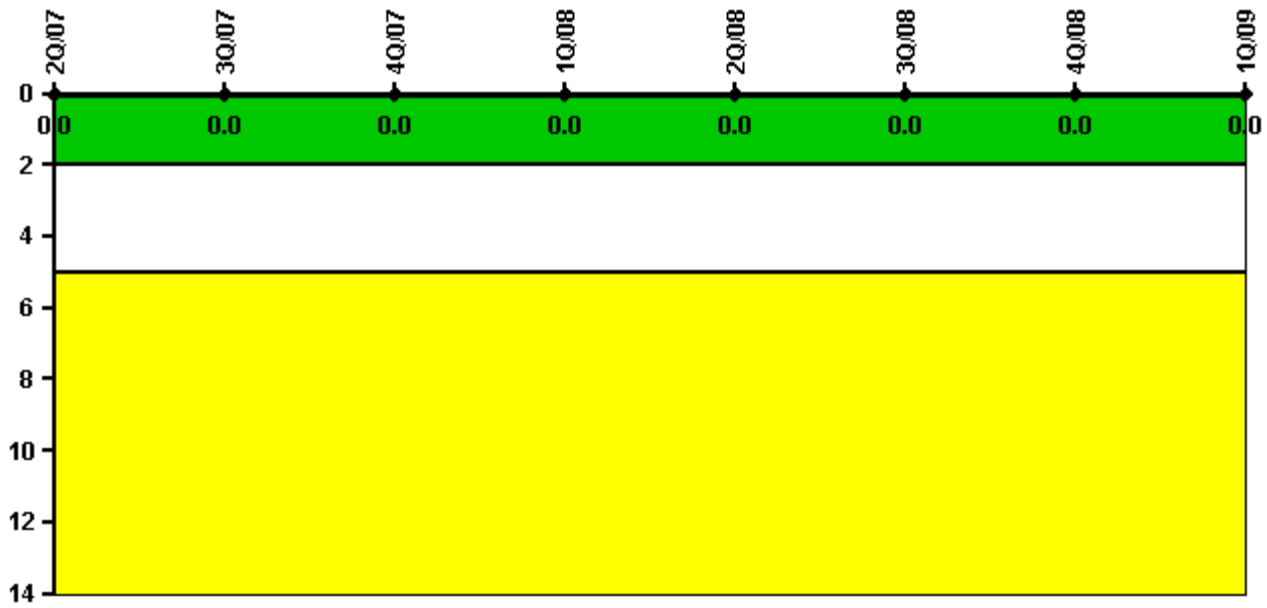

Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.