


Surry 1

1Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

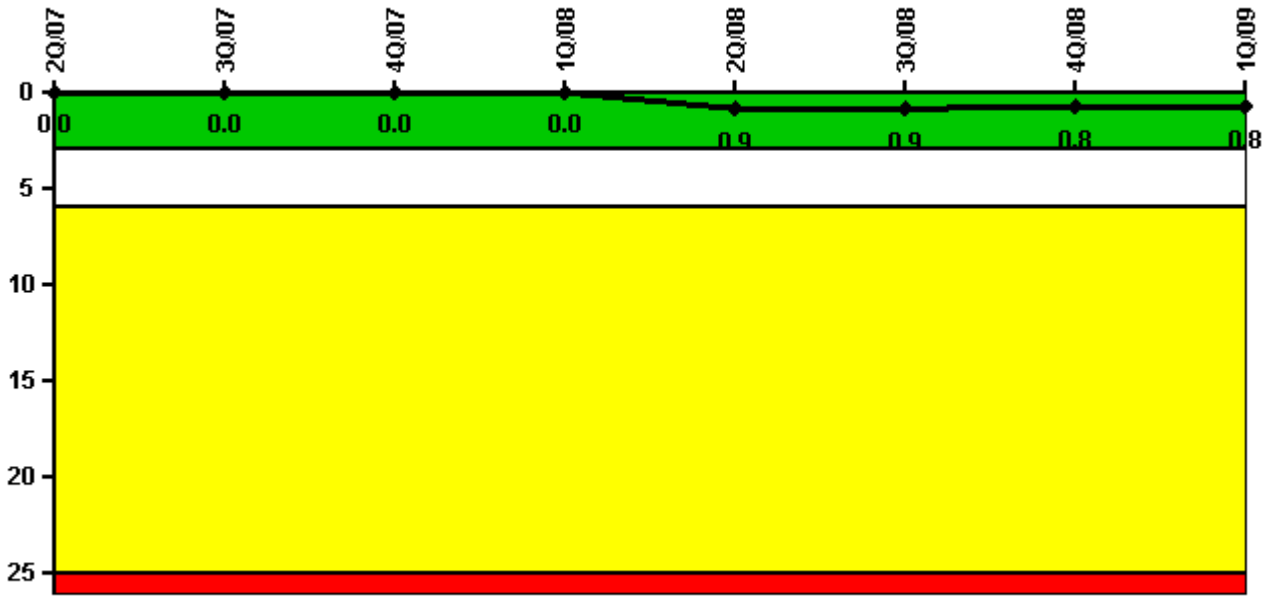


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	2184.0	2208.0	1236.0	2183.0	2081.1	2208.0	2118.0	2159.0
Indicator value	0	0	0	0	0.9	0.9	0.8	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

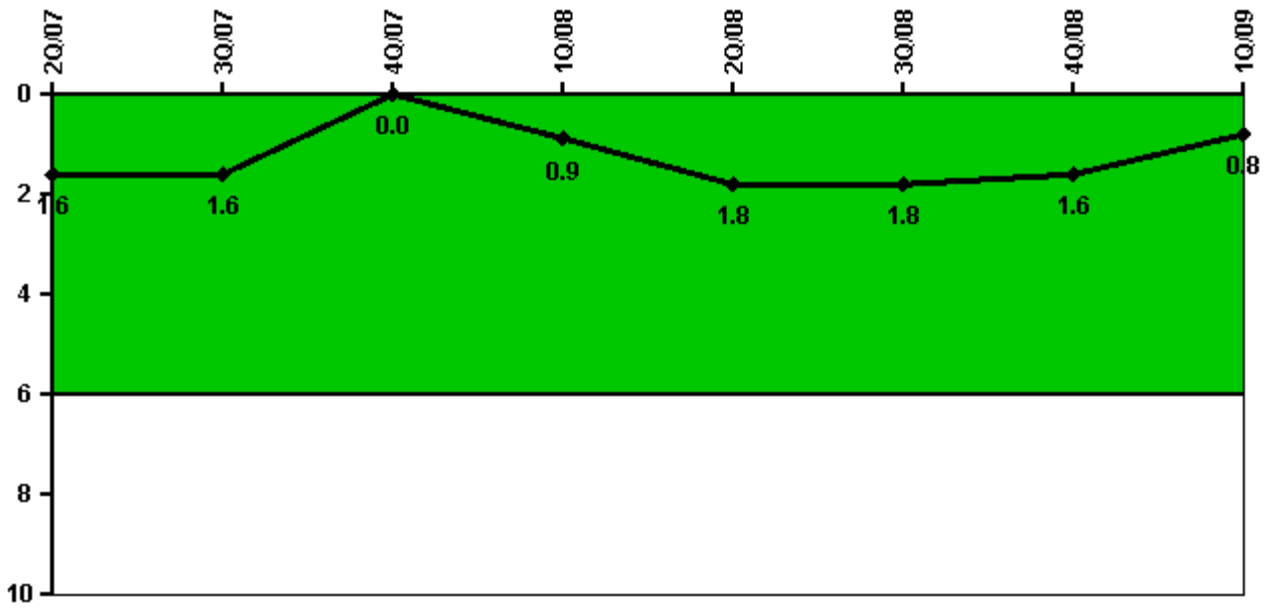

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Unplanned power changes	0	0	0	1.0	1.0	0	0	0
Critical hours	2184.0	2208.0	1236.0	2183.0	2081.1	2208.0	2118.0	2159.0
Indicator value	1.6	1.6	0	0.9	1.8	1.8	1.6	0.8

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value		0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

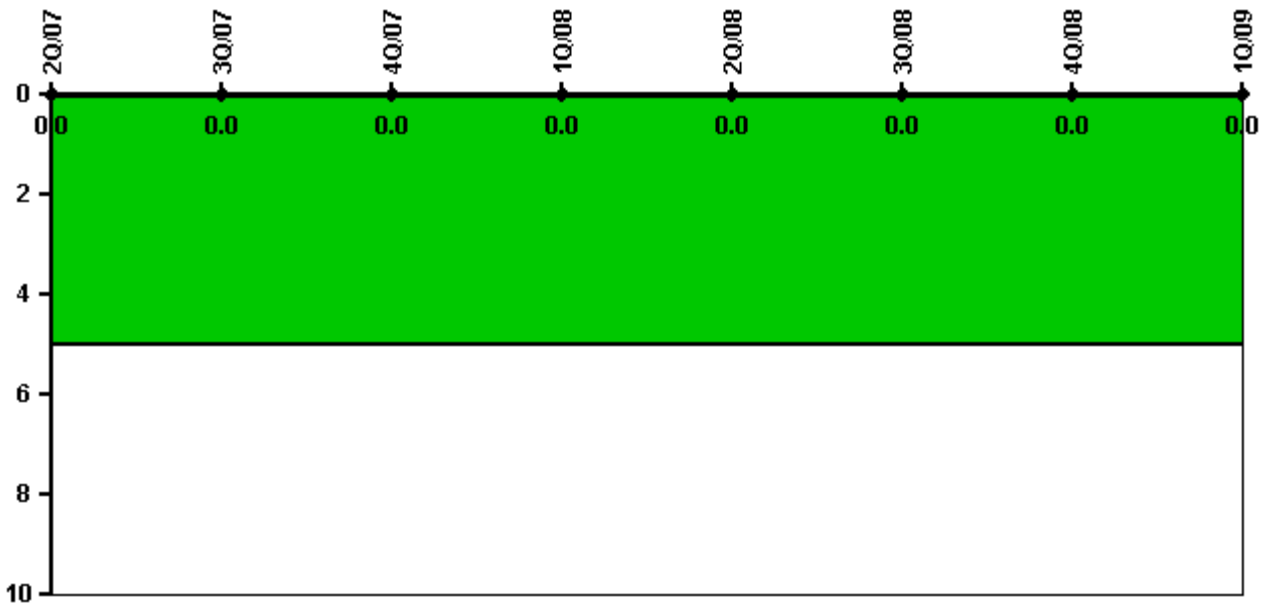


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

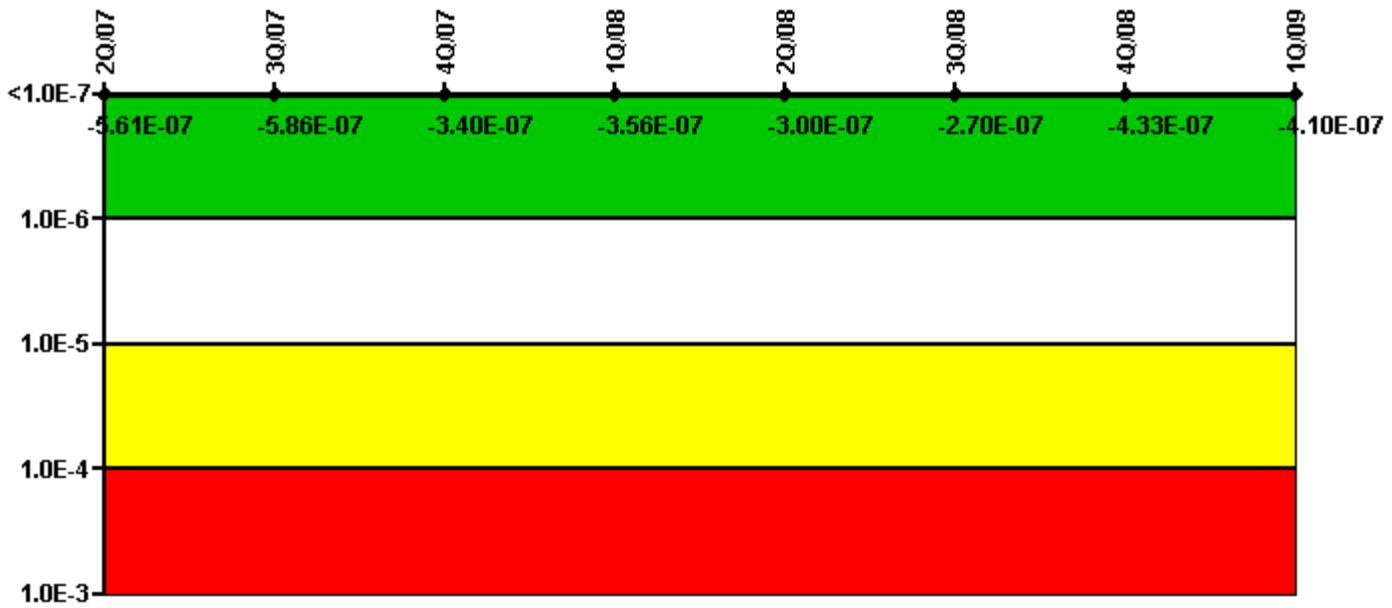


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	5.90E-08	1.40E-08	1.00E-07	8.40E-08	1.50E-07	1.80E-07	1.70E-08	4.00E-08
URI (Δ CDF)	-6.20E-07	-6.00E-07	-4.40E-07	-4.40E-07	-4.50E-07	-4.50E-07	-4.50E-07	-4.50E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.61E-07	-5.86E-07	-3.40E-07	-3.56E-07	-3.00E-07	-2.70E-07	-4.33E-07	-4.10E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

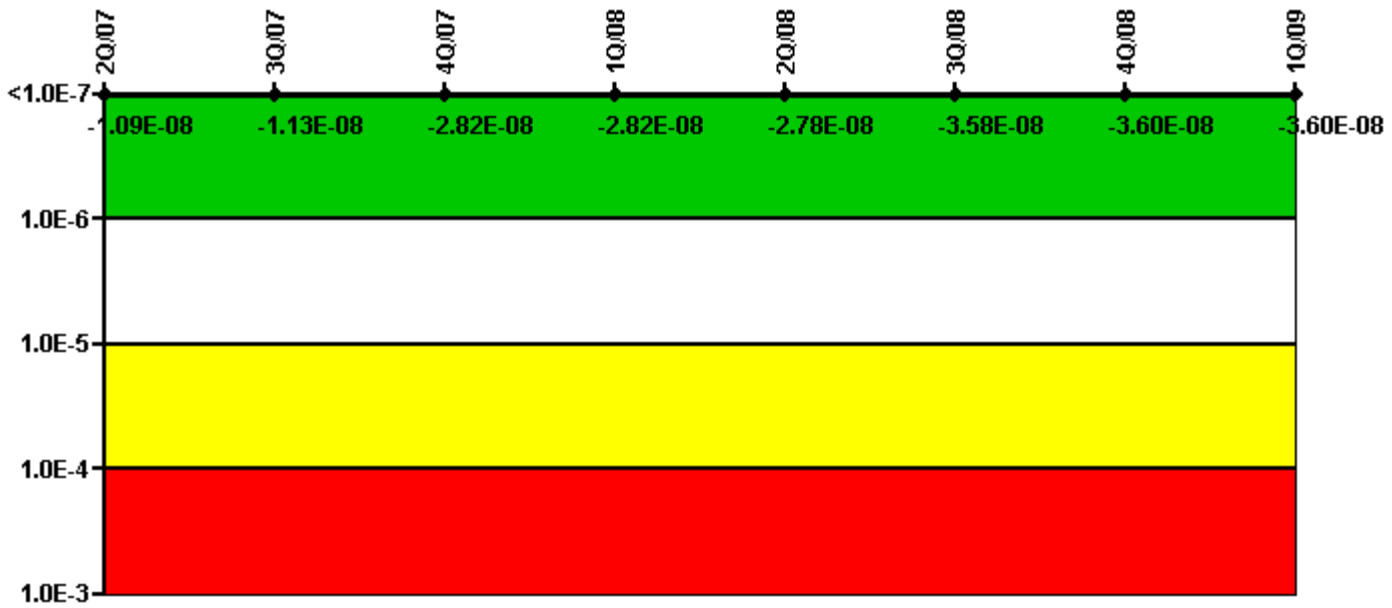


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	-9.20E-10	-1.30E-09	-2.20E-09	-2.20E-09	-1.80E-09	-1.80E-09	-2.00E-09	-2.00E-09
URI (Δ CDF)	-1.00E-08	-1.00E-08	-2.60E-08	-2.60E-08	-2.60E-08	-3.40E-08	-3.40E-08	-3.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.09E-08	-1.13E-08	-2.82E-08	-2.82E-08	-2.78E-08	-3.58E-08	-3.60E-08	-3.60E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

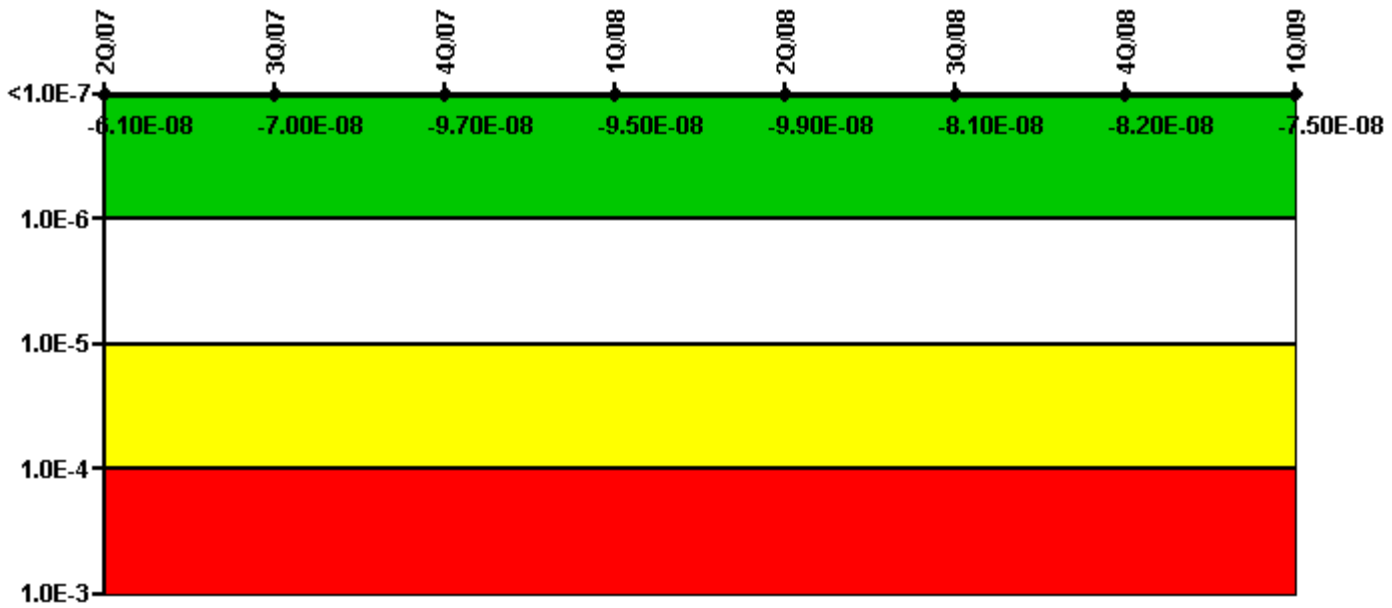


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	3.90E-08	4.00E-08	2.30E-08	2.50E-08	2.10E-08	3.90E-08	3.80E-08	4.50E-08
URI (Δ CDF)	-1.00E-07	-1.10E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.10E-08	-7.00E-08	-9.70E-08	-9.50E-08	-9.90E-08	-8.10E-08	-8.20E-08	-7.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

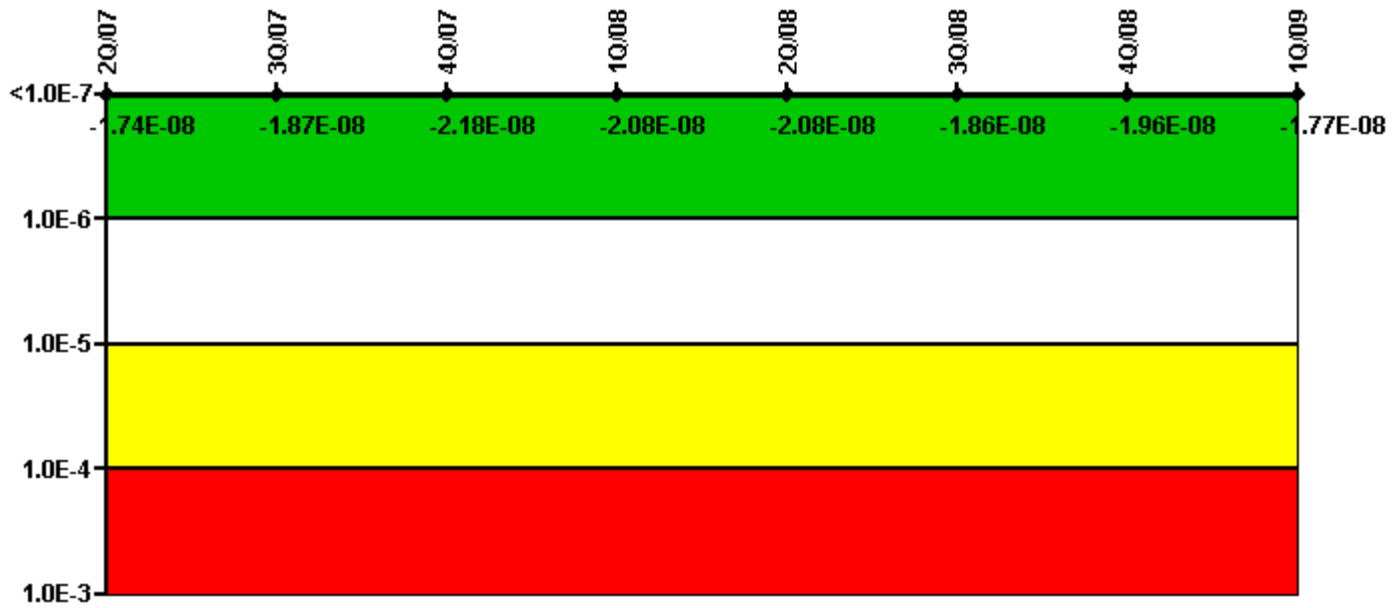


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	-3.40E-09	-4.70E-09	-4.80E-09	-4.80E-09	-4.80E-09	-2.60E-09	-4.60E-09	-2.70E-09
URI (Δ CDF)	-1.40E-08	-1.40E-08	-1.70E-08	-1.60E-08	-1.60E-08	-1.60E-08	-1.50E-08	-1.50E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.74E-08	-1.87E-08	-2.18E-08	-2.08E-08	-2.08E-08	-1.86E-08	-1.96E-08	-1.77E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

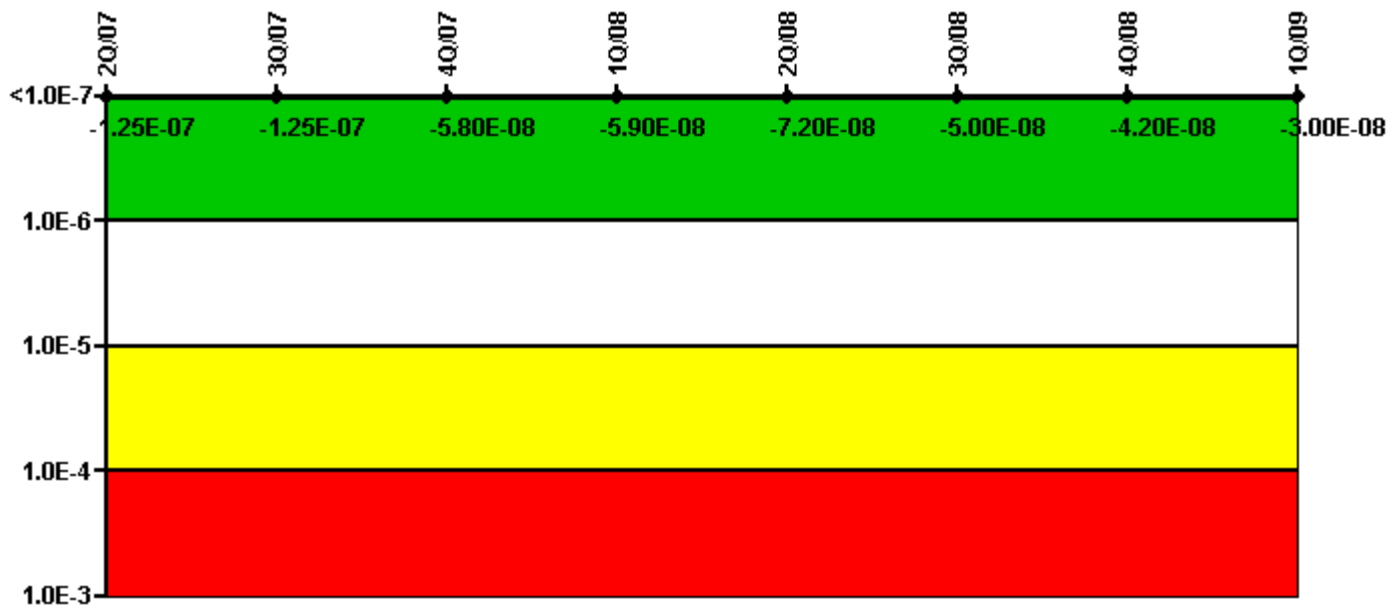


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	4.80E-09	5.00E-09	9.20E-08	9.10E-08	7.80E-08	1.00E-07	9.80E-08	1.20E-07
URI (Δ CDF)	-1.30E-07	-1.30E-07	-1.50E-07	-1.50E-07	-1.50E-07	-1.50E-07	-1.40E-07	-1.50E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.25E-07	-1.25E-07	-5.80E-08	-5.90E-08	-7.20E-08	-5.00E-08	-4.20E-08	-3.00E-08

Licensee Comments: none

Reactor Coolant System Activity

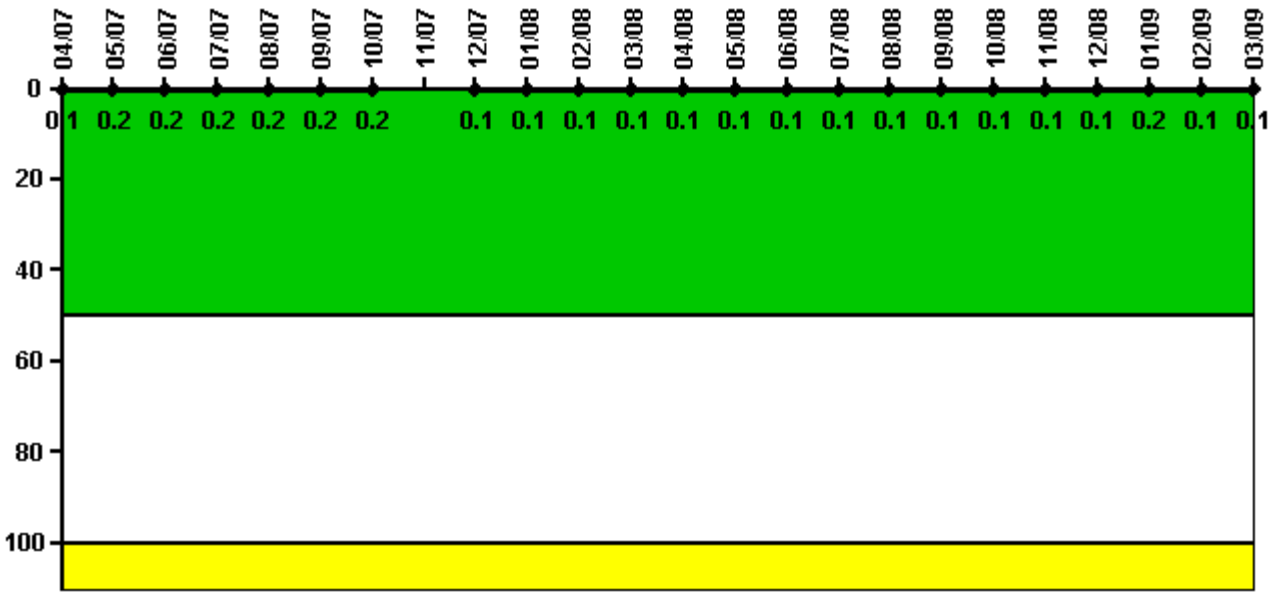

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum activity	0.001430	0.001560	0.001520	0.001620	0.002360	0.001630	0.001750	N/A	0.001060	0.001250	0.001120	0.000964
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.2	0.2	0.2	0.2	0.2	0.2	N/A	0.1	0.1	0.1	0.1

Reactor Coolant System Activity	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum activity	0.000905	0.001270	0.001210	0.001070	0.001030	0.001100	0.001140	0.001310	0.001410	0.001580	0.001420	0.001480
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

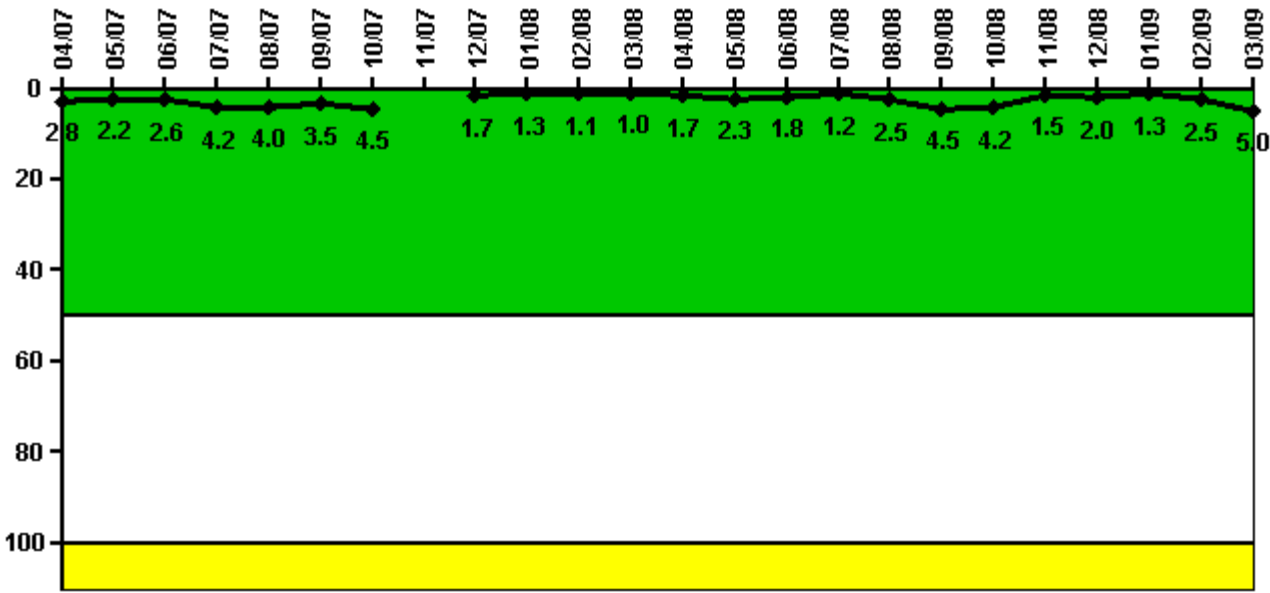


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum leakage	0.280	0.220	0.260	0.420	0.400	0.350	0.450	N/A	0.170	0.130	0.110	0.100
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.8	2.2	2.6	4.2	4.0	3.5	4.5	N/A	1.7	1.3	1.1	1.0
Reactor Coolant System Leakage	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum leakage	0.170	0.230	0.180	0.120	0.250	0.450	0.420	0.150	0.200	0.130	0.250	0.500
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.7	2.3	1.8	1.2	2.5	4.5	4.2	1.5	2.0	1.3	2.5	5.0

Licensee Comments: none

Drill/Exercise Performance

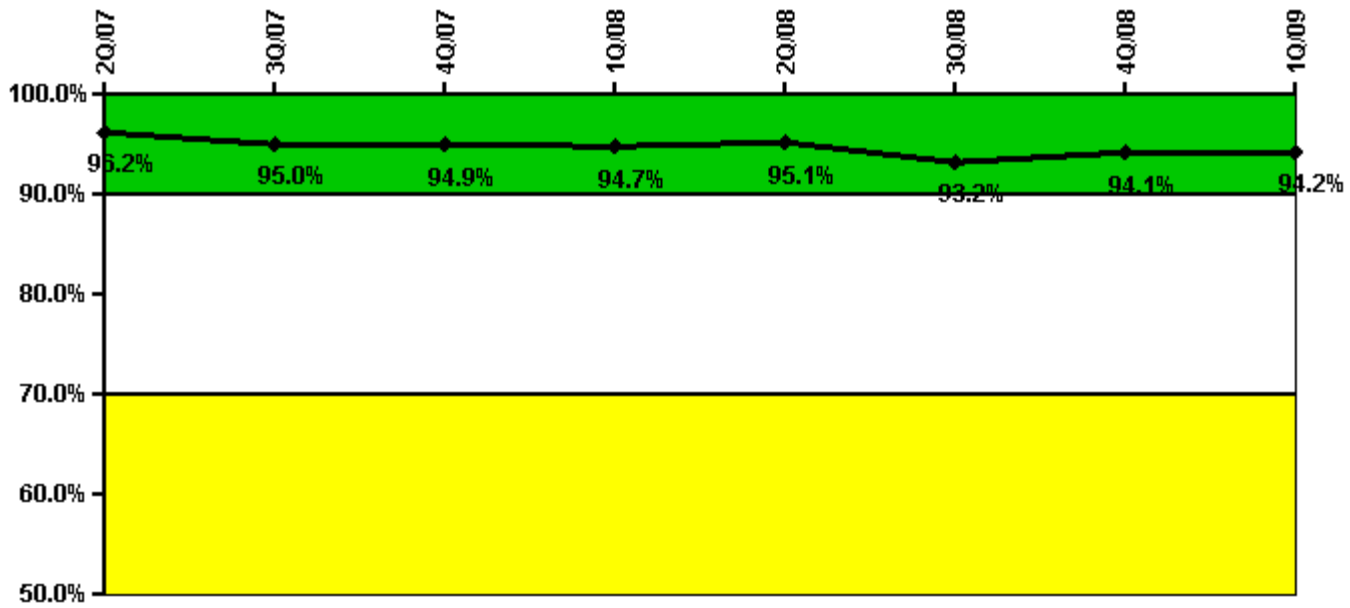


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Successful opportunities	25.0	18.0	24.0	43.0	41.0	37.0	20.0	36.0
Total opportunities	26.0	20.0	24.0	45.0	42.0	43.0	21.0	38.0
Indicator value	96.2%	95.0%	94.9%	94.7%	95.1%	93.2%	94.1%	94.2%

Licensee Comments: none

ERO Drill Participation

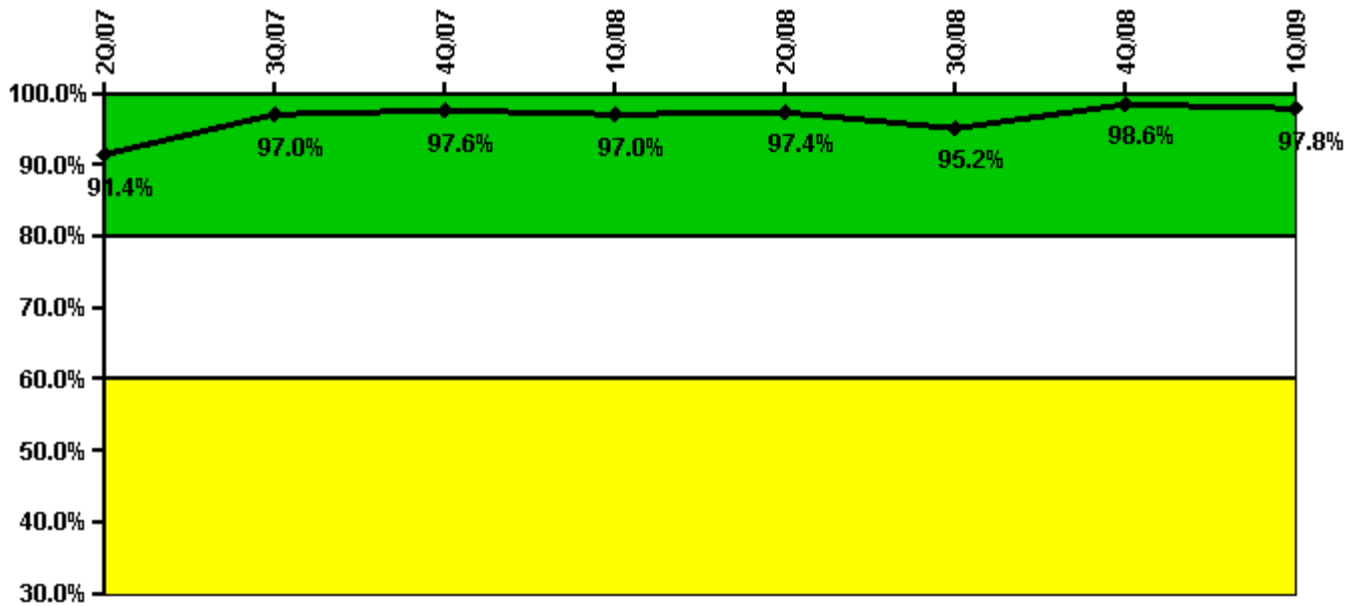

Thresholds: White < 80.0% Yellow < 60.0%


Notes

ERO Drill Participation	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Participating Key personnel	159.0	164.0	160.0	128.0	149.0	138.0	144.0	133.0
Total Key personnel	174.0	169.0	164.0	132.0	153.0	145.0	146.0	136.0
Indicator value	91.4%	97.0%	97.6%	97.0%	97.4%	95.2%	98.6%	97.8%

Licensee Comments:

1Q/09: A self assessment recognized an incorrect count of ERO personnel for October, November and December 2008. Historical data was corrected with no change in color.

Alert & Notification System

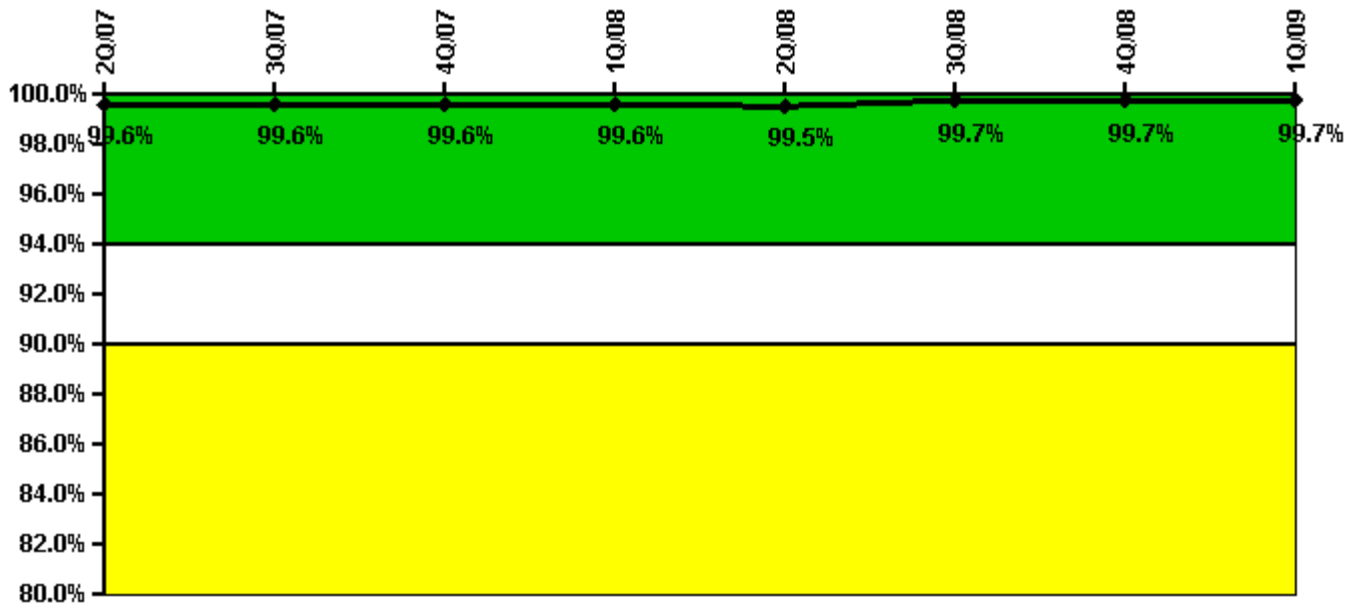


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Successful siren-tests	474	539	476	543	472	475	544	476
Total sirens-tests	476	544	476	544	476	476	544	476
Indicator value	99.6%	99.6%	99.6%	99.6%	99.5%	99.7%	99.7%	99.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness

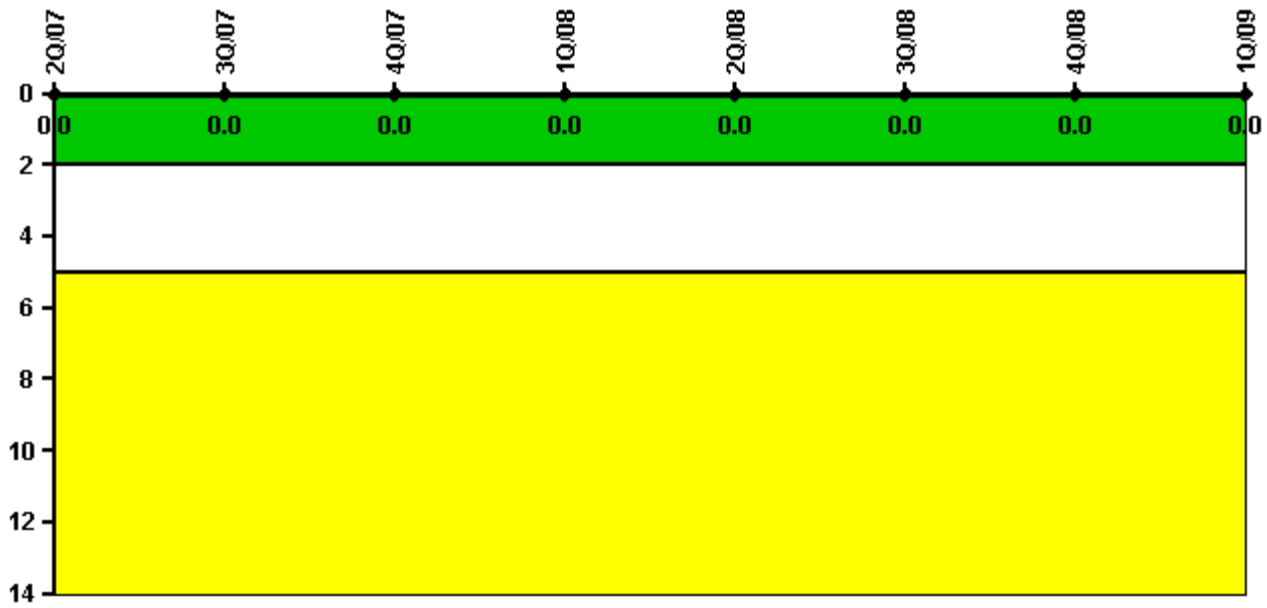


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

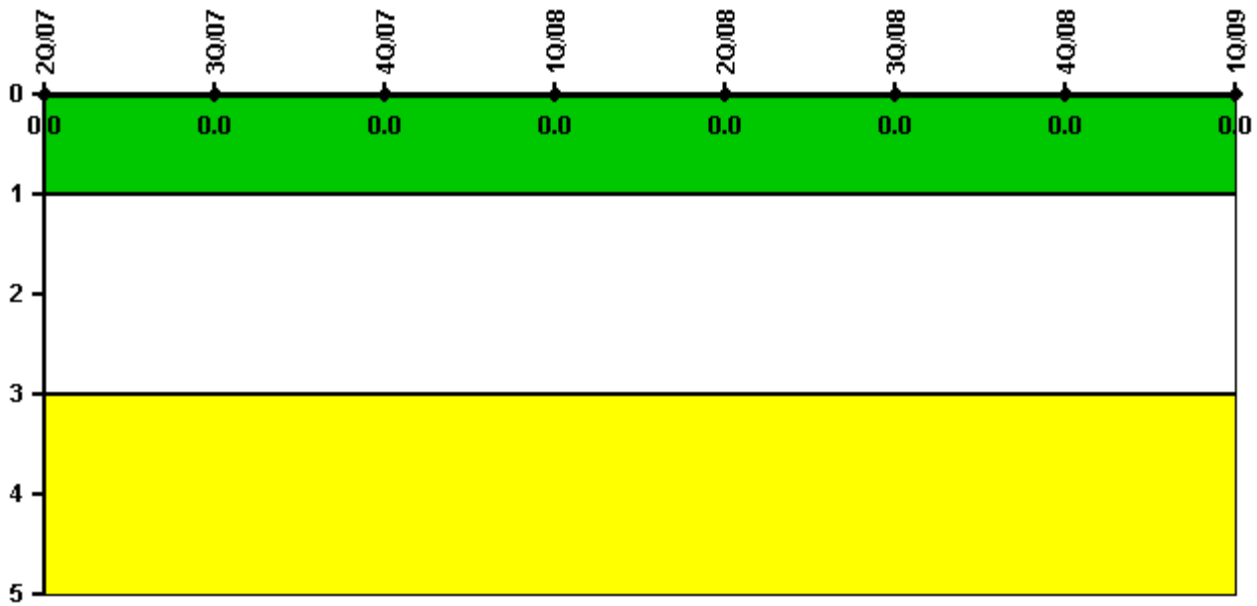

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.