


Turkey Point 4

1Q/2009 Performance Indicators

Licensee's General Comments: The guidance document NEI 99-02 suggests that data not be reported until the associated LER 2008-02 "SI Isolated in Mode 3 Due to Inadequate Configuration Control" was actually issued to NRC. It was not issued until July, 2008. It was reported in 2nd quarter data due to an administrative error. So the database was corrected to report in in the 3rd quarter of 2008, rather than the 2nd quarter.

Unplanned Scrams per 7000 Critical Hrs

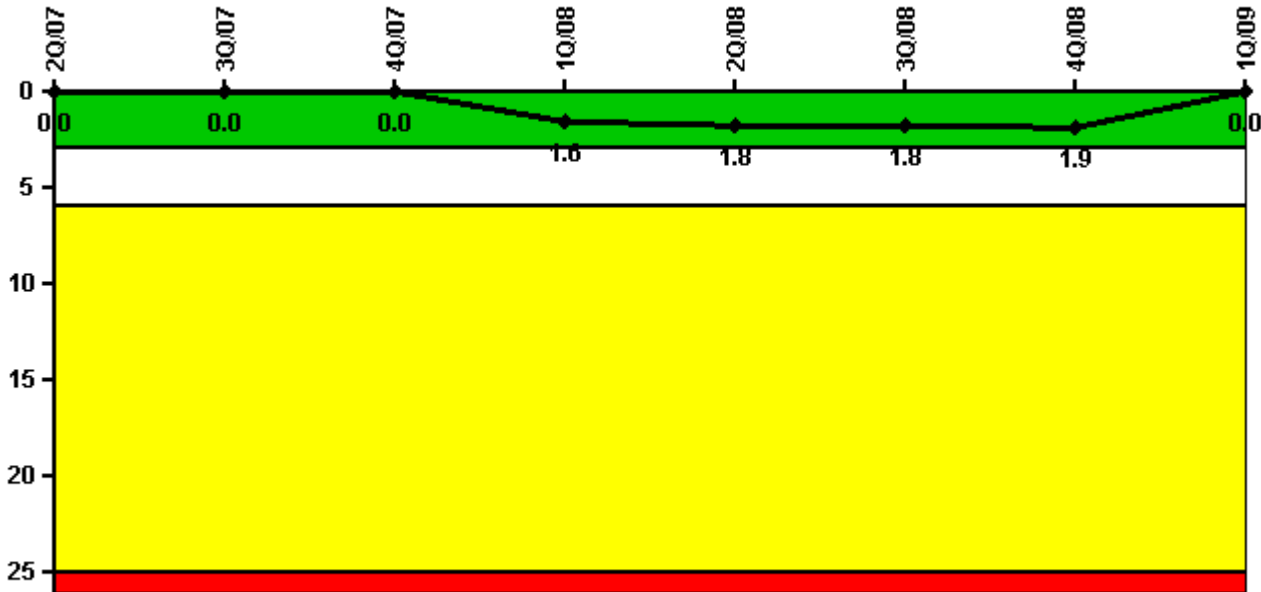


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Unplanned scrams	0	0	0	2.0	0	0	0	0
Critical hours	2184.0	2077.1	2209.0	2098.6	1255.6	2019.8	2144.4	2159.0
Indicator value	0	0	0	1.6	1.8	1.8	1.9	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

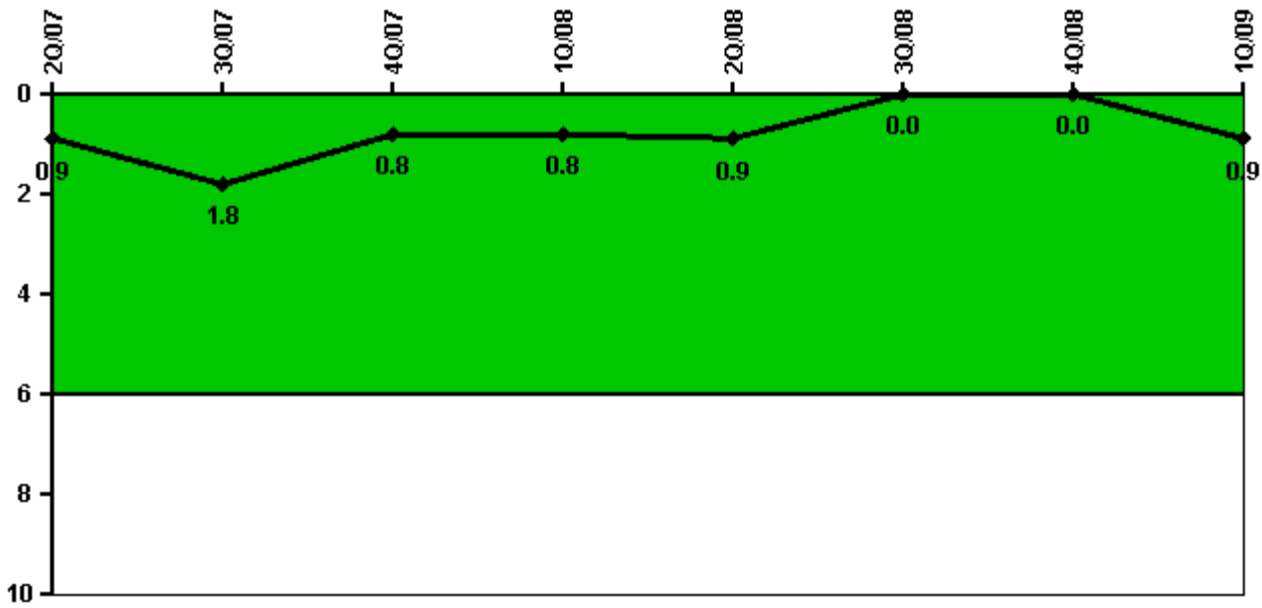

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Unplanned power changes	0	1.0	0	0	0	0	0	1.0
Critical hours	2184.0	2077.1	2209.0	2098.6	1255.6	2019.8	2144.4	2159.0
Indicator value	0.9	1.8	0.8	0.8	0.9	0	0	0.9

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value		0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

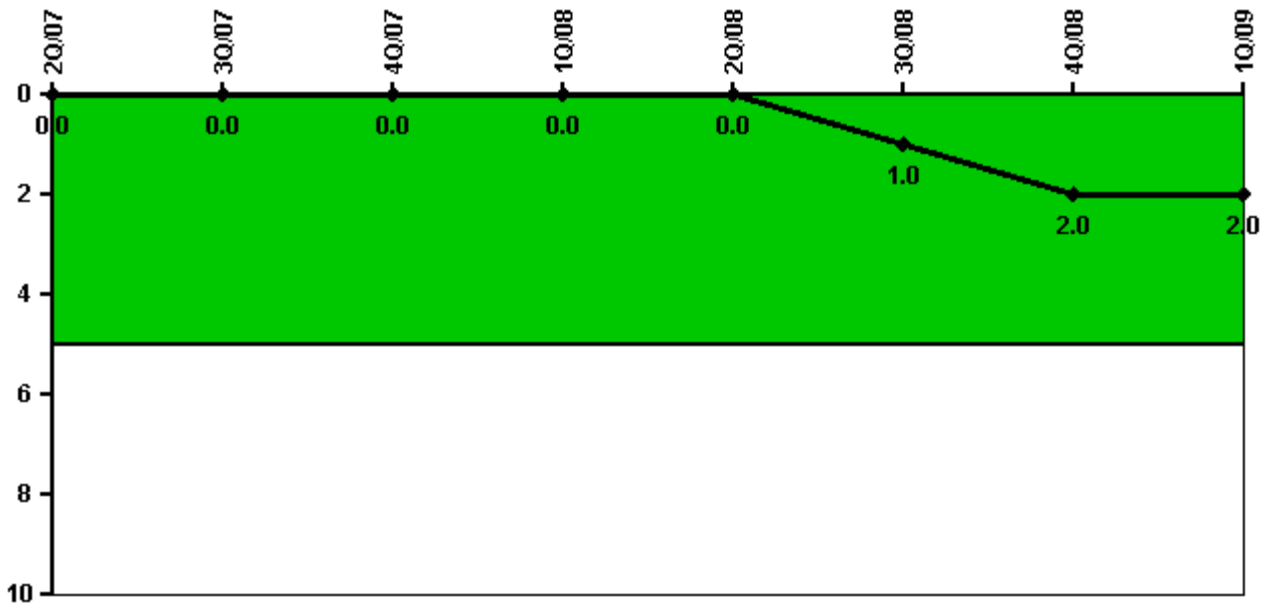

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Safety System Functional Failures	0	0	0	0	0	1	1	0
Indicator value	0	0	0	0	0	1	2	2

Licensee Comments:

3Q/08: LER 2008-02, Safety Injection Isolated in Mode 3 Due to Inadequate Configuration Control, issued 7/2/08

Mitigating Systems Performance Index, Emergency AC Power System

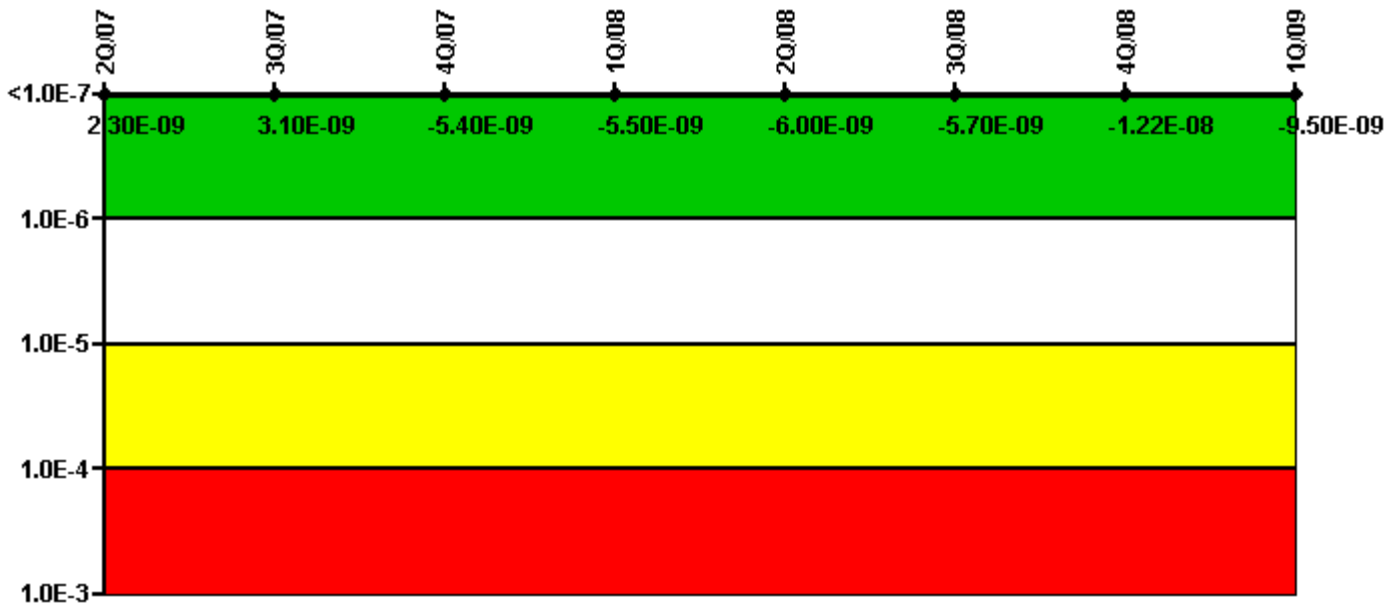


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	6.20E-09	6.60E-09	1.70E-09	1.70E-09	1.60E-09	2.00E-09	1.80E-09	4.50E-09
URI (Δ CDF)	-3.90E-09	-3.50E-09	-7.10E-09	-7.20E-09	-7.60E-09	-7.70E-09	-1.40E-08	-1.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.30E-09	3.10E-09	-5.40E-09	-5.50E-09	-6.00E-09	-5.70E-09	-1.22E-08	-9.50E-09

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

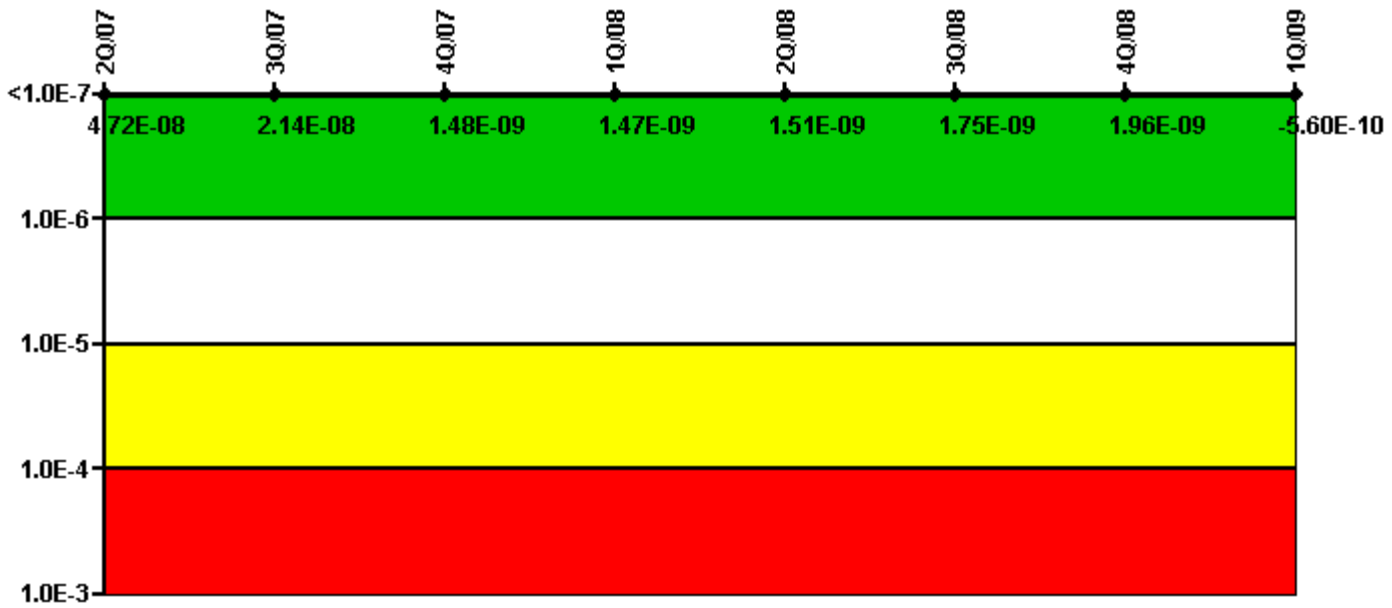


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	-1.80E-09	-1.60E-09	7.60E-11	6.90E-11	1.10E-10	3.50E-10	5.60E-10	5.40E-10
URI (Δ CDF)	4.90E-08	2.30E-08	1.40E-09	1.40E-09	1.40E-09	1.40E-09	1.40E-09	-1.10E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.72E-08	2.14E-08	1.48E-09	1.47E-09	1.51E-09	1.75E-09	1.96E-09	5.60E-10

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

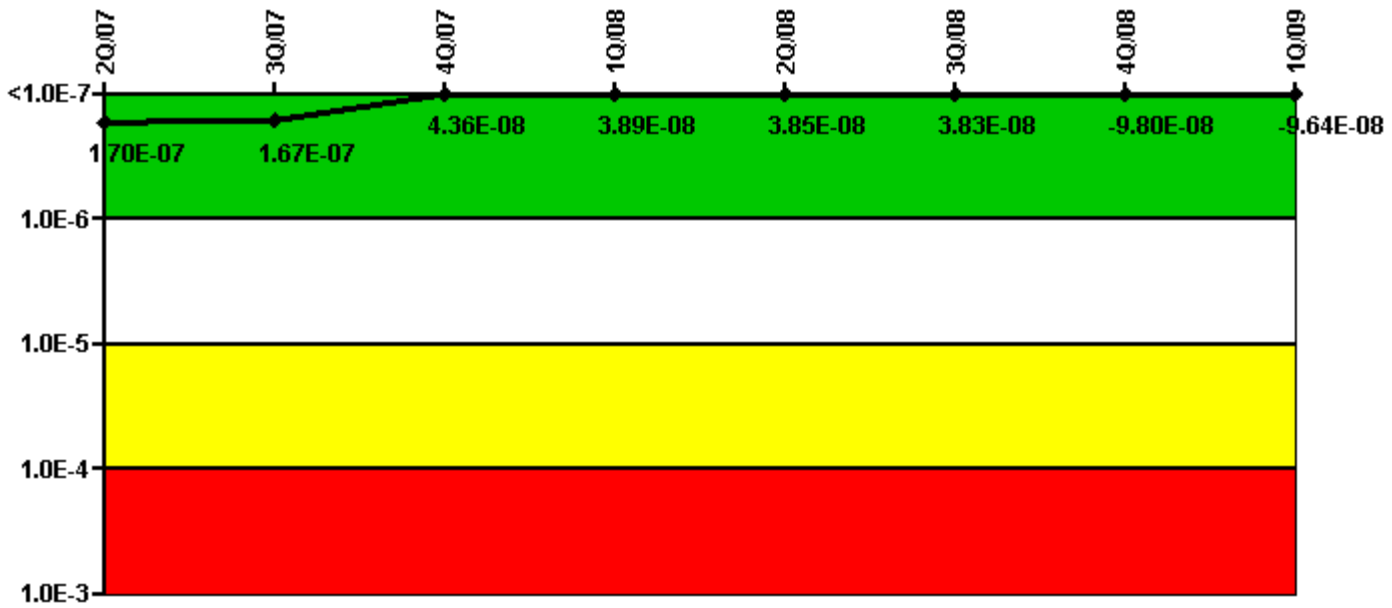


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	9.90E-09	7.30E-09	5.60E-09	8.60E-10	4.50E-10	3.30E-10	-2.50E-11	3.60E-09
URI (Δ CDF)	1.60E-07	1.60E-07	3.80E-08	3.80E-08	3.80E-08	3.80E-08	-9.80E-08	-1.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.70E-07	1.67E-07	4.36E-08	3.89E-08	3.85E-08	3.83E-08	-9.80E-08	-9.64E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

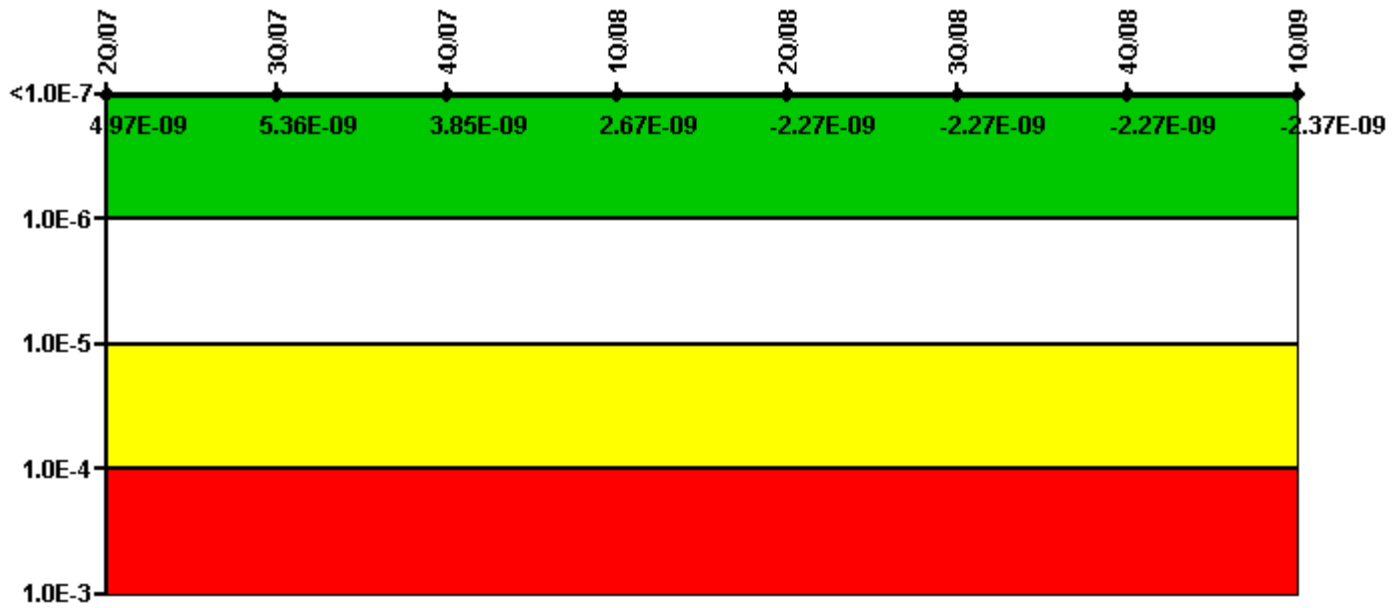


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	-2.70E-11	5.60E-10	9.50E-10	-3.50E-11	-4.70E-10	-4.70E-10	-4.70E-10	-4.70E-10
URI (Δ CDF)	5.00E-09	4.80E-09	2.90E-09	2.70E-09	-1.80E-09	-1.80E-09	-1.80E-09	-1.90E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.97E-09	5.36E-09	3.85E-09	2.67E-09	-2.27E-09	-2.27E-09	-2.27E-09	-2.37E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

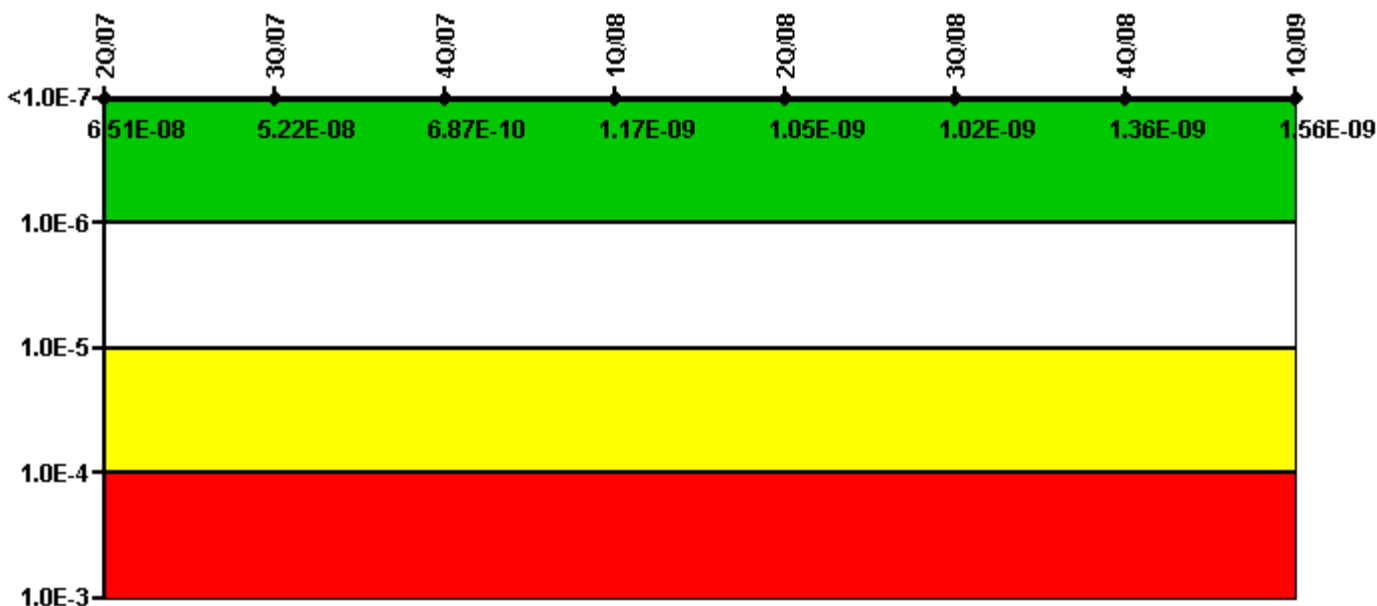


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
UAI (Δ CDF)	6.40E-08	5.10E-08	6.00E-10	8.00E-10	9.90E-10	9.60E-10	1.30E-09	1.50E-09
URI (Δ CDF)	1.10E-09	1.20E-09	8.70E-11	3.70E-10	6.00E-11	6.10E-11	6.20E-11	6.10E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.51E-08	5.22E-08	6.87E-10	1.17E-09	1.05E-09	1.02E-09	1.36E-09	1.56E-09

Licensee Comments: none

Reactor Coolant System Activity

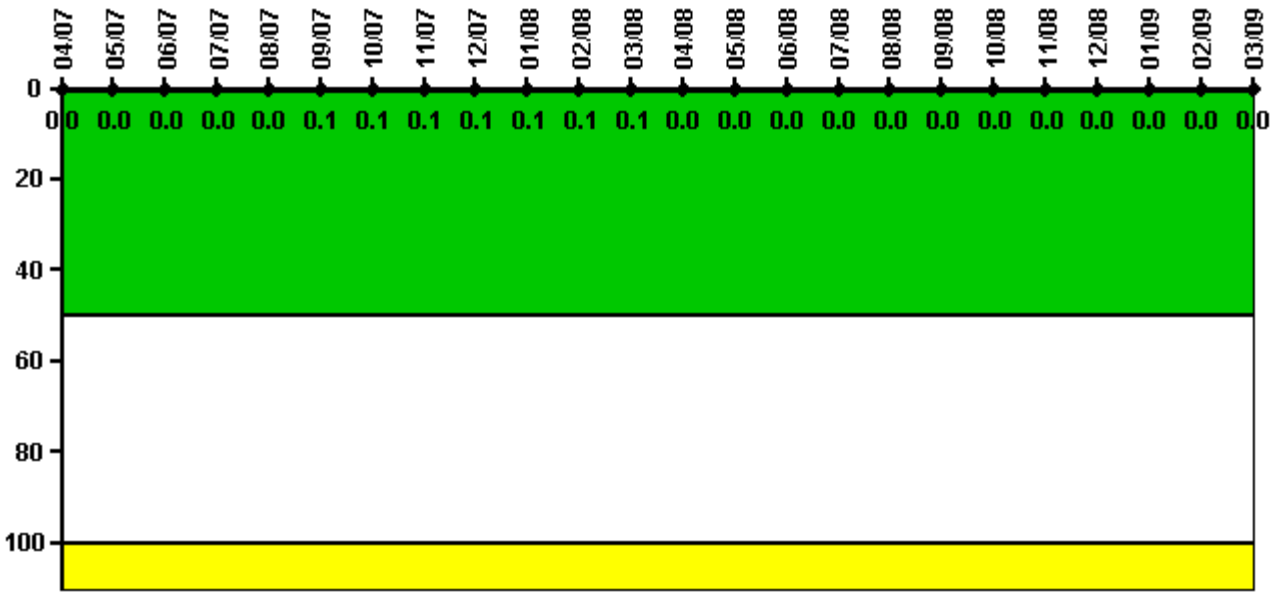

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum activity	0.000397	0.000397	0.000397	0.000427	0.000458	0.000641	0.000641	0.000580	0.000549	0.000710	0.000605	0.000657
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Reactor Coolant System Activity	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum activity	0.000005	0.000286	0.000280	0.000308	0.000308	0.000319	0.000320	0.000369	0.000377	0.000402	0.000391	0.000489
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

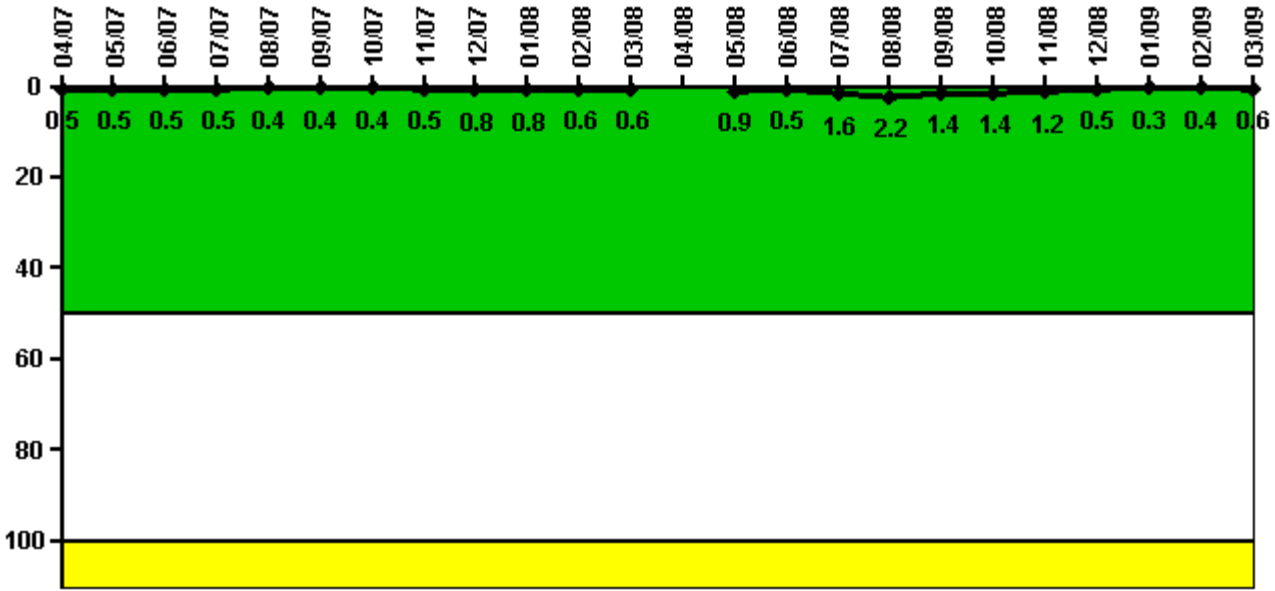


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum leakage	0.050	0.050	0.050	0.050	0.040	0.040	0.040	0.050	0.080	0.080	0.060	0.060
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.5	0.5	0.5	0.4	0.4	0.4	0.5	0.8	0.8	0.6	0.6
Reactor Coolant System Leakage	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum leakage	N/A	0.090	0.050	0.160	0.220	0.140	0.140	0.120	0.050	0.030	0.040	0.060
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	N/A	0.9	0.5	1.6	2.2	1.4	1.4	1.2	0.5	0.3	0.4	0.6

Licensee Comments: none

Drill/Exercise Performance

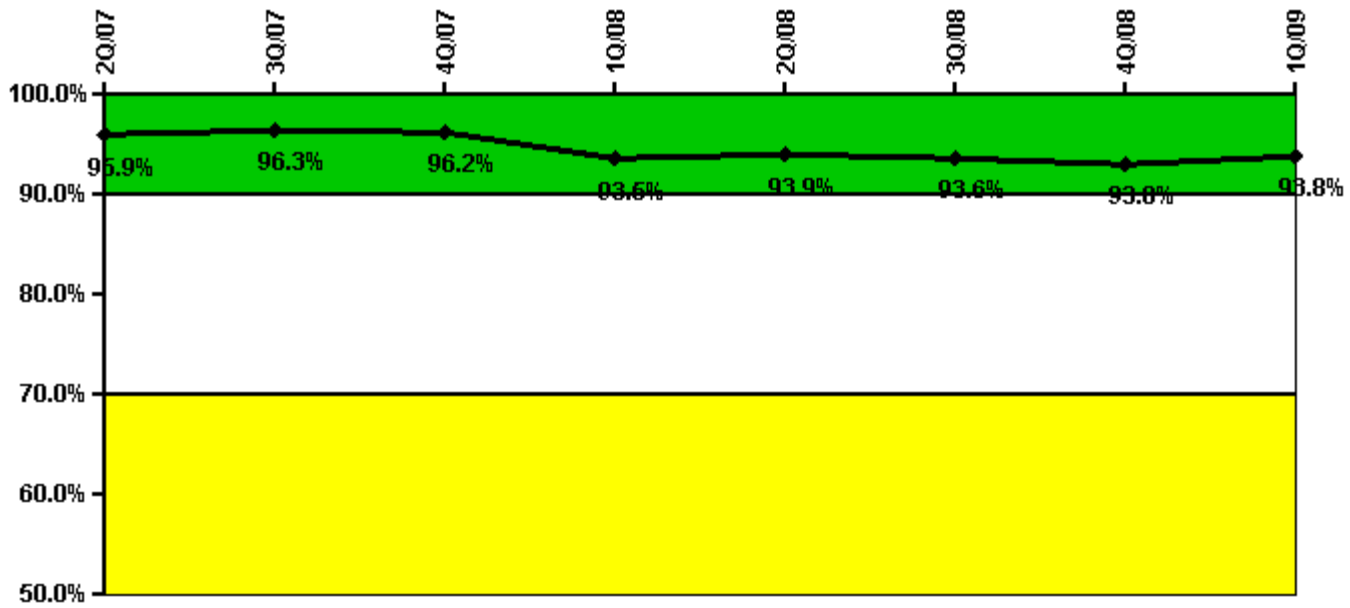


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Successful opportunities	34.0	30.0	36.0	37.0	40.0	20.0	38.0	68.0
Total opportunities	35.0	30.0	38.0	45.0	42.0	20.0	41.0	72.0
Indicator value	95.9%	96.3%	96.2%	93.5%	93.9%	93.6%	93.0%	93.8%

Licensee Comments: none

ERO Drill Participation

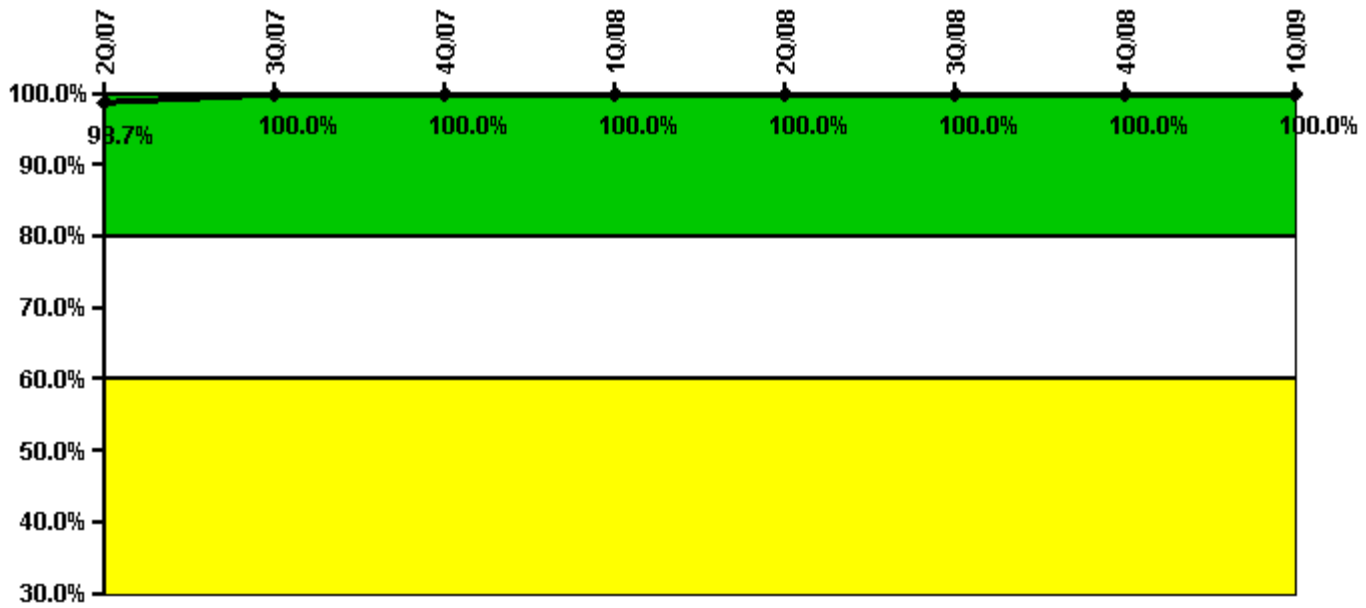


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Participating Key personnel	78.0	83.0	82.0	80.0	85.0	92.0	85.0	81.0
Total Key personnel	79.0	83.0	82.0	80.0	85.0	92.0	85.0	81.0
Indicator value	98.7%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

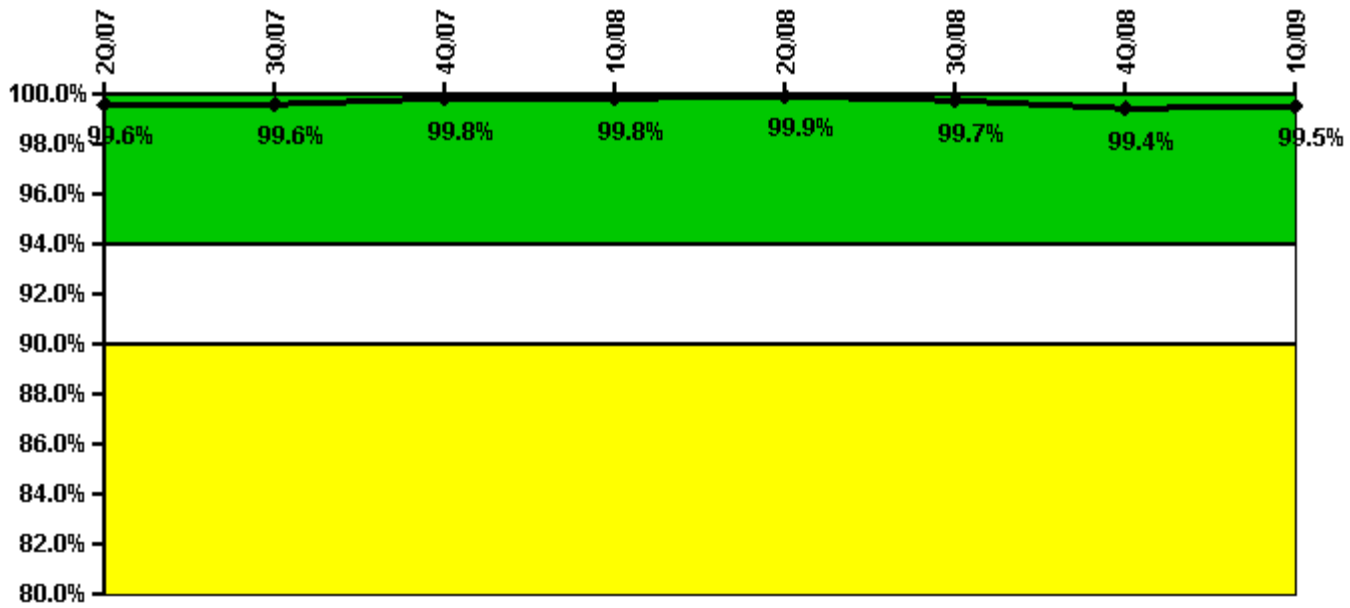


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
Successful siren-tests	375	328	376	375	329	372	326	329
Total sirens-tests	376	329	376	376	329	376	329	329
Indicator value	99.6%	99.6%	99.8%	99.8%	99.9%	99.7%	99.4%	99.5%

Licensee Comments: none

Occupational Exposure Control Effectiveness

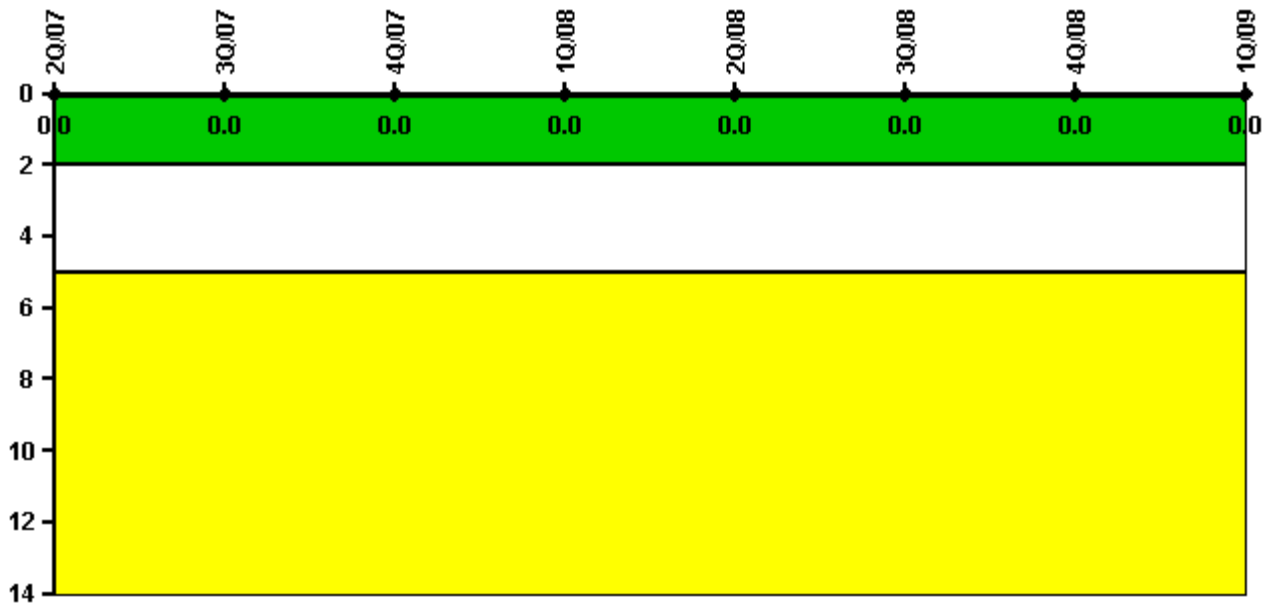

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.