


# Catawba 2

## 2Q/2009 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

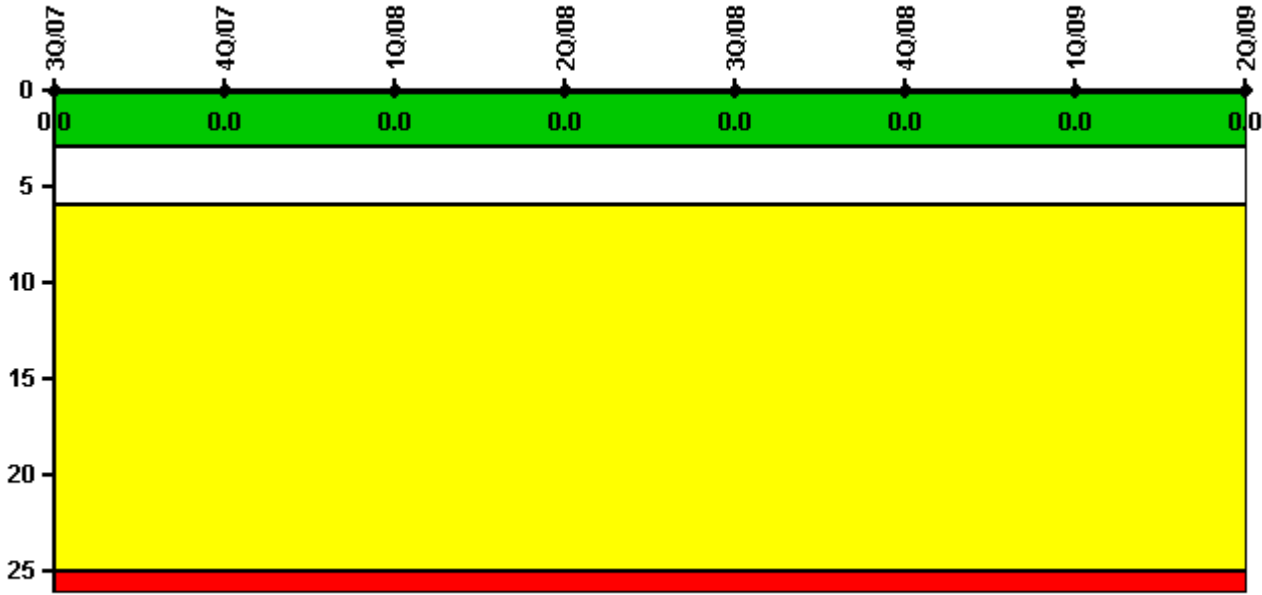


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1826.1	1137.3	2183.0	2184.0	2208.0	2209.0	1564.2	1767.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

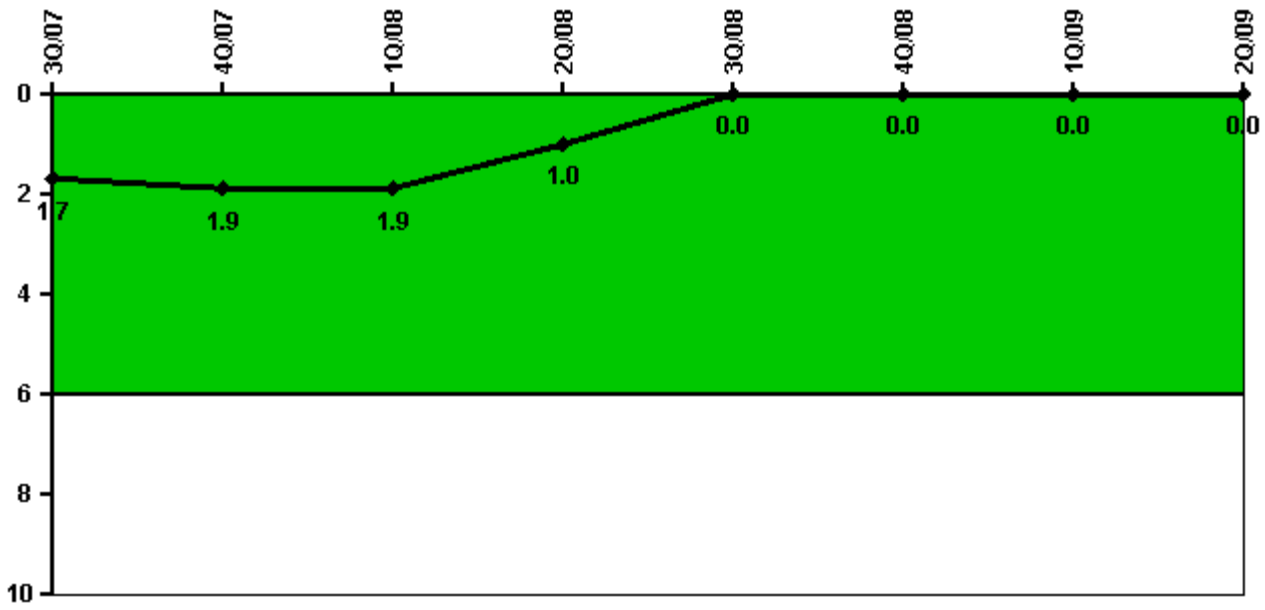


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Unplanned power changes	1.0	0	0	0	0	0	0	0
Critical hours	1826.1	1137.3	2183.0	2184.0	2208.0	2209.0	1564.2	1767.0
Indicator value	1.7	1.9	1.9	1.0	0	0	0	0

Licensee Comments: none

# Unplanned Scrams with Complications

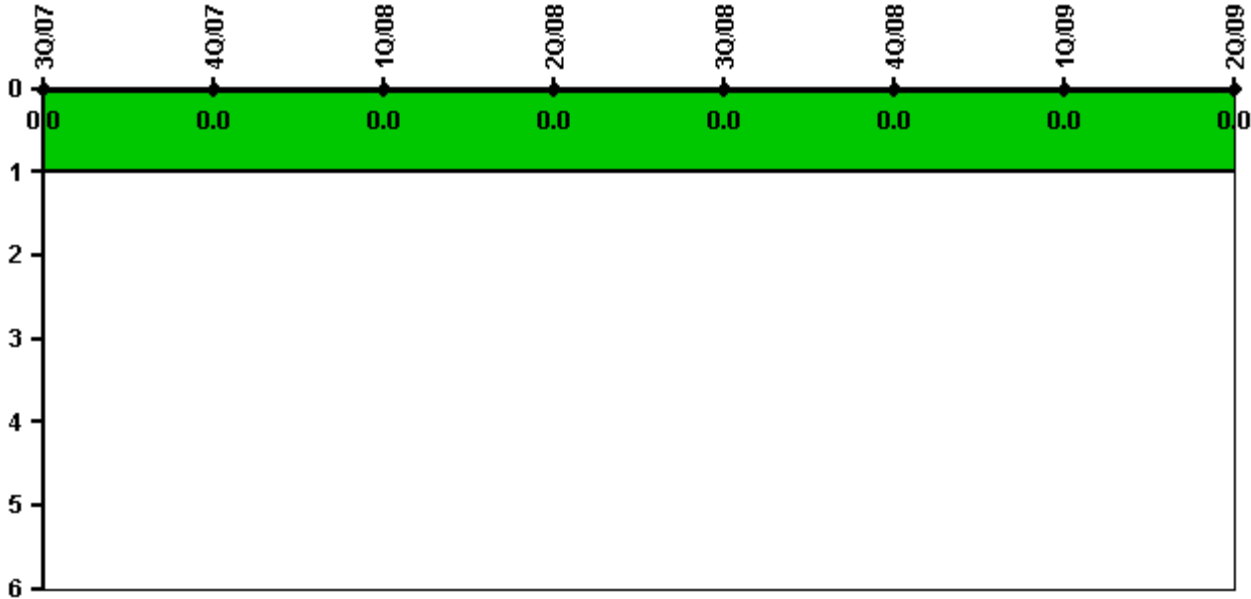


Thresholds: White > 1.0

**Notes**

Unplanned Scrams with Complications	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (PWR)

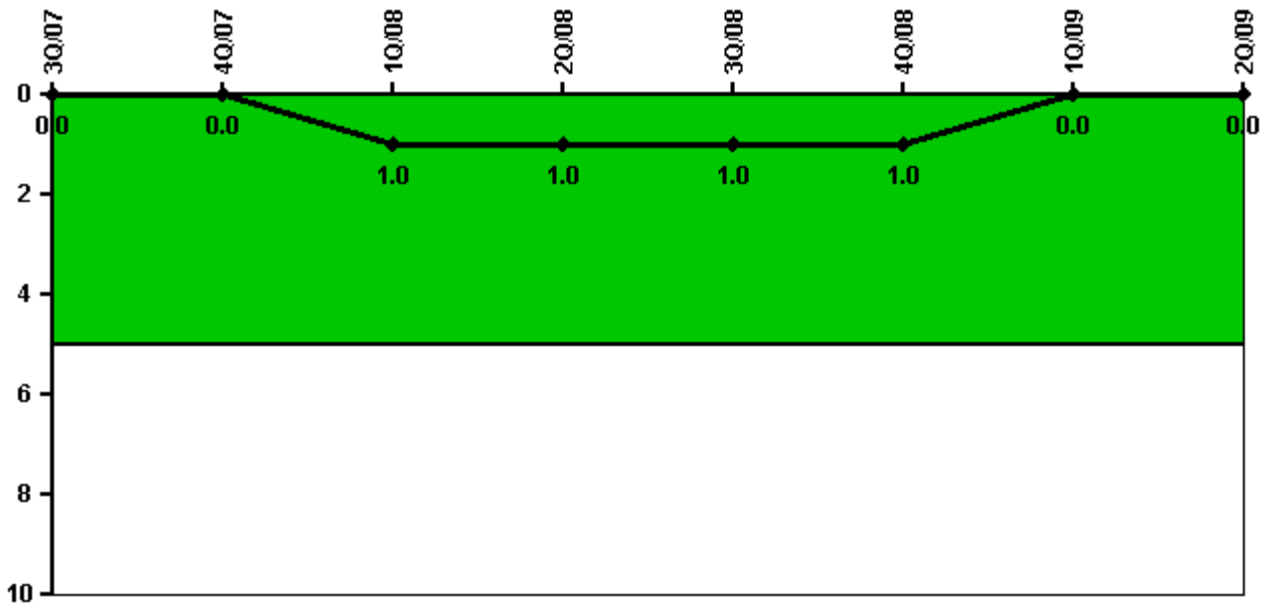


Thresholds: White > 5.0

### Notes

Safety System Functional Failures (PWR)	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Safety System Functional Failures	0	0	1	0	0	0	0	0
Indicator value	0	0	1	1	1	1	0	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

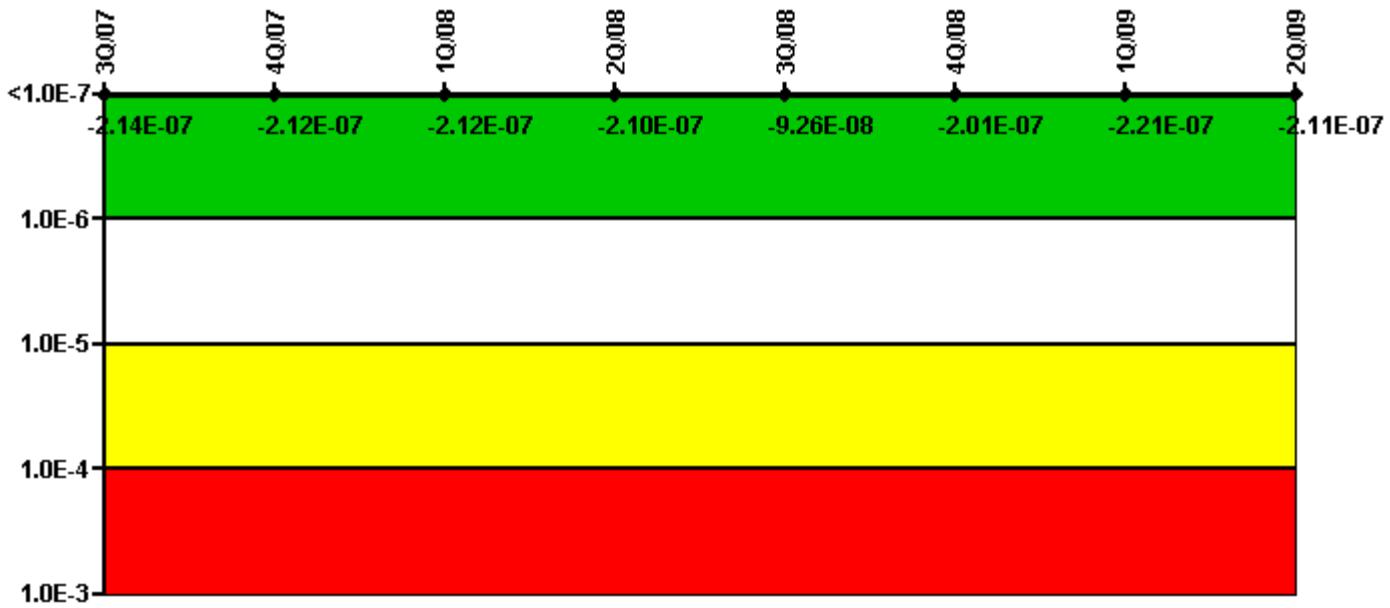


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	-1.40E-08	-1.20E-08	-1.20E-08	-9.60E-09	-5.90E-10	-1.40E-09	-2.10E-08	-2.10E-08
URI ( $\Delta$ CDF)	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-9.20E-08	-2.00E-07	-2.00E-07	-1.90E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.14E-07	-2.12E-07	-2.12E-07	-2.10E-07	-9.26E-08	-2.01E-07	-2.21E-07	-2.11E-07

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

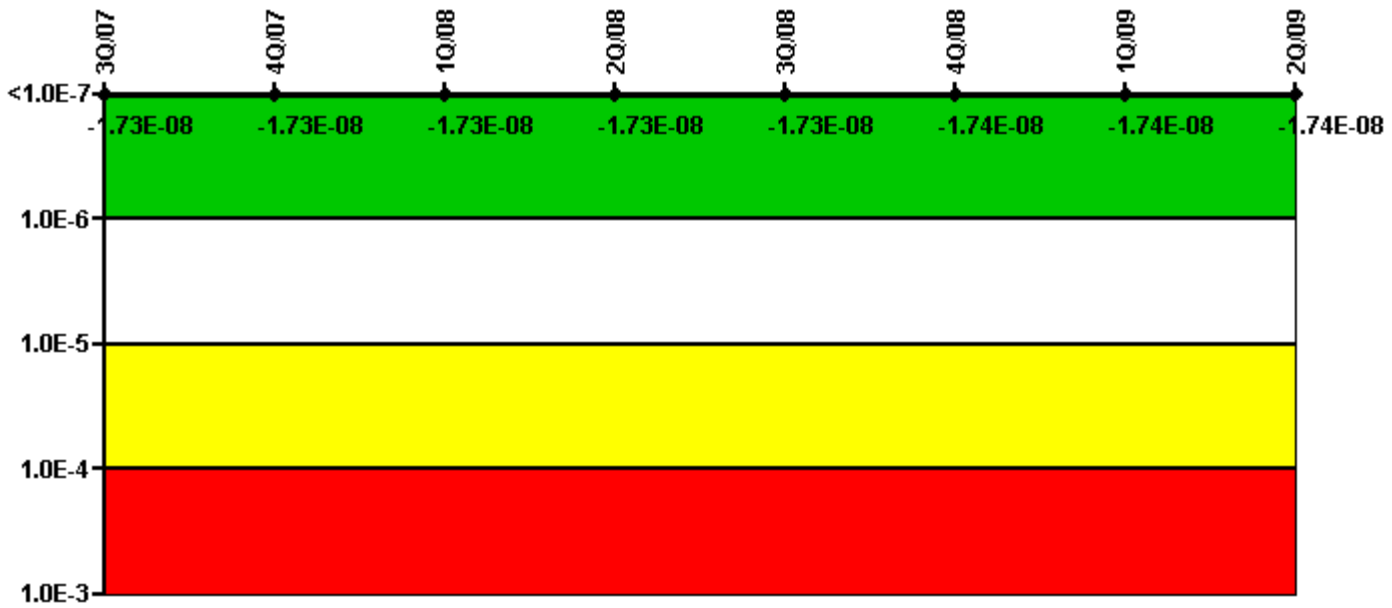


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09	-4.40E-09	-4.40E-09	-4.40E-09
URI ( $\Delta$ CDF)	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.73E-08	-1.73E-08	-1.73E-08	-1.73E-08	-1.73E-08	-1.74E-08	-1.74E-08	-1.74E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

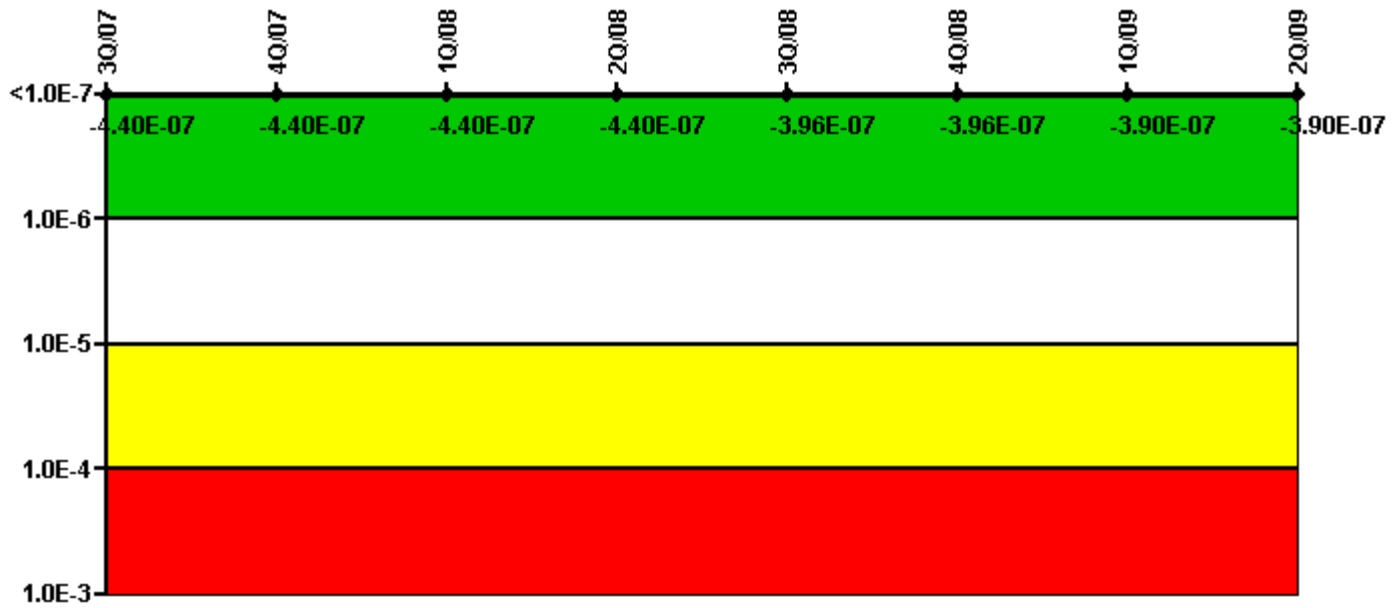


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-7.60E-08	-7.60E-08	-7.00E-08	-7.00E-08
URI ( $\Delta$ CDF)	-3.20E-07	-3.20E-07	-3.20E-07	-3.20E-07	-3.20E-07	-3.20E-07	-3.20E-07	-3.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.40E-07	-4.40E-07	-4.40E-07	-4.40E-07	-3.96E-07	-3.96E-07	-3.90E-07	-3.90E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

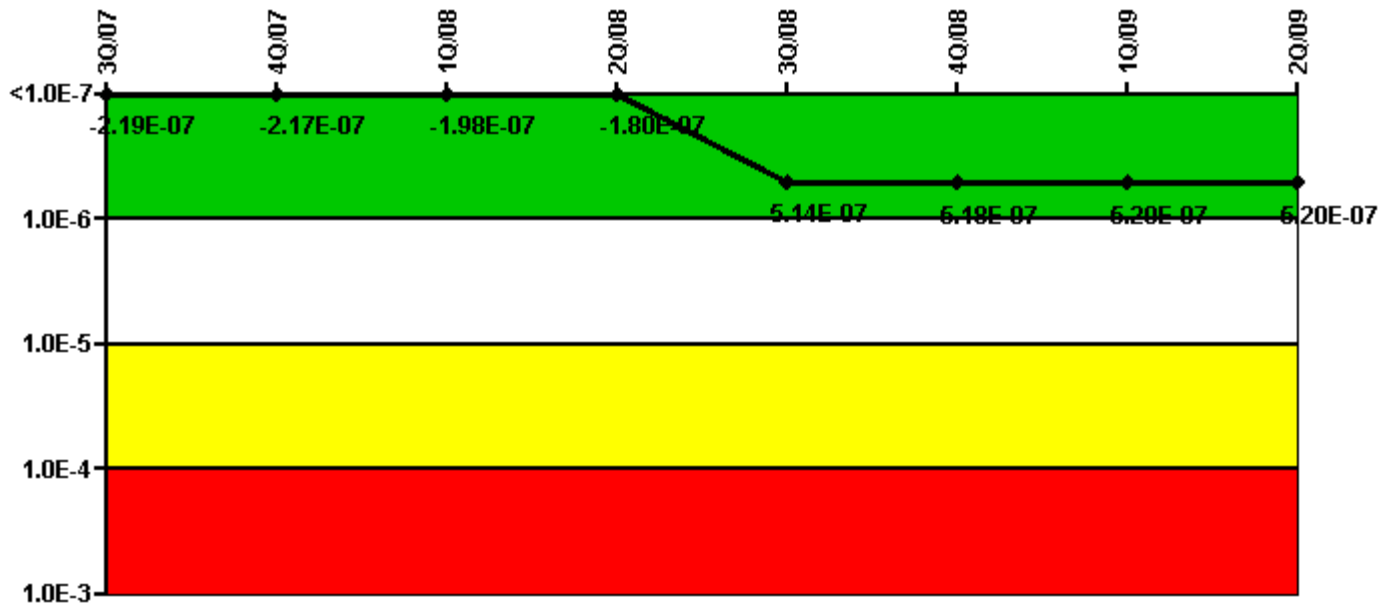

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	-4.90E-08	-4.70E-08	-2.80E-08	-9.80E-09	9.40E-08	9.80E-08	1.00E-07	1.00E-07
URI ( $\Delta$ CDF)	-1.70E-07	-1.70E-07	-1.70E-07	-1.70E-07	4.20E-07	4.20E-07	4.20E-07	4.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.19E-07	-2.17E-07	-1.98E-07	-1.80E-07	5.14E-07	5.18E-07	5.20E-07	5.20E-07

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

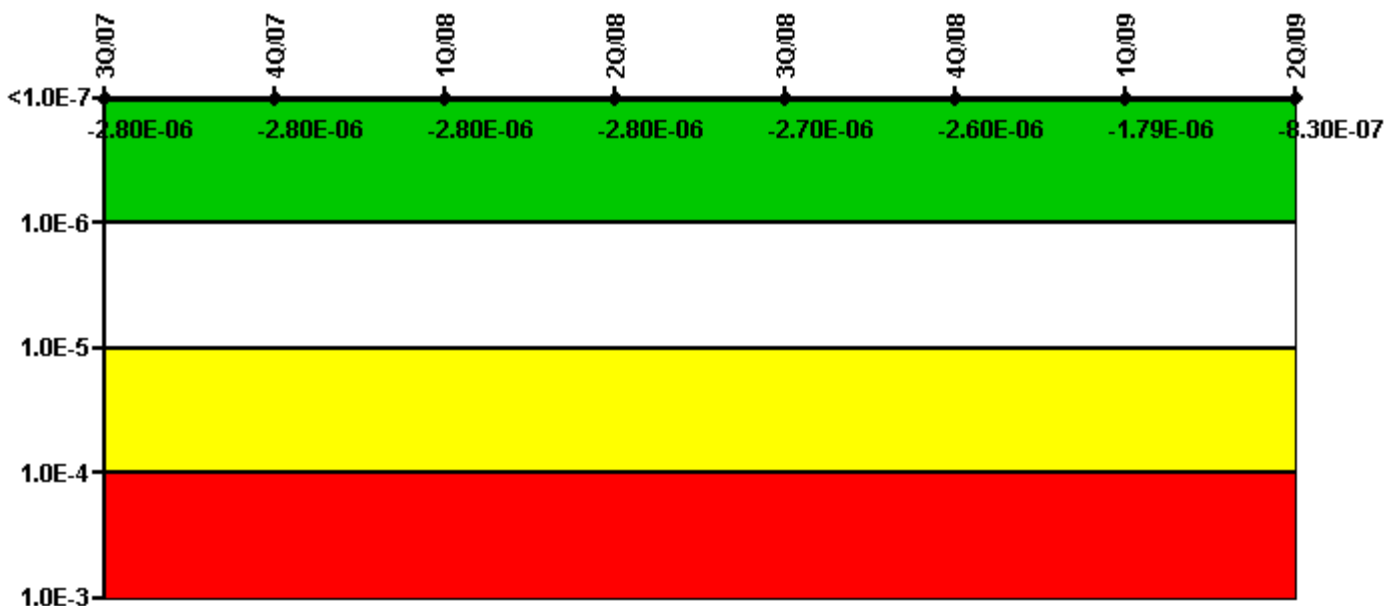


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	-1.60E-06	-1.60E-06	-1.60E-06	-1.60E-06	-1.50E-06	-1.40E-06	-5.90E-07	-4.50E-07
URI ( $\Delta$ CDF)	-1.20E-06	-1.20E-06	-1.20E-06	-1.20E-06	-1.20E-06	-1.20E-06	-1.20E-06	-3.80E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.80E-06	-2.80E-06	-2.80E-06	-2.80E-06	-2.70E-06	-2.60E-06	-1.79E-06	-8.30E-07

Licensee Comments: none

# Reactor Coolant System Activity

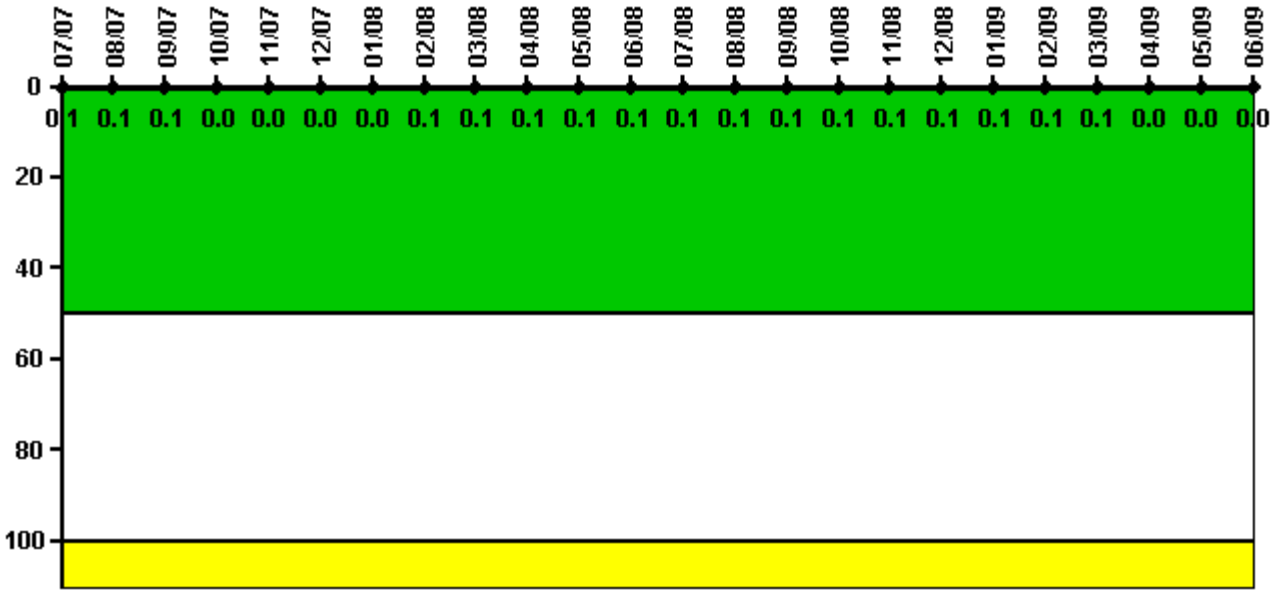

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Activity	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum activity	0.000464	0.000462	0.000380	0	0.000197	0.000218	0.000217	0.000247	0.000239	0.000267	0.000292	0.000328
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.1	0.1	0.1	0	0	0	0	0.1	0.1	0.1	0.1	0.1

Reactor Coolant System Activity	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum activity	0.000328	0.000322	0.000303	0.000331	0.000312	0.000311	0.000335	0.000293	0.000263	0.000143	0.000159	0.000186
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0	0	0

Licensee Comments: none

## Reactor Coolant System Leakage

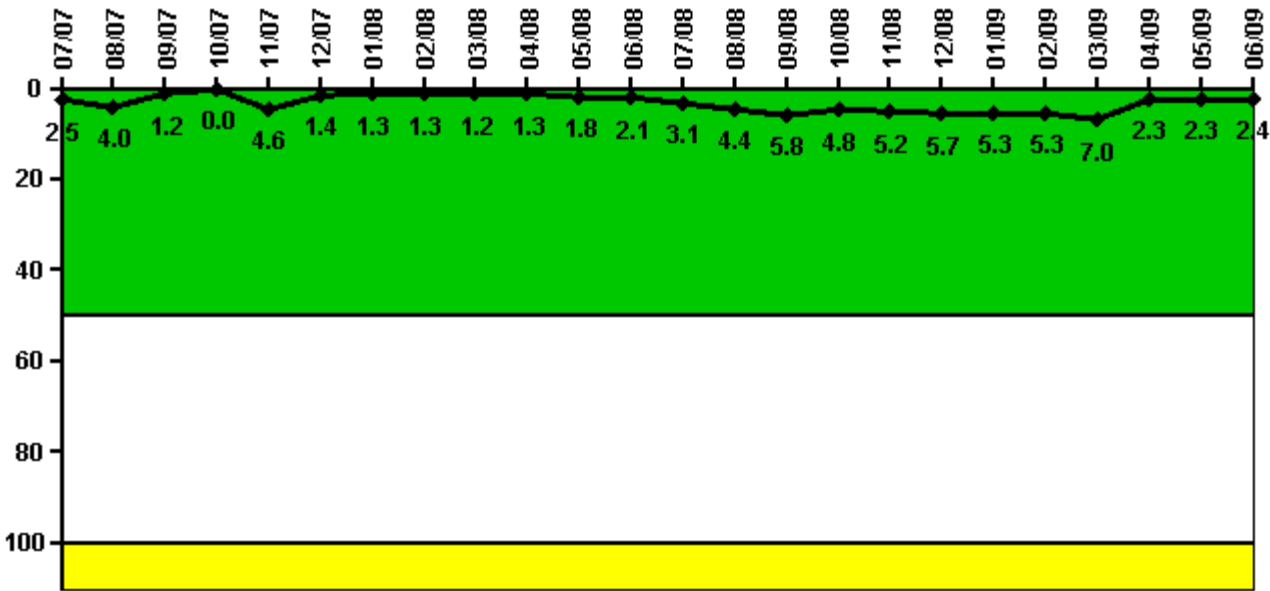


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum leakage	0.250	0.398	0.120	0	0.457	0.135	0.134	0.133	0.115	0.128	0.175	0.212
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.5	4.0	1.2	0	4.6	1.4	1.3	1.3	1.2	1.3	1.8	2.1
Reactor Coolant System Leakage	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum leakage	0.309	0.440	0.584	0.484	0.523	0.570	0.525	0.534	0.698	0.231	0.229	0.244
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	3.1	4.4	5.8	4.8	5.2	5.7	5.3	5.3	7.0	2.3	2.3	2.4

Licensee Comments: none

## Drill/Exercise Performance

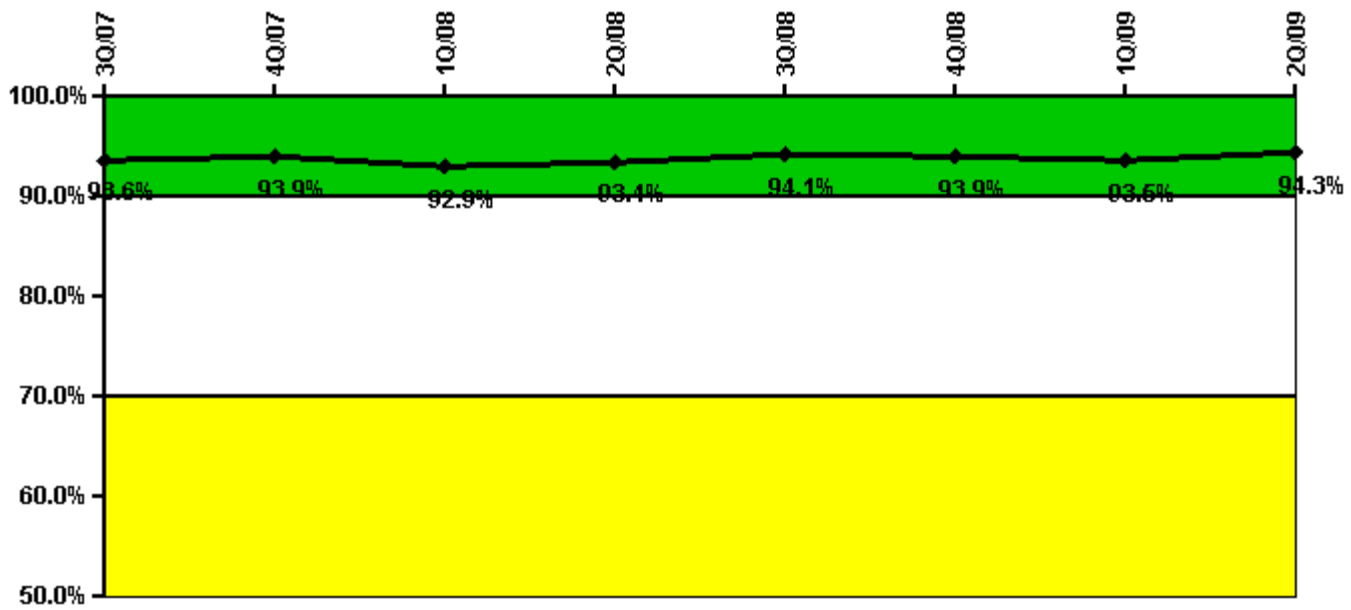


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Successful opportunities	95.0	24.0	54.0	36.0	65.0	16.0	3.0	19.0
Total opportunities	98.0	24.0	60.0	38.0	71.0	17.0	3.0	20.0
Indicator value	93.6%	93.9%	92.9%	93.4%	94.1%	93.9%	93.5%	94.3%

Licensee Comments: none

## ERO Drill Participation

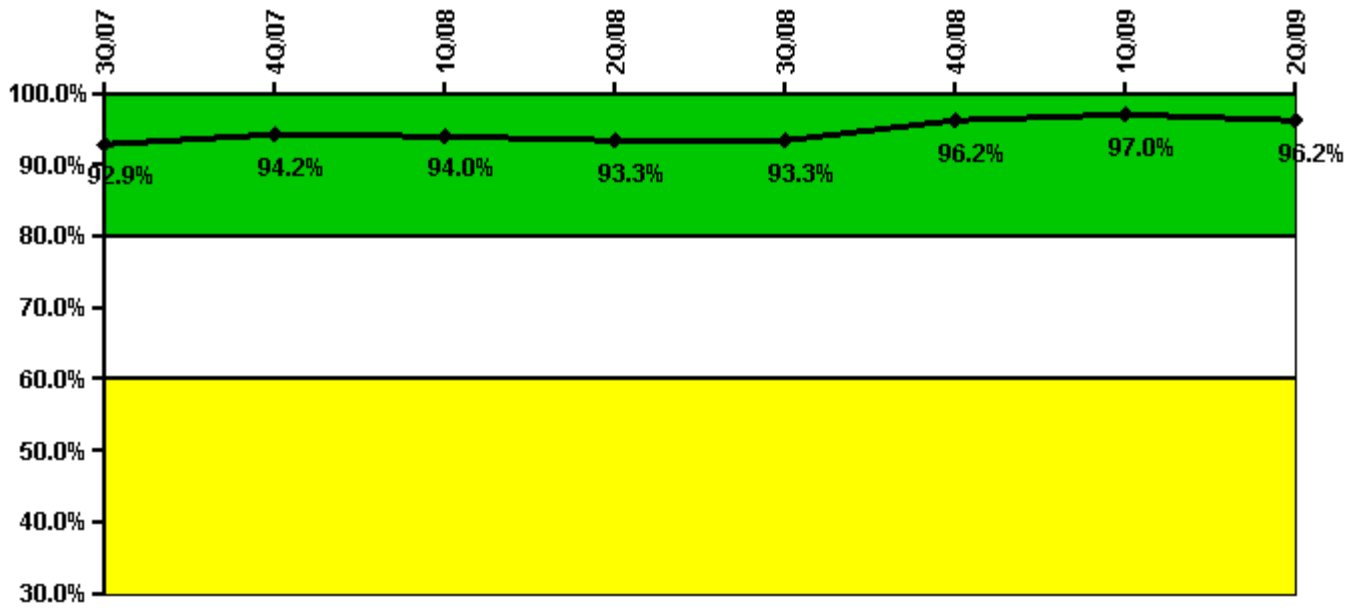


**Thresholds:** White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Participating Key personnel	130.0	130.0	125.0	125.0	126.0	128.0	128.0	128.0
Total Key personnel	140.0	138.0	133.0	134.0	135.0	133.0	132.0	133.0
Indicator value	92.9%	94.2%	94.0%	93.3%	93.3%	96.2%	97.0%	96.2%

Licensee Comments: none

## Alert & Notification System

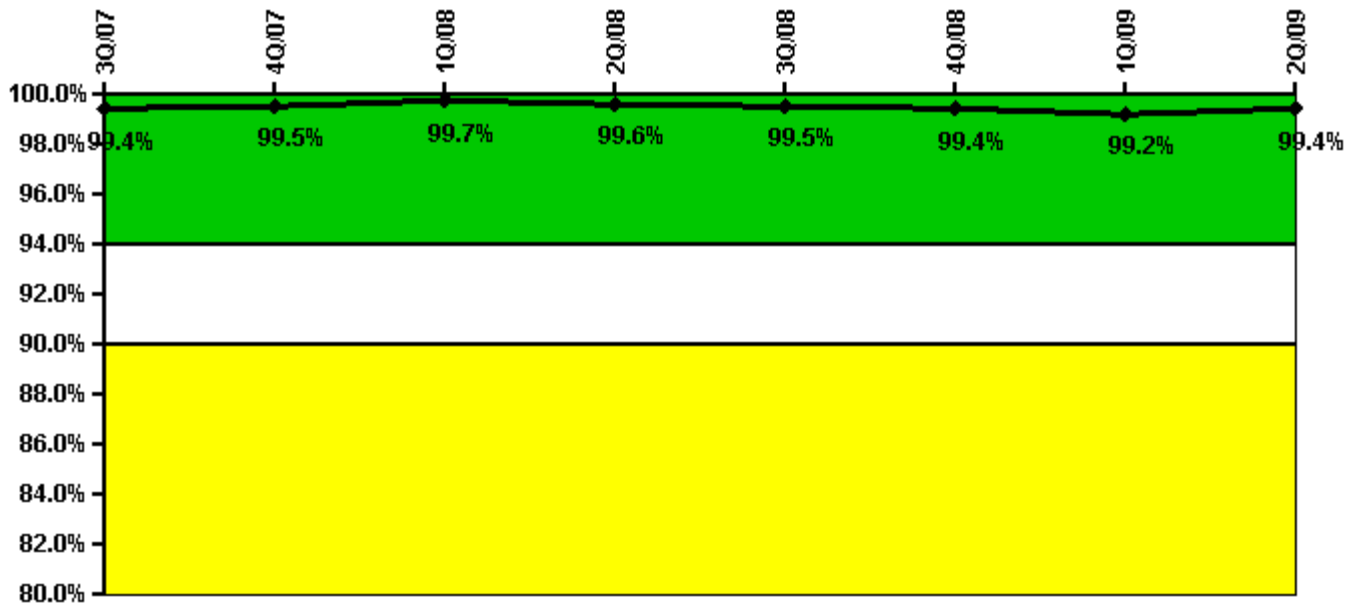


Thresholds: White < 94.0% Yellow < 90.0%

### Notes

Alert & Notification System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Successful siren-tests	2386	2400	2400	2390	2372	2391	2386	2401
Total sirens-tests	2403	2403	2403	2403	2403	2403	2403	2403
Indicator value	99.4%	99.5%	99.7%	99.6%	99.5%	99.4%	99.2%	99.4%

Licensee Comments: none

## Occupational Exposure Control Effectiveness

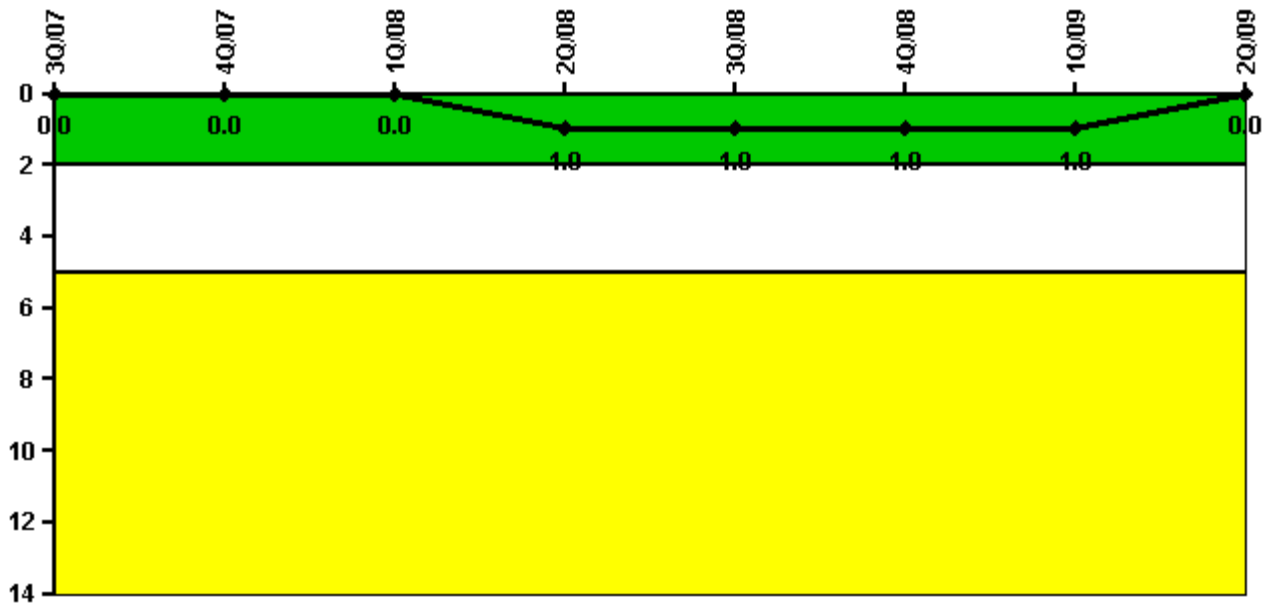


Thresholds: White > 2.0 Yellow > 5.0

### Notes

Occupational Exposure Control Effectiveness	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
High radiation area occurrences	0	0	0	1	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	1	1	1	1	0

Licensee Comments: none

## RETS/ODCM Radiological Effluent

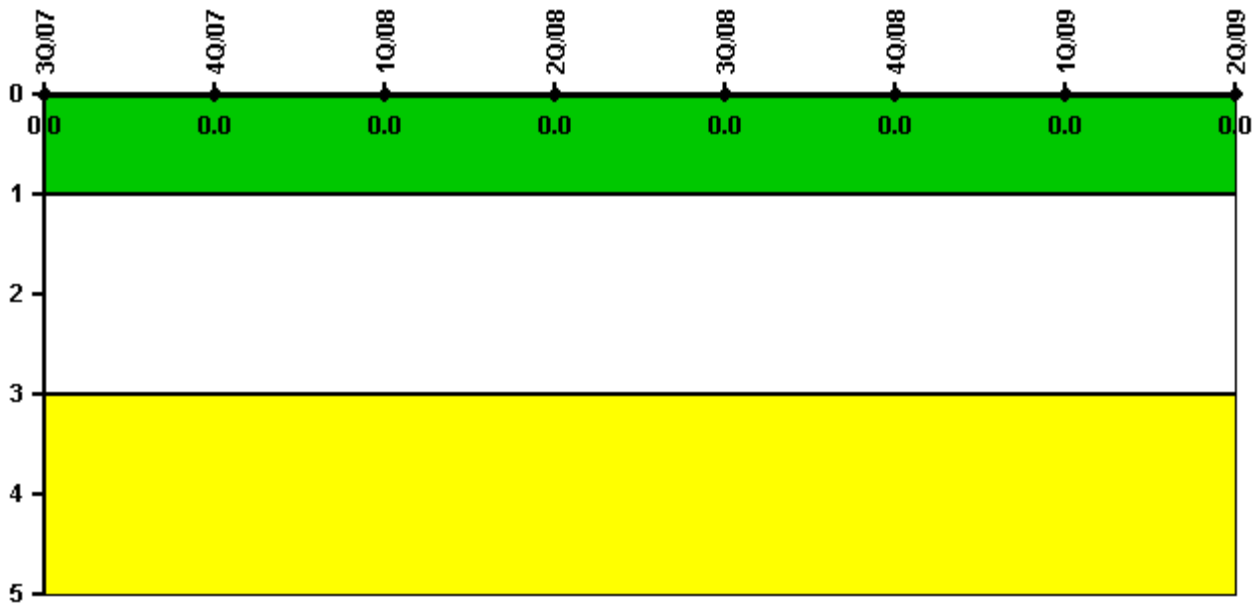

Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.