


Diablo Canyon 1

2Q/2009 Performance Indicators

Licensee's General Comments: Transmitted via DCL-09-052 dated July 21, 2009.

Unplanned Scrams per 7000 Critical Hrs

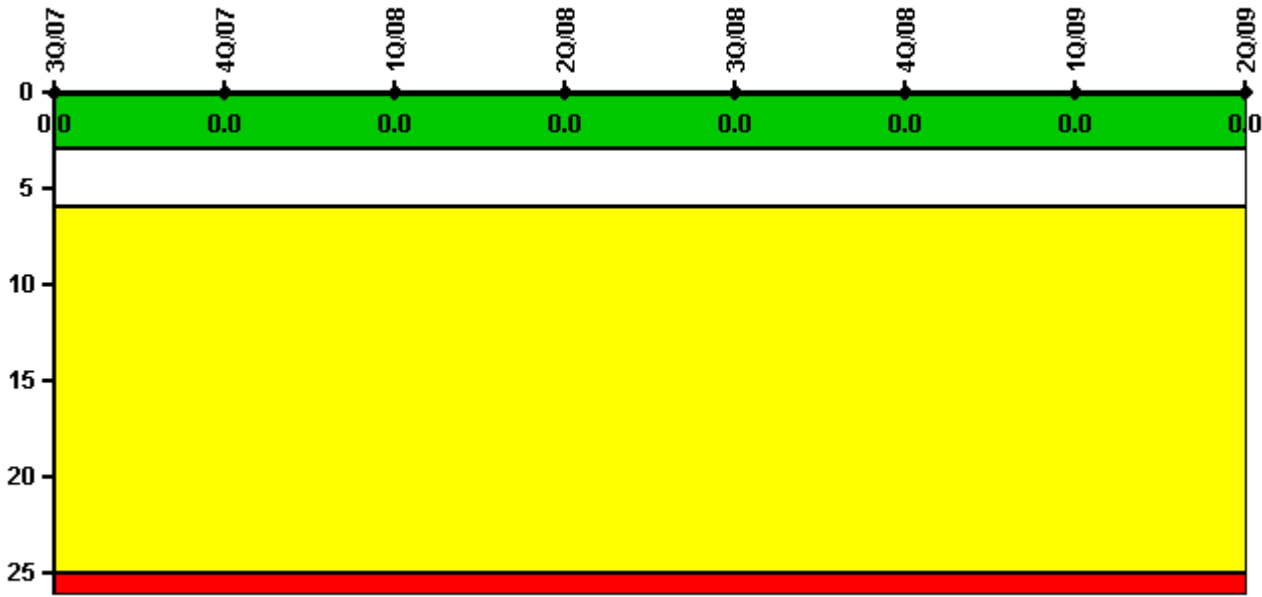


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2085.6	2209.0	2183.0	2184.0	2208.0	2209.0	787.1	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

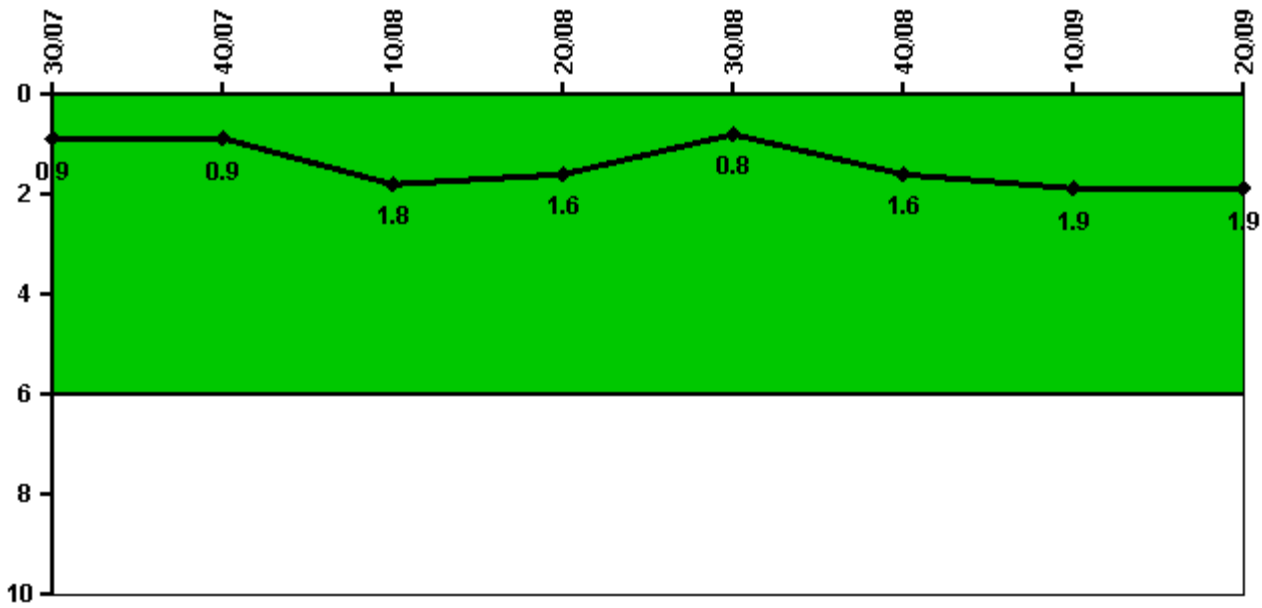

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Unplanned power changes	1.0	0	1.0	0	0	1.0	1.0	0
Critical hours	2085.6	2209.0	2183.0	2184.0	2208.0	2209.0	787.1	2184.0
Indicator value	0.9	0.9	1.8	1.6	0.8	1.6	1.9	1.9

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

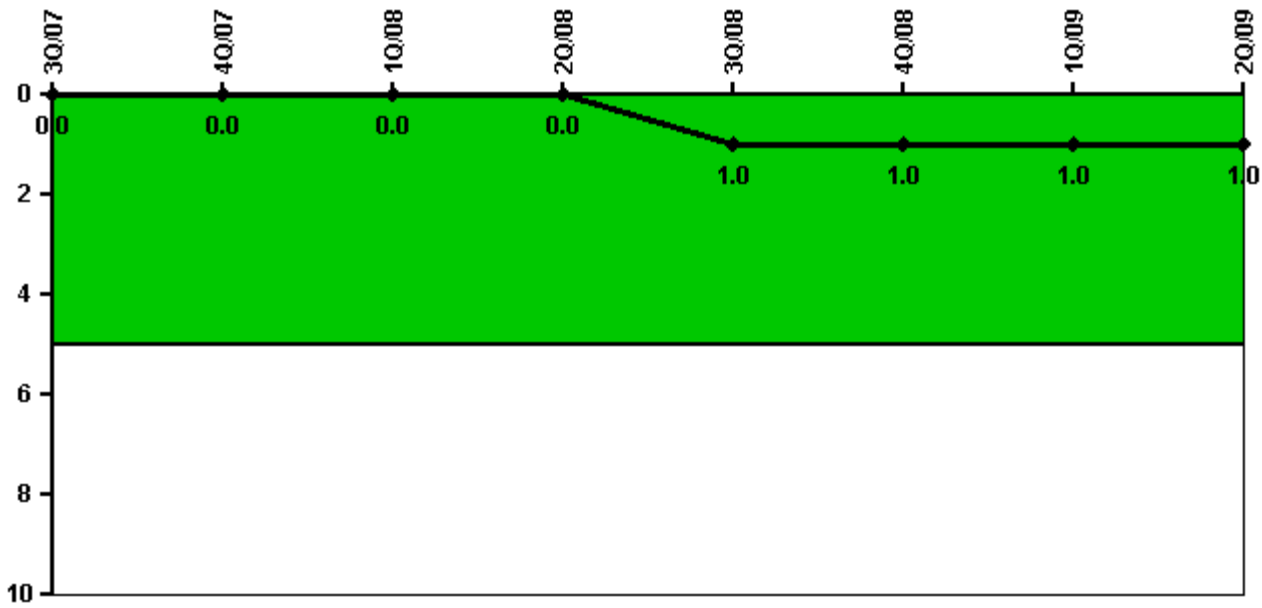

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Safety System Functional Failures	0	0	0	0	1	0	0	0
Indicator value	0	0	0	0	1	1	1	1

Licensee Comments:

3Q/08: LER 1-2008-001-00 reported an event that was identified during April 2009 as a SSFF.

Mitigating Systems Performance Index, Emergency AC Power System

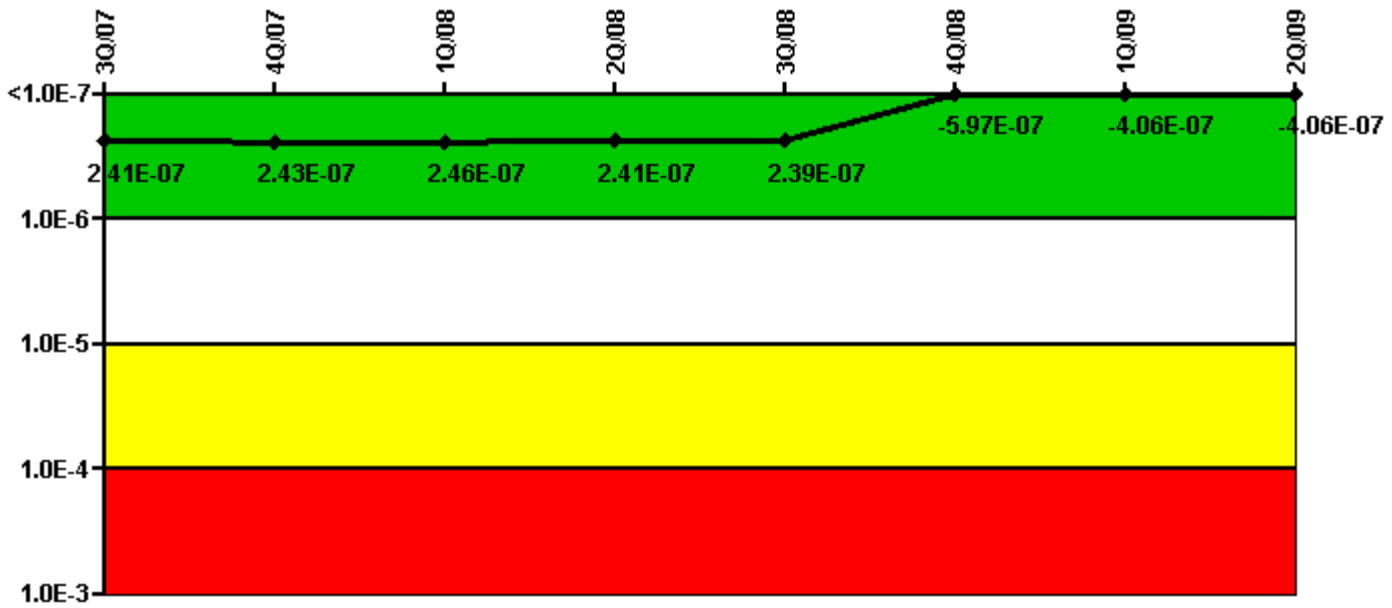


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (Δ CDF)	5.20E-10	3.00E-09	6.00E-09	1.30E-09	-1.10E-09	1.30E-08	1.40E-08	1.40E-08
URI (Δ CDF)	2.40E-07	2.40E-07	2.40E-07	2.40E-07	2.40E-07	-6.10E-07	-4.20E-07	-4.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.41E-07	2.43E-07	2.46E-07	2.41E-07	2.39E-07	-5.97E-07	-4.06E-07	-4.06E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

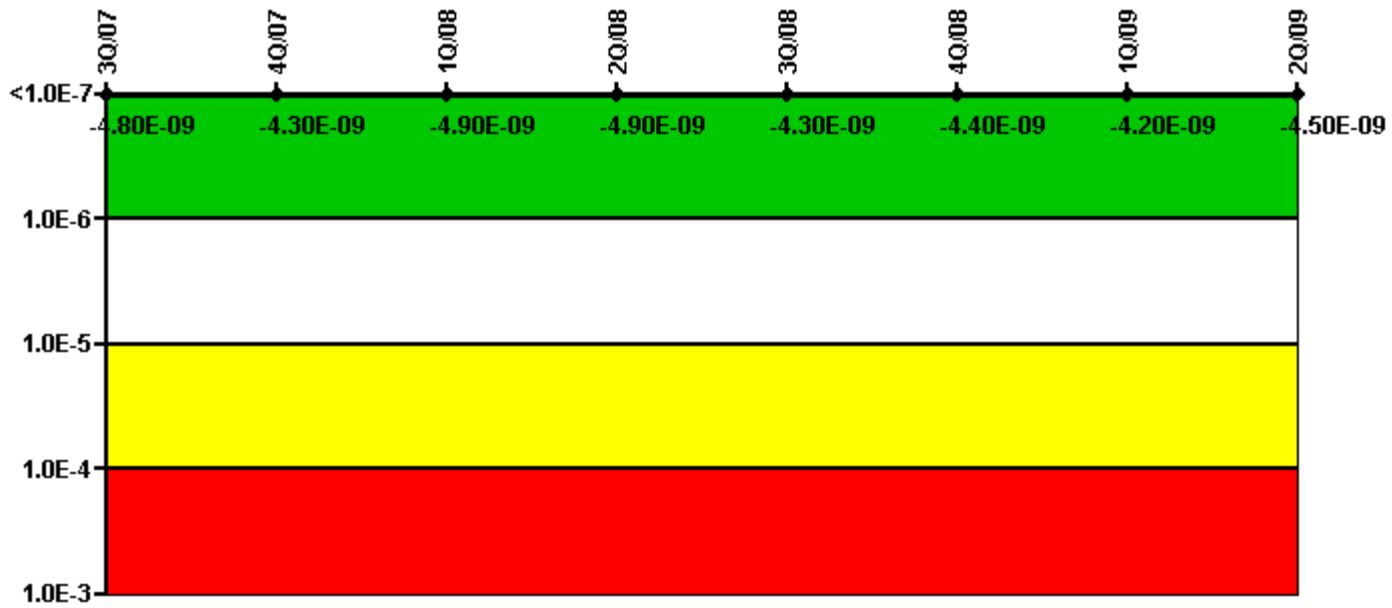

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (Δ CDF)	-3.30E-09	-2.80E-09	-3.40E-09	-3.40E-09	-2.80E-09	-2.90E-09	-2.70E-09	-3.00E-09
URI (Δ CDF)	-1.50E-09	-1.50E-09	-1.50E-09	-1.50E-09	-1.50E-09	-1.50E-09	-1.50E-09	-1.50E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.80E-09	-4.30E-09	-4.90E-09	-4.90E-09	-4.30E-09	-4.40E-09	-4.20E-09	-4.50E-09

Licensee Comments:

2Q/09: Changed the demands and run hours for the Unit 1 Centrifugal Charging Pumps (CCP) 1 and 2 because of the installation of the new CCP-3.

Mitigating Systems Performance Index, Heat Removal System

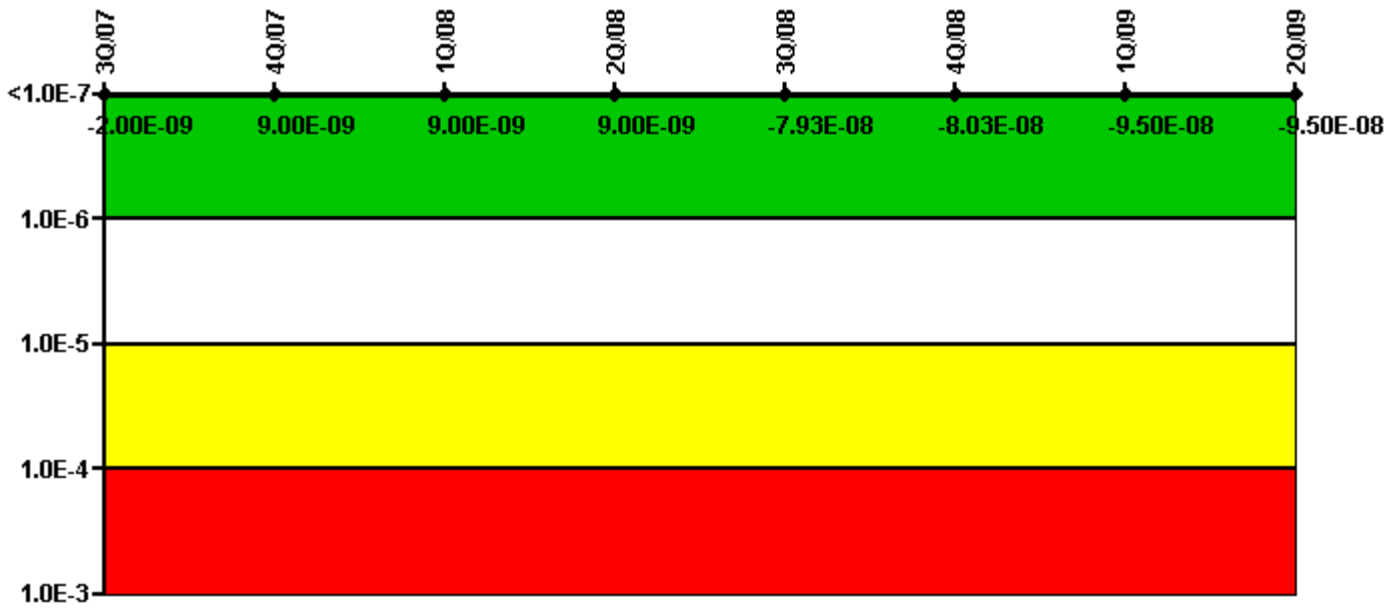


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (Δ CDF)	2.00E-08	3.10E-08	3.10E-08	3.10E-08	4.70E-09	3.70E-09	-1.10E-08	-1.10E-08
URI (Δ CDF)	-2.20E-08	-2.20E-08	-2.20E-08	-2.20E-08	-8.40E-08	-8.40E-08	-8.40E-08	-8.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.00E-09	9.00E-09	9.00E-09	9.00E-09	-7.93E-08	-8.03E-08	-9.50E-08	-9.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

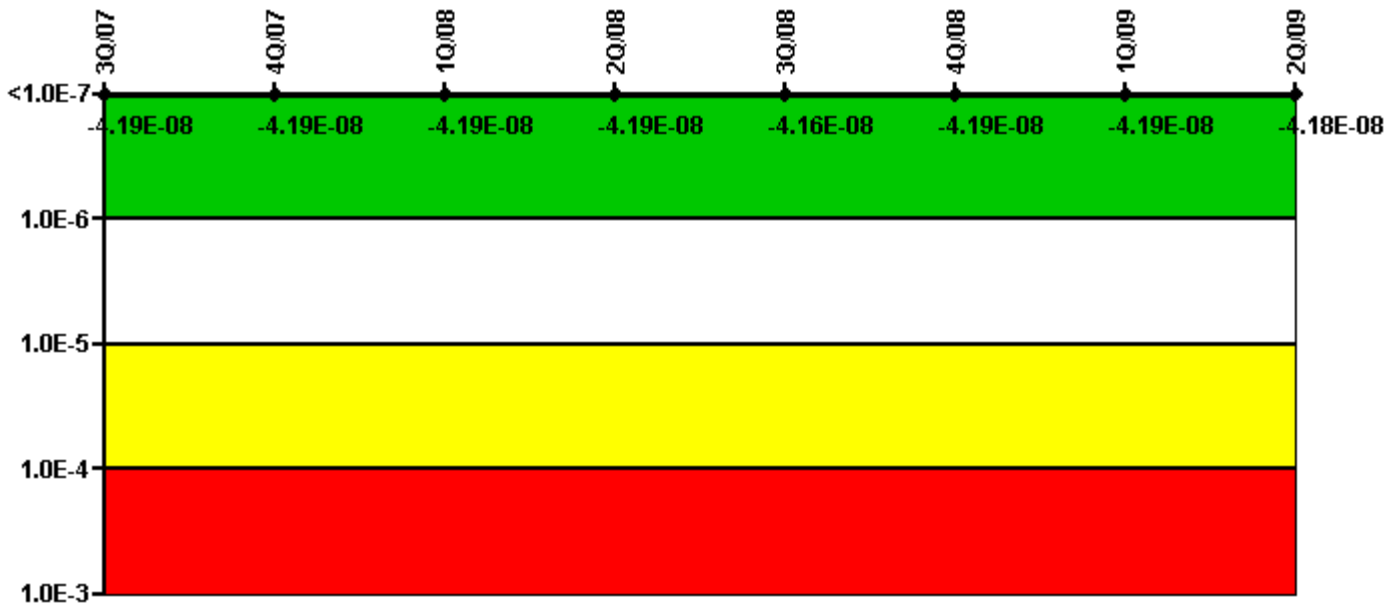


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (Δ CDF)	-5.90E-09	-5.90E-09	-5.90E-09	-5.90E-09	-5.60E-09	-5.90E-09	-5.90E-09	-5.80E-09
URI (Δ CDF)	-3.60E-08	-3.60E-08	-3.60E-08	-3.60E-08	-3.60E-08	-3.60E-08	-3.60E-08	-3.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.19E-08	-4.19E-08	-4.19E-08	-4.19E-08	-4.16E-08	-4.19E-08	-4.19E-08	-4.18E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

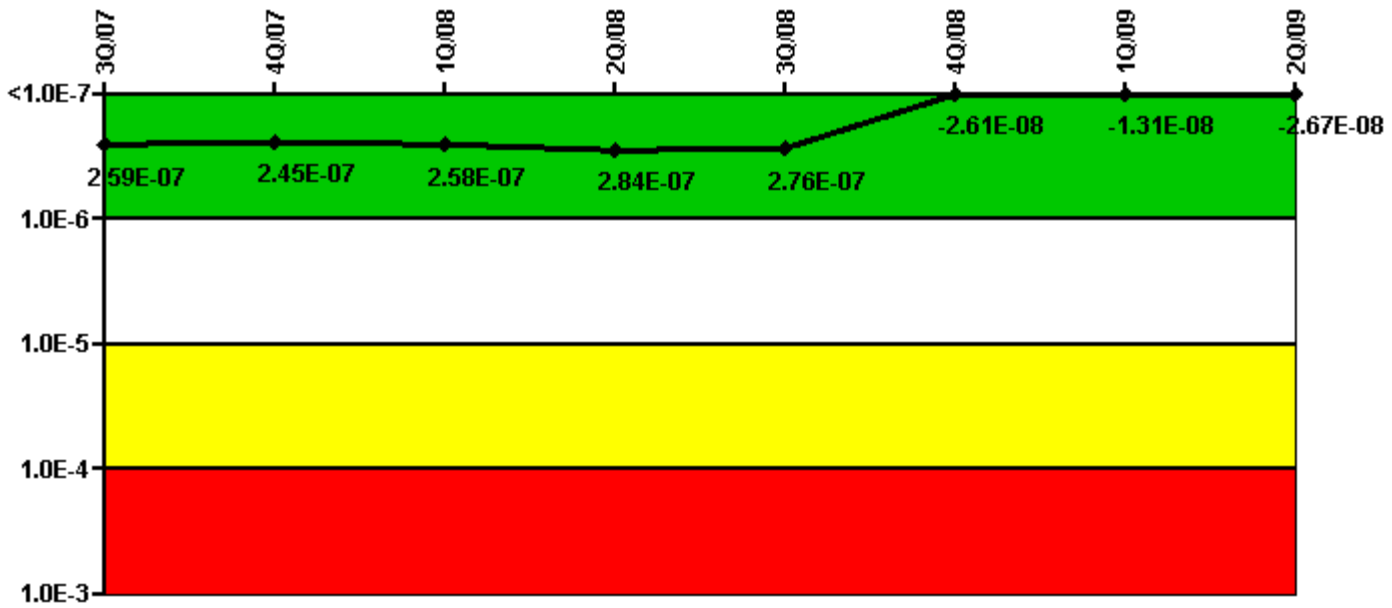


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (Δ CDF)	-2.10E-08	-3.50E-08	-2.20E-08	3.50E-09	-4.00E-09	-1.80E-08	4.90E-09	-8.70E-09
URI (Δ CDF)	2.80E-07	2.80E-07	2.80E-07	2.80E-07	2.80E-07	-8.10E-09	-1.80E-08	-1.80E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.59E-07	2.45E-07	2.58E-07	2.84E-07	2.76E-07	-2.61E-08	-1.31E-08	-2.67E-08

Licensee Comments: none

Reactor Coolant System Activity

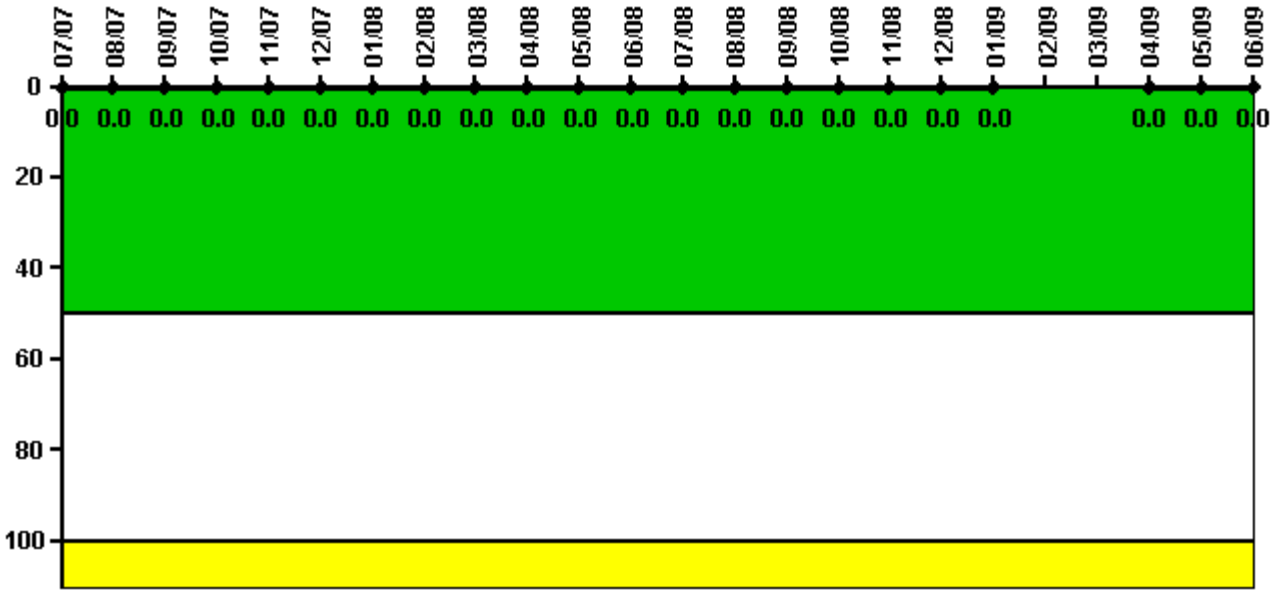

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum activity	0.000070	0.000065	0.000099	0.000092	0.000100	0.000101	0.000108	0.000108	0.000111	0.000122	0.000119	0.000127
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum activity	0.000119	0.000124	0.000136	0.000227	0.000301	0.000142	0.000118	N/A	N/A	0.000069	0.000082	0.000088
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	N/A	N/A	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

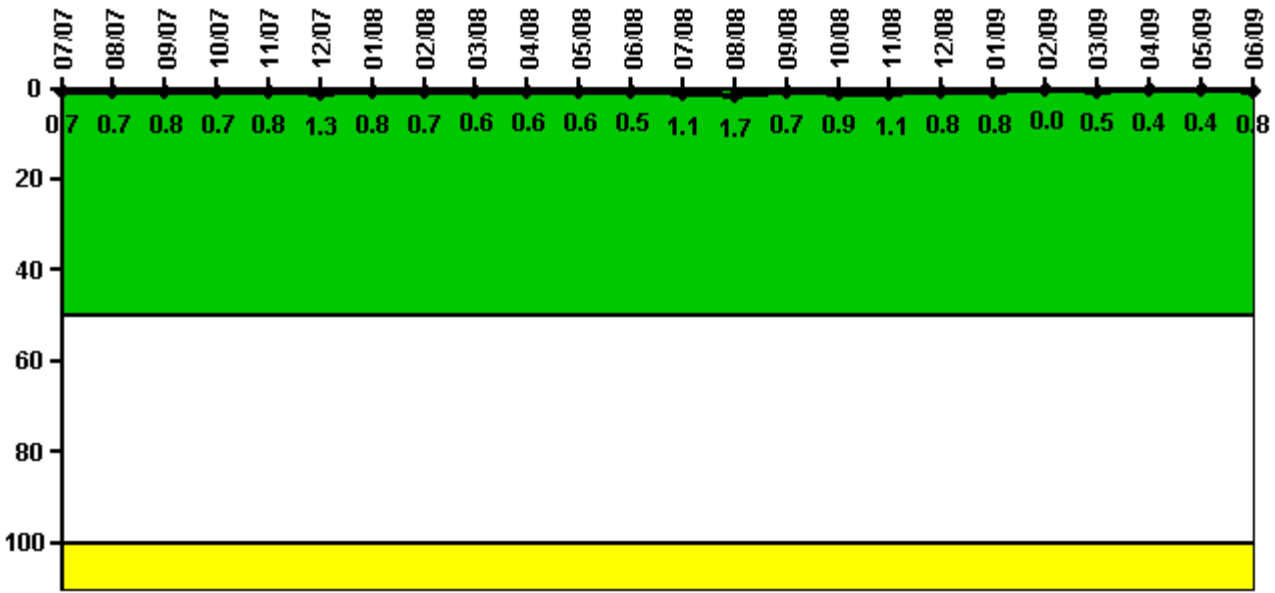


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum leakage	0.073	0.074	0.083	0.071	0.079	0.126	0.075	0.074	0.062	0.063	0.060	0.051
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	0.7	0.8	0.7	0.8	1.3	0.8	0.7	0.6	0.6	0.6	0.5
Reactor Coolant System Leakage	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum leakage	0.111	0.166	0.070	0.085	0.107	0.075	0.083	0	0.053	0.039	0.036	0.076
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.1	1.7	0.7	0.9	1.1	0.8	0.8	0	0.5	0.4	0.4	0.8

Licensee Comments: none

Drill/Exercise Performance

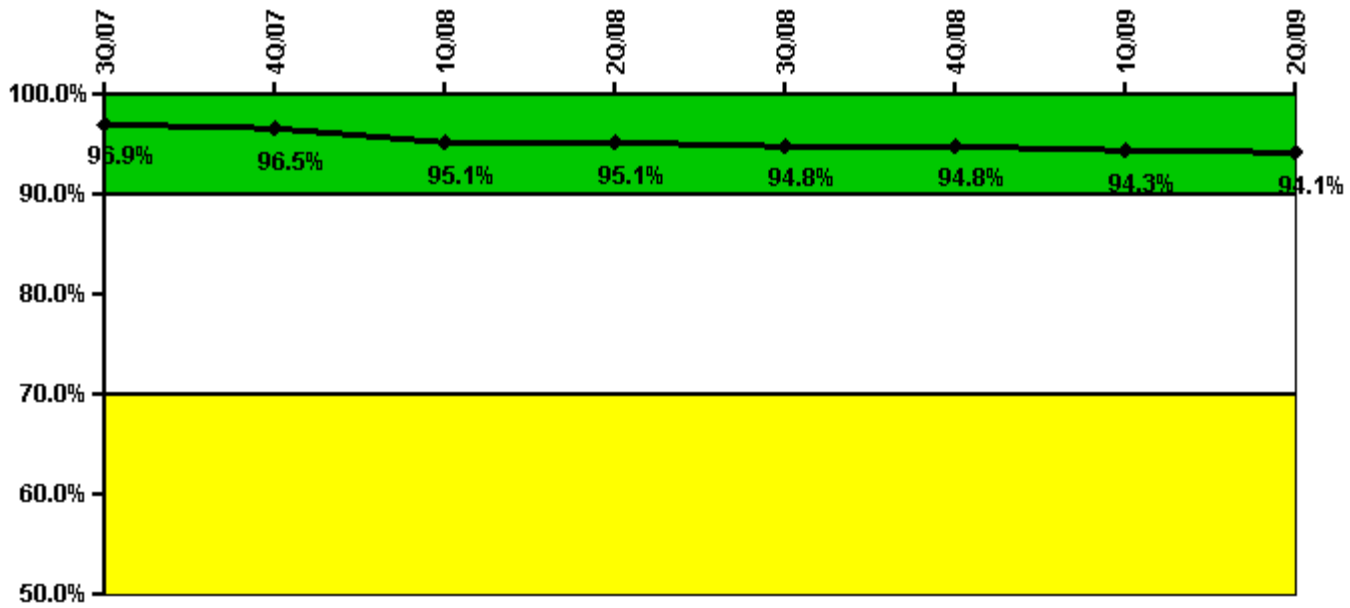


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Successful opportunities	28.0	90.0	17.0	53.0	52.0	47.0	13.0	53.0
Total opportunities	33.0	90.0	18.0	56.0	57.0	52.0	14.0	55.0
Indicator value	96.9%	96.5%	95.1%	95.1%	94.8%	94.8%	94.3%	94.1%

Licensee Comments: none

ERO Drill Participation

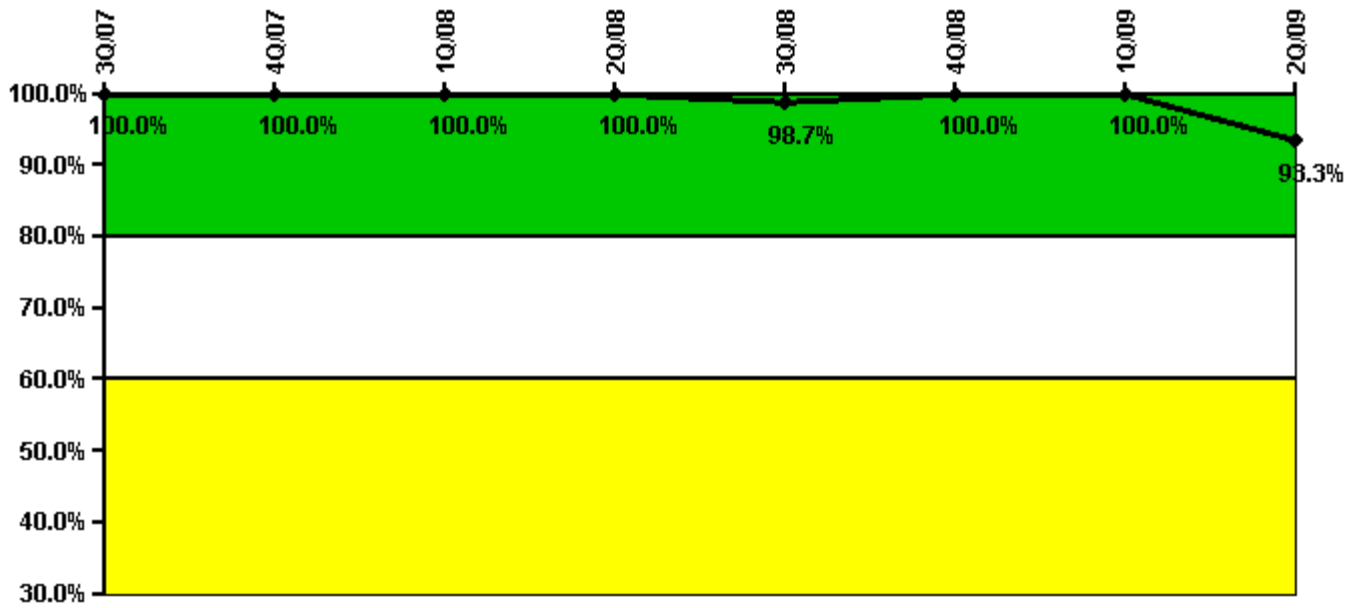


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Participating Key personnel	79.0	78.0	71.0	75.0	75.0	79.0	70.0	83.0
Total Key personnel	79.0	78.0	71.0	75.0	76.0	79.0	70.0	89.0
Indicator value	100.0%	100.0%	100.0%	100.0%	98.7%	100.0%	100.0%	93.3%

Licensee Comments: none

Alert & Notification System

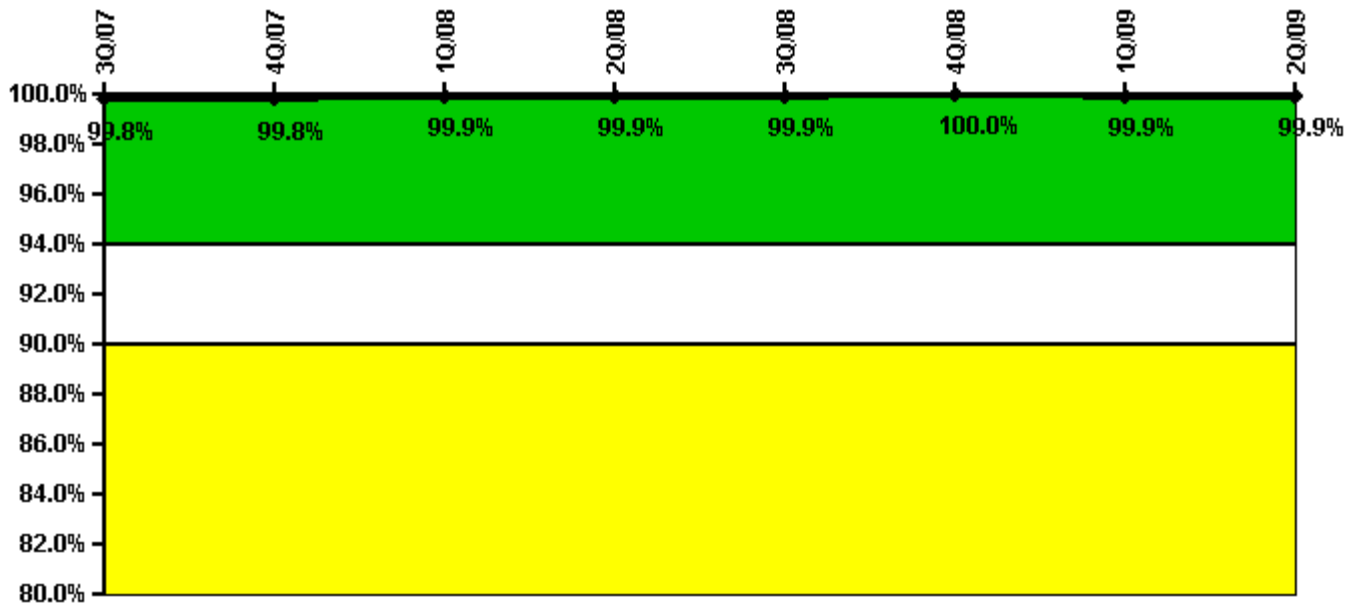


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Successful siren-tests	1309	915	1048	916	1310	1047	1047	916
Total sirens-tests	1310	917	1048	917	1310	1048	1048	917
Indicator value	99.8%	99.8%	99.9%	99.9%	99.9%	100.0%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

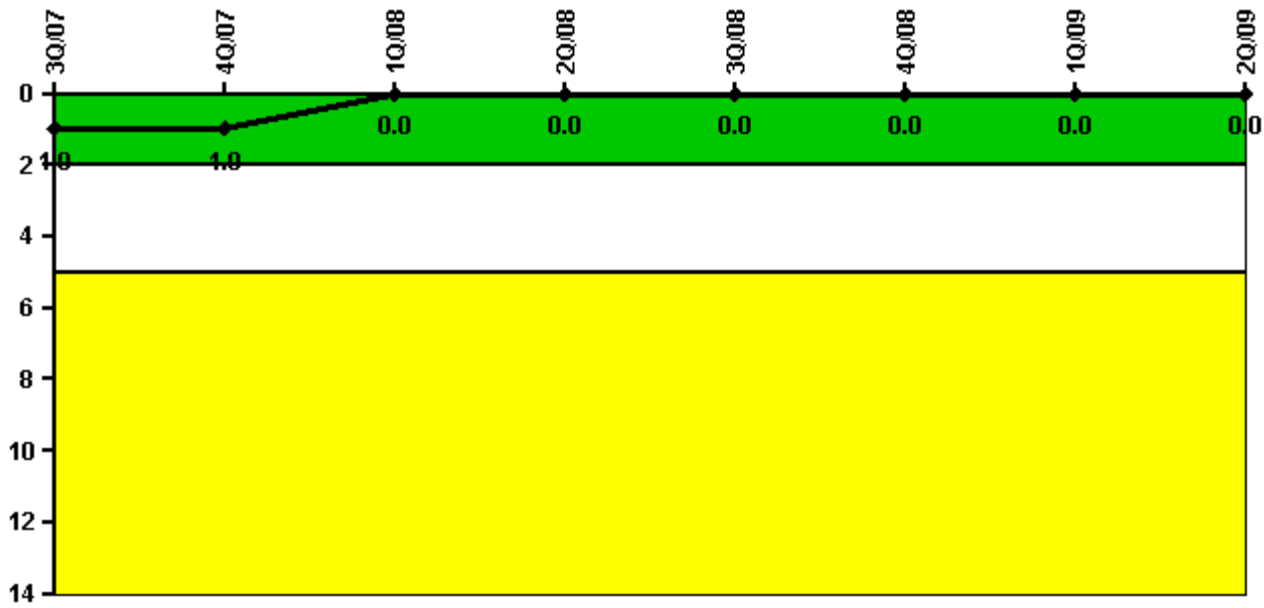

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	1	1	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.