


# Ginna

## 2Q/2009 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

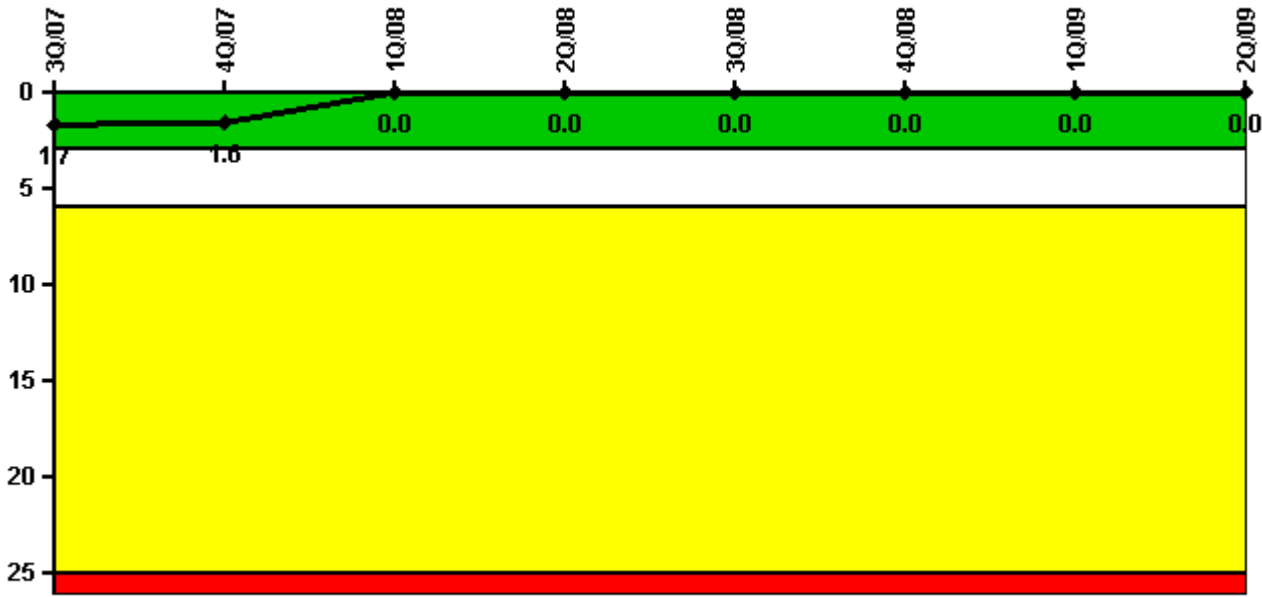


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	2183.0	1697.6	2208.0	2209.0	2159.0	2184.0
Indicator value	1.7	1.6	0	0	0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

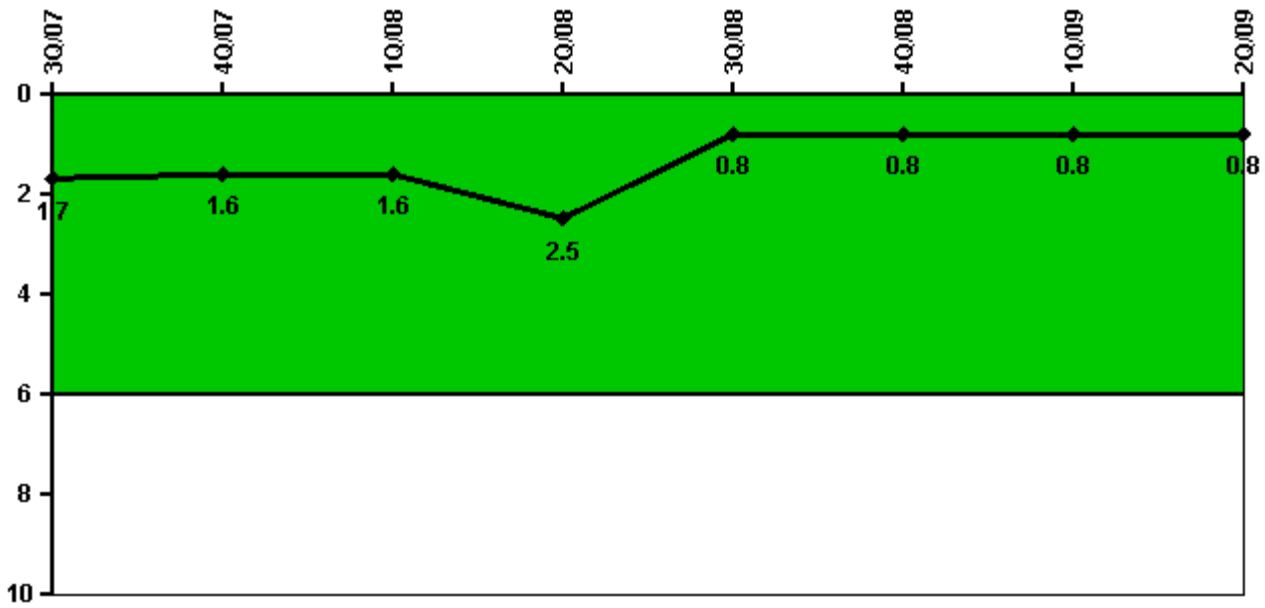


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Unplanned power changes	2.0	0	0	1.0	0	0	0	1.0
Critical hours	2208.0	2209.0	2183.0	1697.6	2208.0	2209.0	2159.0	2184.0
Indicator value	1.7	1.6	1.6	2.5	0.8	0.8	0.8	0.8

Licensee Comments: none

# Unplanned Scrams with Complications

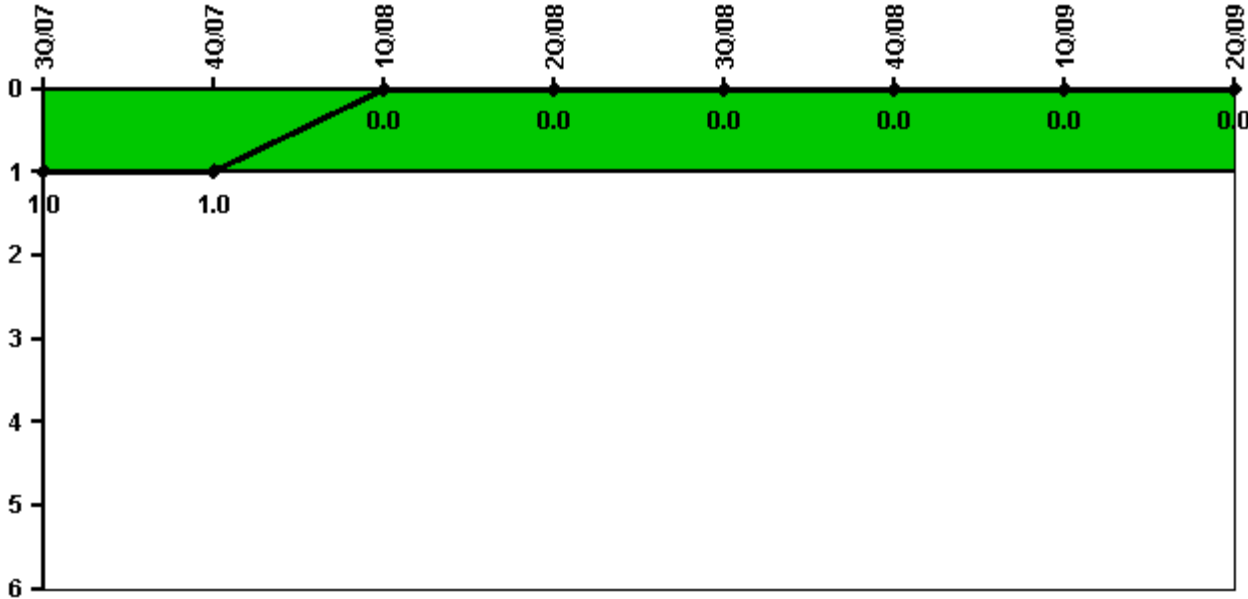


Thresholds: White > 1.0

**Notes**

Unplanned Scrams with Complications	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (PWR)

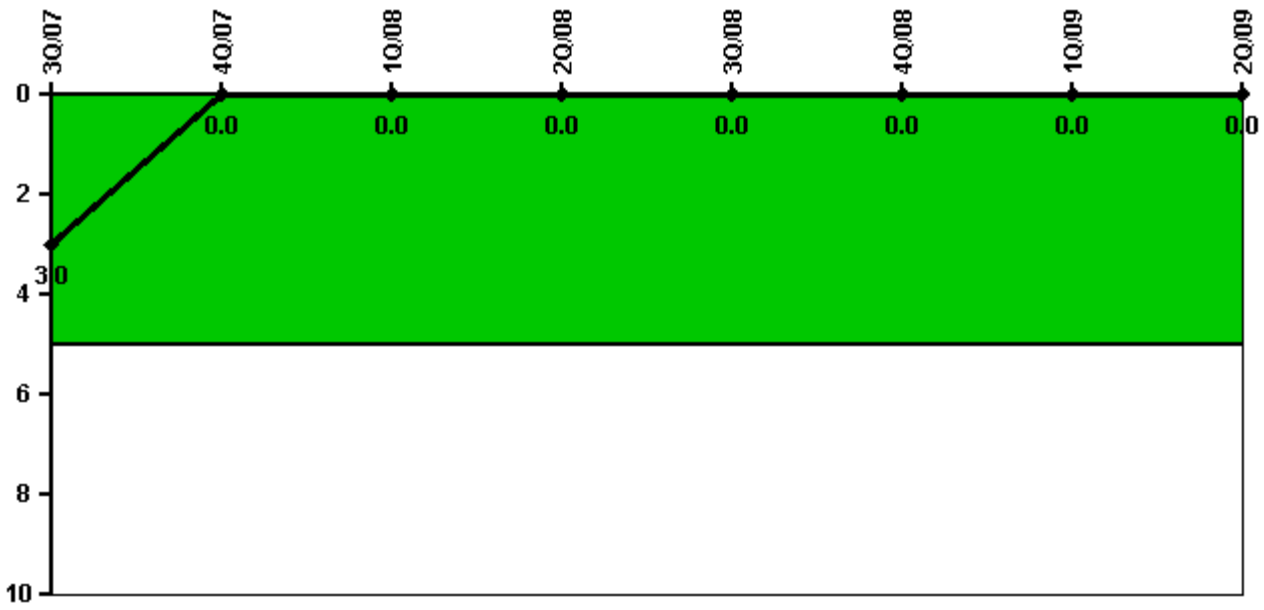


Thresholds: White > 5.0

### Notes

Safety System Functional Failures (PWR)	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	3	0	0	0	0	0	0	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

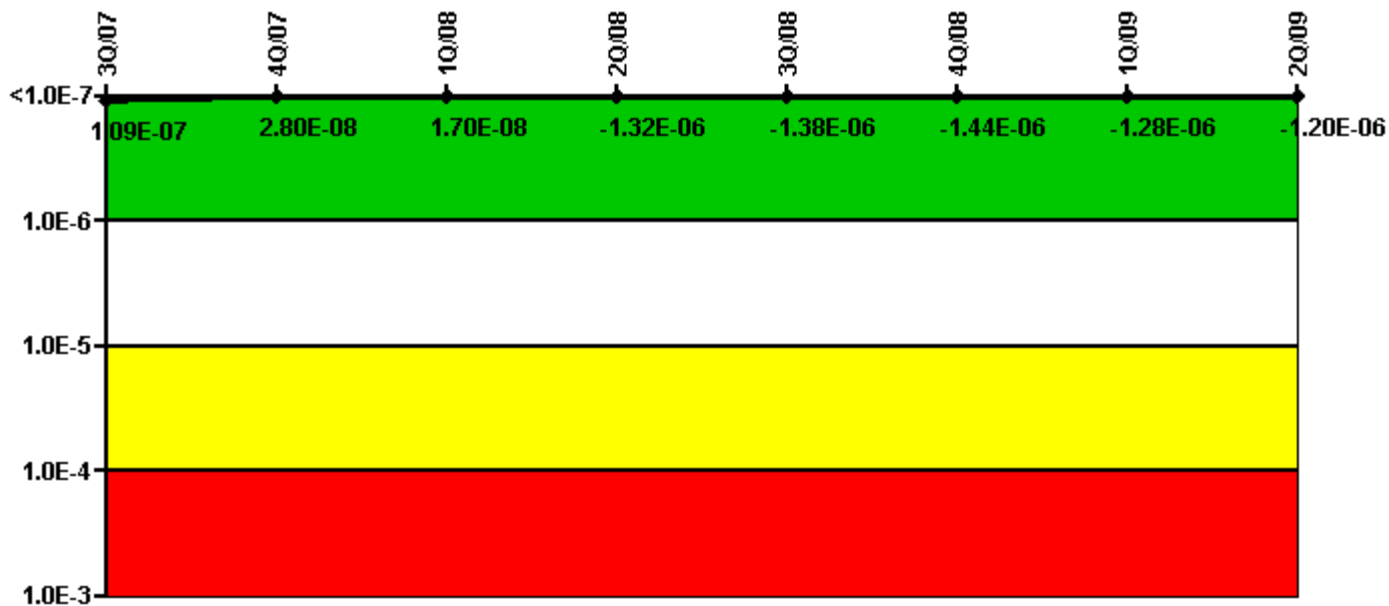

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (ΔCDF)	1.00E-07	3.80E-08	3.50E-08	-2.10E-08	-7.90E-08	-1.40E-07	1.80E-08	9.70E-08
URI (ΔCDF)	8.90E-09	-1.00E-08	-1.80E-08	-1.30E-06	-1.30E-06	-1.30E-06	-1.30E-06	-1.30E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.09E-07	2.80E-08	1.70E-08	-1.32E-06	-1.38E-06	-1.44E-06	-1.28E-06	-1.20E-06

## Licensee Comments:

3Q/06: The January 2004 unavailability data was revised for the A EDG train. Previously reported planned unavailable hours were split to 2.5 hours planned and 4.9 hours unplanned. The adjusted data did not change the "color" of the indicator.

2Q/06: The January 2004 unavailability data was revised for the A EDG train. Previously reported planned unavailable hours were split to 2.5 hours planned and 4.9 hours unplanned. The adjusted data did not change the "color" of the indicator.

# Mitigating Systems Performance Index, High Pressure Injection System

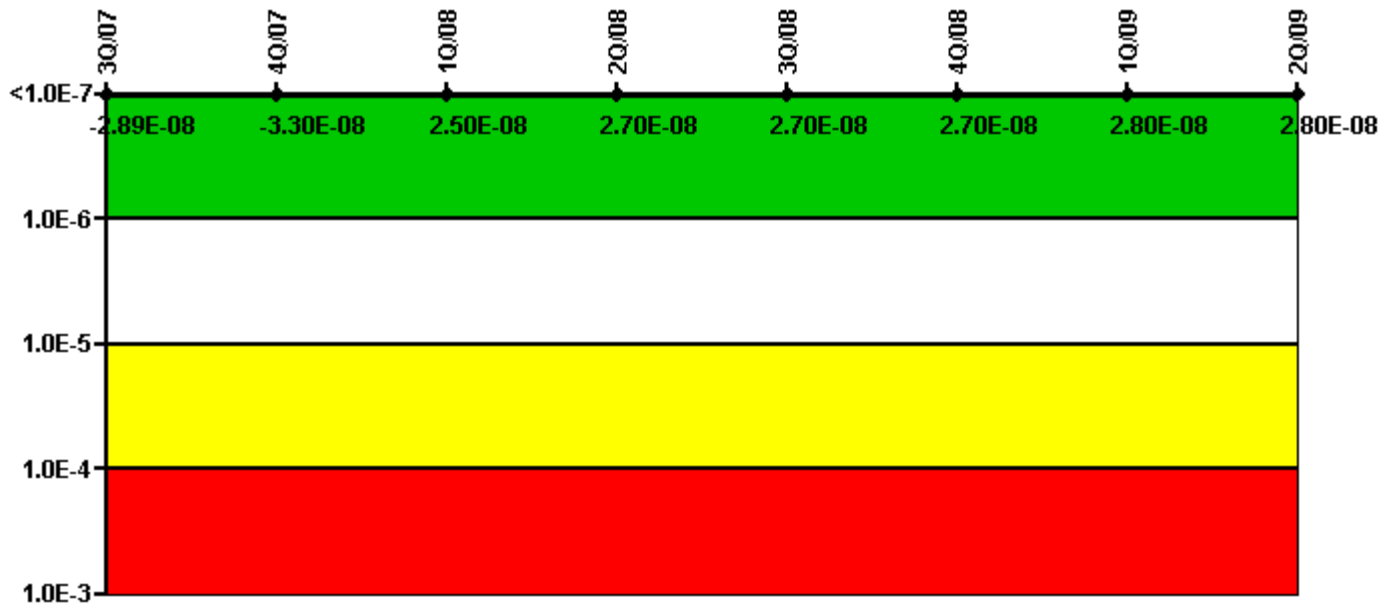


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	-9.90E-09	-1.20E-08	4.60E-08	4.70E-08	4.70E-08	4.70E-08	4.70E-08	4.70E-08
URI ( $\Delta$ CDF)	-1.90E-08	-2.10E-08	-2.10E-08	-2.00E-08	-2.00E-08	-2.00E-08	-1.90E-08	-1.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.89E-08	-3.30E-08	2.50E-08	2.70E-08	2.70E-08	2.70E-08	2.80E-08	2.80E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

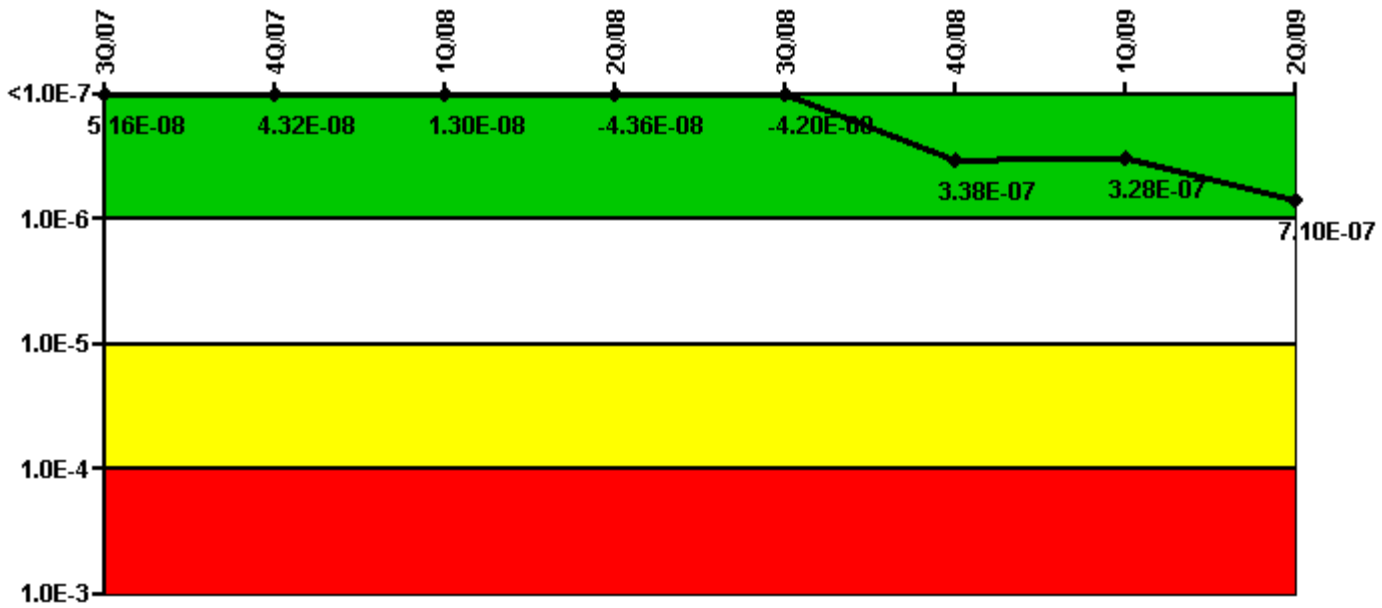


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI (ΔCDF)	5.90E-08	5.30E-08	6.20E-08	6.40E-09	8.00E-09	5.80E-08	4.80E-08	1.10E-07
URI (ΔCDF)	-7.40E-09	-9.80E-09	-4.90E-08	-5.00E-08	-5.00E-08	2.80E-07	2.80E-07	6.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	5.16E-08	4.32E-08	1.30E-08	-4.36E-08	-4.20E-08	3.38E-07	3.28E-07	7.10E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

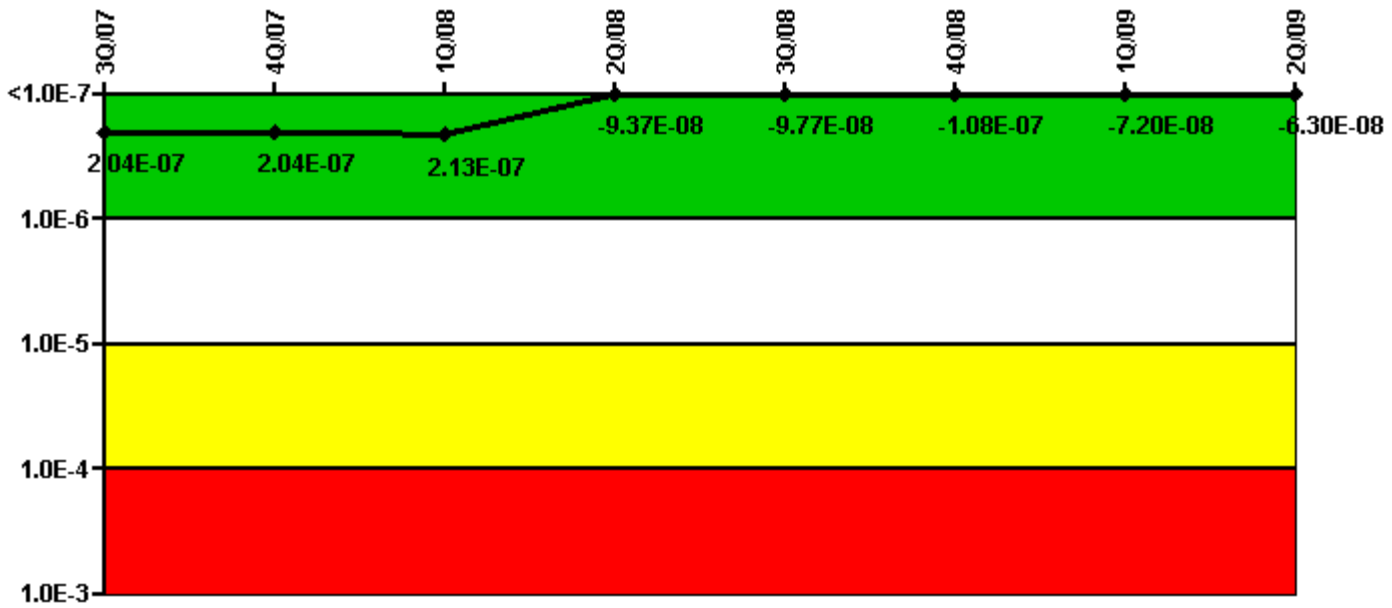

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	3.70E-09	3.70E-09	3.40E-09	2.30E-09	2.30E-09	2.30E-09	3.80E-08	5.70E-08
URI ( $\Delta$ CDF)	2.00E-07	2.00E-07	2.10E-07	-9.60E-08	-1.00E-07	-1.10E-07	-1.10E-07	-1.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.04E-07	2.04E-07	2.13E-07	-9.37E-08	-9.77E-08	-1.08E-07	-7.20E-08	-6.30E-08

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

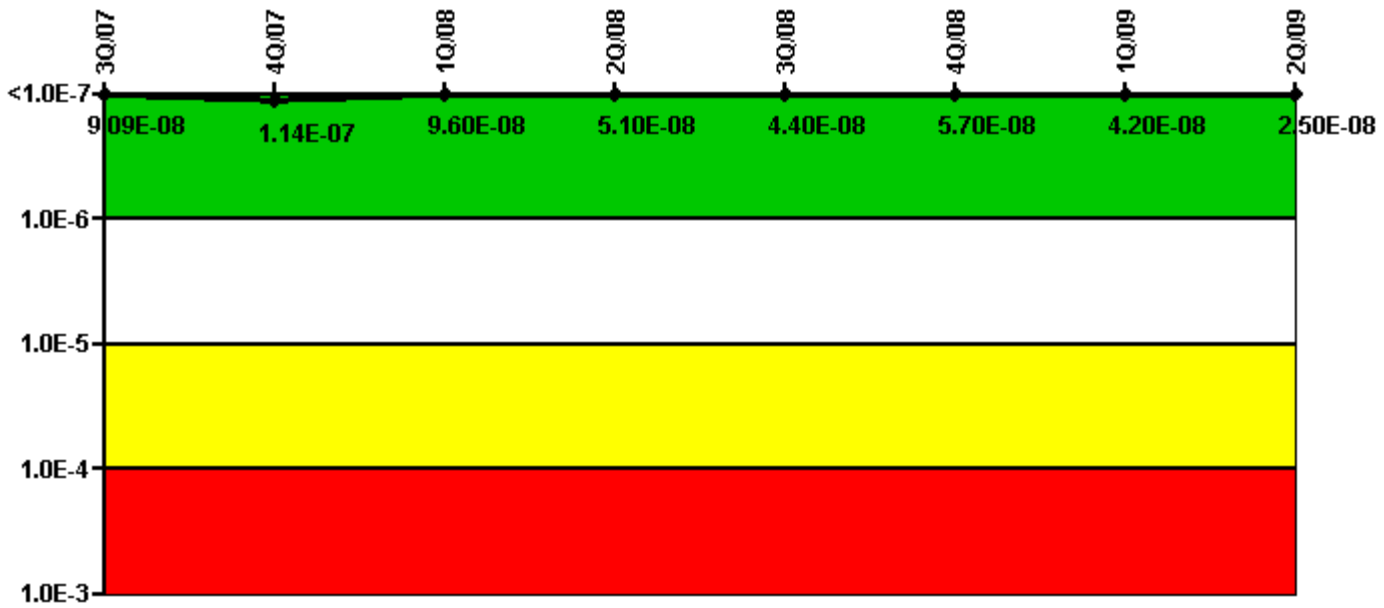


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
UAI ( $\Delta$ CDF)	9.00E-08	9.60E-08	7.70E-08	7.90E-08	7.20E-08	8.50E-08	6.90E-08	5.20E-08
URI ( $\Delta$ CDF)	9.00E-10	1.80E-08	1.90E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.70E-08	-2.70E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	9.09E-08	1.14E-07	9.60E-08	5.10E-08	4.40E-08	5.70E-08	4.20E-08	2.50E-08

Licensee Comments: none

## Reactor Coolant System Activity

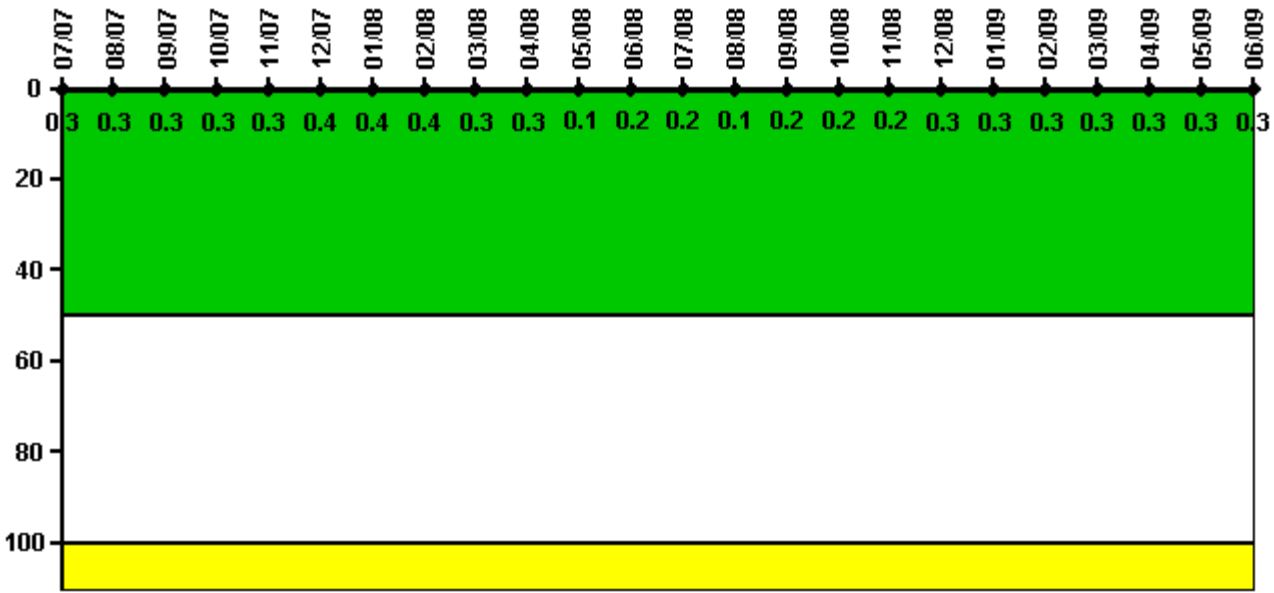

Thresholds: White > 50.0 Yellow > 100.0

### Notes


Reactor Coolant System Activity	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum activity	0.002620	0.002830	0.002960	0.003100	0.003180	0.003500	0.003520	0.003710	0.003010	0.003490	0.001250	0.001500
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.3	0.3	0.3	0.3	0.3	0.4	0.4	0.4	0.3	0.3	0.1	0.2

Reactor Coolant System Activity	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum activity	0.001710	0.001460	0.001620	0.002190	0.002260	0.002690	0.002720	0.002680	0.002550	0.002590	0.002630	0.002700
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.1	0.2	0.2	0.2	0.3	0.3	0.3	0.3	0.3	0.3	0.3

Licensee Comments: none

## Reactor Coolant System Leakage

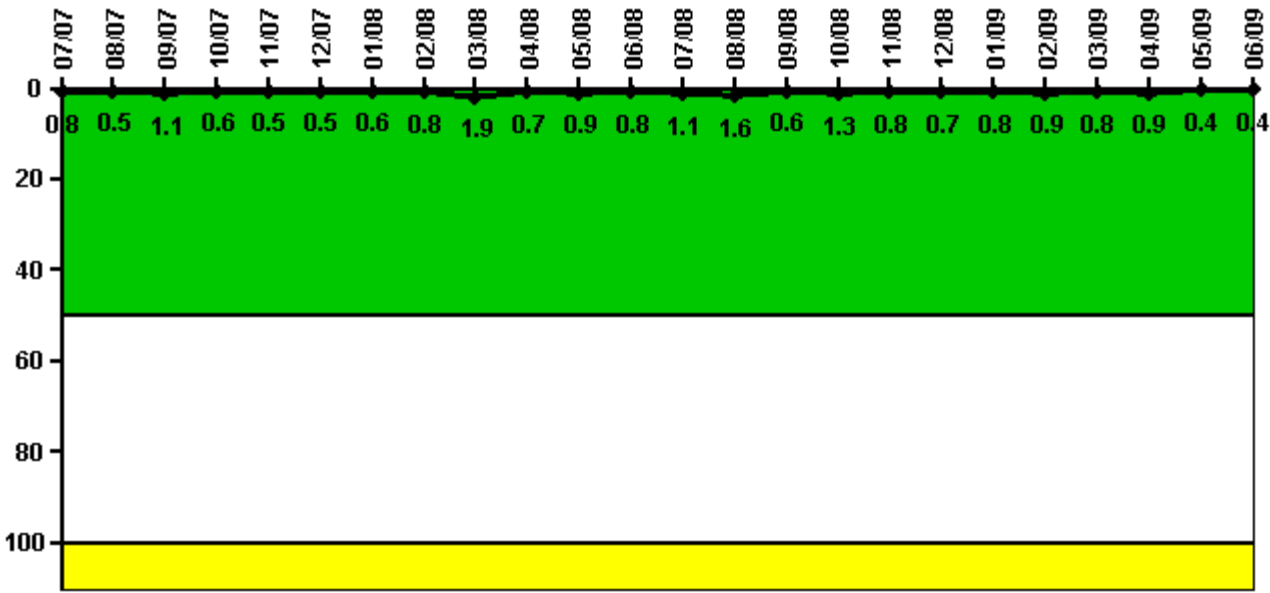


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum leakage	0.075	0.054	0.108	0.058	0.049	0.053	0.060	0.076	0.188	0.067	0.089	0.081
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.8	0.5	1.1	0.6	0.5	0.5	0.6	0.8	1.9	0.7	0.9	0.8
Reactor Coolant System Leakage	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum leakage	0.107	0.158	0.058	0.134	0.077	0.069	0.078	0.094	0.080	0.089	0.038	0.035
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.1	1.6	0.6	1.3	0.8	0.7	0.8	0.9	0.8	0.9	0.4	0.4

Licensee Comments: none

## Drill/Exercise Performance

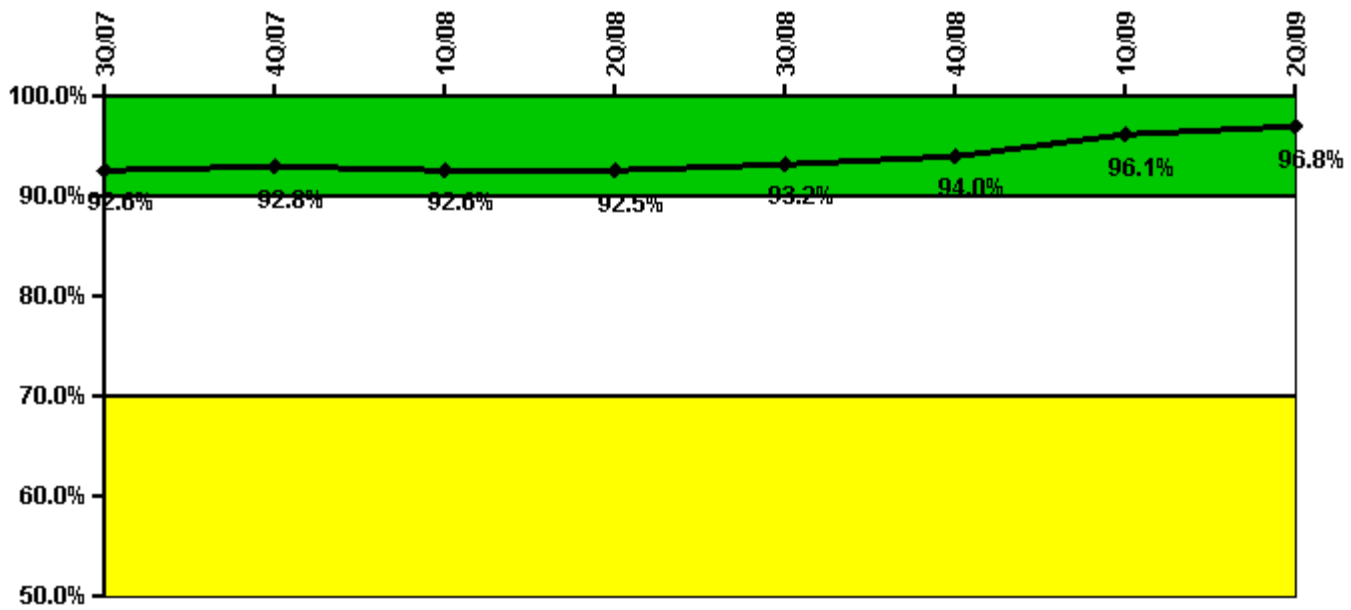


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Successful opportunities	9.0	32.0	63.0	0	38.0	32.0	55.0	15.0
Total opportunities	9.0	34.0	68.0	0	38.0	32.0	55.0	16.0
Indicator value	92.6%	92.8%	92.6%	92.5%	93.2%	94.0%	96.1%	96.8%

Licensee Comments: none

## ERO Drill Participation

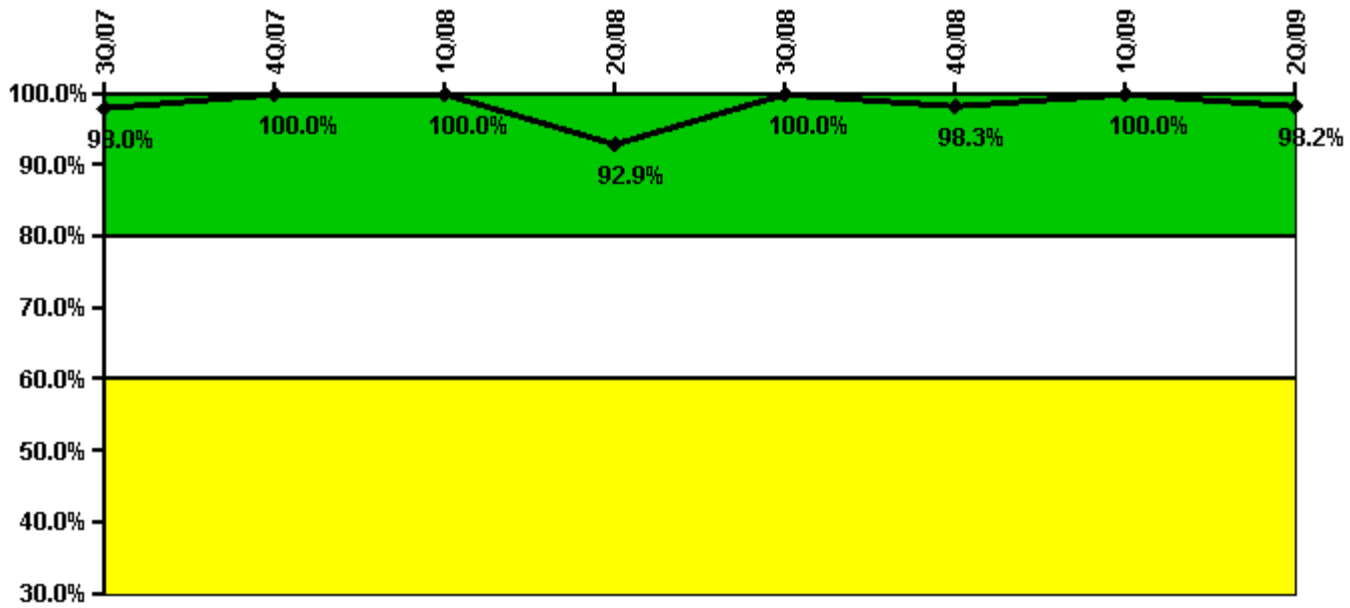


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Participating Key personnel	50.0	51.0	57.0	52.0	57.0	58.0	58.0	54.0
Total Key personnel	51.0	51.0	57.0	56.0	57.0	59.0	58.0	55.0
Indicator value	98.0%	100.0%	100.0%	92.9%	100.0%	98.3%	100.0%	98.2%

Licensee Comments: none

## Alert & Notification System

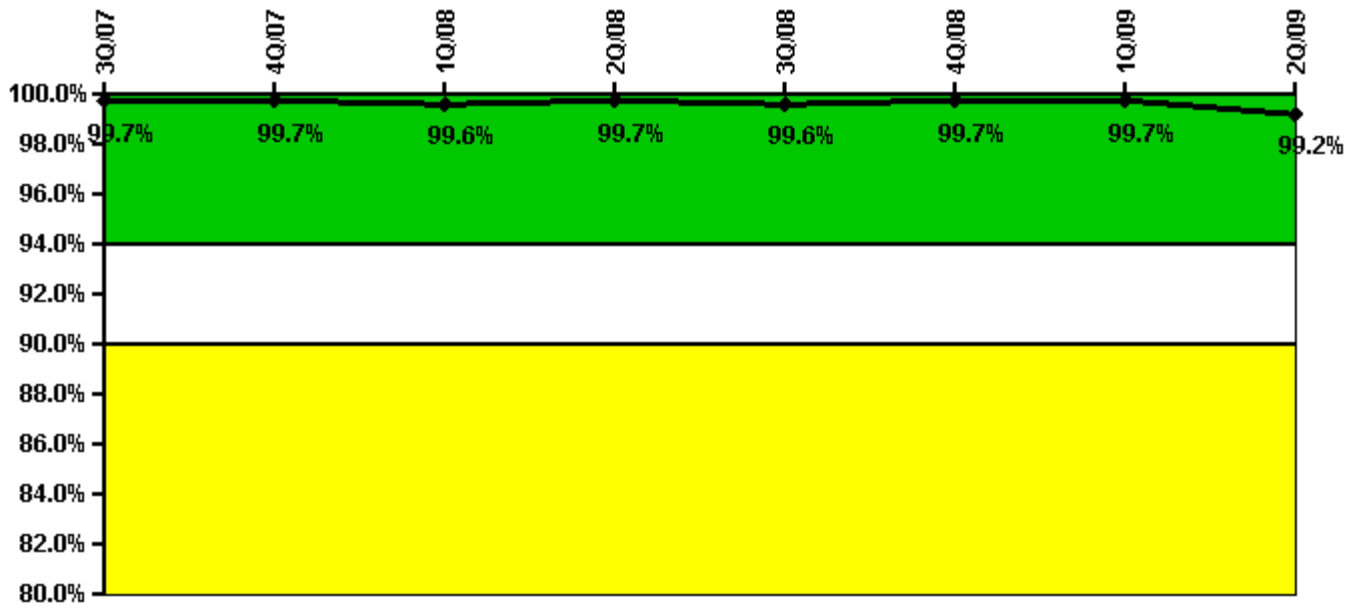

**Thresholds:** White < 94.0% Yellow < 90.0%

### Notes

Alert & Notification System	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
Successful siren-tests	1247	1243	1241	1245	1239	1248	1245	1221
Total sirens-tests	1248	1246	1248	1247	1247	1248	1248	1248
Indicator value	99.7%	99.7%	99.6%	99.7%	99.6%	99.7%	99.7%	99.2%

Licensee Comments: none

## Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

### Notes

Occupational Exposure Control Effectiveness	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.