

Catawba 2

3Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs




Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 1137.3 | 2183.0 | 2184.0 | 2208.0 | 2209.0 | 1564.2 | 1767.0 | 2208.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

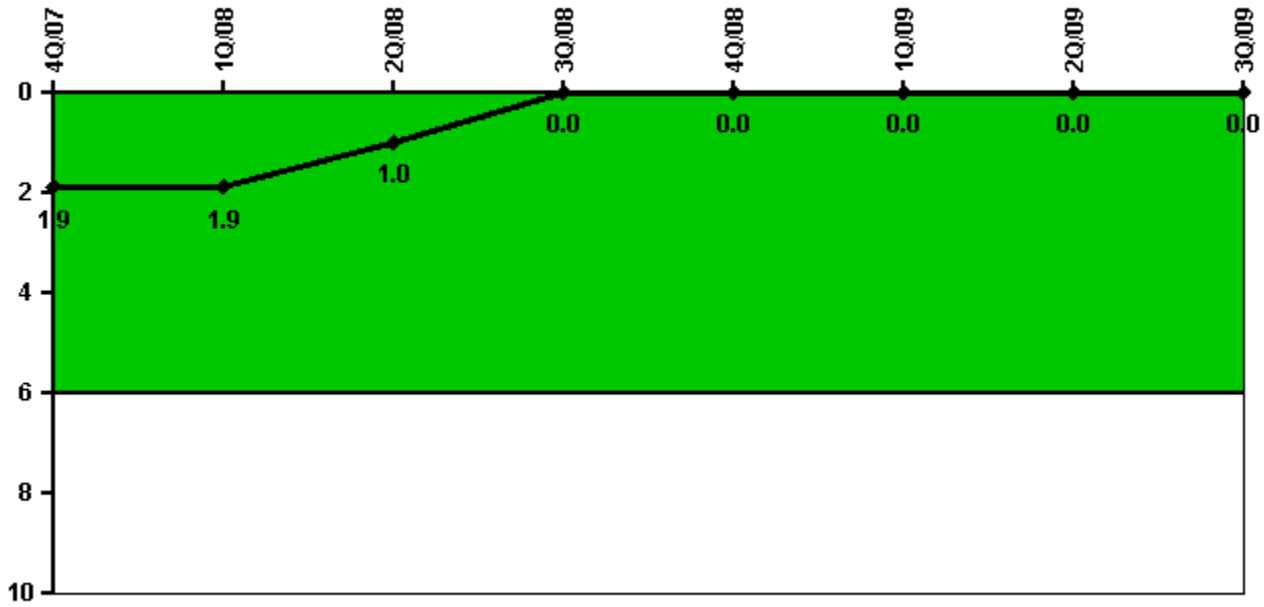

Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 1137.3 | 2183.0 | 2184.0 | 2208.0 | 2209.0 | 1564.2 | 1767.0 | 2208.0 |
| Indicator value | 1.9 | 1.9 | 1.0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|-------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (PWR)

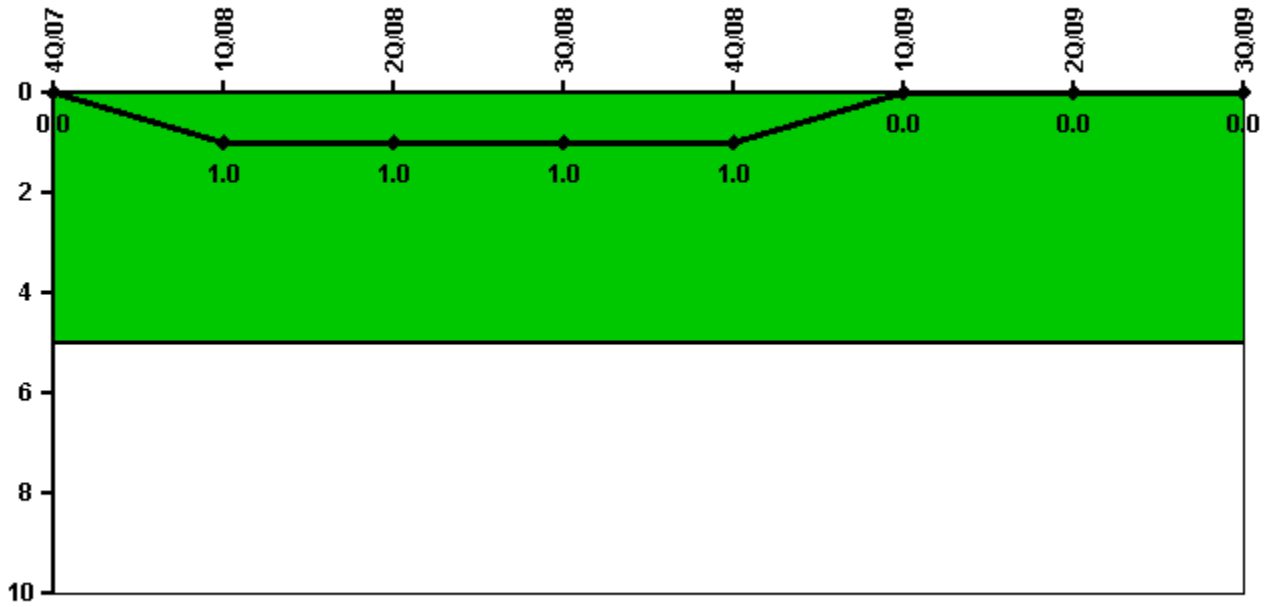


Thresholds: White > 5.0

Notes

| Safety System Functional Failures (PWR) | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 1 | 1 | 1 | 1 | 0 | 0 | 0 |

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

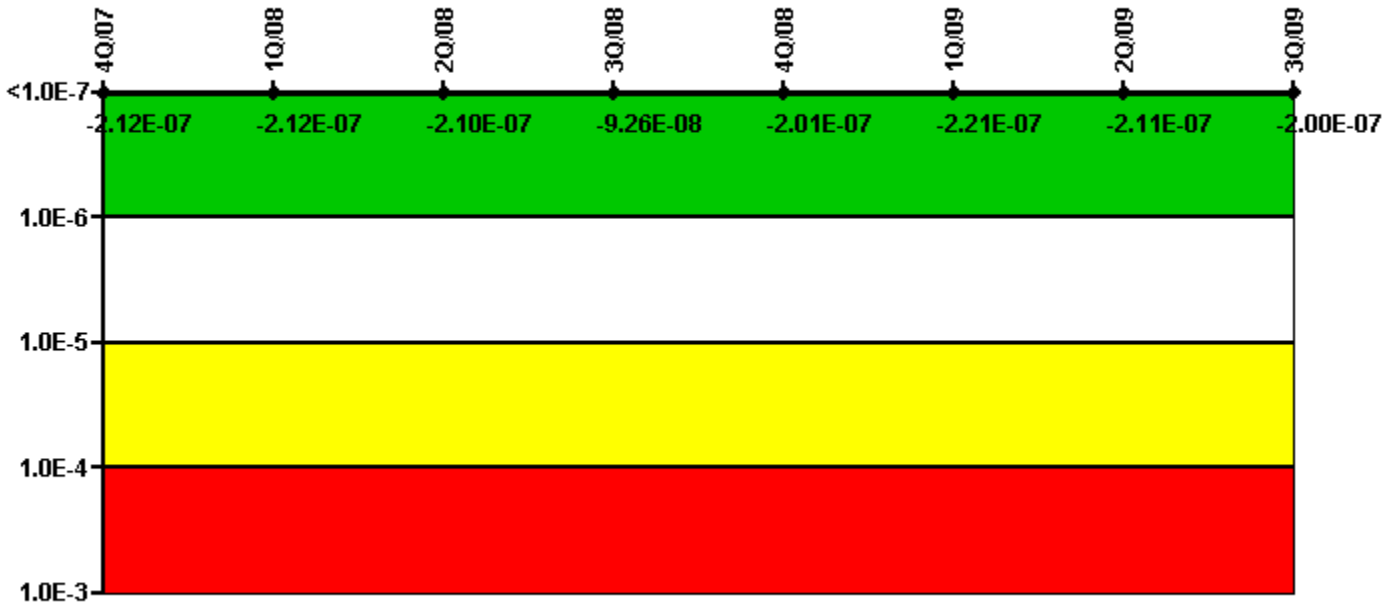


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.20E-08 | -1.20E-08 | -9.60E-09 | -5.90E-10 | -1.40E-09 | -2.10E-08 | -2.10E-08 | -9.70E-09 |
| URI (Δ CDF) | -2.00E-07 | -2.00E-07 | -2.00E-07 | -9.20E-08 | -2.00E-07 | -2.00E-07 | -1.90E-07 | -1.90E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.12E-07 | -2.12E-07 | -2.10E-07 | -9.26E-08 | -2.01E-07 | -2.21E-07 | -2.11E-07 | -2.00E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

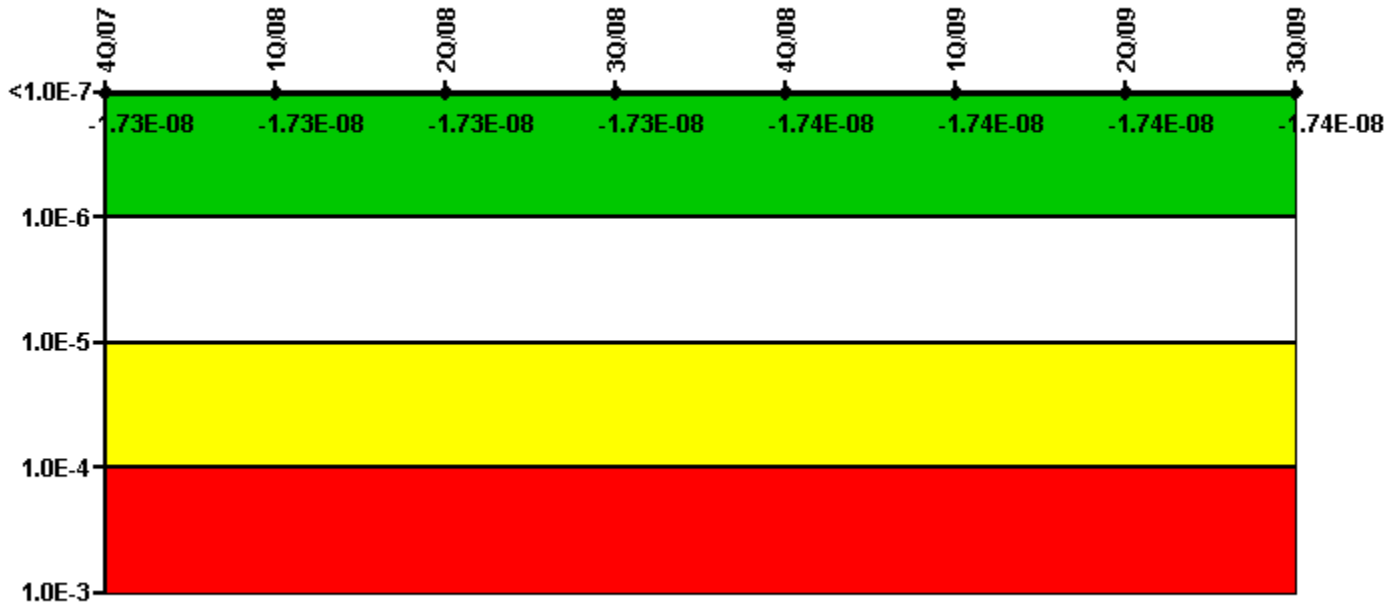


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -4.30E-09 | -4.30E-09 | -4.30E-09 | -4.30E-09 | -4.40E-09 | -4.40E-09 | -4.40E-09 | -4.40E-09 |
| URI (Δ CDF) | -1.30E-08 | -1.30E-08 | -1.30E-08 | -1.30E-08 | -1.30E-08 | -1.30E-08 | -1.30E-08 | -1.30E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.73E-08 | -1.73E-08 | -1.73E-08 | -1.73E-08 | -1.74E-08 | -1.74E-08 | -1.74E-08 | -1.74E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

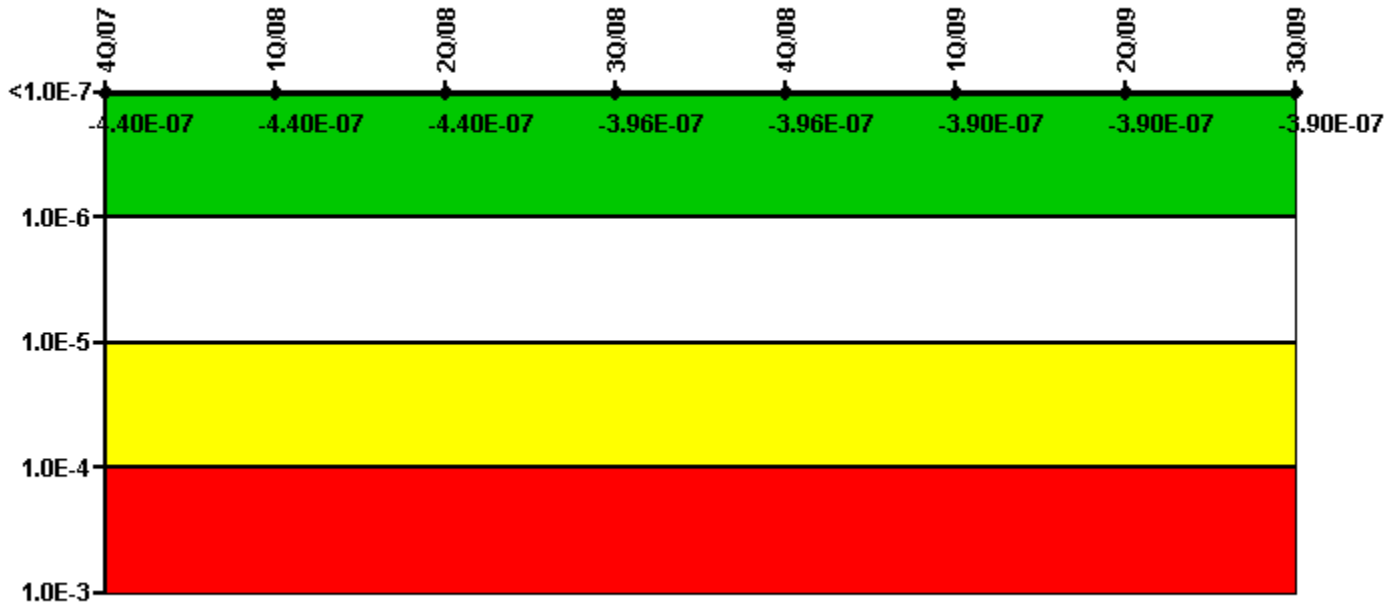


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.20E-07 | -1.20E-07 | -1.20E-07 | -7.60E-08 | -7.60E-08 | -7.00E-08 | -7.00E-08 | -7.00E-08 |
| URI (Δ CDF) | -3.20E-07 | -3.20E-07 | -3.20E-07 | -3.20E-07 | -3.20E-07 | -3.20E-07 | -3.20E-07 | -3.20E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -4.40E-07 | -4.40E-07 | -4.40E-07 | -3.96E-07 | -3.96E-07 | -3.90E-07 | -3.90E-07 | -3.90E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

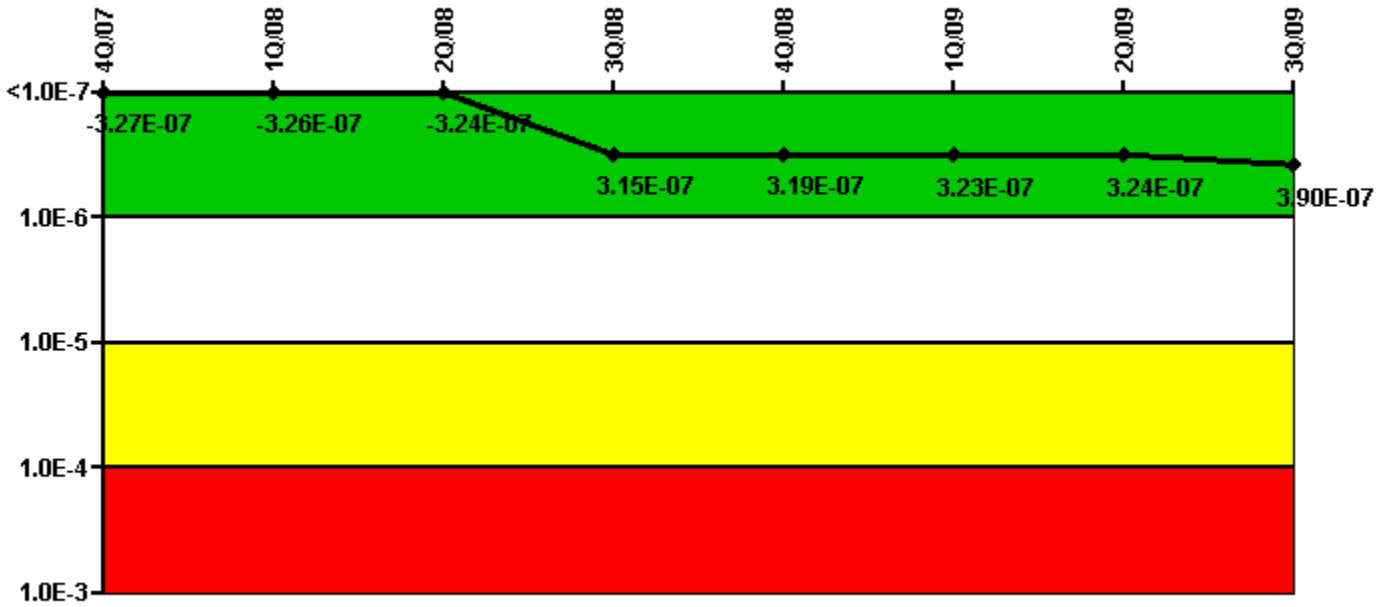


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|--|-----------|-----------|-----------|----------|----------|----------|----------|----------|
| UAI (Δ CDF) | -4.70E-08 | -4.60E-08 | -4.40E-08 | 4.50E-08 | 4.90E-08 | 5.30E-08 | 5.40E-08 | 1.20E-07 |
| URI (Δ CDF) | -2.80E-07 | -2.80E-07 | -2.80E-07 | 2.70E-07 | 2.70E-07 | 2.70E-07 | 2.70E-07 | 2.70E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -3.27E-07 | -3.26E-07 | -3.24E-07 | 3.15E-07 | 3.19E-07 | 3.23E-07 | 3.24E-07 | 3.90E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

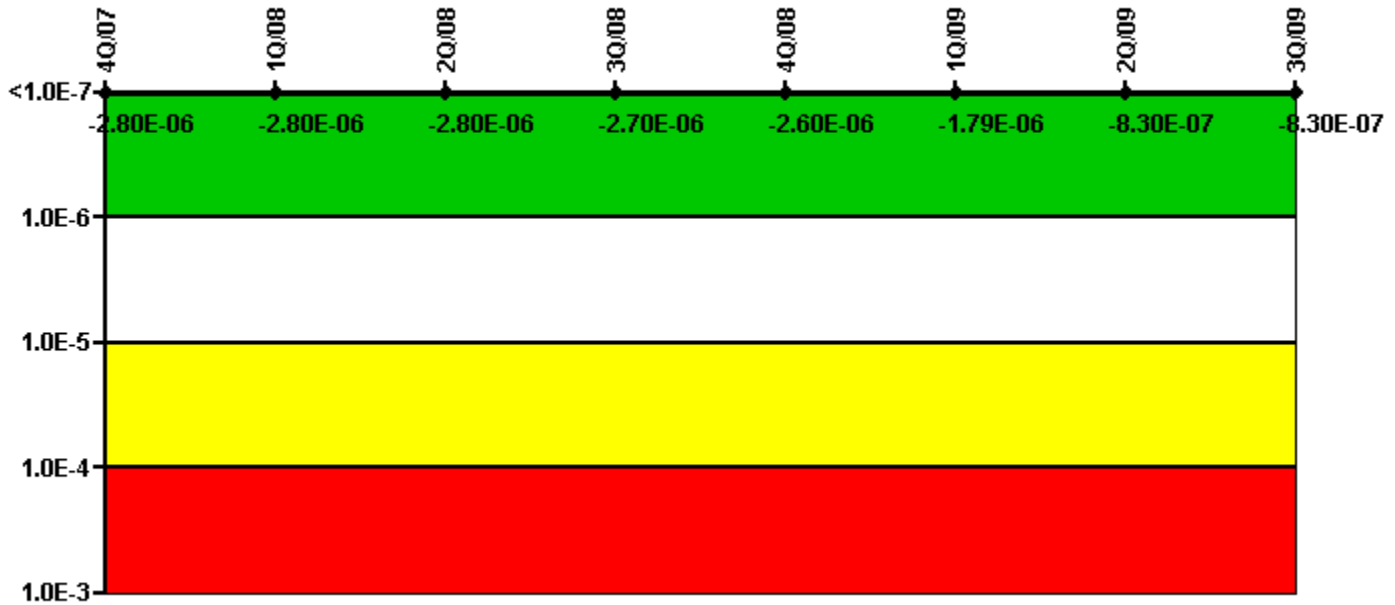


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.60E-06 | -1.60E-06 | -1.60E-06 | -1.50E-06 | -1.40E-06 | -5.90E-07 | -4.50E-07 | -4.50E-07 |
| URI (Δ CDF) | -1.20E-06 | -1.20E-06 | -1.20E-06 | -1.20E-06 | -1.20E-06 | -1.20E-06 | -3.80E-07 | -3.80E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.80E-06 | -2.80E-06 | -2.80E-06 | -2.70E-06 | -2.60E-06 | -1.79E-06 | -8.30E-07 | -8.30E-07 |

Licensee Comments: none

Reactor Coolant System Activity

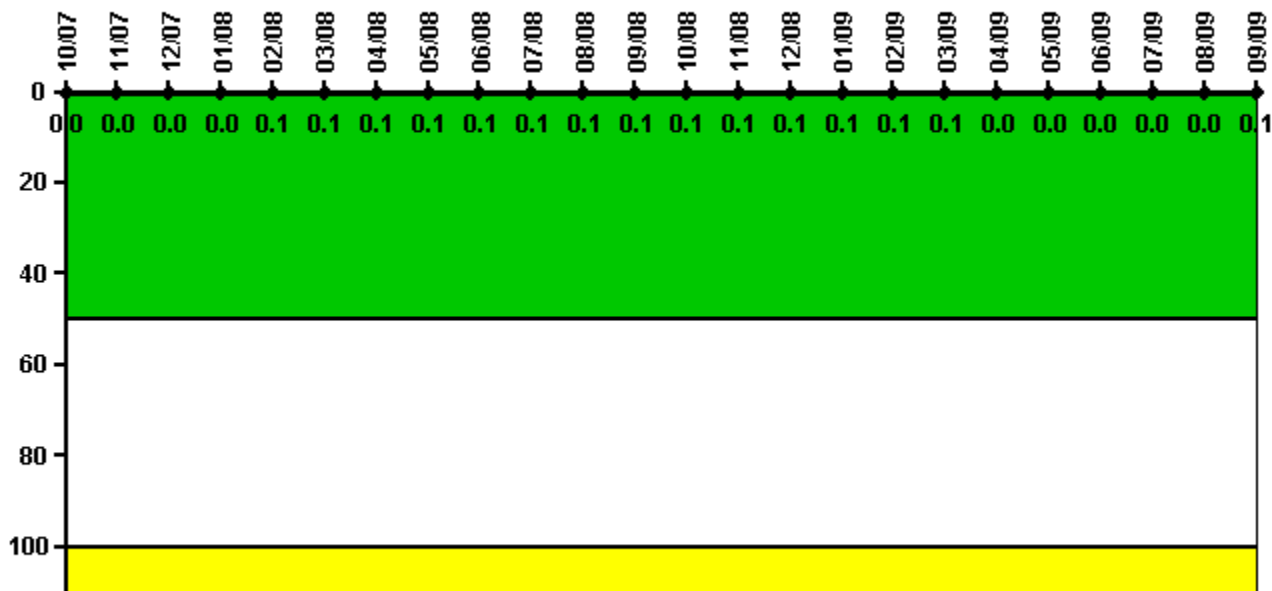


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Activity | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0 | 0.000197 | 0.000218 | 0.000217 | 0.000247 | 0.000239 | 0.000267 | 0.000292 | 0.000328 | 0.000328 | 0.000322 | 0.000303 |
| Technical specification limit | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 |
| Indicator value | 0 | 0 | 0 | 0 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 |
| Reactor Coolant System Activity | 10/08 | 11/08 | 12/08 | 1/09 | 2/09 | 3/09 | 4/09 | 5/09 | 6/09 | 7/09 | 8/09 | 9/09 |
| Maximum activity | 0.000331 | 0.000312 | 0.000311 | 0.000335 | 0.000293 | 0.000263 | 0.000143 | 0.000159 | 0.000186 | 0.000173 | 0.000171 | 0.000236 |
| Technical specification limit | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 |
| Indicator value | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0 | 0 | 0 | 0 | 0 | 0.1 |

Licensee Comments: none

Reactor Coolant System Leakage

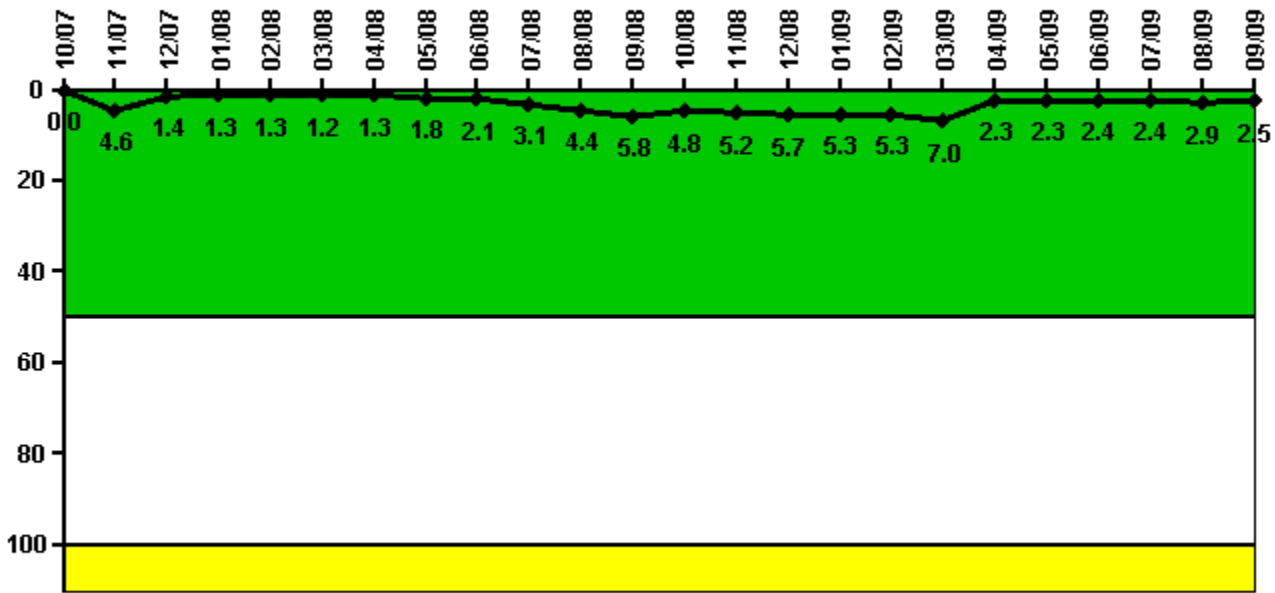


Thresholds: White > 50.0 Yellow > 100.0

Notes

| | | | | | | | | | | | | |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Reactor Coolant System Leakage | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 |
| Maximum leakage | 0 | 0.457 | 0.135 | 0.134 | 0.133 | 0.115 | 0.128 | 0.175 | 0.212 | 0.309 | 0.440 | 0.584 |
| Technical specification limit | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 |
| Indicator value | 0 | 4.6 | 1.4 | 1.3 | 1.3 | 1.2 | 1.3 | 1.8 | 2.1 | 3.1 | 4.4 | 5.8 |
| Reactor Coolant System Leakage | 10/08 | 11/08 | 12/08 | 1/09 | 2/09 | 3/09 | 4/09 | 5/09 | 6/09 | 7/09 | 8/09 | 9/09 |
| Maximum leakage | 0.484 | 0.523 | 0.570 | 0.525 | 0.534 | 0.698 | 0.231 | 0.229 | 0.244 | 0.237 | 0.288 | 0.254 |
| Technical specification limit | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 |
| Indicator value | 4.8 | 5.2 | 5.7 | 5.3 | 5.3 | 7.0 | 2.3 | 2.3 | 2.4 | 2.4 | 2.9 | 2.5 |

Licensee Comments: none

Drill/Exercise Performance

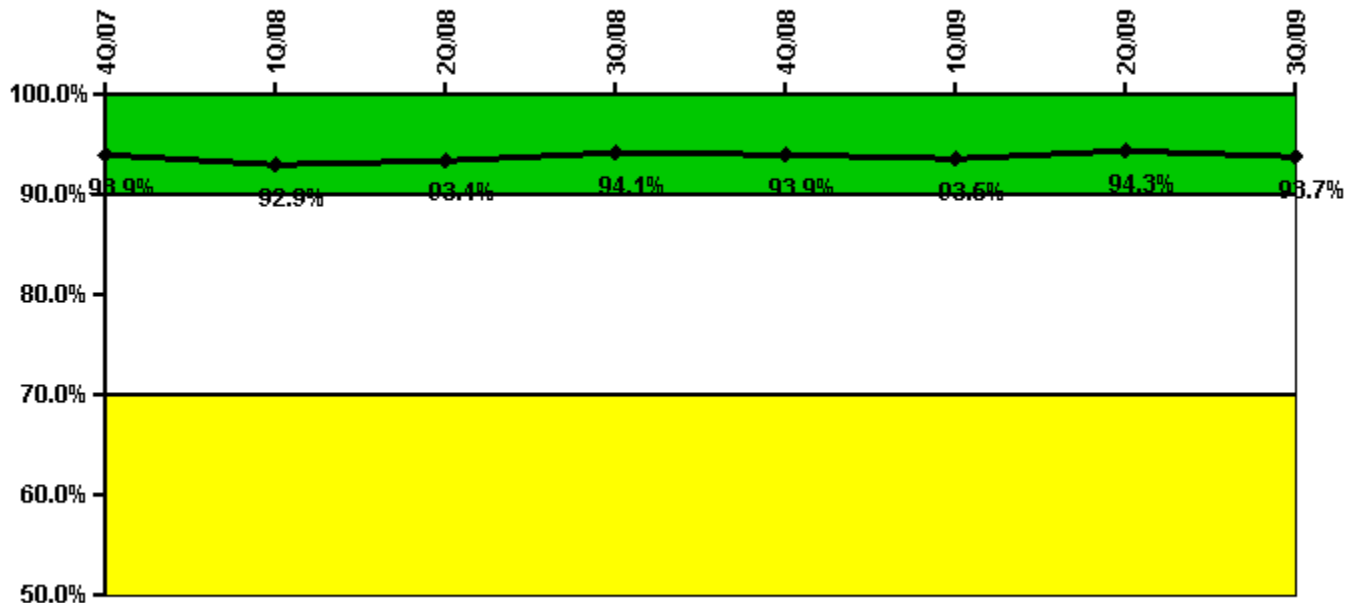


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 24.0 | 54.0 | 36.0 | 65.0 | 16.0 | 3.0 | 19.0 | 34.0 |
| Total opportunities | 24.0 | 60.0 | 38.0 | 71.0 | 17.0 | 3.0 | 20.0 | 35.0 |
| | | | | | | | | |
| Indicator value | 93.9% | 92.9% | 93.4% | 94.1% | 93.9% | 93.5% | 94.3% | 93.7% |

Licensee Comments: none

ERO Drill Participation

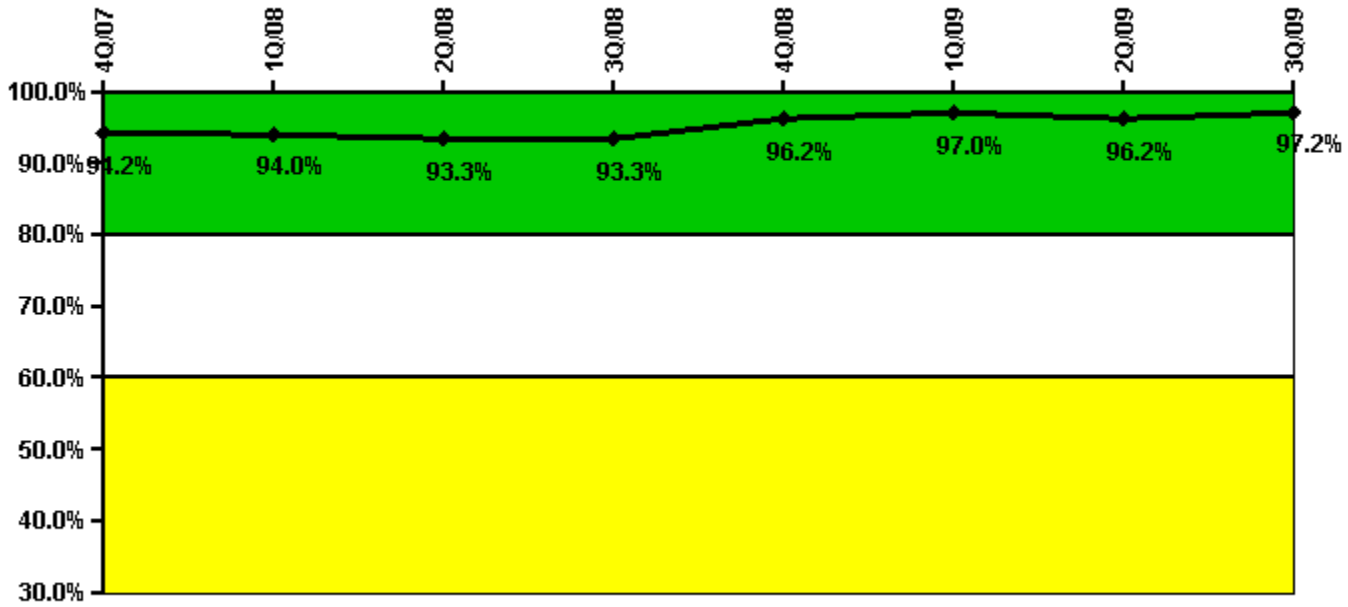


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Participating Key personnel | 130.0 | 125.0 | 125.0 | 126.0 | 128.0 | 128.0 | 128.0 | 139.0 |
| Total Key personnel | 138.0 | 133.0 | 134.0 | 135.0 | 133.0 | 132.0 | 133.0 | 143.0 |
| | | | | | | | | |
| Indicator value | 94.2% | 94.0% | 93.3% | 93.3% | 96.2% | 97.0% | 96.2% | 97.2% |

Licensee Comments: none

Alert & Notification System

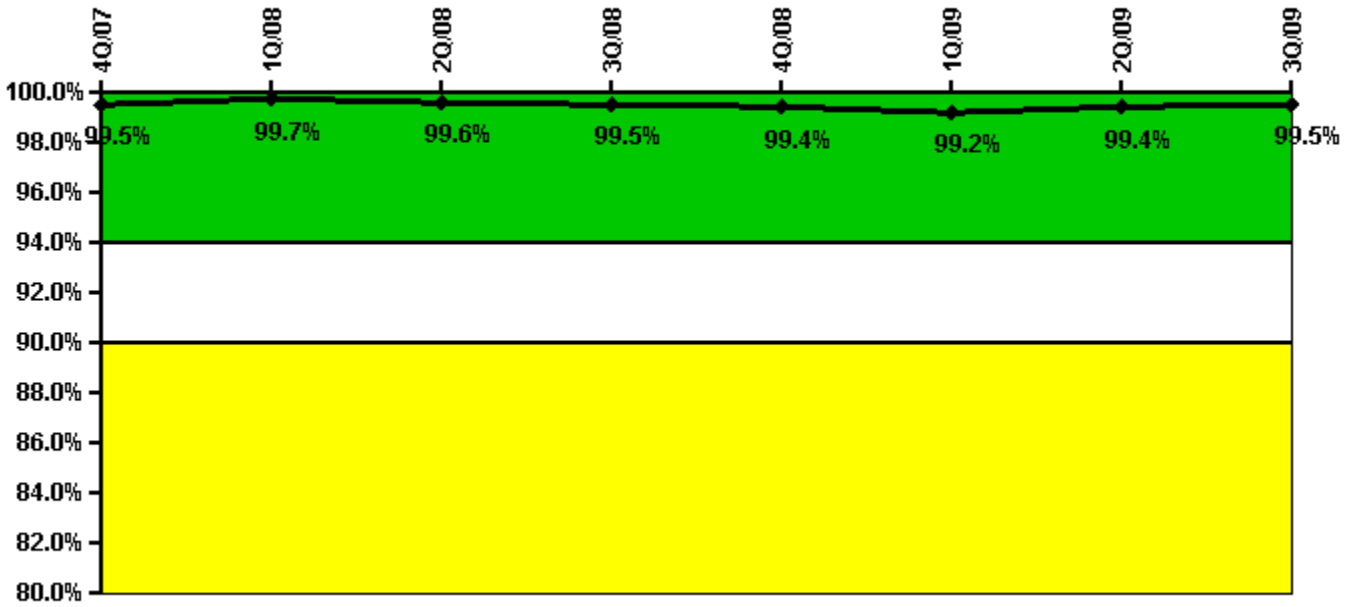


Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 2400 | 2400 | 2390 | 2372 | 2391 | 2386 | 2401 | 2386 |
| Total sirens-tests | 2403 | 2403 | 2403 | 2403 | 2403 | 2403 | 2403 | 2403 |
| | | | | | | | | |
| Indicator value | 99.5% | 99.7% | 99.6% | 99.5% | 99.4% | 99.2% | 99.4% | 99.5% |

Licensee Comments: none

Occupational Exposure Control Effectiveness

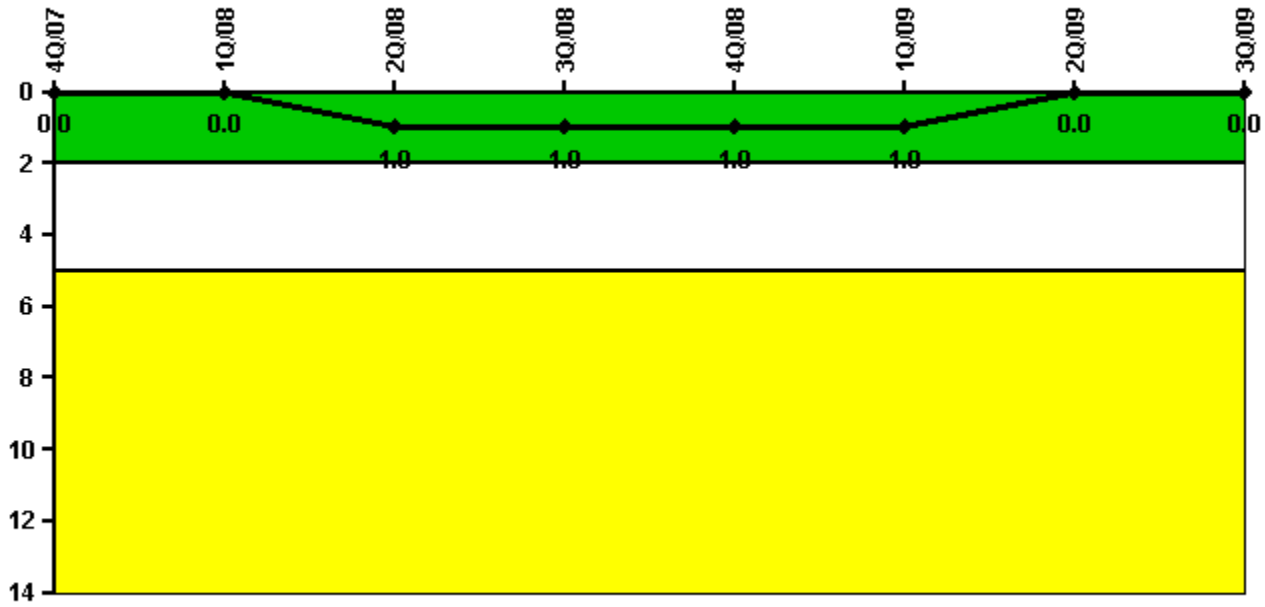

Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 1 | 1 | 1 | 1 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 | 4Q/08 | 1Q/09 | 2Q/09 | 3Q/09 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

[Security](#) information not publicly available.