


Farley 1

3Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

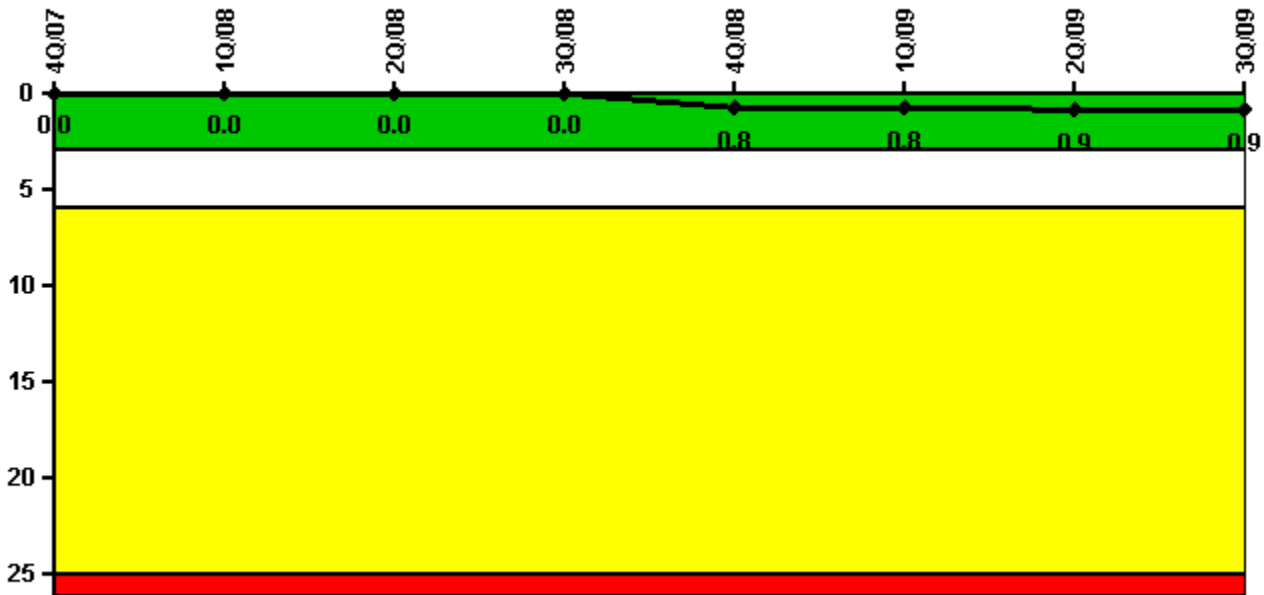


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	1185.6	2183.0	2184.0	2044.8	2187.7	2159.0	1373.0	2208.0
Indicator value	0	0	0	0	0.8	0.8	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

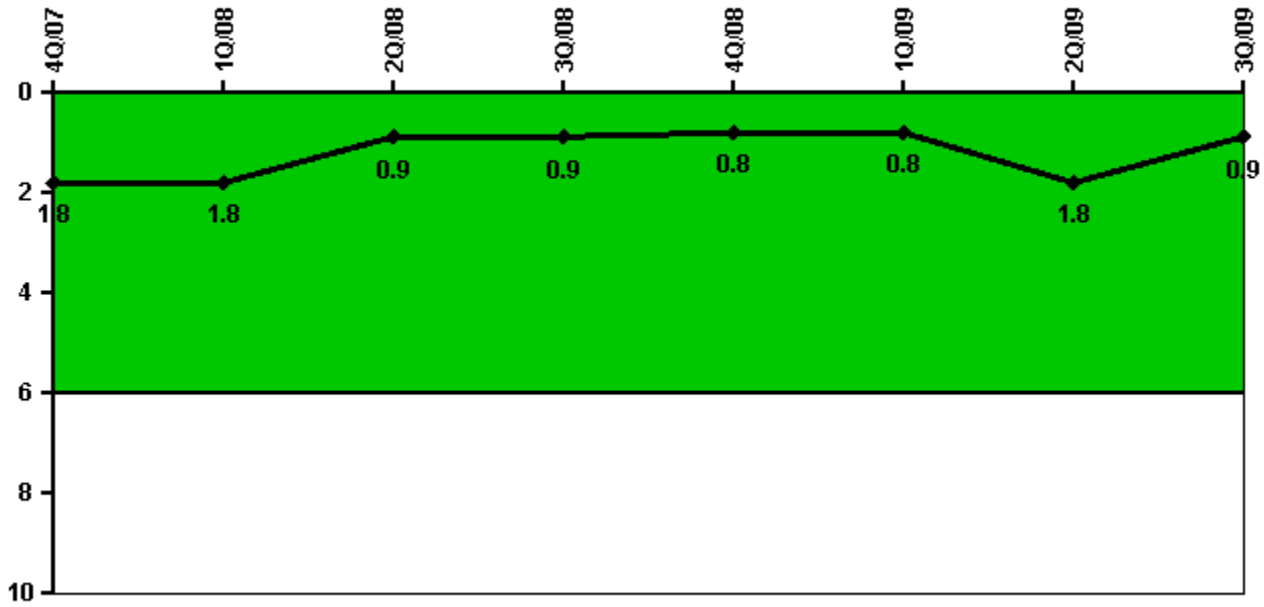

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned power changes	0	0	0	1.0	0	0	1.0	0
Critical hours	1185.6	2183.0	2184.0	2044.8	2187.7	2159.0	1373.0	2208.0
Indicator value	1.8	1.8	0.9	0.9	0.8	0.8	1.8	0.9

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

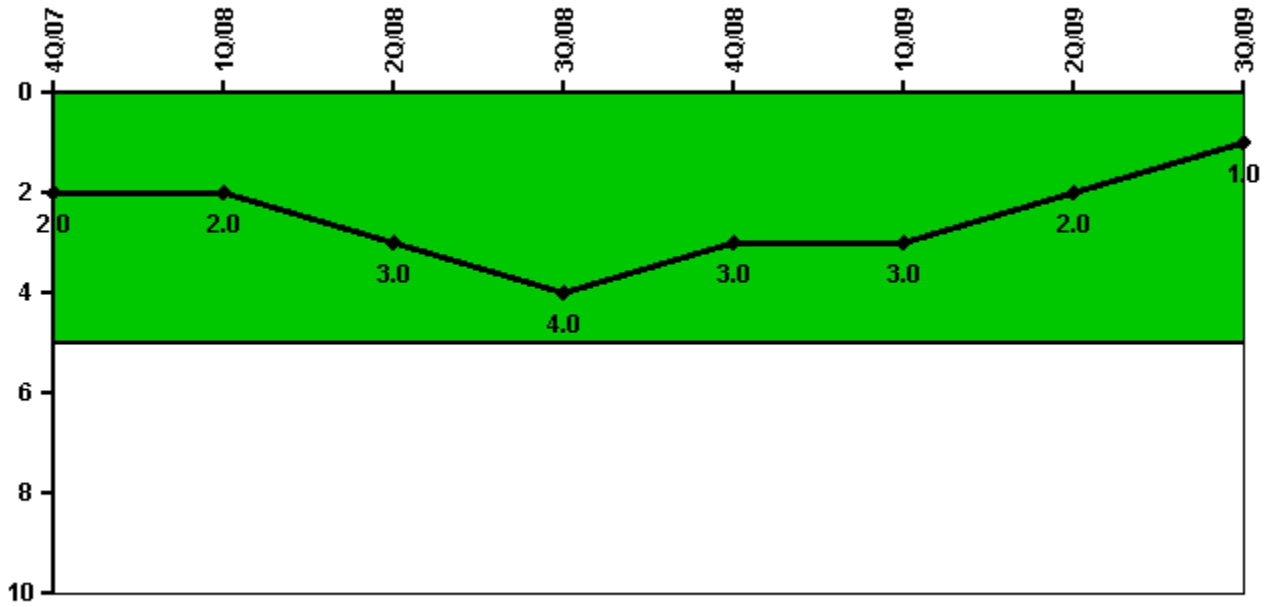


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Safety System Functional Failures	1	0	2	1	0	0	1	0
Indicator value	2	2	3	4	3	3	2	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

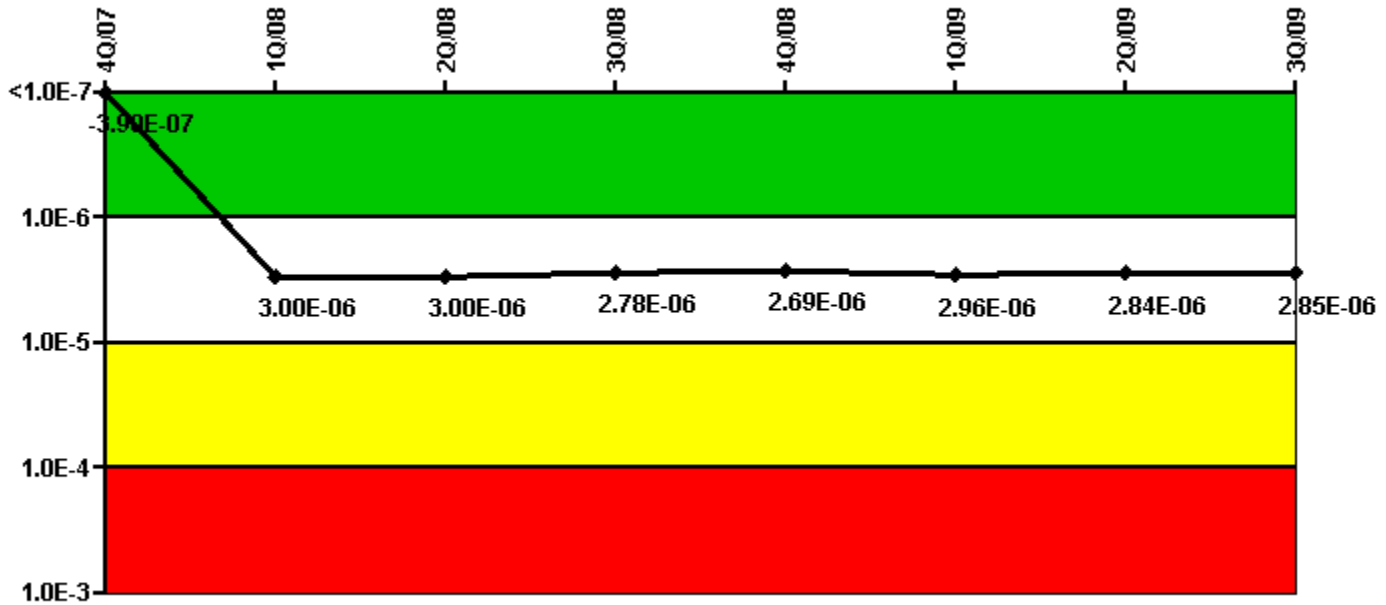

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (ΔCDF)	6.10E-07	1.20E-06	1.20E-06	7.80E-07	6.90E-07	9.60E-07	8.40E-07	8.50E-07
URI (ΔCDF)	-1.00E-06	1.80E-06	1.80E-06	2.00E-06	2.00E-06	2.00E-06	2.00E-06	2.00E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.90E-07	3.00E-06	3.00E-06	2.78E-06	2.69E-06	2.96E-06	2.84E-06	2.85E-06

Licensee Comments:

3Q/09: Risk Cap Invoked.

2Q/09: Risk Cap Invoked. Revised 2Q2009 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

1Q/09: Risk Cap Invoked. Revised 1Q2009 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

4Q/08: Risk Cap Invoked. Revised 4Q2008 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

3Q/08: Risk Cap Invoked. Revised 3Q2008 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

2Q/08: Risk Cap Invoked. Revised 2Q2008 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

1Q/08: Risk Cap Invoked. Revised 1Q2008 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

4Q/07: Revised 4Q2007 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

3Q/07: Revised 3Q2007 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

2Q/07: Revised 2Q2007 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

1Q/07: Revised 1Q2007 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

4Q/06: Revised 4Q2006 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

3Q/06: Revised 3Q2006 unavailability data upon revision of site procedures to include restoration actions to allow credit for operator action. PI indicator color not affected.

Mitigating Systems Performance Index, High Pressure Injection System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	-3.10E-08	-3.10E-08	-8.50E-09	-8.00E-09	-3.50E-09	-9.50E-09	-3.80E-09	1.40E-09
URI (Δ CDF)	-7.00E-08	-7.00E-08	-7.00E-08	-5.20E-08	-5.20E-08	-5.20E-08	-5.20E-08	-5.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.01E-07	-1.01E-07	-7.85E-08	-6.00E-08	-5.55E-08	-6.15E-08	-5.58E-08	-5.06E-08

Mitigating Systems Performance Index, Heat Removal System

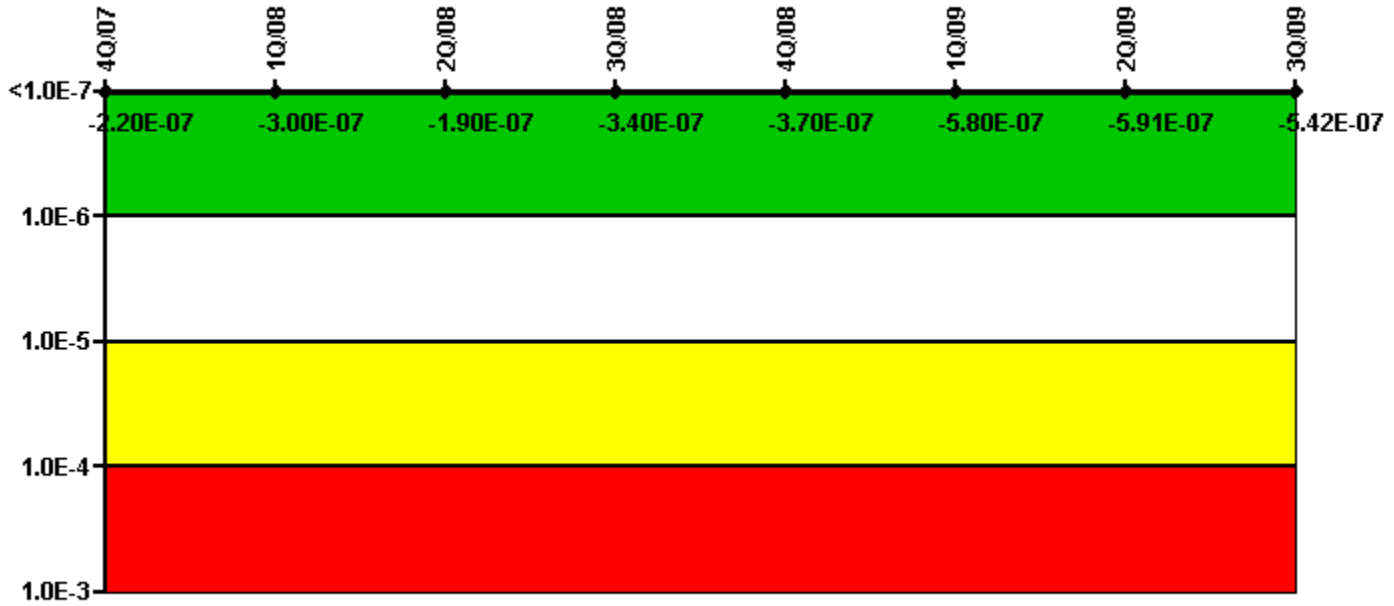


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	3.00E-07	2.20E-07	3.30E-07	1.60E-07	1.30E-07	-8.00E-08	-9.10E-08	-4.20E-08
URI (Δ CDF)	-5.20E-07	-5.20E-07	-5.20E-07	-5.00E-07	-5.00E-07	-5.00E-07	-5.00E-07	-5.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.20E-07	-3.00E-07	-1.90E-07	-3.40E-07	-3.70E-07	-5.80E-07	-5.91E-07	-5.42E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

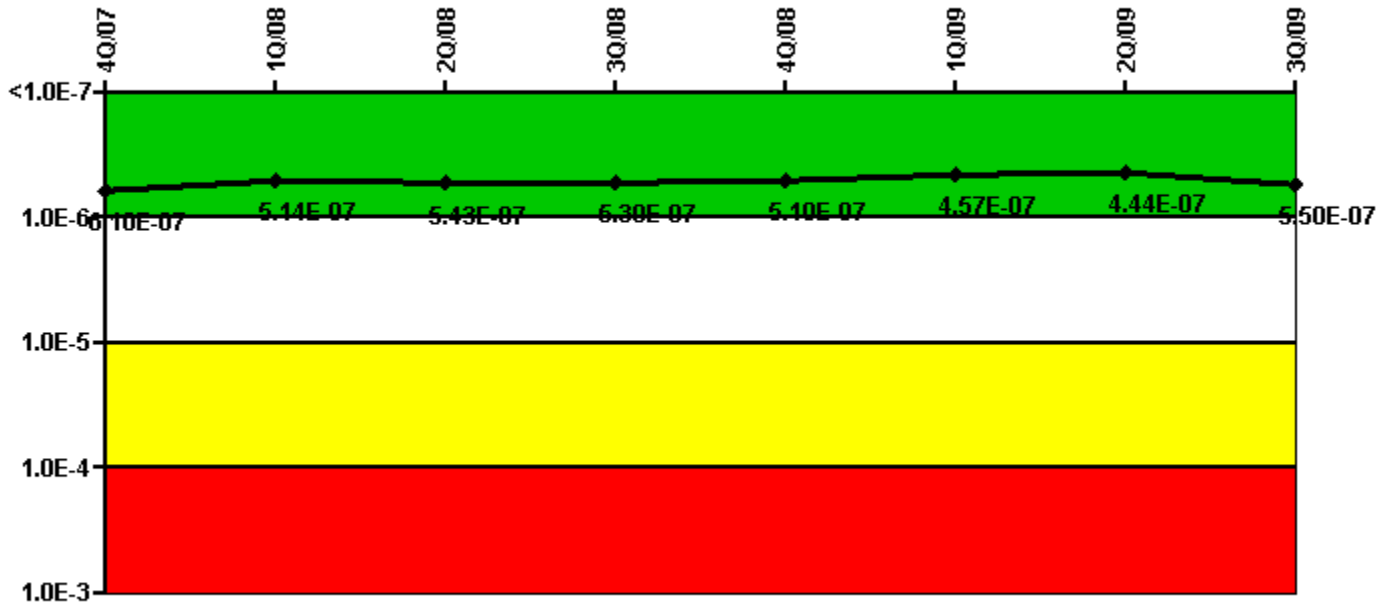


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	1.50E-07	5.40E-08	8.30E-08	1.20E-07	1.00E-07	4.70E-08	3.40E-08	1.40E-07
URI (Δ CDF)	4.60E-07	4.60E-07	4.60E-07	4.10E-07	4.10E-07	4.10E-07	4.10E-07	4.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.10E-07	5.14E-07	5.43E-07	5.30E-07	5.10E-07	4.57E-07	4.44E-07	5.50E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

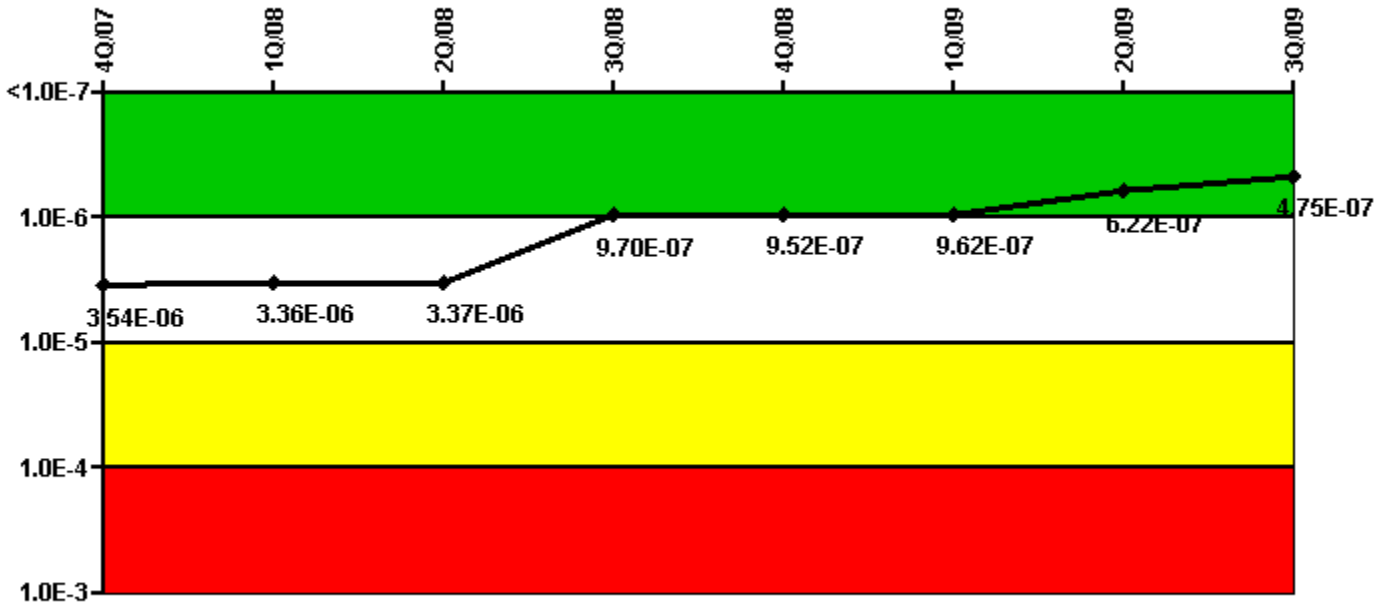


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (ΔCDF)	3.40E-07	3.60E-07	3.70E-07	4.00E-08	2.20E-08	2.20E-08	2.20E-08	2.50E-08
URI (ΔCDF)	3.20E-06	3.00E-06	3.00E-06	9.30E-07	9.30E-07	9.40E-07	6.00E-07	4.50E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.54E-06	3.36E-06	3.37E-06	9.70E-07	9.52E-07	9.62E-07	6.22E-07	4.75E-07

Licensee Comments: none

Reactor Coolant System Activity

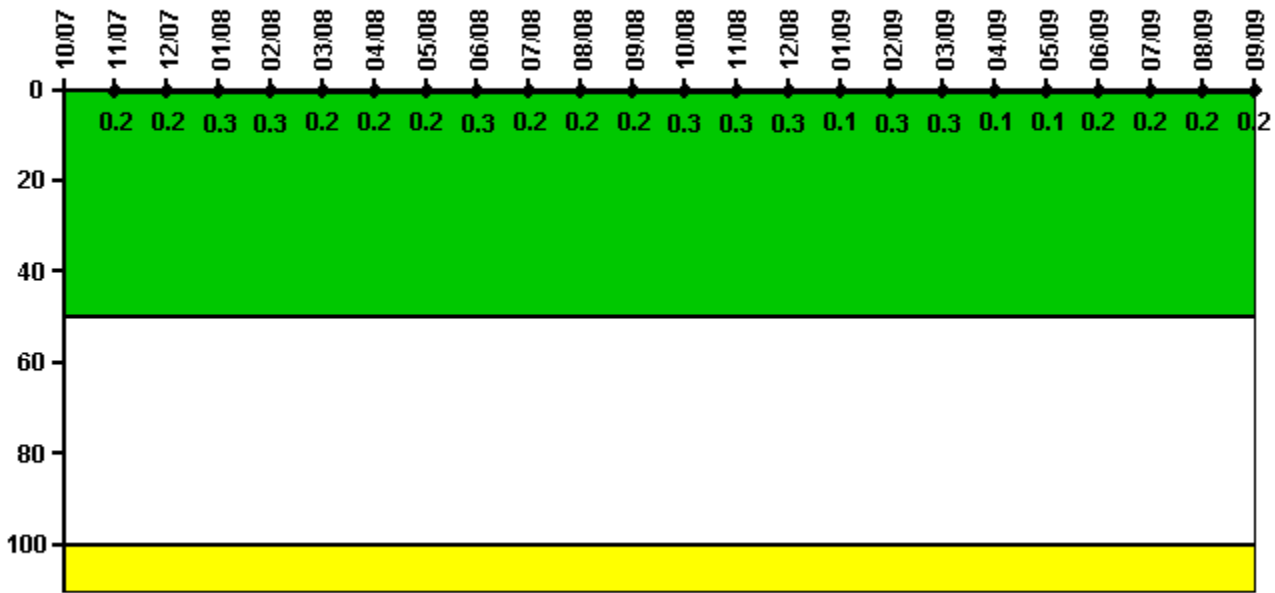


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	N/A	0.000917	0.001003	0.001271	0.001684	0.001040	0.001166	0.001242	0.001619	0.001189	0.001180	0.001170
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	N/A	0.2	0.2	0.3	0.3	0.2	0.2	0.2	0.3	0.2	0.2	0.2
Reactor Coolant System Activity	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum activity	0.001280	0.001290	0.001530	0.000284	0.001570	0.001590	0.000366	0.000692	0.000856	0.000876	0.000909	0.000975
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.3	0.3	0.3	0.1	0.3	0.3	0.1	0.1	0.2	0.2	0.2	0.2

Licensee Comments: none

Reactor Coolant System Leakage

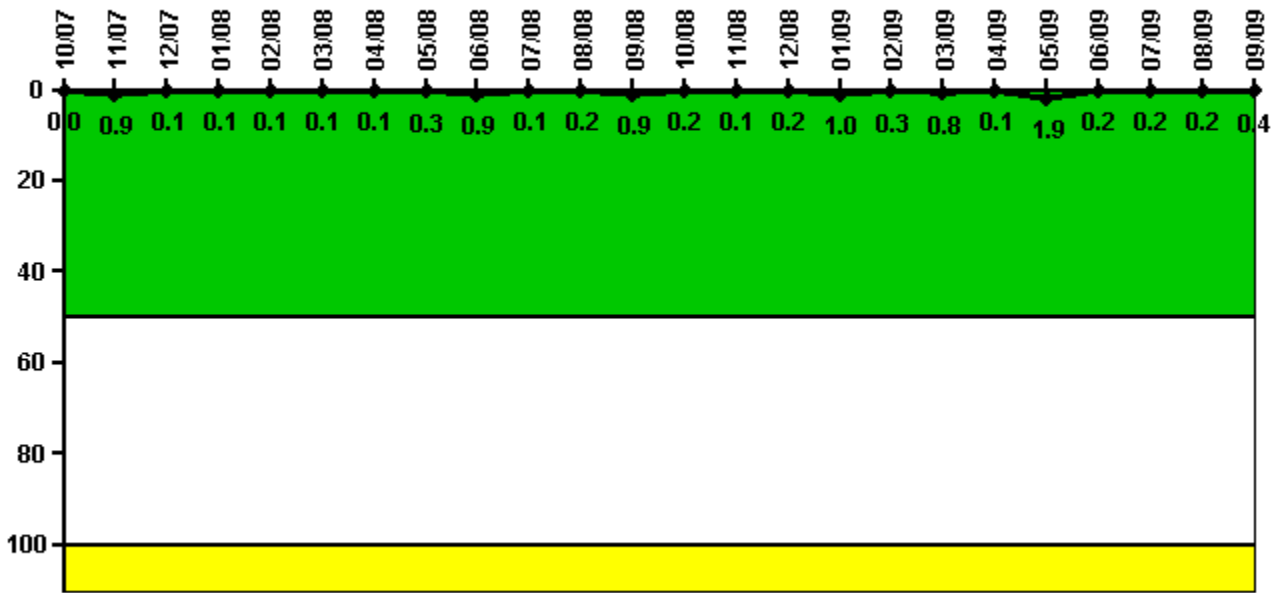

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	0	0.090	0.010	0.010	0.010	0.010	0.010	0.030	0.090	0.010	0.020	0.090
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0	0.9	0.1	0.1	0.1	0.1	0.1	0.3	0.9	0.1	0.2	0.9
Reactor Coolant System Leakage	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum leakage	0.020	0.010	0.020	0.100	0.030	0.080	0.007	0.185	0.020	0.016	0.020	0.038
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.1	0.2	1.0	0.3	0.8	0.1	1.9	0.2	0.2	0.2	0.4

Licensee Comments:

6/09: May 2009 Maximum RCS Identified Leakage revised due to original data obtained while plant was not stable enough to support an accurate leakage calculation. Indicator color is not affected.

Drill/Exercise Performance

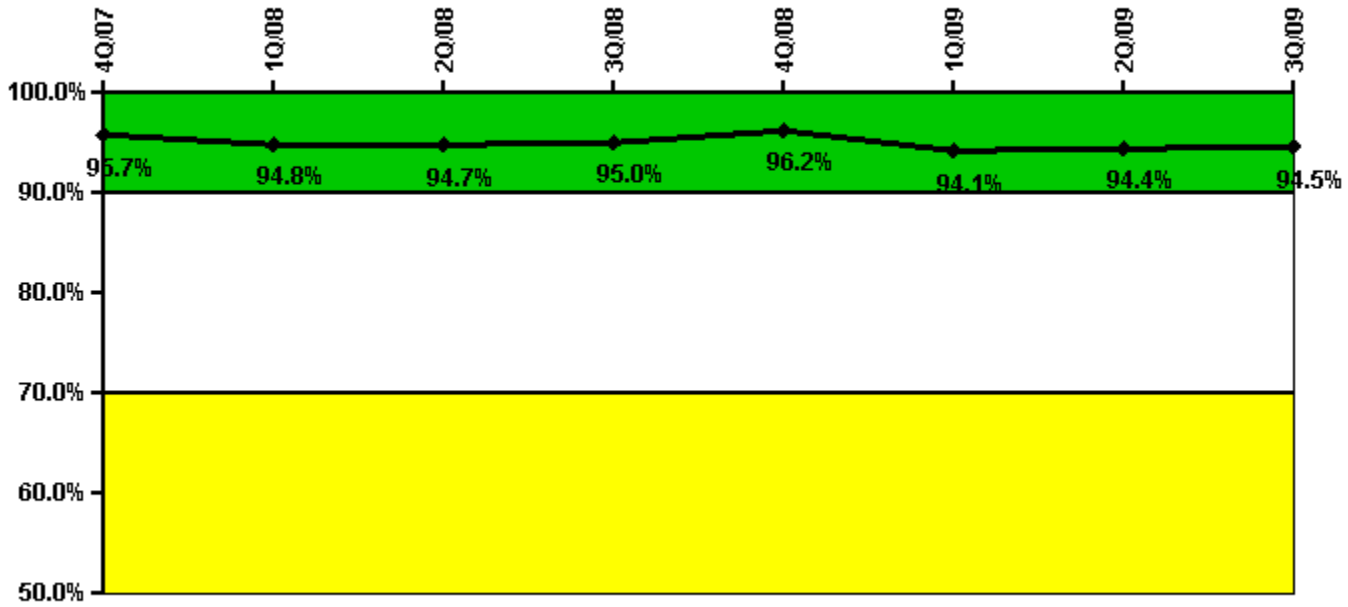


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful opportunities	14.0	57.0	19.0	27.0	13.0	25.0	18.0	15.0
Total opportunities	14.0	62.0	20.0	28.0	13.0	29.0	18.0	15.0
Indicator value	95.7%	94.8%	94.7%	95.0%	96.2%	94.1%	94.4%	94.5%

Licensee Comments: none

ERO Drill Participation

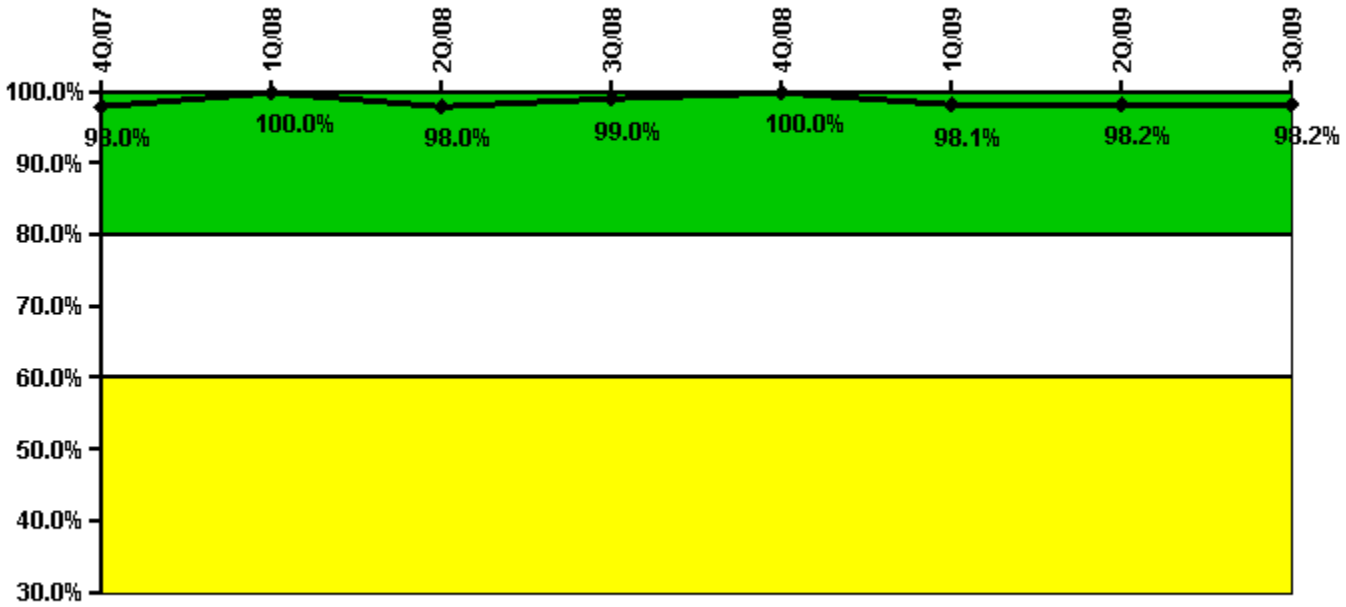


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Participating Key personnel	100.0	103.0	99.0	98.0	107.0	105.0	110.0	111.0
Total Key personnel	102.0	103.0	101.0	99.0	107.0	107.0	112.0	113.0
Indicator value	98.0%	100.0%	98.0%	99.0%	100.0%	98.1%	98.2%	98.2%

Licensee Comments: none

Alert & Notification System

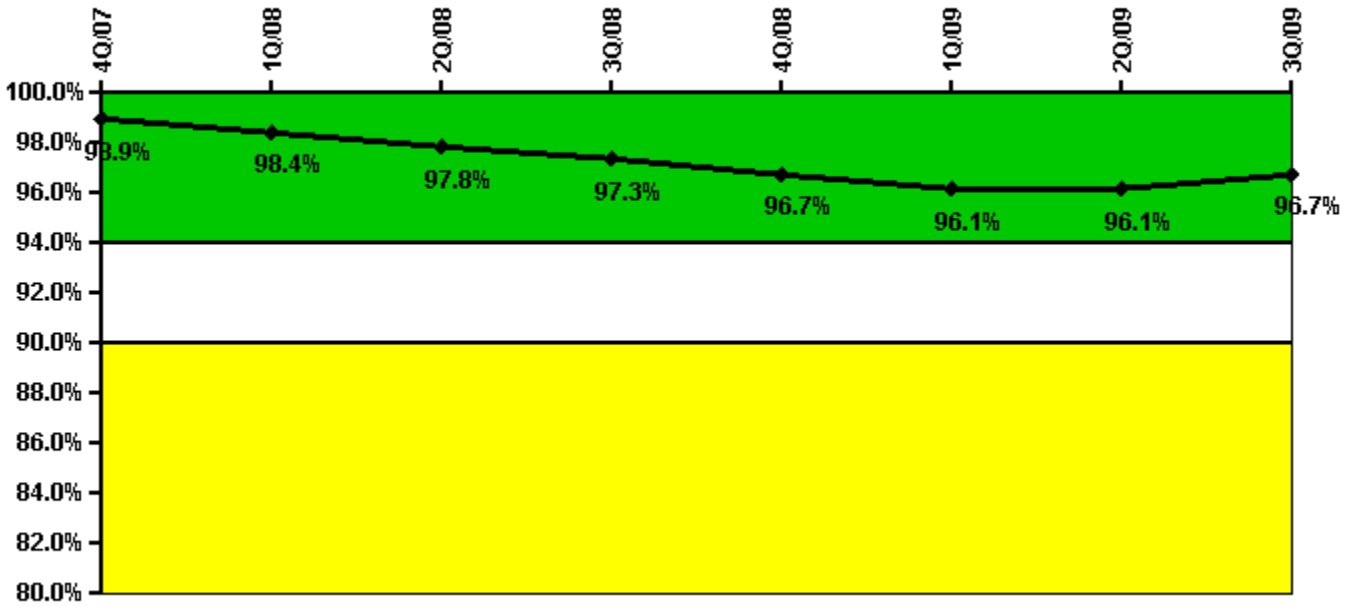


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful siren-tests	47	44	43	44	46	40	43	45
Total sirens-tests	48	45	45	45	48	42	45	45
Indicator value	98.9%	98.4%	97.8%	97.3%	96.7%	96.1%	96.1%	96.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness

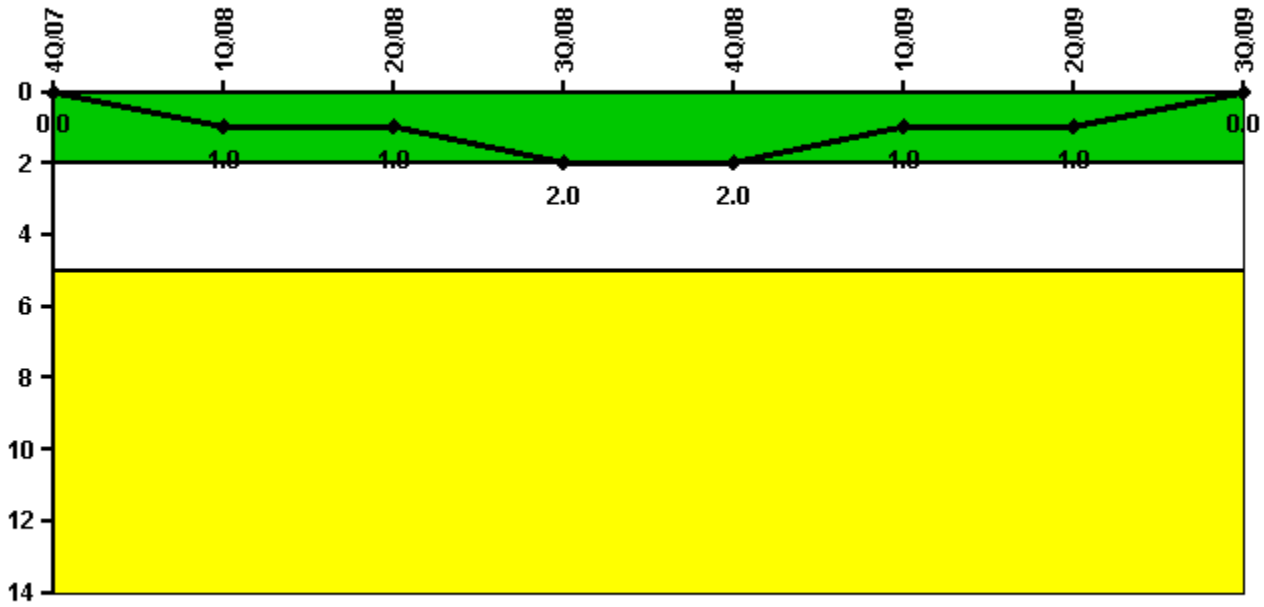

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
High radiation area occurrences	0	1	0	1	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	1	1	2	2	1	1	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.