


# Ginna

## 3Q/2009 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

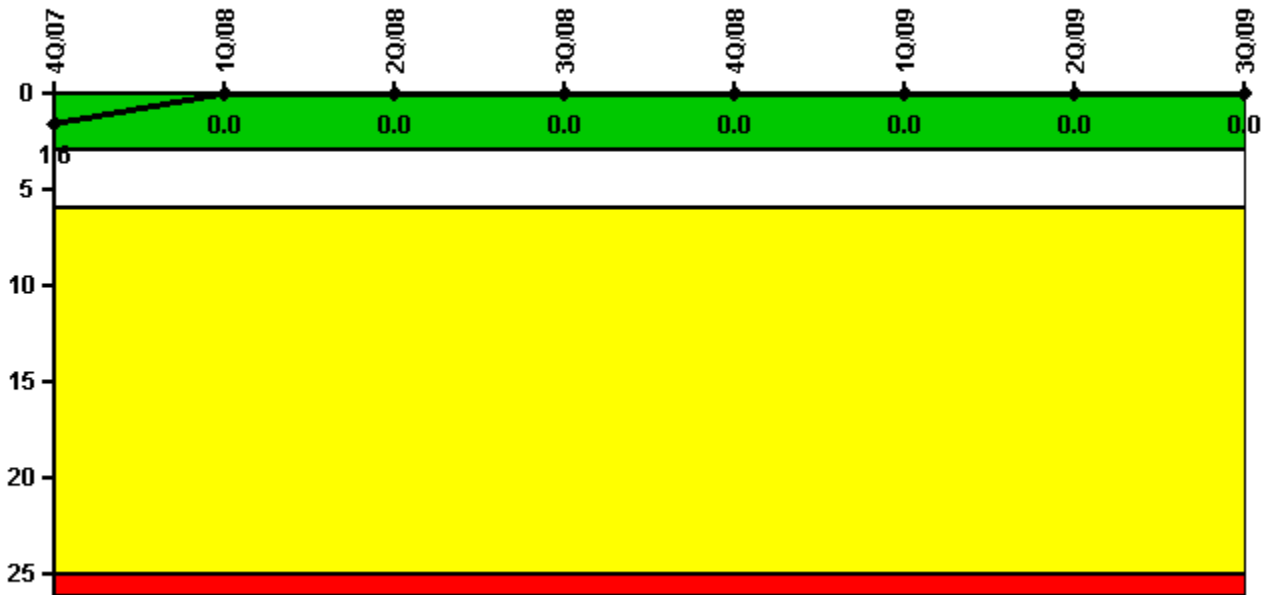

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


### Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2209.0	2183.0	1697.6	2208.0	2209.0	2159.0	2184.0	1796.0
Indicator value	1.6	0	0	0	0	0	0	0

Licensee Comments: none

---

## Unplanned Power Changes per 7000 Critical Hrs

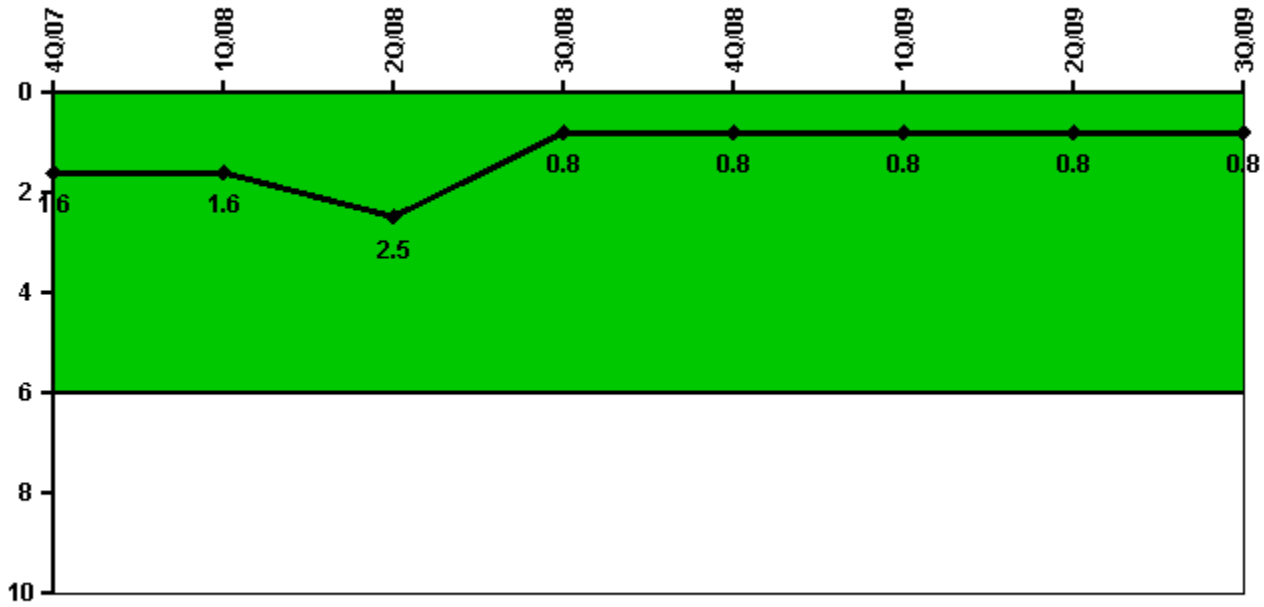


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned power changes	0	0	1.0	0	0	0	1.0	0
Critical hours	2209.0	2183.0	1697.6	2208.0	2209.0	2159.0	2184.0	1796.0
Indicator value	1.6	1.6	2.5	0.8	0.8	0.8	0.8	0.8

Licensee Comments: none

## Unplanned Scrams with Complications

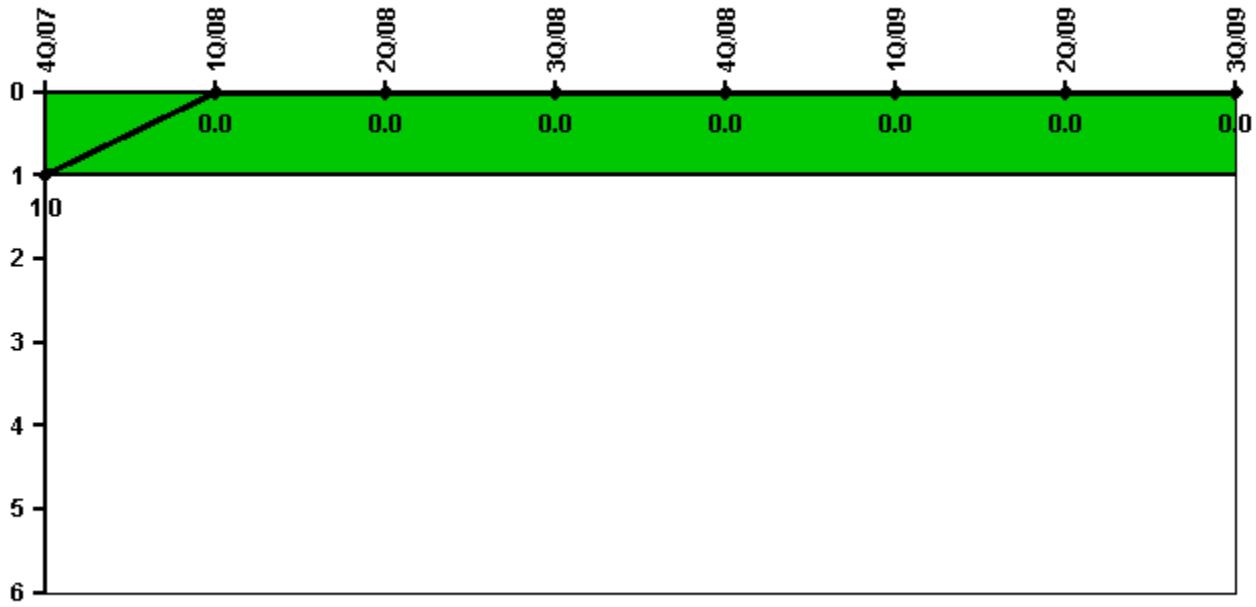

Thresholds: White > 1.0


### Notes

Unplanned Scrams with Complications	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

---

## Safety System Functional Failures (PWR)

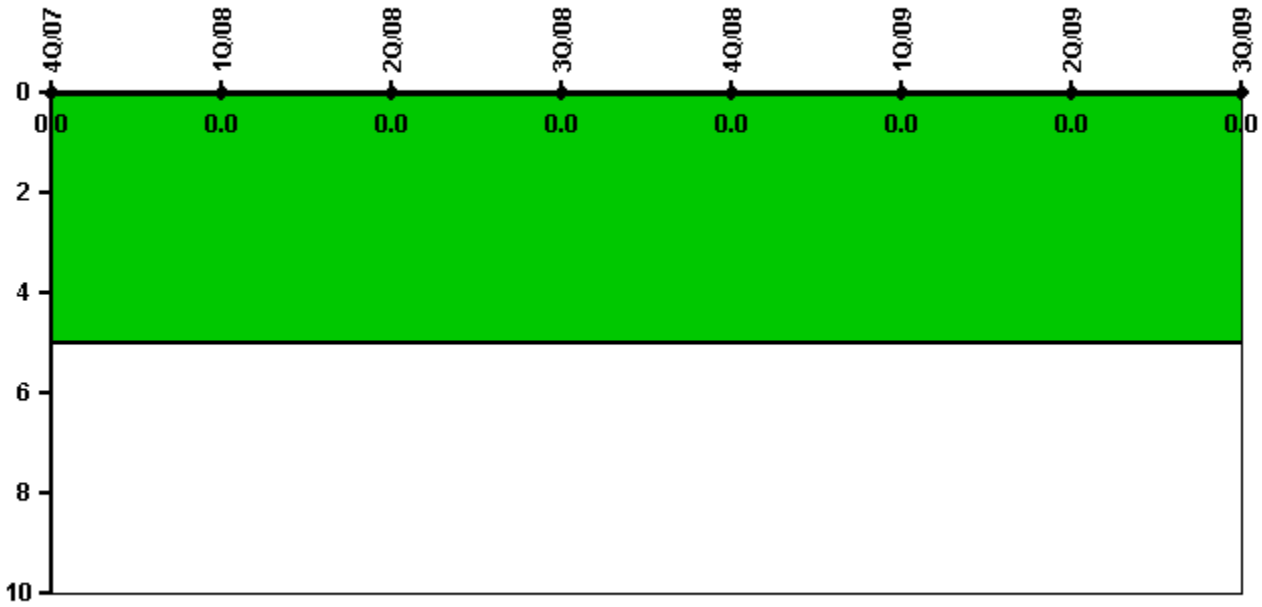

Thresholds: White > 5.0


### Notes

Safety System Functional Failures (PWR)	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

---

# Mitigating Systems Performance Index, Emergency AC Power System

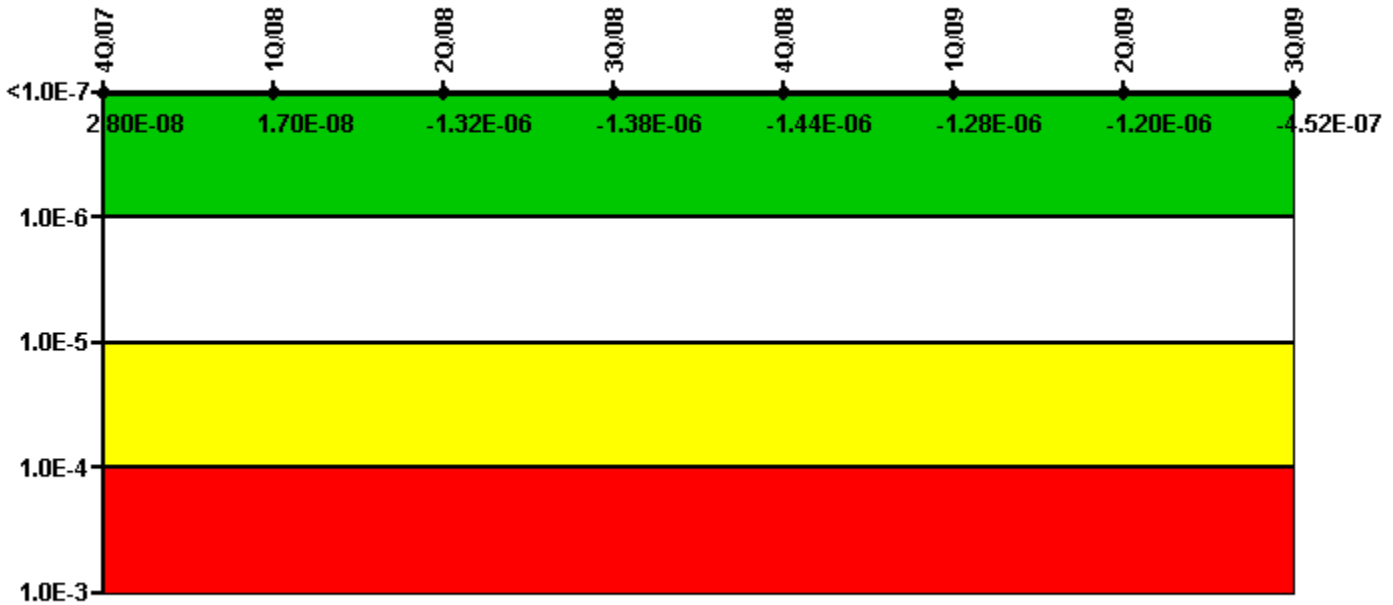

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	3.80E-08	3.50E-08	-2.10E-08	-7.90E-08	-1.40E-07	1.80E-08	9.70E-08	8.80E-08
URI ( $\Delta$ CDF)	-1.00E-08	-1.80E-08	-1.30E-06	-1.30E-06	-1.30E-06	-1.30E-06	-1.30E-06	-5.40E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.80E-08	1.70E-08	-1.32E-06	-1.38E-06	-1.44E-06	-1.28E-06	-1.20E-06	-4.52E-07

Licensee Comments:

3Q/09: Changed PRA Parameter(s). The Ginna PRA (GPRA) was updated to meet the quality standards in Regulatory Guide (RG) 1.200.

# Mitigating Systems Performance Index, High Pressure Injection System

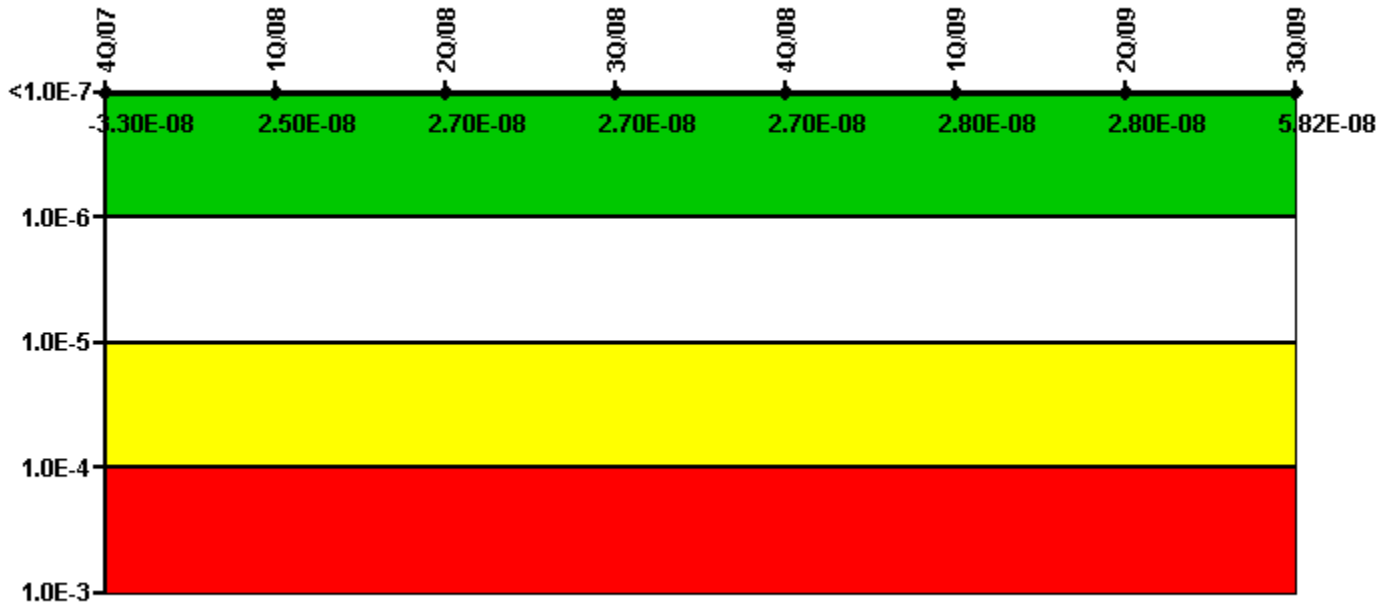

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	-1.20E-08	4.60E-08	4.70E-08	4.70E-08	4.70E-08	4.70E-08	4.70E-08	6.30E-08
URI ( $\Delta$ CDF)	-2.10E-08	-2.10E-08	-2.00E-08	-2.00E-08	-2.00E-08	-1.90E-08	-1.90E-08	-4.80E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.30E-08	2.50E-08	2.70E-08	2.70E-08	2.70E-08	2.80E-08	2.80E-08	5.82E-08

Licensee Comments:

3Q/09: Changed PRA Parameter(s). The Ginna PRA (GPRA) was updated to meet the quality standards in Regulatory Guide (RG) 1.200.

# Mitigating Systems Performance Index, Heat Removal System

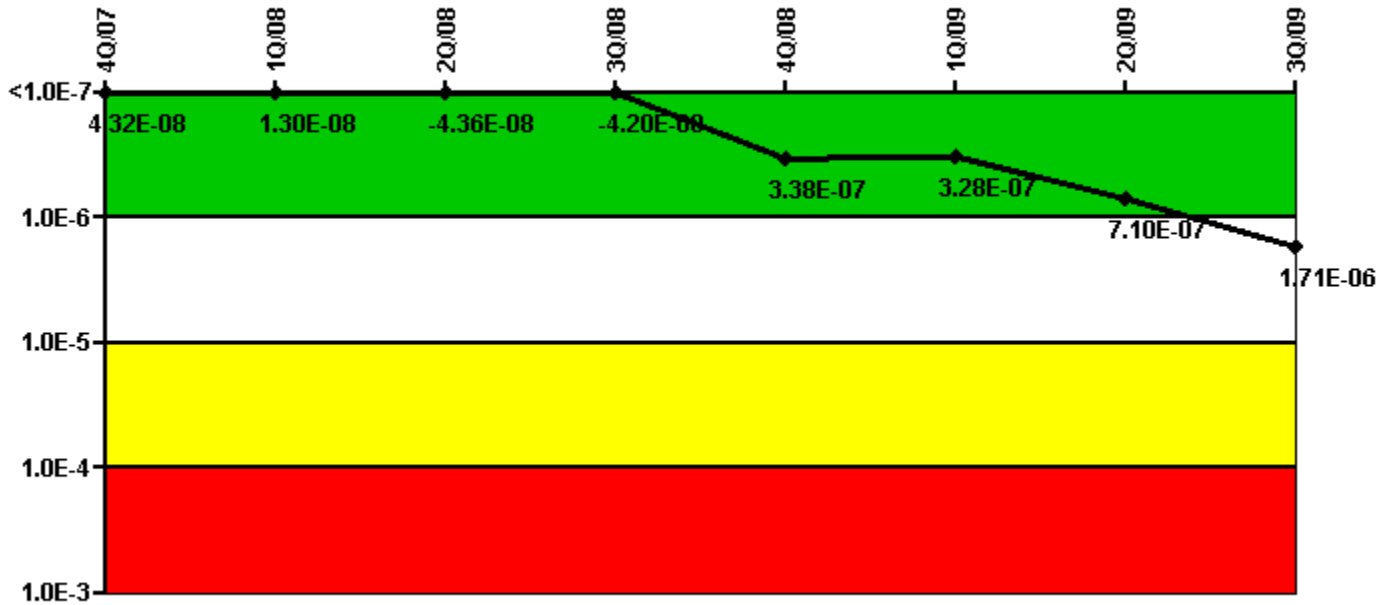

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	5.30E-08	6.20E-08	6.40E-09	8.00E-09	5.80E-08	4.80E-08	1.10E-07	3.10E-07
URI ( $\Delta$ CDF)	-9.80E-09	-4.90E-08	-5.00E-08	-5.00E-08	2.80E-07	2.80E-07	6.00E-07	1.40E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.32E-08	1.30E-08	-4.36E-08	-4.20E-08	3.38E-07	3.28E-07	7.10E-07	1.71E-06

Licensee Comments:

3Q/09: Changed PRA Parameter(s). The Ginna PRA (GPRA) was updated to meet the quality standards in Regulatory Guide (RG) 1.200.

# Mitigating Systems Performance Index, Residual Heat Removal System

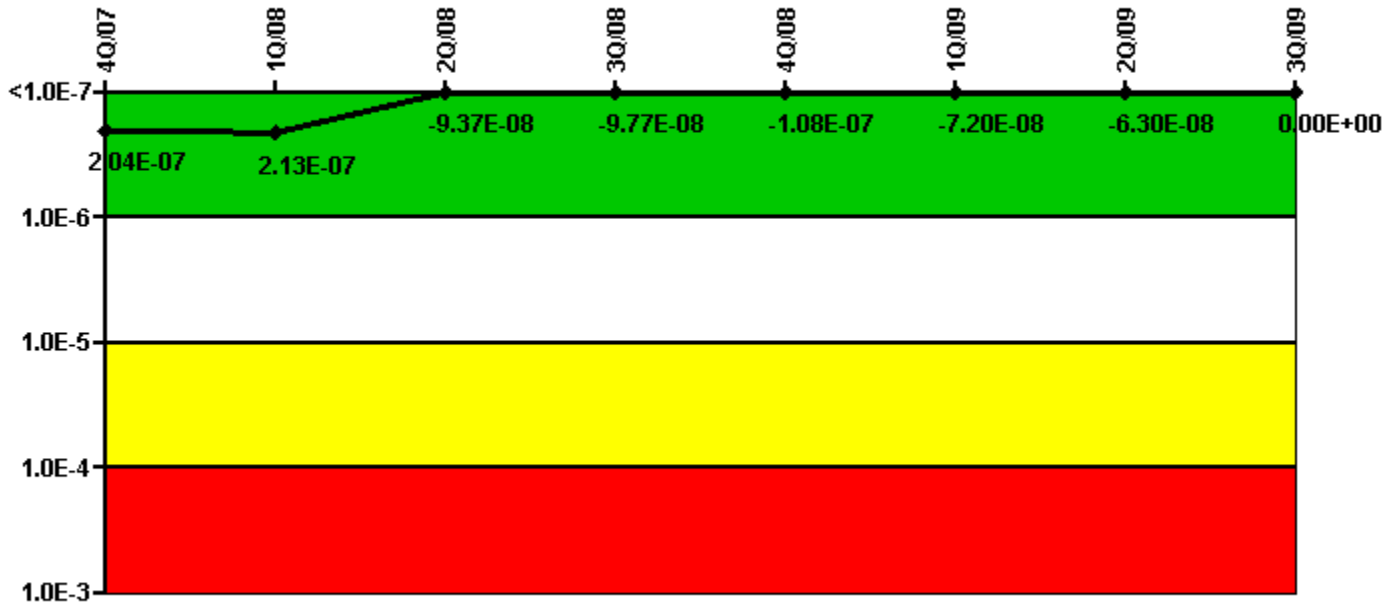

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes


Mitigating Systems Performance Index, Residual Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	3.70E-09	3.40E-09	2.30E-09	2.30E-09	2.30E-09	3.80E-08	5.70E-08	2.20E-08
URI ( $\Delta$ CDF)	2.00E-07	2.10E-07	-9.60E-08	-1.00E-07	-1.10E-07	-1.10E-07	-1.20E-07	-2.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.04E-07	2.13E-07	-9.37E-08	-9.77E-08	-1.08E-07	-7.20E-08	-6.30E-08	0.00E+00

Licensee Comments:

3Q/09: Changed PRA Parameter(s). The Ginna PRA (GPRA) was updated to meet the quality standards in Regulatory Guide (RG) 1.200.



# Mitigating Systems Performance Index, Cooling Water Systems

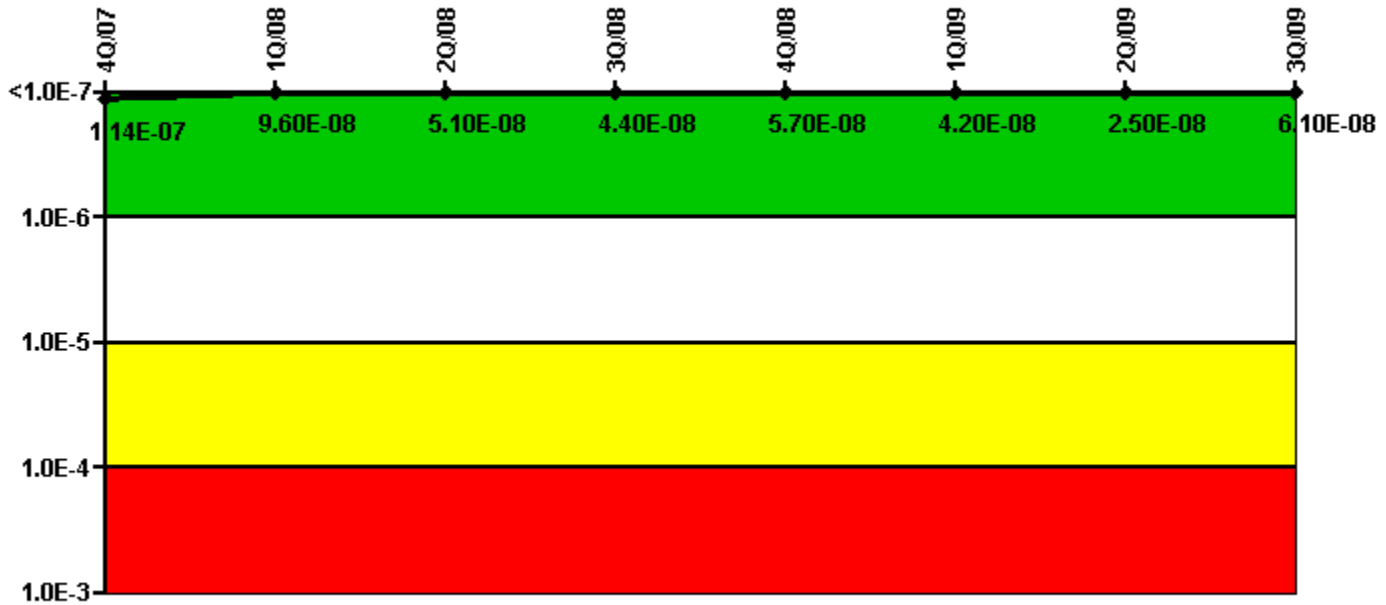

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	9.60E-08	7.70E-08	7.90E-08	7.20E-08	8.50E-08	6.90E-08	5.20E-08	9.00E-08
URI ( $\Delta$ CDF)	1.80E-08	1.90E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.70E-08	-2.70E-08	-2.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.14E-07	9.60E-08	5.10E-08	4.40E-08	5.70E-08	4.20E-08	2.50E-08	6.10E-08

Licensee Comments:

3Q/09: Changed PRA Parameter(s). The Ginna PRA (GPRA) was updated to meet the quality standards in Regulatory Guide (RG) 1.200.

# Reactor Coolant System Activity

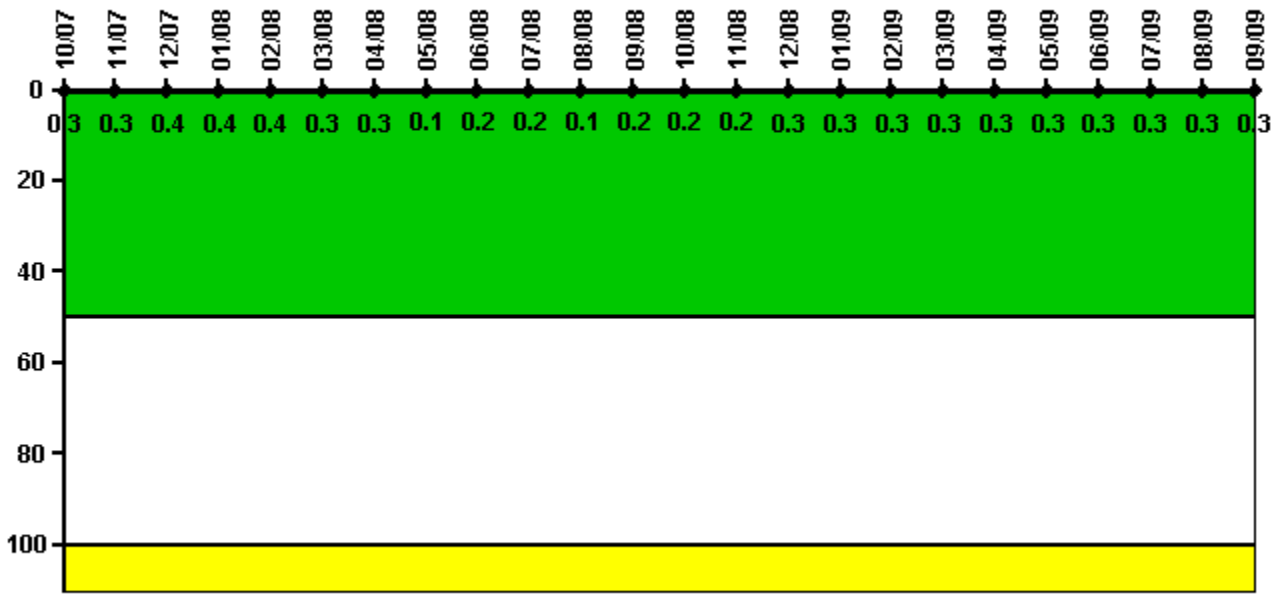


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.003100	0.003180	0.003500	0.003520	0.003710	0.003010	0.003490	0.001250	0.001500	0.001710	0.001460	0.001620
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.3	0.3	0.4	0.4	0.4	0.3	0.3	0.1	0.2	0.2	0.1	0.2
Reactor Coolant System Activity	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum activity	0.002190	0.002260	0.002690	0.002720	0.002680	0.002550	0.002590	0.002630	0.002700	0.002800	0.002830	0.002530
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3

Licensee Comments: none

## Reactor Coolant System Leakage

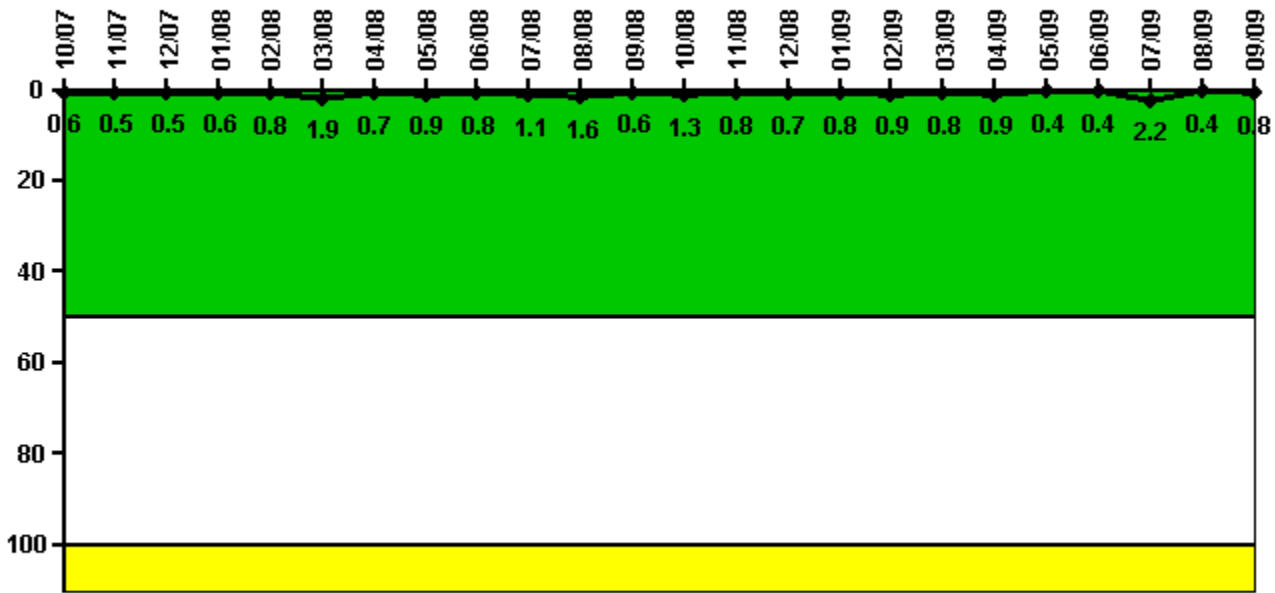


Thresholds: White > 50.0 Yellow > 100.0

### Notes

<b>Reactor Coolant System Leakage</b>	<b>10/07</b>	<b>11/07</b>	<b>12/07</b>	<b>1/08</b>	<b>2/08</b>	<b>3/08</b>	<b>4/08</b>	<b>5/08</b>	<b>6/08</b>	<b>7/08</b>	<b>8/08</b>	<b>9/08</b>
Maximum leakage	0.058	0.049	0.053	0.060	0.076	0.188	0.067	0.089	0.081	0.107	0.158	0.058
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.5	0.5	0.6	0.8	1.9	0.7	0.9	0.8	1.1	1.6	0.6
<b>Reactor Coolant System Leakage</b>	<b>10/08</b>	<b>11/08</b>	<b>12/08</b>	<b>1/09</b>	<b>2/09</b>	<b>3/09</b>	<b>4/09</b>	<b>5/09</b>	<b>6/09</b>	<b>7/09</b>	<b>8/09</b>	<b>9/09</b>
Maximum leakage	0.134	0.077	0.069	0.078	0.094	0.080	0.089	0.038	0.035	0.216	0.035	0.079
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.3	0.8	0.7	0.8	0.9	0.8	0.9	0.4	0.4	2.2	0.4	0.8

Licensee Comments: none

## Drill/Exercise Performance

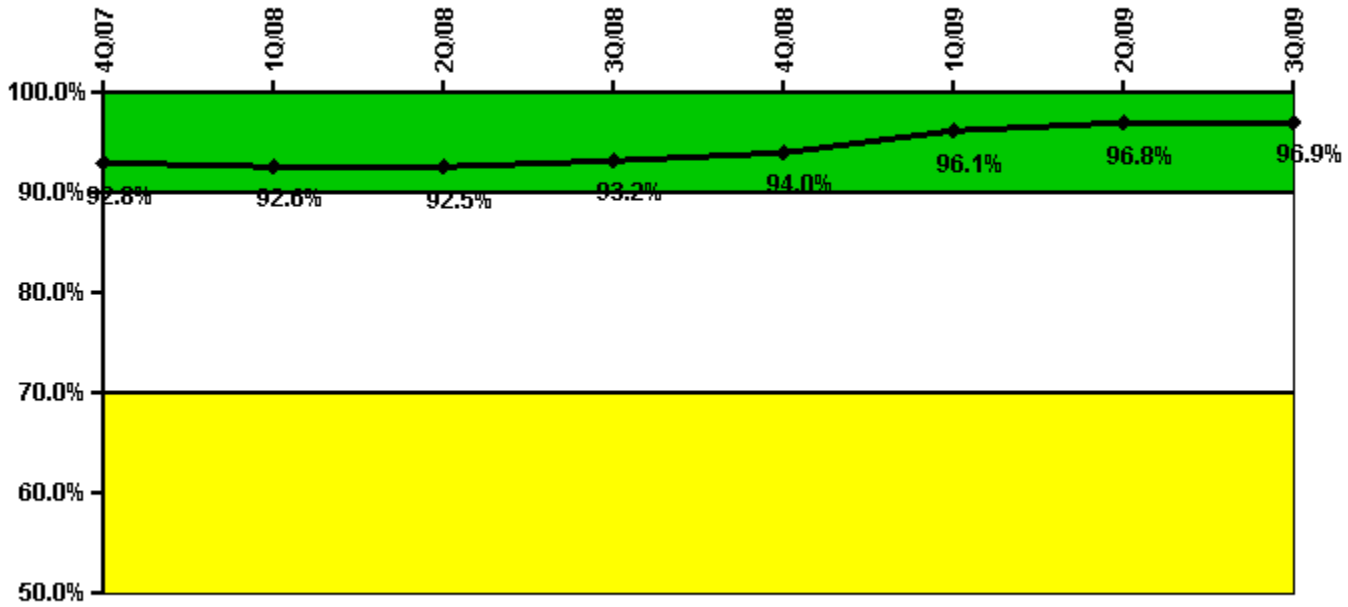


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful opportunities	32.0	63.0	0	38.0	32.0	55.0	15.0	14.0
Total opportunities	34.0	68.0	0	38.0	32.0	55.0	16.0	14.0
Indicator value	92.8%	92.6%	92.5%	93.2%	94.0%	96.1%	96.8%	96.9%

Licensee Comments: none

# ERO Drill Participation

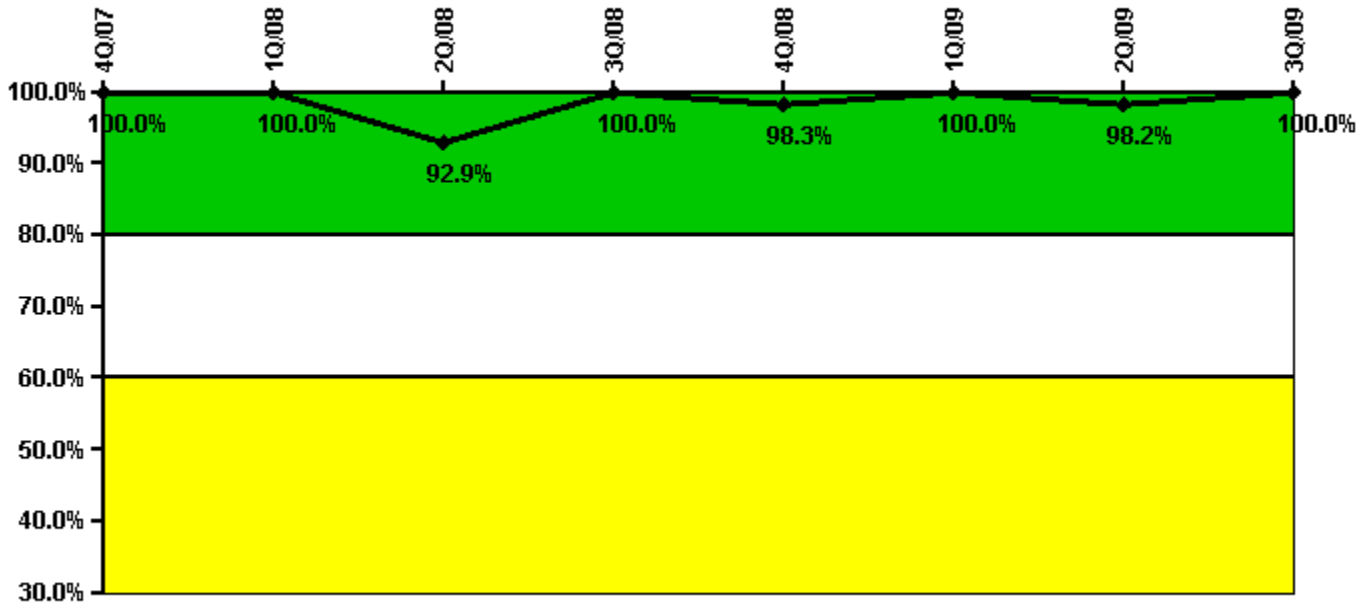


Thresholds: White < 80.0% Yellow < 60.0%

## Notes

ERO Drill Participation	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Participating Key personnel	51.0	57.0	52.0	57.0	58.0	58.0	54.0	53.0
Total Key personnel	51.0	57.0	56.0	57.0	59.0	58.0	55.0	53.0
Indicator value	100.0%	100.0%	92.9%	100.0%	98.3%	100.0%	98.2%	100.0%

Licensee Comments: none

# Alert & Notification System

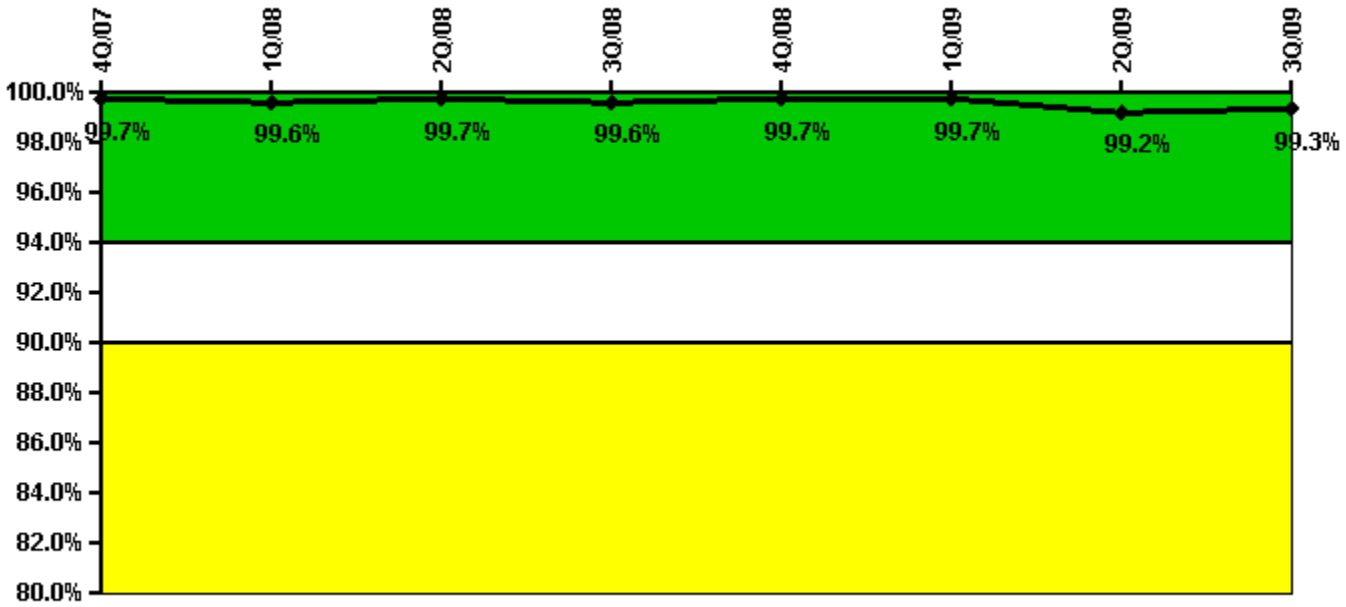


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful siren-tests	1243	1241	1245	1239	1248	1245	1221	1243
Total sirens-tests	1246	1248	1247	1247	1248	1248	1248	1248
Indicator value	99.7%	99.6%	99.7%	99.6%	99.7%	99.7%	99.2%	99.3%

Licensee Comments: none

# Occupational Exposure Control Effectiveness

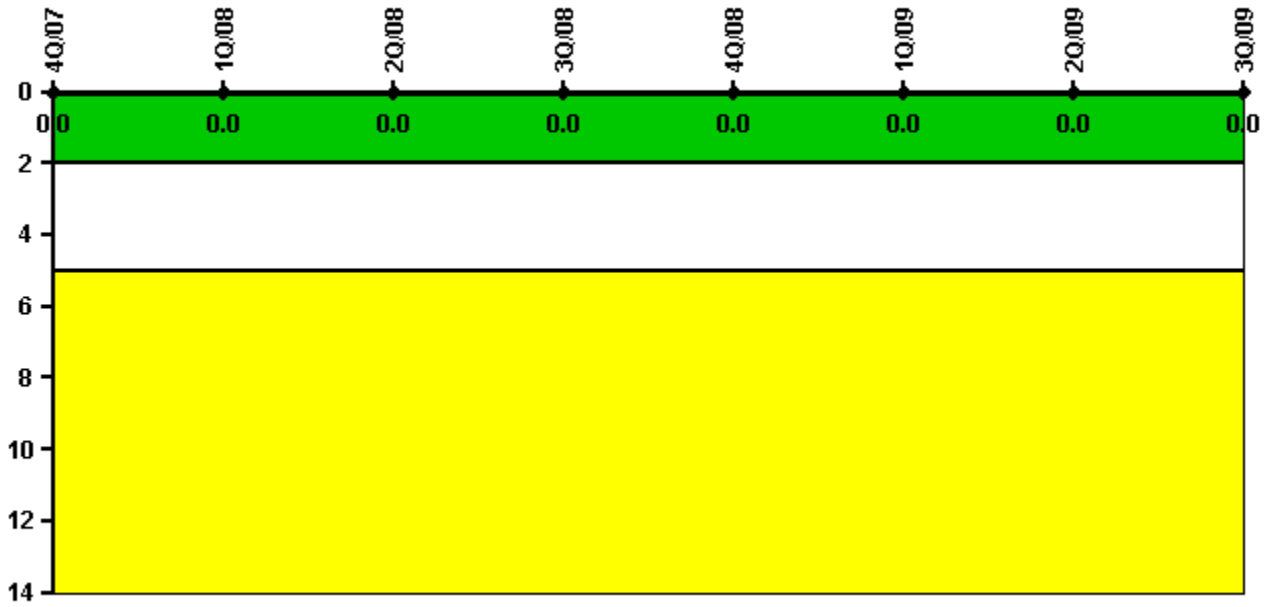

Thresholds: White > 2.0 Yellow > 5.0


## Notes

Occupational Exposure Control Effectiveness	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

---

# RETS/ODCM Radiological Effluent

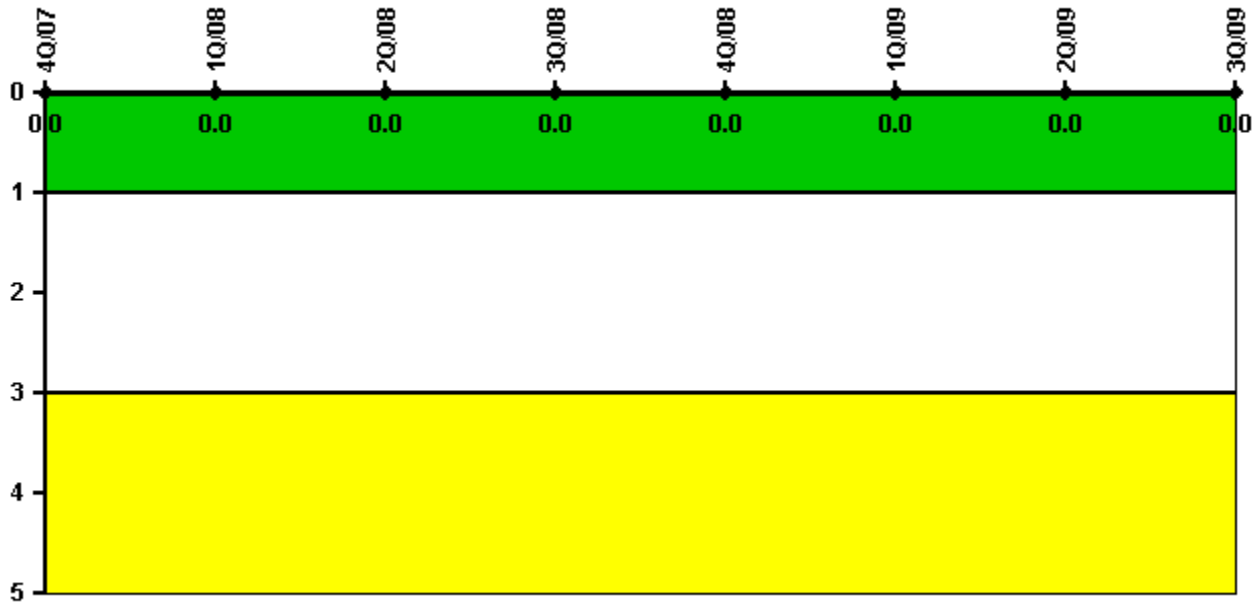

Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.