


# Hope Creek 1

## 3Q/2009 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

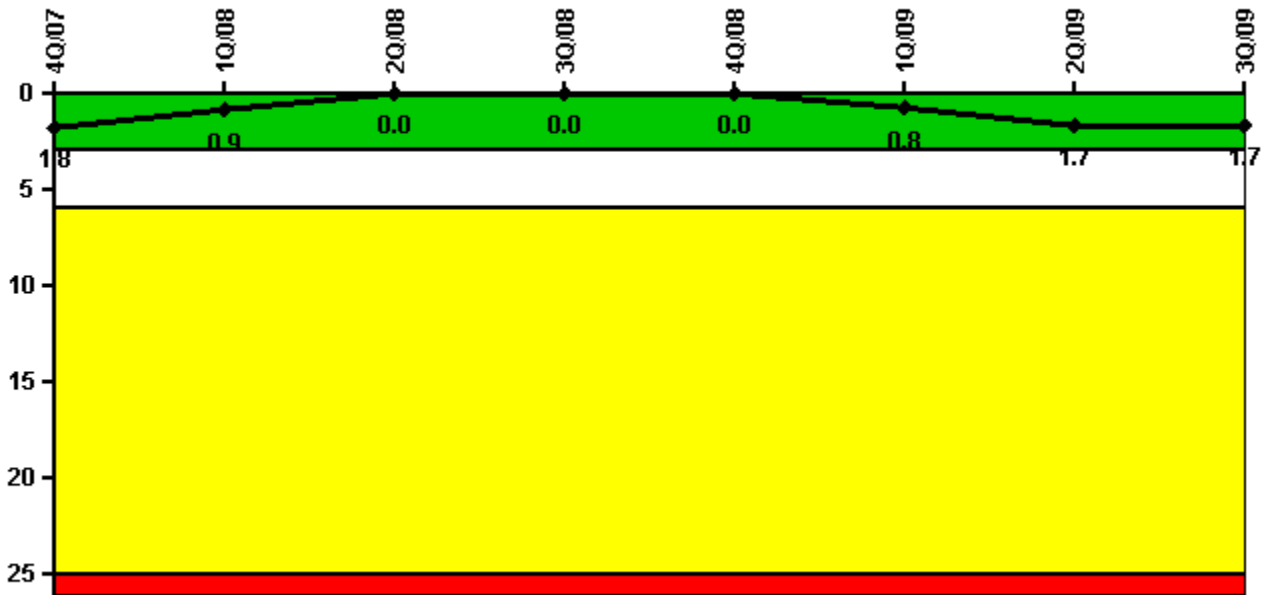


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned scrams	0	0	0	0	0	1.0	1.0	0
Critical hours	1556.4	2183.0	2184.0	2208.0	2209.0	2130.0	1622.0	2208.0
Indicator value	1.8	0.9	0	0	0	0.8	1.7	1.7

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

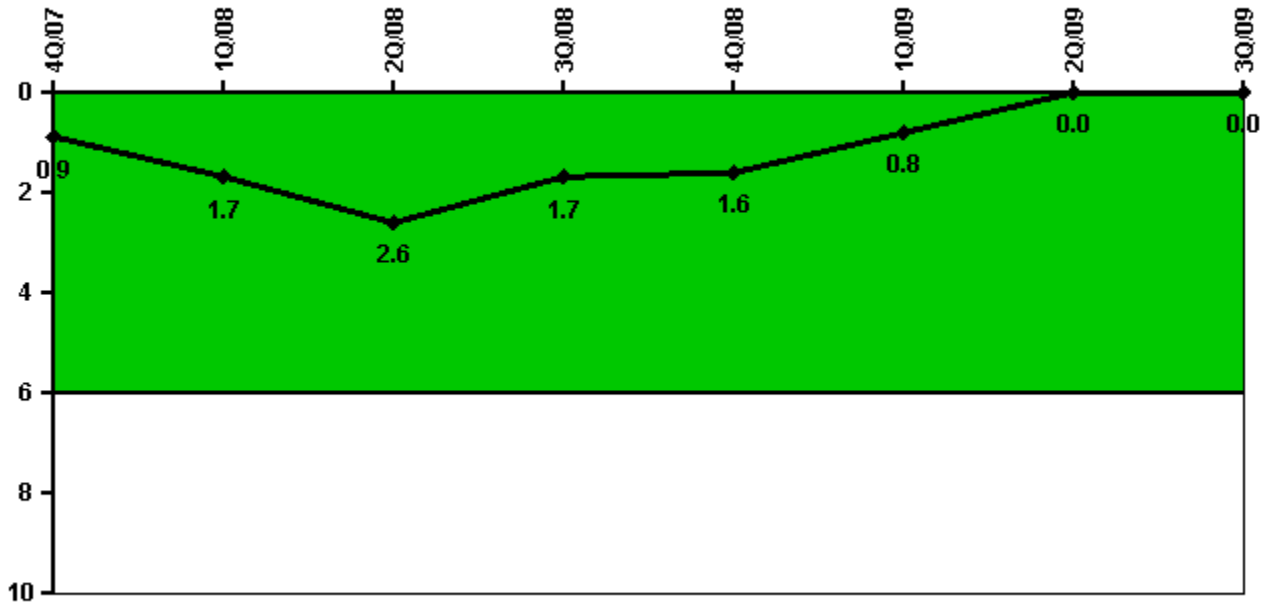

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned power changes	0	1.0	1.0	0	0	0	0	0
Critical hours	1556.4	2183.0	2184.0	2208.0	2209.0	2130.0	1622.0	2208.0
Indicator value	0.9	1.7	2.6	1.7	1.6	0.8	0	0

Licensee Comments: none

# Unplanned Scrams with Complications



Thresholds: White > 1.0


## Notes

Unplanned Scrams with Complications	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

---

## Safety System Functional Failures (BWR)

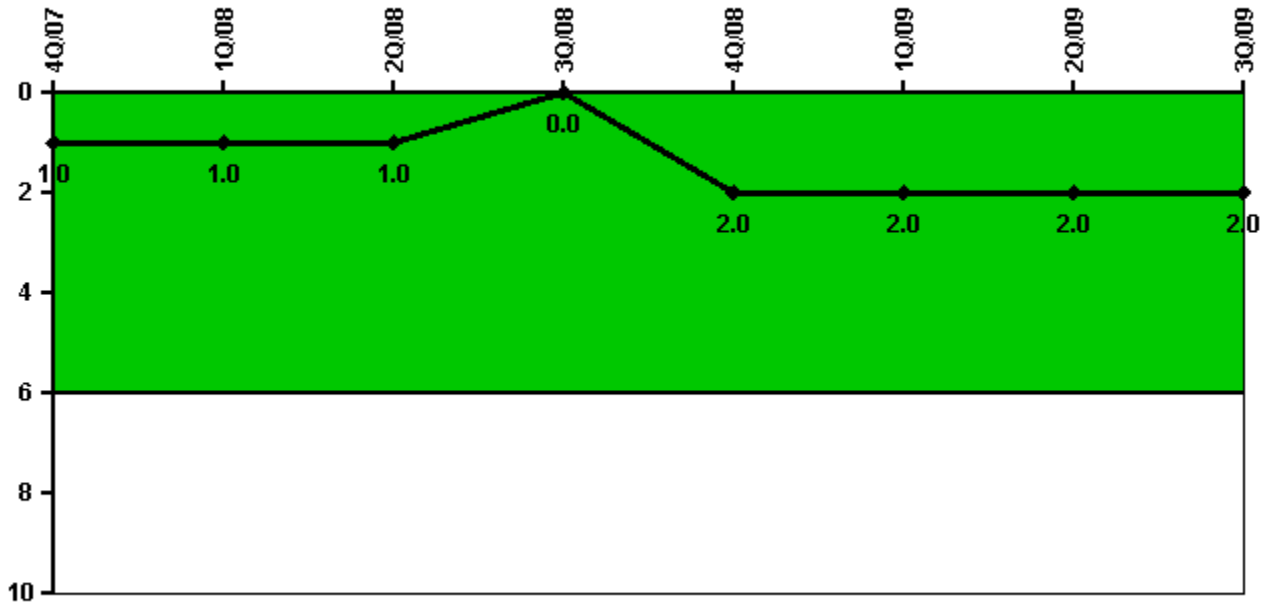


Thresholds: White > 6.0

### Notes

Safety System Functional Failures (BWR)	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Safety System Functional Failures	0	0	0	0	2	0	0	0
Indicator value	1	1	1	0	2	2	2	2

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

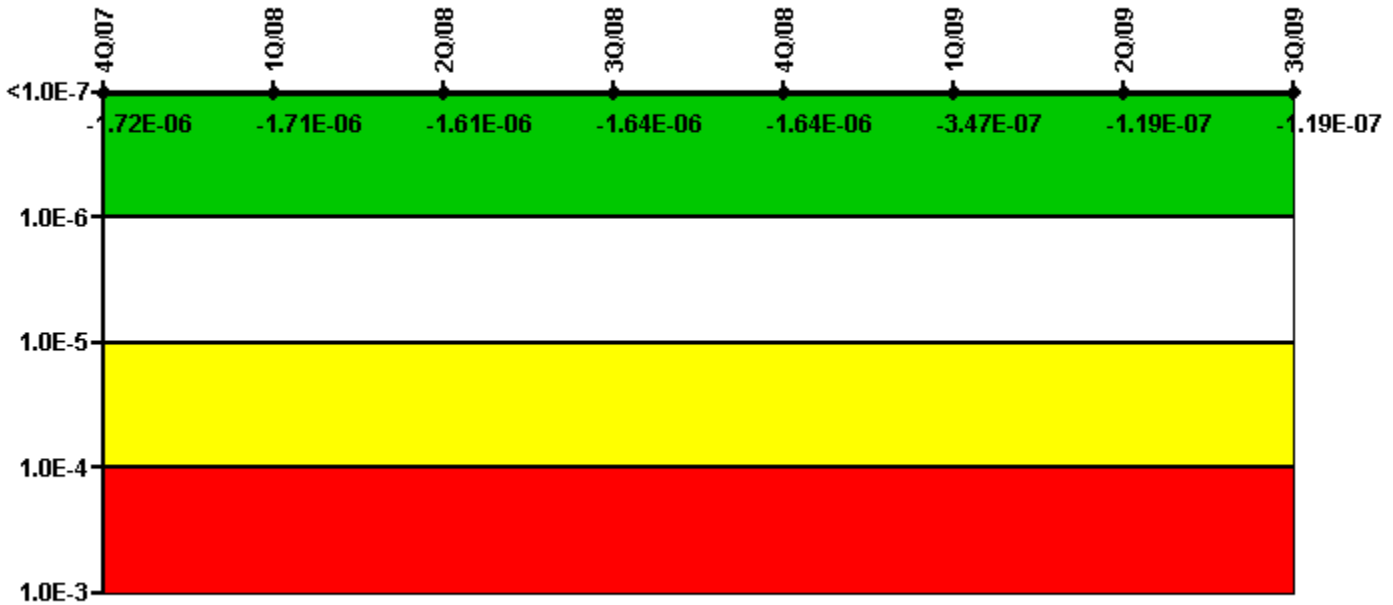


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	-1.20E-07	-1.10E-07	-1.10E-07	-1.40E-07	-1.40E-07	-1.70E-08	2.10E-08	2.10E-08
URI ( $\Delta$ CDF)	-1.60E-06	-1.60E-06	-1.50E-06	-1.50E-06	-1.50E-06	-3.30E-07	-1.40E-07	-1.40E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.72E-06	-1.71E-06	-1.61E-06	-1.64E-06	-1.64E-06	-3.47E-07	-1.19E-07	-1.19E-07

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

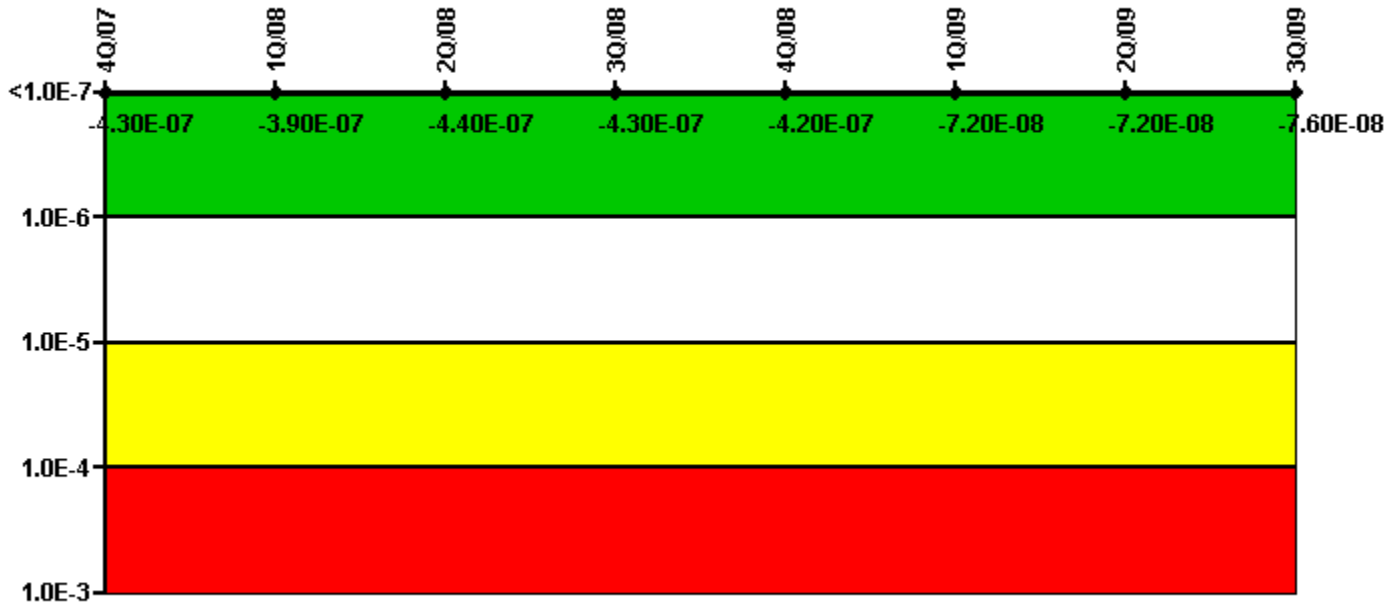


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	-1.40E-07	-1.40E-07	-1.40E-07	-1.60E-07	-1.50E-07	-2.00E-08	-2.00E-08	-2.00E-08
URI ( $\Delta$ CDF)	-2.90E-07	-2.50E-07	-3.00E-07	-2.70E-07	-2.70E-07	-5.20E-08	-5.20E-08	-5.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.30E-07	-3.90E-07	-4.40E-07	-4.30E-07	-4.20E-07	-7.20E-08	-7.20E-08	-7.60E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

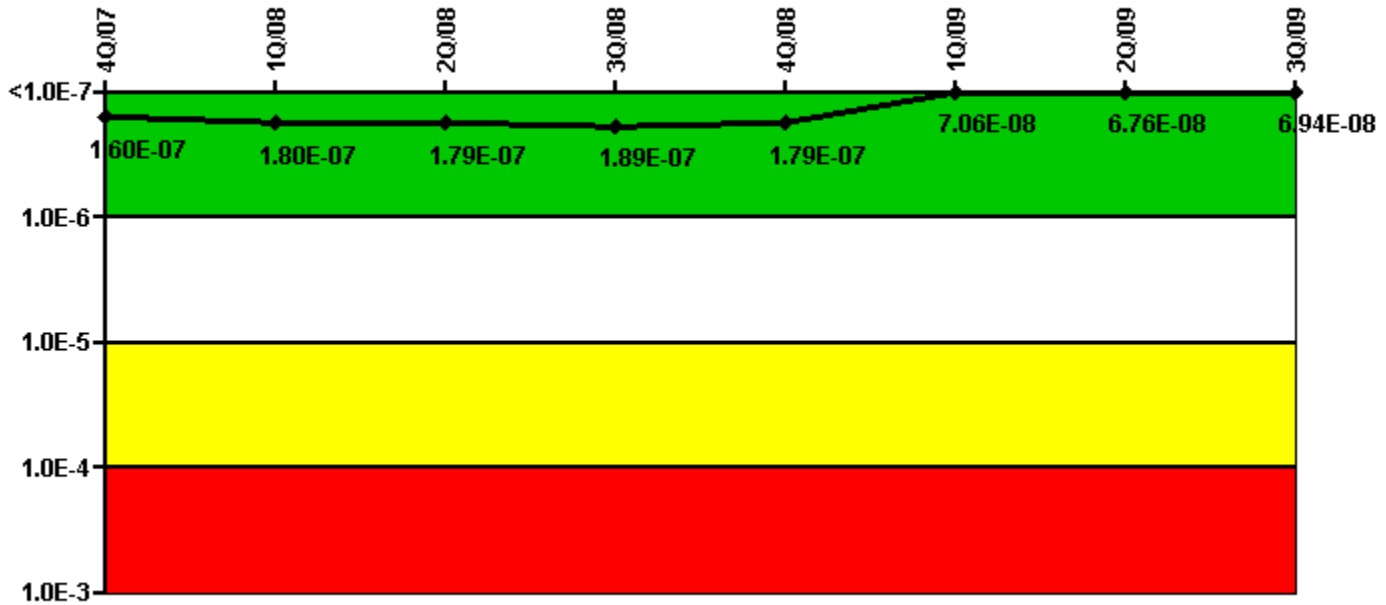


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	-2.00E-08	-2.00E-08	-2.10E-08	-2.10E-08	-2.10E-08	-5.40E-09	-5.40E-09	-6.60E-09
URI ( $\Delta$ CDF)	1.80E-07	2.00E-07	2.00E-07	2.10E-07	2.00E-07	7.60E-08	7.30E-08	7.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.60E-07	1.80E-07	1.79E-07	1.89E-07	1.79E-07	7.06E-08	6.76E-08	6.94E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

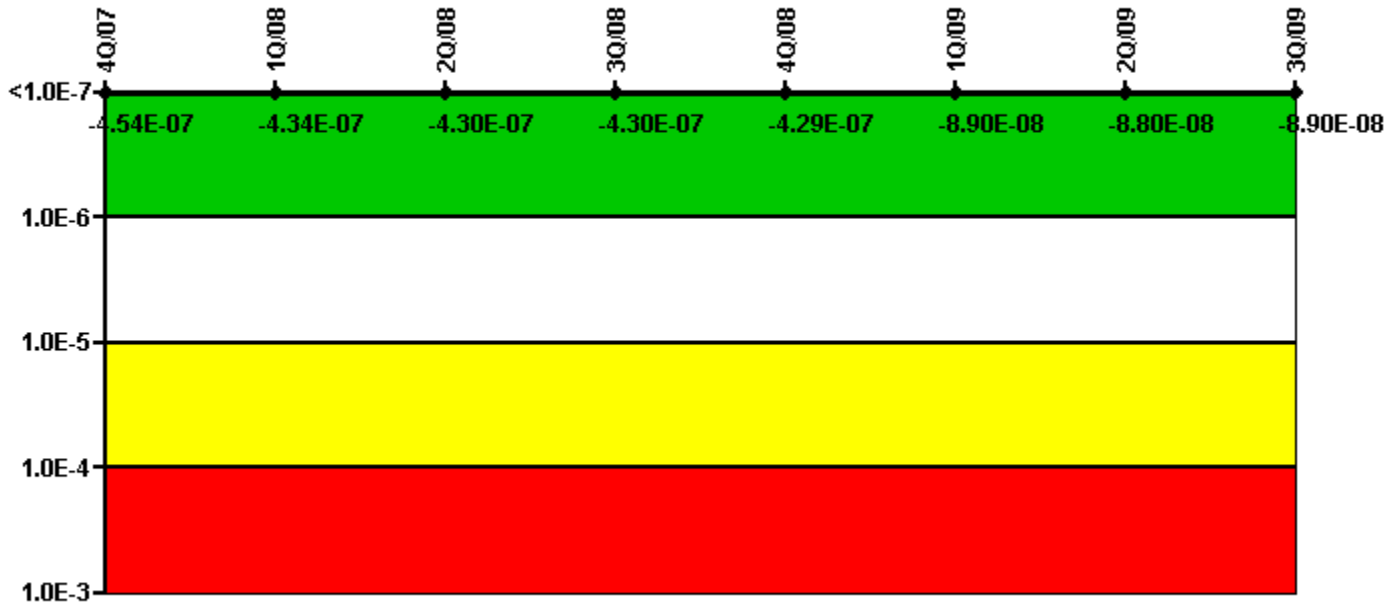

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI ( $\Delta$ CDF)	-8.40E-08	-8.40E-08	-9.00E-08	-9.00E-08	-9.90E-08	-1.10E-08	-1.10E-08	-1.10E-08
URI ( $\Delta$ CDF)	-3.70E-07	-3.50E-07	-3.40E-07	-3.40E-07	-3.30E-07	-7.80E-08	-7.70E-08	-7.80E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.54E-07	-4.34E-07	-4.30E-07	-4.30E-07	-4.29E-07	-8.90E-08	-8.80E-08	-8.90E-08

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

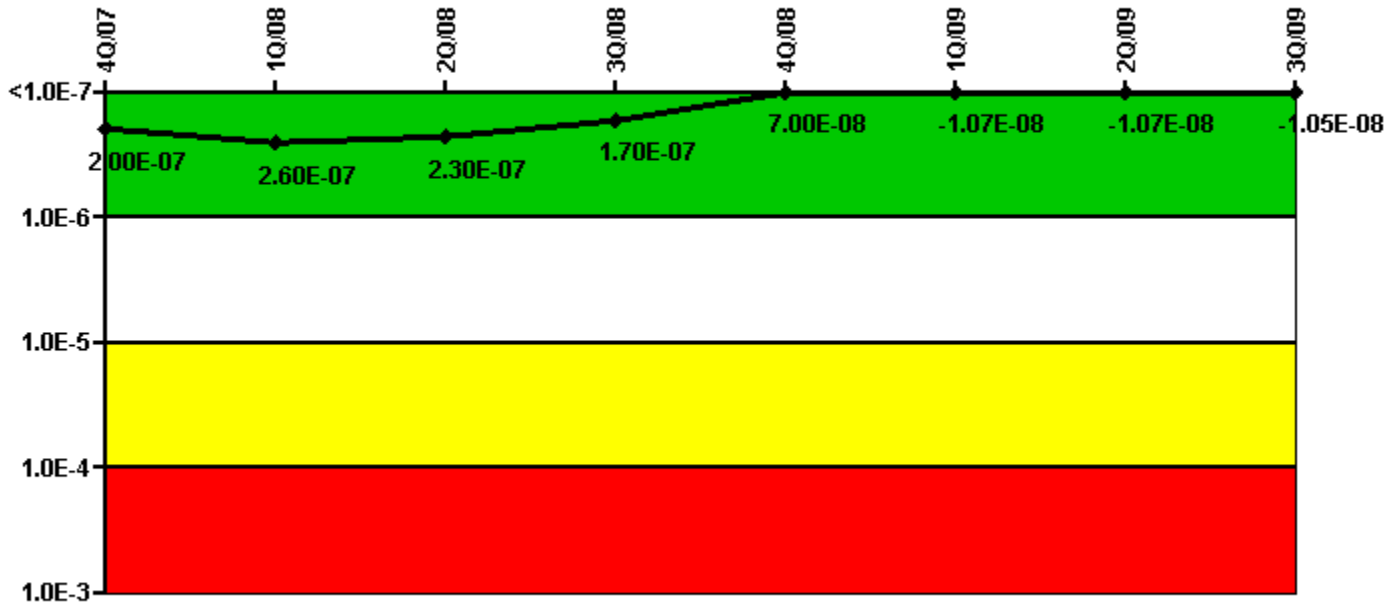


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (ΔCDF)	4.90E-07	5.60E-07	5.20E-07	4.70E-07	3.70E-07	1.30E-09	1.30E-09	1.50E-09
URI (ΔCDF)	-2.90E-07	-3.00E-07	-2.90E-07	-3.00E-07	-3.00E-07	-1.20E-08	-1.20E-08	-1.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.00E-07	2.60E-07	2.30E-07	1.70E-07	7.00E-08	-1.07E-08	-1.07E-08	-1.05E-08

Licensee Comments: none

# Reactor Coolant System Activity

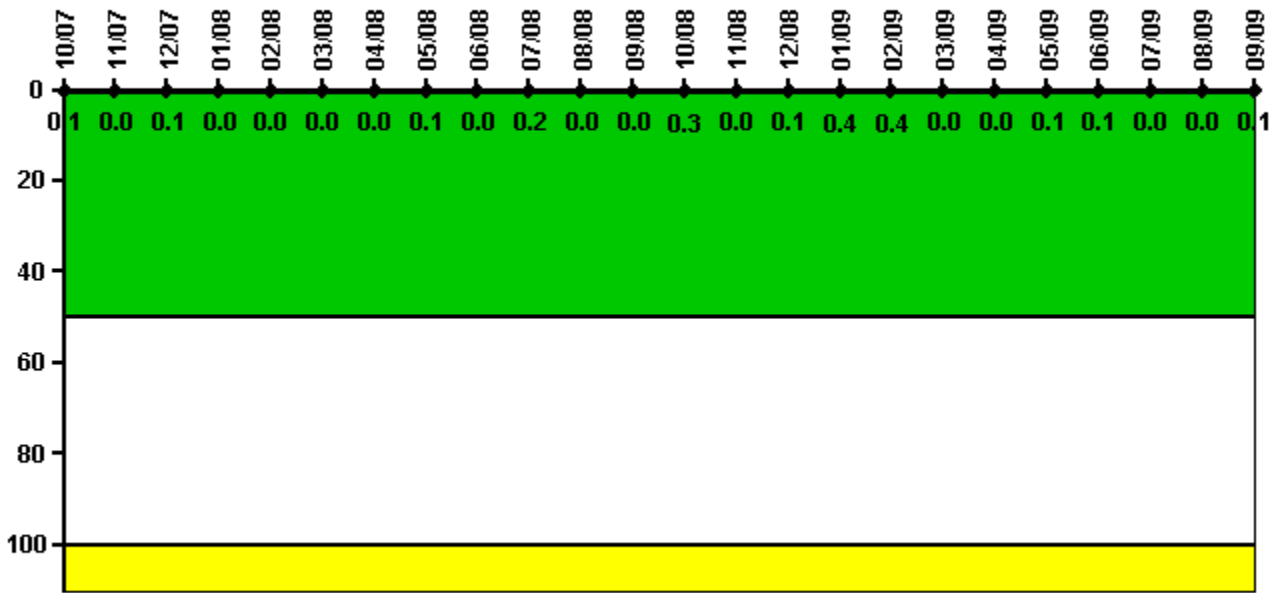


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.000143	0.000069	0.000101	0.000068	0.000061	0.000074	0.000075	0.000116	0.000076	0.000403	0.000087	0.000076
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0	0.1	0	0	0	0	0.1	0	0.2	0	0
Reactor Coolant System Activity	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum activity	0.000570	0.000076	0.000133	0.000733	0.000738	0.000092	0.000071	0.000102	0.000139	0.000063	0.000065	0.000118
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.3	0	0.1	0.4	0.4	0	0	0.1	0.1	0	0	0.1

Licensee Comments: none

## Reactor Coolant System Leakage

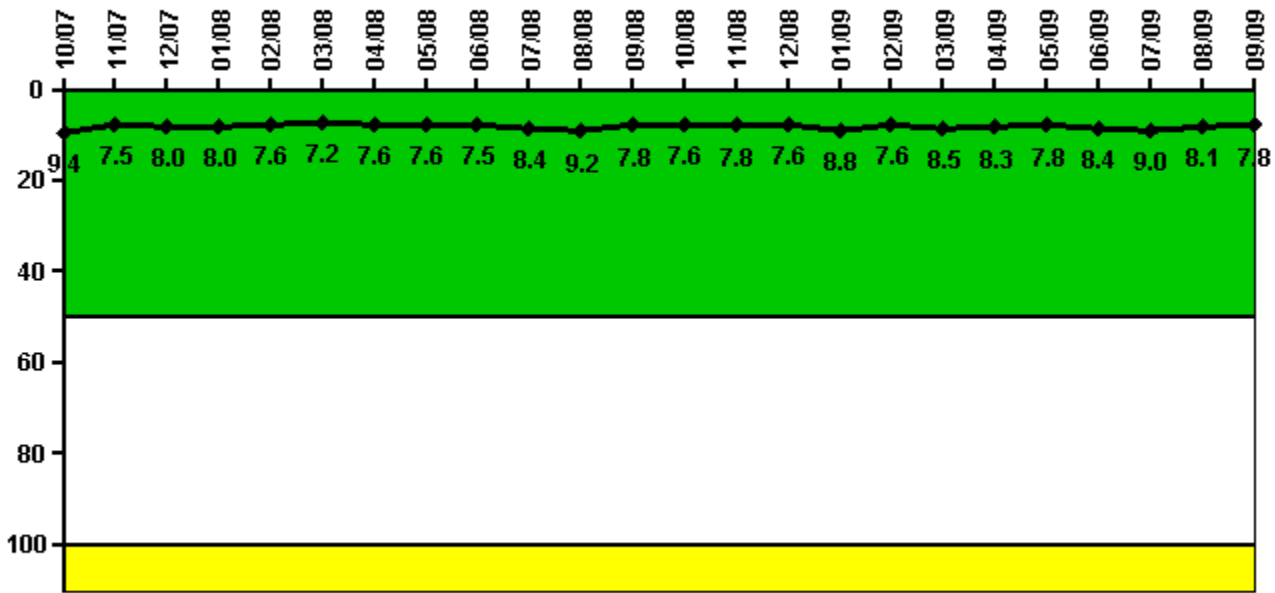


Thresholds: White > 50.0 Yellow > 100.0

### Notes

<b>Reactor Coolant System Leakage</b>	<b>10/07</b>	<b>11/07</b>	<b>12/07</b>	<b>1/08</b>	<b>2/08</b>	<b>3/08</b>	<b>4/08</b>	<b>5/08</b>	<b>6/08</b>	<b>7/08</b>	<b>8/08</b>	<b>9/08</b>
Maximum leakage	2.360	1.870	2.010	1.990	1.890	1.800	1.890	1.900	1.880	2.100	2.310	1.950
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	9.4	7.5	8.0	8.0	7.6	7.2	7.6	7.6	7.5	8.4	9.2	7.8
<b>Reactor Coolant System Leakage</b>	<b>10/08</b>	<b>11/08</b>	<b>12/08</b>	<b>1/09</b>	<b>2/09</b>	<b>3/09</b>	<b>4/09</b>	<b>5/09</b>	<b>6/09</b>	<b>7/09</b>	<b>8/09</b>	<b>9/09</b>
Maximum leakage	1.900	1.940	1.910	2.190	1.900	2.116	2.076	1.940	2.100	2.240	2.017	1.950
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.6	7.8	7.6	8.8	7.6	8.5	8.3	7.8	8.4	9.0	8.1	7.8

Licensee Comments: none

## Drill/Exercise Performance

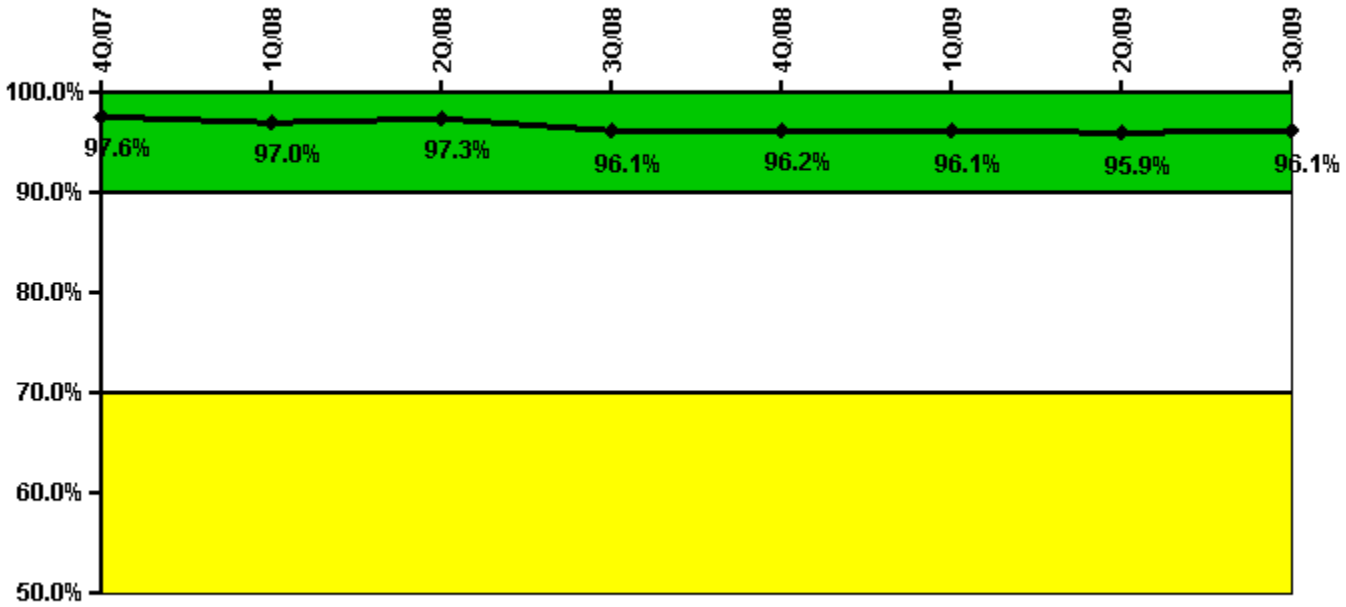


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful opportunities	56.0	32.0	35.0	65.0	72.0	35.0	49.0	70.0
Total opportunities	58.0	34.0	36.0	70.0	74.0	36.0	51.0	72.0
Indicator value	97.6%	97.0%	97.3%	96.1%	96.2%	96.1%	95.9%	96.1%

Licensee Comments: none

## ERO Drill Participation

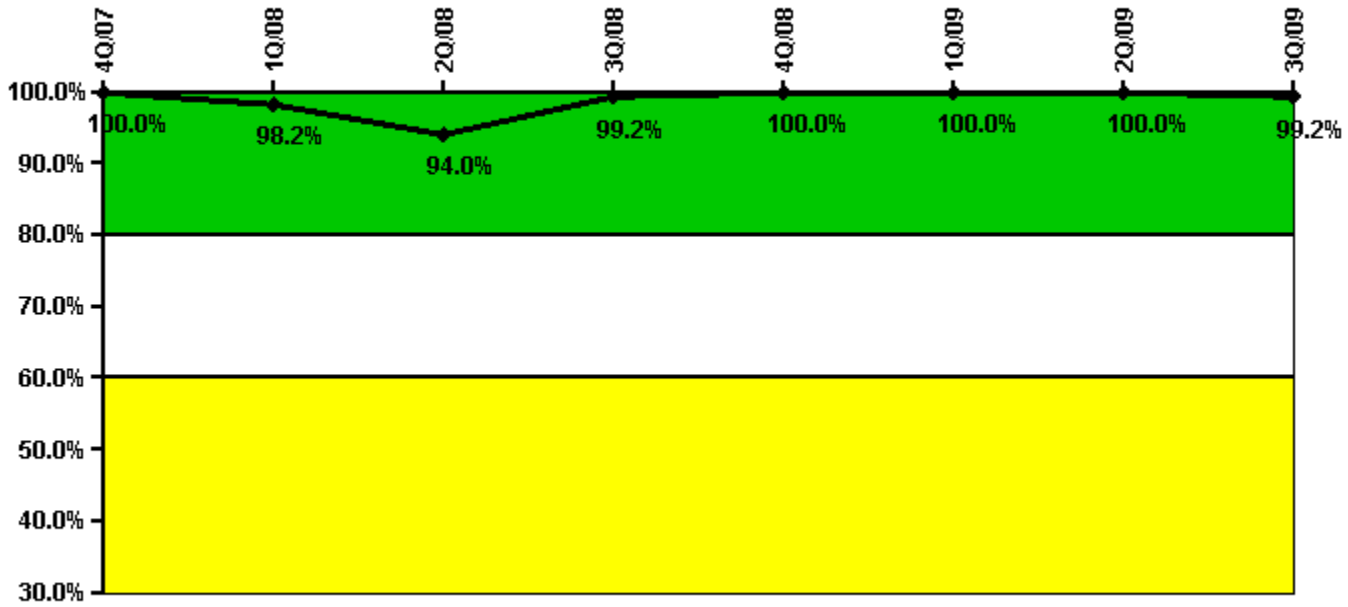


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Participating Key personnel	115.0	109.0	109.0	120.0	123.0	124.0	122.0	127.0
Total Key personnel	115.0	111.0	116.0	121.0	123.0	124.0	122.0	128.0
Indicator value	100.0%	98.2%	94.0%	99.2%	100.0%	100.0%	100.0%	99.2%

Licensee Comments: none

# Alert & Notification System

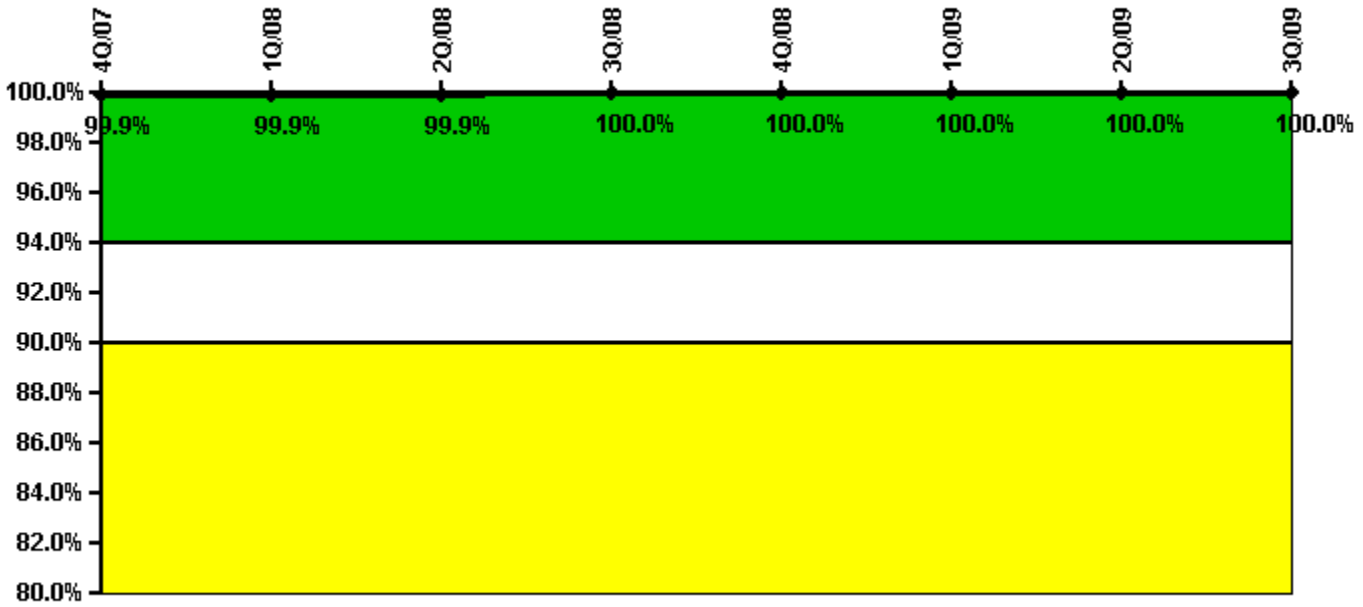

Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful siren-tests	497	497	497	497	497	497	497	497
Total sirens-tests	497	497	497	497	497	497	497	497
Indicator value	99.9%	99.9%	99.9%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

# Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

---

# RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: November 30, 2009