


La Salle 1

3Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

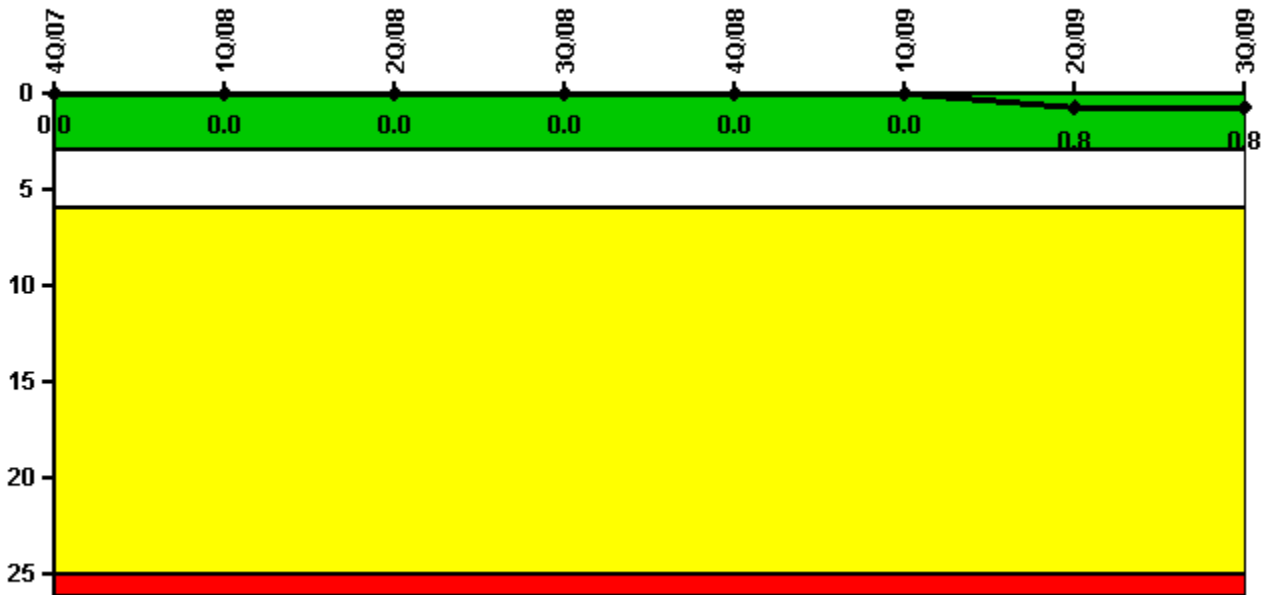


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned scrams	0	0	0	0	0	0	1.0	0
Critical hours	2209.0	1614.8	2184.0	2160.5	2198.5	2159.0	2142.3	2146.0
Indicator value	0	0	0	0	0	0	0.8	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

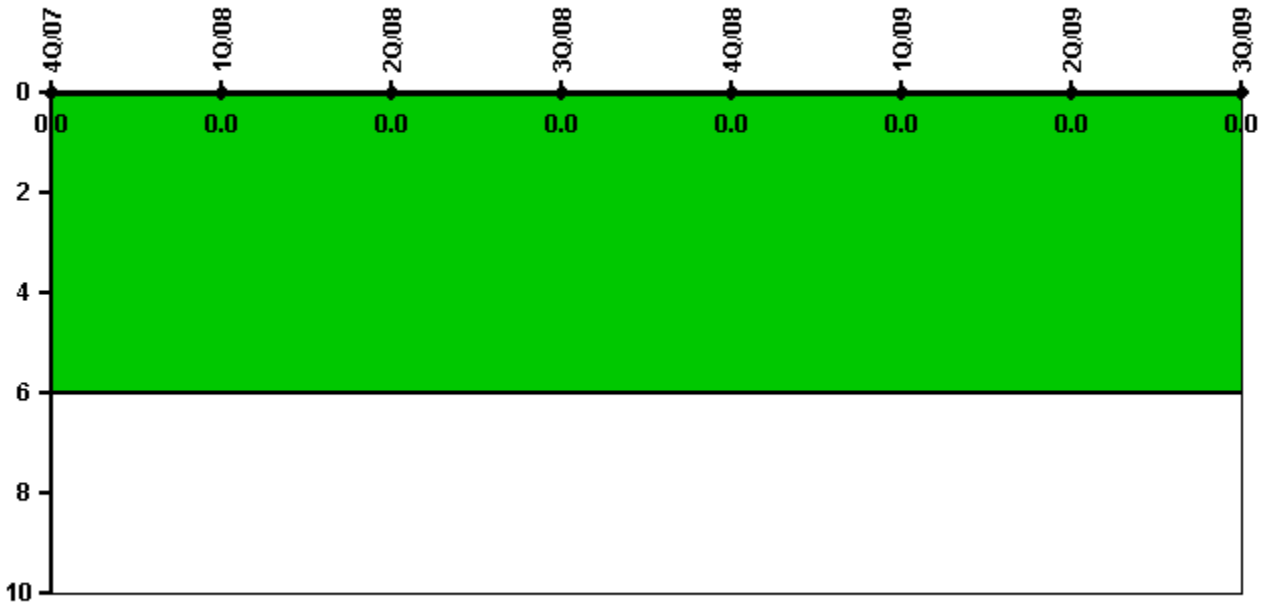

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2209.0	1614.8	2184.0	2160.5	2198.5	2159.0	2142.3	2146.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

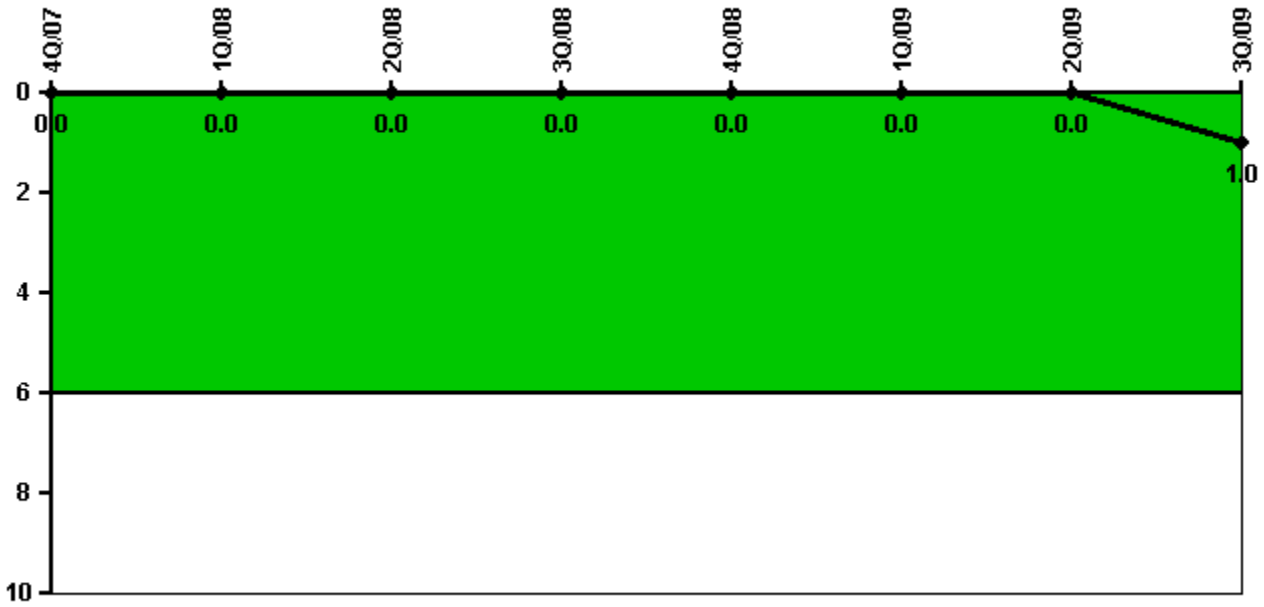


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Safety System Functional Failures	0	0	0	0	0	0	0	1
Indicator value	0	0	0	0	0	0	0	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

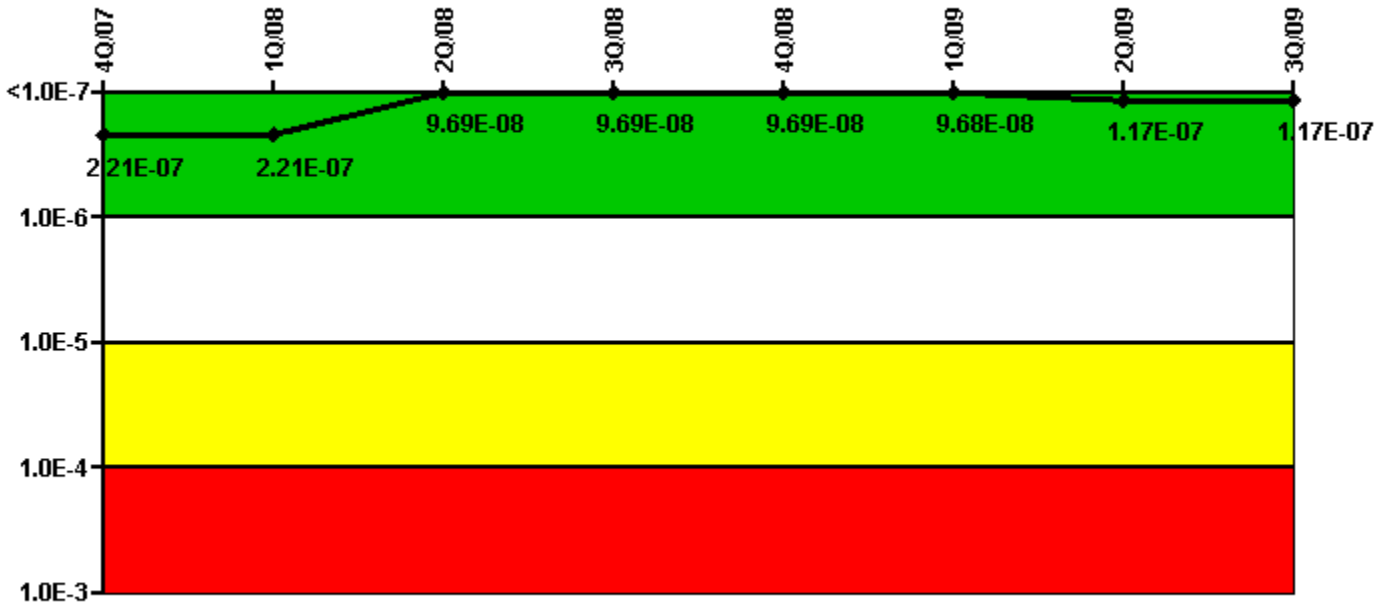


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	-9.20E-09	-9.10E-09	-3.10E-09	-3.10E-09	-3.10E-09	-3.20E-09	-3.00E-09	-3.00E-09
URI (Δ CDF)	2.30E-07	2.30E-07	1.00E-07	1.00E-07	1.00E-07	1.00E-07	1.20E-07	1.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.21E-07	2.21E-07	9.69E-08	9.69E-08	9.69E-08	9.68E-08	1.17E-07	1.17E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

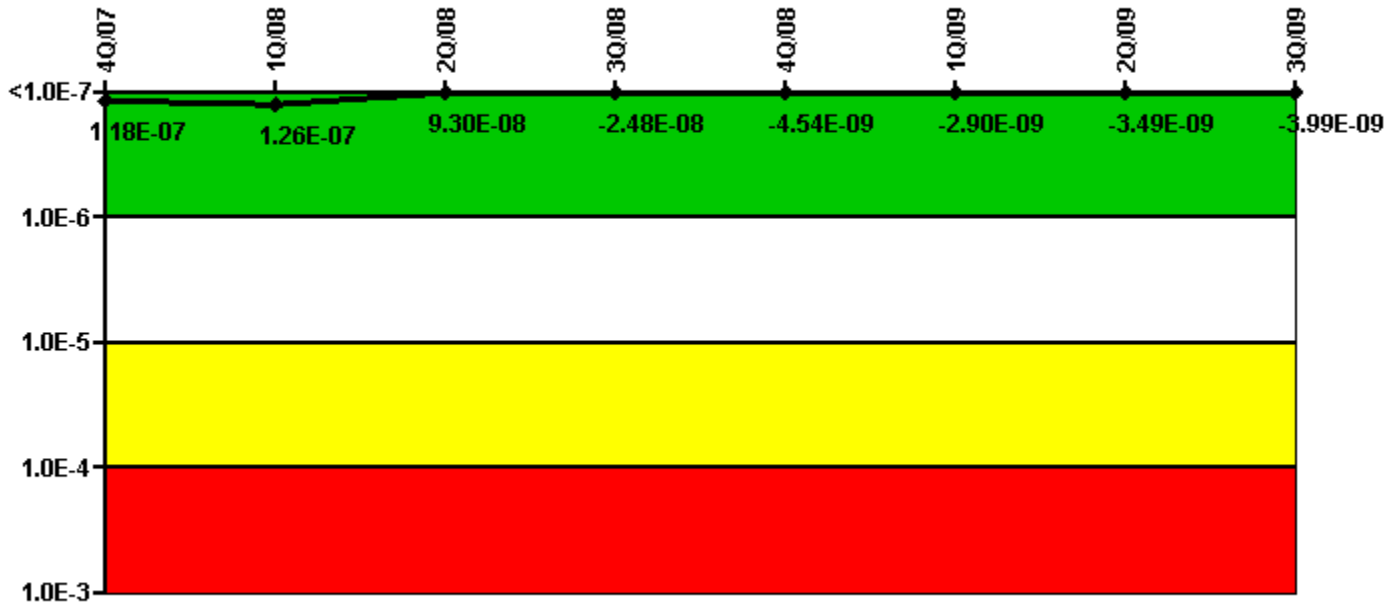

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	6.60E-08	7.60E-08	3.50E-08	-2.80E-09	-6.40E-10	-7.00E-10	-6.90E-10	-6.90E-10
URI (Δ CDF)	5.20E-08	5.00E-08	5.80E-08	-2.20E-08	-3.90E-09	-2.20E-09	-2.80E-09	-3.30E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.18E-07	1.26E-07	9.30E-08	-2.48E-08	-4.54E-09	-2.90E-09	-3.49E-09	-3.99E-09

Licensee Comments:

3Q/09: An internal review identified an entry error in the September 2008 unplanned unavailability data for the Unit 1 HPCS Diesel Generator. One hour of unplanned unavailability was reported, although the correct number was zero. This error has been corrected with no change to the Performance Indicator color. The occurrence has been entered into the Station's corrective action program.

Mitigating Systems Performance Index, Heat Removal System

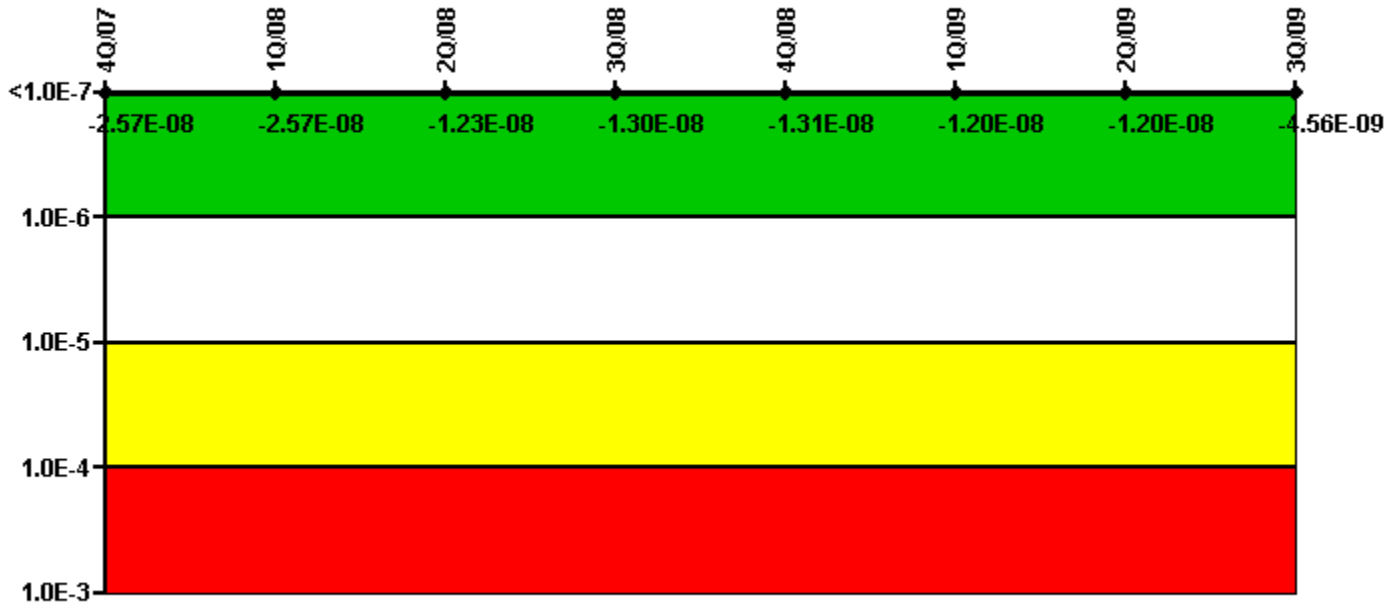


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	-9.70E-09	-9.70E-09	-4.70E-09	-5.40E-09	-5.40E-09	-5.40E-09	-5.40E-09	-4.50E-09
URI (Δ CDF)	-1.60E-08	-1.60E-08	-7.60E-09	-7.60E-09	-7.70E-09	-6.60E-09	-6.60E-09	-5.60E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.57E-08	-2.57E-08	-1.23E-08	-1.30E-08	-1.31E-08	-1.20E-08	-1.20E-08	-4.56E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

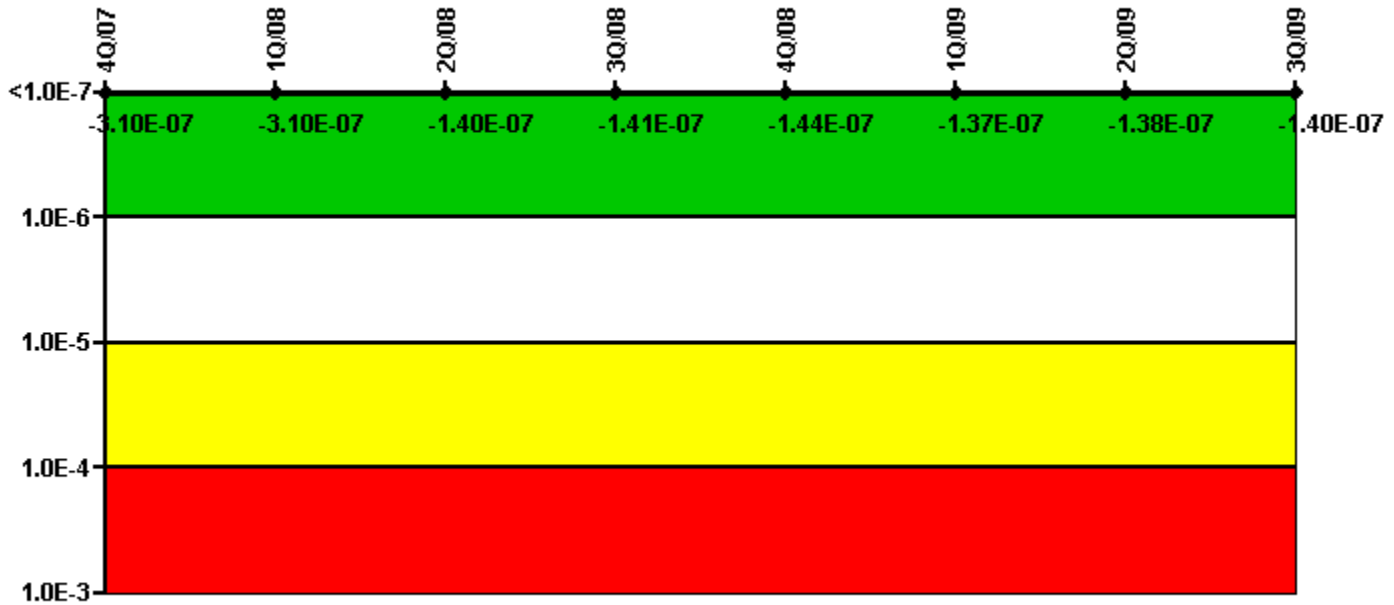


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	-1.30E-07	-1.30E-07	-5.70E-08	-5.60E-08	-5.80E-08	-5.80E-08	-5.80E-08	-5.80E-08
URI (Δ CDF)	-1.80E-07	-1.80E-07	-8.30E-08	-8.50E-08	-8.60E-08	-7.90E-08	-8.00E-08	-8.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.10E-07	-3.10E-07	-1.40E-07	-1.41E-07	-1.44E-07	-1.37E-07	-1.38E-07	-1.40E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

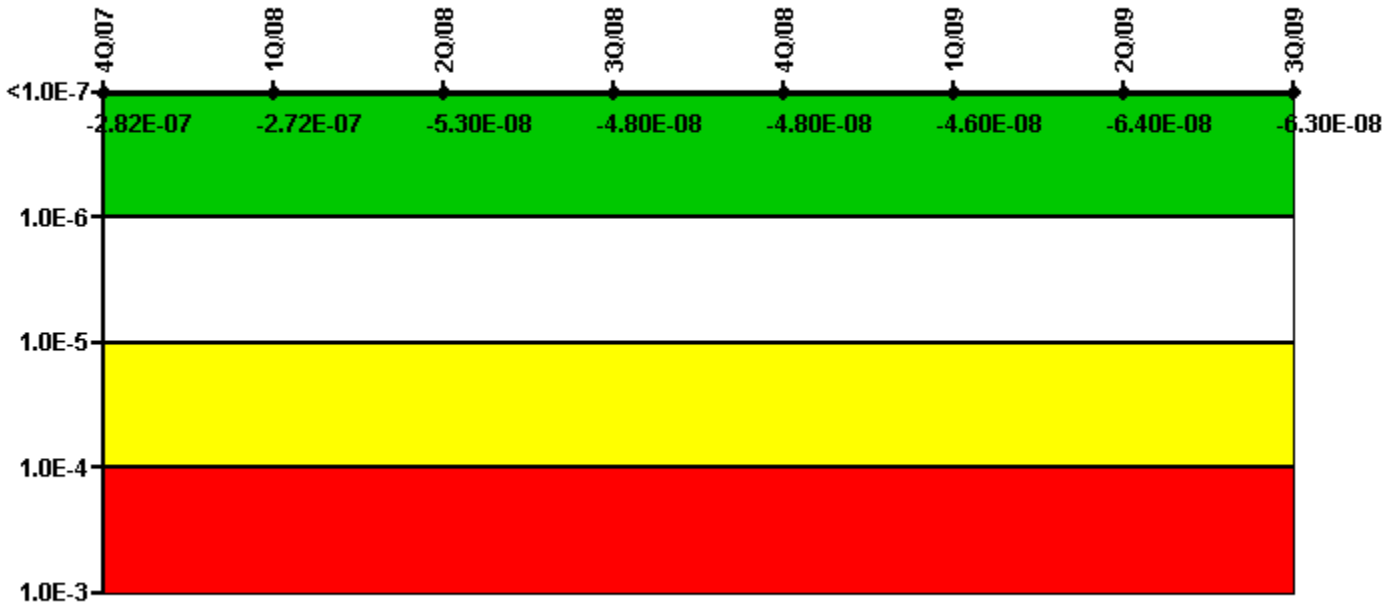


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
UAI (Δ CDF)	-1.70E-09	-1.70E-09	5.70E-08	6.20E-08	6.20E-08	6.40E-08	4.60E-08	4.70E-08
URI (Δ CDF)	-2.80E-07	-2.70E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.82E-07	-2.72E-07	-5.30E-08	-4.80E-08	-4.80E-08	-4.60E-08	-6.40E-08	-6.30E-08

Licensee Comments: none

Reactor Coolant System Activity

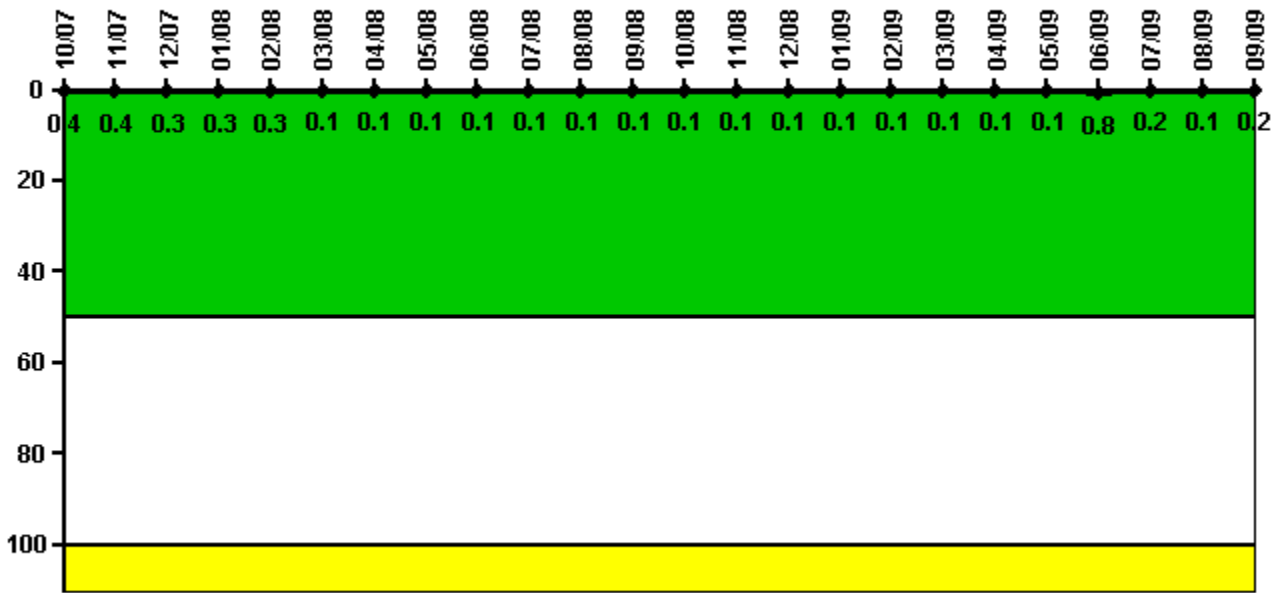


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.000769	0.000771	0.000574	0.000650	0.000605	0.000237	0.000270	0.000267	0.000260	0.000253	0.000257	0.000280
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.4	0.4	0.3	0.3	0.3	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum activity	0.000214	0.000219	0.000231	0.000218	0.000259	0.000213	0.000199	0.000200	0.001510	0.000446	0.000257	0.000426
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.8	0.2	0.1	0.2

Licensee Comments: none

Reactor Coolant System Leakage

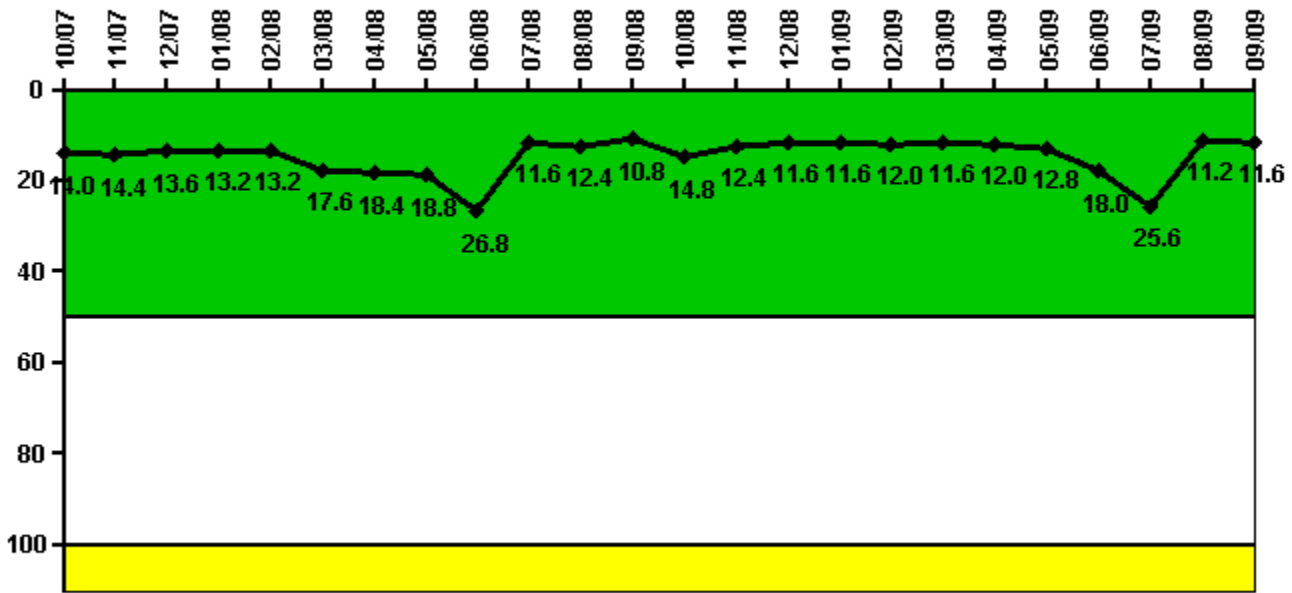


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	3.500	3.600	3.400	3.300	3.300	4.400	4.600	4.700	6.700	2.900	3.100	2.700
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	14.0	14.4	13.6	13.2	13.2	17.6	18.4	18.8	26.8	11.6	12.4	10.8
Reactor Coolant System Leakage	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum leakage	3.700	3.100	2.900	2.900	3.000	2.900	3.000	3.200	4.500	6.400	2.800	2.900
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	14.8	12.4	11.6	11.6	12.0	11.6	12.0	12.8	18.0	25.6	11.2	11.6

Licensee Comments: none

Drill/Exercise Performance

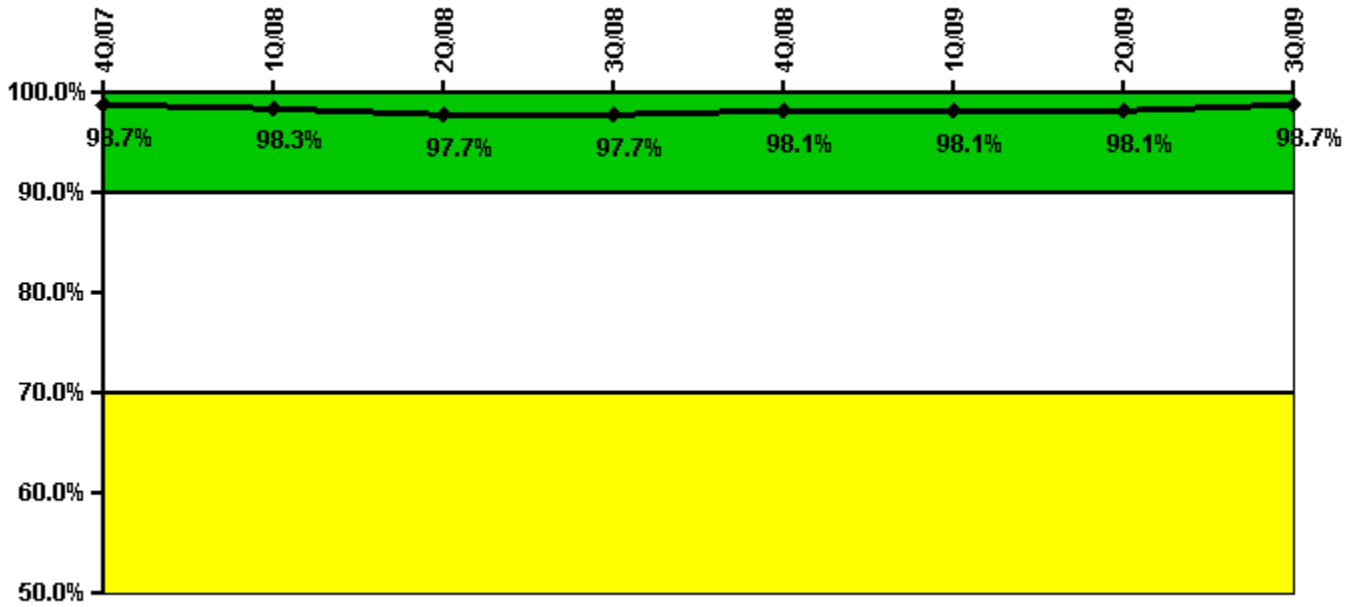


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful opportunities	50.0	7.0	49.0	36.0	50.0	20.0	44.0	48.0
Total opportunities	50.0	8.0	52.0	36.0	50.0	20.0	44.0	48.0
Indicator value	98.7%	98.3%	97.7%	97.7%	98.1%	98.1%	98.1%	98.7%

Licensee Comments: none

ERO Drill Participation

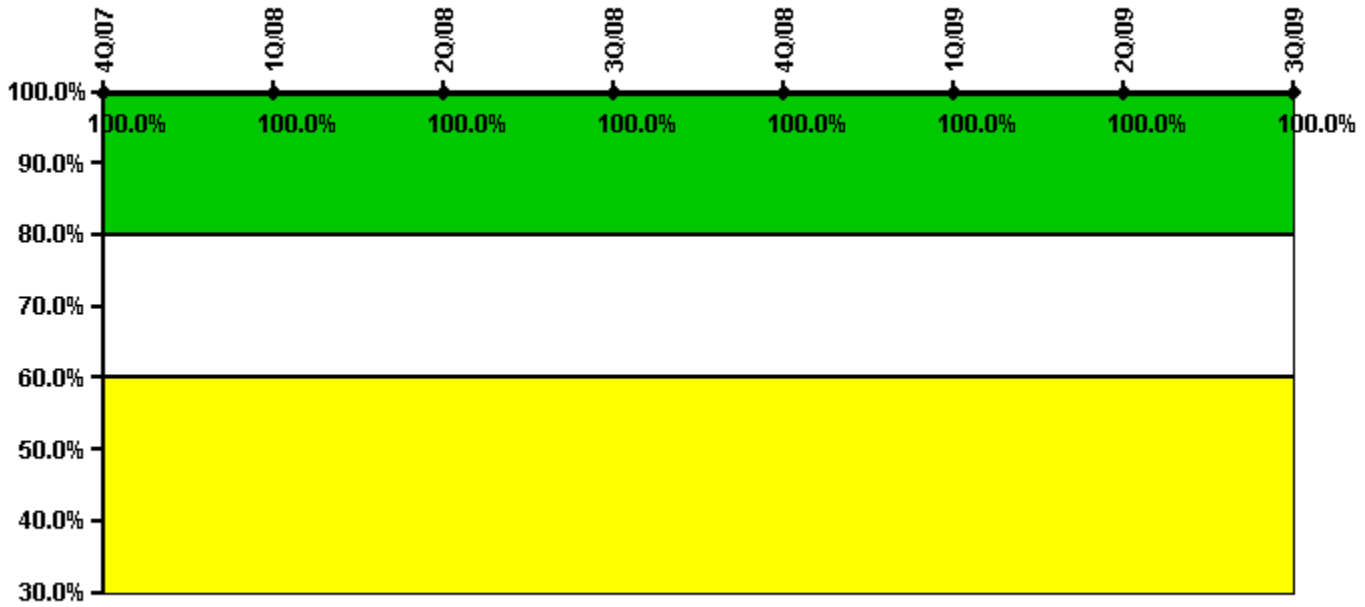


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Participating Key personnel	65.0	64.0	67.0	67.0	68.0	65.0	66.0	68.0
Total Key personnel	65.0	64.0	67.0	67.0	68.0	65.0	66.0	68.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

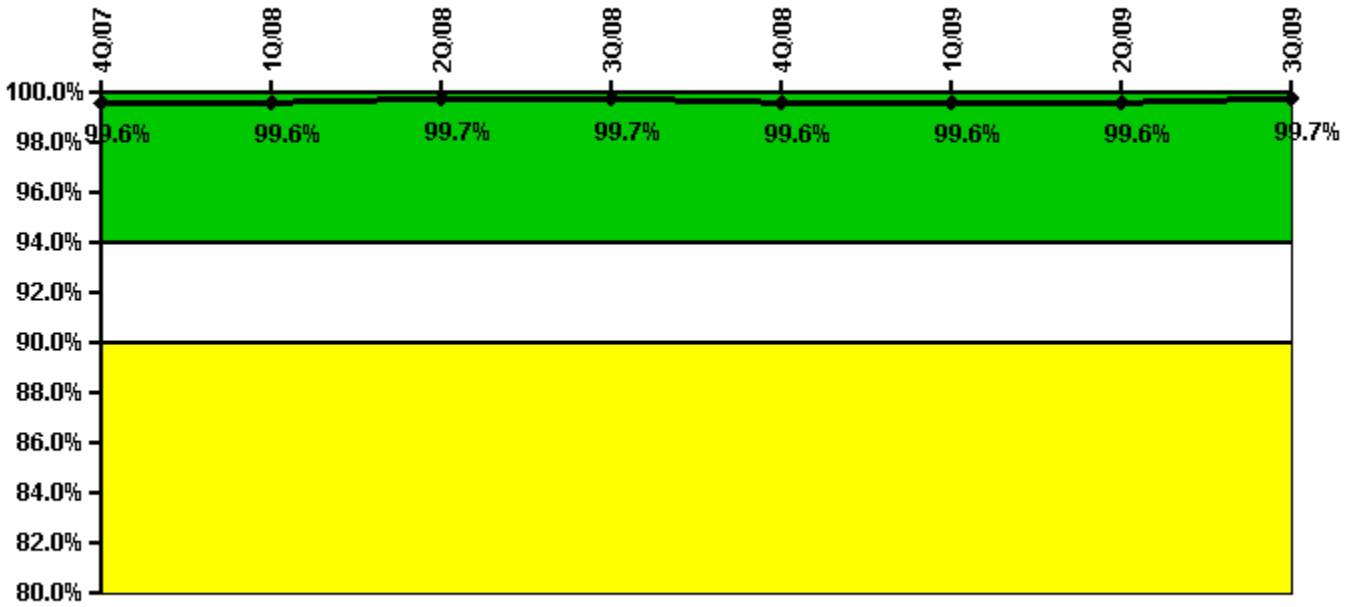


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
Successful siren-tests	3191	3191	3196	3235	3169	3144	3199	3246
Total sirens-tests	3200	3200	3200	3246	3200	3150	3200	3250
Indicator value	99.6%	99.6%	99.7%	99.7%	99.6%	99.6%	99.6%	99.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness

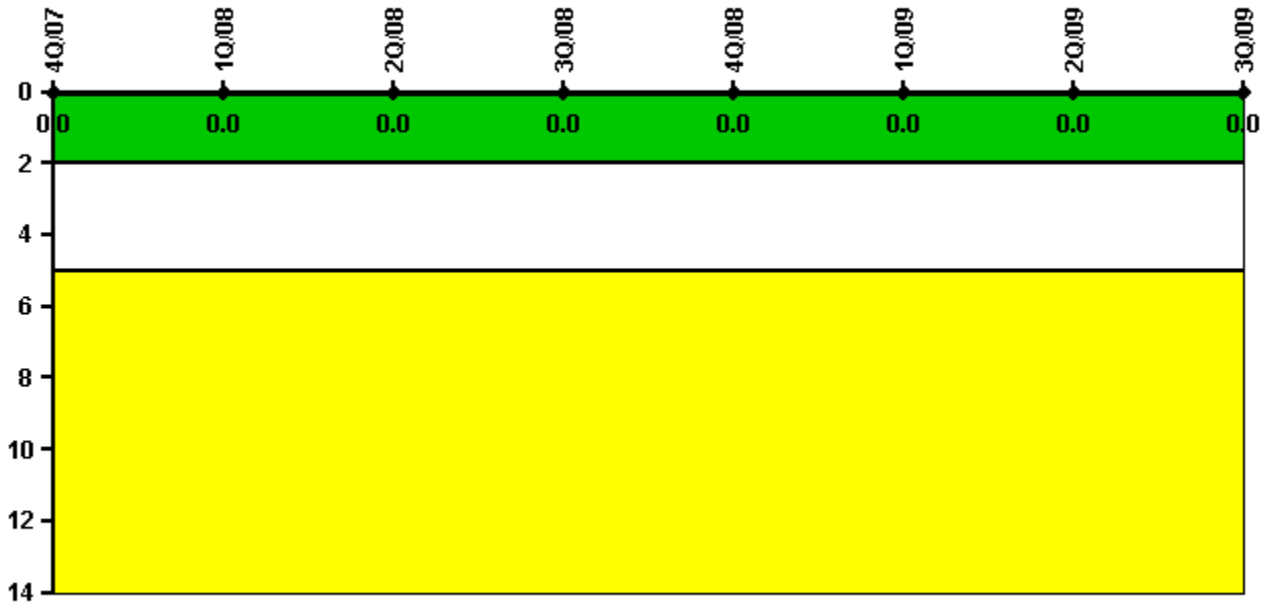

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: November 30, 2009