


Farley 1

4Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

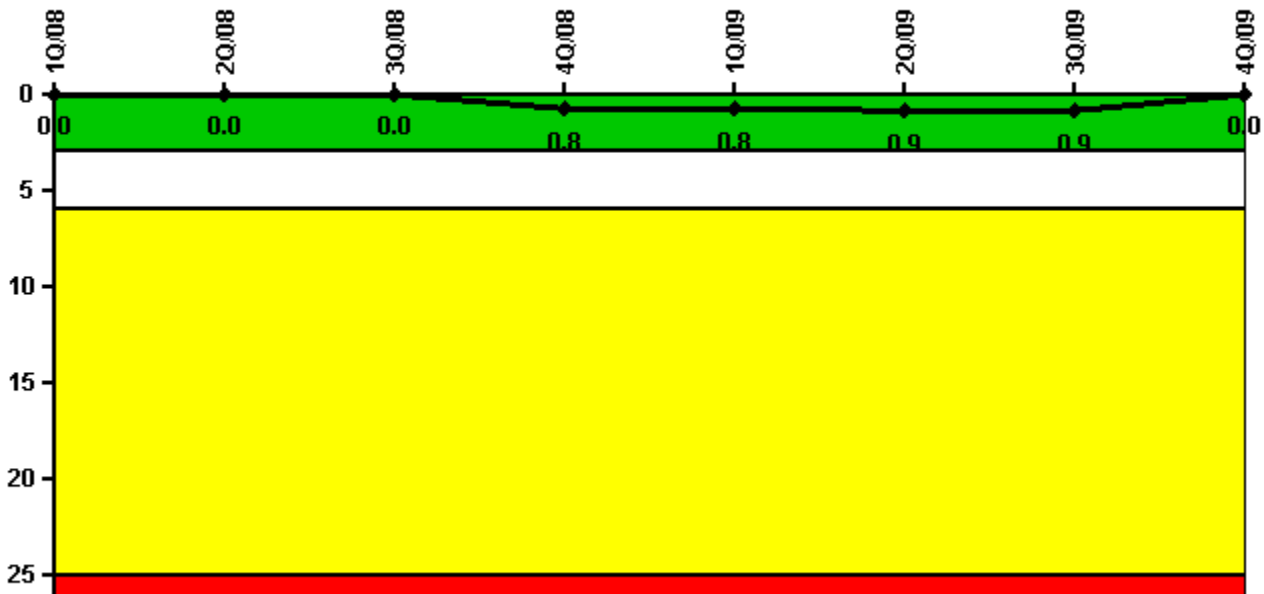


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Unplanned scrams	0	0	0	1.0	0	0	0	0
Critical hours	2183.0	2184.0	2044.8	2187.7	2159.0	1373.0	2208.0	2209.0
Indicator value	0	0	0	0.8	0.8	0.9	0.9	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

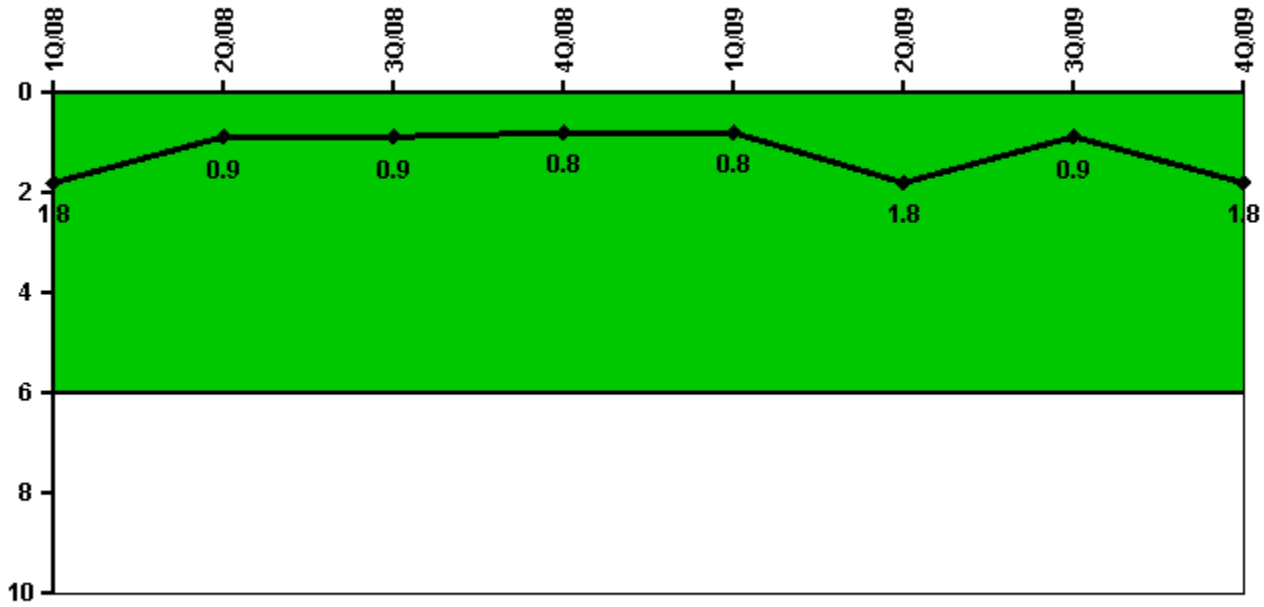

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Unplanned power changes	0	0	1.0	0	0	1.0	0	1.0
Critical hours	2183.0	2184.0	2044.8	2187.7	2159.0	1373.0	2208.0	2209.0
Indicator value	1.8	0.9	0.9	0.8	0.8	1.8	0.9	1.8

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

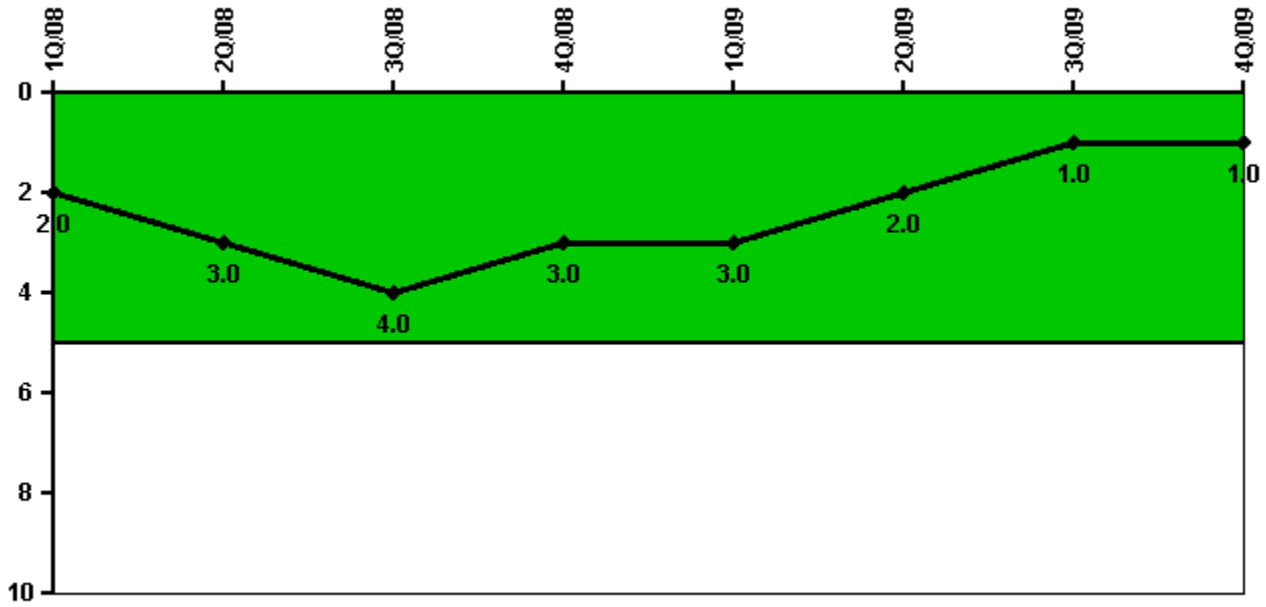


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Safety System Functional Failures	0	2	1	0	0	1	0	0
Indicator value	2	3	4	3	3	2	1	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

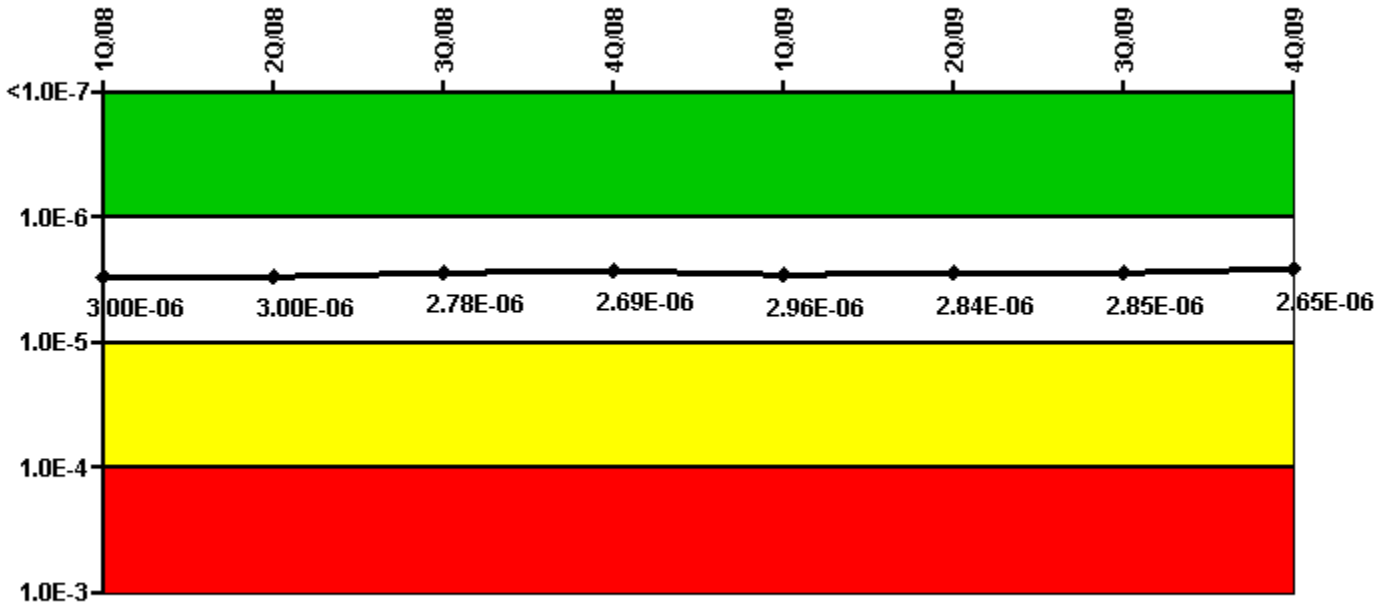

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	1.20E-06	1.20E-06	7.80E-07	6.90E-07	9.60E-07	8.40E-07	8.50E-07	6.50E-07
URI (Δ CDF)	1.80E-06	1.80E-06	2.00E-06	2.00E-06	2.00E-06	2.00E-06	2.00E-06	2.00E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.00E-06	3.00E-06	2.78E-06	2.69E-06	2.96E-06	2.84E-06	2.85E-06	2.65E-06

Licensee Comments:

4Q/09: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

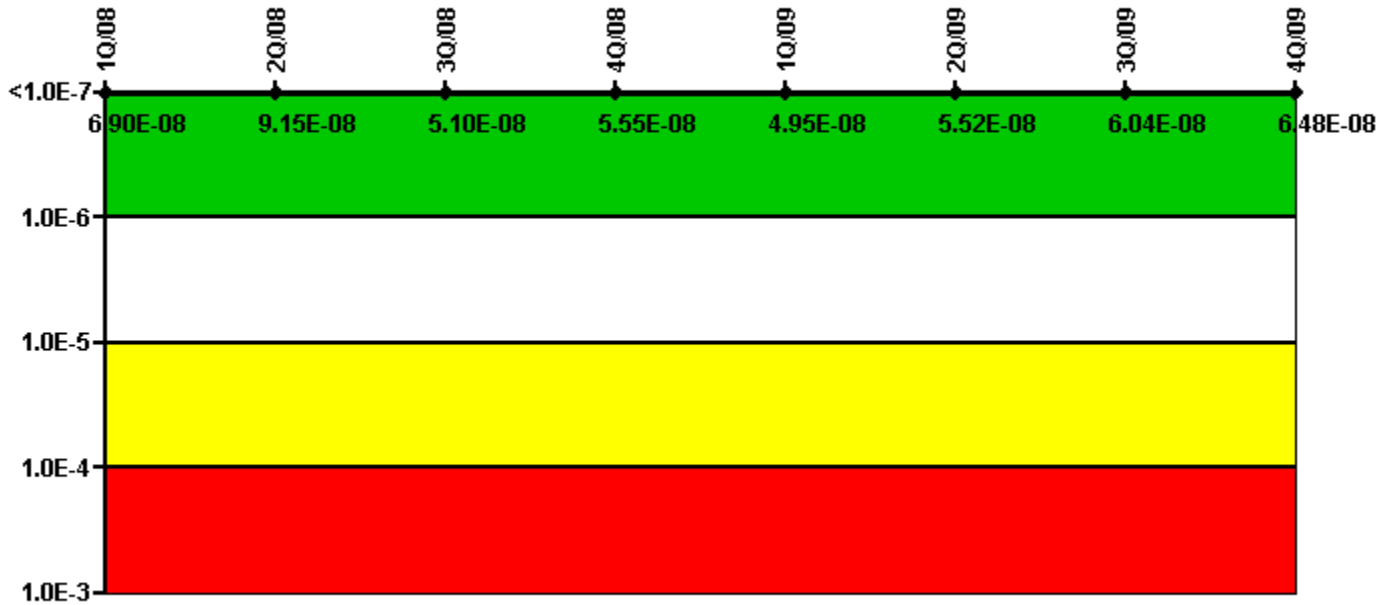


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	-3.10E-08	-8.50E-09	-8.00E-09	-3.50E-09	-9.50E-09	-3.80E-09	1.40E-09	5.80E-09
URI (Δ CDF)	1.00E-07	1.00E-07	5.90E-08	5.90E-08	5.90E-08	5.90E-08	5.90E-08	5.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.90E-08	9.15E-08	5.10E-08	5.55E-08	4.95E-08	5.52E-08	6.04E-08	6.48E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

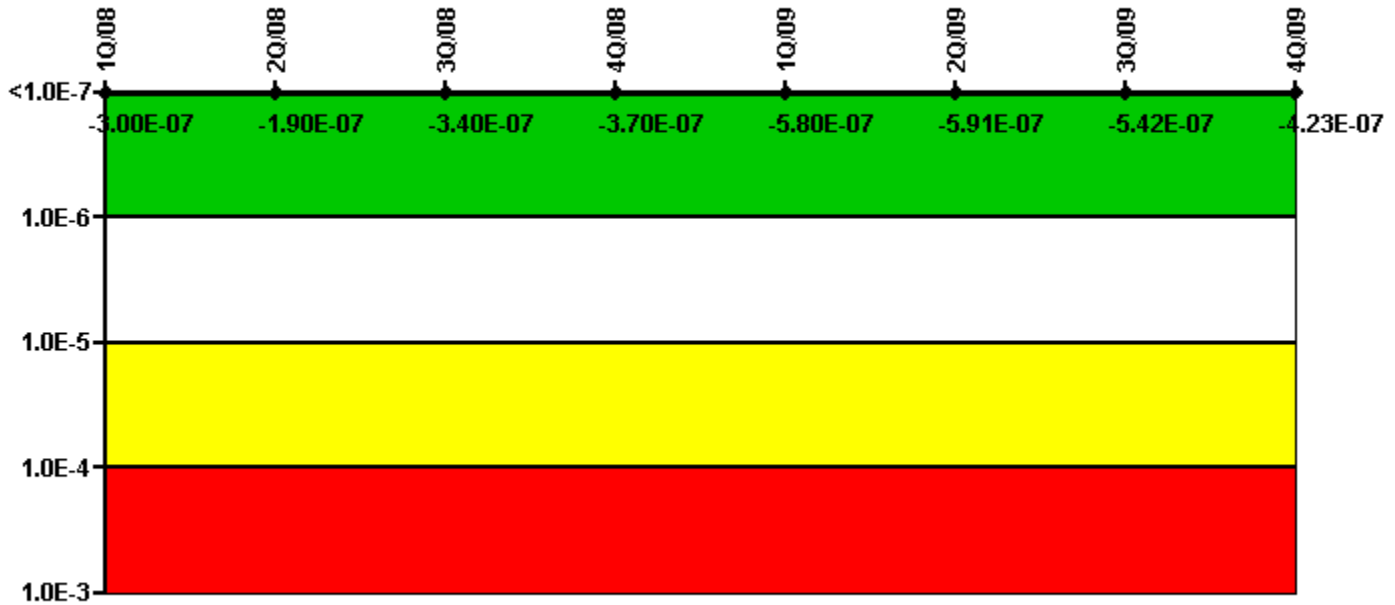


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	2.20E-07	3.30E-07	1.60E-07	1.30E-07	-8.00E-08	-9.10E-08	-4.20E-08	7.70E-08
URI (Δ CDF)	-5.20E-07	-5.20E-07	-5.00E-07	-5.00E-07	-5.00E-07	-5.00E-07	-5.00E-07	-5.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.00E-07	-1.90E-07	-3.40E-07	-3.70E-07	-5.80E-07	-5.91E-07	-5.42E-07	-4.23E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

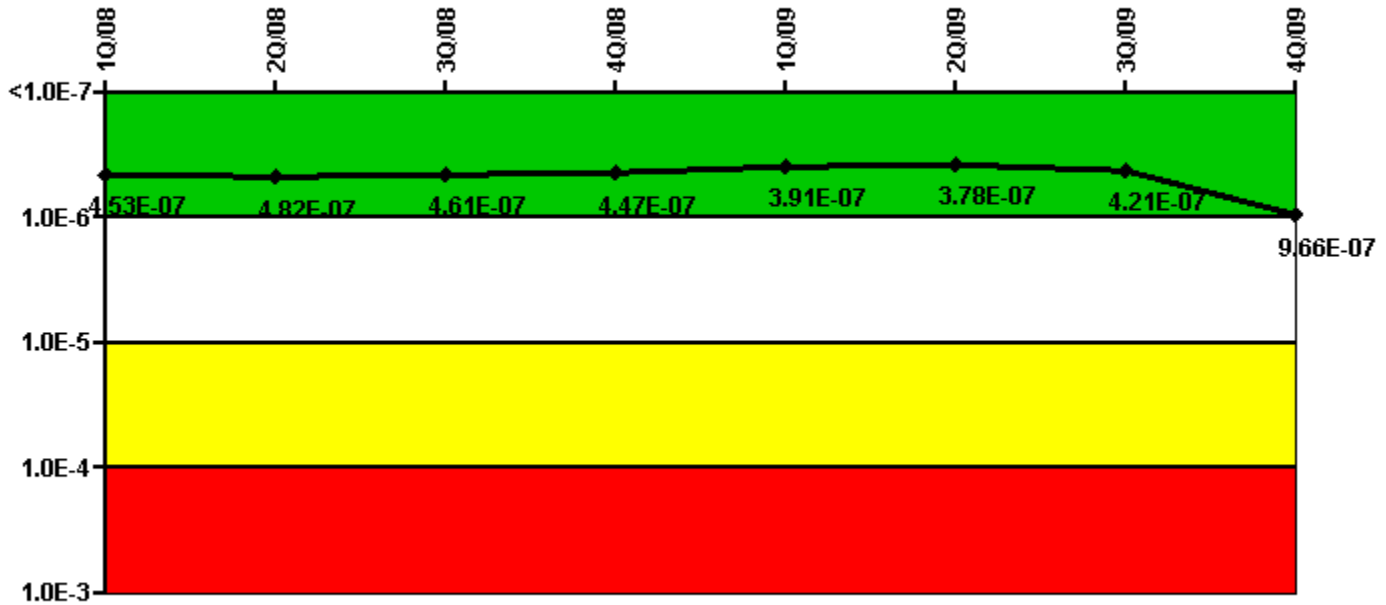

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	-7.20E-09	2.20E-08	5.10E-08	3.70E-08	-1.90E-08	-3.20E-08	1.10E-08	5.60E-08
URI (Δ CDF)	4.60E-07	4.60E-07	4.10E-07	4.10E-07	4.10E-07	4.10E-07	4.10E-07	9.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.53E-07	4.82E-07	4.61E-07	4.47E-07	3.91E-07	3.78E-07	4.21E-07	9.66E-07

Licensee Comments:

4Q/09: Risk Cap Invoked.

3Q/09: Revised Q3 2009 unavailable hours from a conservative value to the actual hours considering the time that the equipment became available. This change affects the unavailability index for Q3 2009. Color unaffected.


3Q/08: Revised Q3 2008 unavailable hours from a conservative value to the actual hours considering the time that the equipment became available. This change affects the unavailability index for Q3 2008 through Q3 2009. Color unaffected.

1Q/08: 1B RHR demand failure added due to MSPI applicability to the breaker failure not being recognized at the time of occurrence. Change affects 4th quarter 2007 data. Indicator color unaffected.

4Q/07: Revised Q4 2007 unavailable hours from a conservative value to the actual hours considering the time that the equipment became available. This change affects the unavailability index for Q4 2007 through Q3 2009. Color unaffected.

3Q/07: Revised Q3 2007 unavailable hours from a conservative value to the actual hours considering the time that the equipment became available. This change affects the unavailability index for Q3 2007 through Q3 2009. Color unaffected.

Mitigating Systems Performance Index, Cooling Water Systems

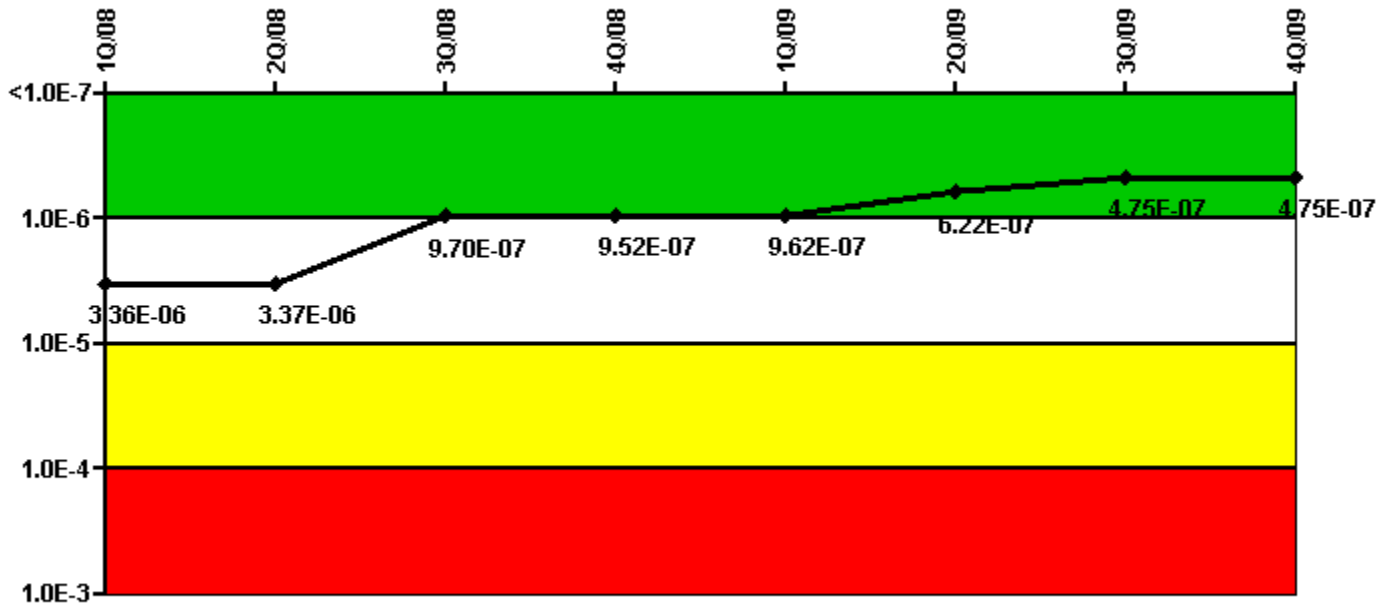


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	3.60E-07	3.70E-07	4.00E-08	2.20E-08	2.20E-08	2.20E-08	2.50E-08	2.50E-08
URI (Δ CDF)	3.00E-06	3.00E-06	9.30E-07	9.30E-07	9.40E-07	6.00E-07	4.50E-07	4.50E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.36E-06	3.37E-06	9.70E-07	9.52E-07	9.62E-07	6.22E-07	4.75E-07	4.75E-07

Licensee Comments: none

Reactor Coolant System Activity

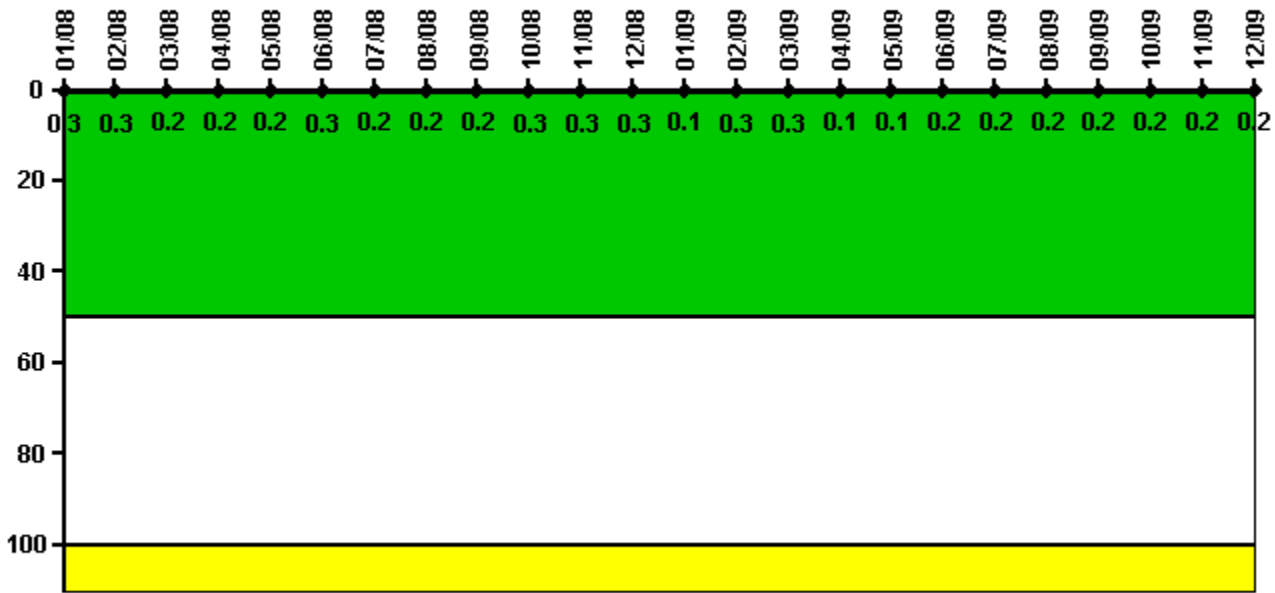


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum activity	0.001271	0.001684	0.001040	0.001166	0.001242	0.001619	0.001189	0.001180	0.001170	0.001280	0.001290	0.001530
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.3	0.3	0.2	0.2	0.2	0.3	0.2	0.2	0.2	0.3	0.3	0.3
Reactor Coolant System Activity	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09
Maximum activity	0.000284	0.001570	0.001590	0.000366	0.000692	0.000856	0.000876	0.000909	0.000975	0.000971	0.001050	0.001140
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.1	0.3	0.3	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2

Licensee Comments: none

Reactor Coolant System Leakage

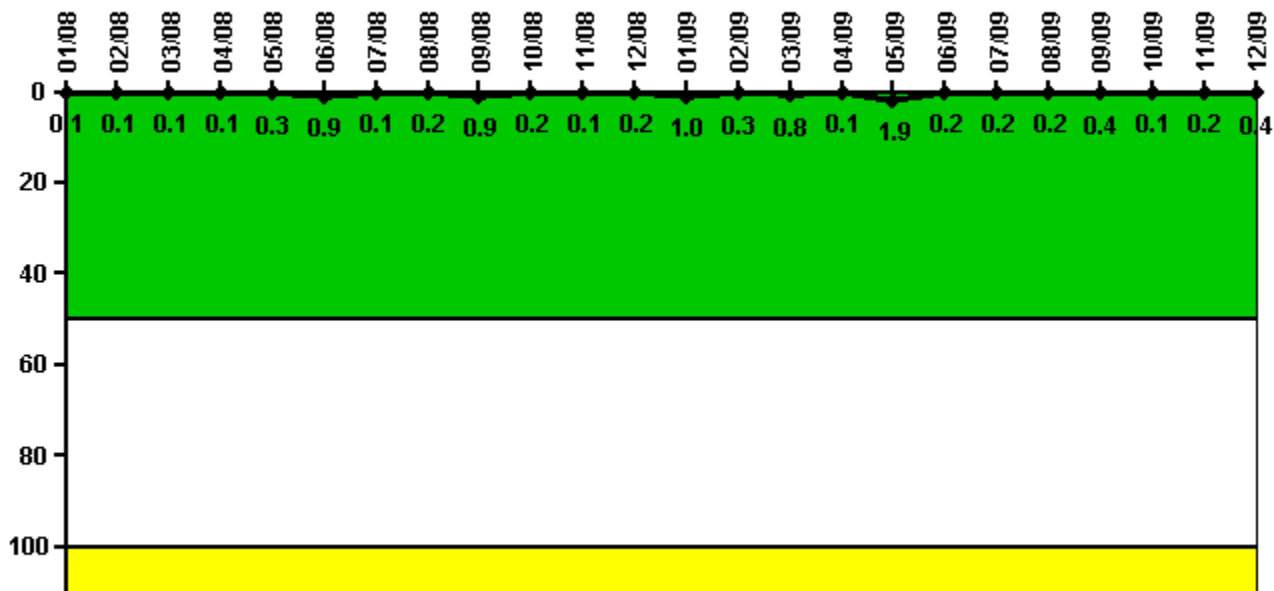


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum leakage	0.010	0.010	0.010	0.010	0.030	0.090	0.010	0.020	0.090	0.020	0.010	0.020
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.1	0.1	0.1	0.3	0.9	0.1	0.2	0.9	0.2	0.1	0.2
Reactor Coolant System Leakage	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09
Maximum leakage	0.100	0.030	0.080	0.007	0.185	0.020	0.016	0.020	0.038	0.013	0.016	0.039
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.0	0.3	0.8	0.1	1.9	0.2	0.2	0.2	0.4	0.1	0.2	0.4

Licensee Comments: none

Drill/Exercise Performance

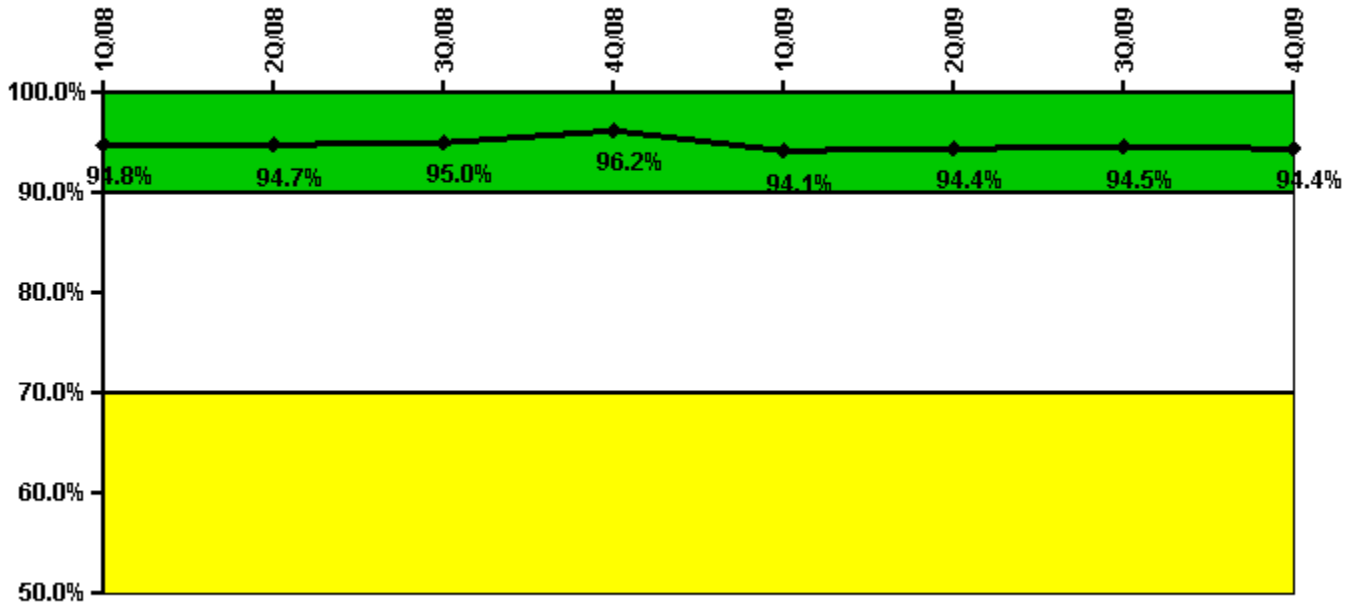


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Successful opportunities	57.0	19.0	27.0	13.0	25.0	18.0	15.0	30.0
Total opportunities	62.0	20.0	28.0	13.0	29.0	18.0	15.0	31.0
Indicator value	94.8%	94.7%	95.0%	96.2%	94.1%	94.4%	94.5%	94.4%

Licensee Comments: none

ERO Drill Participation

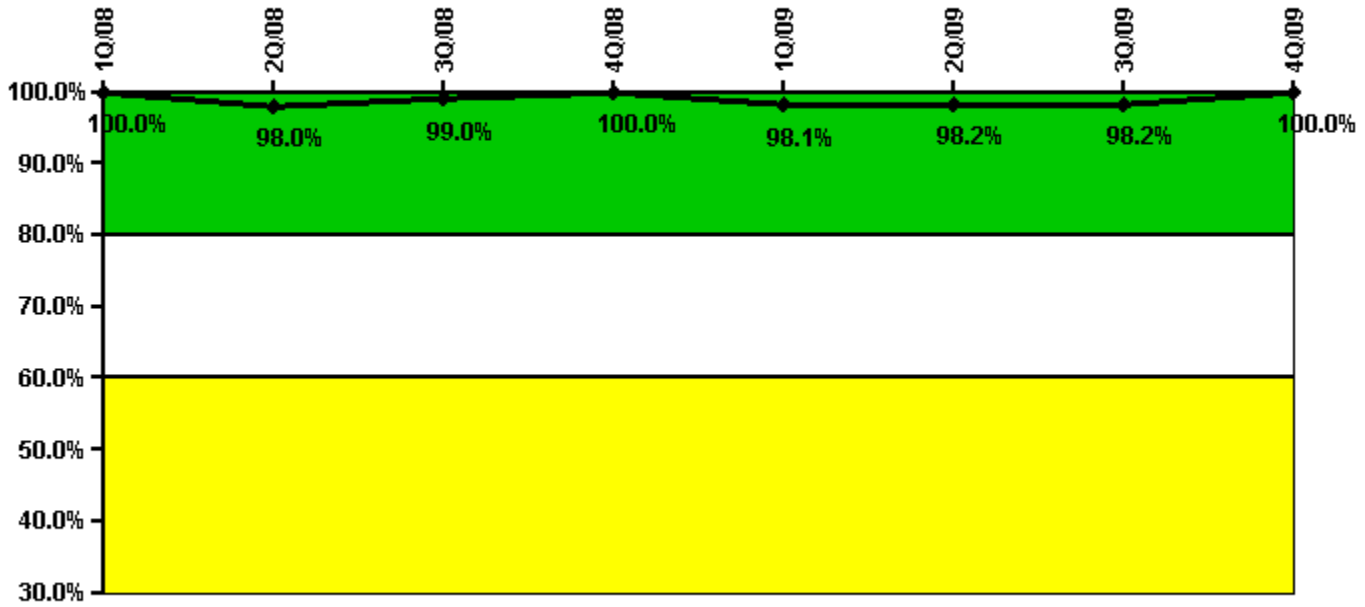


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Participating Key personnel	103.0	99.0	98.0	107.0	105.0	110.0	111.0	110.0
Total Key personnel	103.0	101.0	99.0	107.0	107.0	112.0	113.0	110.0
Indicator value	100.0%	98.0%	99.0%	100.0%	98.1%	98.2%	98.2%	100.0%

Licensee Comments: none

Alert & Notification System

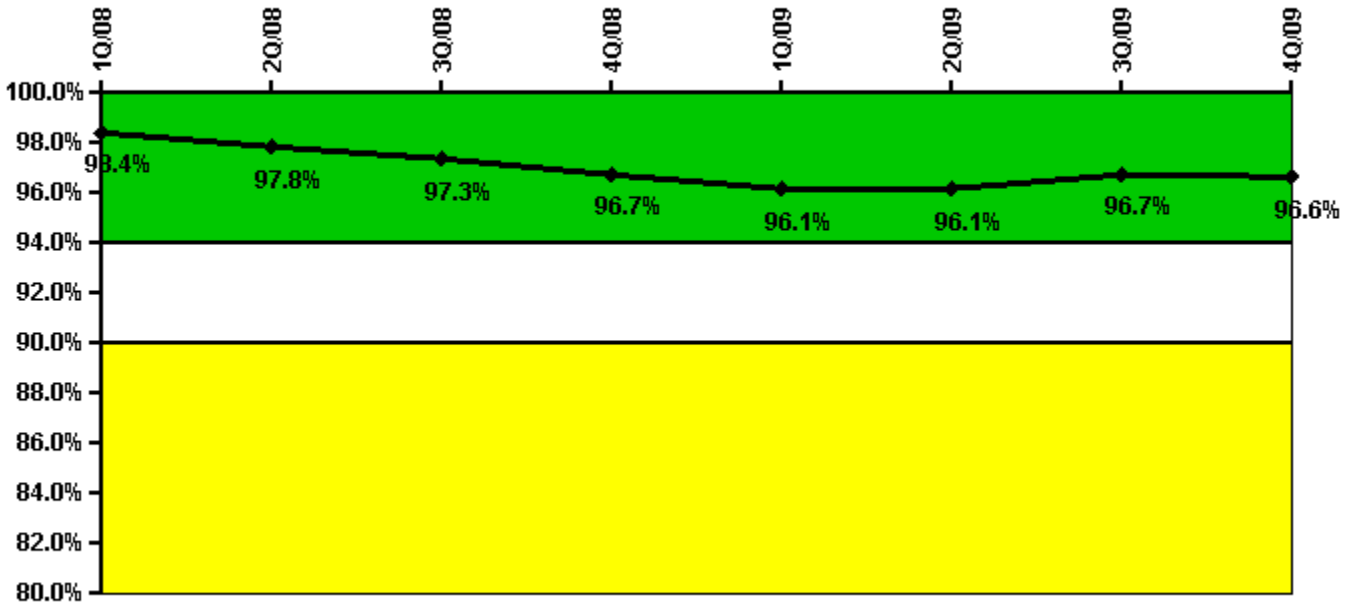


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Successful siren-tests	44	43	44	46	40	43	45	40
Total sirens-tests	45	45	45	48	42	45	45	42
Indicator value	98.4%	97.8%	97.3%	96.7%	96.1%	96.1%	96.7%	96.6%

Licensee Comments: none

Occupational Exposure Control Effectiveness

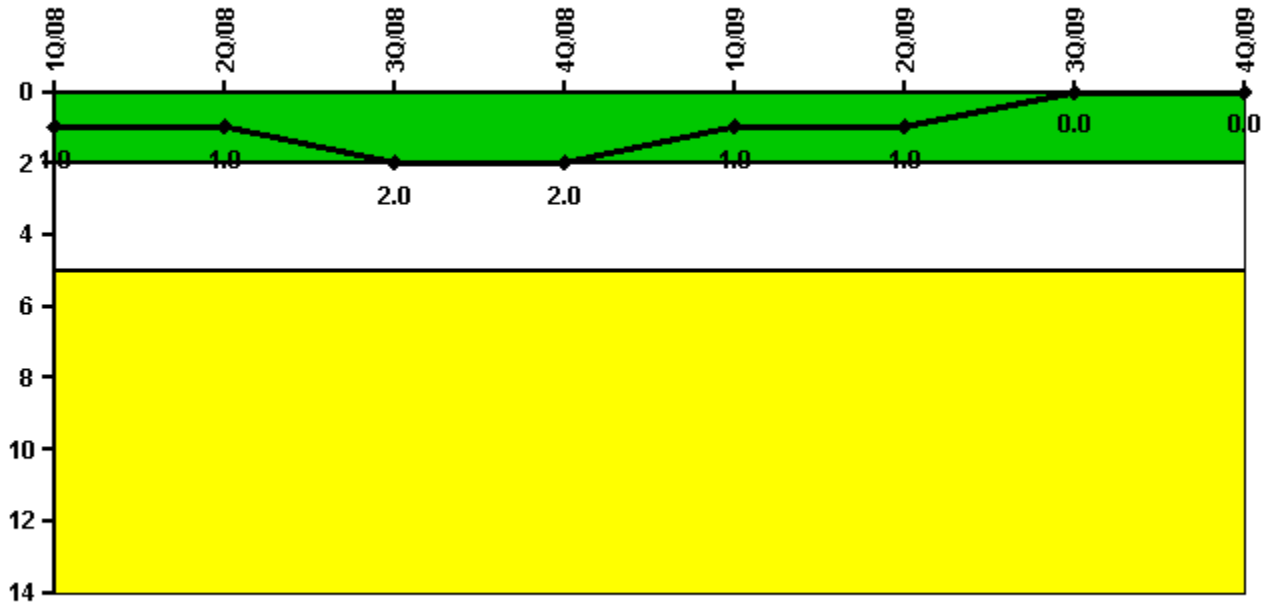

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
High radiation area occurrences	1	0	1	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	1	1	2	2	1	1	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.