


Saint Lucie 1

4Q/2009 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

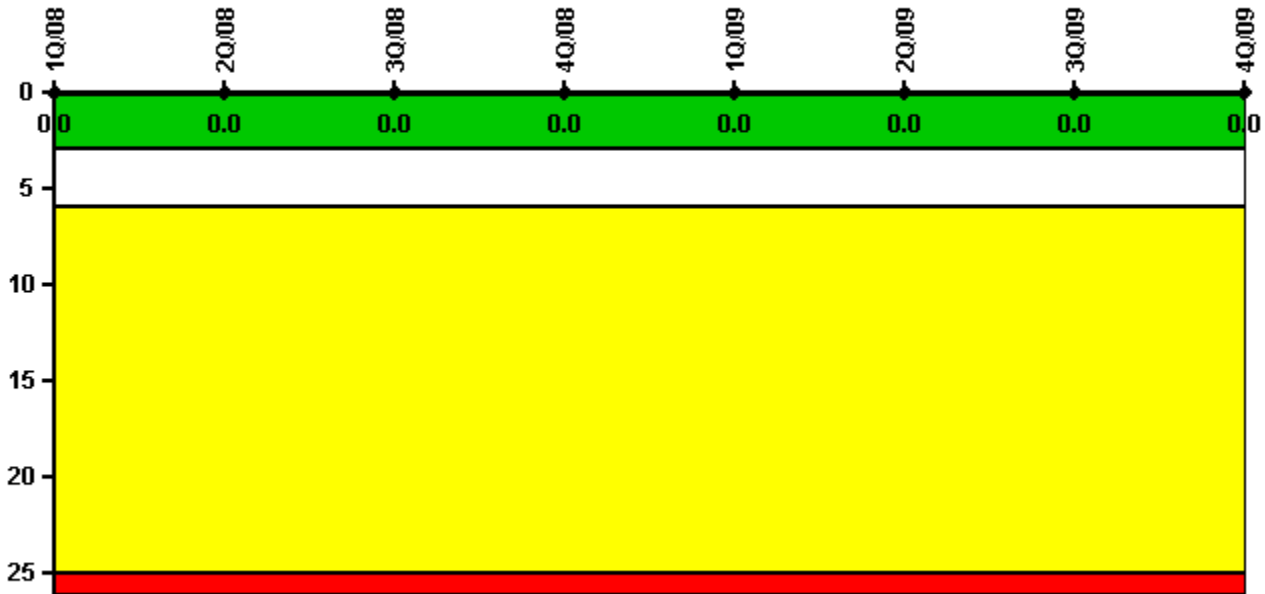


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2183.0	2184.0	2091.3	1443.0	2159.0	2184.0	2208.0	2209.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

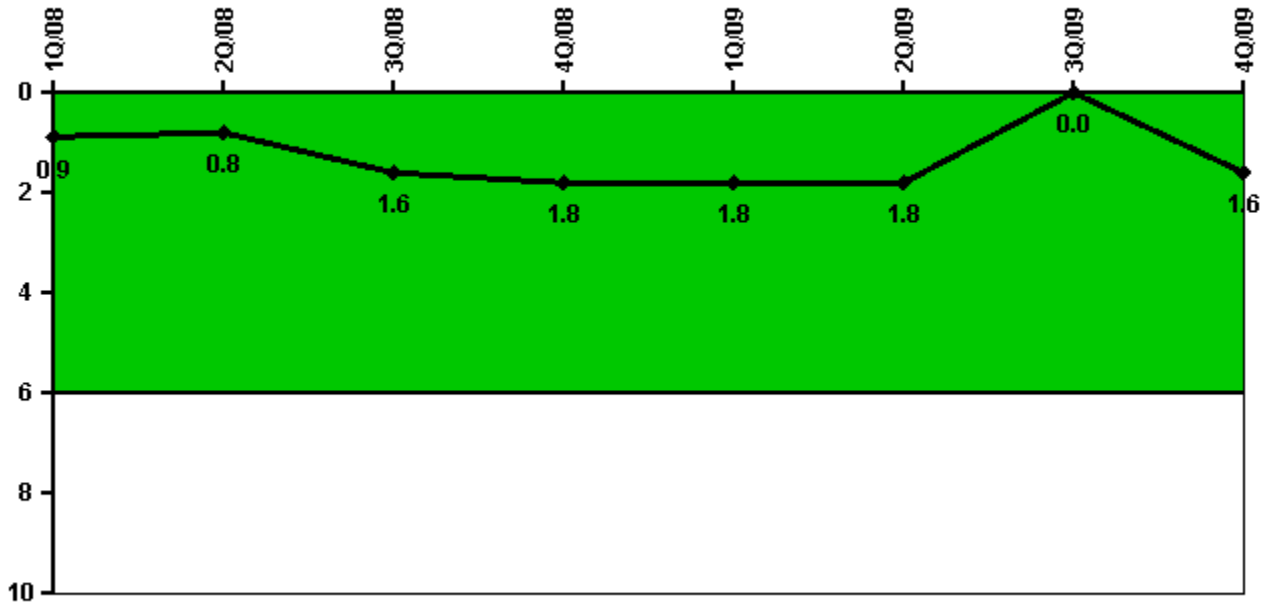

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Unplanned power changes	0	0	2.0	0	0	0	0	2.0
Critical hours	2183.0	2184.0	2091.3	1443.0	2159.0	2184.0	2208.0	2209.0
Indicator value	0.9	0.8	1.6	1.8	1.8	1.8	0	1.6

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

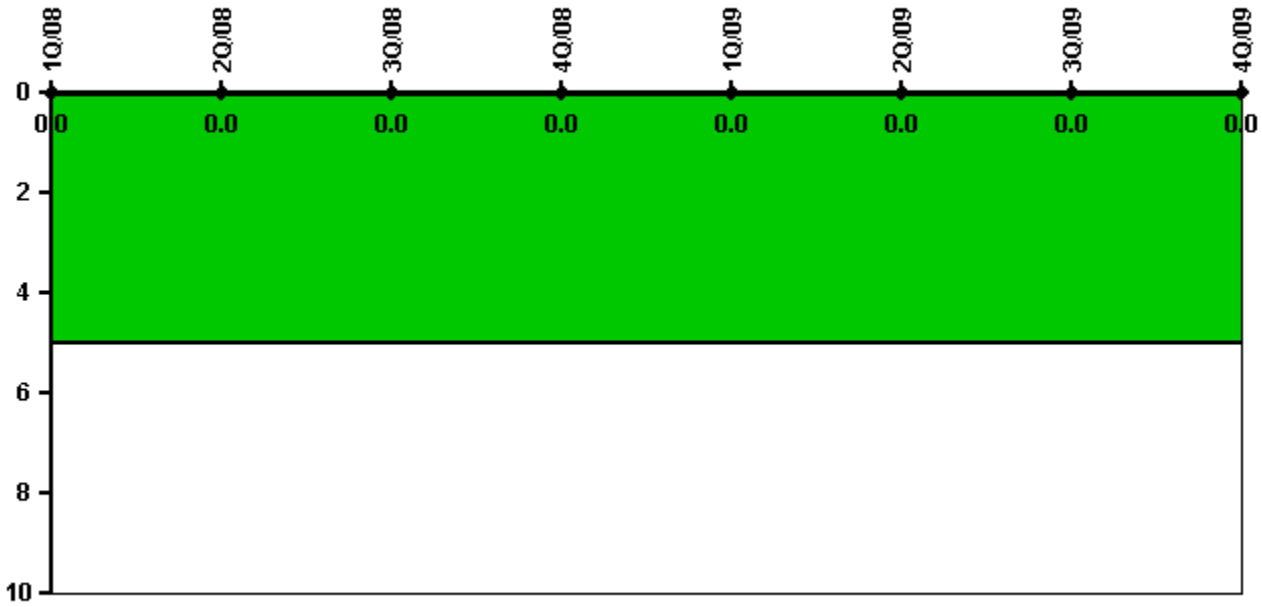


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

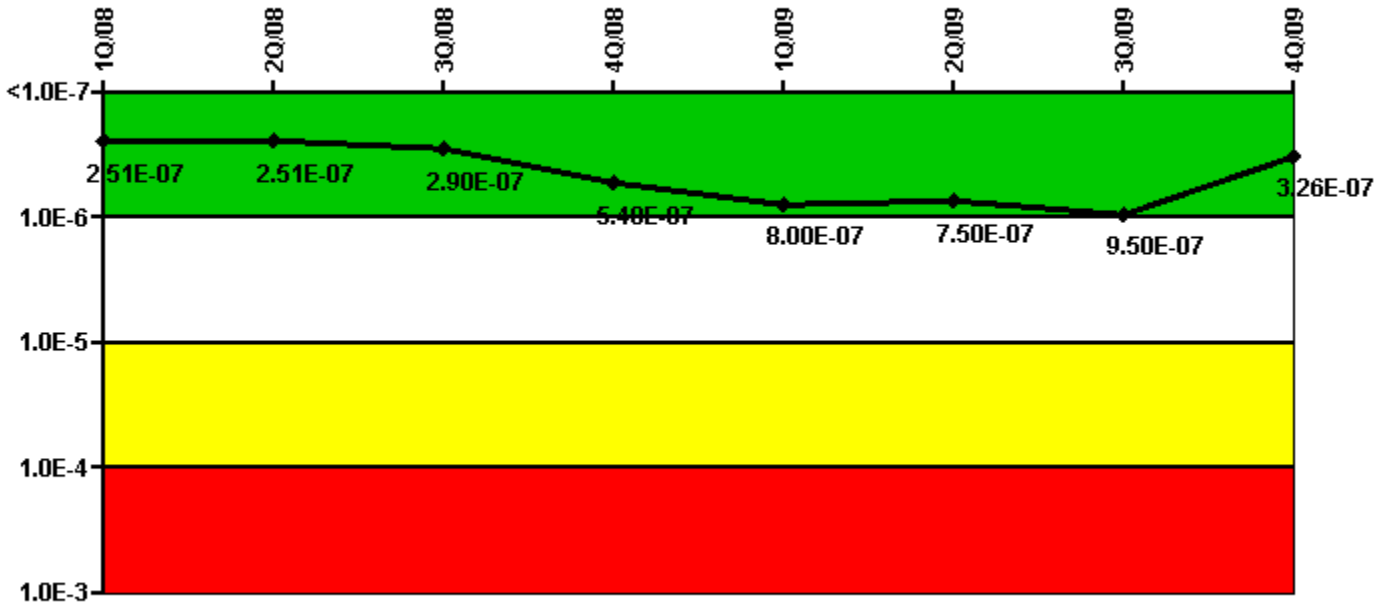

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	9.10E-08	9.10E-08	1.30E-07	1.20E-07	1.70E-07	1.70E-07	1.70E-07	5.60E-08
URI (Δ CDF)	1.60E-07	1.60E-07	1.60E-07	4.20E-07	6.30E-07	5.80E-07	7.80E-07	2.70E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.51E-07	2.51E-07	2.90E-07	5.40E-07	8.00E-07	7.50E-07	9.50E-07	3.26E-07

Licensee Comments:

4Q/09: Changed PRA Parameter(s). CDE PRA values were revised to reflect the updated PRA models (for Unit 1 & 2 models) that were approved August 2009. The updated PRA models included the following PRA elements: revised simplified LERF model (Level 2), revised CCF analysis, revised unit 1 success criteria analysis, revised pre-initiating human reliability analysis, revised interfacing system LOCA analysis, and inclusion of containment isolation system fault tree.

Mitigating Systems Performance Index, High Pressure Injection System

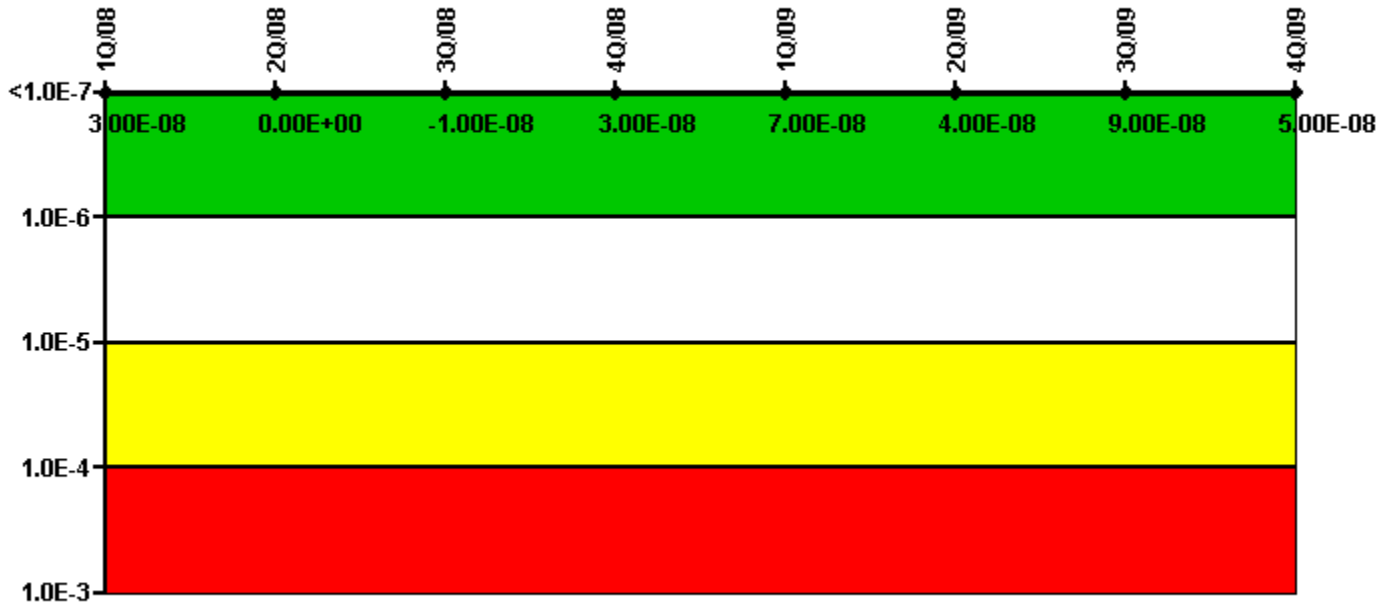

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	1.40E-07	1.10E-07	1.00E-07	1.40E-07	1.80E-07	1.50E-07	2.00E-07	1.80E-07
URI (Δ CDF)	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.00E-08	0.00E+00	-1.00E-08	3.00E-08	7.00E-08	4.00E-08	9.00E-08	5.00E-08

Licensee Comments:

4Q/09: Changed PRA Parameter(s). CDE PRA values were revised to reflect the updated PRA models (for Unit 1 & 2 models) that were approved August 2009. The updated PRA models included the following PRA elements: revised simplified LERF model (Level 2), revised CCF analysis, revised unit 1 success criteria analysis, revised pre-initiating human reliability analysis, revised interfacing system LOCA analysis, and inclusion of containment isolation system fault tree.

Mitigating Systems Performance Index, Heat Removal System

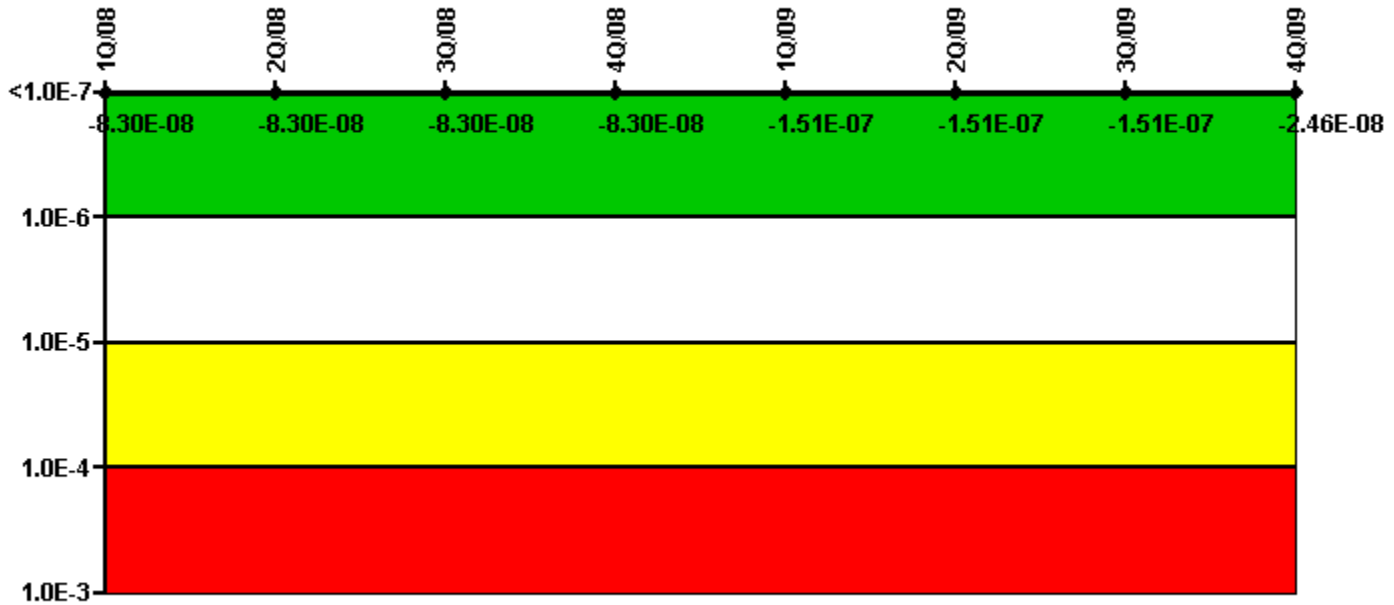

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (Δ CDF)	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-3.10E-08	-3.10E-08	-3.10E-08	-4.60E-09
URI (Δ CDF)	-7.10E-08	-7.10E-08	-7.10E-08	-7.10E-08	-1.20E-07	-1.20E-07	-1.20E-07	-2.00E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.30E-08	-8.30E-08	-8.30E-08	-8.30E-08	-1.51E-07	-1.51E-07	-1.51E-07	-2.46E-08

Licensee Comments:

4Q/09: Changed PRA Parameter(s). CDE PRA values were revised to reflect the updated PRA models (for Unit 1 & 2 models) that were approved August 2009. The updated PRA models included the following PRA elements: revised simplified LERF model (Level 2), revised CCF analysis, revised unit 1 success criteria analysis, revised pre-initiating human reliability analysis, revised interfacing system LOCA analysis, and inclusion of containment isolation system fault tree.

Mitigating Systems Performance Index, Residual Heat Removal System

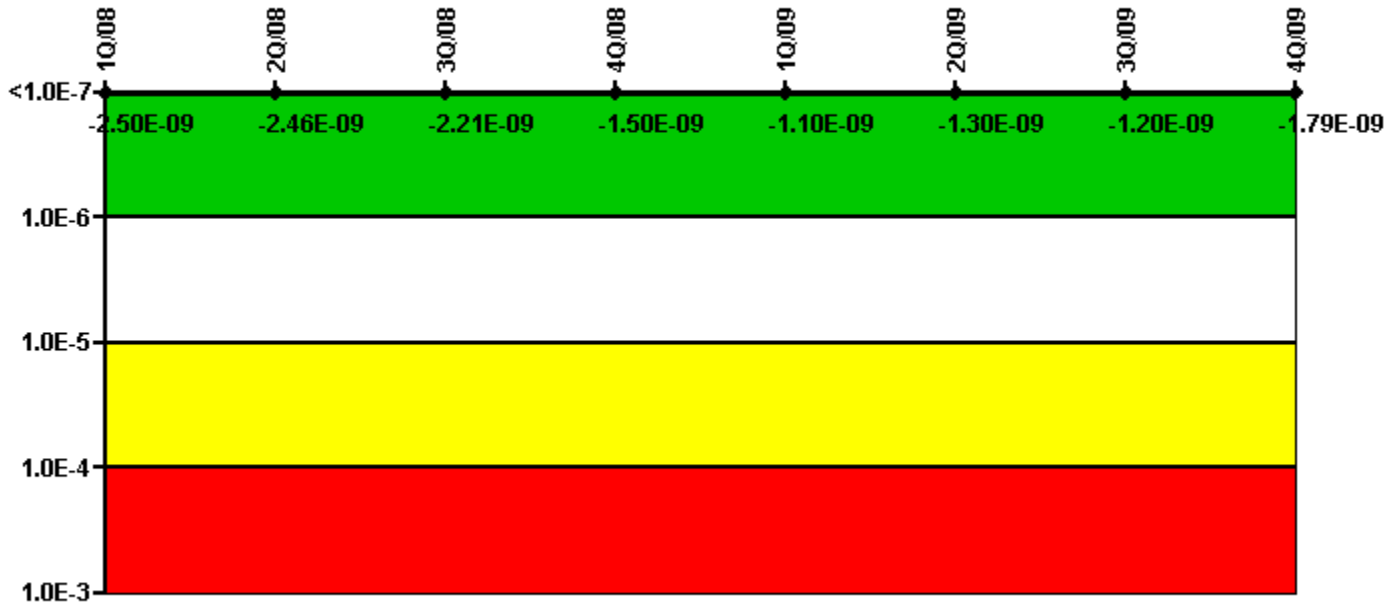

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (ΔCDF)	2.20E-12	4.20E-11	2.90E-10	1.00E-09	1.40E-09	1.20E-09	1.30E-09	5.10E-10
URI (ΔCDF)	-2.50E-09	-2.50E-09	-2.50E-09	-2.50E-09	-2.50E-09	-2.50E-09	-2.50E-09	-2.30E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-09	-2.46E-09	-2.21E-09	-1.50E-09	-1.10E-09	-1.30E-09	-1.20E-09	-1.79E-09

Licensee Comments:

4Q/09: Changed PRA Parameter(s). CDE PRA values were revised to reflect the updated PRA models (for Unit 1 & 2 models) that were approved August 2009. The updated PRA models included the following PRA elements: revised simplified LERF model (Level 2), revised CCF analysis, revised unit 1 success criteria analysis, revised pre-initiating human reliability analysis, revised interfacing system LOCA analysis, and inclusion of containment isolation system fault tree.

Mitigating Systems Performance Index, Cooling Water Systems

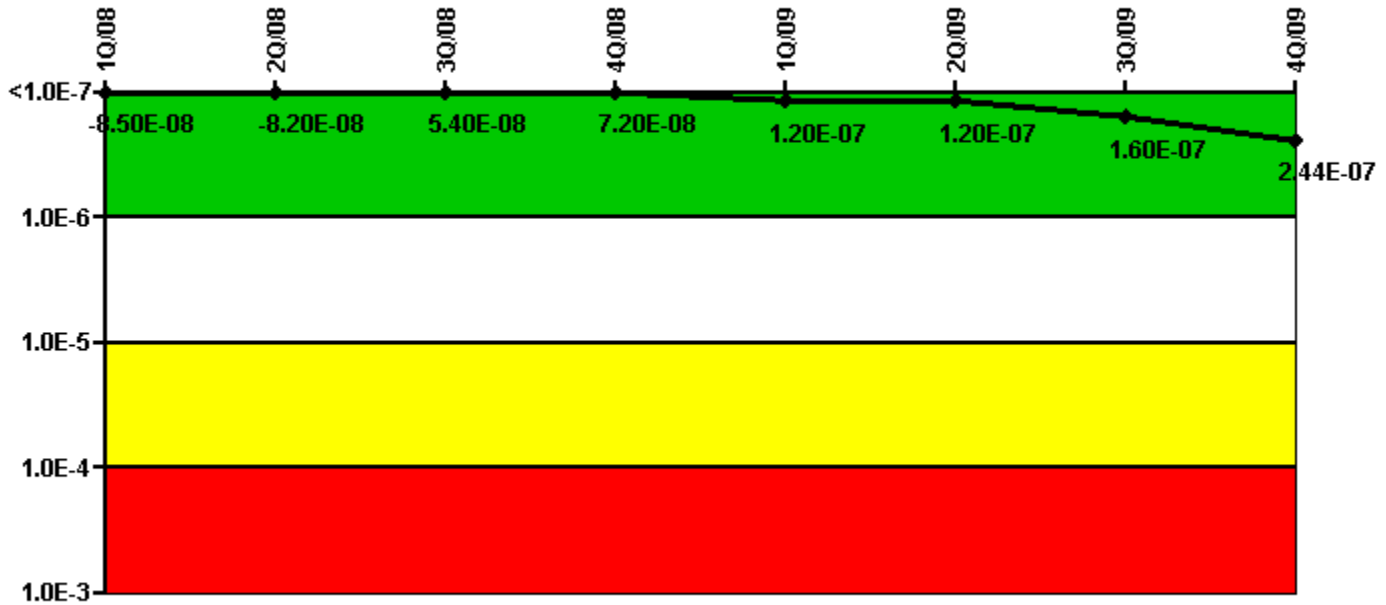

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
UAI (ΔCDF)	-7.50E-08	-7.20E-08	6.40E-08	8.20E-08	1.30E-07	1.30E-07	1.70E-07	2.80E-07
URI (ΔCDF)	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-3.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.50E-08	-8.20E-08	5.40E-08	7.20E-08	1.20E-07	1.20E-07	1.60E-07	2.44E-07

Licensee Comments:

4Q/09: Changed PRA Parameter(s). CDE PRA values were revised to reflect the updated PRA models (for Unit 1 & 2 models) that were approved August 2009. The updated PRA models included the following PRA elements: revised simplified LERF model (Level 2), revised CCF analysis, revised unit 1 success criteria analysis, revised pre-initiating human reliability analysis, revised interfacing system LOCA analysis, and inclusion of containment isolation system fault tree.

Reactor Coolant System Activity

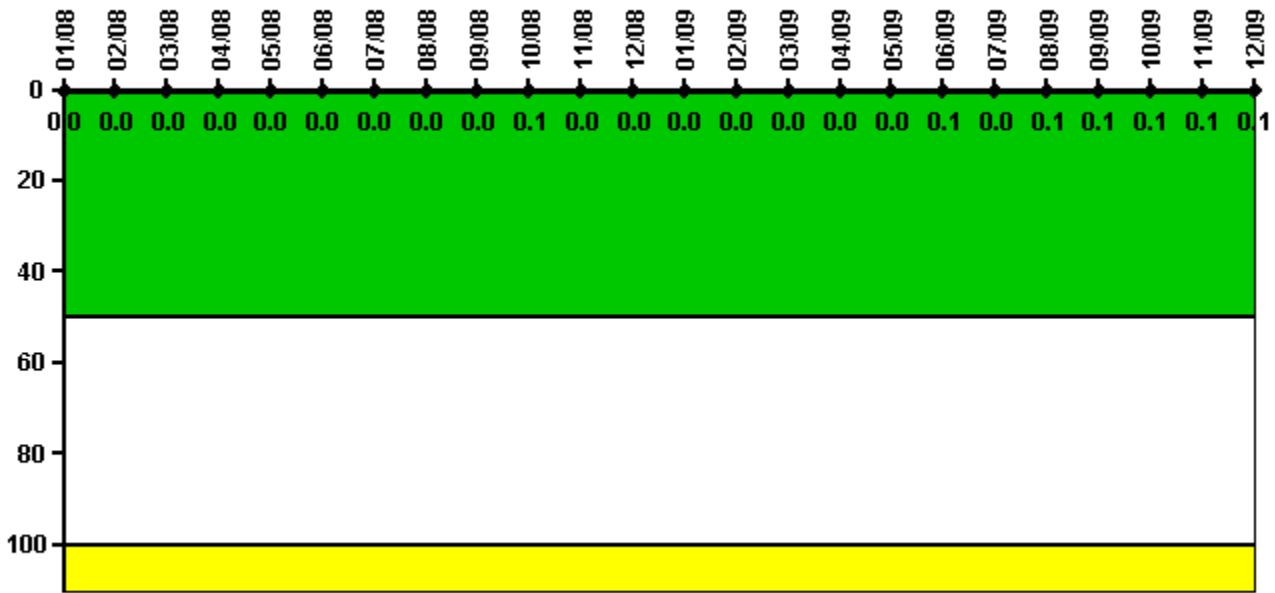


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum activity	0.000299	0.000309	0.000341	0.000356	0.000414	0.000347	0.000362	0.000356	0.000400	0.000610	0.000140	0.000250
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0.1	0	0
Reactor Coolant System Activity	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09
Maximum activity	0.000252	0.000273	0.000277	0.000298	0.000288	0.000530	0.000494	0.000548	0.000576	0.000579	0.000577	0.000612
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0.1	0	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

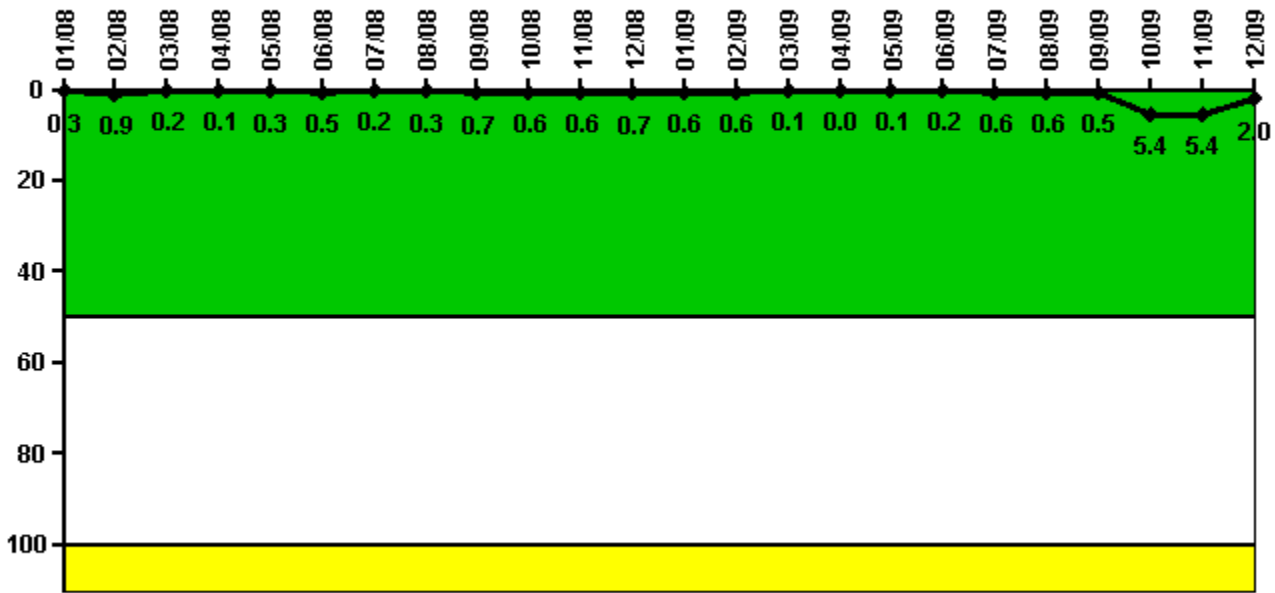


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum leakage	0.030	0.088	0.024	0.005	0.030	0.050	0.020	0.030	0.070	0.060	0.060	0.070
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.9	0.2	0.1	0.3	0.5	0.2	0.3	0.7	0.6	0.6	0.7
Reactor Coolant System Leakage	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09
Maximum leakage	0.060	0.060	0.010	0	0.009	0.015	0.057	0.060	0.050	0.540	0.540	0.200
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.6	0.1	0	0.1	0.2	0.6	0.6	0.5	5.4	5.4	2.0

Licensee Comments: none

Drill/Exercise Performance

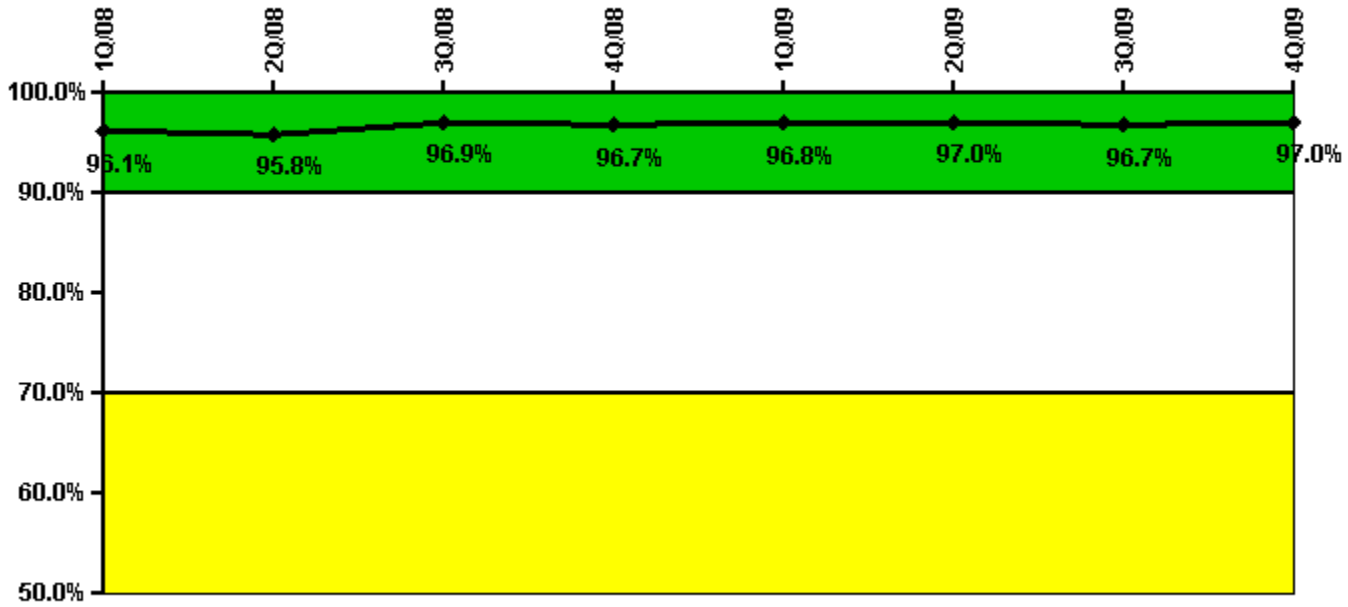


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Successful opportunities	68.0	48.0	68.0	16.0	39.0	26.0	51.0	74.0
Total opportunities	72.0	51.0	69.0	17.0	39.0	26.0	53.0	75.0
Indicator value	96.1%	95.8%	96.9%	96.7%	96.8%	97.0%	96.7%	97.0%

Licensee Comments: none

ERO Drill Participation

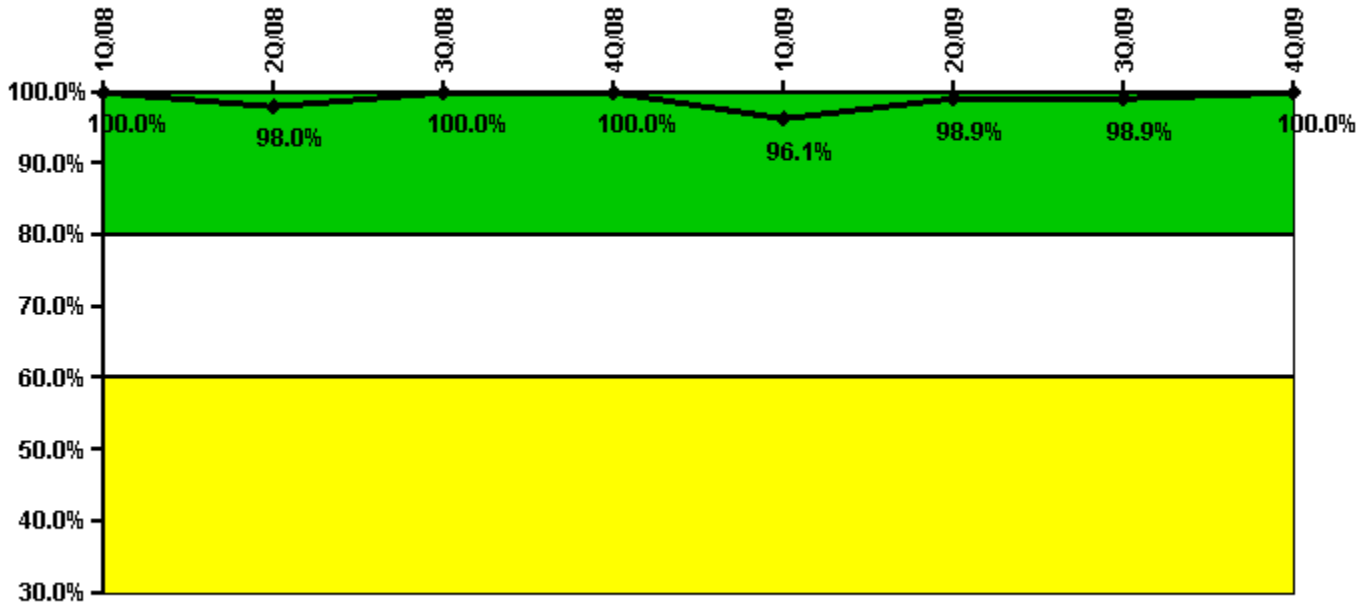


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Participating Key personnel	101.0	96.0	97.0	103.0	99.0	93.0	92.0	96.0
Total Key personnel	101.0	98.0	97.0	103.0	103.0	94.0	93.0	96.0
Indicator value	100.0%	98.0%	100.0%	100.0%	96.1%	98.9%	98.9%	100.0%

Licensee Comments: none

Alert & Notification System

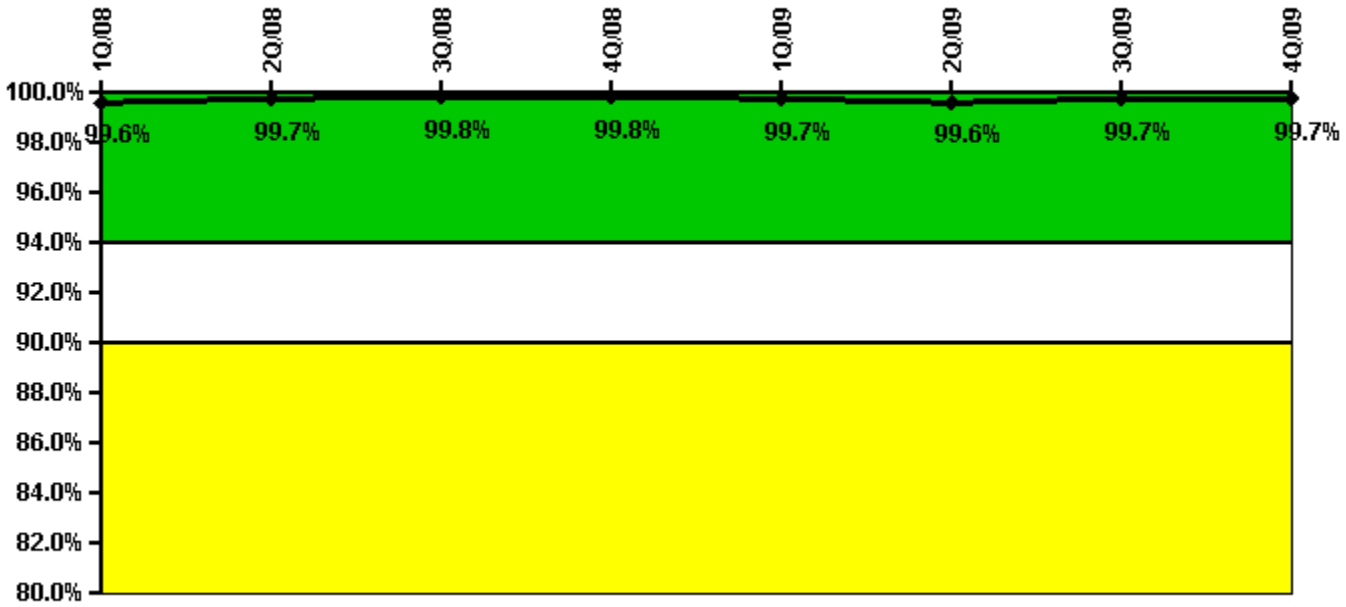

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
Successful siren-tests	629	719	627	720	626	717	630	718
Total sirens-tests	630	720	630	720	630	720	630	720
Indicator value	99.6%	99.7%	99.8%	99.8%	99.7%	99.6%	99.7%	99.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/08	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.