


# Ocone 3

## 1Q/2010 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

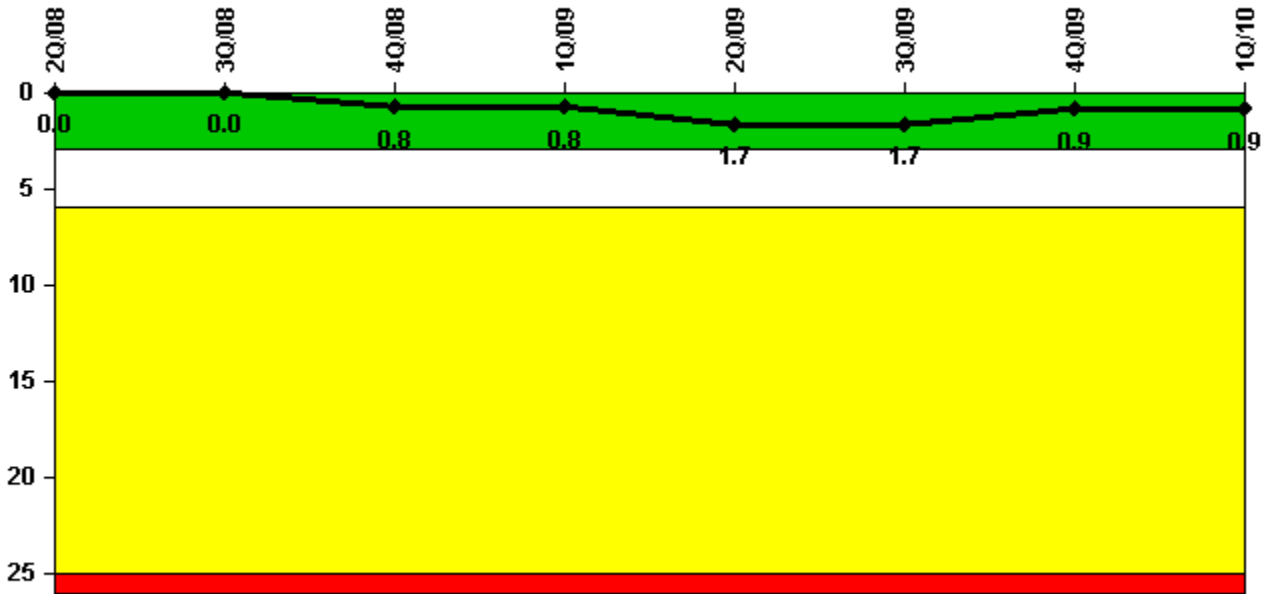


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Unplanned scrams	0	0	1.0	0	1.0	0	0	0
Critical hours	2184.0	2208.0	2151.1	2159.0	1555.6	2208.0	2209.0	2159.0
Indicator value	0	0	0.8	0.8	1.7	1.7	0.9	0.9

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

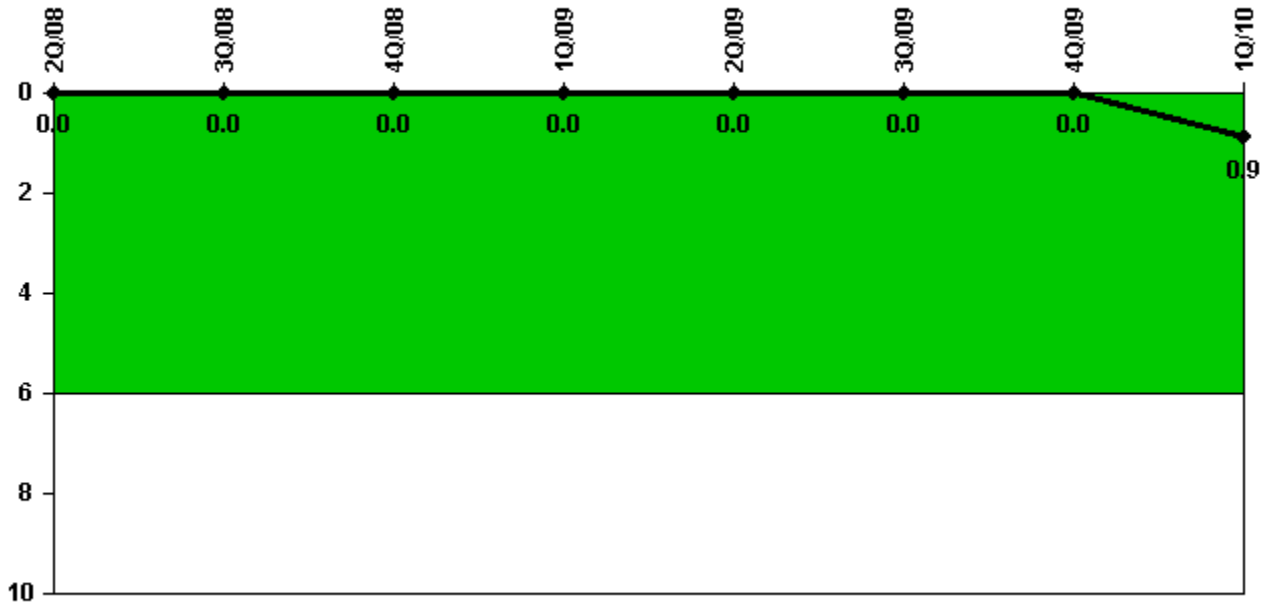

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Unplanned power changes	0	0	0	0	0	0	0	1.0
Critical hours	2184.0	2208.0	2151.1	2159.0	1555.6	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0	0	0	0.9

Licensee Comments: none

## Unplanned Scrams with Complications



Thresholds: White > 1.0


### Notes

Unplanned Scrams with Complications	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

---

## Safety System Functional Failures (PWR)

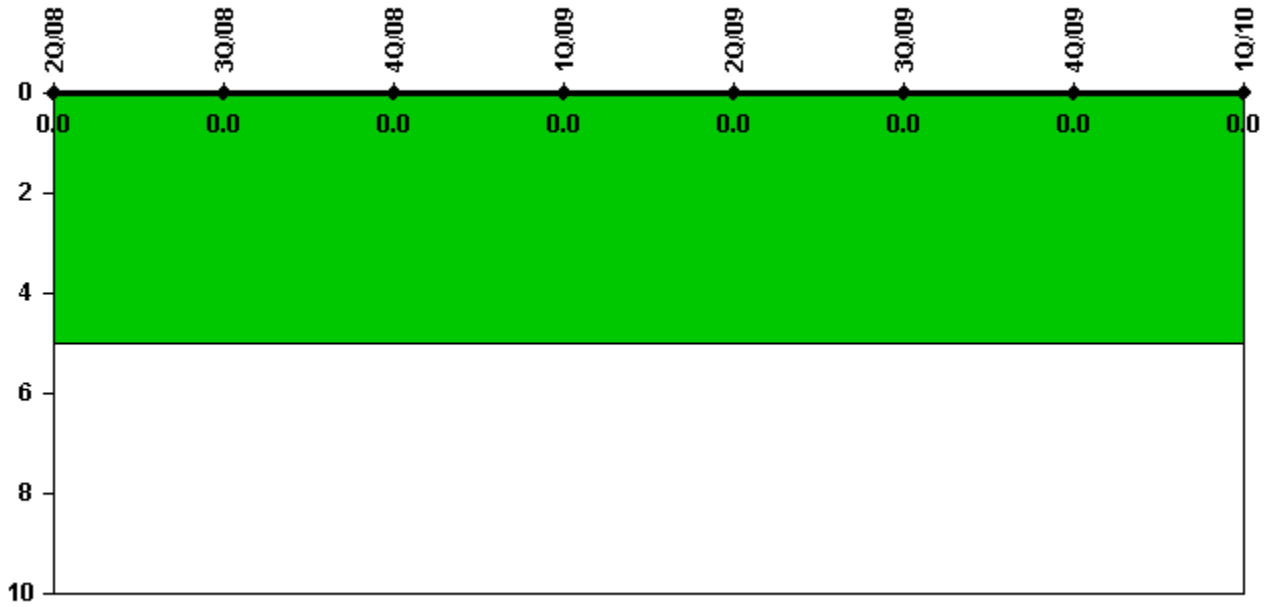

Thresholds: White > 5.0


### Notes

Safety System Functional Failures (PWR)	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

---

# Mitigating Systems Performance Index, Emergency AC Power System

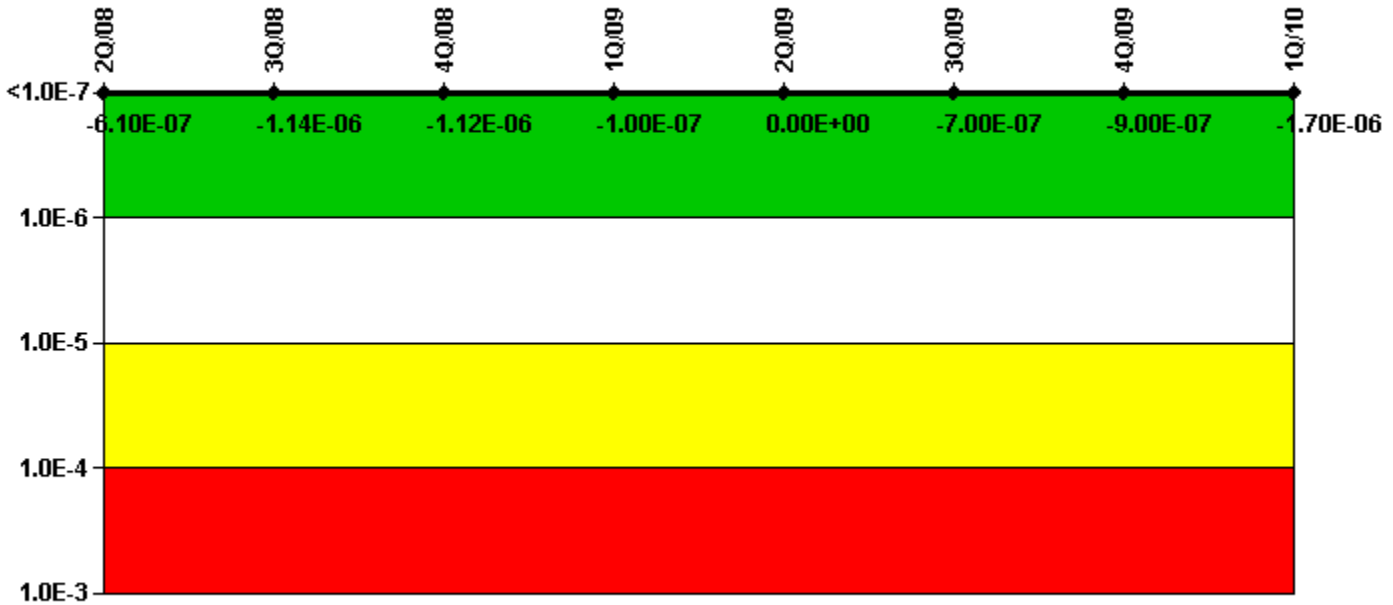


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI ( $\Delta$ CDF)	7.90E-07	8.60E-07	8.80E-07	1.70E-06	1.80E-06	1.30E-06	1.10E-06	3.09E-07
URI ( $\Delta$ CDF)	-1.40E-06	-2.00E-06	-2.00E-06	-1.80E-06	-1.80E-06	-2.00E-06	-2.00E-06	-2.03E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.10E-07	-1.14E-06	-1.12E-06	-1.00E-07	0.00E+00	-7.00E-07	-9.00E-07	-1.70E-06

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

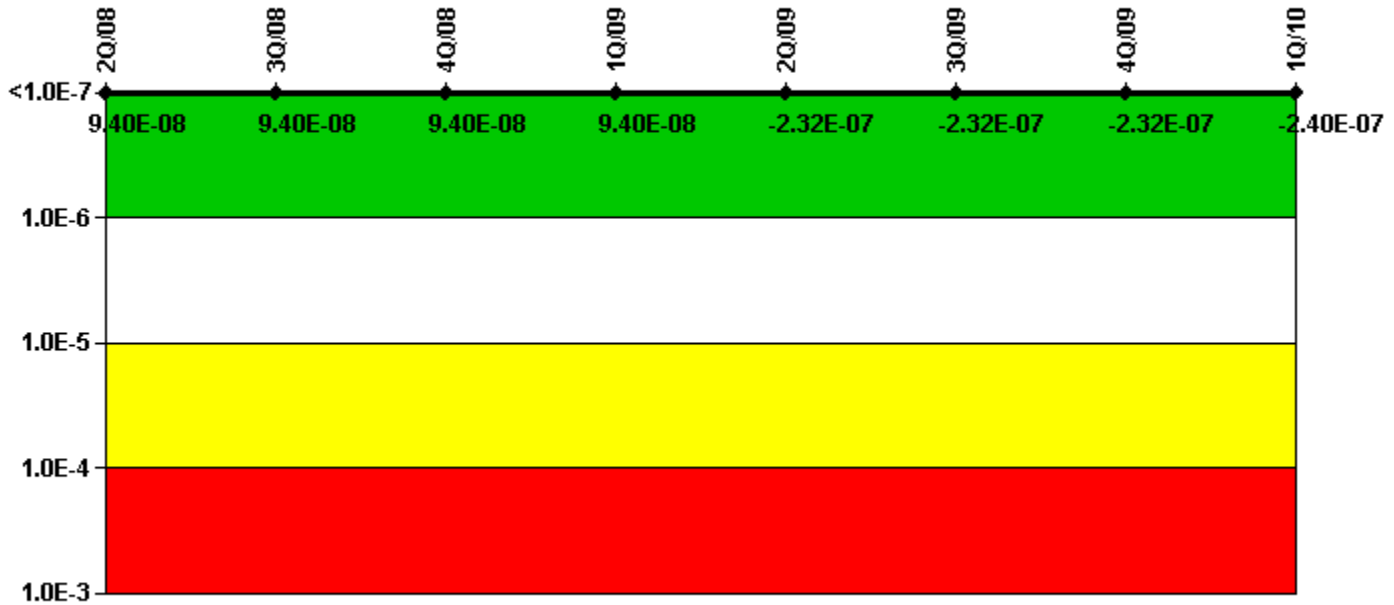


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI ( $\Delta$ CDF)	-5.60E-08	-5.60E-08	-5.60E-08	-5.60E-08	-6.20E-08	-6.20E-08	-6.20E-08	-6.19E-08
URI ( $\Delta$ CDF)	1.50E-07	1.50E-07	1.50E-07	1.50E-07	-1.70E-07	-1.70E-07	-1.70E-07	-1.73E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	9.40E-08	9.40E-08	9.40E-08	9.40E-08	-2.32E-07	-2.32E-07	-2.32E-07	-2.40E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

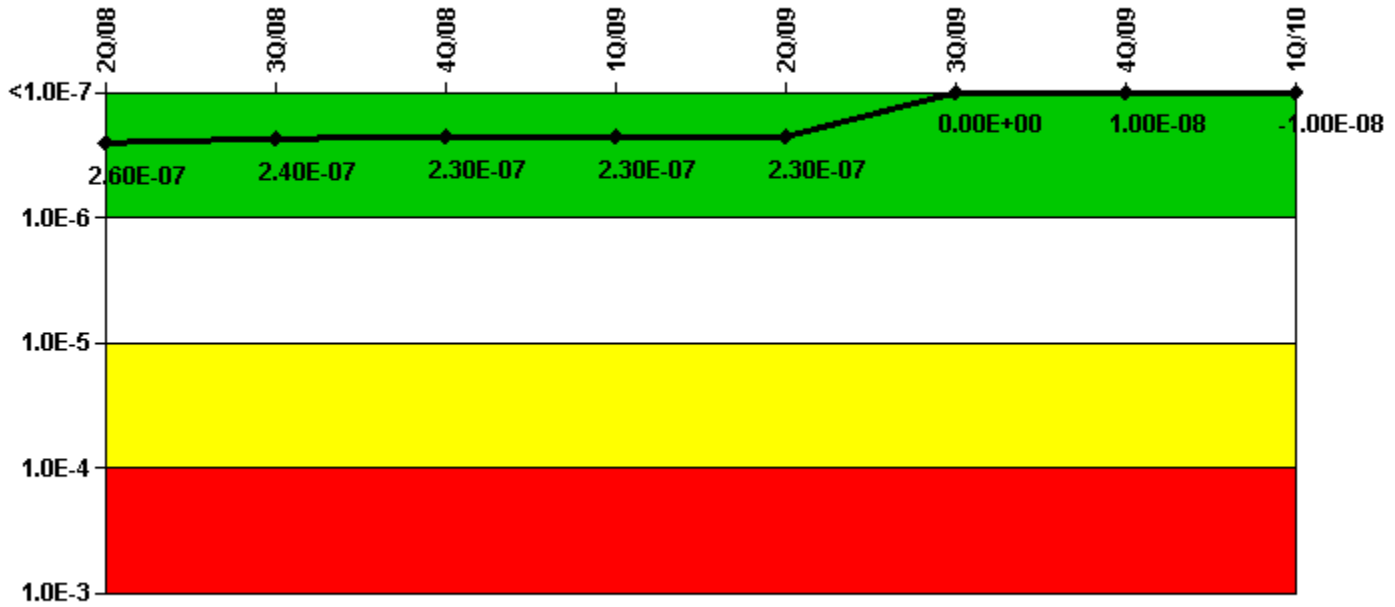


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI ( $\Delta$ CDF)	3.80E-07	3.60E-07	3.50E-07	3.50E-07	3.50E-07	1.20E-07	1.30E-07	1.14E-07
URI ( $\Delta$ CDF)	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.24E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.60E-07	2.40E-07	2.30E-07	2.30E-07	2.30E-07	0.00E+00	1.00E-08	-1.00E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

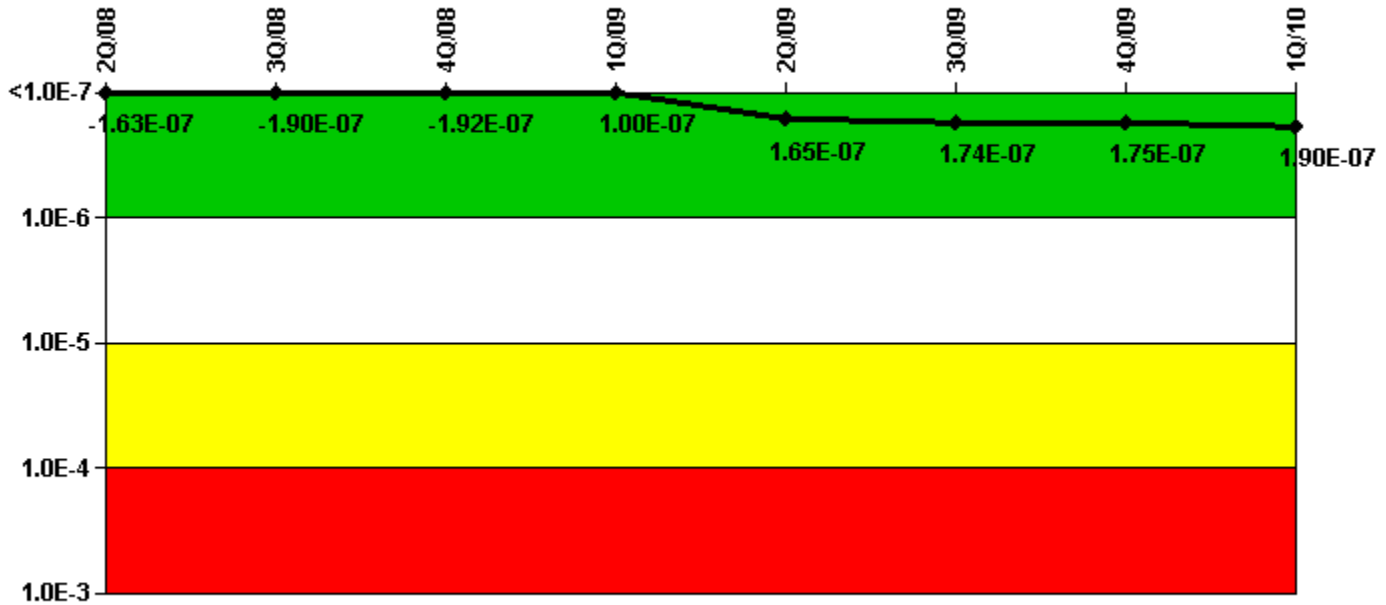

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI ( $\Delta$ CDF)	-3.30E-08	-6.00E-08	-6.20E-08	2.30E-07	2.50E-08	3.40E-08	3.50E-08	5.61E-08
URI ( $\Delta$ CDF)	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	1.40E-07	1.40E-07	1.40E-07	1.37E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.63E-07	-1.90E-07	-1.92E-07	1.00E-07	1.65E-07	1.74E-07	1.75E-07	1.90E-07

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

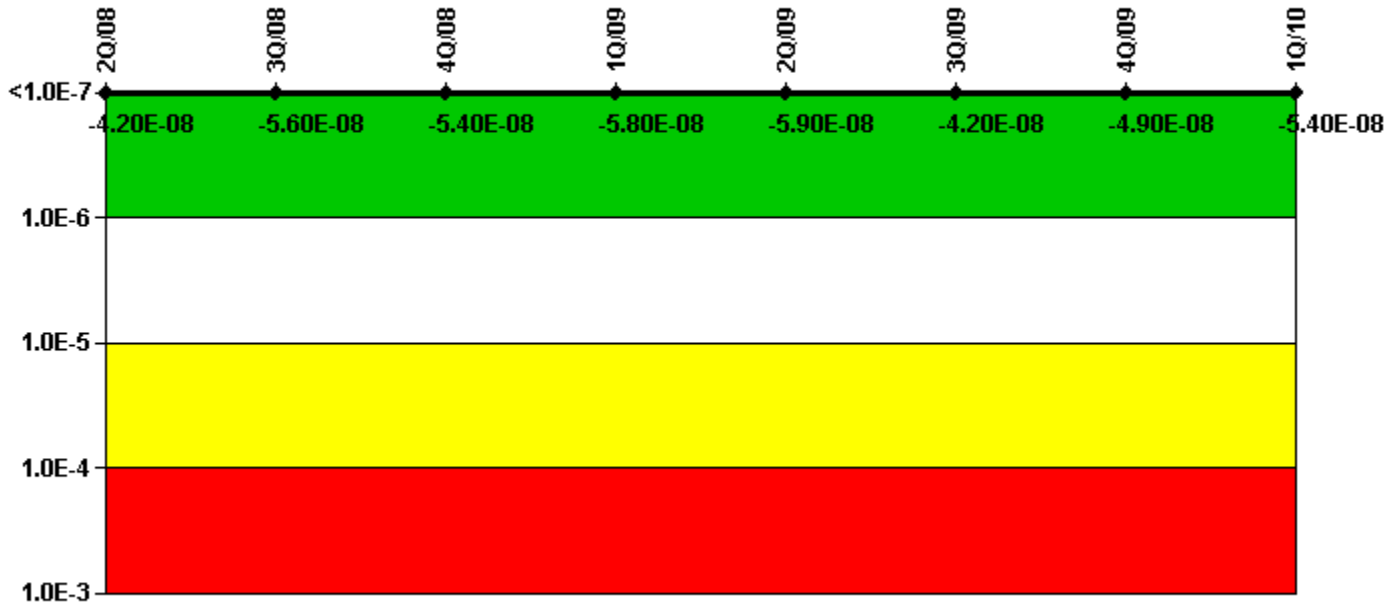


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI ( $\Delta$ CDF)	-1.40E-08	-2.80E-08	-2.60E-08	-3.00E-08	-3.10E-08	-1.40E-08	-2.10E-08	-2.60E-08
URI ( $\Delta$ CDF)	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.78E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.20E-08	-5.60E-08	-5.40E-08	-5.80E-08	-5.90E-08	-4.20E-08	-4.90E-08	-5.40E-08

Licensee Comments: none

# Reactor Coolant System Activity

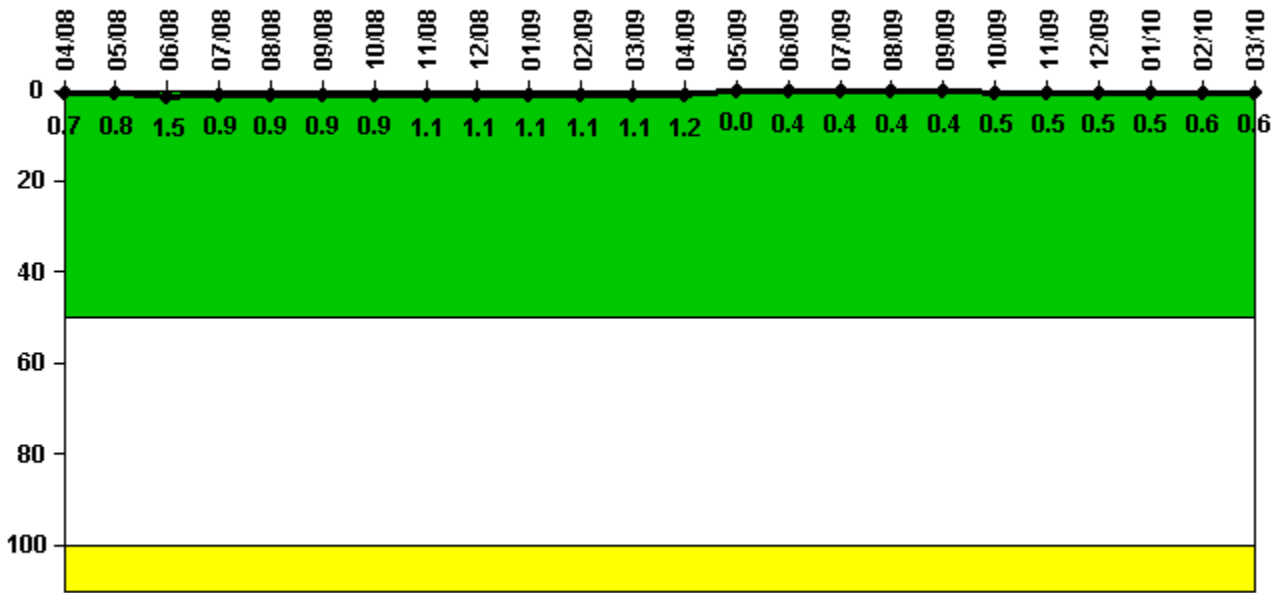


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum activity	0.007420	0.008340	0.015160	0.008657	0.009128	0.009398	0.009485	0.010900	0.010550	0.010740	0.010970	0.011400
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.7	0.8	1.5	0.9	0.9	0.9	0.9	1.1	1.1	1.1	1.1	1.1
Reactor Coolant System Activity	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum activity	0.012110	0	0.003673	0.003850	0.003877	0.004477	0.004664	0.004784	0.005331	0.005188	0.005742	0.005789
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	1.2	0	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.6	0.6

Licensee Comments: none

## Reactor Coolant System Leakage

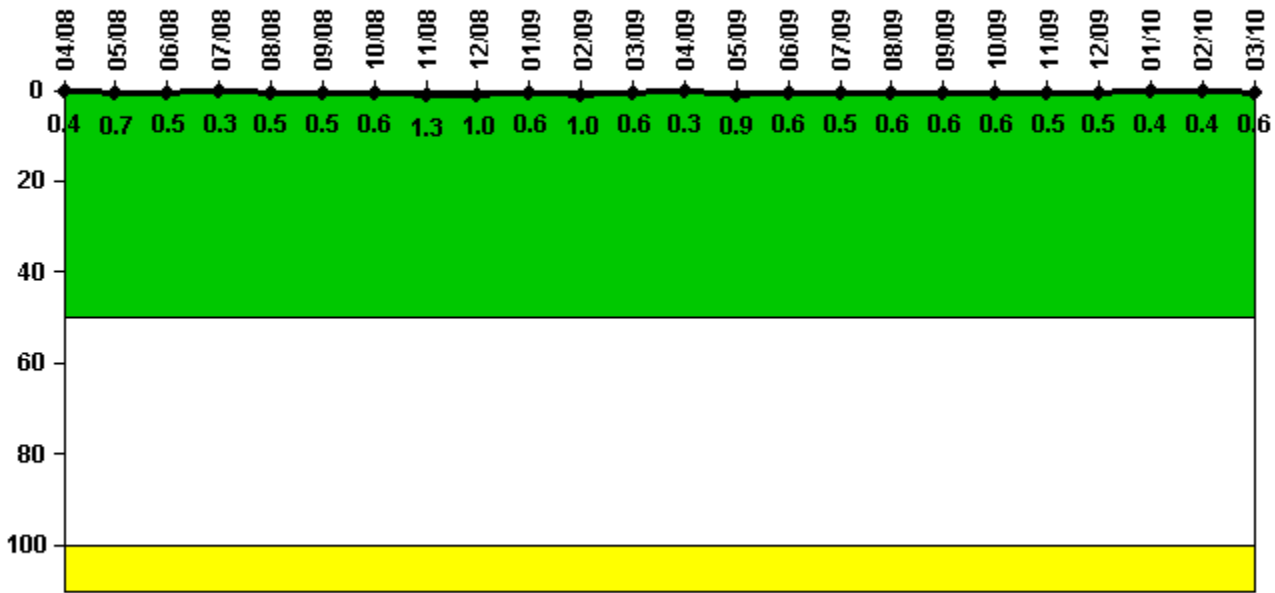


Thresholds: White > 50.0 Yellow > 100.0

### Notes

<b>Reactor Coolant System Leakage</b>	<b>4/08</b>	<b>5/08</b>	<b>6/08</b>	<b>7/08</b>	<b>8/08</b>	<b>9/08</b>	<b>10/08</b>	<b>11/08</b>	<b>12/08</b>	<b>1/09</b>	<b>2/09</b>	<b>3/09</b>
Maximum leakage	0.041	0.071	0.050	0.033	0.051	0.045	0.062	0.132	0.099	0.064	0.099	0.064
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.7	0.5	0.3	0.5	0.5	0.6	1.3	1.0	0.6	1.0	0.6
<b>Reactor Coolant System Leakage</b>	<b>4/09</b>	<b>5/09</b>	<b>6/09</b>	<b>7/09</b>	<b>8/09</b>	<b>9/09</b>	<b>10/09</b>	<b>11/09</b>	<b>12/09</b>	<b>1/10</b>	<b>2/10</b>	<b>3/10</b>
Maximum leakage	0.032	0.086	0.056	0.052	0.061	0.063	0.064	0.053	0.049	0.044	0.042	0.058
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.9	0.6	0.5	0.6	0.6	0.6	0.5	0.5	0.4	0.4	0.6

Licensee Comments: none

## Drill/Exercise Performance

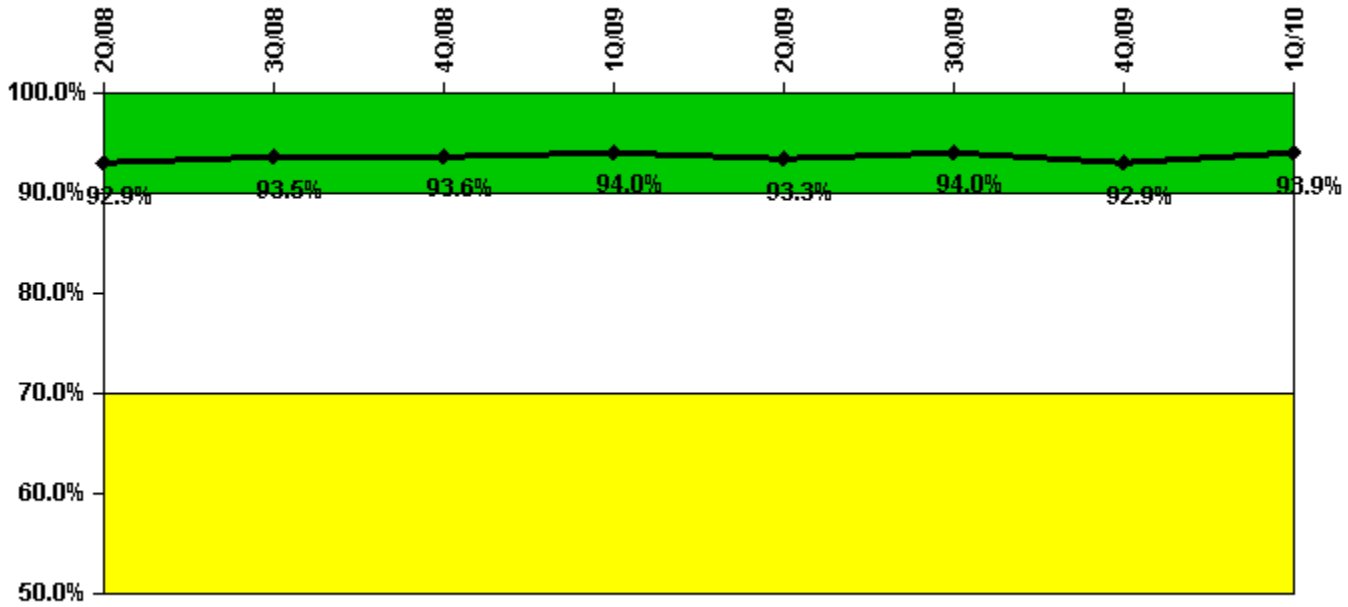


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Successful opportunities	18.0	31.0	8.0	43.0	0	24.0	16.0	30.0
Total opportunities	23.0	34.0	8.0	44.0	0	24.0	18.0	30.0
Indicator value	92.9%	93.5%	93.6%	94.0%	93.3%	94.0%	92.9%	93.9%

Licensee Comments: none

## ERO Drill Participation

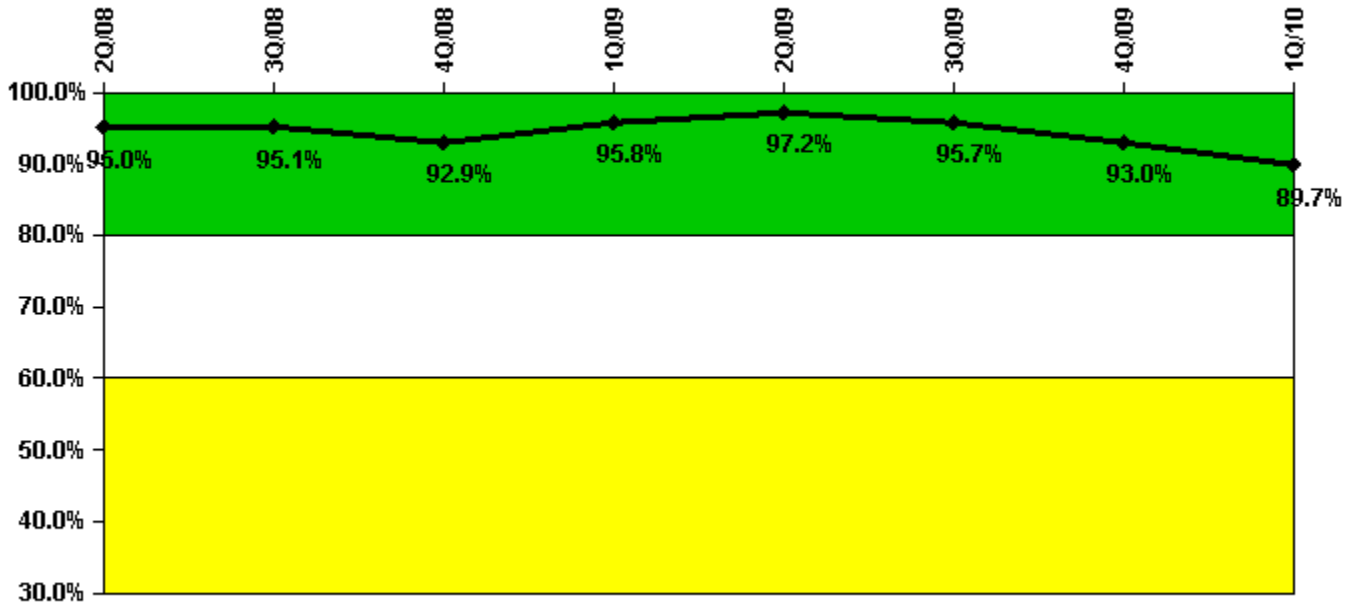


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Participating Key personnel	134.0	137.0	130.0	136.0	141.0	133.0	132.0	122.0
Total Key personnel	141.0	144.0	140.0	142.0	145.0	139.0	142.0	136.0
Indicator value	95.0%	95.1%	92.9%	95.8%	97.2%	95.7%	93.0%	89.7%

Licensee Comments: none

# Alert & Notification System

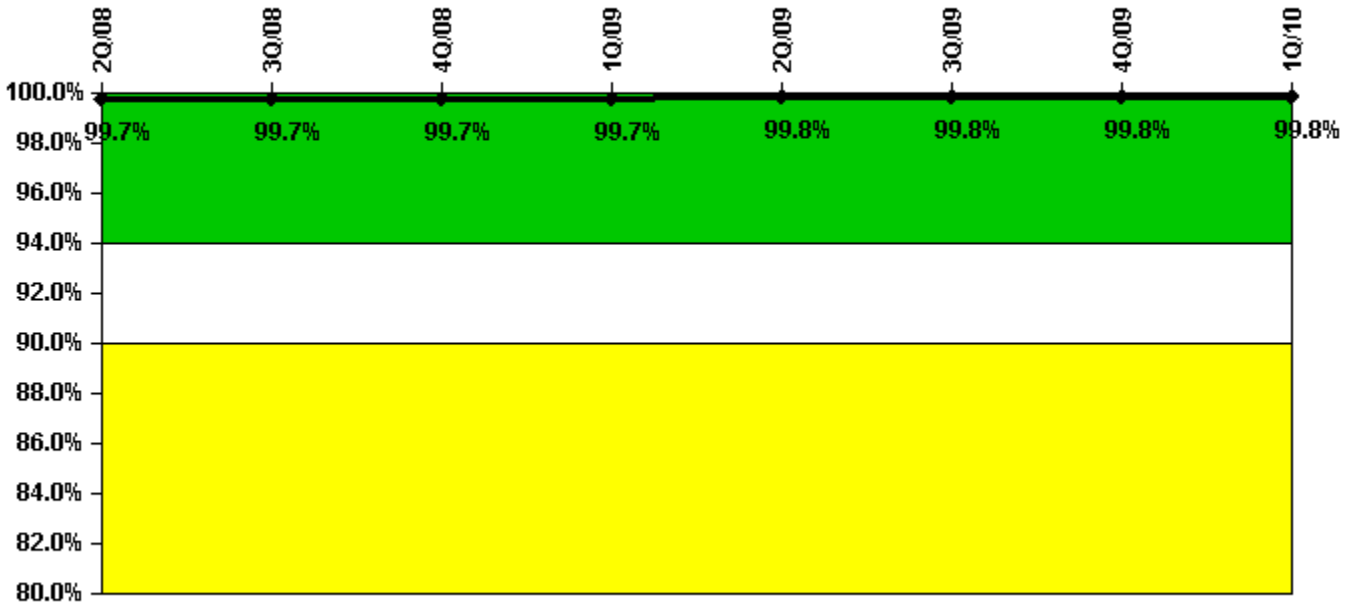

Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Successful siren-tests	1619	1622	1685	1748	1754	1751	1753	1749
Total sirens-tests	1625	1625	1690	1755	1755	1755	1755	1755
Indicator value	99.7%	99.7%	99.7%	99.7%	99.8%	99.8%	99.8%	99.8%

Licensee Comments: none

# Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

---

# RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.