


Palisades

1Q/2010 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

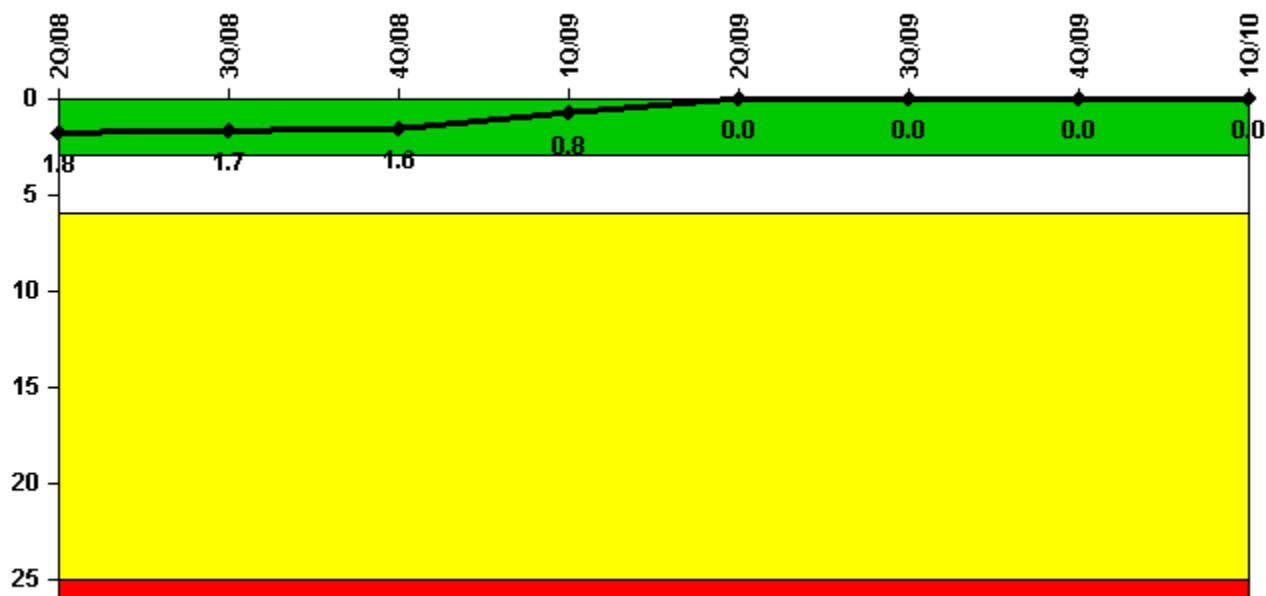


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Unplanned scrams	1.0	0	0	0	0	0	0	0
Critical hours	2158.1	2113.1	2209.0	1853.5	1522.5	2208.0	2209.0	2159.0
Indicator value	1.8	1.7	1.6	0.8	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

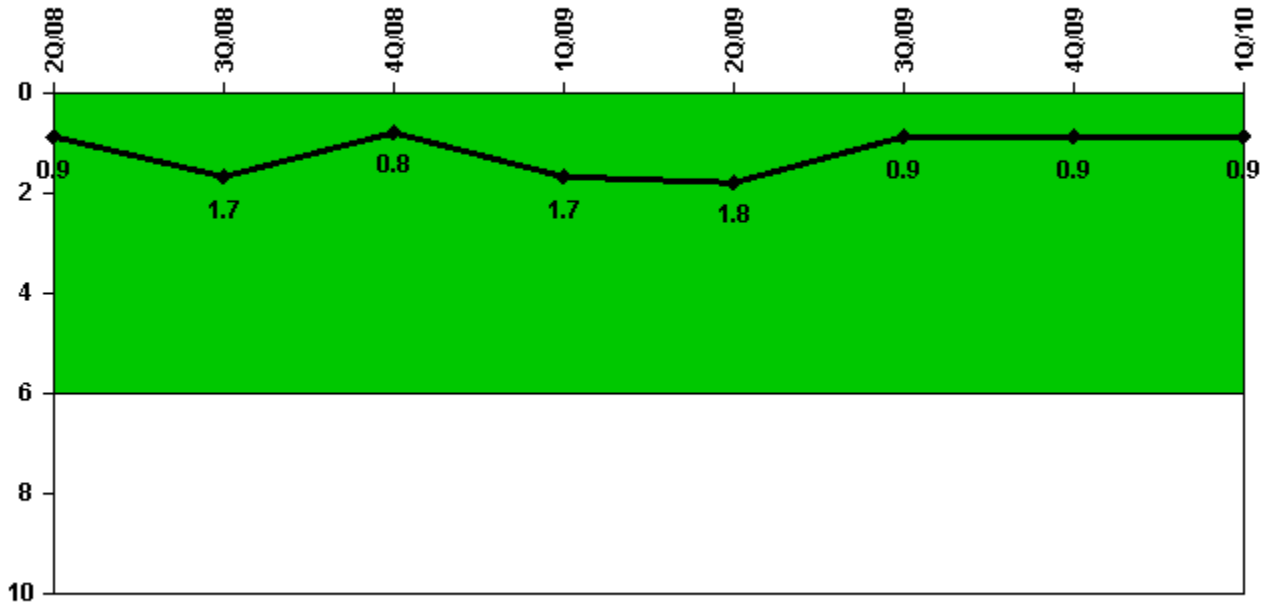


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Unplanned power changes	0	1.0	0	1.0	0	0	0	1.0
Critical hours	2158.1	2113.1	2209.0	1853.5	1522.5	2208.0	2209.0	2159.0
Indicator value	0.9	1.7	0.8	1.7	1.8	0.9	0.9	0.9

Licensee Comments: none

Unplanned Scrams with Complications

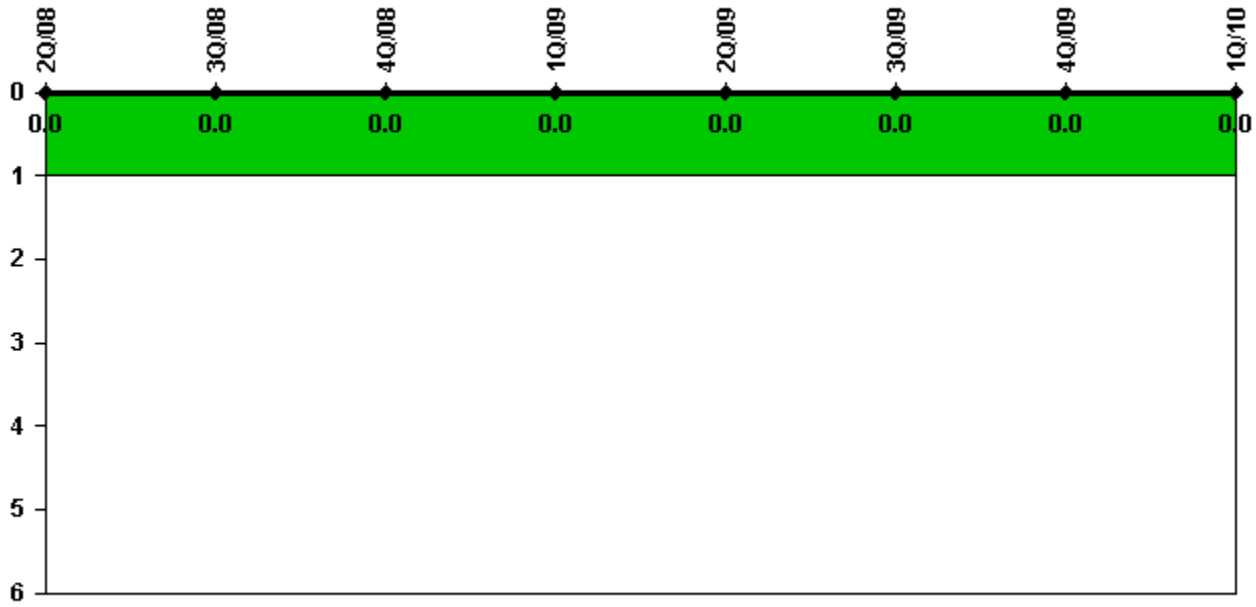


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

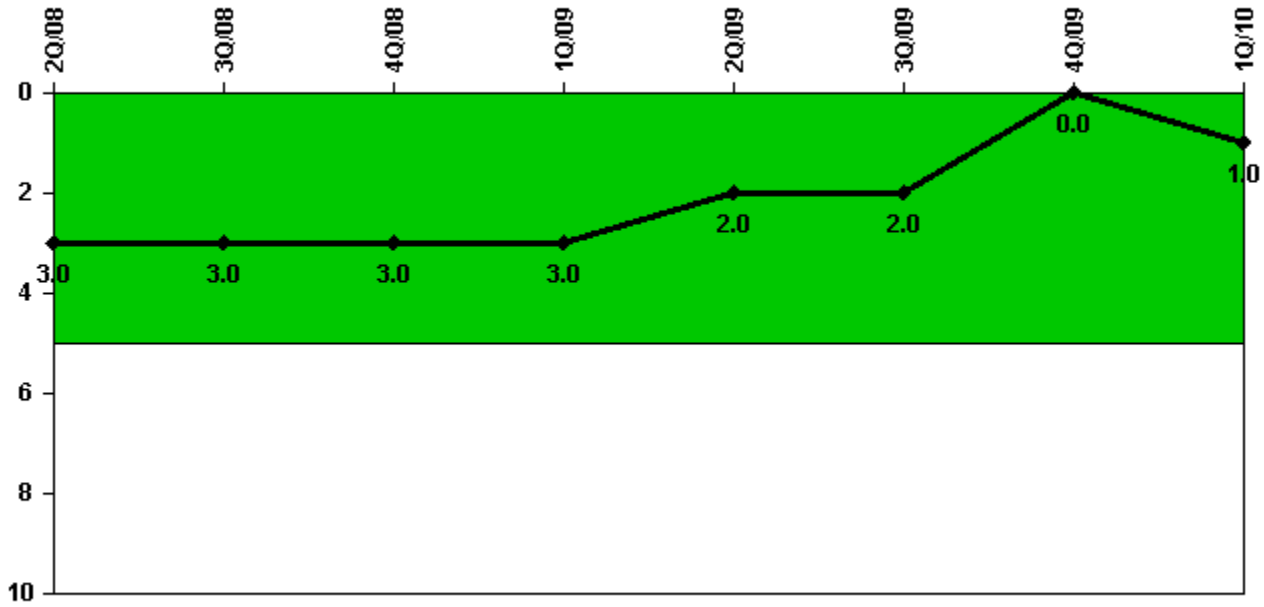

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Safety System Functional Failures	1	0	2	0	0	0	0	1
Indicator value	3	3	3	3	2	2	0	1

Licensee Comments:

1Q/10: March 2010, LER 2010-001-00 Potential Loss of Safety Function Due to a Service Water Pump Shaft Coupling Failure

Mitigating Systems Performance Index, Emergency AC Power System

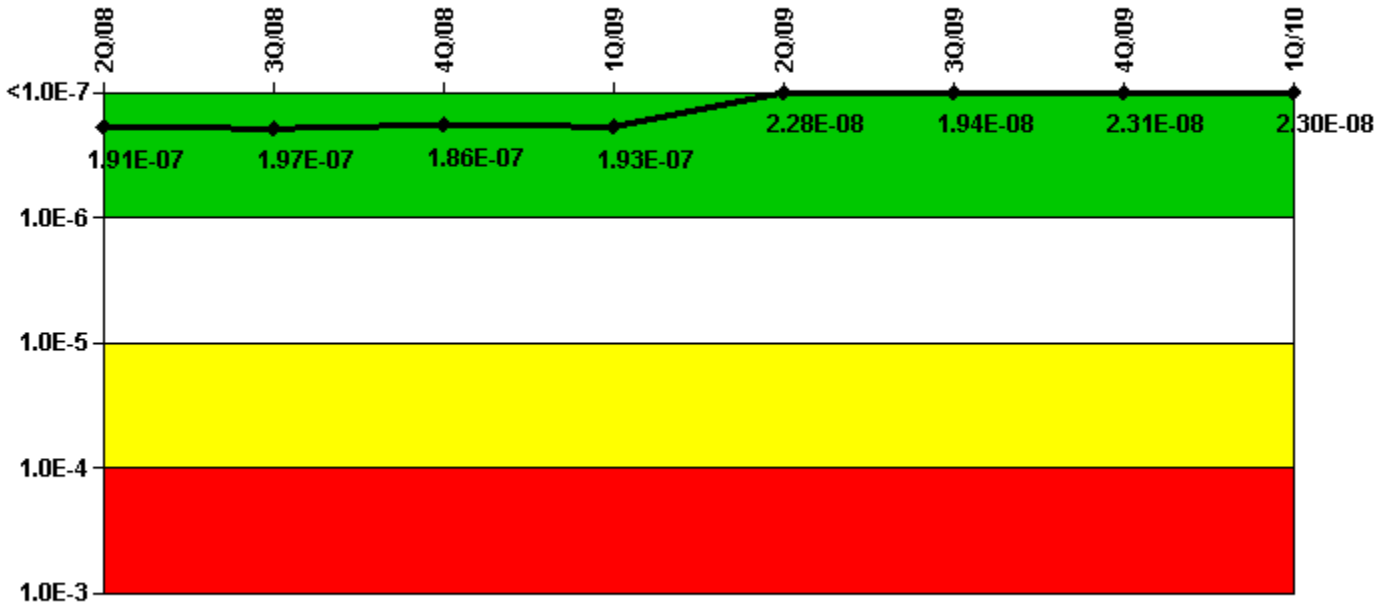


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI (Δ CDF)	4.10E-08	4.70E-08	3.60E-08	4.30E-08	3.00E-08	2.60E-08	2.90E-08	2.82E-08
URI (Δ CDF)	1.50E-07	1.50E-07	1.50E-07	1.50E-07	-7.20E-09	-6.60E-09	-5.90E-09	-5.21E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.91E-07	1.97E-07	1.86E-07	1.93E-07	2.28E-08	1.94E-08	2.31E-08	2.30E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

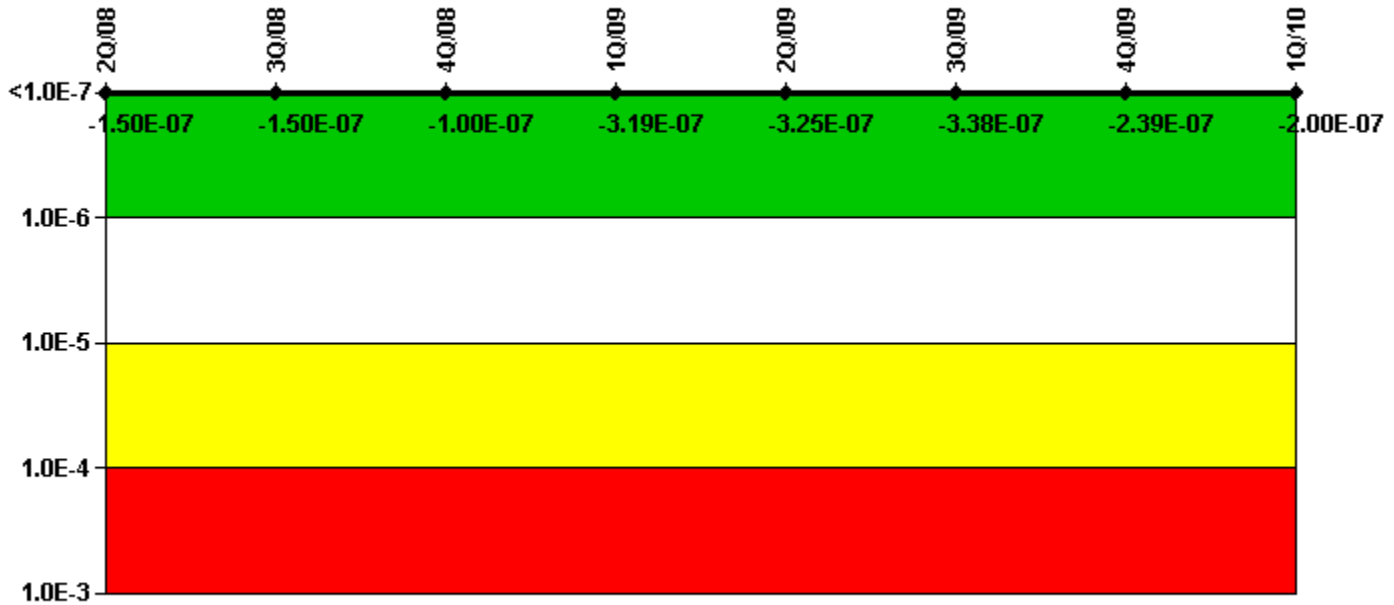


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI (Δ CDF)	1.20E-07	1.20E-07	1.70E-07	-4.90E-08	-5.50E-08	-6.80E-08	3.10E-08	6.09E-08
URI (Δ CDF)	-2.70E-07	-2.70E-07	-2.70E-07	-2.70E-07	-2.70E-07	-2.70E-07	-2.70E-07	-2.65E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.50E-07	-1.50E-07	-1.00E-07	-3.19E-07	-3.25E-07	-3.38E-07	-2.39E-07	-2.00E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

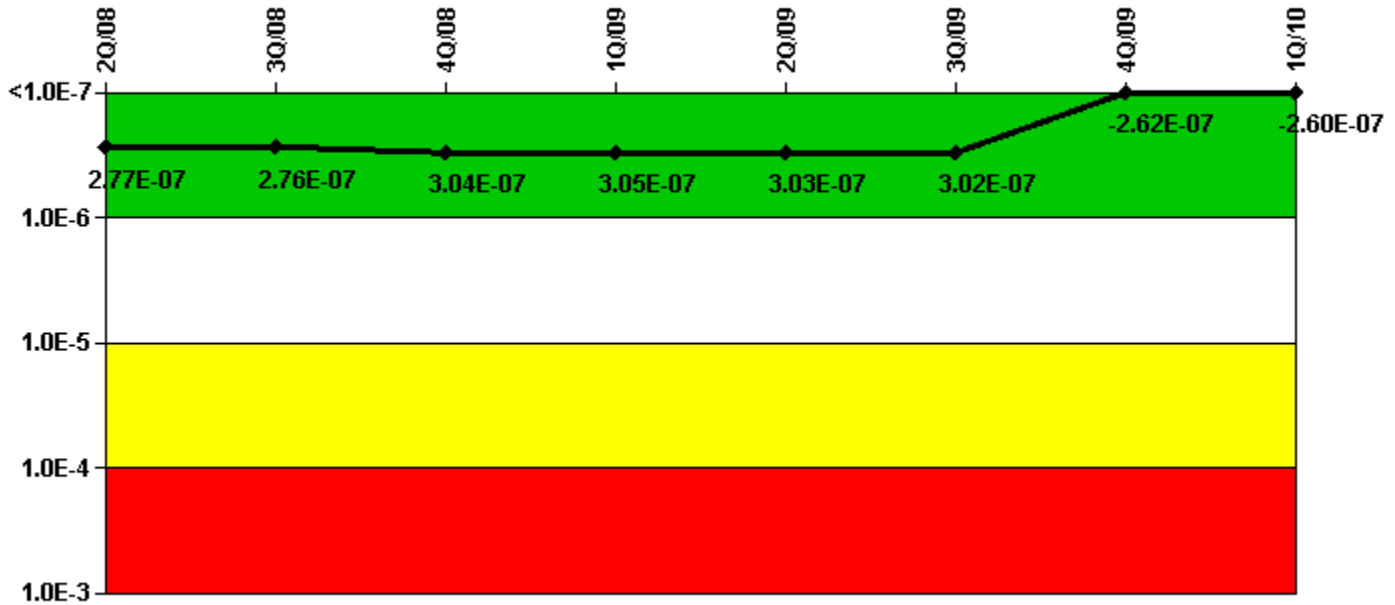


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI (Δ CDF)	-3.30E-09	-3.60E-09	2.40E-08	2.50E-08	2.30E-08	2.20E-08	1.80E-08	2.03E-08
URI (Δ CDF)	2.80E-07	2.80E-07	2.80E-07	2.80E-07	2.80E-07	2.80E-07	-2.80E-07	-2.77E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.77E-07	2.76E-07	3.04E-07	3.05E-07	3.03E-07	3.02E-07	-2.62E-07	-2.60E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

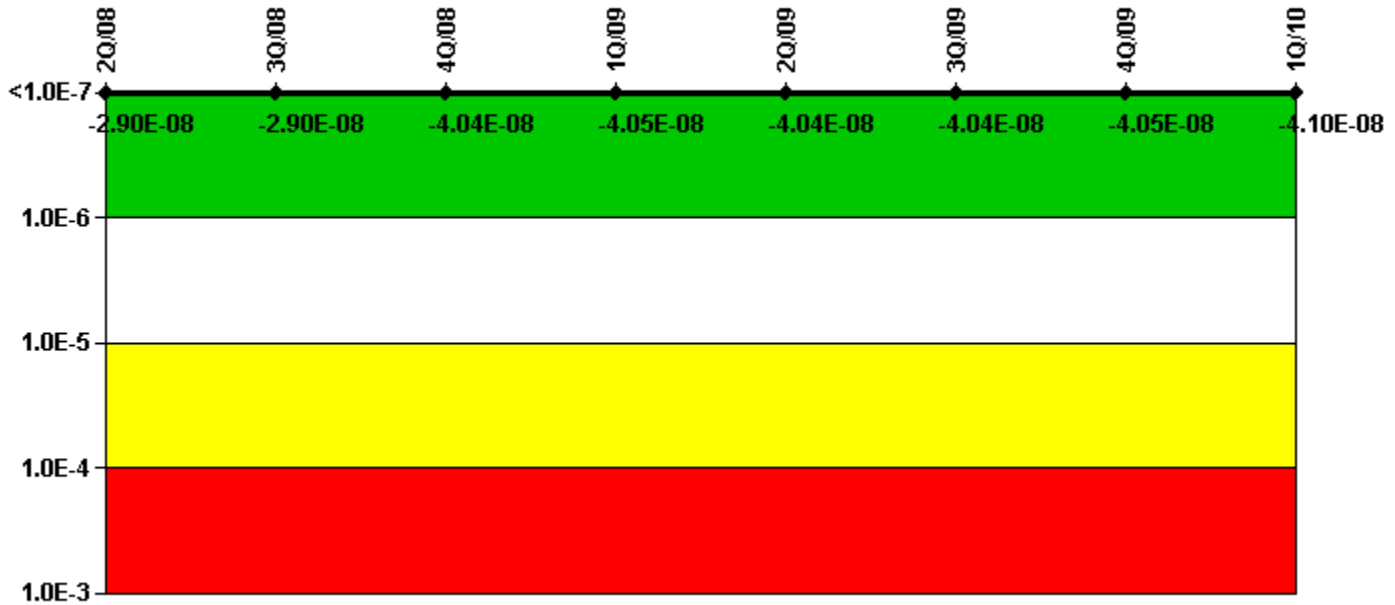


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI (Δ CDF)	1.10E-08	1.10E-08	-3.90E-10	-4.80E-10	-3.60E-10	-4.10E-10	-4.80E-10	-3.39E-10
URI (Δ CDF)	-4.00E-08	-4.00E-08	-4.00E-08	-4.00E-08	-4.00E-08	-4.00E-08	-4.00E-08	-4.04E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.90E-08	-2.90E-08	-4.04E-08	-4.05E-08	-4.04E-08	-4.04E-08	-4.05E-08	-4.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

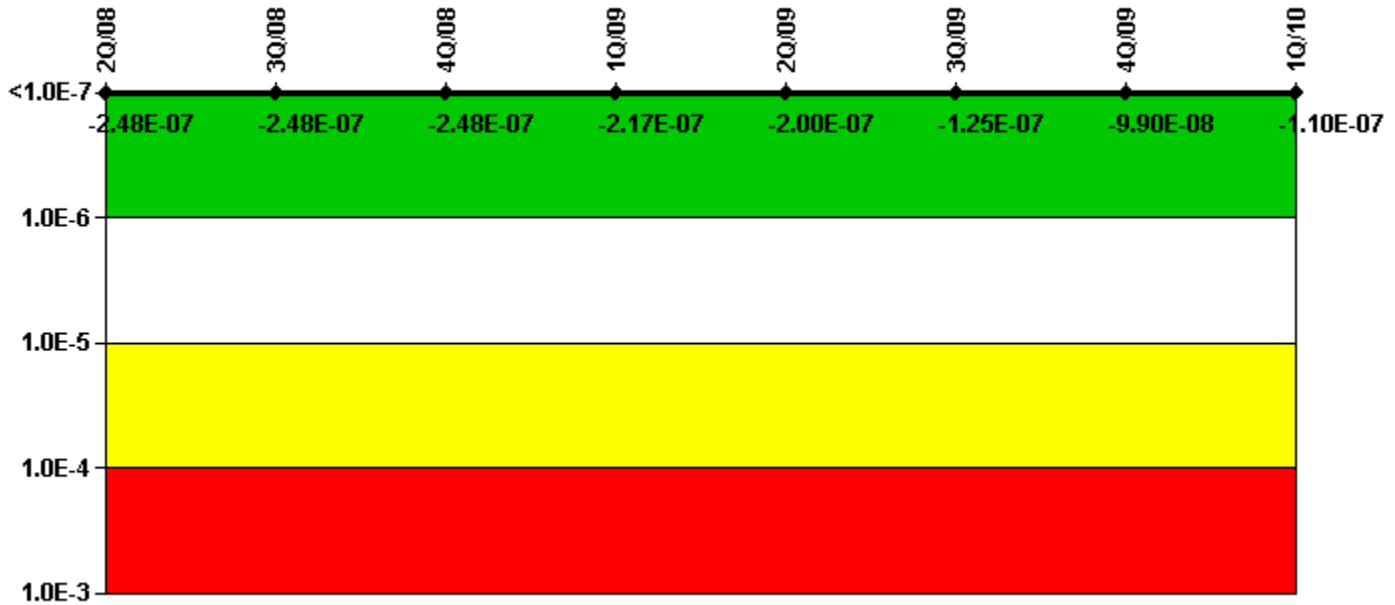


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
UAI (Δ CDF)	-2.80E-08	-2.80E-08	-2.80E-08	1.30E-08	3.00E-08	5.50E-08	8.10E-08	7.05E-08
URI (Δ CDF)	-2.20E-07	-2.20E-07	-2.20E-07	-2.30E-07	-2.30E-07	-1.80E-07	-1.80E-07	-1.84E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.48E-07	-2.48E-07	-2.48E-07	-2.17E-07	-2.00E-07	-1.25E-07	-9.90E-08	-1.10E-07

Licensee Comments: none

Reactor Coolant System Activity

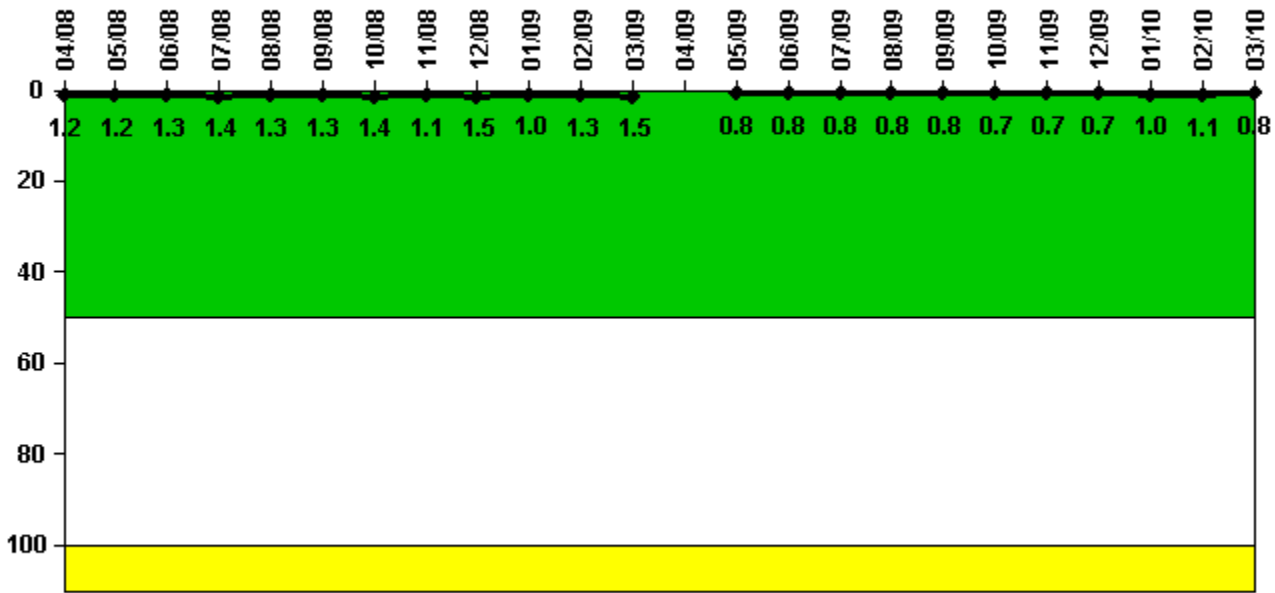


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum activity	0.011500	0.012200	0.012900	0.014000	0.013200	0.013200	0.013700	0.010800	0.014600	0.010400	0.013200	0.014800
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	1.2	1.2	1.3	1.4	1.3	1.3	1.4	1.1	1.5	1.0	1.3	1.5
Reactor Coolant System Activity	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum activity	N/A	0.007570	0.007680	0.008310	0.008260	0.008190	0.007360	0.007120	0.007170	0.010300	0.011000	0.007520
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	N/A	0.8	0.8	0.8	0.8	0.8	0.7	0.7	0.7	1.0	1.1	0.8

Licensee Comments: none

Reactor Coolant System Leakage

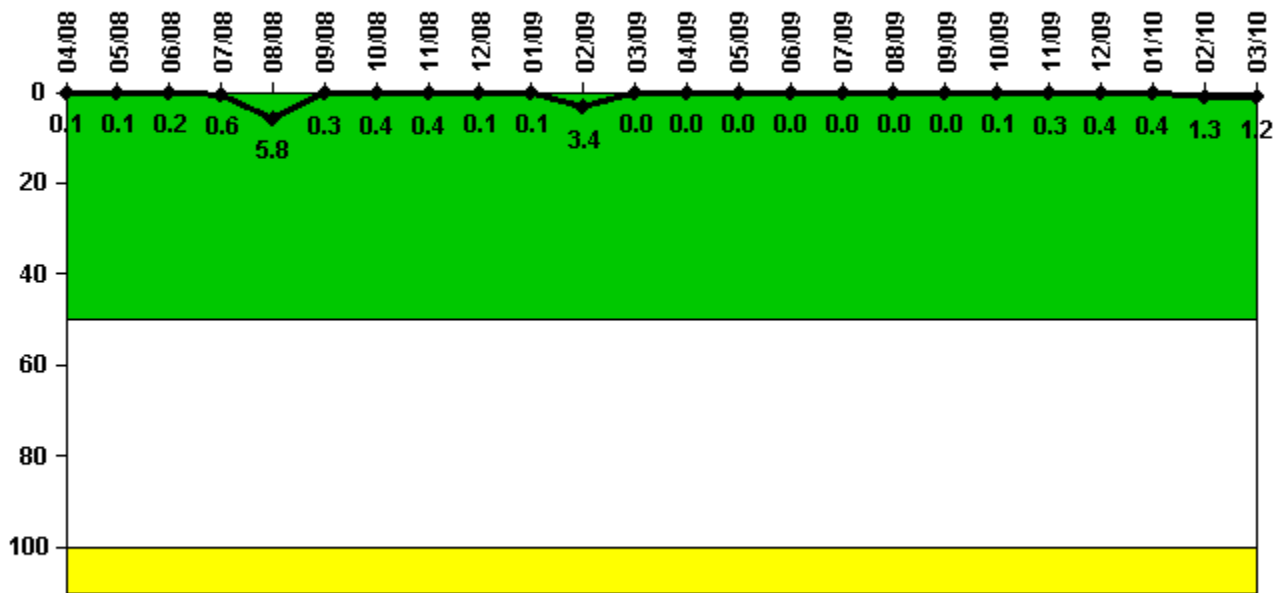


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09
Maximum leakage	0.007	0.008	0.017	0.055	0.576	0.029	0.040	0.040	0.007	0.013	0.341	0.001
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.1	0.2	0.6	5.8	0.3	0.4	0.4	0.1	0.1	3.4	0
Reactor Coolant System Leakage	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum leakage	0	0.003	0.003	0.003	0.004	0.003	0.013	0.026	0.037	0.037	0.132	0.119
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0	0	0	0	0	0	0.1	0.3	0.4	0.4	1.3	1.2

Licensee Comments: none

Drill/Exercise Performance

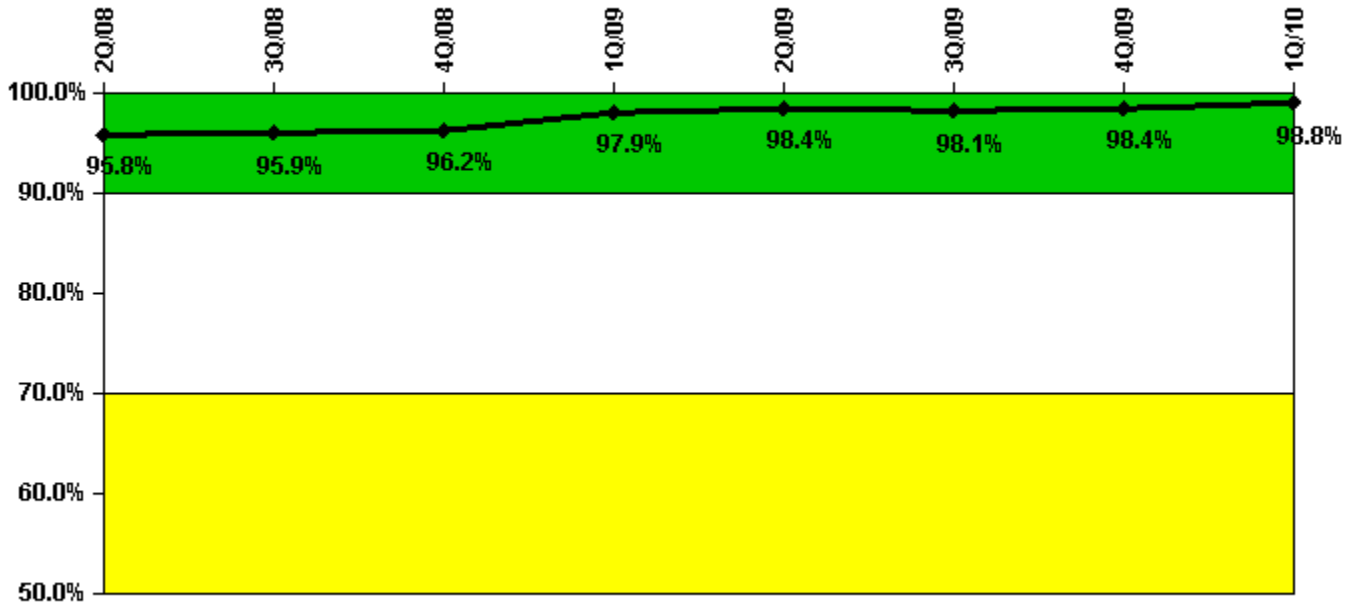


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Successful opportunities	42.0	44.0	45.0	65.0	12.0	23.0	22.0	89.0
Total opportunities	42.0	44.0	46.0	66.0	12.0	24.0	22.0	90.0
Indicator value	95.8%	95.9%	96.2%	97.9%	98.4%	98.1%	98.4%	98.8%

Licensee Comments: none

ERO Drill Participation

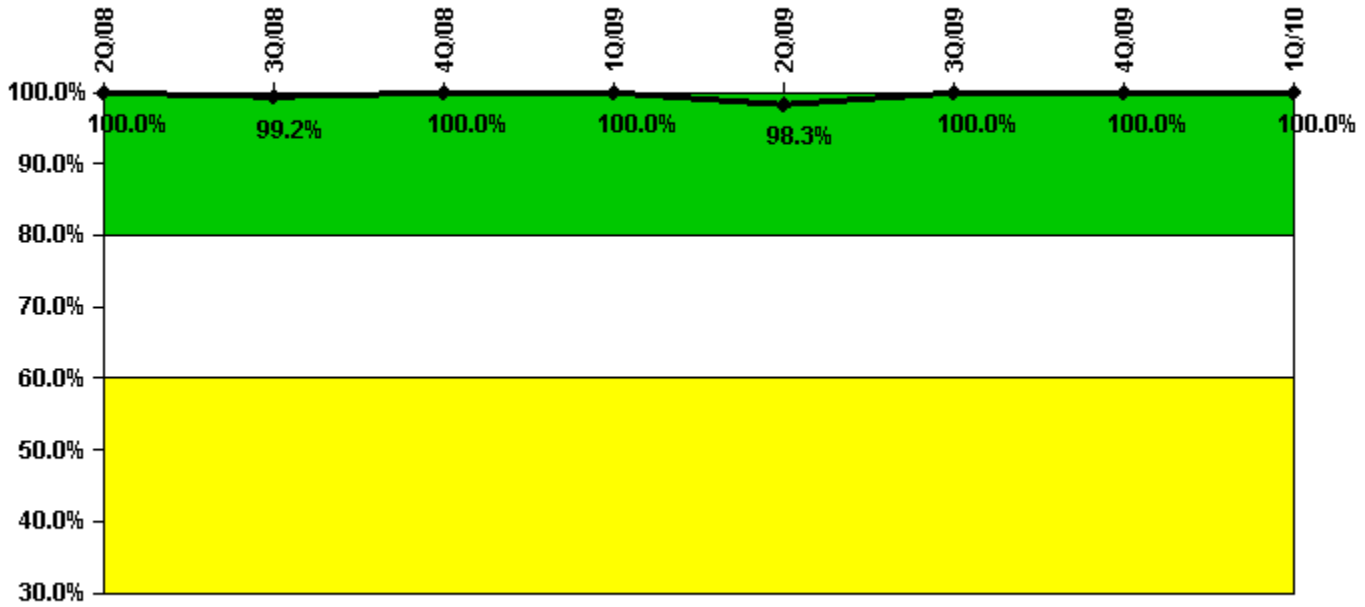


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Participating Key personnel	112.0	119.0	118.0	120.0	113.0	122.0	123.0	75.0
Total Key personnel	112.0	120.0	118.0	120.0	115.0	122.0	123.0	75.0
Indicator value	100.0%	99.2%	100.0%	100.0%	98.3%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

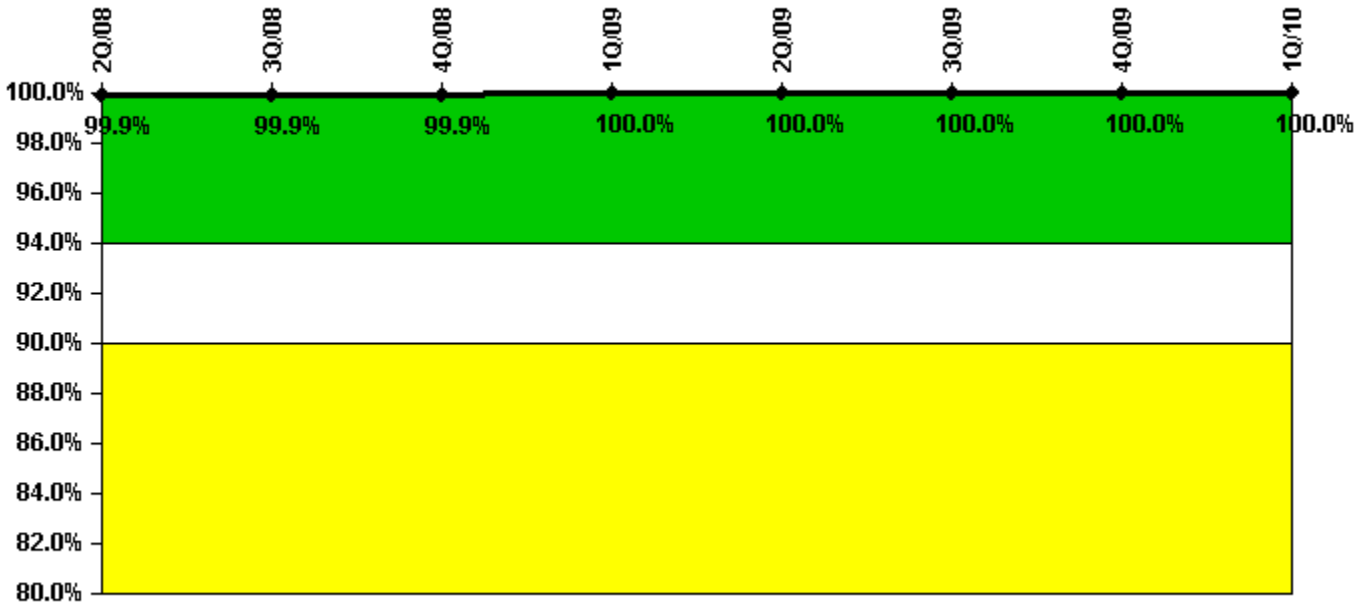


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
Successful siren-tests	183	183	183	183	183	183	183	183
Total sirens-tests	183	183	183	183	183	183	183	183
Indicator value	99.9%	99.9%	99.9%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

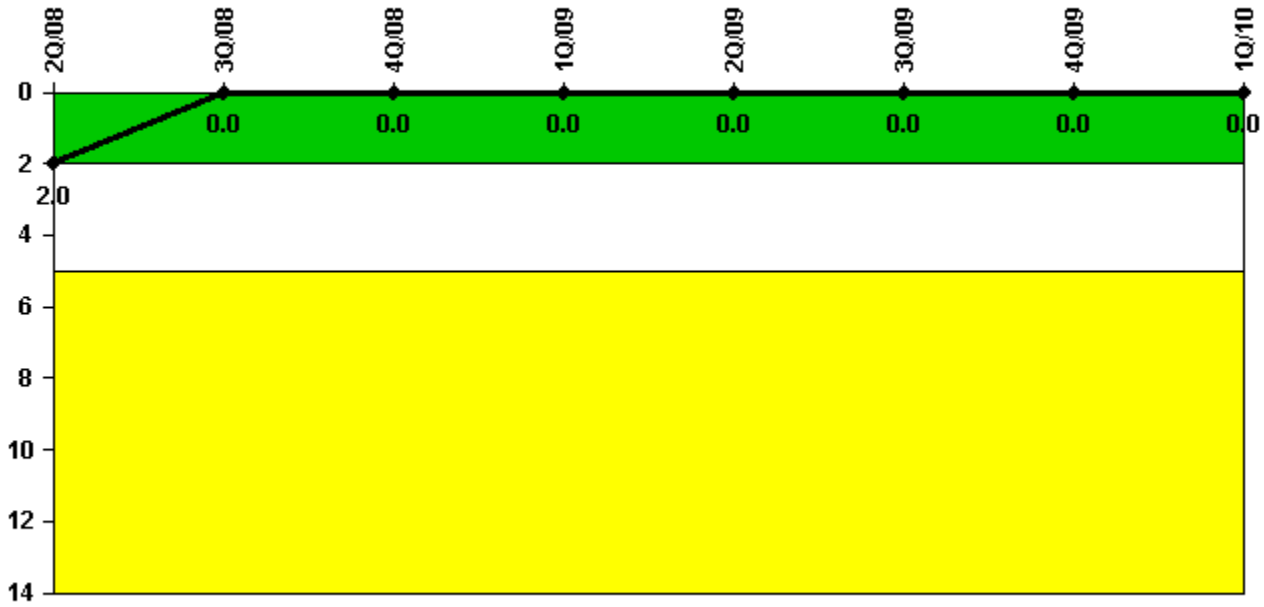


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	2	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

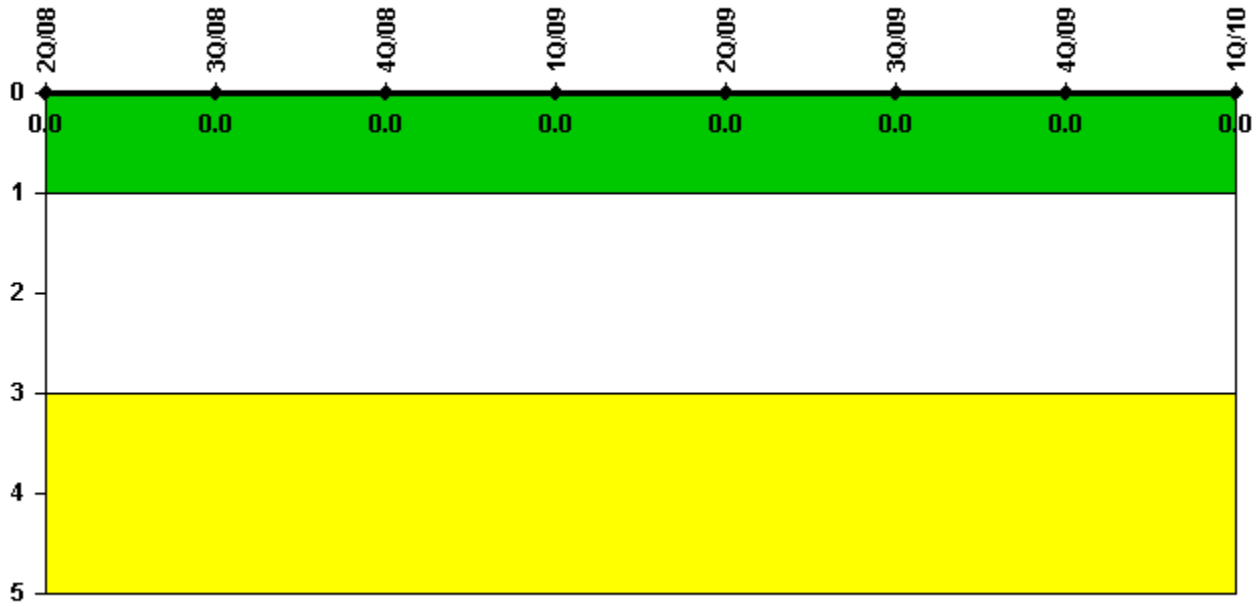

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/08	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.