


Hatch 2

2Q/2010 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

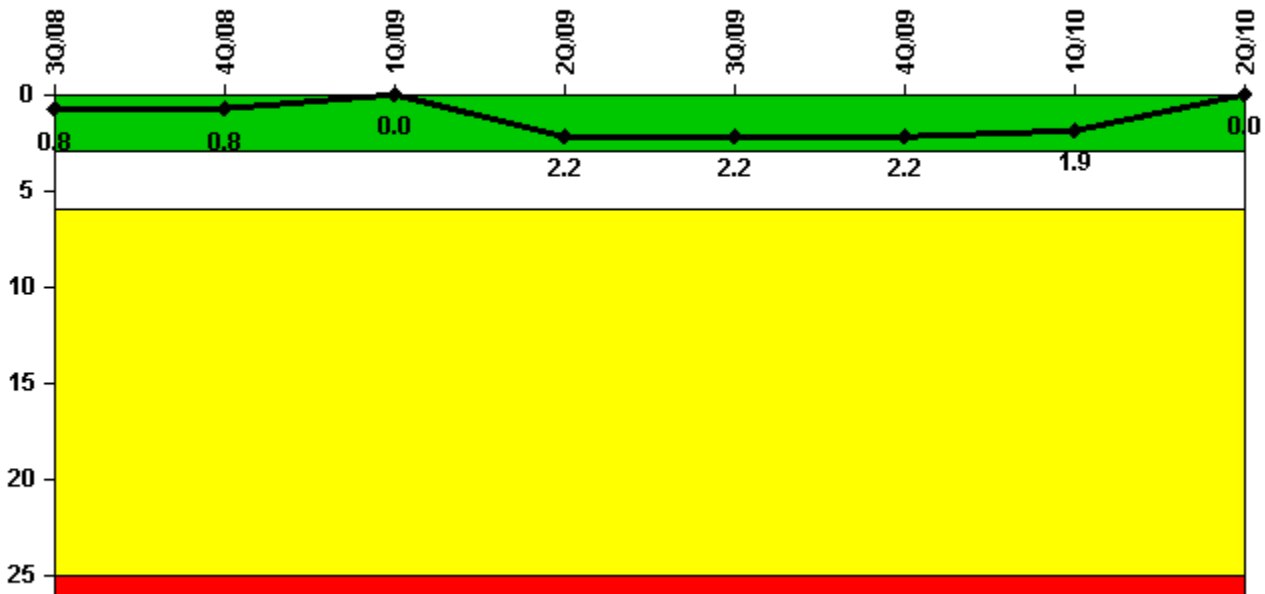


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Unplanned scrams	0	0	0	2.0	0	0	0	0
Critical hours	2208.0	2209.0	937.3	877.2	2208.0	2209.0	2159.0	1925.1
Indicator value	0.8	0.8	0	2.2	2.2	2.2	1.9	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

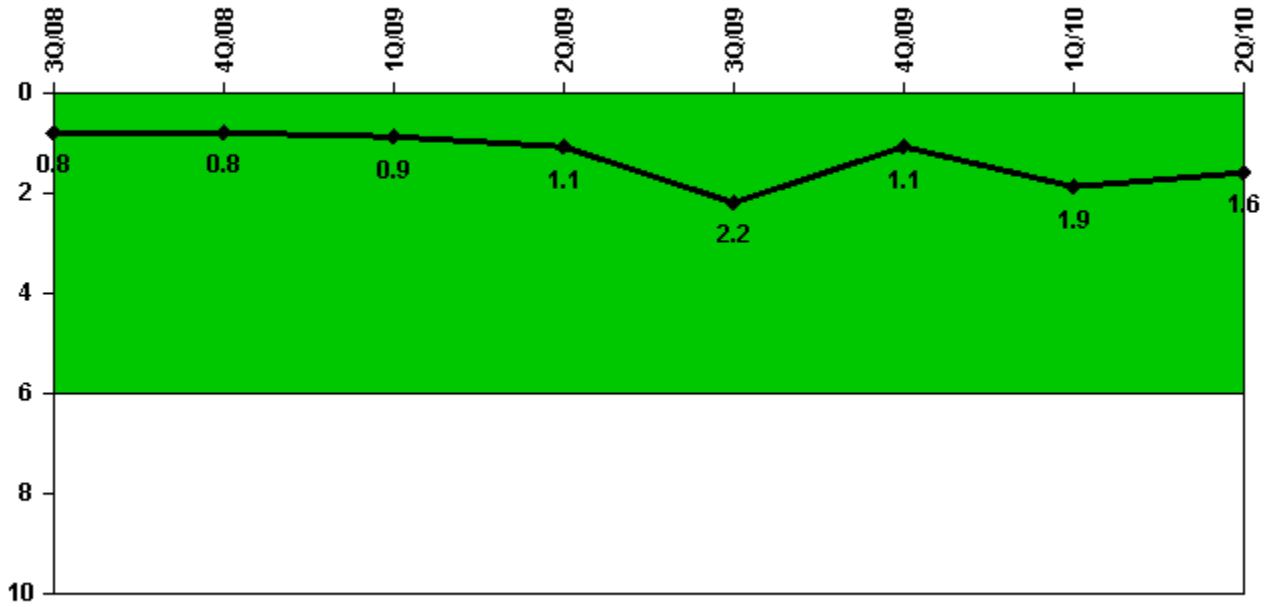


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Unplanned power changes	0	1.0	0	0	1.0	0	1.0	0
Critical hours	2208.0	2209.0	937.3	877.2	2208.0	2209.0	2159.0	1925.1
Indicator value	0.8	0.8	0.9	1.1	2.2	1.1	1.9	1.6

Licensee Comments: none

Unplanned Scrams with Complications

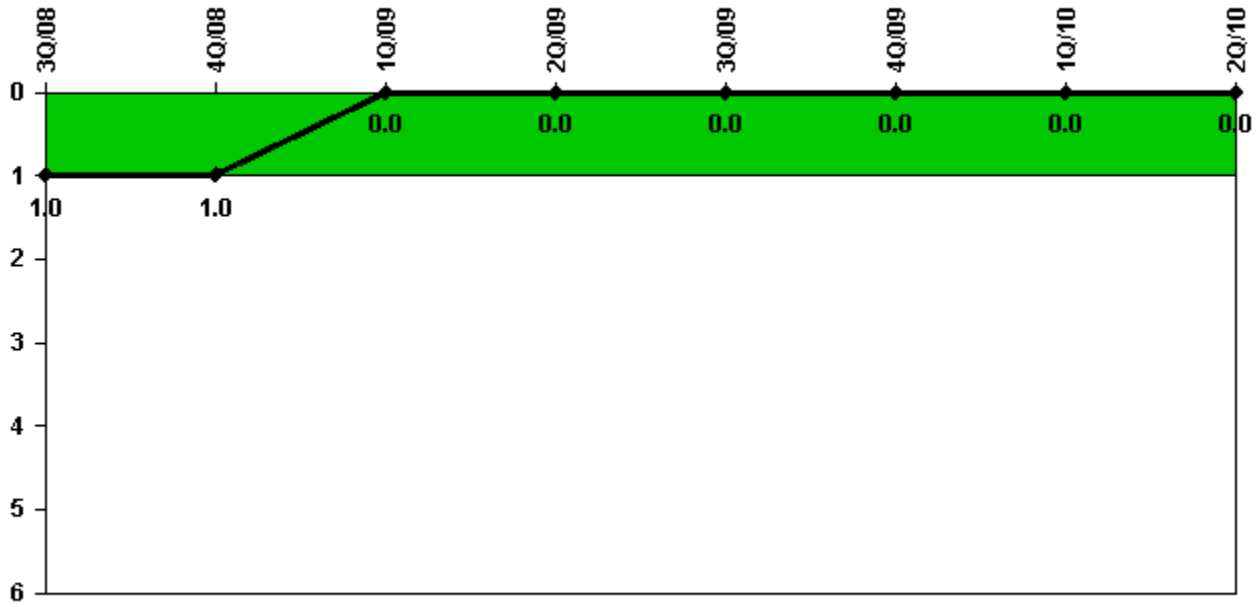


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

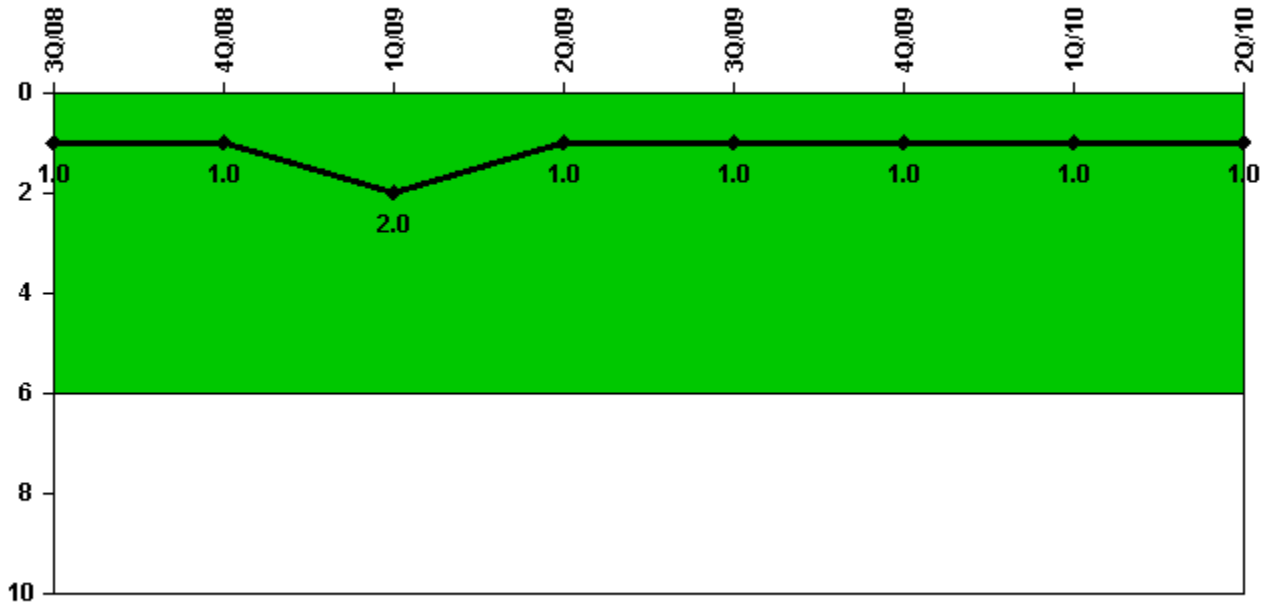


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Safety System Functional Failures	0	0	1	0	0	0	1	0
Indicator value	1	1	2	1	1	1	1	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

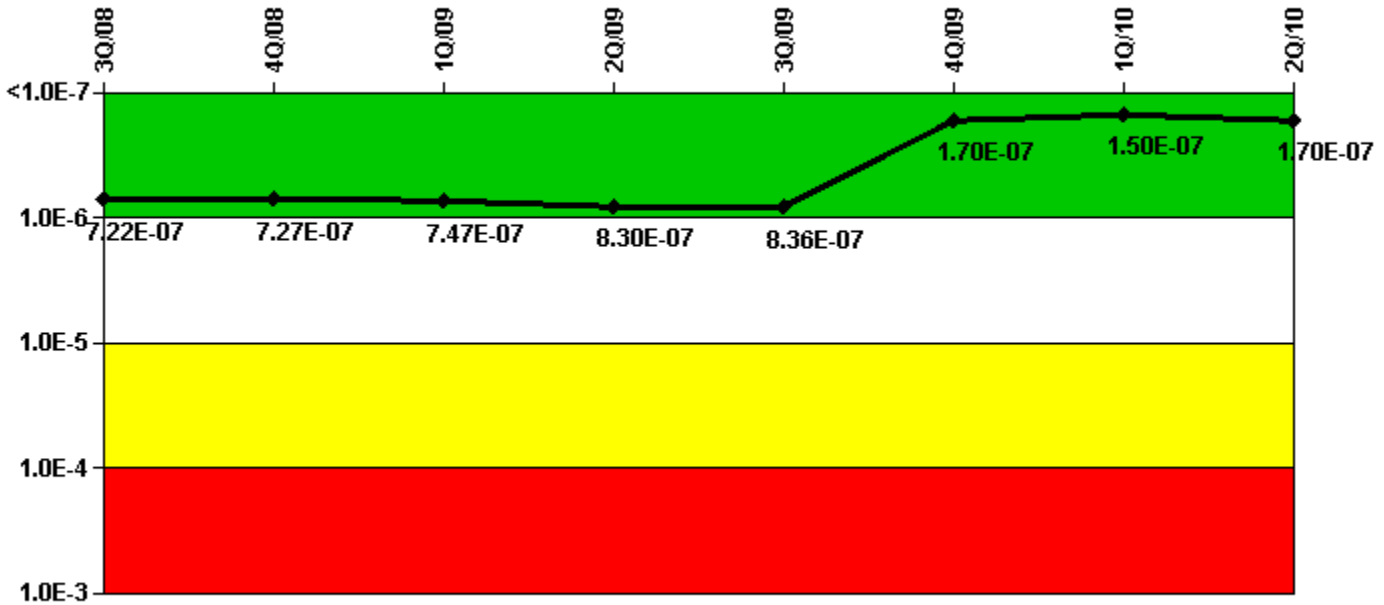

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI (ΔCDF)	6.20E-08	6.70E-08	8.70E-08	6.00E-08	6.60E-08	8.56E-08	8.26E-08	9.03E-08
URI (ΔCDF)	6.60E-07	6.60E-07	6.60E-07	7.70E-07	7.70E-07	8.04E-08	7.13E-08	7.51E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.22E-07	7.27E-07	7.47E-07	8.30E-07	8.36E-07	1.70E-07	1.50E-07	1.70E-07

Licensee Comments:

2Q/10: Risk Cap Invoked.

4Q/09: Risk Cap Invoked. One Diesel event under evaluation (CR2009112068). Update: The engineering evaluation is complete and this event was determined not to be a failure.

Mitigating Systems Performance Index, High Pressure Injection System

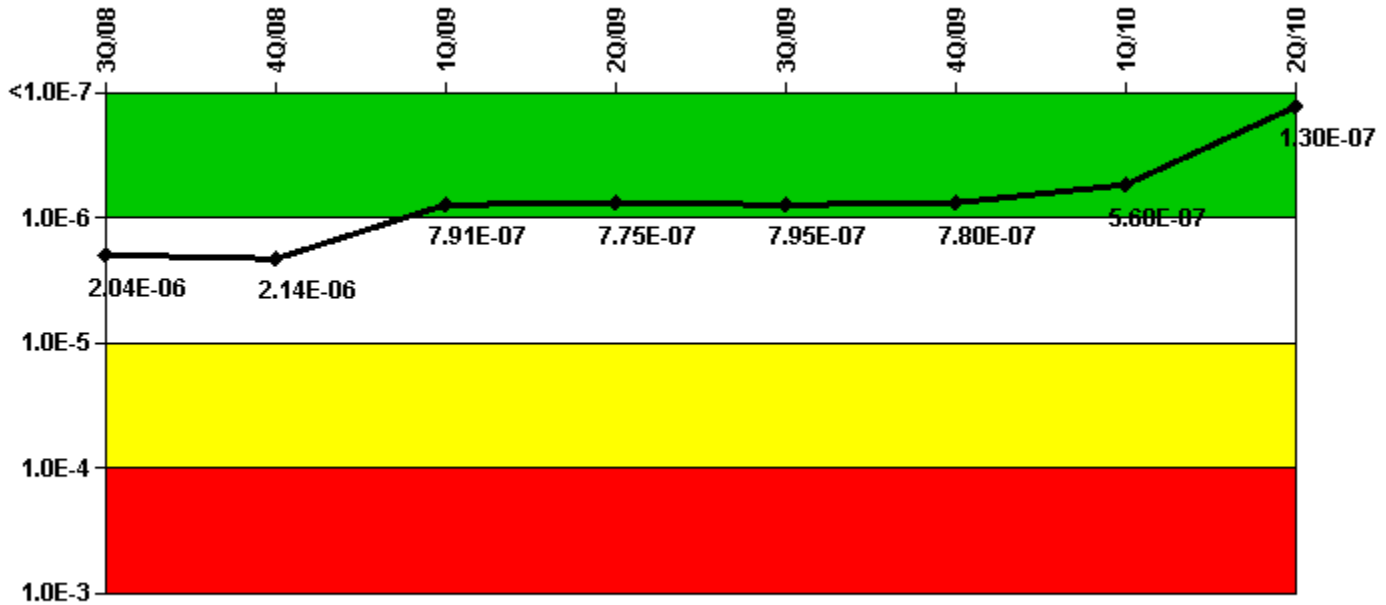

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI (ΔCDF)	3.70E-08	3.70E-08	1.10E-08	-4.80E-09	-4.80E-09	-4.81E-09	-1.40E-08	-2.62E-08
URI (ΔCDF)	2.00E-06	2.10E-06	7.80E-07	7.80E-07	8.00E-07	7.82E-07	5.70E-07	1.52E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.04E-06	2.14E-06	7.91E-07	7.75E-07	7.95E-07	7.80E-07	5.60E-07	1.30E-07

Licensee Comments:

4Q/09: One HPCI event is under evaluation (CR2009111523). Update: The engineering evaluation is complete and this event was determined not to be a failure.

Mitigating Systems Performance Index, Heat Removal System

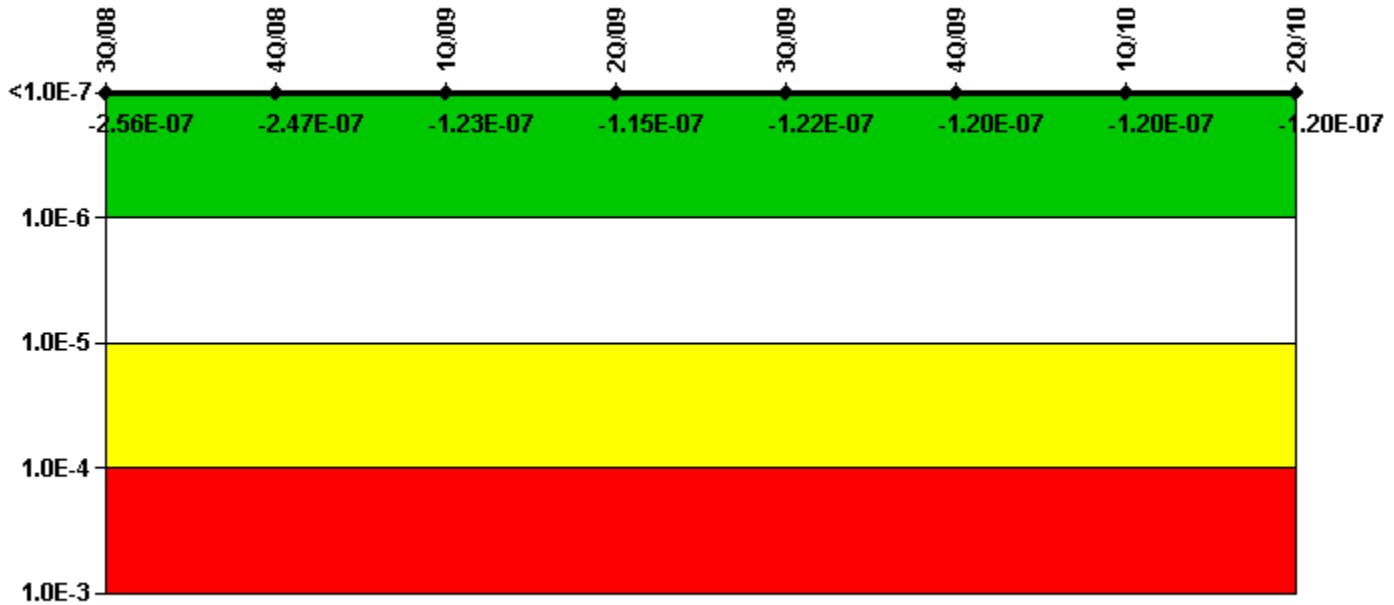

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI (Δ CDF)	-6.60E-08	-6.70E-08	-3.50E-08	-3.20E-08	-4.00E-08	-3.95E-08	-3.96E-08	-3.96E-08
URI (Δ CDF)	-1.90E-07	-1.80E-07	-8.80E-08	-8.30E-08	-8.20E-08	-8.15E-08	-7.91E-08	-7.92E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.56E-07	-2.47E-07	-1.23E-07	-1.15E-07	-1.22E-07	-1.20E-07	-1.20E-07	-1.20E-07

Licensee Comments:

4Q/09: One RCIC event is under evaluation (CR2009111523). Update: The engineering evaluation is complete and this event was determined not to be a failure.

Mitigating Systems Performance Index, Residual Heat Removal System

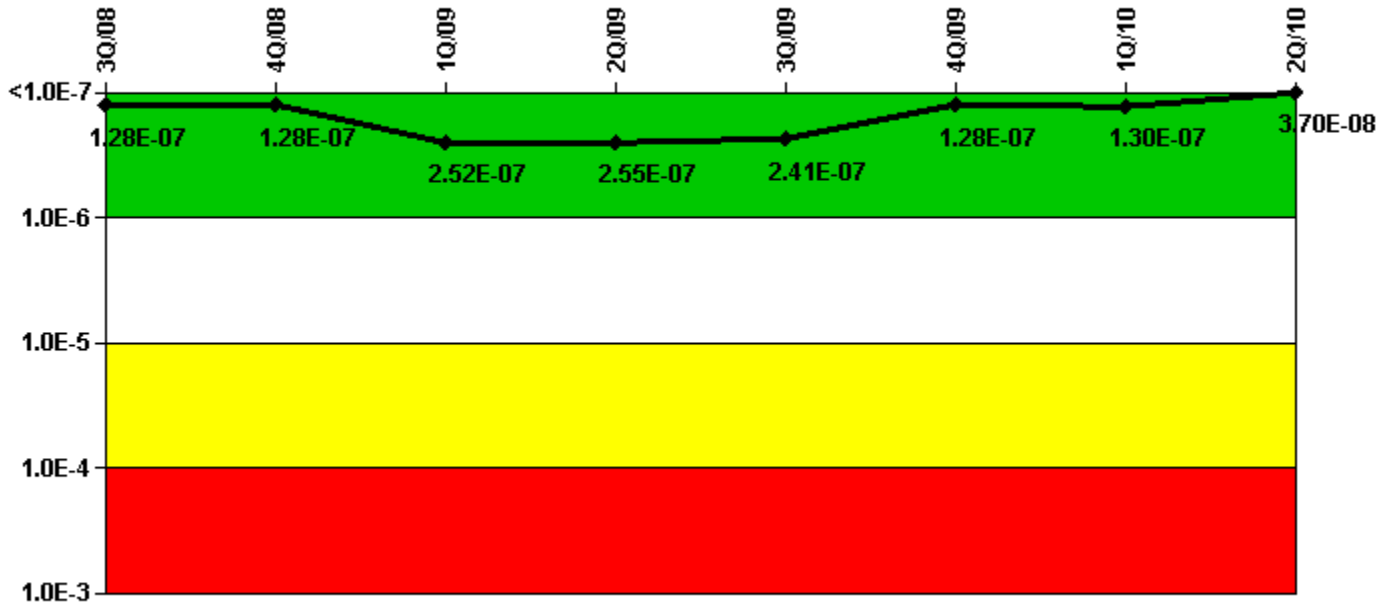


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI (Δ CDF)	1.80E-08	1.80E-08	2.20E-08	2.50E-08	1.10E-08	-2.20E-09	-3.80E-09	8.17E-09
URI (Δ CDF)	1.10E-07	1.10E-07	2.30E-07	2.30E-07	2.30E-07	1.30E-07	1.34E-07	2.89E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.28E-07	1.28E-07	2.52E-07	2.55E-07	2.41E-07	1.28E-07	1.30E-07	3.70E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

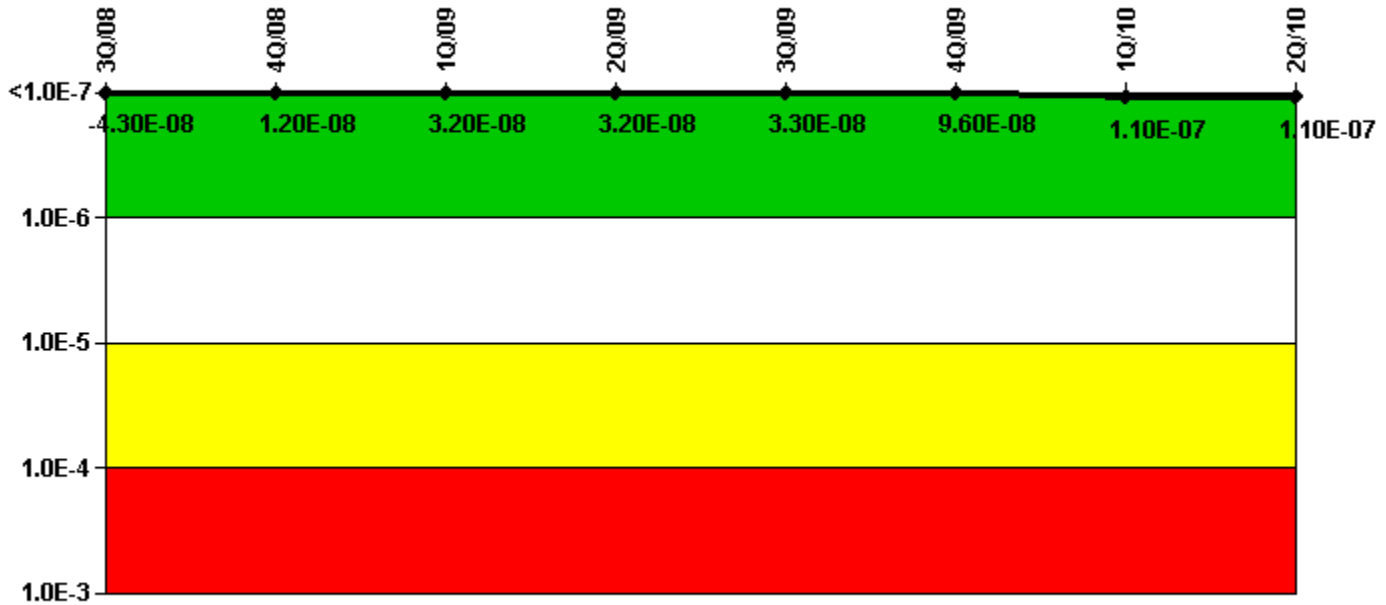


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI (Δ CDF)	4.40E-08	4.50E-08	5.90E-08	5.90E-08	5.90E-08	6.10E-08	6.57E-08	6.43E-08
URI (Δ CDF)	-8.70E-08	-3.30E-08	-2.70E-08	-2.70E-08	-2.60E-08	3.50E-08	4.41E-08	4.64E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.30E-08	1.20E-08	3.20E-08	3.20E-08	3.30E-08	9.60E-08	1.10E-07	1.10E-07

Licensee Comments: none

Reactor Coolant System Activity

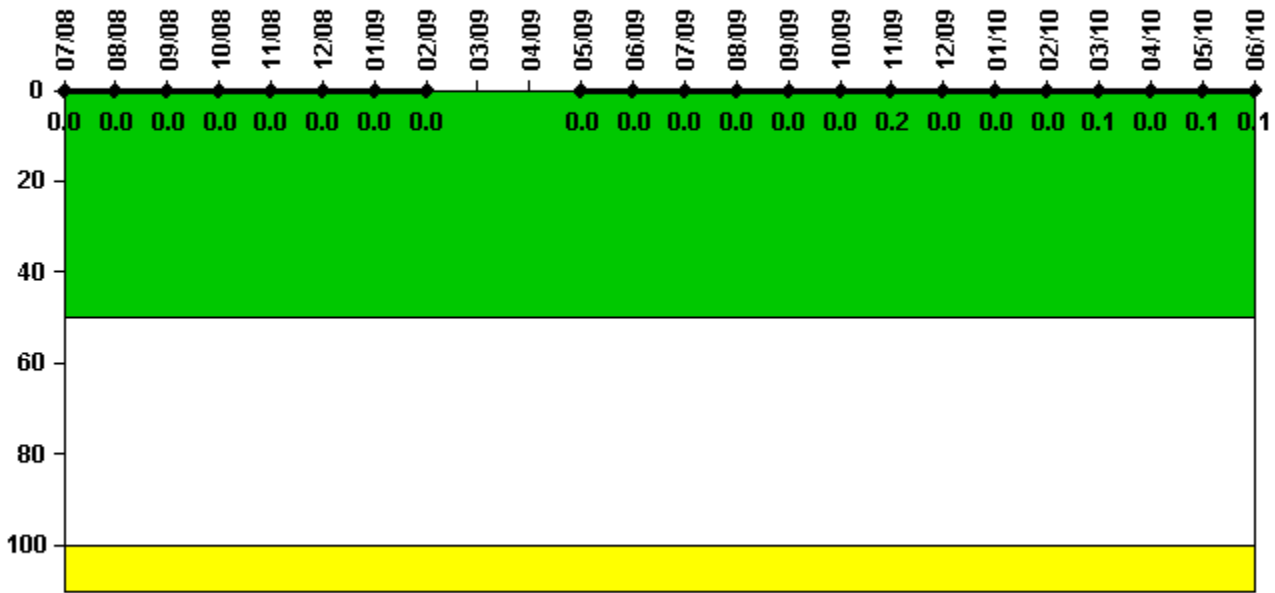

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum activity	0.000007	0.000006	0.000005	0.000010	0.000016	0.000005	0.000004	0.000004	N/A	N/A	0.000001	0.000003
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	N/A	N/A	0	0

Reactor Coolant System Activity	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum activity	0.000005	0.000004	0.000004	0.000002	0.000356	0.000031	0.000051	0.000085	0.000124	0.000075	0.000125	0.000113
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0.2	0	0	0	0.1	0	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

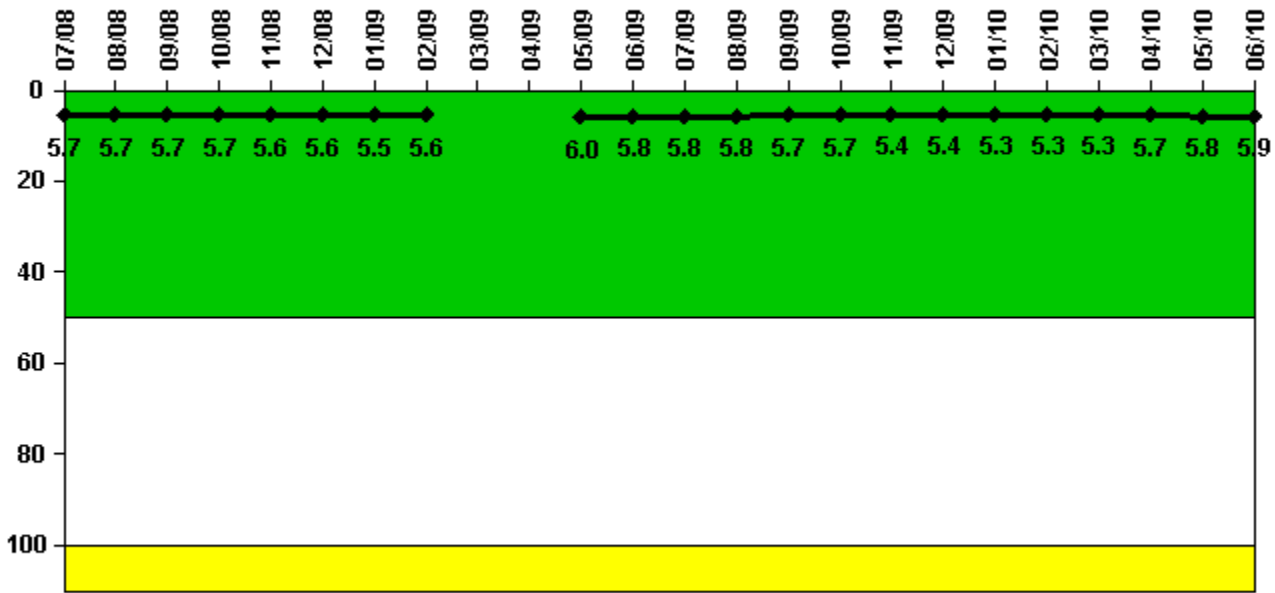


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum leakage	1.720	1.710	1.710	1.710	1.690	1.680	1.660	1.690	N/A	N/A	1.810	1.740
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	5.7	5.7	5.7	5.7	5.6	5.6	5.5	5.6	N/A	N/A	6.0	5.8
Reactor Coolant System Leakage	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum leakage	1.740	1.740	1.710	1.700	1.630	1.610	1.600	1.580	1.600	1.720	1.750	1.770
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	5.8	5.8	5.7	5.7	5.4	5.4	5.3	5.3	5.3	5.7	5.8	5.9

Licensee Comments: none

Drill/Exercise Performance

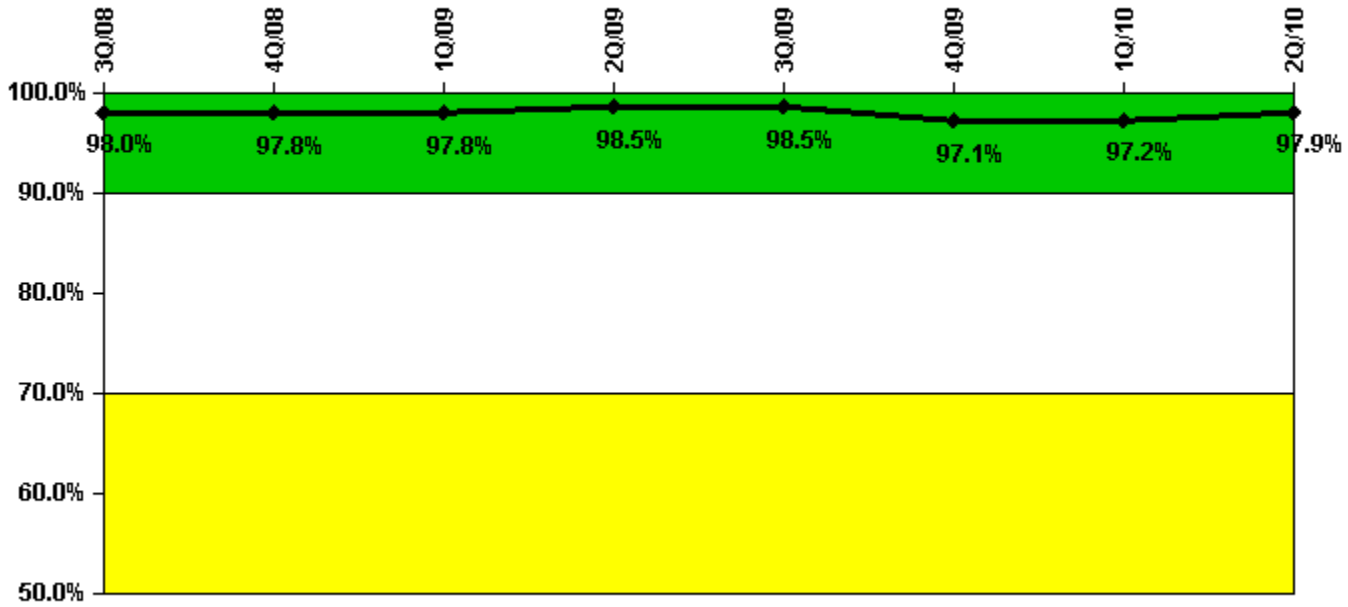


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Successful opportunities	43.0	8.0	2.0	23.0	10.0	12.0	12.0	27.0
Total opportunities	43.0	8.0	2.0	23.0	10.0	14.0	12.0	28.0
Indicator value	98.0%	97.8%	97.8%	98.5%	98.5%	97.1%	97.2%	97.9%

Licensee Comments: none

ERO Drill Participation

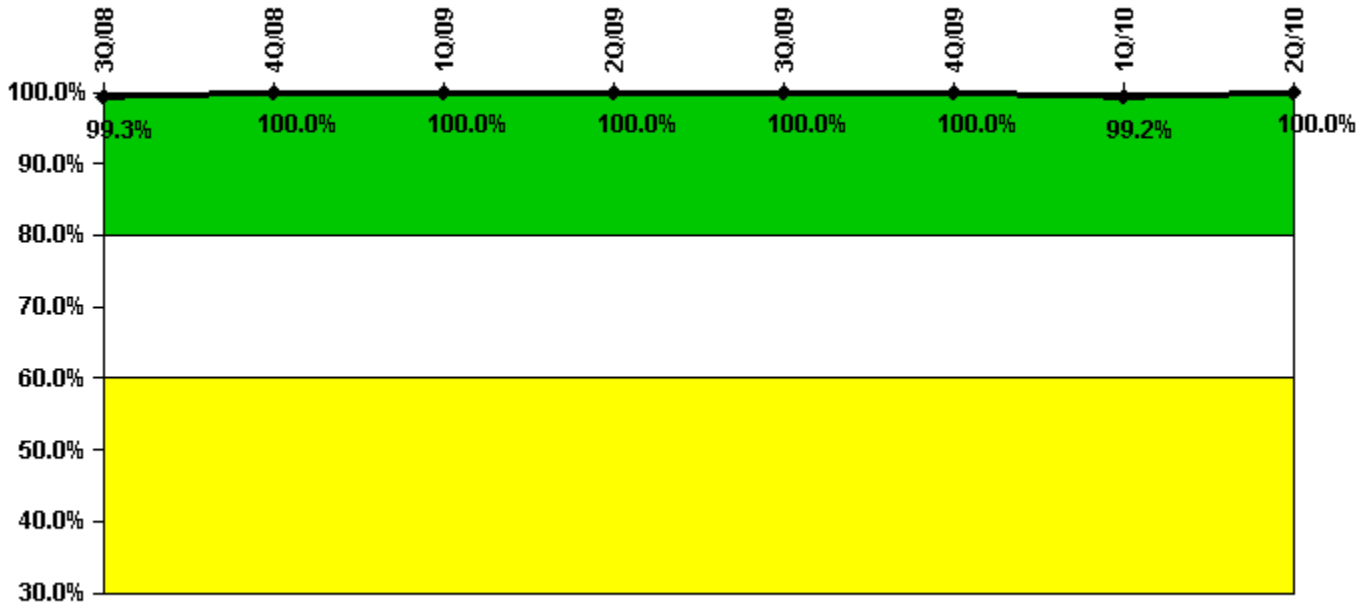

Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Participating Key personnel	142.0	148.0	141.0	132.0	136.0	134.0	129.0	135.0
Total Key personnel	143.0	148.0	141.0	132.0	136.0	134.0	130.0	135.0
Indicator value	99.3%	100.0%	100.0%	100.0%	100.0%	100.0%	99.2%	100.0%

Licensee Comments: none

Alert & Notification System

**Not applicable due to
unique design
characteristics.
Performance in this area
will be assessed through
focused NRC inspection
efforts.**


Notes

Alert & Notification System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Successful siren-tests								
Total sirens-tests								
Indicator value								

Licensee Comments:

2Q/10: Plant Hatch does not use sirens as an emergency notification system.

Occupational Exposure Control Effectiveness

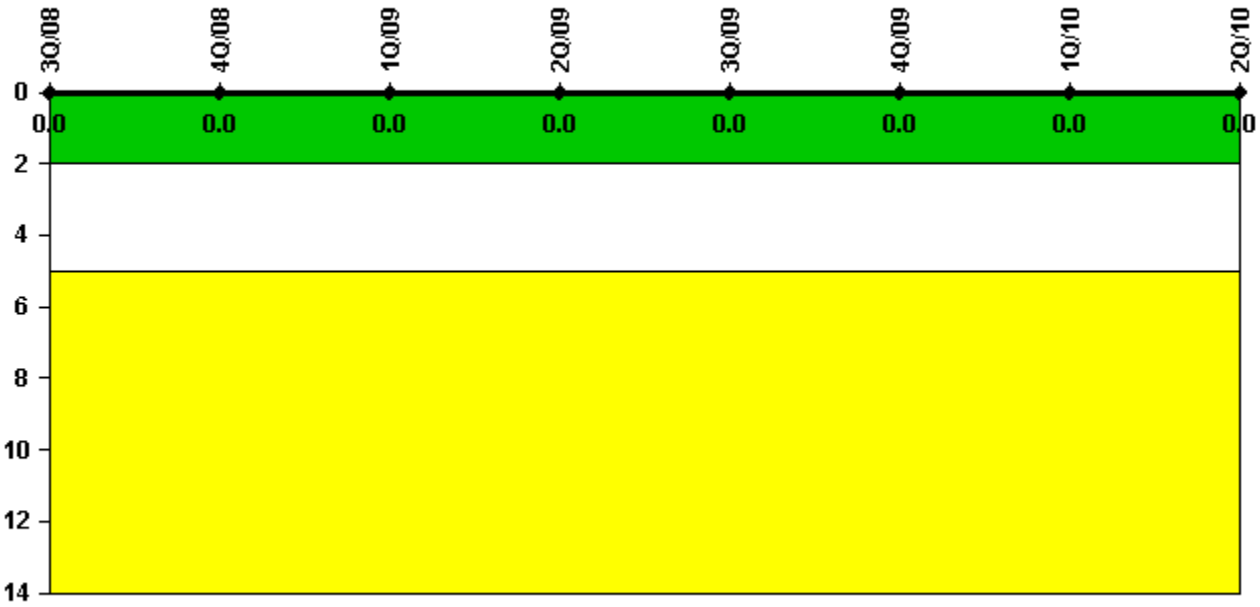

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.