


# Quad Cities 1

## 2Q/2010 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

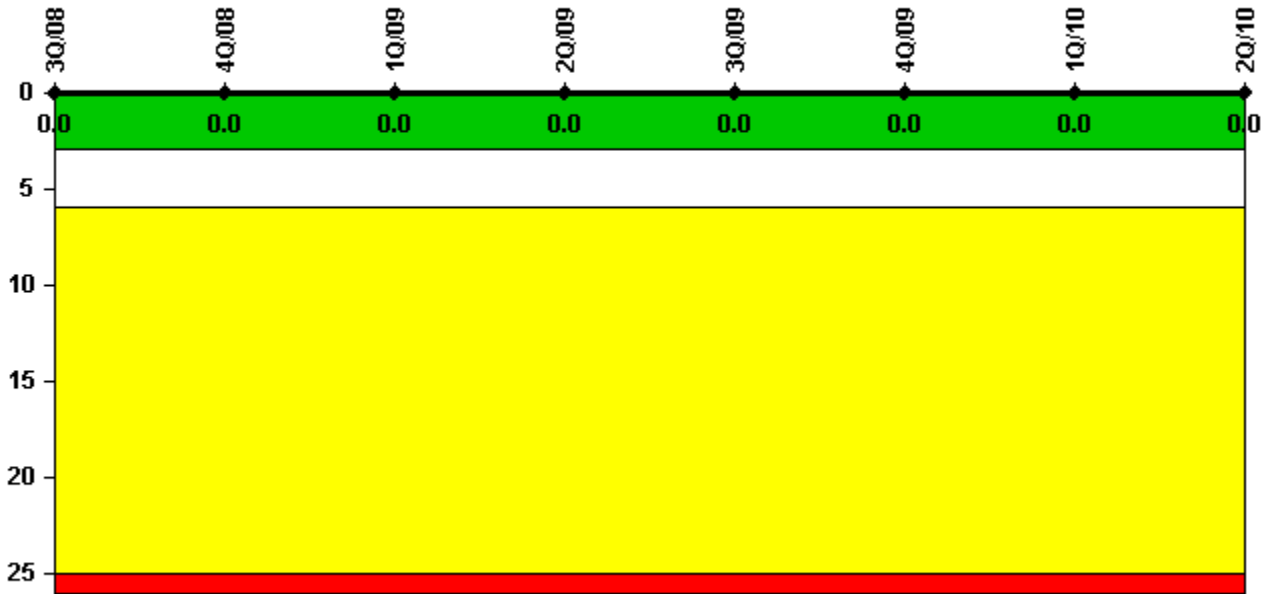

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	2159.0	1439.0	2145.4	2209.0	2159.0	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

---

## Unplanned Power Changes per 7000 Critical Hrs

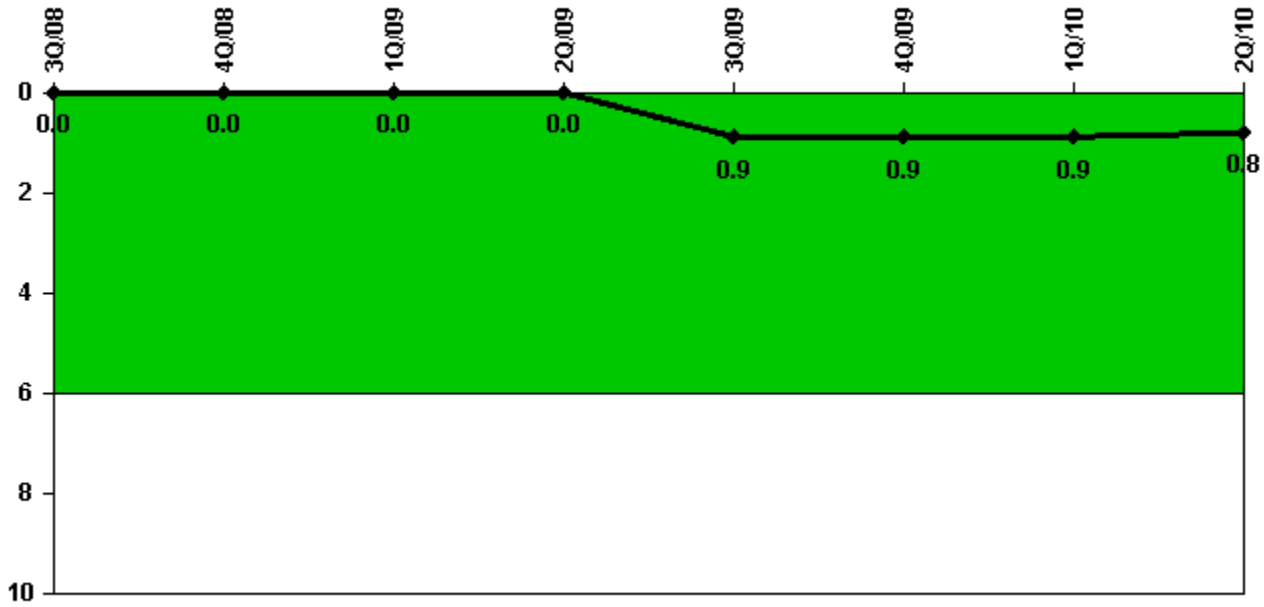

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Unplanned power changes	0	0	0	0	1.0	0	0	0
Critical hours	2208.0	2209.0	2159.0	1439.0	2145.4	2209.0	2159.0	2184.0
Indicator value	0	0	0	0	0.9	0.9	0.9	0.8

Licensee Comments: none

# Unplanned Scrams with Complications




Thresholds: White > 1.0

## Notes

Unplanned Scrams with Complications	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (BWR)

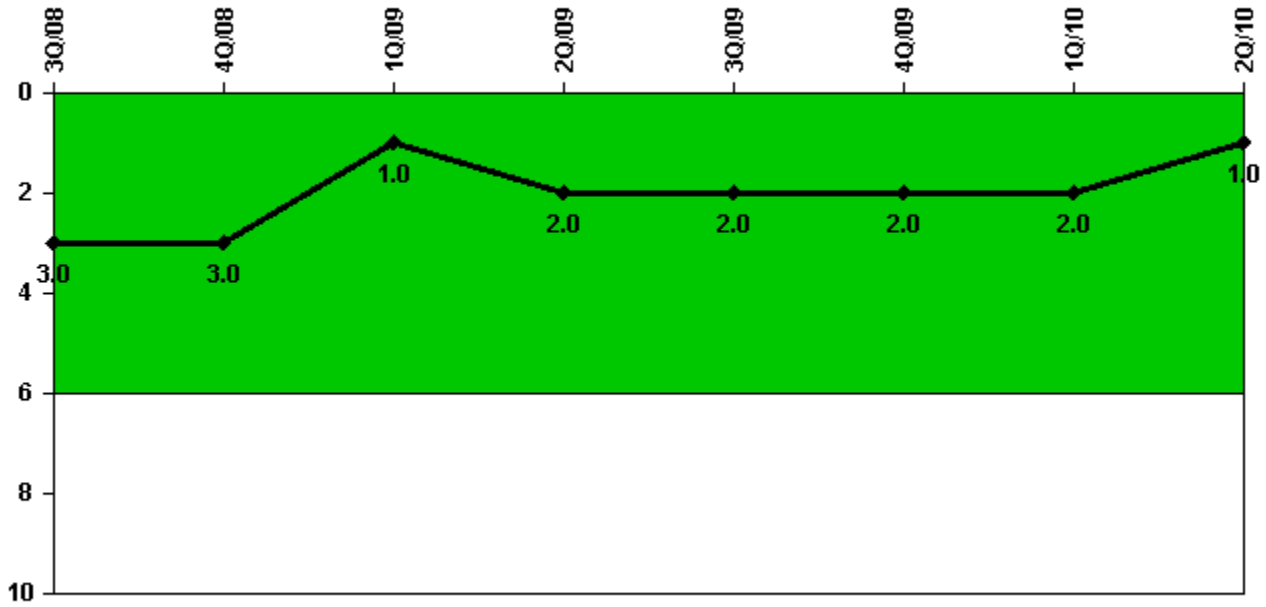


Thresholds: White > 6.0

### Notes

Safety System Functional Failures (BWR)	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Safety System Functional Failures	1	0	0	1	1	0	0	0
Indicator value	3	3	1	2	2	2	2	1

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

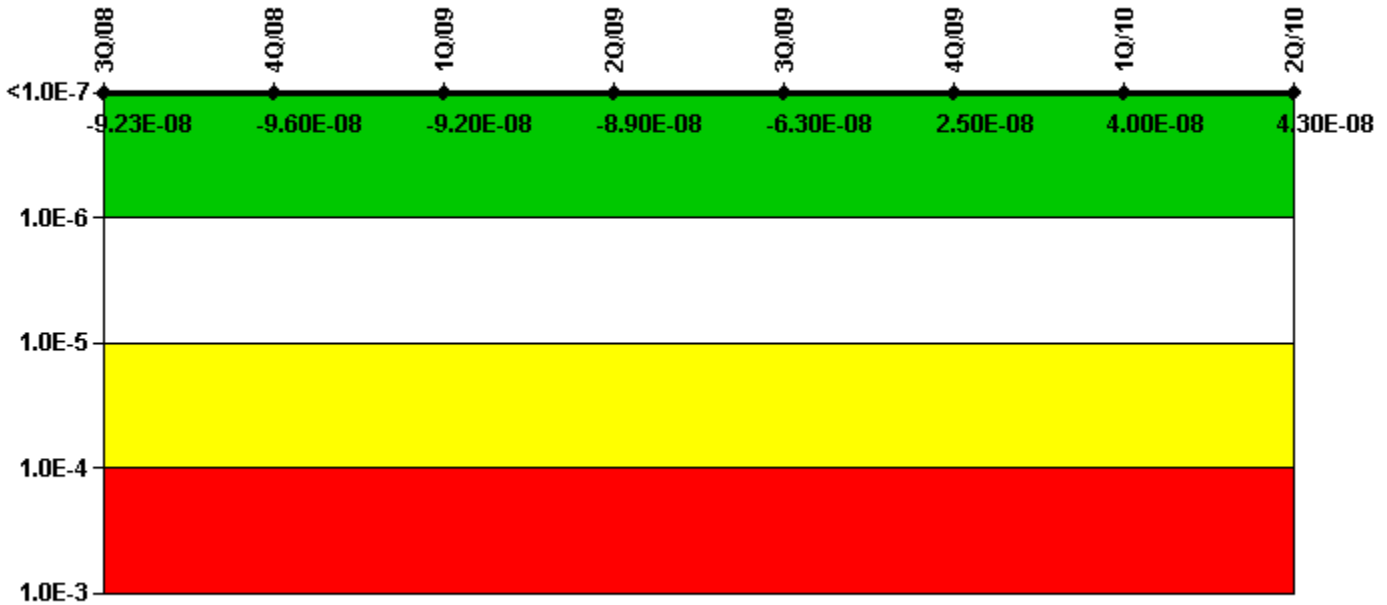


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI ( $\Delta$ CDF)	4.70E-09	5.40E-08	6.80E-08	7.10E-08	9.70E-08	9.60E-08	1.07E-07	1.07E-07
URI ( $\Delta$ CDF)	-9.70E-08	-1.50E-07	-1.60E-07	-1.60E-07	-1.60E-07	-7.10E-08	-6.71E-08	-6.45E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.23E-08	-9.60E-08	-9.20E-08	-8.90E-08	-6.30E-08	2.50E-08	4.00E-08	4.30E-08

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

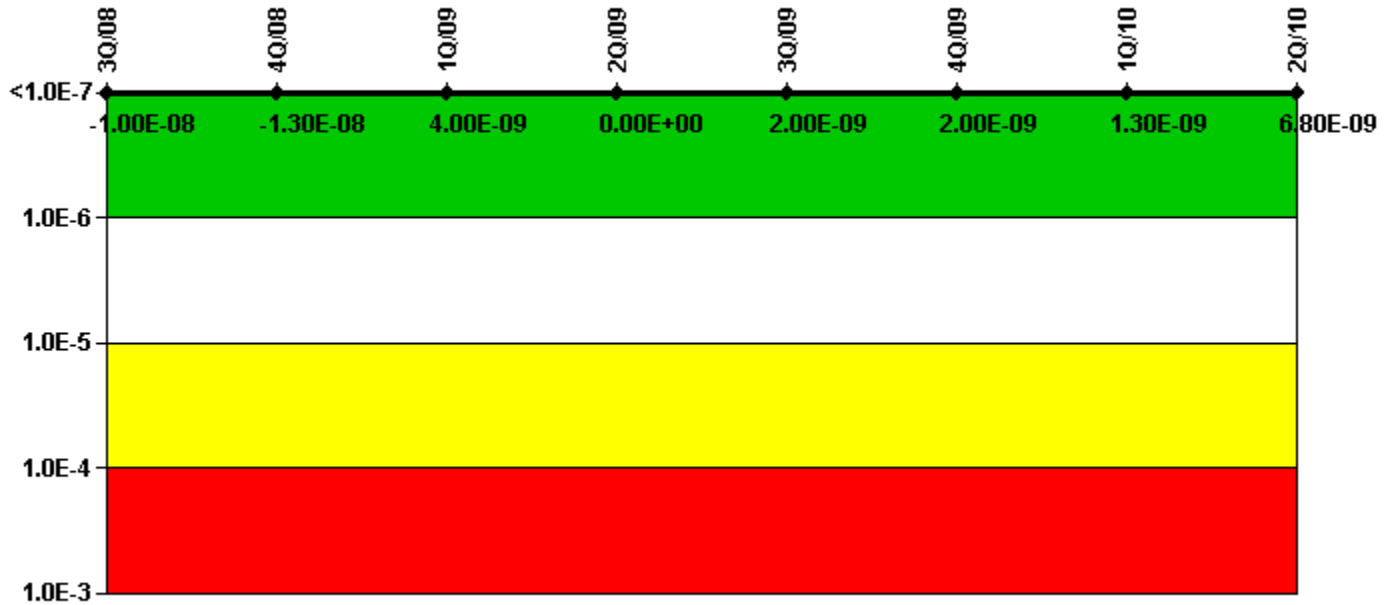


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI ( $\Delta$ CDF)	2.40E-08	2.10E-08	3.80E-08	3.90E-08	4.20E-08	4.20E-08	4.16E-08	4.42E-08
URI ( $\Delta$ CDF)	-3.40E-08	-3.40E-08	-3.40E-08	-3.90E-08	-4.00E-08	-4.00E-08	-4.03E-08	-3.74E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.00E-08	-1.30E-08	4.00E-09	0.00E+00	2.00E-09	2.00E-09	1.30E-09	6.80E-09

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

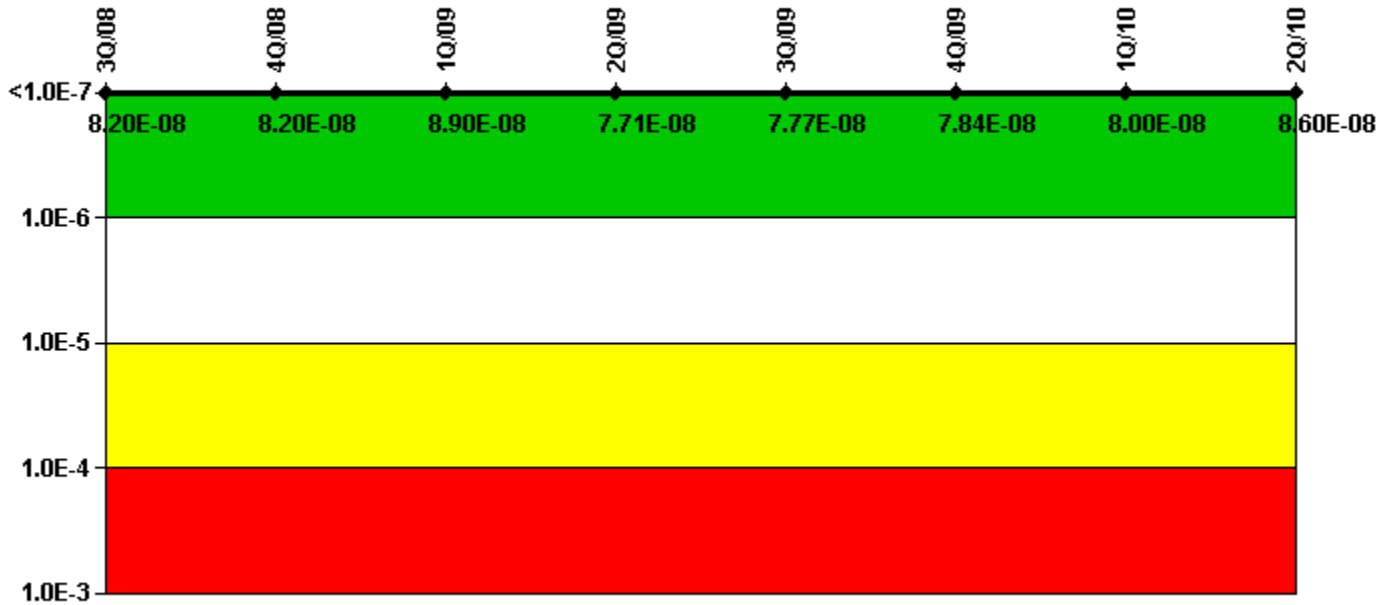


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI ( $\Delta$ CDF)	-1.70E-08	-1.70E-08	-1.00E-08	-4.90E-09	-4.30E-09	-3.60E-09	-1.90E-09	-2.39E-09
URI ( $\Delta$ CDF)	9.90E-08	9.90E-08	9.90E-08	8.20E-08	8.20E-08	8.20E-08	8.24E-08	8.86E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.20E-08	8.20E-08	8.90E-08	7.71E-08	7.77E-08	7.84E-08	8.00E-08	8.60E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

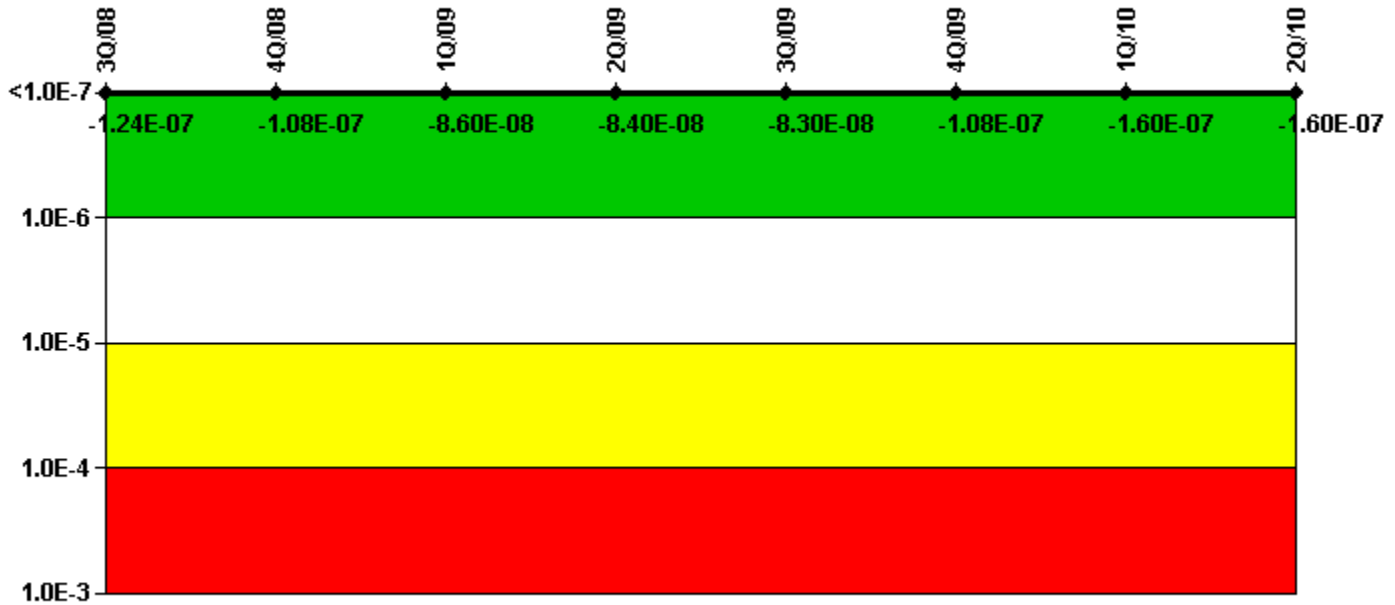

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI ( $\Delta$ CDF)	-2.70E-08	-1.10E-08	1.10E-08	1.30E-08	1.40E-08	-1.10E-08	-5.90E-08	-5.47E-08
URI ( $\Delta$ CDF)	-9.70E-08	-9.70E-08	-9.70E-08	-9.70E-08	-9.70E-08	-9.70E-08	-1.00E-07	-1.04E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.24E-07	-1.08E-07	-8.60E-08	-8.40E-08	-8.30E-08	-1.08E-07	-1.60E-07	-1.60E-07

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

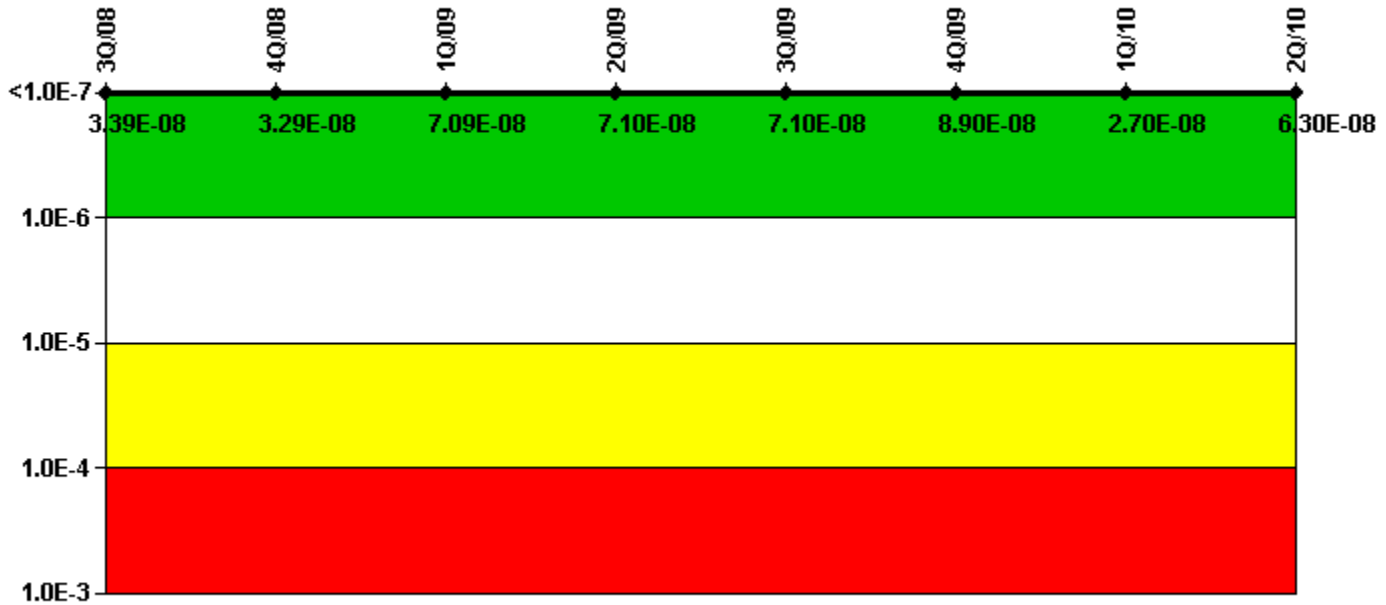


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
UAI ( $\Delta$ CDF)	3.20E-08	3.10E-08	6.90E-08	7.20E-08	7.20E-08	9.00E-08	2.76E-08	6.40E-08
URI ( $\Delta$ CDF)	1.90E-09	1.90E-09	1.90E-09	-9.60E-10	-9.60E-10	-9.60E-10	-9.61E-10	-9.61E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.39E-08	3.29E-08	7.09E-08	7.10E-08	7.10E-08	8.90E-08	2.70E-08	6.30E-08

Licensee Comments: none

# Reactor Coolant System Activity

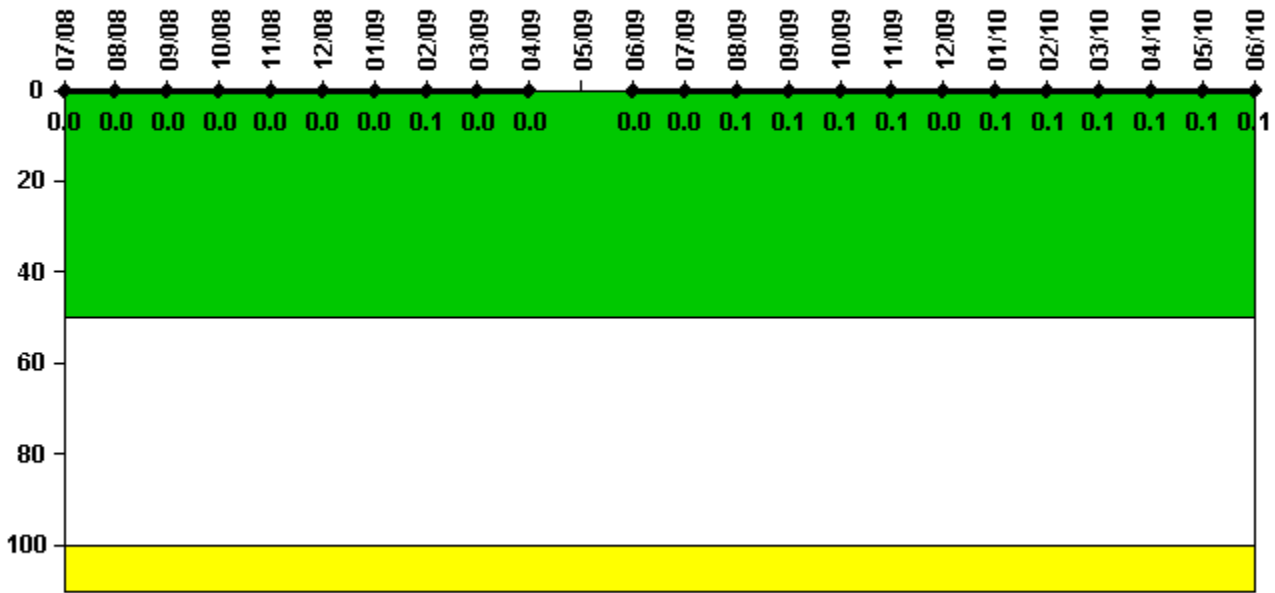

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Activity	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum activity	0.000052	0.000072	0.000053	0.000059	0.000027	0.000084	0.000035	0.000145	0.000040	0.000041	N/A	0.000060
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0.1	0	0	N/A	0

Reactor Coolant System Activity	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum activity	0.000086	0.000107	0.000107	0.000138	0.000105	0.000097	0.000107	0.000116	0.000108	0.000164	0.000161	0.000223
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0.1	0.1	0.1	0.1	0	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

## Reactor Coolant System Leakage

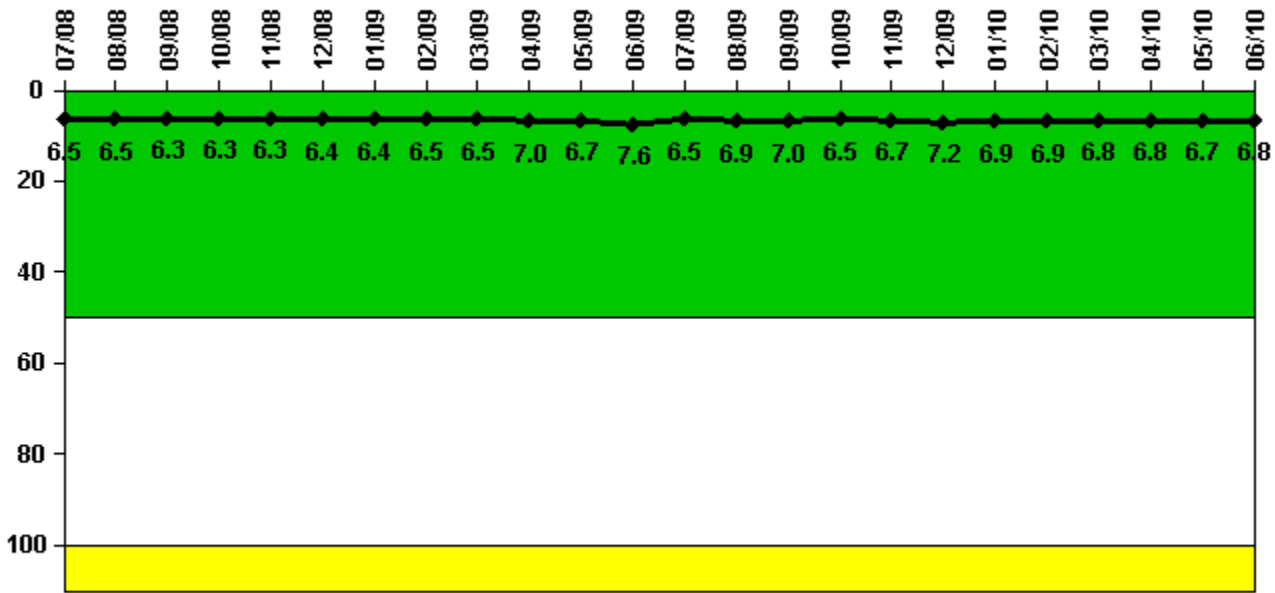


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	7/08	8/08	9/08	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09
Maximum leakage	1.620	1.620	1.570	1.570	1.570	1.610	1.610	1.630	1.620	1.740	1.670	1.910
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.5	6.5	6.3	6.3	6.3	6.4	6.4	6.5	6.5	7.0	6.7	7.6
Reactor Coolant System Leakage	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum leakage	1.630	1.720	1.760	1.630	1.670	1.810	1.730	1.730	1.710	1.690	1.680	1.690
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.5	6.9	7.0	6.5	6.7	7.2	6.9	6.9	6.8	6.8	6.7	6.8

Licensee Comments: none

## Drill/Exercise Performance

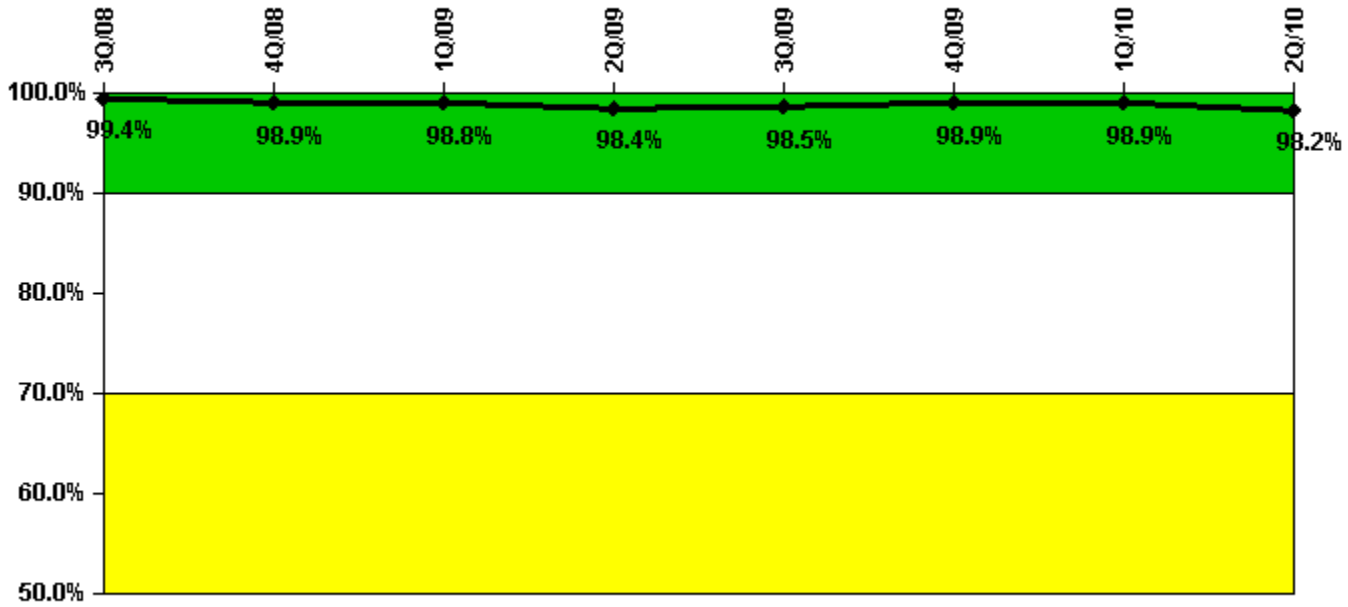


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Successful opportunities	24.0	47.0	15.0	11.0	70.0	42.0	18.0	46.0
Total opportunities	24.0	49.0	15.0	12.0	70.0	42.0	18.0	48.0
Indicator value	99.4%	98.9%	98.8%	98.4%	98.5%	98.9%	98.9%	98.2%

Licensee Comments: none

# ERO Drill Participation

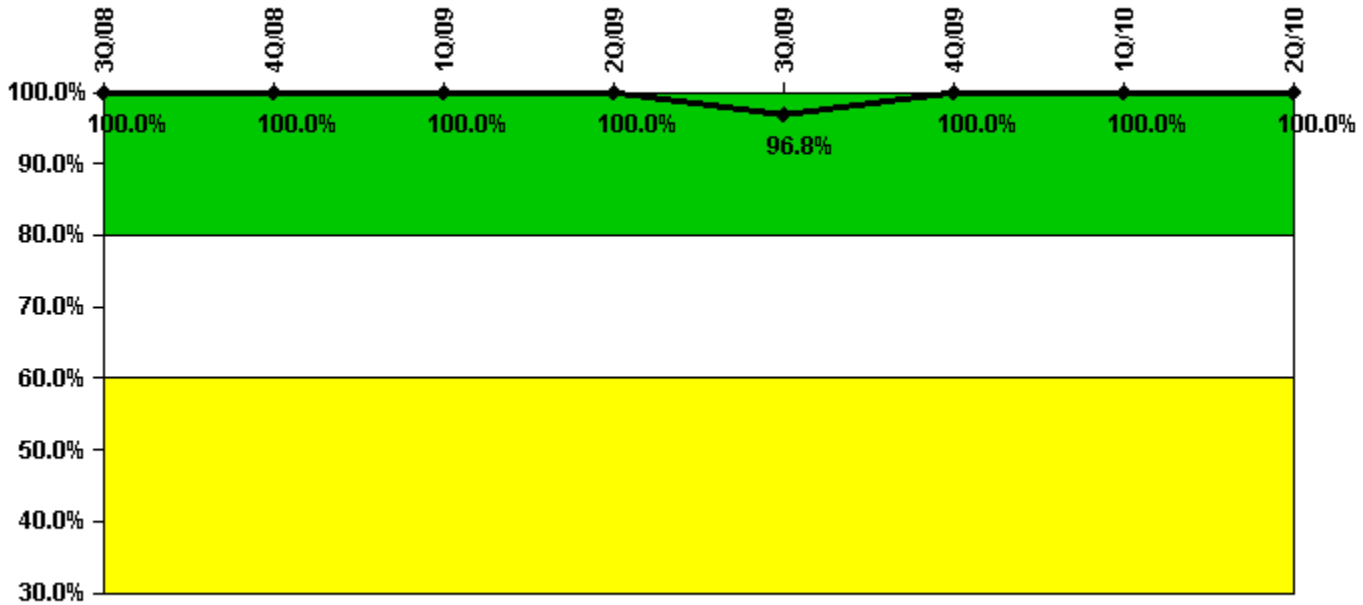


Thresholds: White < 80.0% Yellow < 60.0%

## Notes

ERO Drill Participation	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Participating Key personnel	69.0	64.0	69.0	68.0	61.0	64.0	63.0	68.0
Total Key personnel	69.0	64.0	69.0	68.0	63.0	64.0	63.0	68.0
Indicator value	100.0%	100.0%	100.0%	100.0%	96.8%	100.0%	100.0%	100.0%

Licensee Comments: none

# Alert & Notification System

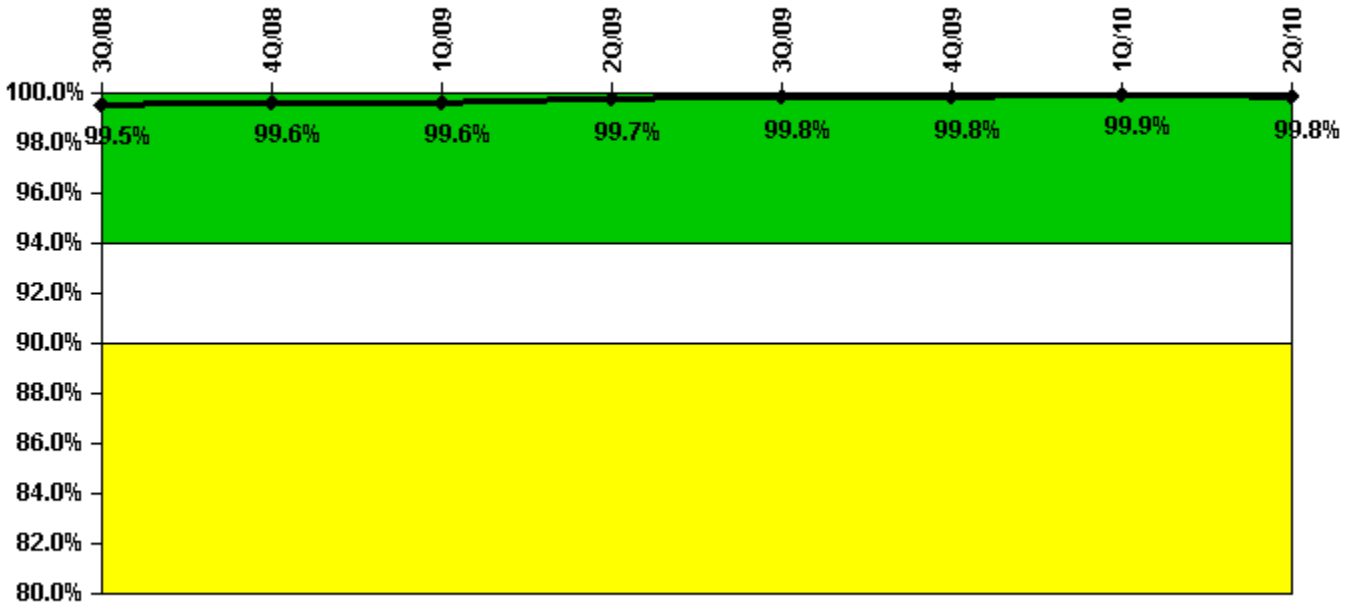


**Thresholds:** White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
Successful siren-tests	3367	3315	3269	3325	3372	3326	2643	2675
Total sirens-tests	3380	3328	3276	3328	3380	3328	2646	2688
Indicator value	99.5%	99.6%	99.6%	99.7%	99.8%	99.8%	99.9%	99.8%

Licensee Comments: none

# Occupational Exposure Control Effectiveness

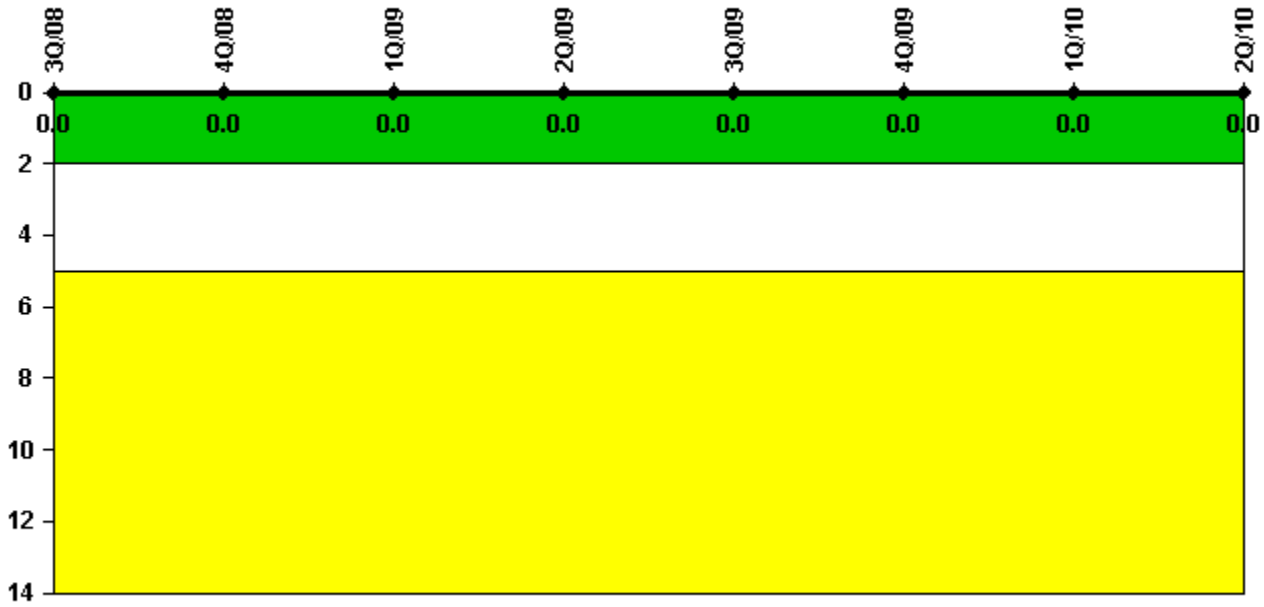


Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

## RETS/ODCM Radiological Effluent

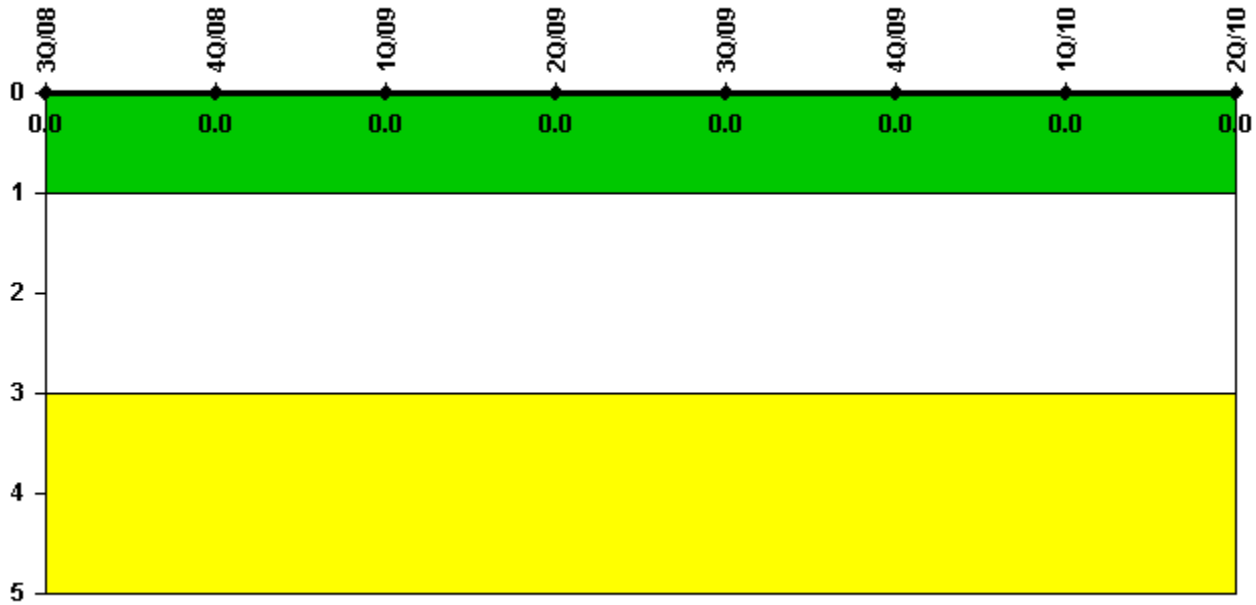

Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	3Q/08	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.