


Pilgrim 1

3Q/2010 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

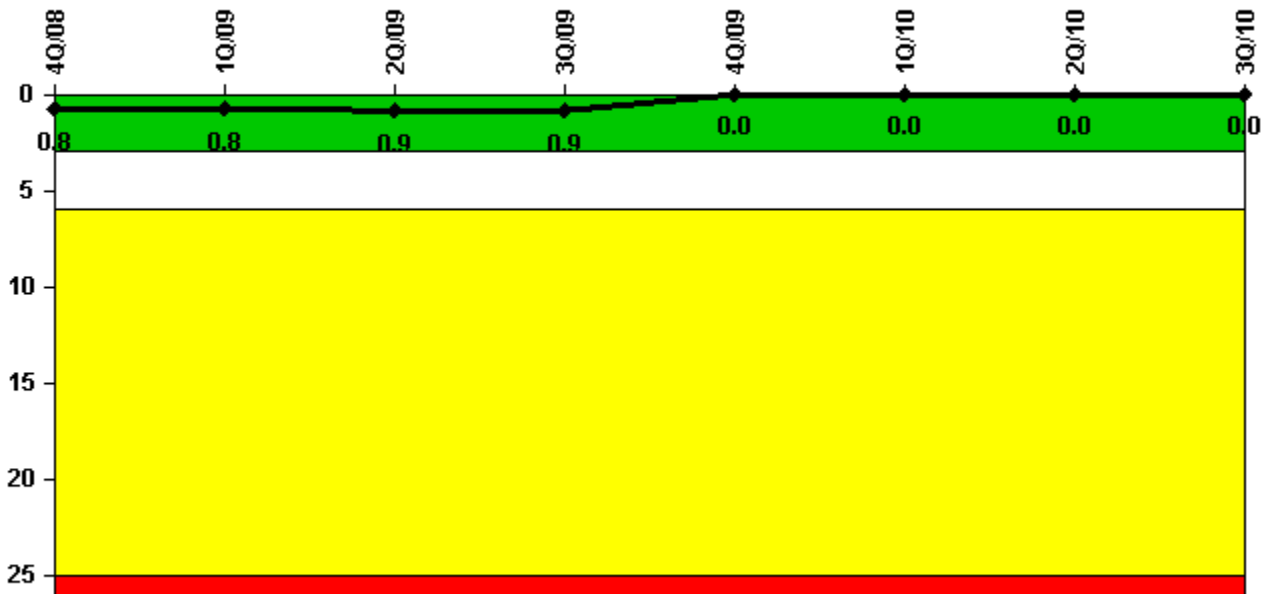


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Unplanned scrams	1.0	0	0	0	0	0	0	0
Critical hours	2152.7	2159.0	1453.1	2208.0	2209.0	2159.0	2184.0	2208.0
Indicator value	0.8	0.8	0.9	0.9	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

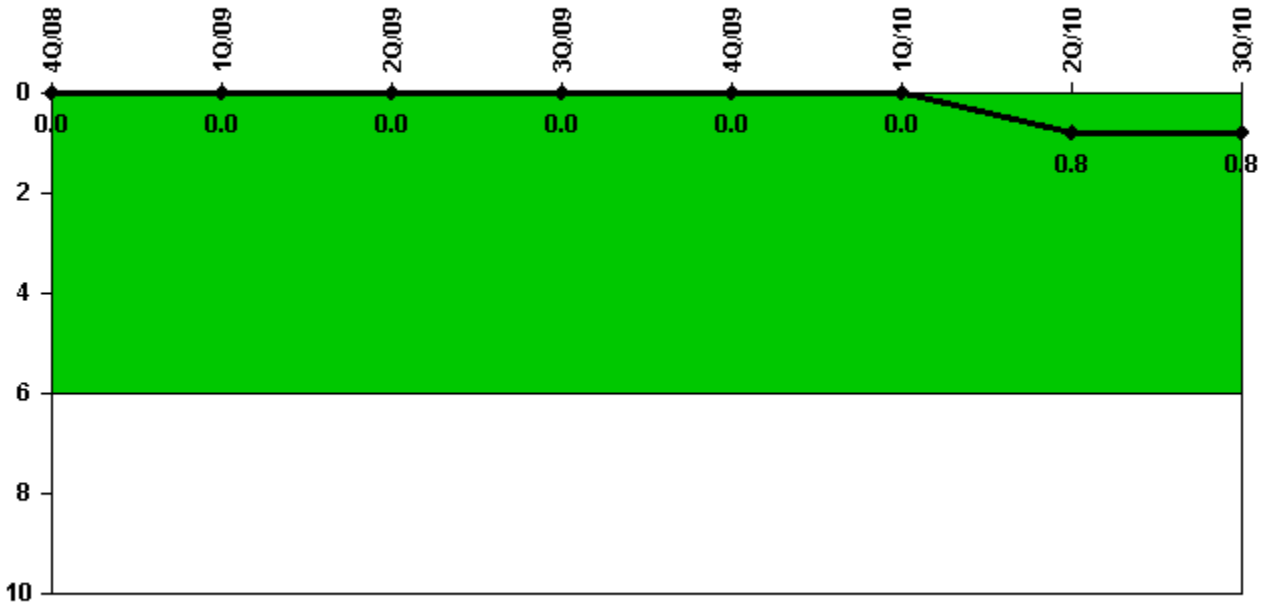

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Unplanned power changes	0	0	0	0	0	0	1.0	0
Critical hours	2152.7	2159.0	1453.1	2208.0	2209.0	2159.0	2184.0	2208.0
Indicator value	0	0	0	0	0	0	0.8	0.8

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

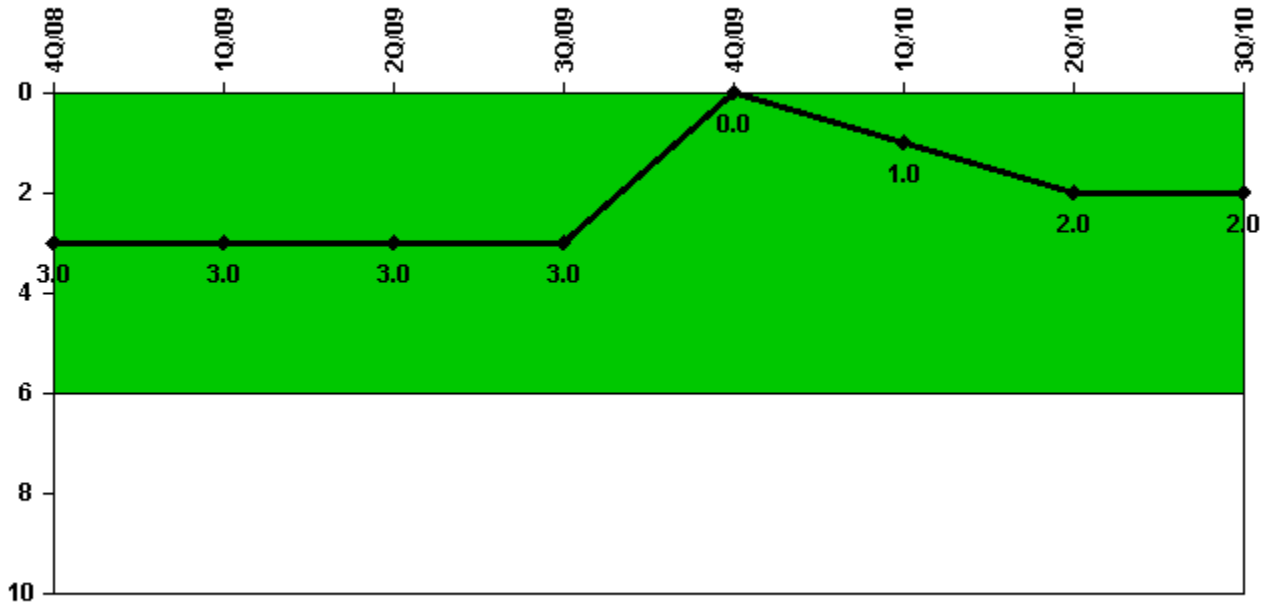

Thresholds: White > 6.0

Notes


Safety System Functional Failures (BWR)	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Safety System Functional Failures	3	0	0	0	0	1	1	0
Indicator value	3	3	3	3	0	1	2	2

Licensee Comments:

2Q/10: LER 2010-002 - "Standby Gas Treatment Declared Inoperable After Discovery of Open Demister Door"

1Q/10: LER 2009-02-01 "Failure to Meet Technical Specification Requirements for Secondary Containment"

Mitigating Systems Performance Index, Emergency AC Power System

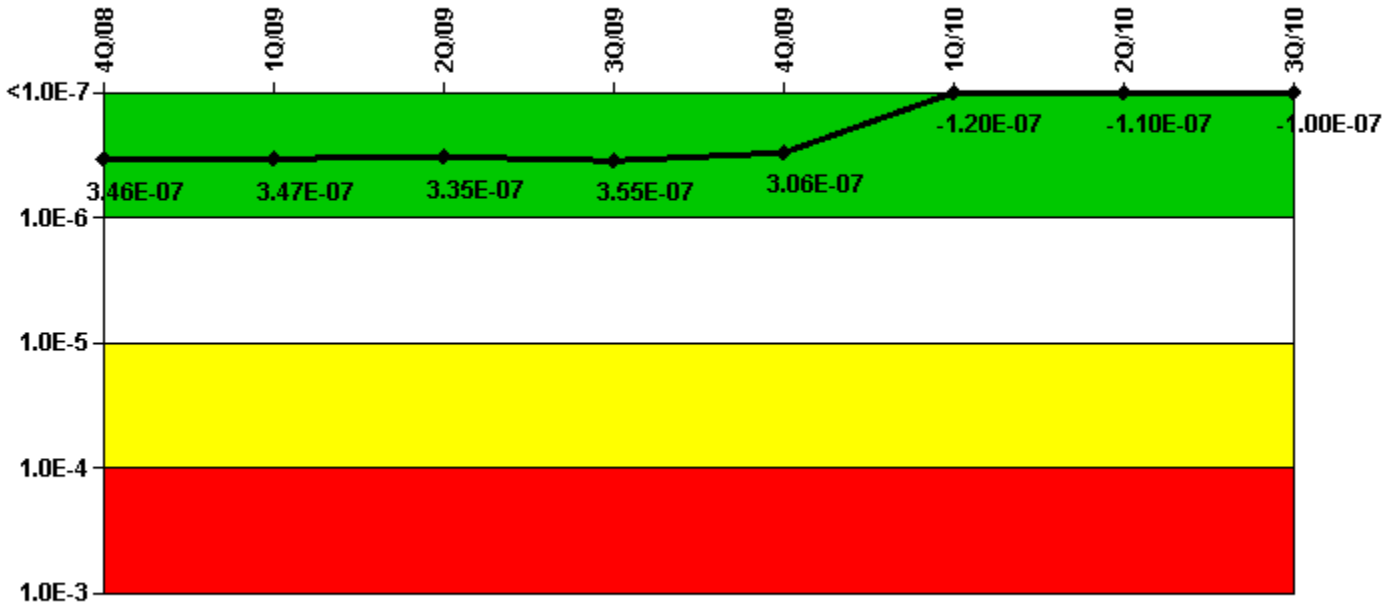


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
UAI (Δ CDF)	2.60E-08	2.70E-08	1.50E-08	2.50E-08	2.60E-08	5.38E-09	7.94E-09	8.75E-09
URI (Δ CDF)	3.20E-07	3.20E-07	3.20E-07	3.30E-07	2.80E-07	-1.22E-07	-1.14E-07	-1.13E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.46E-07	3.47E-07	3.35E-07	3.55E-07	3.06E-07	-1.20E-07	-1.10E-07	-1.00E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

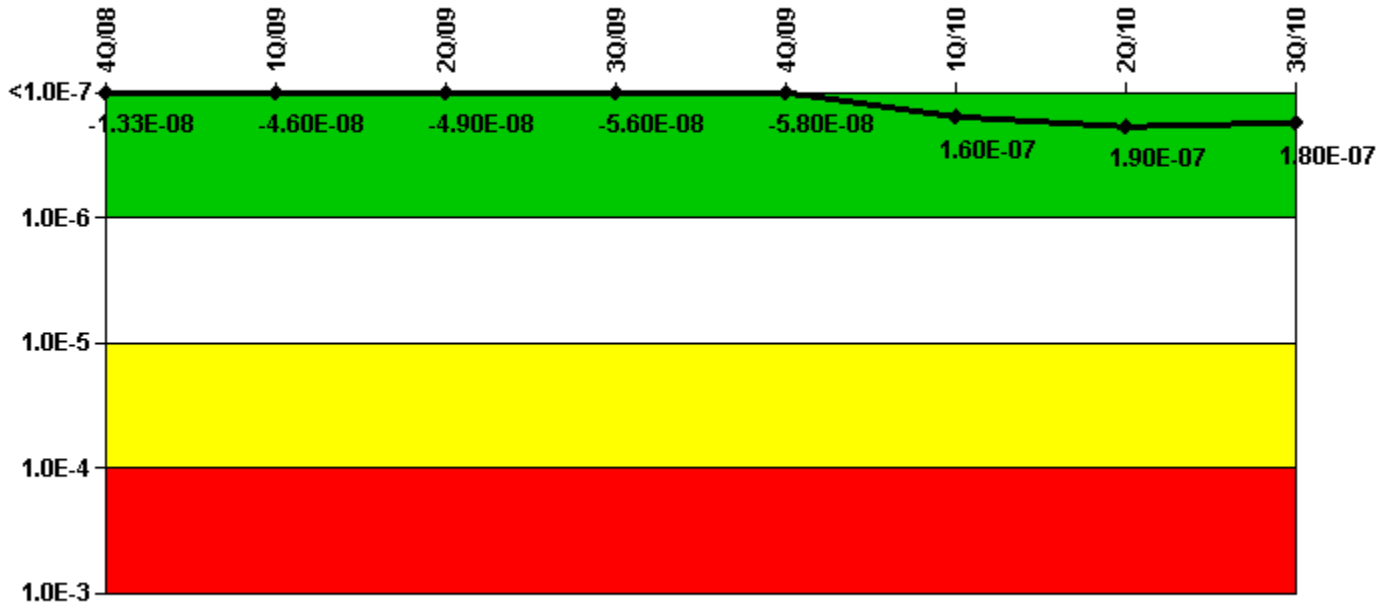


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
UAI (Δ CDF)	$7.70E-09$	$-2.10E-08$	$-1.90E-08$	$-3.00E-08$	$-3.00E-08$	$-2.47E-08$	$-1.61E-08$	$-2.10E-08$
URI (Δ CDF)	$-2.10E-08$	$-2.50E-08$	$-3.00E-08$	$-2.60E-08$	$-2.80E-08$	$1.86E-07$	$2.04E-07$	$2.04E-07$
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	$-1.33E-08$	$-4.60E-08$	$-4.90E-08$	$-5.60E-08$	$-5.80E-08$	$1.60E-07$	$1.90E-07$	$1.80E-07$

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

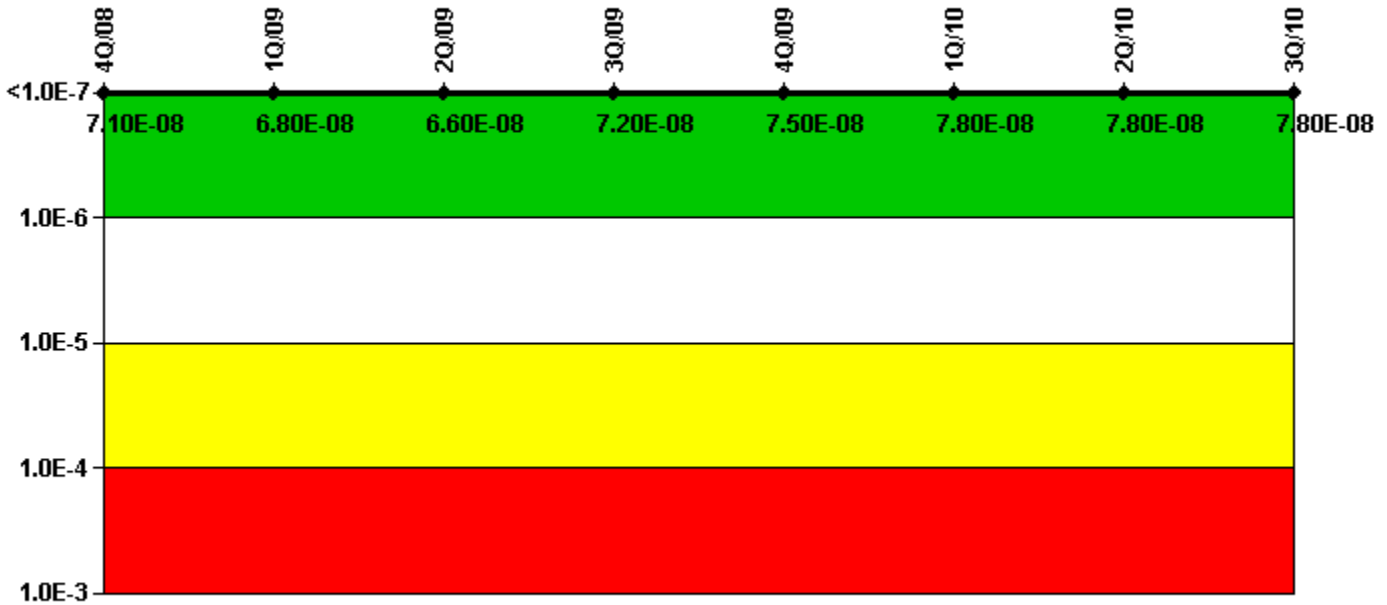


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
UAI (Δ CDF)	-1.10E-08	-1.10E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.04E-08	-1.06E-08	-1.06E-08
URI (Δ CDF)	8.20E-08	7.90E-08	7.60E-08	8.20E-08	8.50E-08	8.80E-08	8.82E-08	8.82E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.10E-08	6.80E-08	6.60E-08	7.20E-08	7.50E-08	7.80E-08	7.80E-08	7.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

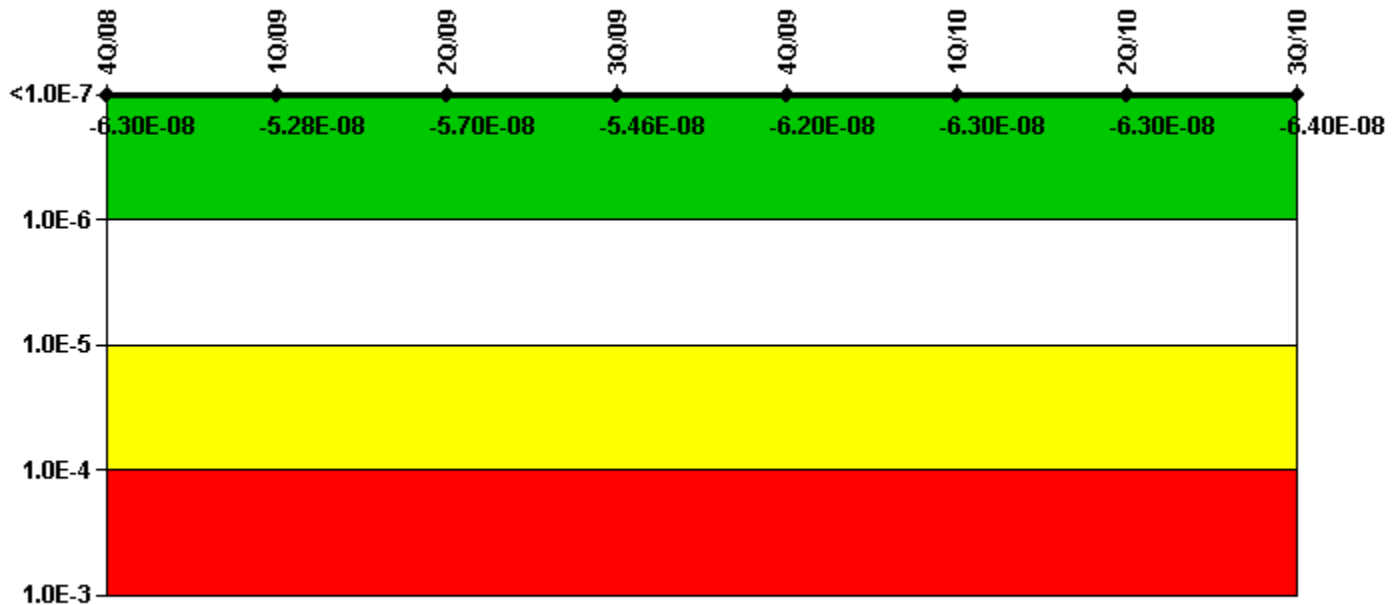


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
UAI (Δ CDF)	-2.10E-08	-9.80E-09	-1.20E-08	-9.60E-09	-1.70E-08	-1.90E-08	-2.04E-08	-2.09E-08
URI (Δ CDF)	-4.20E-08	-4.30E-08	-4.50E-08	-4.50E-08	-4.50E-08	-4.44E-08	-4.25E-08	-4.35E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.30E-08	-5.28E-08	-5.70E-08	-5.46E-08	-6.20E-08	-6.30E-08	-6.30E-08	-6.40E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

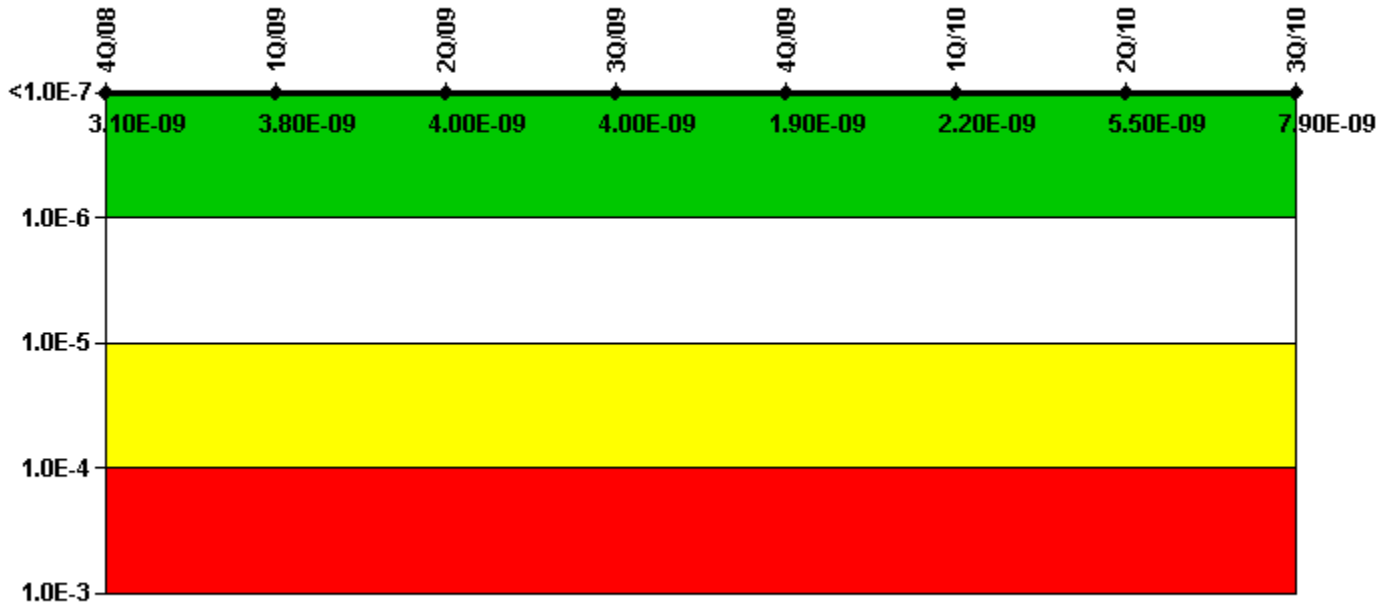


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
UAI (Δ CDF)	4.60E-09	5.30E-09	5.50E-09	5.50E-09	3.50E-09	3.80E-09	5.03E-09	7.50E-09
URI (Δ CDF)	-1.50E-09	-1.50E-09	-1.50E-09	-1.50E-09	-1.60E-09	-1.60E-09	4.39E-10	3.77E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.10E-09	3.80E-09	4.00E-09	4.00E-09	1.90E-09	2.20E-09	5.50E-09	7.90E-09

Licensee Comments: none

Reactor Coolant System Activity

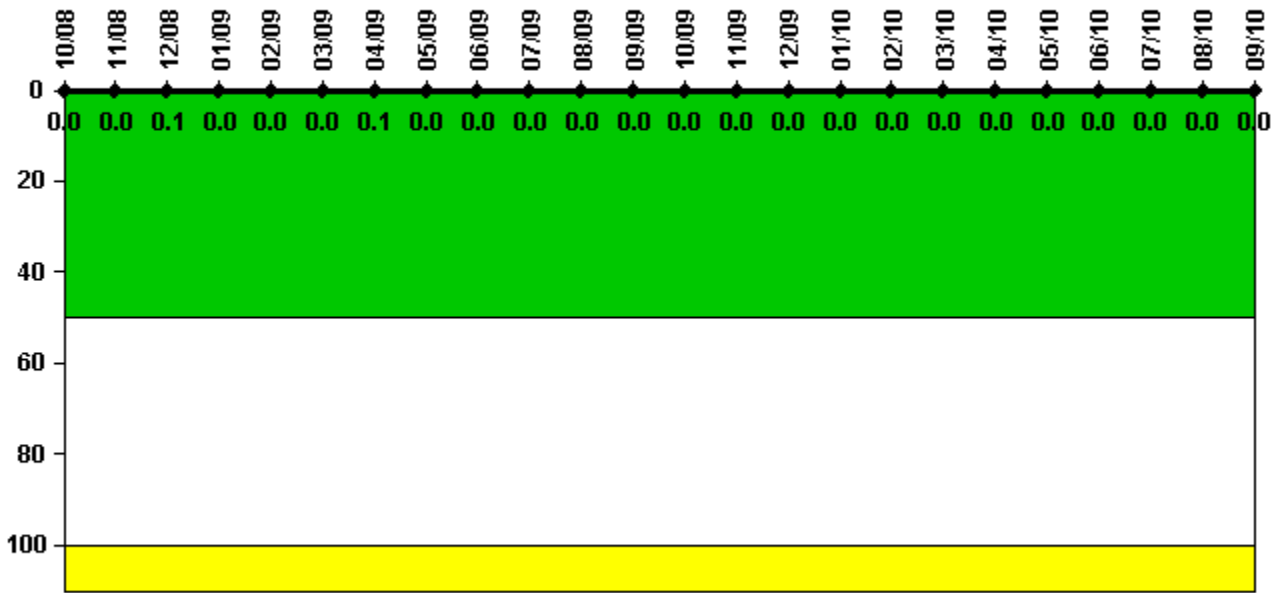

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum activity	0.001090	0.000887	0.027100	0.000862	0.001240	0.001390	0.017500	0.005240	0.000637	0.000613	0.000577	0.000931
Technical specification limit	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
Indicator value	0	0	0.1	0	0	0	0.1	0	0	0	0	0
Reactor Coolant System Activity	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum activity	0.001060	0.000535	0.000561	0.001310	0.000546	0.000871	0.000718	0.000981	0.000544	0.000681	0.000799	0.000529
Technical specification limit	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments:

9/10: Indicates reactor coolant activity, expressed as a percentage of the Technical Specifications limit for Iodine. Technical Specifications do not specify a limit for Iodine-131.

Reactor Coolant System Leakage

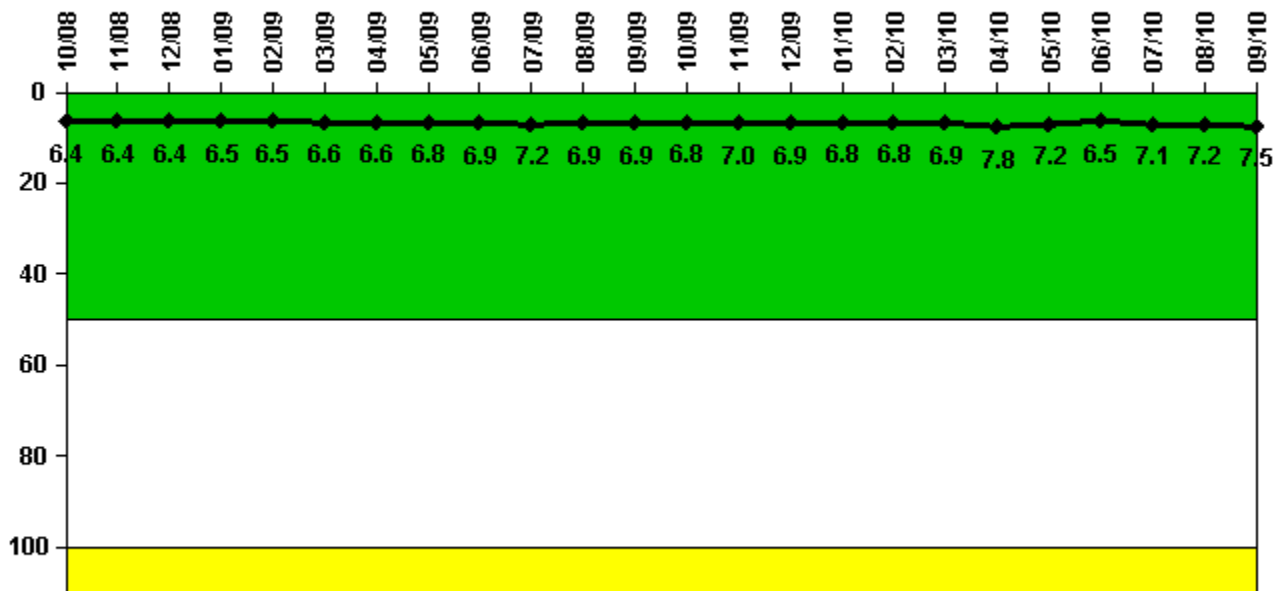

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	10/08	11/08	12/08	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09
Maximum leakage	1.600	1.600	1.590	1.620	1.630	1.650	1.640	1.690	1.720	1.810	1.730	1.720
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.4	6.4	6.4	6.5	6.5	6.6	6.6	6.8	6.9	7.2	6.9	6.9
Reactor Coolant System Leakage	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum leakage	1.700	1.740	1.720	1.710	1.710	1.730	1.940	1.800	1.630	1.780	1.800	1.880
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.8	7.0	6.9	6.8	6.8	6.9	7.8	7.2	6.5	7.1	7.2	7.5

Licensee Comments:

9/10: Reflects total leakage (identified plus un-identified), expressed as a percentage of the Technical Specifications limit. Technical Specifications specify un-identified and total leakage; it does not specify identified leakage.

Drill/Exercise Performance

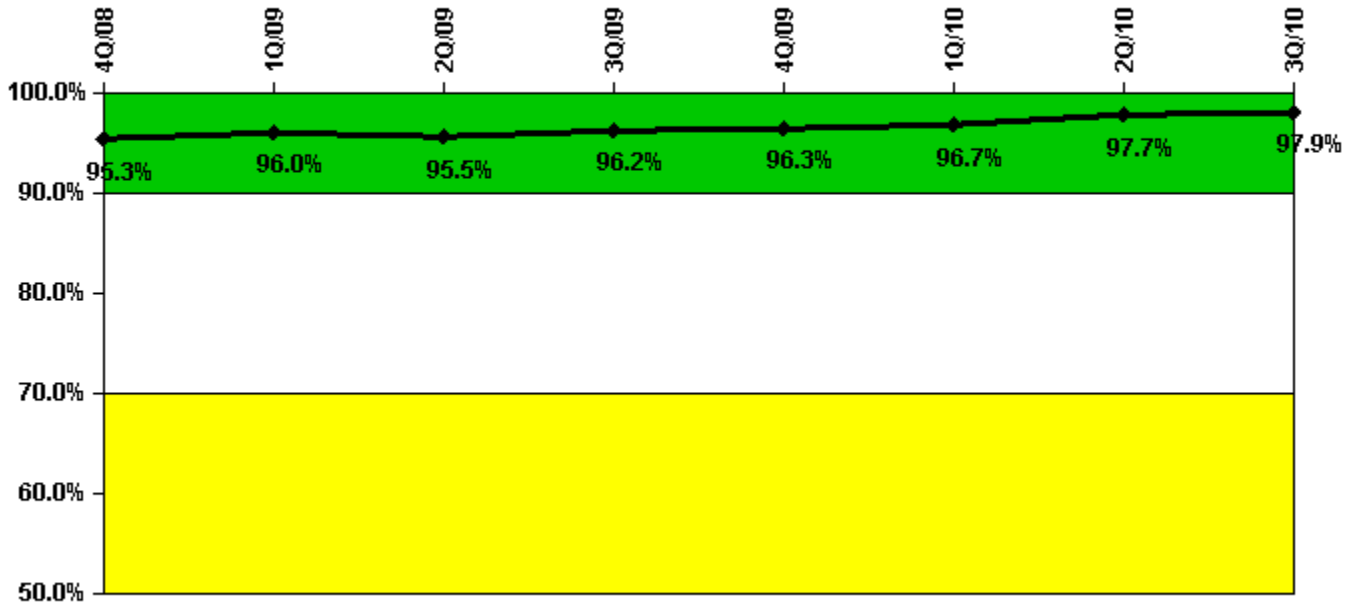


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Successful opportunities	57.0	103.0	22.0	57.0	42.0	33.0	25.0	36.0
Total opportunities	58.0	106.0	24.0	57.0	42.0	34.0	25.0	37.0
Indicator value	95.3%	96.0%	95.5%	96.2%	96.3%	96.7%	97.7%	97.9%

Licensee Comments: none

ERO Drill Participation

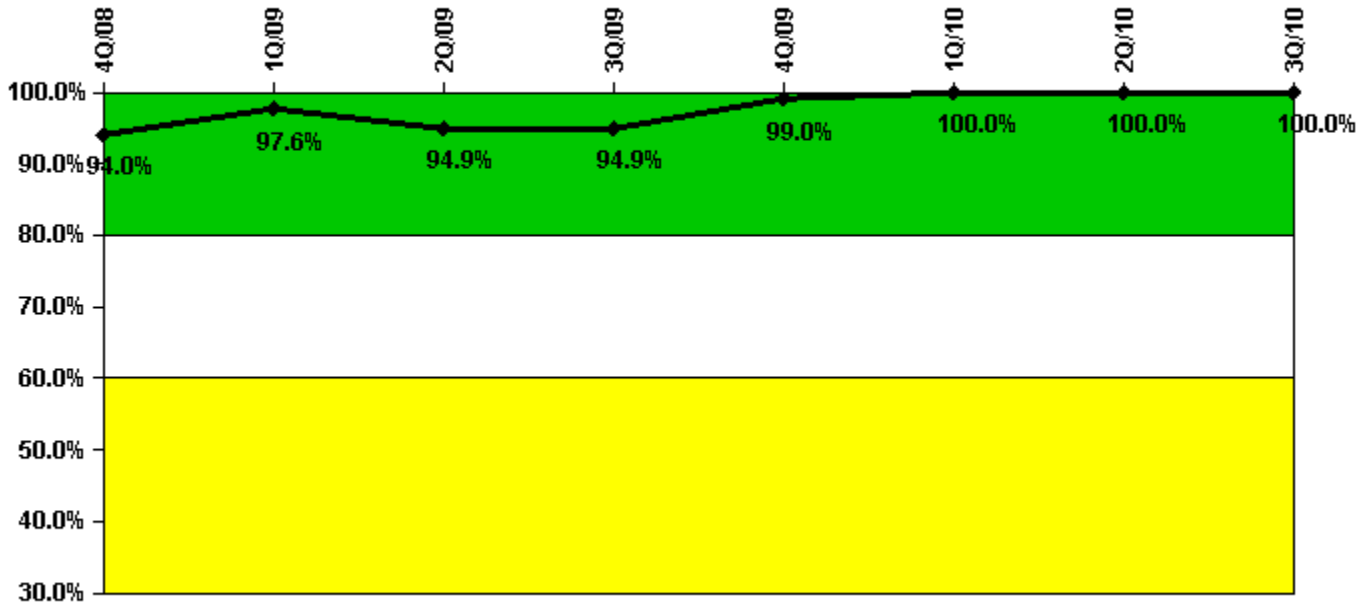


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Participating Key personnel	78.0	82.0	94.0	93.0	96.0	96.0	103.0	100.0
Total Key personnel	83.0	84.0	99.0	98.0	97.0	96.0	103.0	100.0
Indicator value	94.0%	97.6%	94.9%	94.9%	99.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

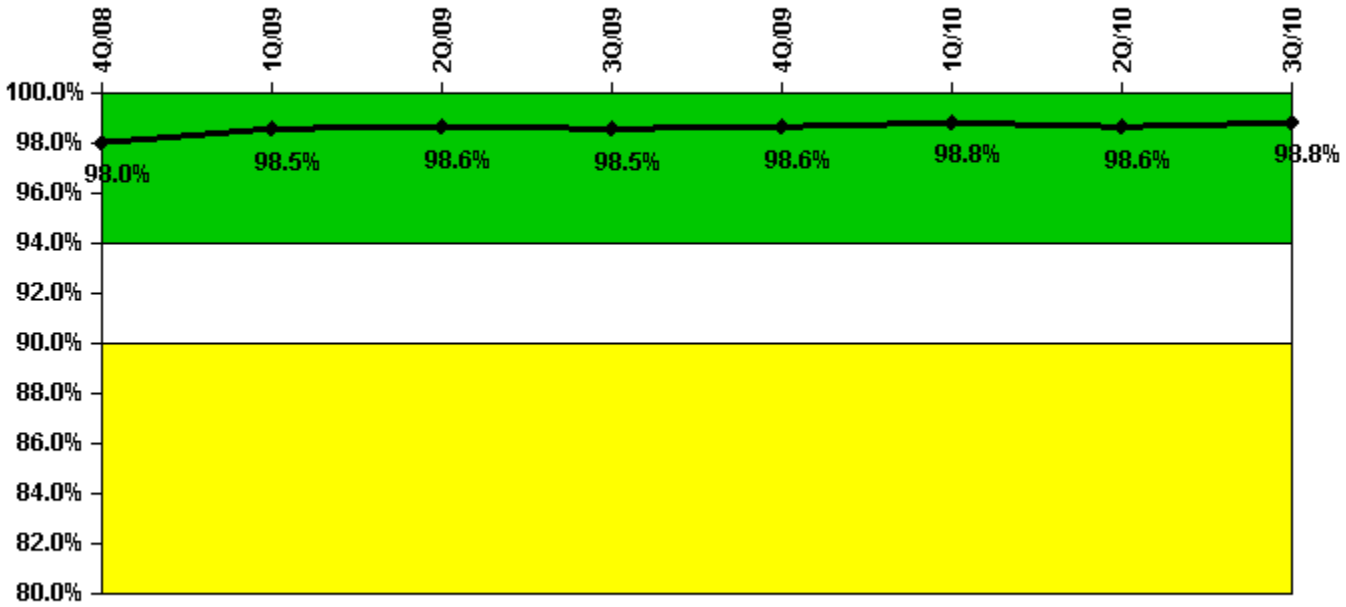


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
Successful siren-tests	444	333	333	333	448	337	331	335
Total sirens-tests	450	337	339	339	452	339	339	339
Indicator value	98.0%	98.5%	98.6%	98.5%	98.6%	98.8%	98.6%	98.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

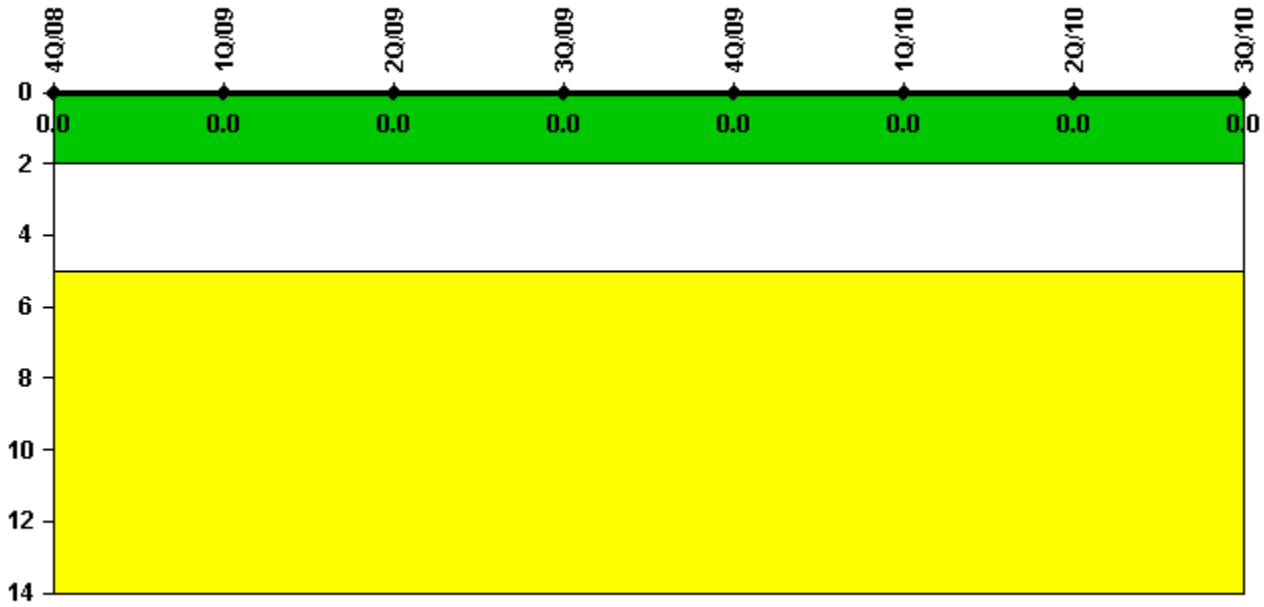


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

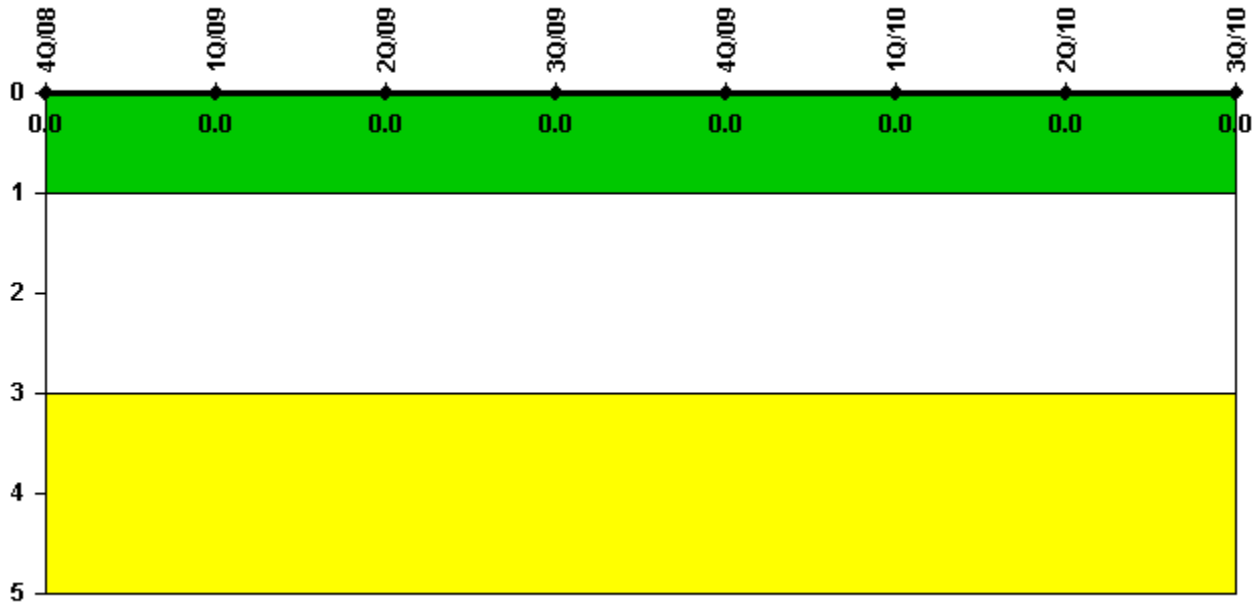

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/08	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.