


Nine Mile Point 1

4Q/2010 Performance Indicators

Licensee's General Comments: Change reflects correction to Successful siren-test and Total siren-test for August 2010. They were reported as 74 each. The actual numbers should have been 111 each. This change has no impact on the color of the indicator which continues to be in GREEN

Unplanned Scrams per 7000 Critical Hrs

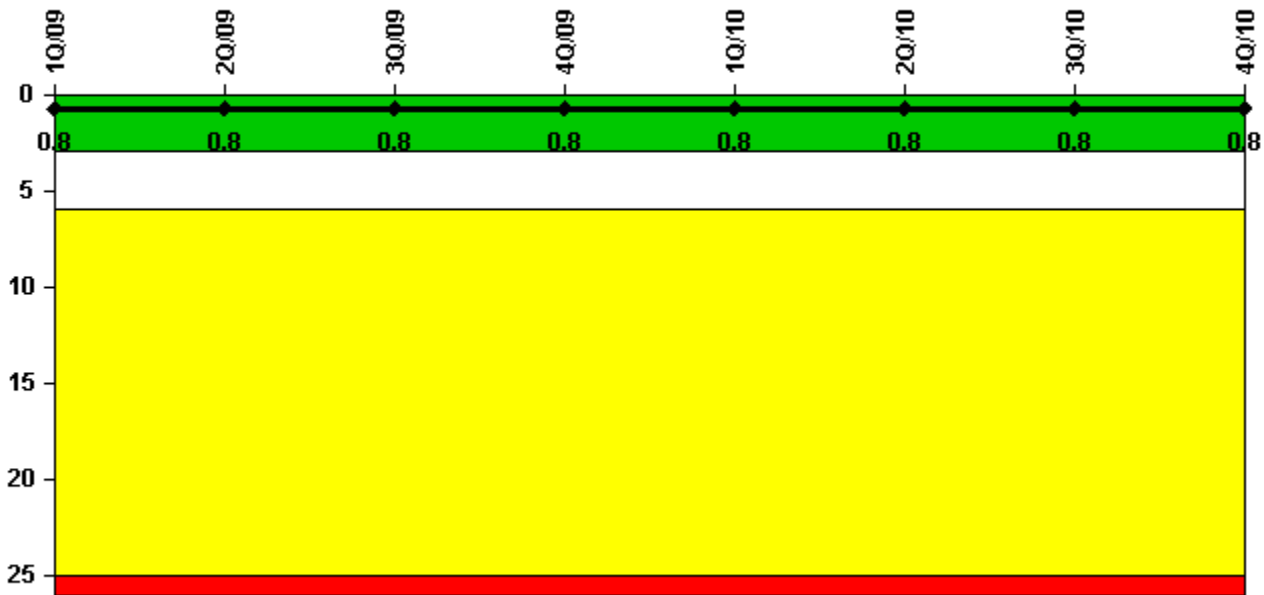


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Unplanned scrams	0	0	0	1.0	0	0	0	1.0
Critical hours	1896.3	1988.9	2208.0	2151.4	2159.0	2184.0	2208.0	2138.5
Indicator value	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

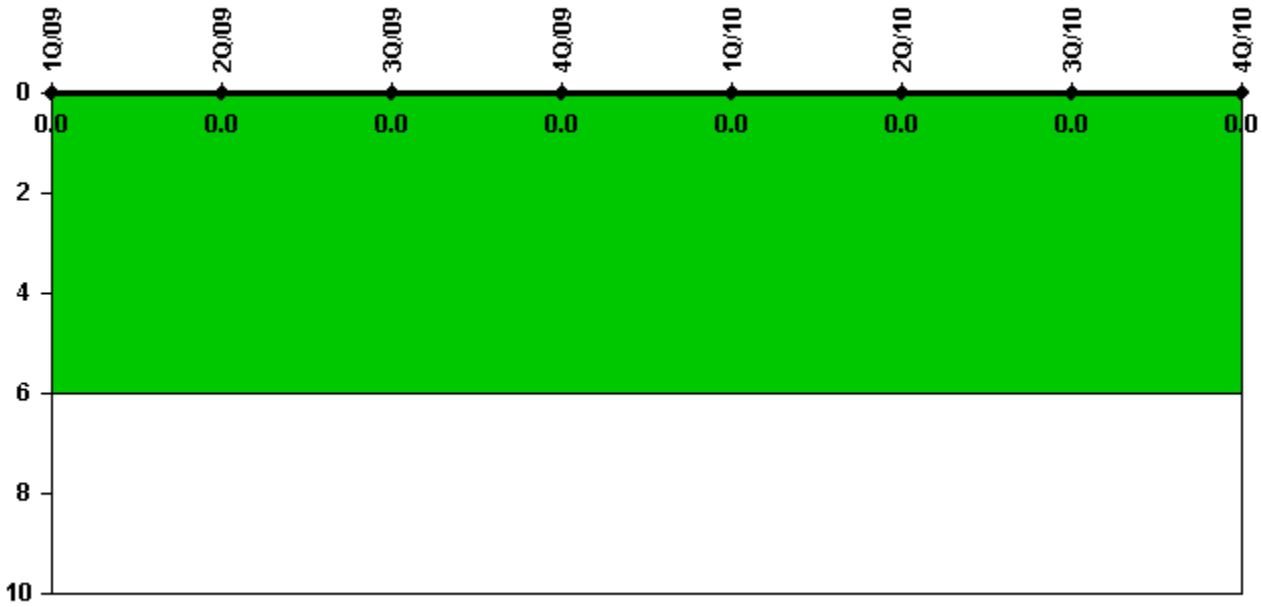


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1896.3	1988.9	2208.0	2151.4	2159.0	2184.0	2208.0	2138.5
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

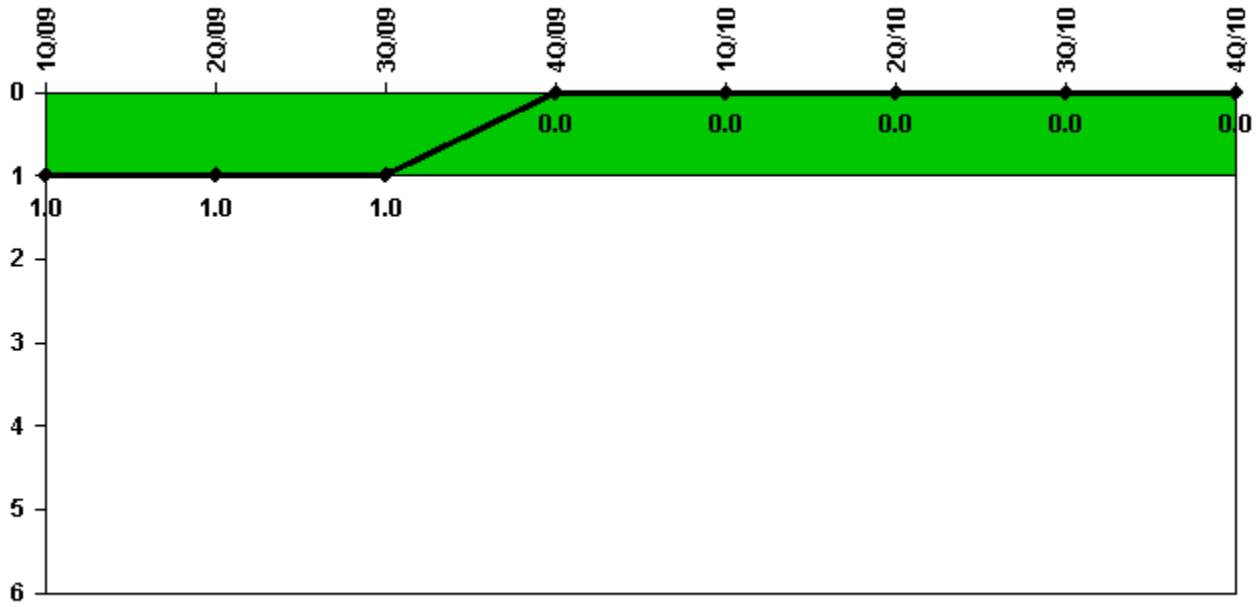


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

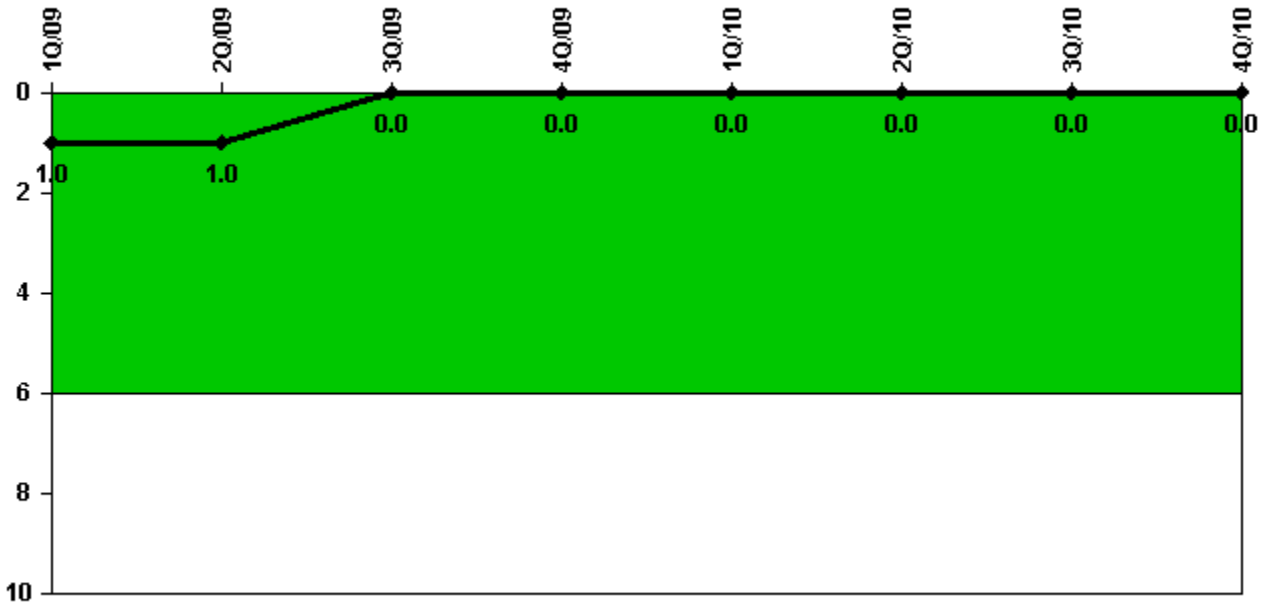


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	1	1	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

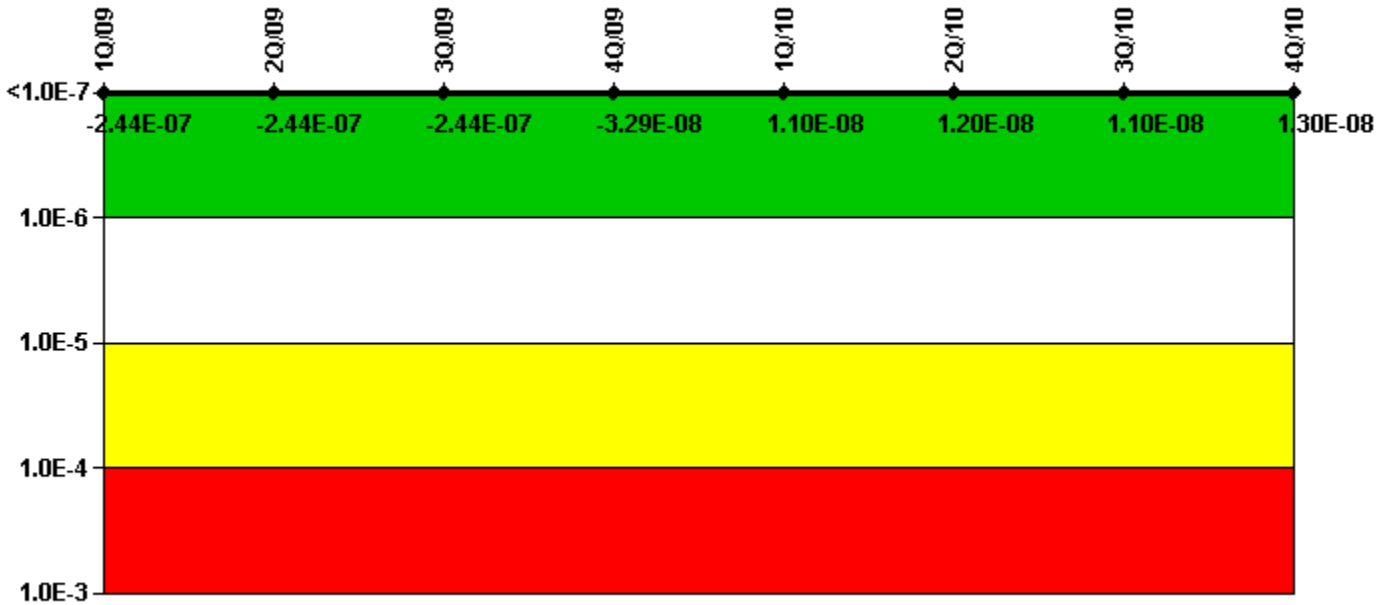


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
UAI (Δ CDF)	-4.40E-08	-4.40E-08	-4.40E-08	-5.90E-09	-4.06E-09	-4.26E-09	-4.26E-09	-4.25E-09
URI (Δ CDF)	-2.00E-07	-2.00E-07	-2.00E-07	-2.70E-08	1.55E-08	1.58E-08	1.57E-08	1.72E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.44E-07	-2.44E-07	-2.44E-07	-3.29E-08	1.10E-08	1.20E-08	1.10E-08	1.30E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

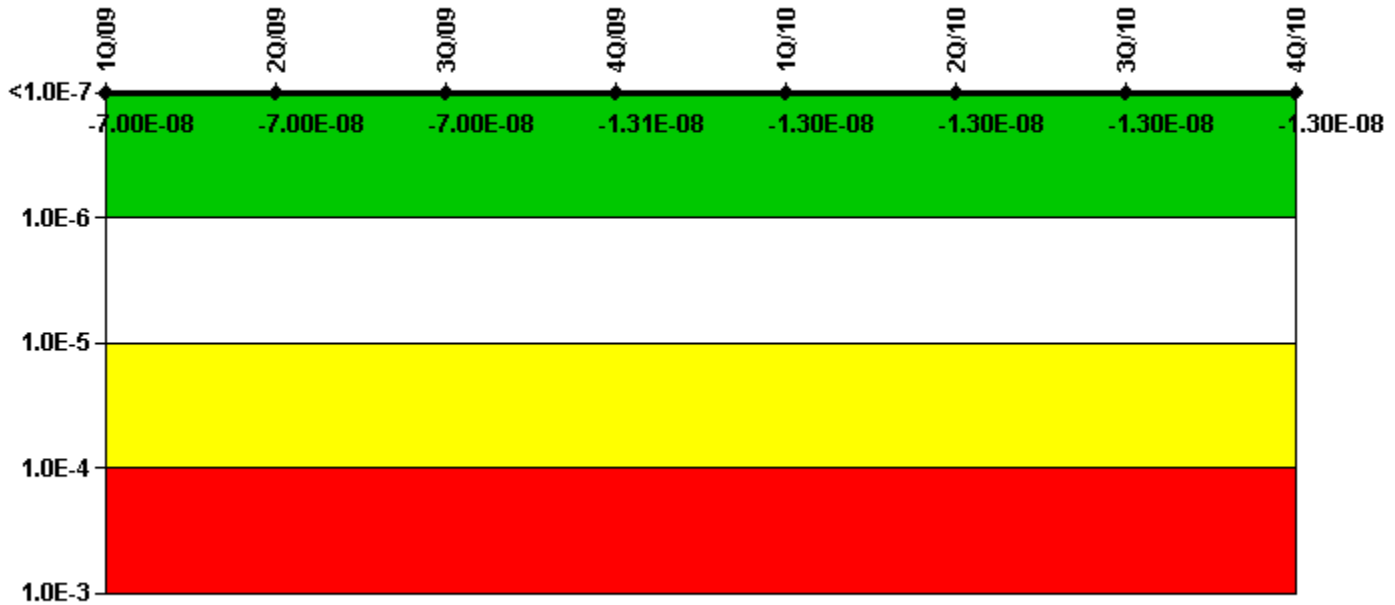


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
UAI (Δ CDF)	-5.60E-08	-5.60E-08	-5.60E-08	-1.10E-08	-1.13E-08	-1.13E-08	-1.13E-08	-1.13E-08
URI (Δ CDF)	-1.40E-08	-1.40E-08	-1.40E-08	-2.10E-09	-2.14E-09	-1.92E-09	-1.90E-09	-1.98E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.00E-08	-7.00E-08	-7.00E-08	-1.31E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

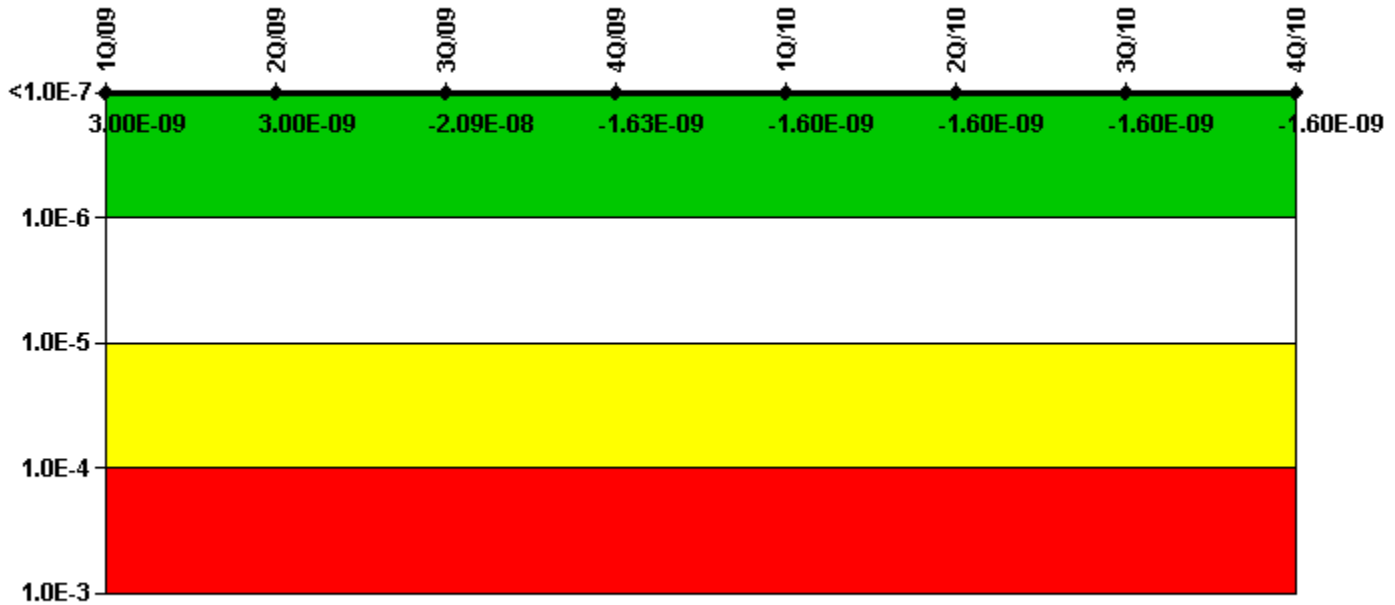


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
UAI (Δ CDF)	1.70E-08	1.70E-08	-6.90E-09	-1.10E-09	-1.10E-09	-1.11E-09	-1.11E-09	-1.11E-09
URI (Δ CDF)	-1.40E-08	-1.40E-08	-1.40E-08	-5.30E-10	-5.12E-10	-5.00E-10	-5.06E-10	-4.98E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.00E-09	3.00E-09	-2.09E-08	-1.63E-09	-1.60E-09	-1.60E-09	-1.60E-09	-1.60E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

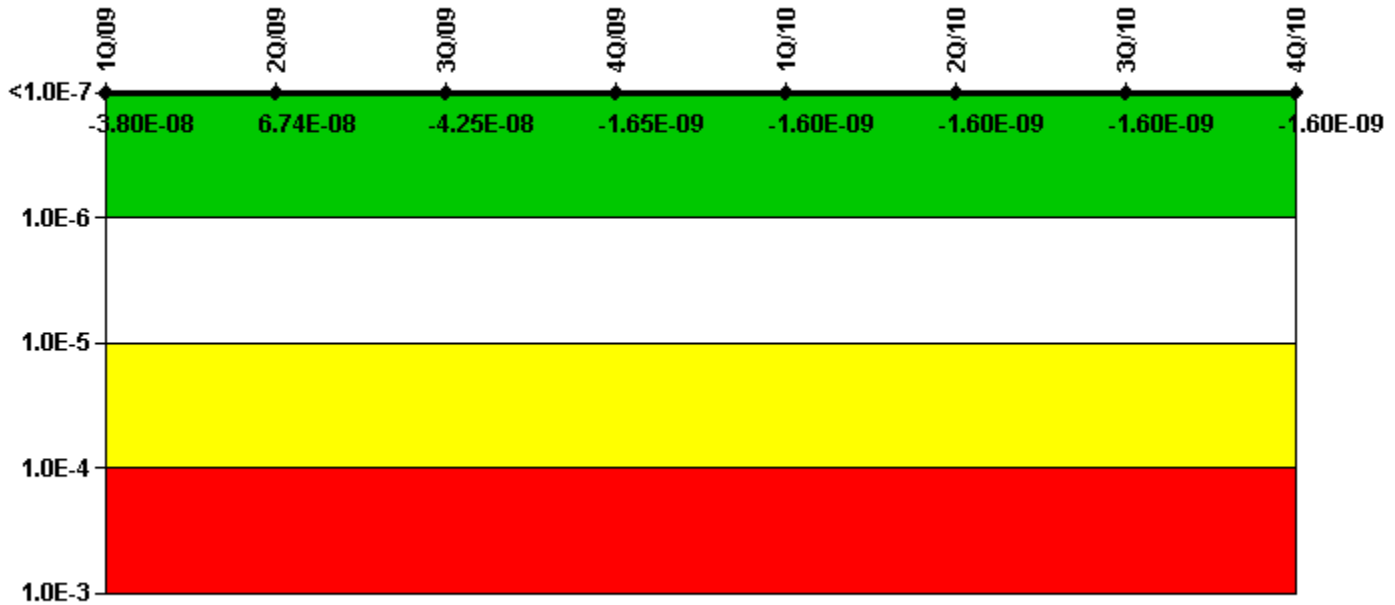

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
UAI (Δ CDF)	-3.00E-08	7.60E-08	-3.40E-08	-1.50E-10	-1.46E-10	-1.47E-10	-1.47E-10	-1.47E-10
URI (Δ CDF)	-8.00E-09	-8.60E-09	-8.50E-09	-1.50E-09	-1.48E-09	-1.45E-09	-1.43E-09	-1.44E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.80E-08	6.74E-08	-4.25E-08	-1.65E-09	-1.60E-09	-1.60E-09	-1.60E-09	-1.60E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
UAI (Δ CDF)	-9.20E-08	2.10E-08	-1.10E-07	-1.50E-08	-1.56E-08	-1.57E-08	-1.57E-08	-1.57E-08
URI (Δ CDF)	-3.60E-08	-3.70E-08	-3.70E-08	-7.30E-10	-7.14E-10	-7.12E-10	1.33E-08	1.33E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.28E-07	-1.60E-08	-1.47E-07	-1.57E-08	-1.60E-08	-1.60E-08	-2.40E-09	-2.40E-09

Licensee Comments: none

Reactor Coolant System Activity

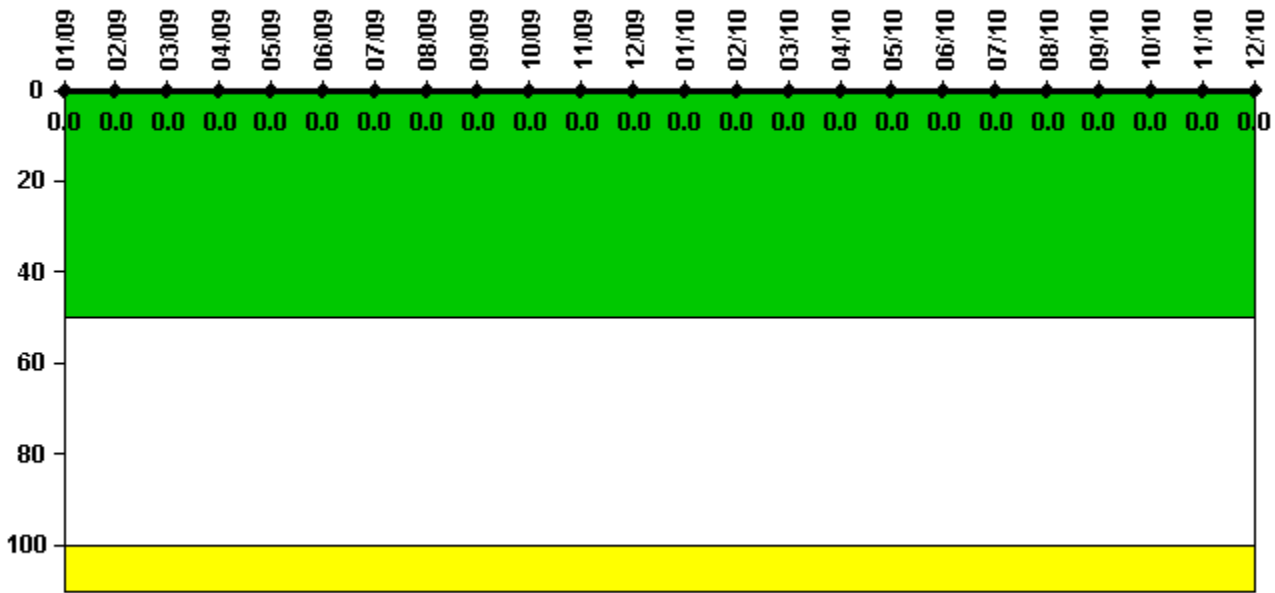


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09
Maximum activity	0.000006	0.000007	0.000005	0.000010	0.000014	0.000009	0.000006	0.000005	0.000006	0.000007	0.000006	0.000007
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10
Maximum activity	0.000005	0.000006	0.000005	0.000006	0.000008	0.000006	0.000006	0.000005	0.000008	0.000007	0.000007	0.000005
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

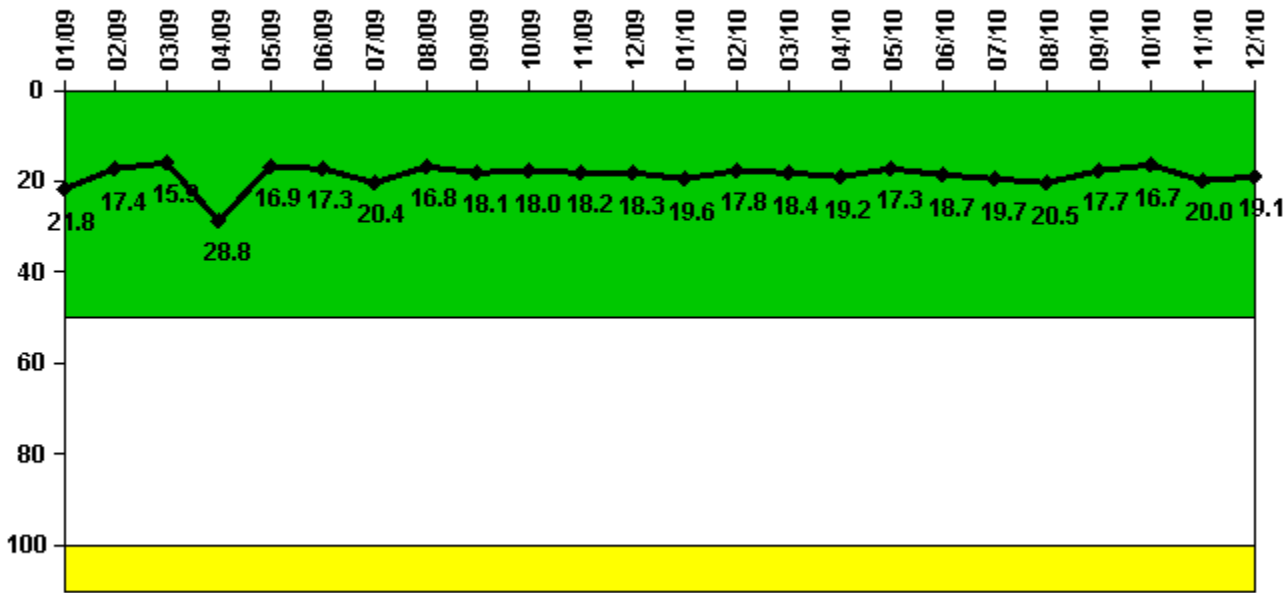


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/09	2/09	3/09	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09
Maximum leakage	5.456	4.360	3.974	7.207	4.216	4.337	5.088	4.199	4.521	4.500	4.561	4.566
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	21.8	17.4	15.9	28.8	16.9	17.3	20.4	16.8	18.1	18.0	18.2	18.3
Reactor Coolant System Leakage	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10
Maximum leakage	4.901	4.451	4.603	4.810	4.320	4.680	4.921	5.118	4.434	4.170	5.001	4.785
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	19.6	17.8	18.4	19.2	17.3	18.7	19.7	20.5	17.7	16.7	20.0	19.1

Licensee Comments: none

Drill/Exercise Performance

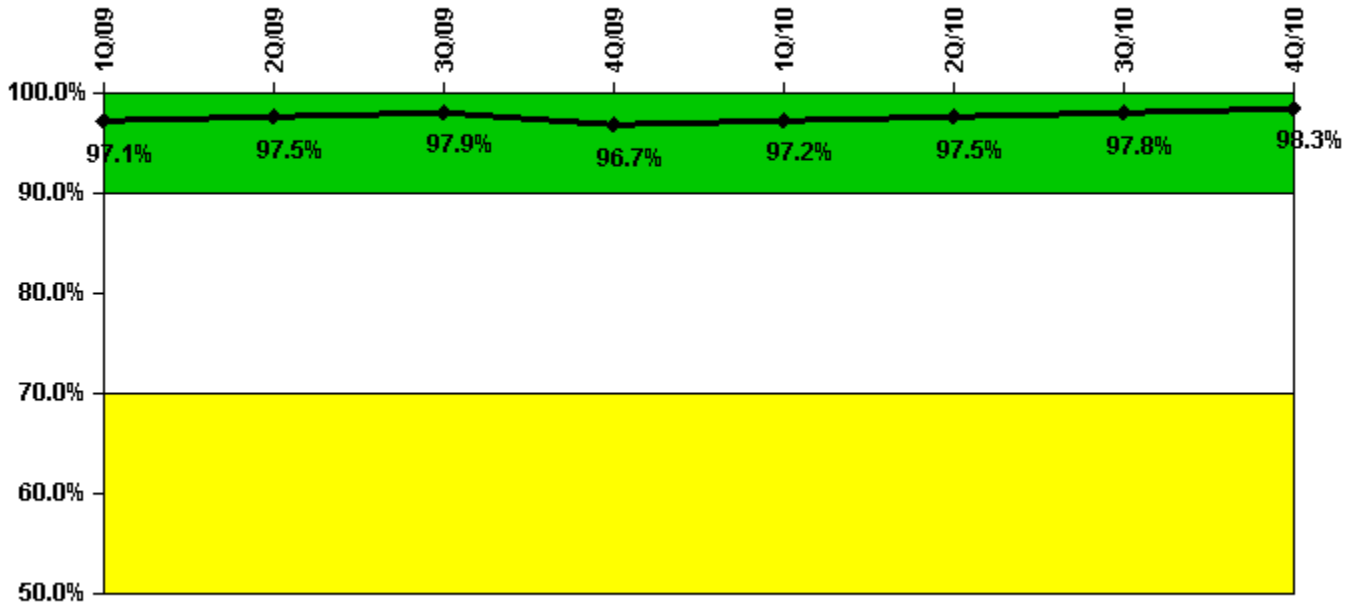


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Successful opportunities	34.0	20.0	68.0	87.0	45.0	14.0	21.0	50.0
Total opportunities	35.0	20.0	70.0	88.0	46.0	14.0	21.0	51.0
Indicator value	97.1%	97.5%	97.9%	96.7%	97.2%	97.5%	97.8%	98.3%

Licensee Comments: none

ERO Drill Participation

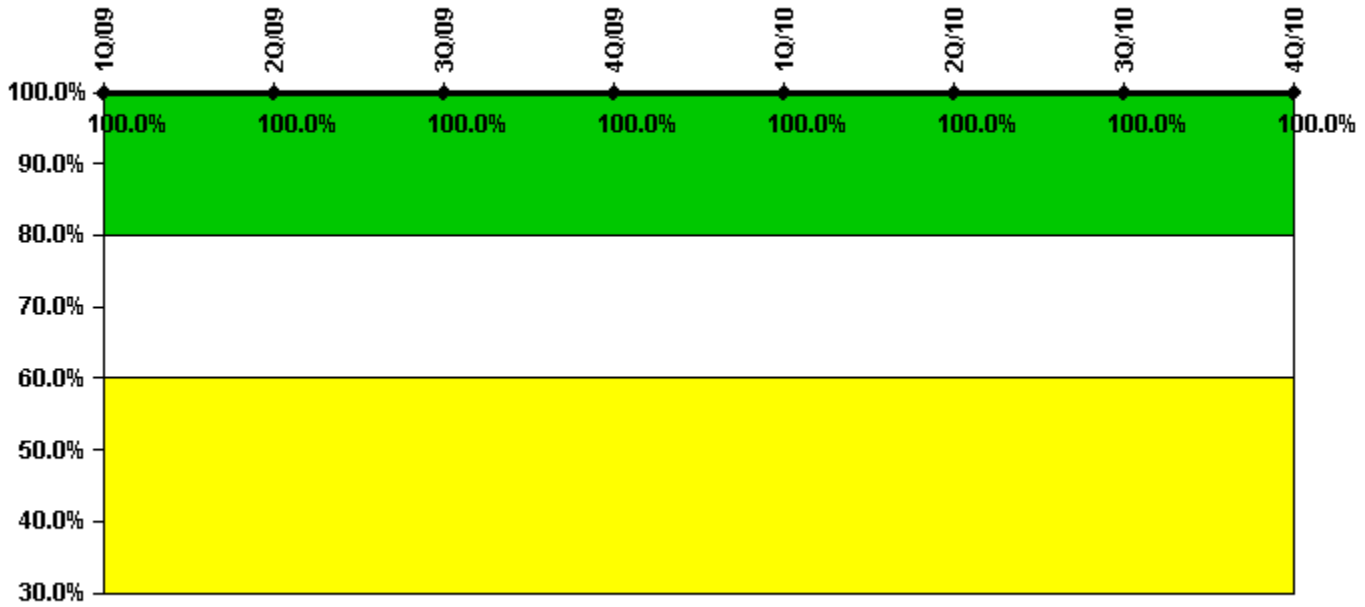


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Participating Key personnel	93.0	93.0	92.0	97.0	103.0	102.0	101.0	96.0
Total Key personnel	93.0	93.0	92.0	97.0	103.0	102.0	101.0	96.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

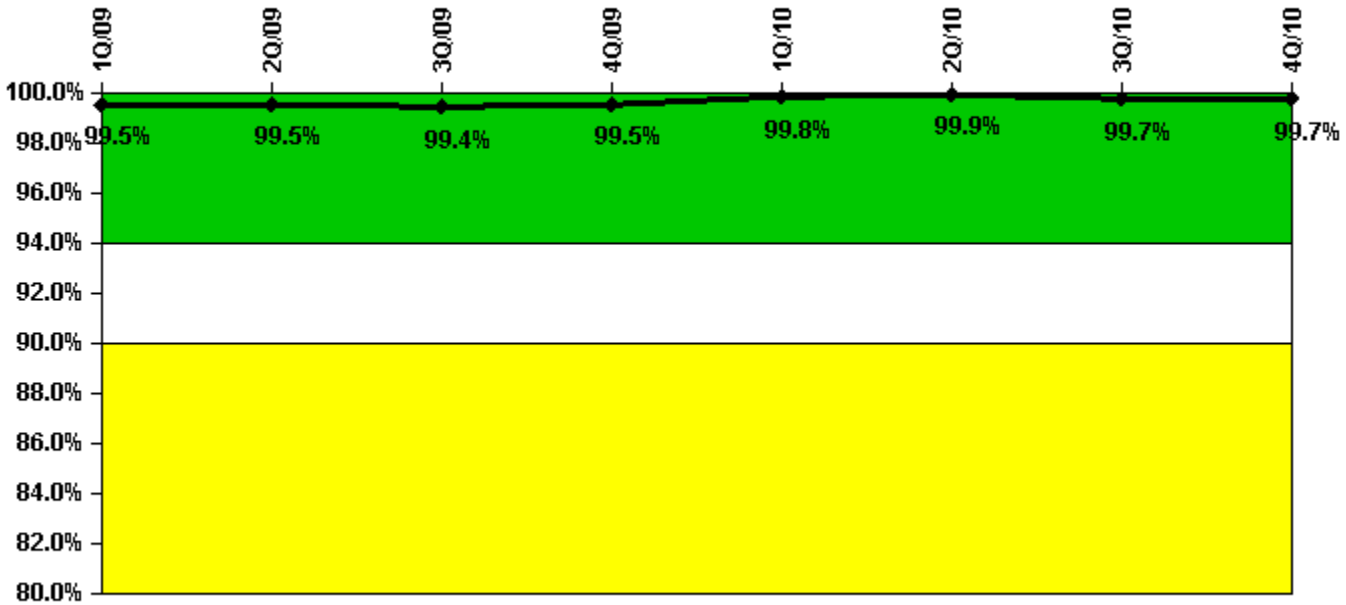

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
Successful siren-tests	256	258	258	296	259	259	256	296
Total sirens-tests	259	259	259	296	259	259	259	296
Indicator value	99.5%	99.5%	99.4%	99.5%	99.8%	99.9%	99.7%	99.7%

Licensee Comments:

3Q/10: Change reflect correction to Successful siren-test and Total siren-test for August 2010. They were reported as 74 each. The actual numbers should have been 111 each. This change has no impact on the color of the indicator which continues to be in GREEN

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/09	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.