


Catawba 2

1Q/2011 Performance Indicators

Licensee's General Comments: Average unplanned UA across all KC Trains per NEI 99-02, Rev. 6 guidance. This change is reflected in the MSPI, CCW Basis.

Unplanned Scrams per 7000 Critical Hrs

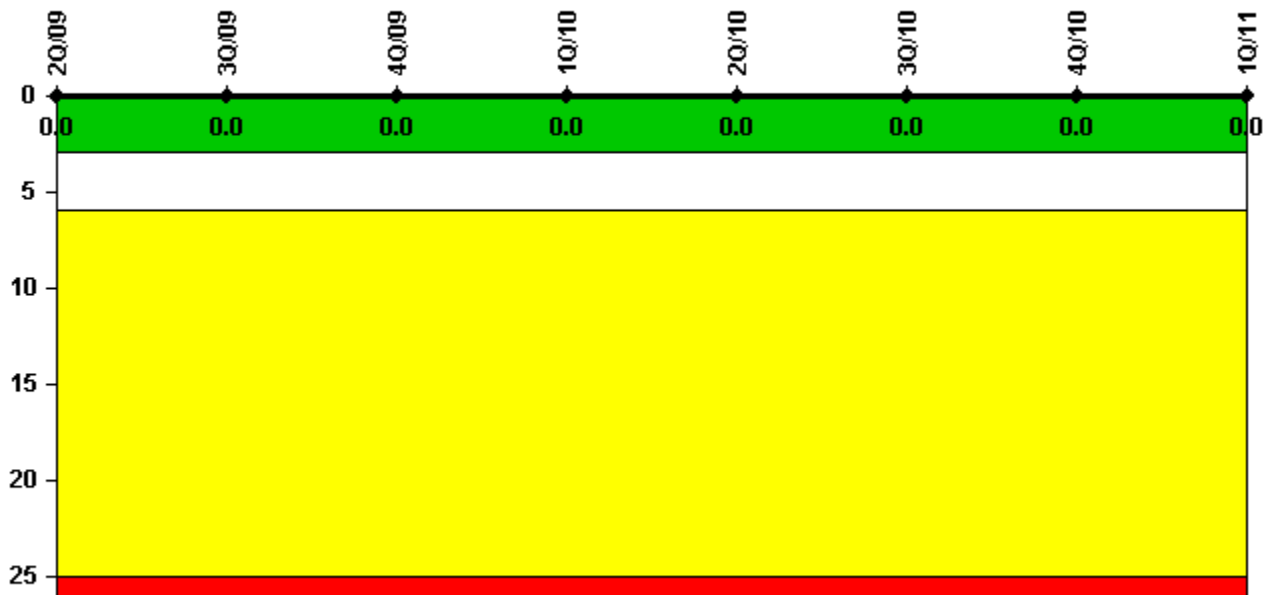


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1767.0	2208.0	2209.0	2159.0	2184.0	1900.3	1734.9	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

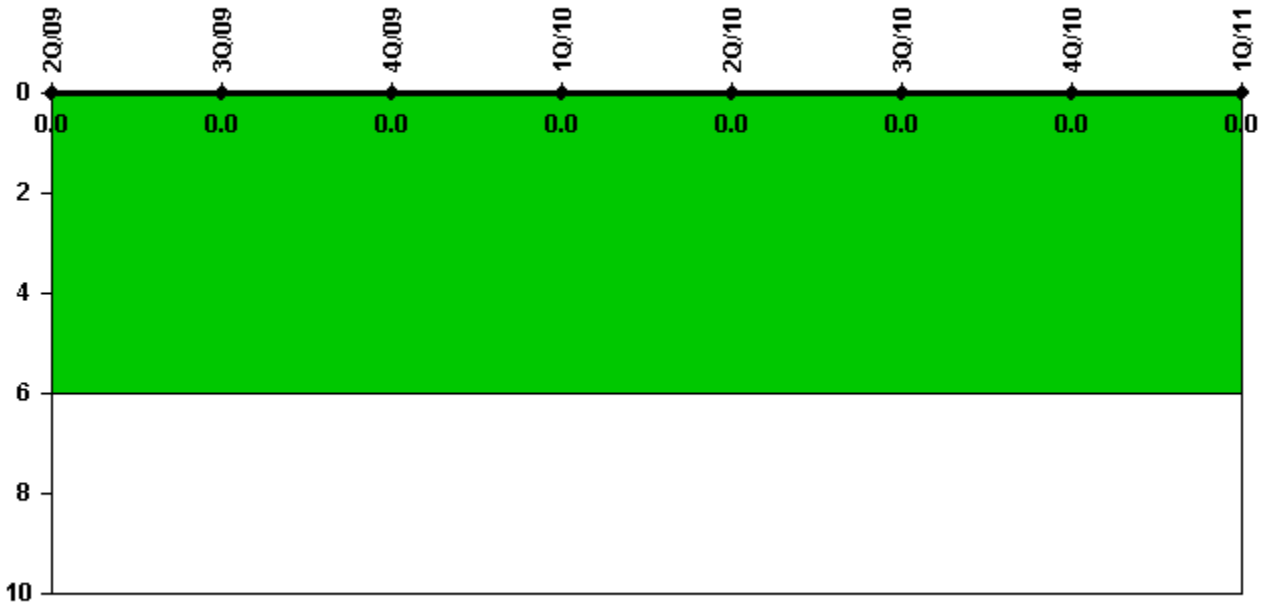


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1767.0	2208.0	2209.0	2159.0	2184.0	1900.3	1734.9	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

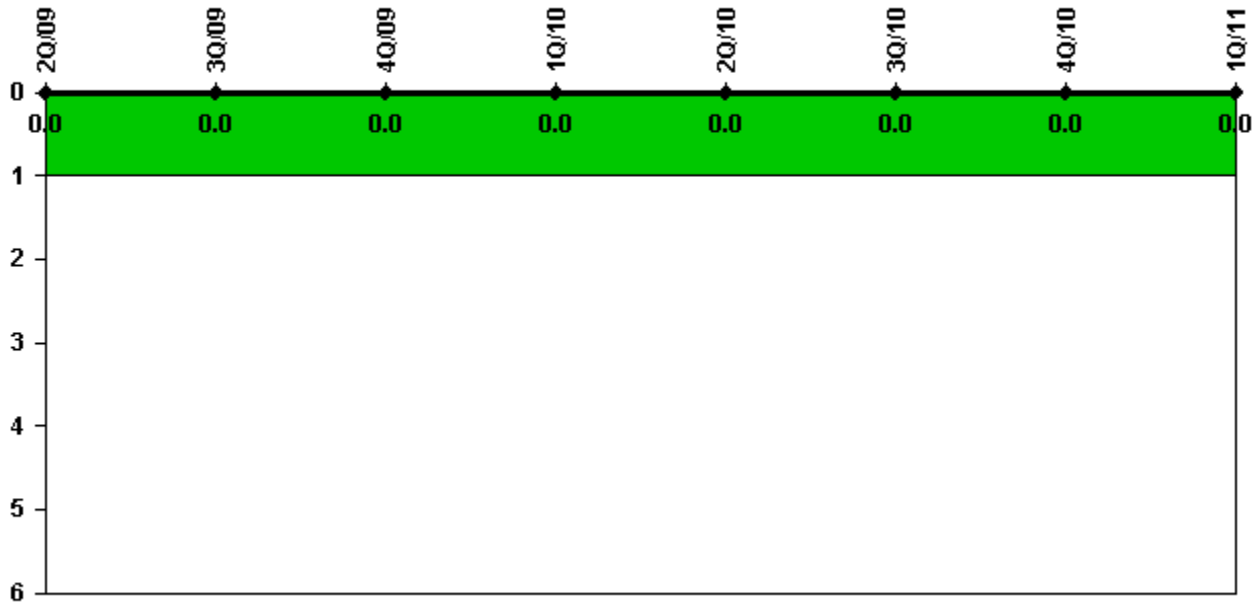


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

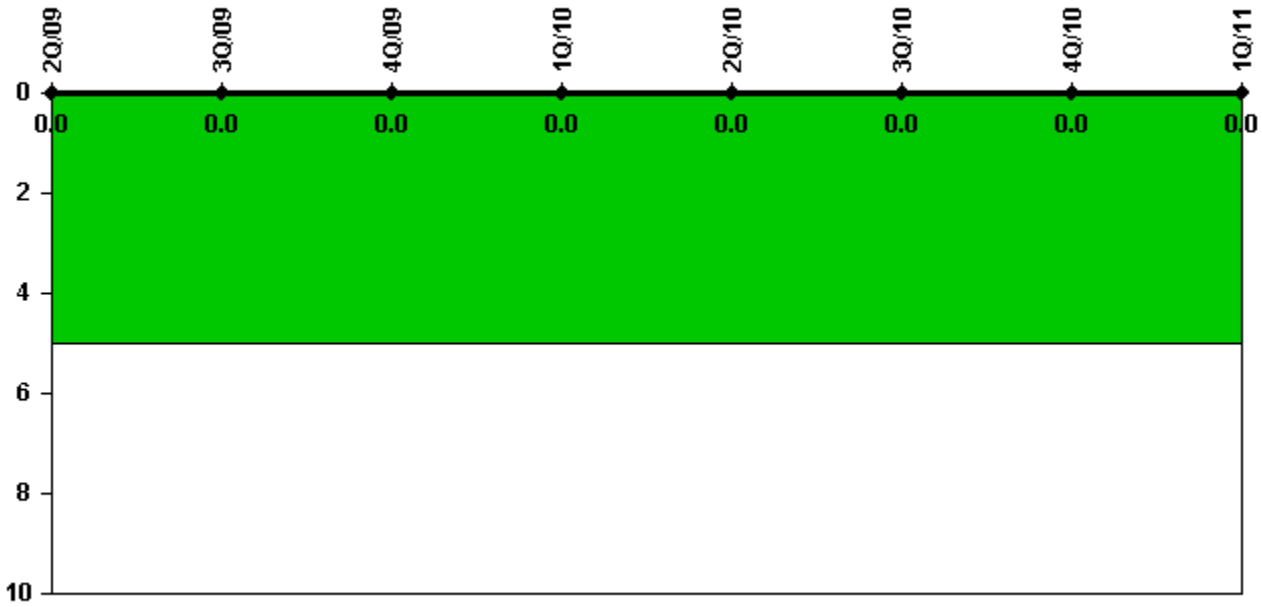


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

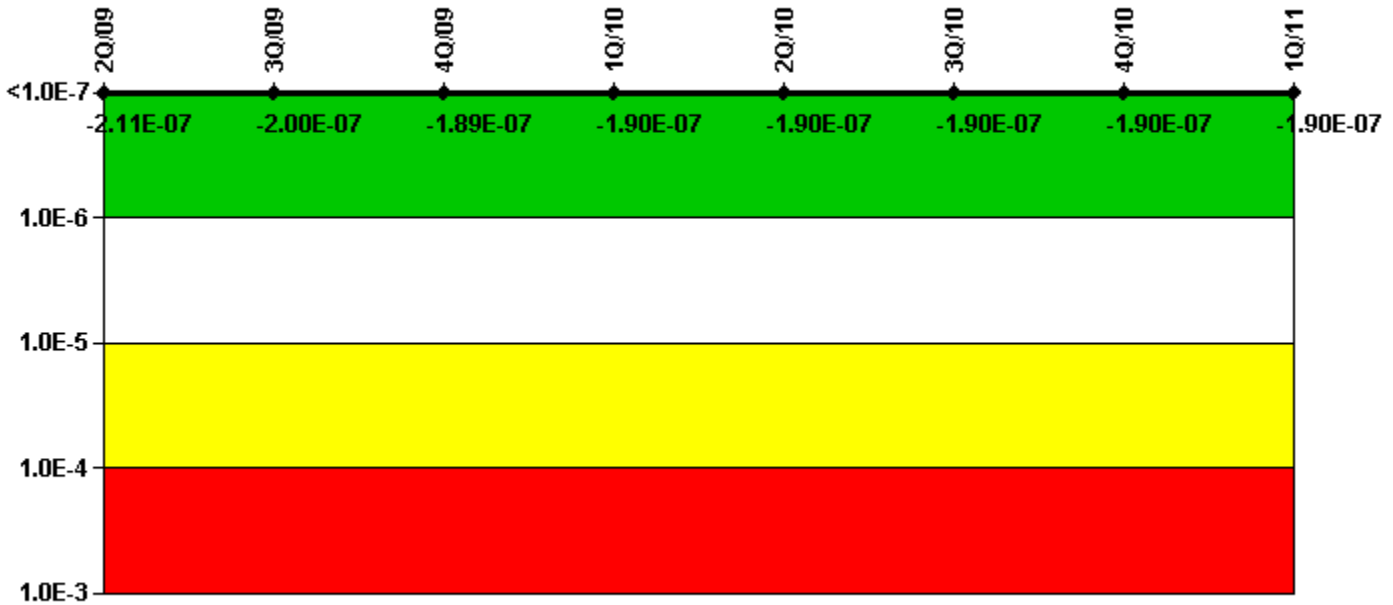

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-2.10E-08	-9.70E-09	5.80E-10	2.13E-09	-3.00E-09	-1.06E-09	-3.12E-09	-3.77E-09
URI (Δ CDF)	-1.90E-07	-1.90E-07	-1.90E-07	-1.91E-07	-1.91E-07	-1.90E-07	-1.90E-07	-1.90E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.11E-07	-2.00E-07	-1.89E-07	-1.90E-07	-1.90E-07	-1.90E-07	-1.90E-07	-1.90E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-4.40E-09	-4.40E-09	-4.40E-09	-4.44E-09	-4.44E-09	-4.44E-09	-4.44E-09	-4.26E-09
URI (Δ CDF)	-1.30E-08	-1.30E-08	-1.30E-08	-1.32E-08	-1.32E-08	-1.32E-08	-1.32E-08	-1.32E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.74E-08	-1.74E-08	-1.74E-08	-1.80E-08	-1.80E-08	-1.80E-08	-1.80E-08	-1.70E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

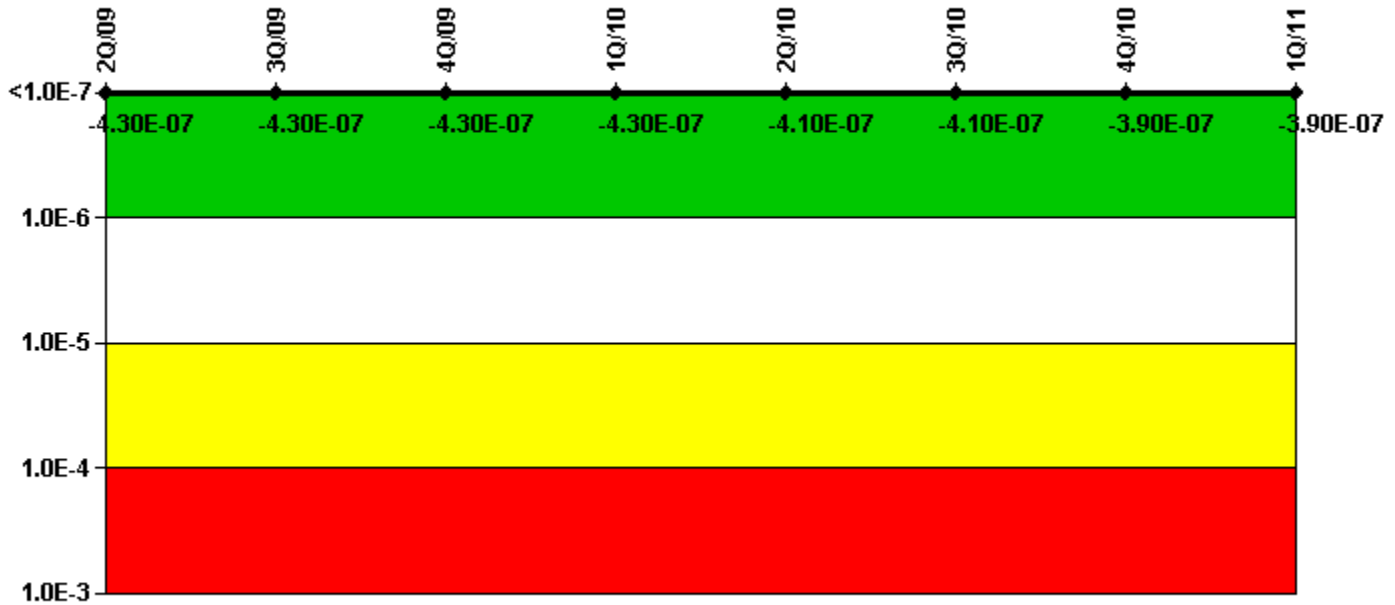


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-1.14E-07	-1.14E-07	-1.14E-07	-1.14E-07	-9.71E-08	-9.71E-08	-7.33E-08	-7.33E-08
URI (Δ CDF)	-3.17E-07	-3.17E-07	-3.17E-07	-3.17E-07	-3.17E-07	-3.17E-07	-3.17E-07	-3.17E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.30E-07	-4.30E-07	-4.30E-07	-4.30E-07	-4.10E-07	-4.10E-07	-3.90E-07	-3.90E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

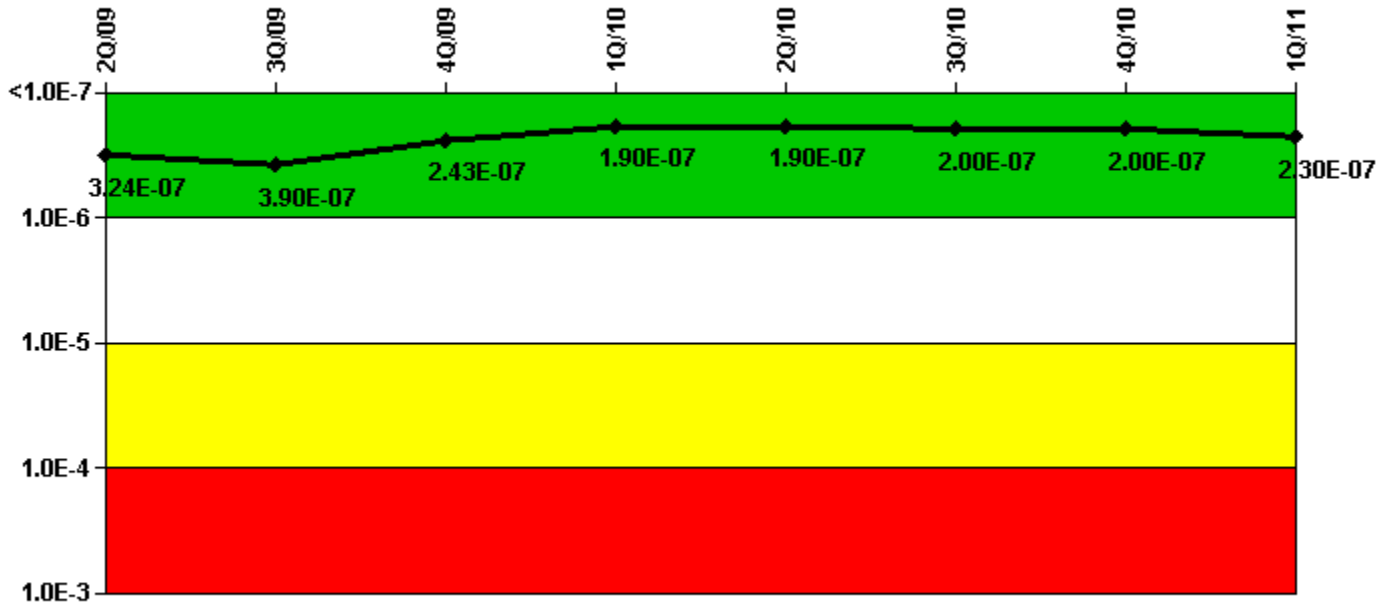

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	5.40E-08	1.20E-07	-2.70E-08	-2.67E-08	-2.67E-08	-1.52E-08	-1.93E-08	6.44E-09
URI (Δ CDF)	2.70E-07	2.70E-07	2.70E-07	2.20E-07	2.20E-07	2.20E-07	2.20E-07	2.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.24E-07	3.90E-07	2.43E-07	1.90E-07	1.90E-07	2.00E-07	2.00E-07	2.30E-07

Licensee Comments:

1Q/11: Risk Cap Invoked.

Mitigating Systems Performance Index, Cooling Water Systems

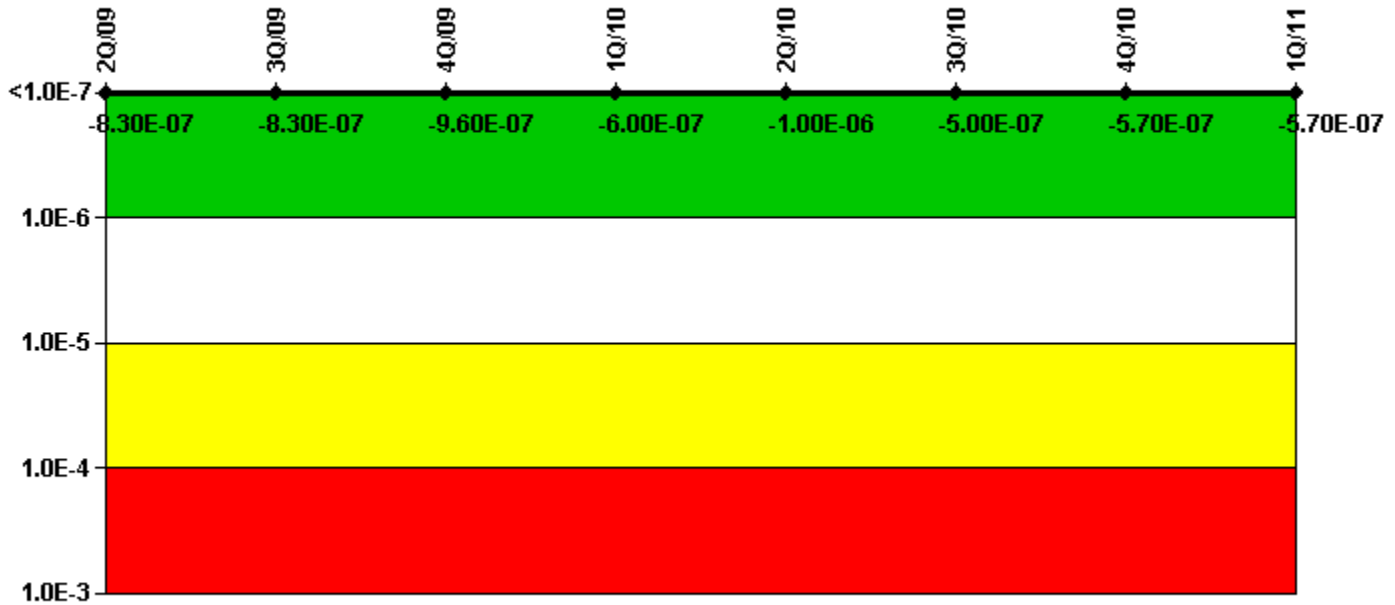


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-4.50E-07	-4.50E-07	-5.80E-07	-2.23E-07	-6.50E-07	-1.95E-07	-2.72E-07	-2.69E-07
URI (Δ CDF)	-3.80E-07	-3.80E-07	-3.80E-07	-3.80E-07	-3.80E-07	-3.01E-07	-3.01E-07	-3.01E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.30E-07	-8.30E-07	-9.60E-07	-6.00E-07	-1.00E-06	-5.00E-07	-5.70E-07	-5.70E-07

Licensee Comments: none

Reactor Coolant System Activity

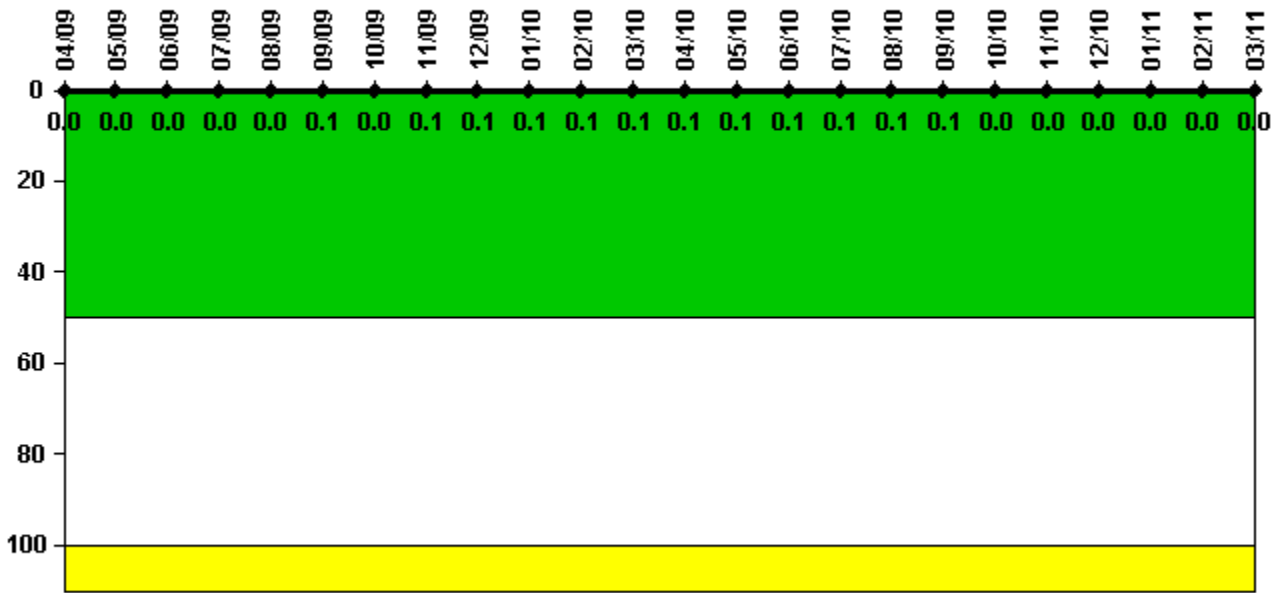


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum activity	0.000143	0.000159	0.000186	0.000173	0.000171	0.000236	0.000221	0.000238	0.000249	0.000262	0.000254	0.000271
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0	0.1	0	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum activity	0.000256	0.000245	0.000262	0.000285	0.000246	0.000230	0.000111	0.000151	0.000140	0.000154	0.000161	0.000168
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

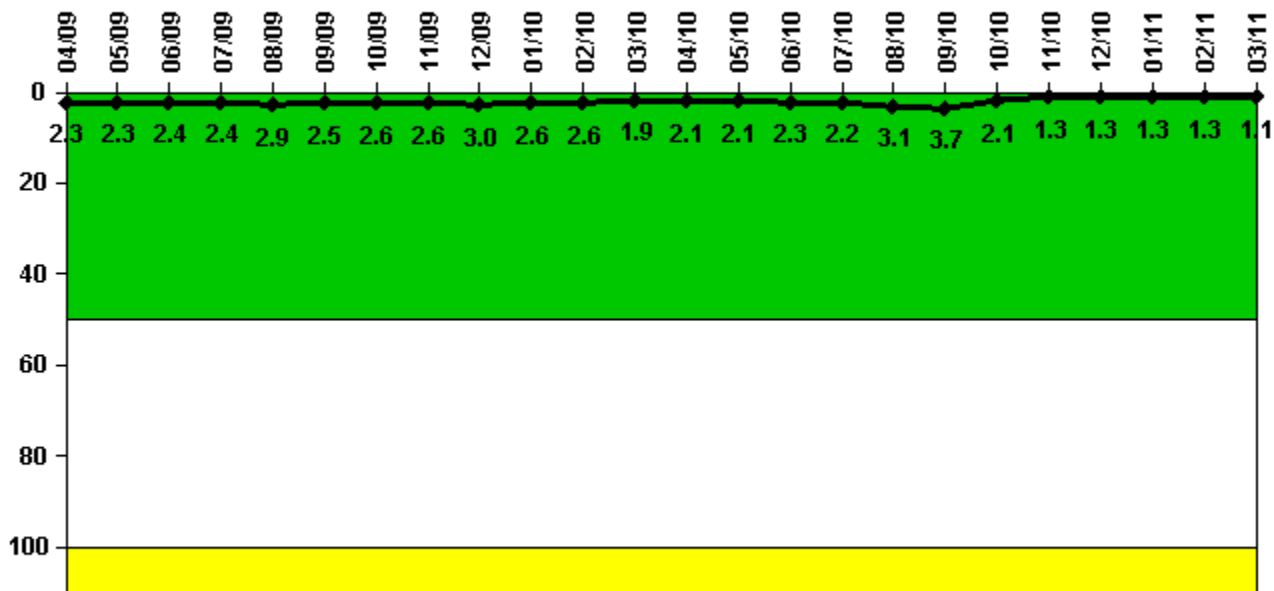


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum leakage	0.231	0.229	0.244	0.237	0.288	0.254	0.262	0.259	0.295	0.258	0.262	0.191
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.3	2.3	2.4	2.4	2.9	2.5	2.6	2.6	3.0	2.6	2.6	1.9
Reactor Coolant System Leakage	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum leakage	0.212	0.208	0.228	0.222	0.305	0.372	0.207	0.130	0.128	0.129	0.128	0.112
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.1	2.1	2.3	2.2	3.1	3.7	2.1	1.3	1.3	1.3	1.3	1.1

Licensee Comments: none

Drill/Exercise Performance

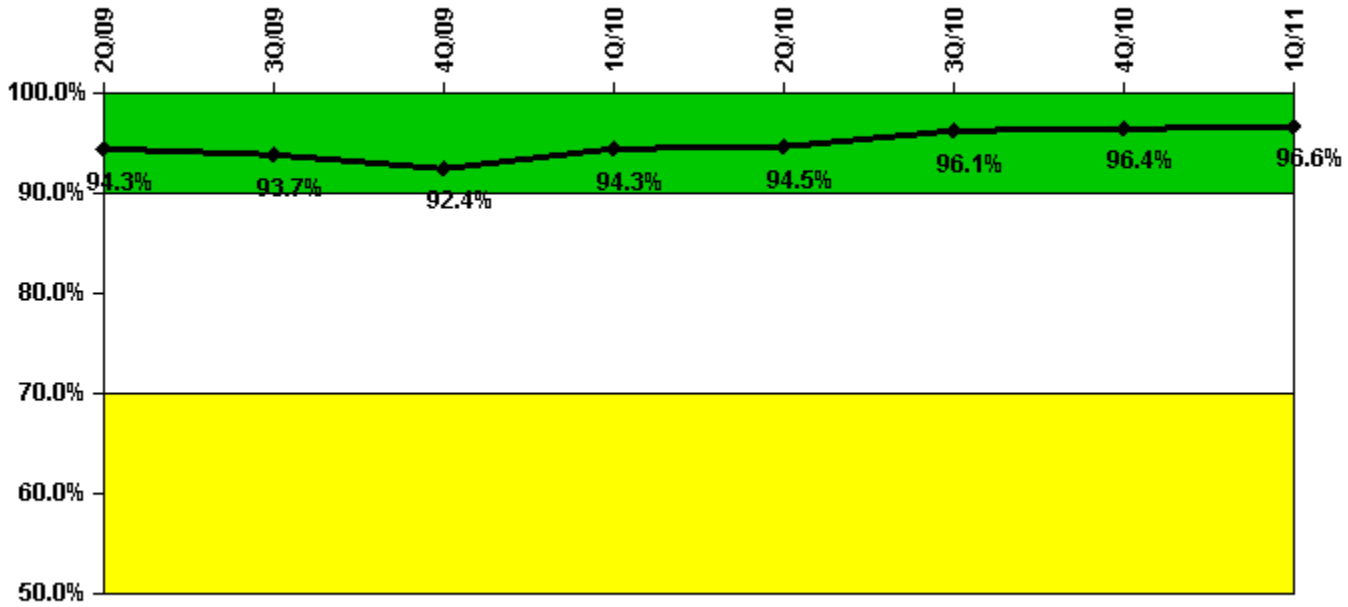


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Successful opportunities	19.0	34.0	15.0	44.0	27.0	41.0	29.0	15.0
Total opportunities	20.0	35.0	18.0	44.0	28.0	42.0	30.0	15.0
Indicator value	94.3%	93.7%	92.4%	94.3%	94.5%	96.1%	96.4%	96.6%

Licensee Comments: none

ERO Drill Participation

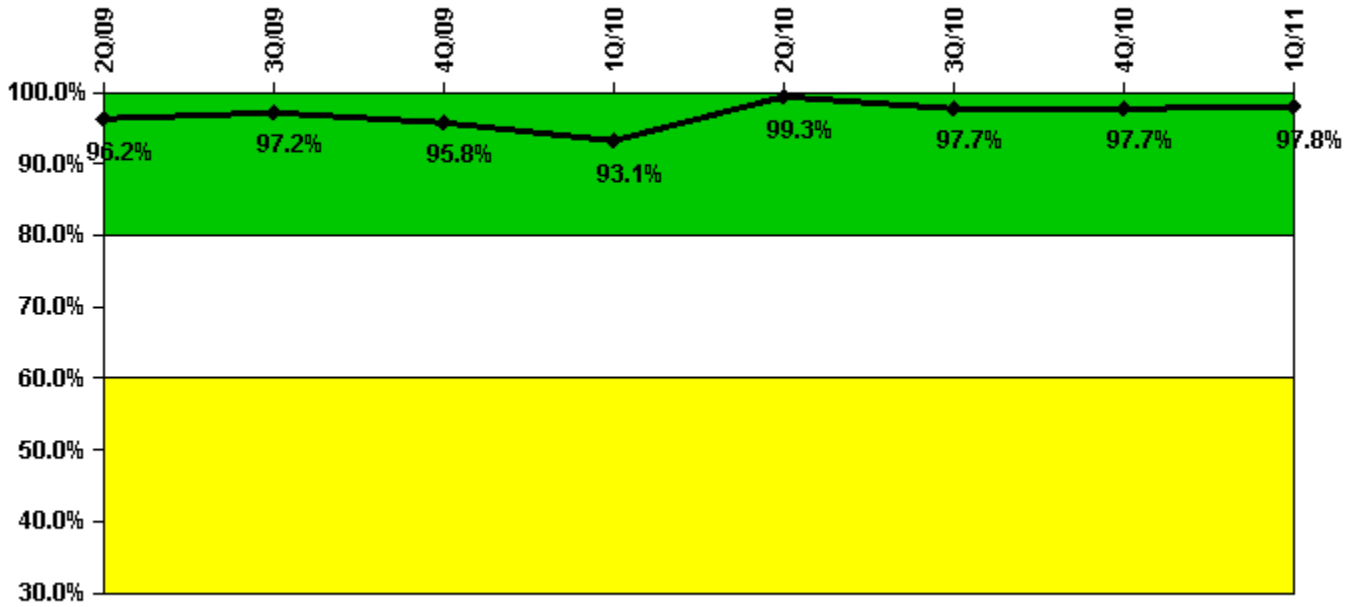

Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Participating Key personnel	128.0	139.0	136.0	134.0	136.0	130.0	129.0	131.0
Total Key personnel	133.0	143.0	142.0	144.0	137.0	133.0	132.0	134.0
Indicator value	96.2%	97.2%	95.8%	93.1%	99.3%	97.7%	97.7%	97.8%

Licensee Comments: none

Alert & Notification System




Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Successful siren-tests	2401	2386	2485	2214	2394	2483	2400	2387
Total sirens-tests	2403	2403	2492	2225	2403	2492	2403	2403
Indicator value	99.4%	99.5%	99.6%	99.6%	99.5%	99.6%	99.7%	99.6%

Licensee Comments: none

Occupational Exposure Control Effectiveness

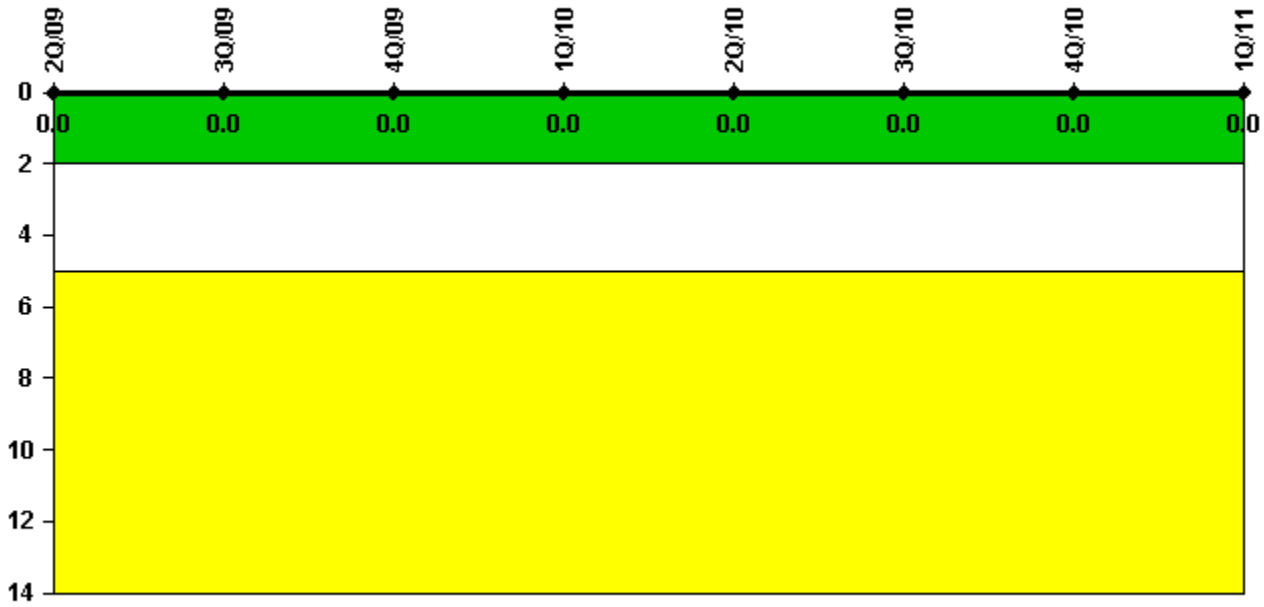


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

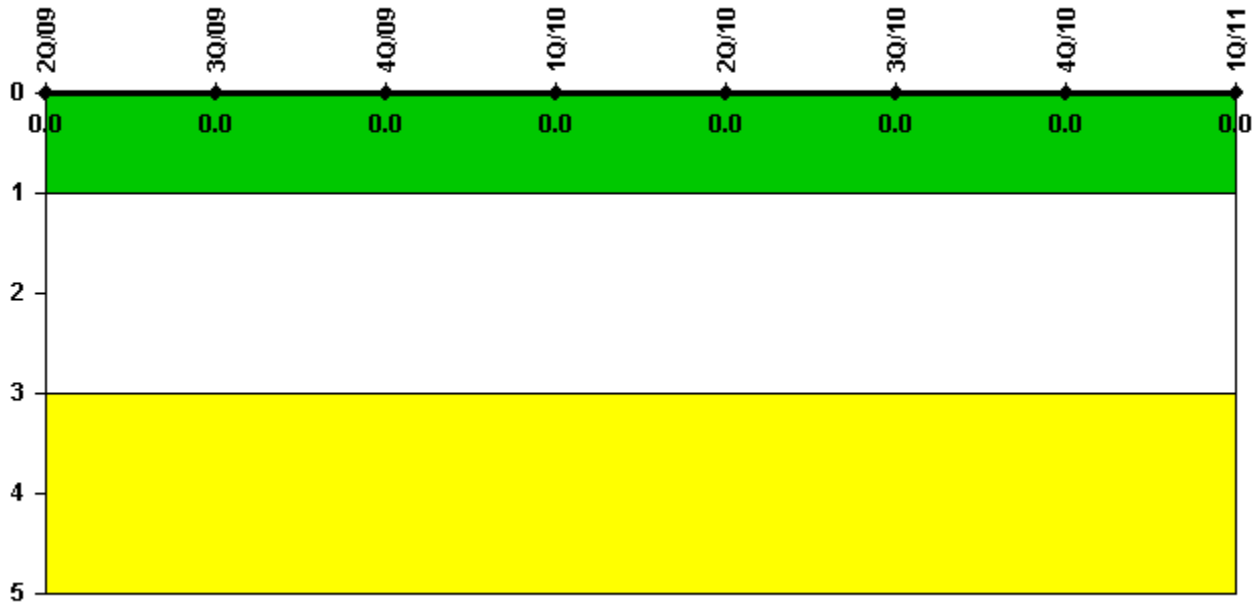

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.