

Clinton

1Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs




Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Unplanned scrams	0	0	1.0	0	0	0	0	0
Critical hours	2184.0	2186.0	1934.4	1585.4	2184.0	2208.0	2209.0	2159.0
Indicator value	0	0	0.8	0.9	0.9	0.9	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

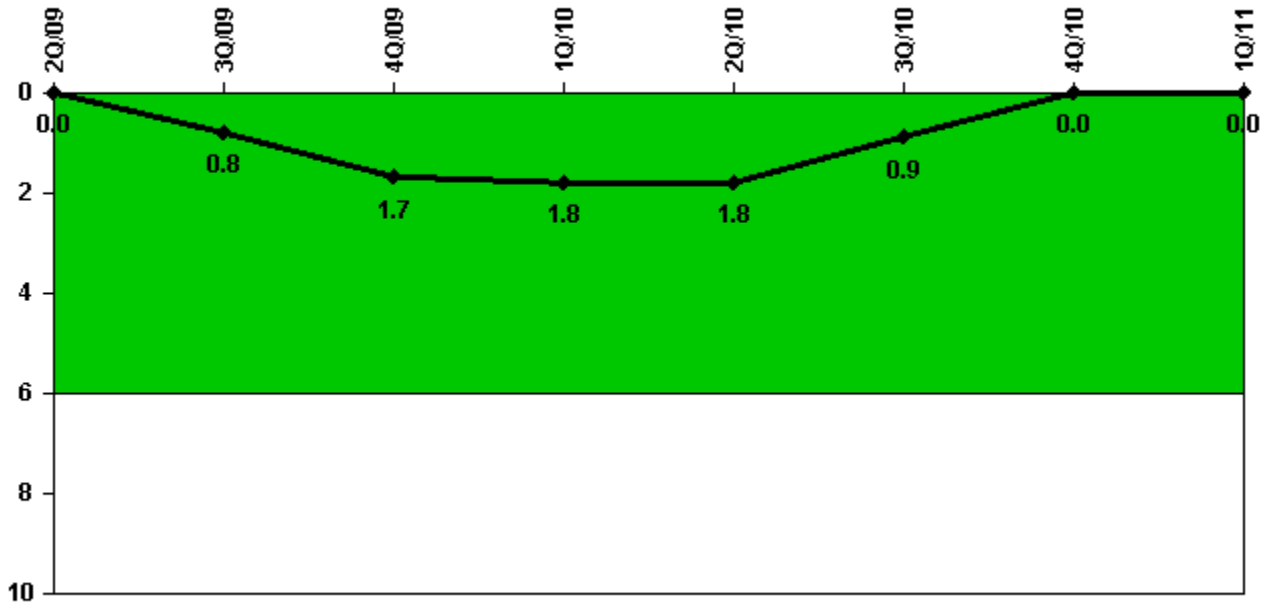


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Unplanned power changes	0	1.0	1.0	0	0	0	0	0
Critical hours	2184.0	2186.0	1934.4	1585.4	2184.0	2208.0	2209.0	2159.0
Indicator value	0	0.8	1.7	1.8	1.8	0.9	0	0

Licensee Comments: none

Unplanned Scrams with Complications

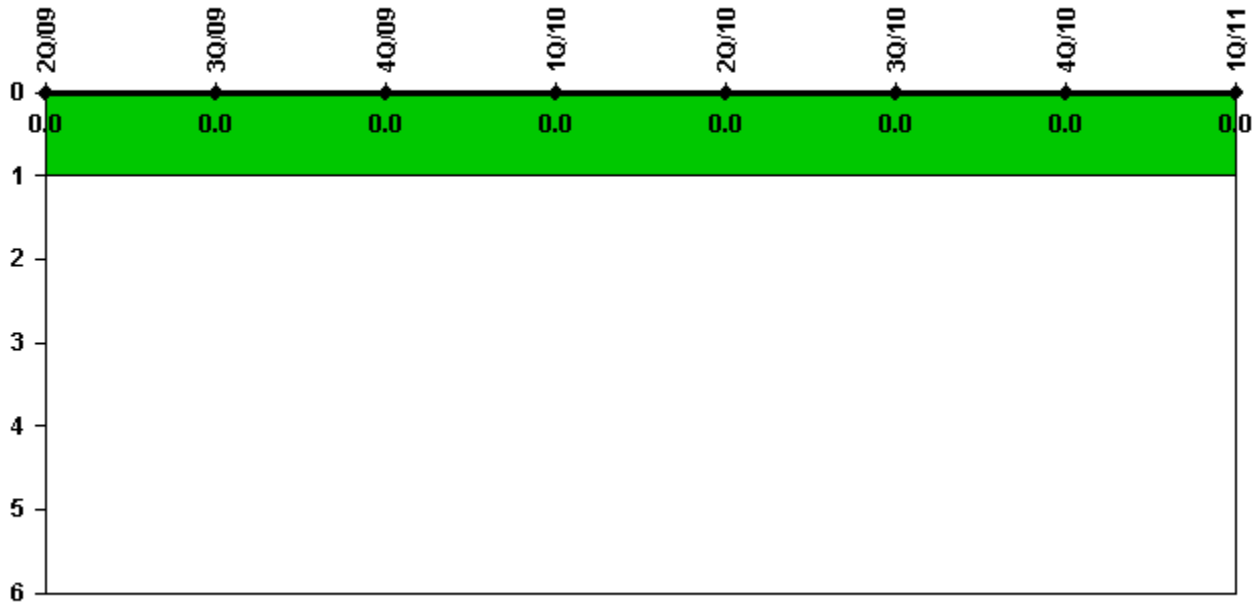


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

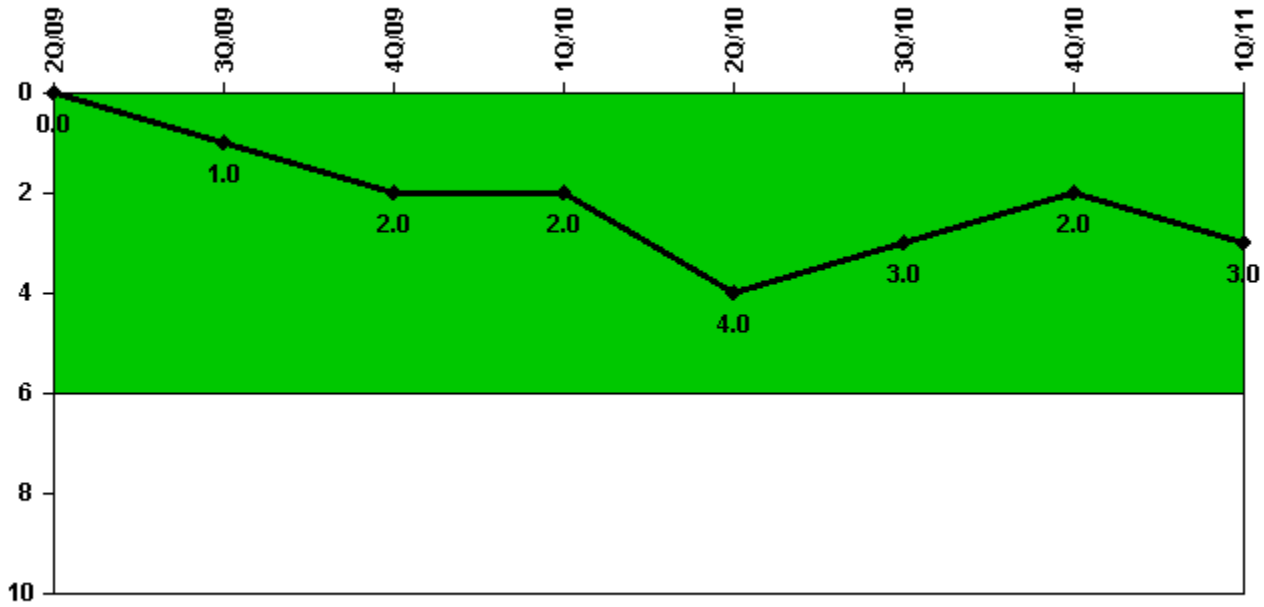

Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Safety System Functional Failures	0	1	1	0	2	0	0	1
Indicator value	0	1	2	2	4	3	2	3

Licensee Comments:

1Q/11: Safety System Functional Failure reported to NRC 1/26/2011 under LER 2010-001-01

Mitigating Systems Performance Index, Emergency AC Power System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-3.60E-08	-3.60E-08	-2.70E-08	-2.13E-08	-2.13E-08	-2.10E-09	3.17E-08	3.56E-08
URI (Δ CDF)	-3.70E-07	-3.70E-07	-1.10E-08	-1.13E-08	-1.13E-08	-1.13E-08	-1.13E-08	-1.13E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.06E-07	-4.06E-07	-3.80E-08	-3.30E-08	-3.30E-08	-1.30E-08	2.00E-08	2.40E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

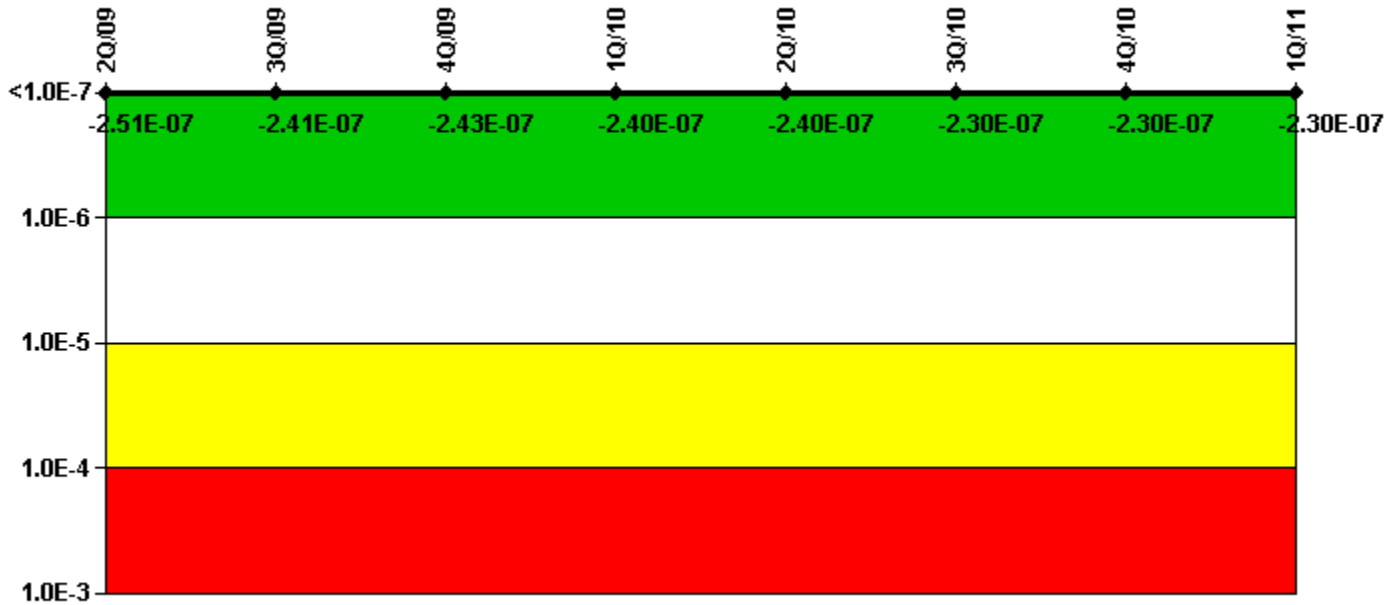


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-6.10E-08	-6.10E-08	-6.30E-08	-6.28E-08	-6.28E-08	-4.42E-08	-4.42E-08	-4.42E-08
URI (Δ CDF)	-1.90E-07	-1.80E-07	-1.80E-07	-1.81E-07	-1.81E-07	-1.81E-07	-1.81E-07	-1.81E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.51E-07	-2.41E-07	-2.43E-07	-2.40E-07	-2.40E-07	-2.30E-07	-2.30E-07	-2.30E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

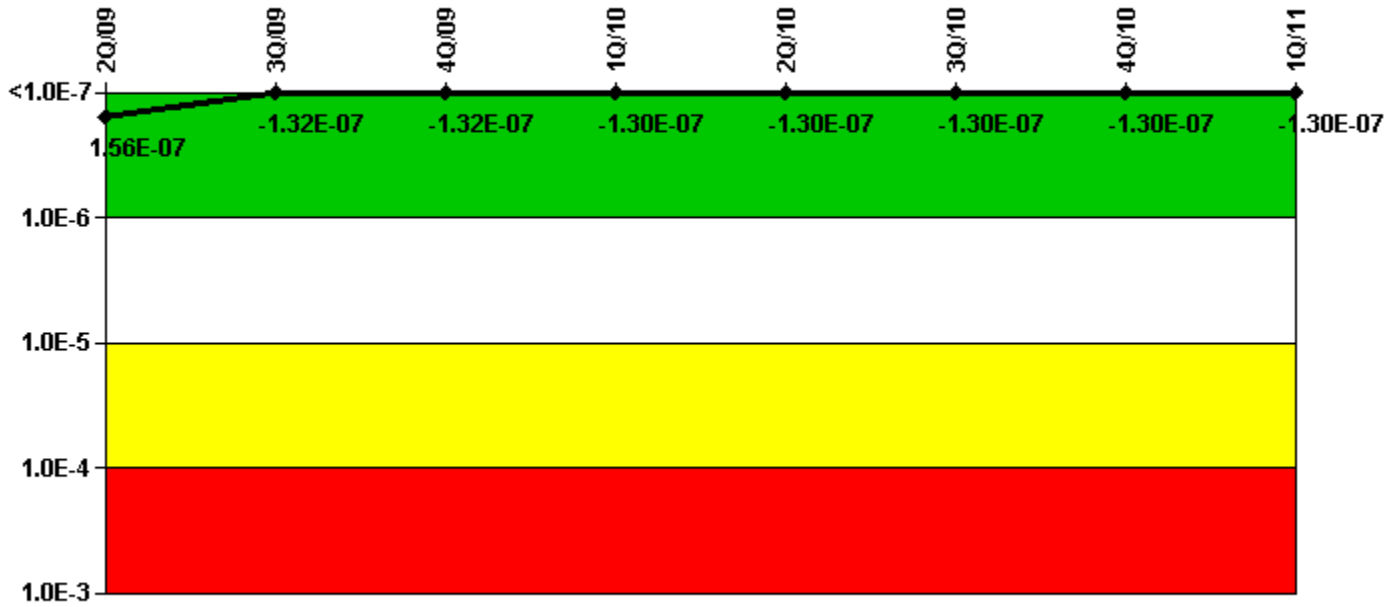


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-3.40E-08	-4.80E-08	-4.80E-08	-4.77E-08	-4.77E-08	-4.77E-08	-4.77E-08	-4.77E-08
URI (Δ CDF)	1.90E-07	-8.40E-08	-8.40E-08	-8.43E-08	-8.43E-08	-8.43E-08	-8.43E-08	-8.43E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.56E-07	-1.32E-07	-1.32E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

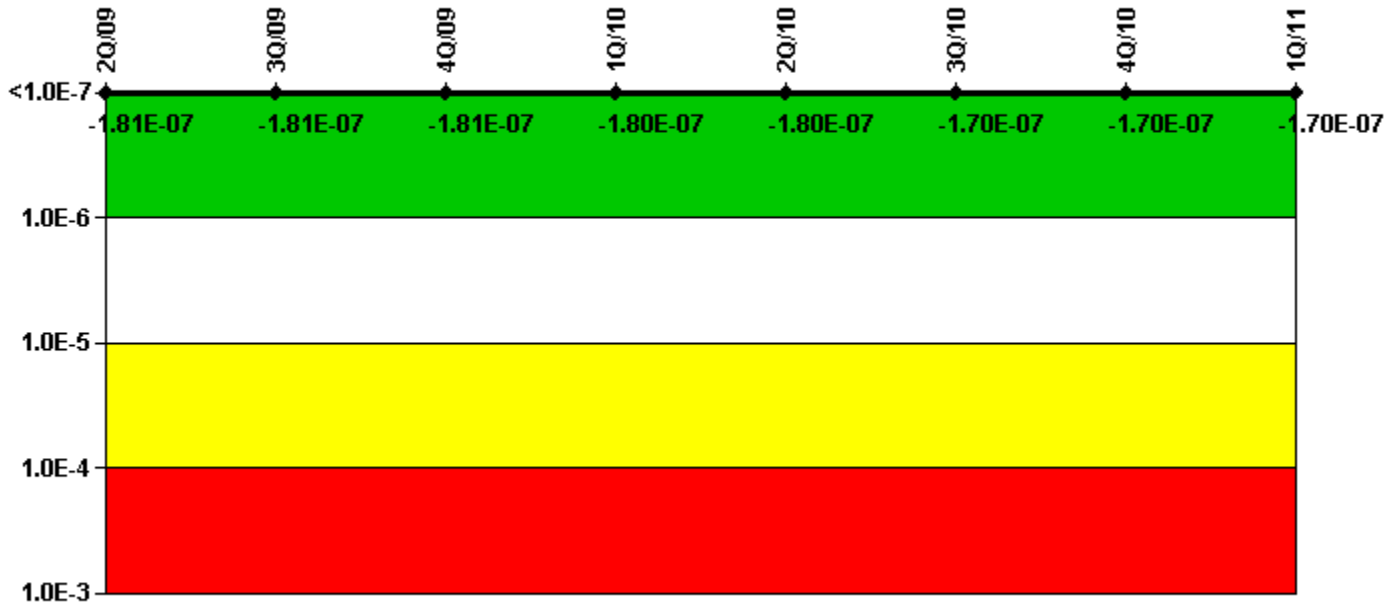


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-7.10E-08	-7.10E-08	-7.10E-08	-7.09E-08	-7.09E-08	-5.83E-08	-5.83E-08	-5.83E-08
URI (Δ CDF)	-1.10E-07	-1.10E-07	-1.10E-07	-1.09E-07	-1.09E-07	-1.09E-07	-1.09E-07	-1.09E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.81E-07	-1.81E-07	-1.81E-07	-1.80E-07	-1.80E-07	-1.70E-07	-1.70E-07	-1.70E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

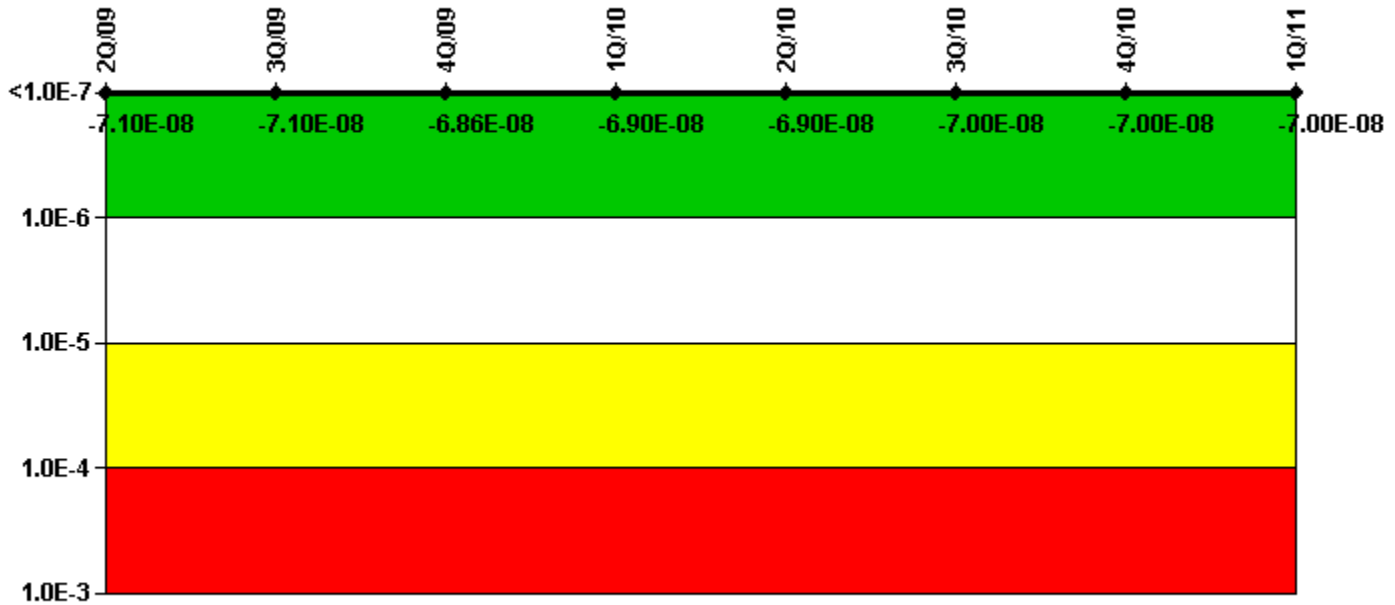


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	0.00E+00	0.00E+00	2.40E-09	2.45E-09	2.44E-09	1.59E-09	1.59E-09	1.55E-09
URI (Δ CDF)	-7.10E-08	-7.10E-08	-7.10E-08	-7.14E-08	-7.14E-08	-7.14E-08	-7.14E-08	-7.14E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.10E-08	-7.10E-08	-6.86E-08	-6.90E-08	-6.90E-08	-7.00E-08	-7.00E-08	-7.00E-08

Licensee Comments: none

Reactor Coolant System Activity

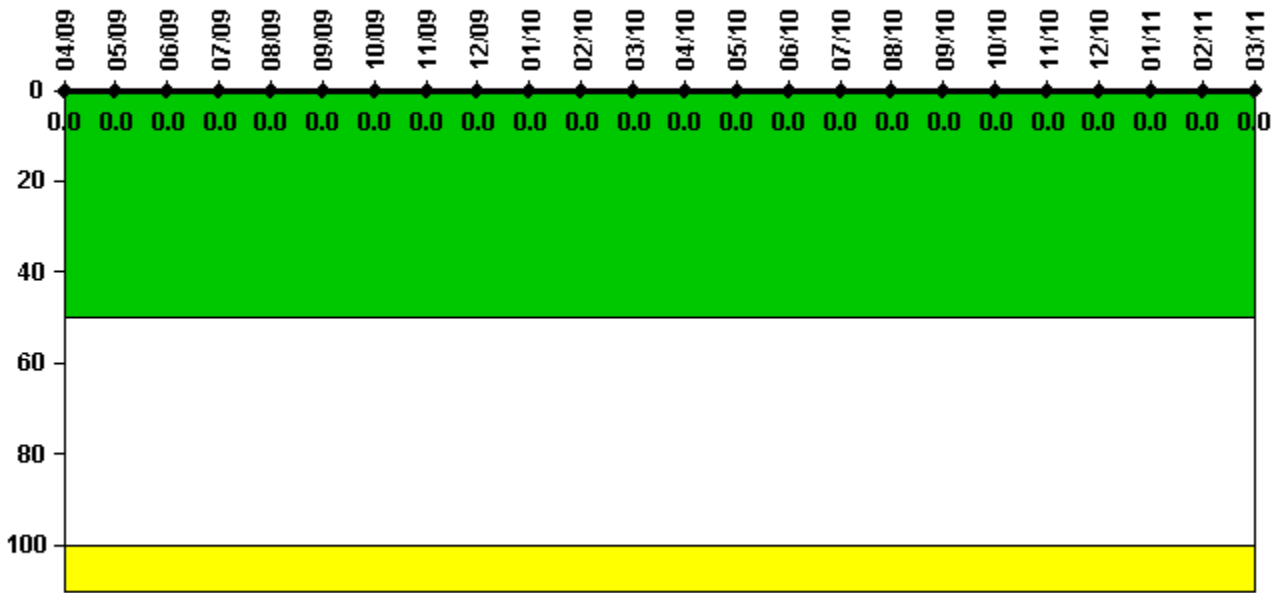


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum activity	0.000002	0.000002	0.000003	0.000002	0.000002	0.000002	0.000003	0.000003	0.000002	0.000002	0.000002	0.000002
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum activity	0.000002	0.000002	0.000004	0.000002	0.000002	0.000002	0.000002	0.000002	0.000002	0.000002	0.000002	0.000004
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

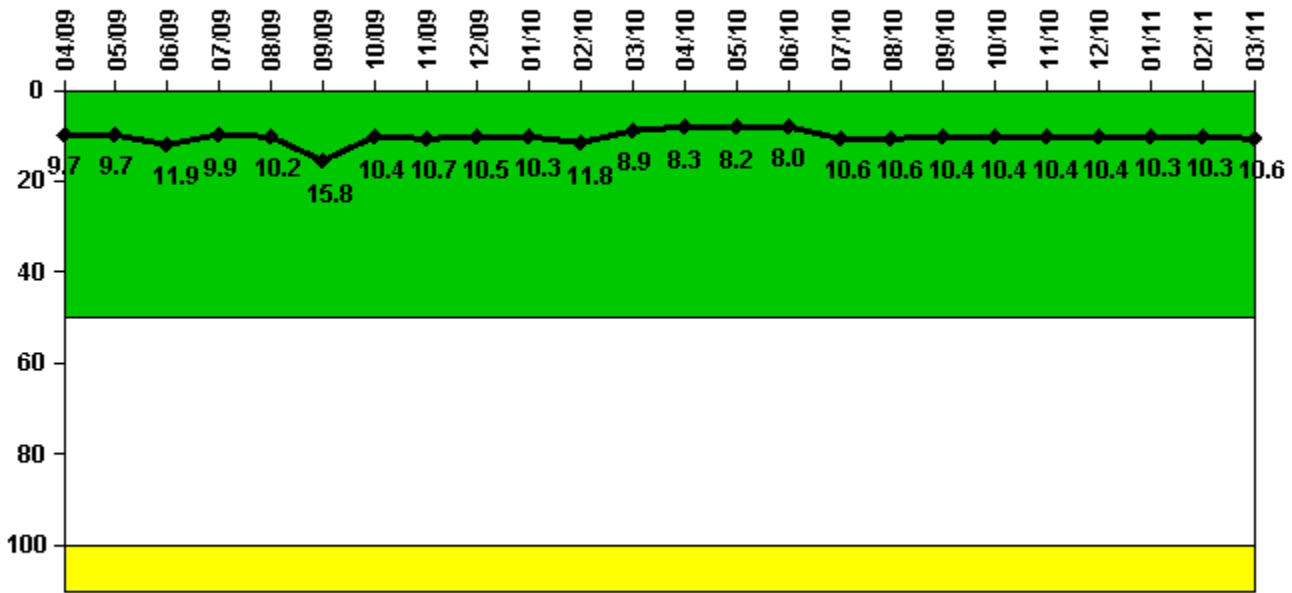


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum leakage	2.910	2.900	3.570	2.970	3.050	4.740	3.130	3.210	3.140	3.090	3.530	2.660
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	9.7	9.7	11.9	9.9	10.2	15.8	10.4	10.7	10.5	10.3	11.8	8.9
Reactor Coolant System Leakage	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum leakage	2.480	2.470	2.410	3.170	3.190	3.130	3.130	3.120	3.120	3.090	3.080	3.180
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	8.3	8.2	8.0	10.6	10.6	10.4	10.4	10.4	10.4	10.3	10.3	10.6

Licensee Comments: none

Drill/Exercise Performance

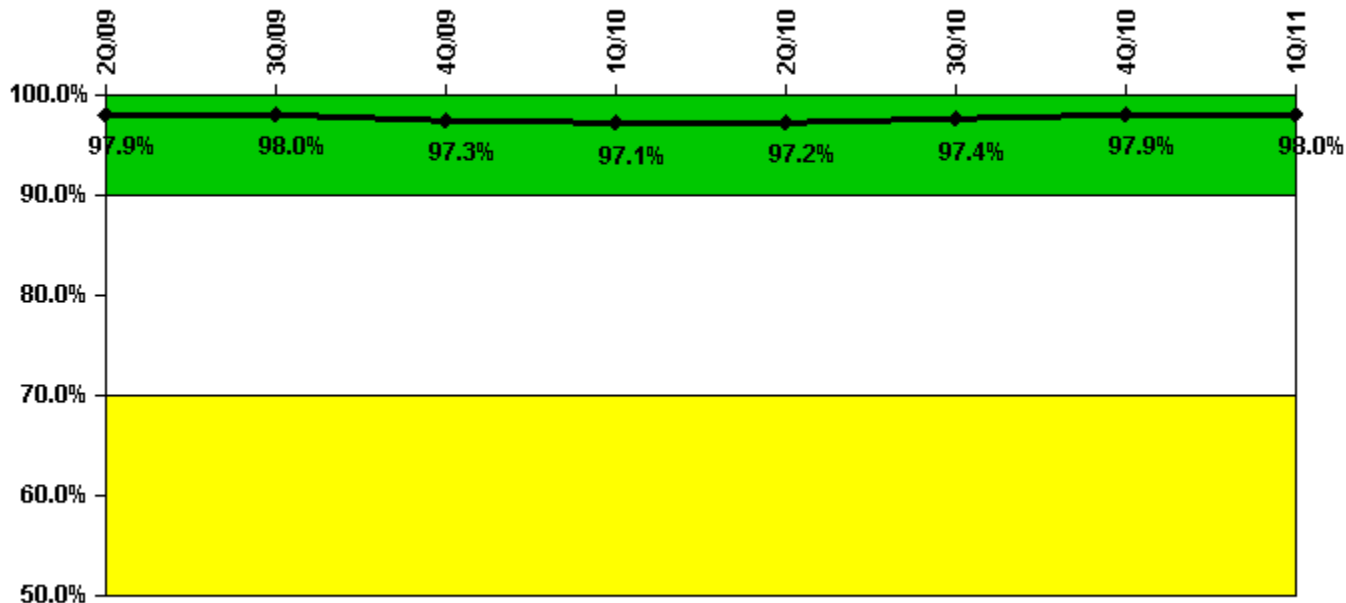


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Successful opportunities	44.0	41.0	60.0	23.0	40.0	55.0	46.0	30.0
Total opportunities	46.0	42.0	63.0	24.0	40.0	55.0	46.0	30.0
Indicator value	97.9%	98.0%	97.3%	97.1%	97.2%	97.4%	97.9%	98.0%

License Comments: none

ERO Drill Participation

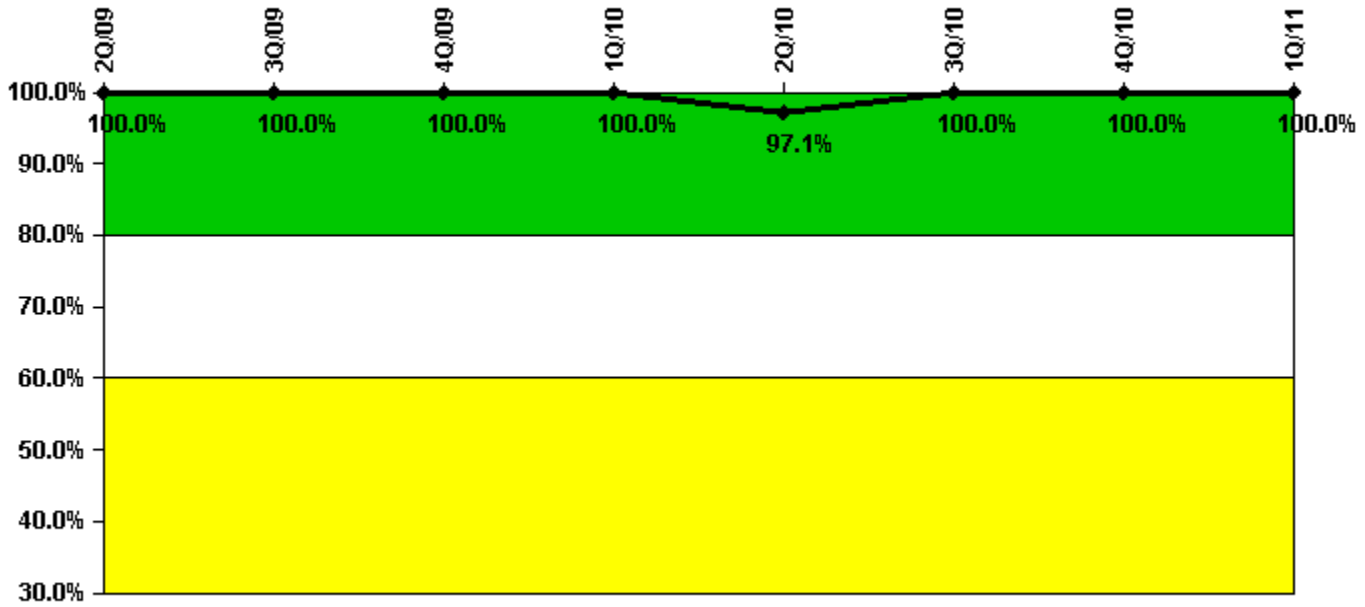


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Participating Key personnel	61.0	66.0	65.0	62.0	66.0	68.0	67.0	65.0
Total Key personnel	61.0	66.0	65.0	62.0	68.0	68.0	67.0	65.0
Indicator value	100.0%	100.0%	100.0%	100.0%	97.1%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

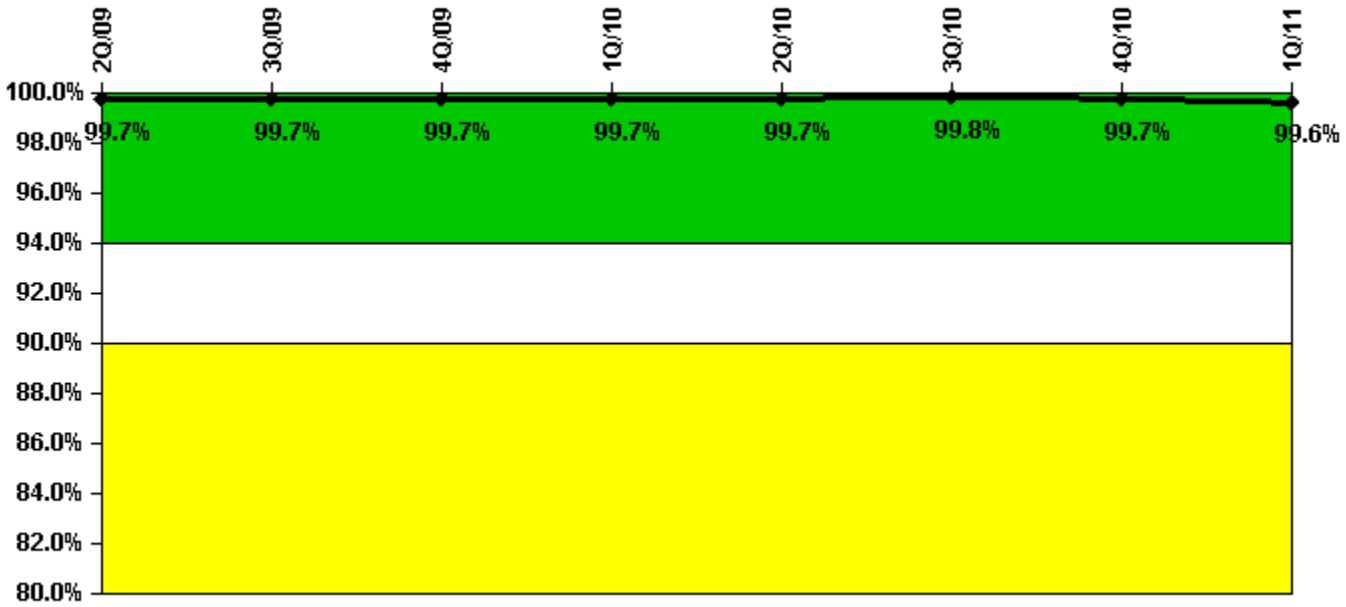


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Successful siren-tests	2808	2847	2812	2517	2551	2591	2594	2545
Total sirens-tests	2816	2860	2816	2520	2560	2600	2600	2560
Indicator value	99.7%	99.7%	99.7%	99.7%	99.7%	99.8%	99.7%	99.6%

Licensee Comments: none

Occupational Exposure Control Effectiveness

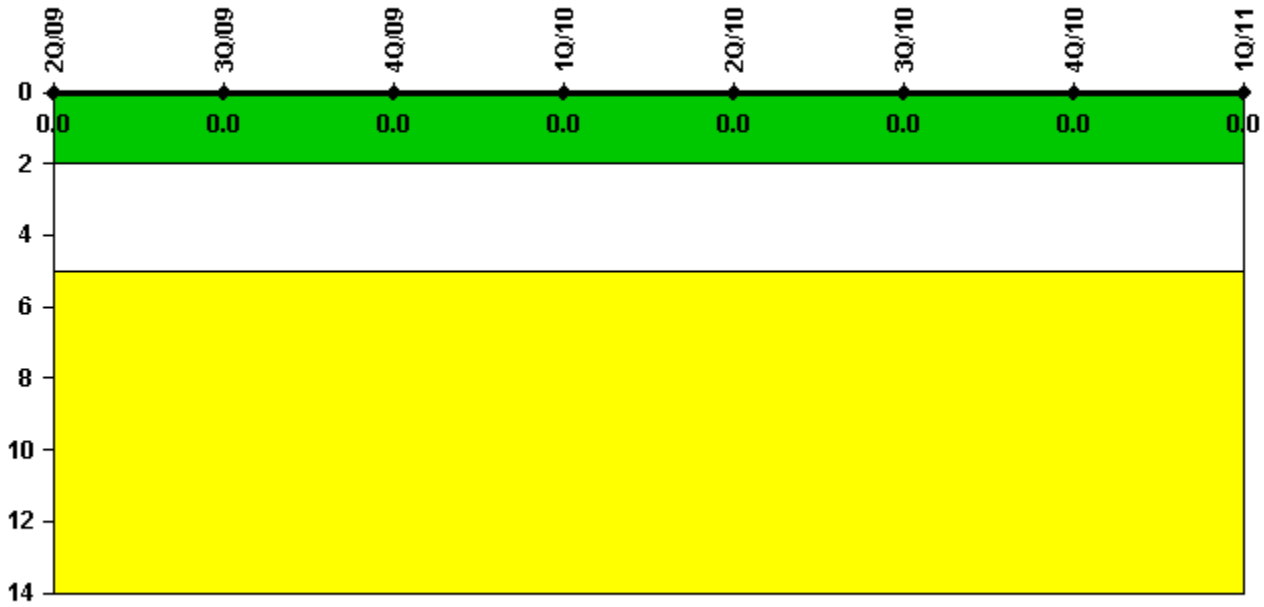


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

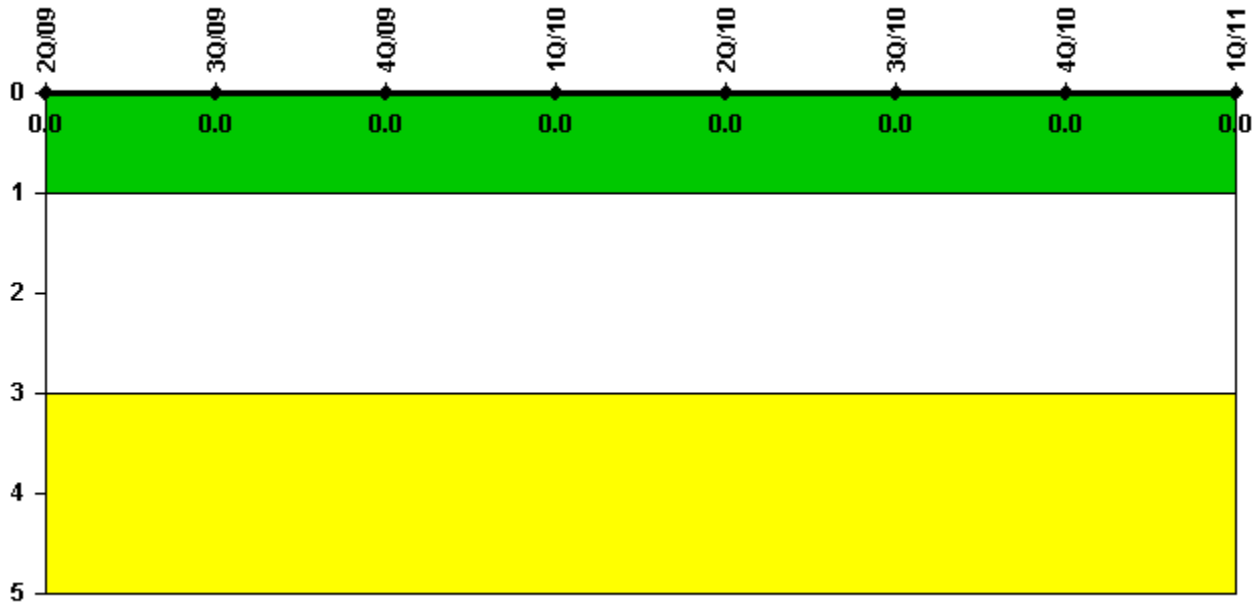

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.