


La Salle 2

1Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

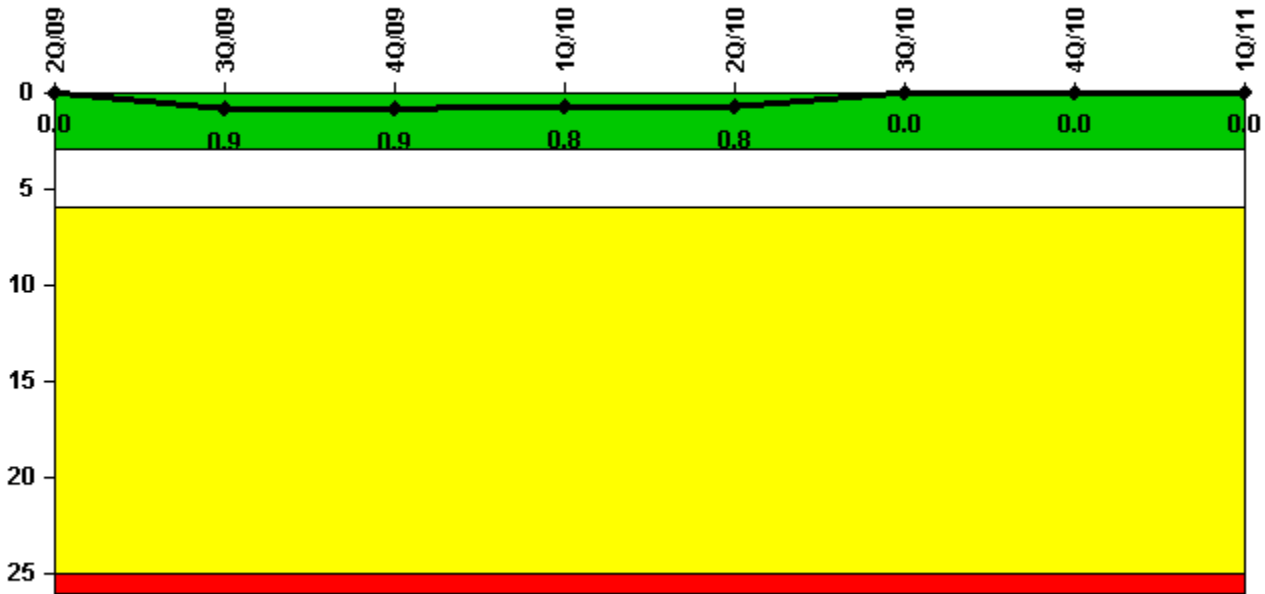


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 1.0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2127.2 | 2154.3 | 2159.0 | 2184.0 | 2208.0 | 2209.0 | 1666.4 |
| Indicator value | 0 | 0.9 | 0.9 | 0.8 | 0.8 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

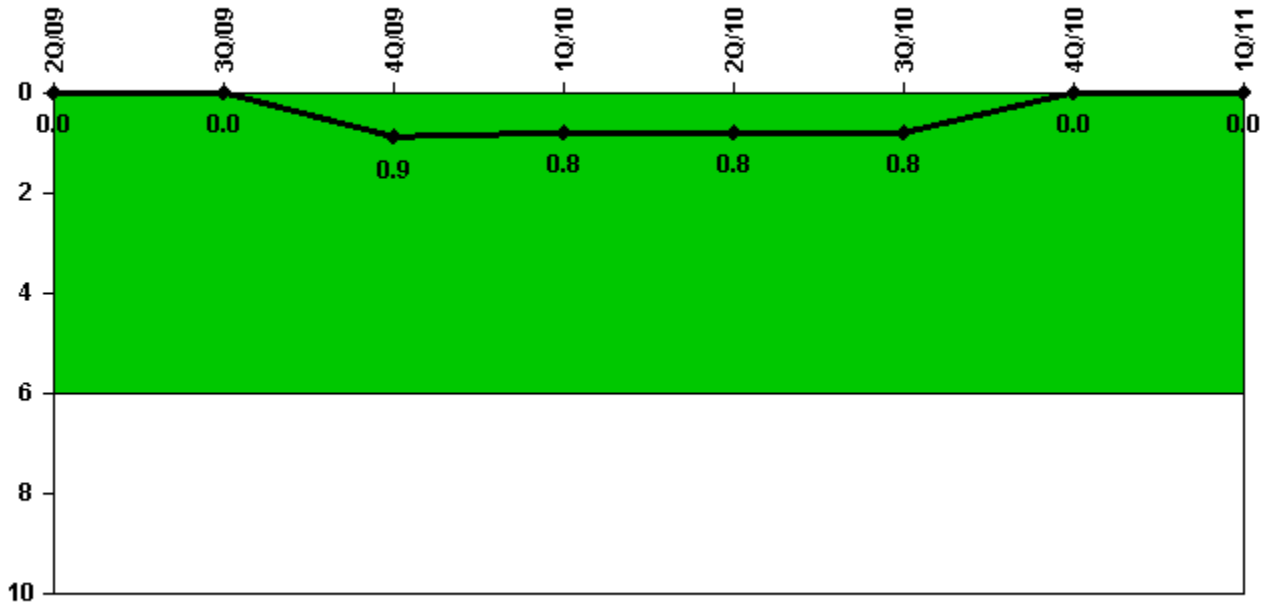


Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 0 | 1.0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2127.2 | 2154.3 | 2159.0 | 2184.0 | 2208.0 | 2209.0 | 1666.4 |
| Indicator value | 0 | 0 | 0.9 | 0.8 | 0.8 | 0.8 | 0 | 0 |

Licensee Comments: none

Unplanned Scrams with Complications

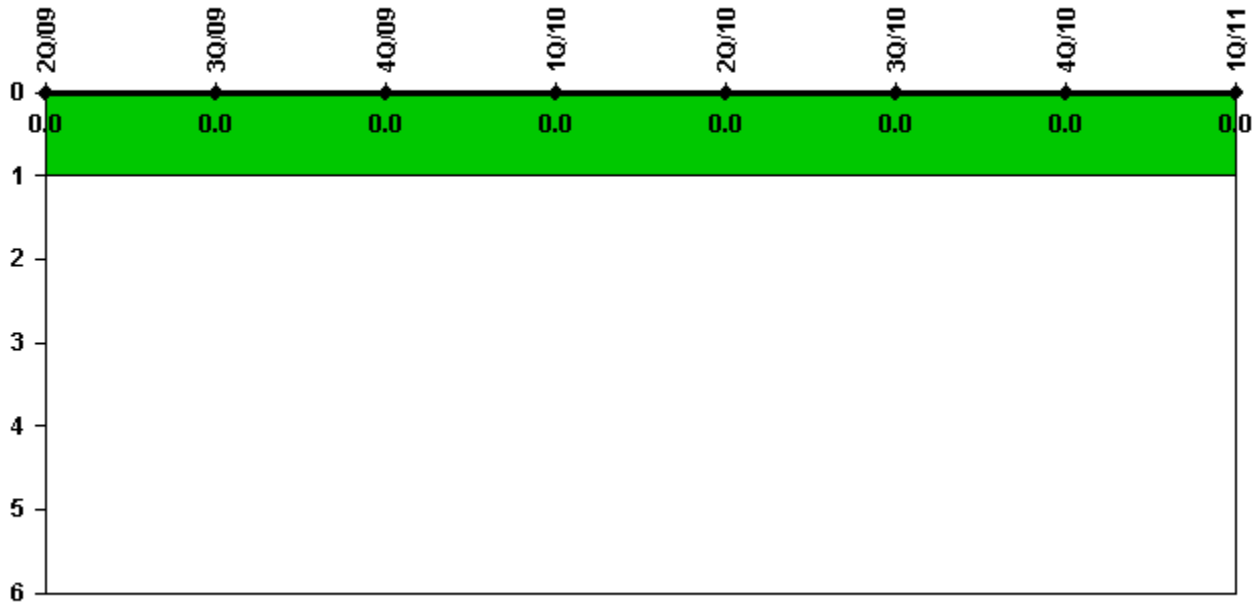


Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|-------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (BWR)

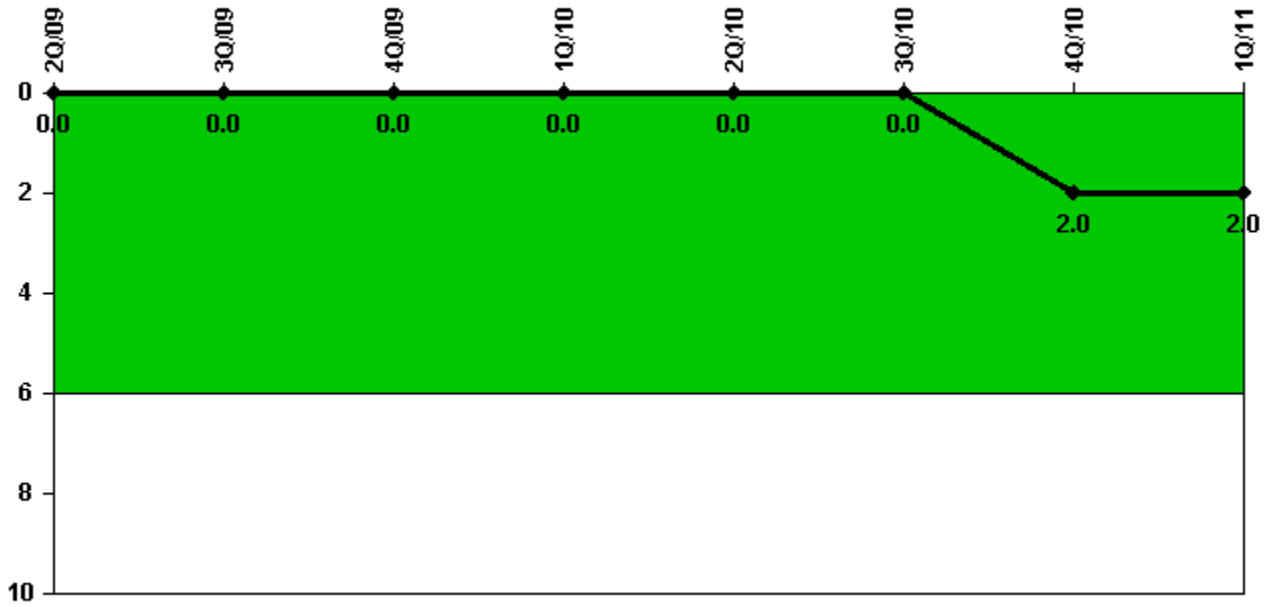


Thresholds: White > 6.0

Notes

| Safety System Functional Failures (BWR) | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 0 | 0 | 0 | 0 | 0 | 2 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 2 | 2 |

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

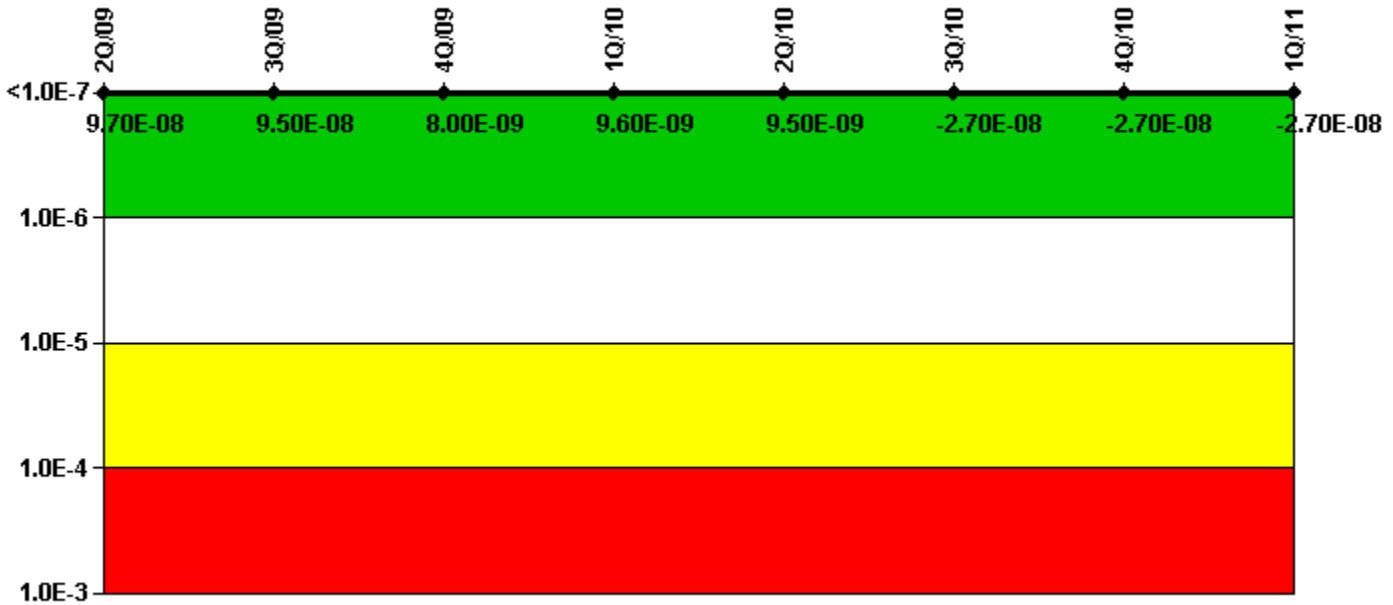

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -3.00E-09 | -3.00E-09 | -3.00E-09 | -2.23E-09 | -2.23E-09 | -3.99E-09 | -3.99E-09 | -3.98E-09 |
| URI (Δ CDF) | 1.00E-07 | 9.80E-08 | 1.10E-08 | 1.18E-08 | 1.17E-08 | -2.25E-08 | -2.25E-08 | -2.25E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 9.70E-08 | 9.50E-08 | 8.00E-09 | 9.60E-09 | 9.50E-09 | -2.70E-08 | -2.70E-08 | -2.70E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -2.80E-09 | -2.80E-09 | -2.80E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 |
| URI (Δ CDF) | -2.10E-08 | -2.20E-08 | -2.20E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.38E-08 | -2.48E-08 | -2.48E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

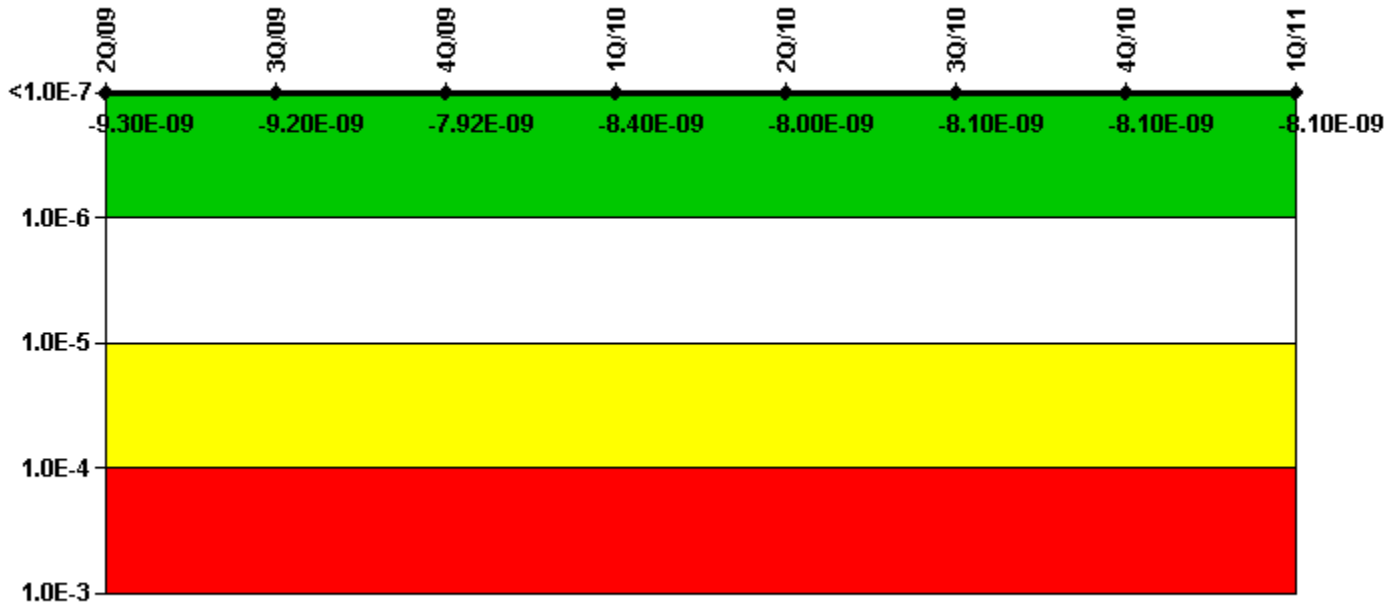


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -2.20E-09 | -2.10E-09 | -7.20E-10 | -1.60E-09 | -1.23E-09 | -1.30E-09 | -1.30E-09 | -1.28E-09 |
| URI (Δ CDF) | -7.10E-09 | -7.10E-09 | -7.20E-09 | -6.77E-09 | -6.77E-09 | -6.78E-09 | -6.78E-09 | -6.78E-09 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -9.30E-09 | -9.20E-09 | -7.92E-09 | -8.40E-09 | -8.00E-09 | -8.10E-09 | -8.10E-09 | -8.10E-09 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

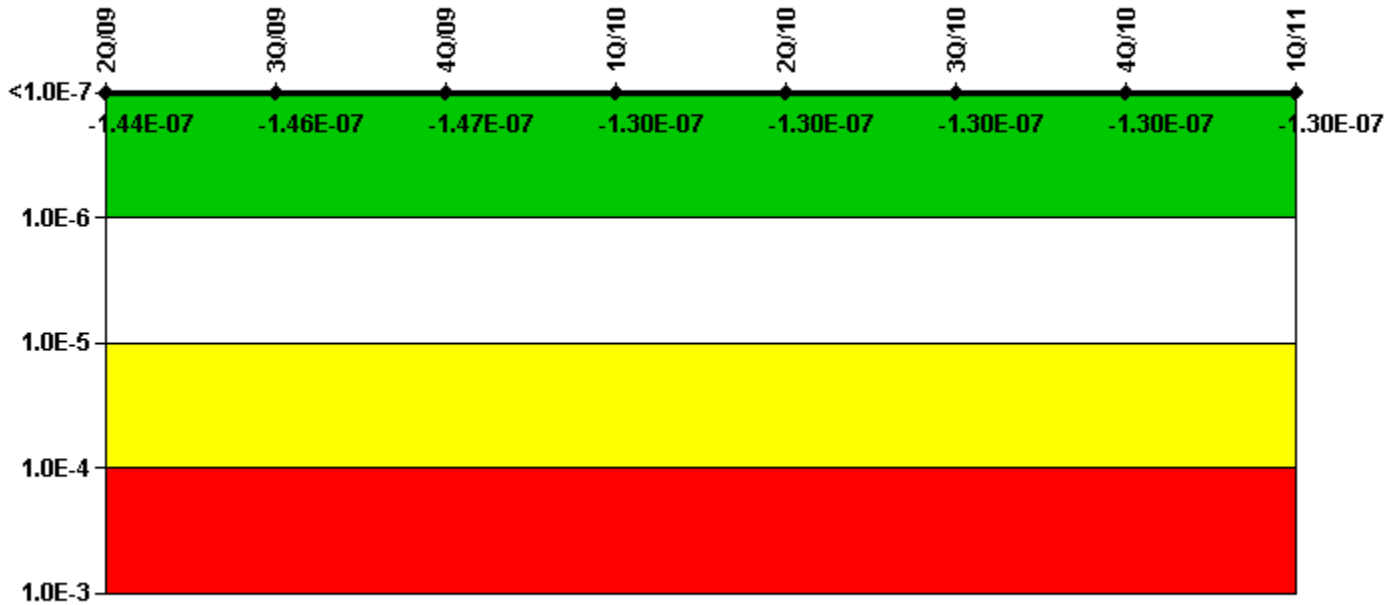


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -5.80E-08 | -5.80E-08 | -5.80E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 |
| URI (Δ CDF) | -8.60E-08 | -8.80E-08 | -8.90E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.44E-07 | -1.46E-07 | -1.47E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

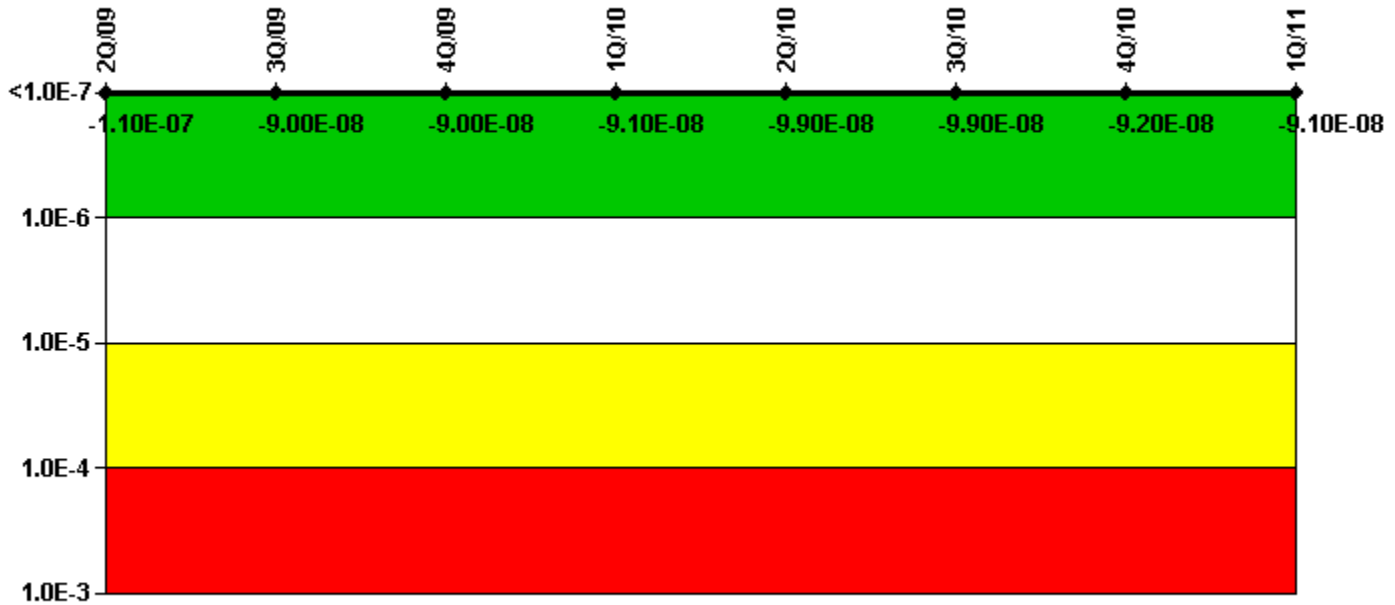


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 0.00E+00 | 2.00E-08 | 2.00E-08 | 1.29E-08 | 4.92E-09 | 4.92E-09 | 1.17E-08 | 1.31E-08 |
| URI (Δ CDF) | -1.10E-07 | -1.10E-07 | -1.10E-07 | -1.04E-07 | -1.04E-07 | -1.04E-07 | -1.04E-07 | -1.04E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.10E-07 | -9.00E-08 | -9.00E-08 | -9.10E-08 | -9.90E-08 | -9.90E-08 | -9.20E-08 | -9.10E-08 |

Licensee Comments: none

Reactor Coolant System Activity

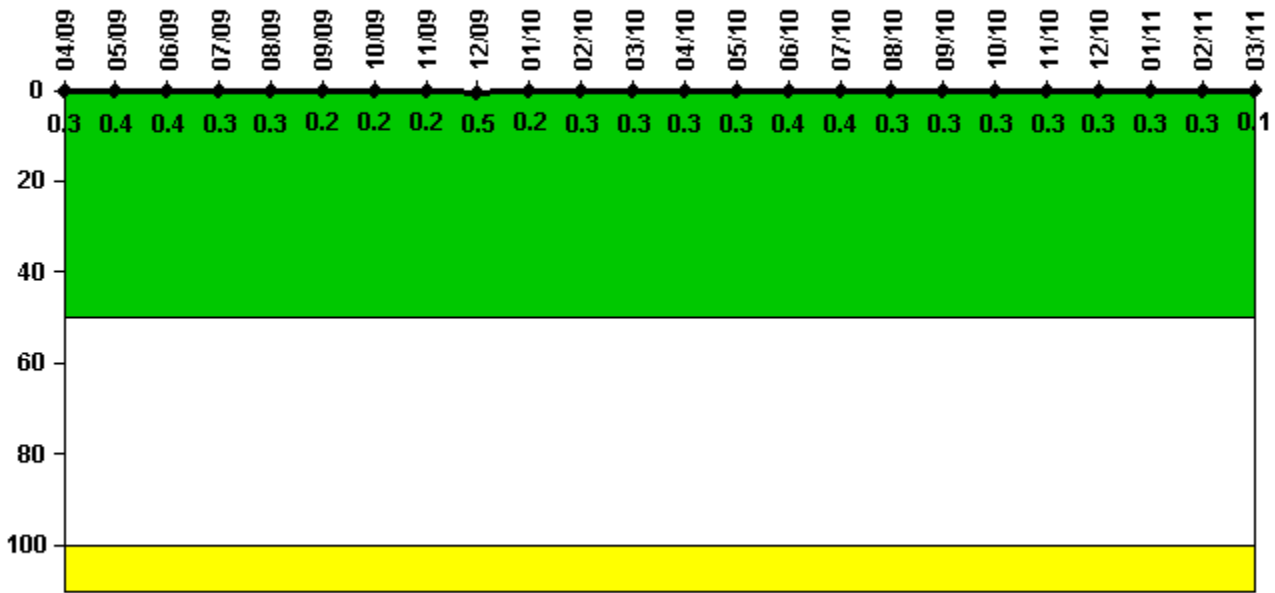


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Activity | 4/09 | 5/09 | 6/09 | 7/09 | 8/09 | 9/09 | 10/09 | 11/09 | 12/09 | 1/10 | 2/10 | 3/10 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000570 | 0.000711 | 0.000791 | 0.000632 | 0.000572 | 0.000447 | 0.000430 | 0.000363 | 0.001010 | 0.000468 | 0.000550 | 0.000607 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0.3 | 0.4 | 0.4 | 0.3 | 0.3 | 0.2 | 0.2 | 0.2 | 0.5 | 0.2 | 0.3 | 0.3 |
| Reactor Coolant System Activity | 4/10 | 5/10 | 6/10 | 7/10 | 8/10 | 9/10 | 10/10 | 11/10 | 12/10 | 1/11 | 2/11 | 3/11 |
| Maximum activity | 0.000595 | 0.000556 | 0.000836 | 0.000713 | 0.000601 | 0.000596 | 0.000597 | 0.000592 | 0.000622 | 0.000559 | 0.000572 | 0.000177 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0.3 | 0.3 | 0.4 | 0.4 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.1 |

Licensee Comments: none

Reactor Coolant System Leakage

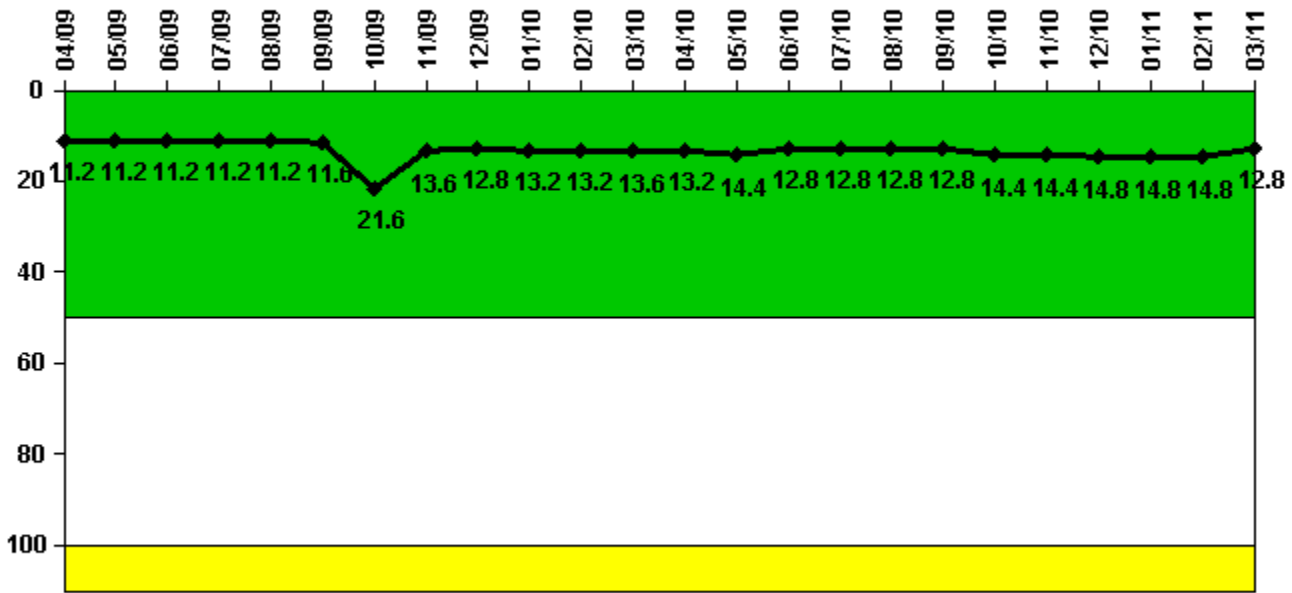


Thresholds: White > 50.0 Yellow > 100.0

Notes

| | | | | | | | | | | | | |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Reactor Coolant System Leakage | 4/09 | 5/09 | 6/09 | 7/09 | 8/09 | 9/09 | 10/09 | 11/09 | 12/09 | 1/10 | 2/10 | 3/10 |
| Maximum leakage | 2.800 | 2.800 | 2.800 | 2.800 | 2.800 | 2.900 | 5.400 | 3.400 | 3.200 | 3.300 | 3.300 | 3.400 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 11.2 | 11.2 | 11.2 | 11.2 | 11.2 | 11.6 | 21.6 | 13.6 | 12.8 | 13.2 | 13.2 | 13.6 |
| Reactor Coolant System Leakage | 4/10 | 5/10 | 6/10 | 7/10 | 8/10 | 9/10 | 10/10 | 11/10 | 12/10 | 1/11 | 2/11 | 3/11 |
| Maximum leakage | 3.300 | 3.600 | 3.200 | 3.200 | 3.200 | 3.200 | 3.600 | 3.600 | 3.700 | 3.700 | 3.700 | 3.200 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 13.2 | 14.4 | 12.8 | 12.8 | 12.8 | 12.8 | 14.4 | 14.4 | 14.8 | 14.8 | 14.8 | 12.8 |

Licensee Comments: none

Drill/Exercise Performance

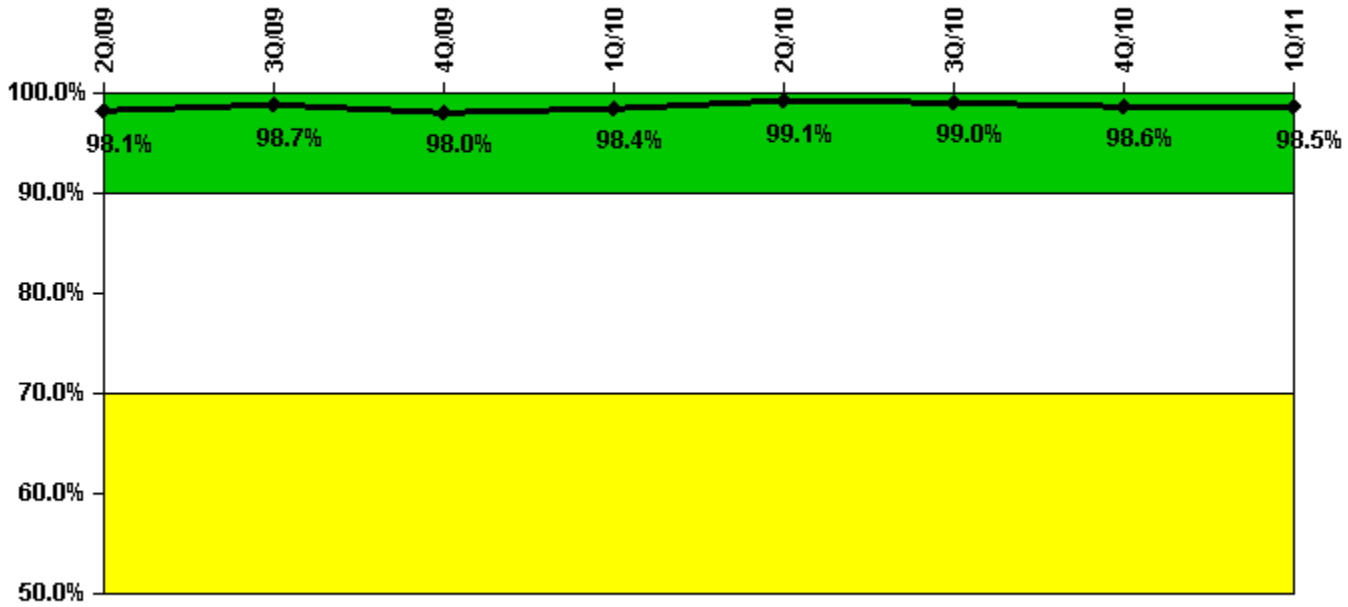


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 44.0 | 48.0 | 44.0 | 20.0 | 55.0 | 16.0 | 36.0 | 0 |
| Total opportunities | 44.0 | 48.0 | 46.0 | 20.0 | 56.0 | 16.0 | 37.0 | 0 |
| | | | | | | | | |
| Indicator value | 98.1% | 98.7% | 98.0% | 98.4% | 99.1% | 99.0% | 98.6% | 98.5% |

Licensee Comments: none

ERO Drill Participation

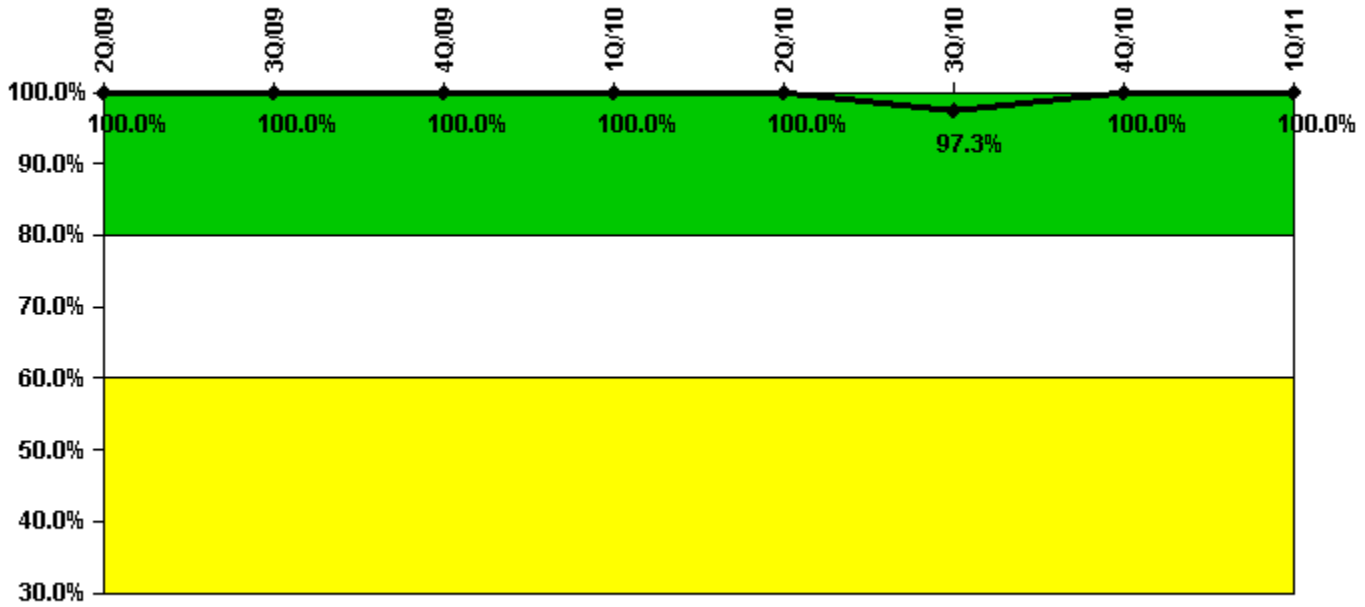


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|-----------------------------|--------|--------|--------|--------|--------|-------|--------|--------|
| Participating Key personnel | 66.0 | 68.0 | 68.0 | 70.0 | 77.0 | 72.0 | 70.0 | 65.0 |
| Total Key personnel | 66.0 | 68.0 | 68.0 | 70.0 | 77.0 | 74.0 | 70.0 | 65.0 |
| | | | | | | | | |
| Indicator value | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 97.3% | 100.0% | 100.0% |

Licensee Comments: none

Alert & Notification System

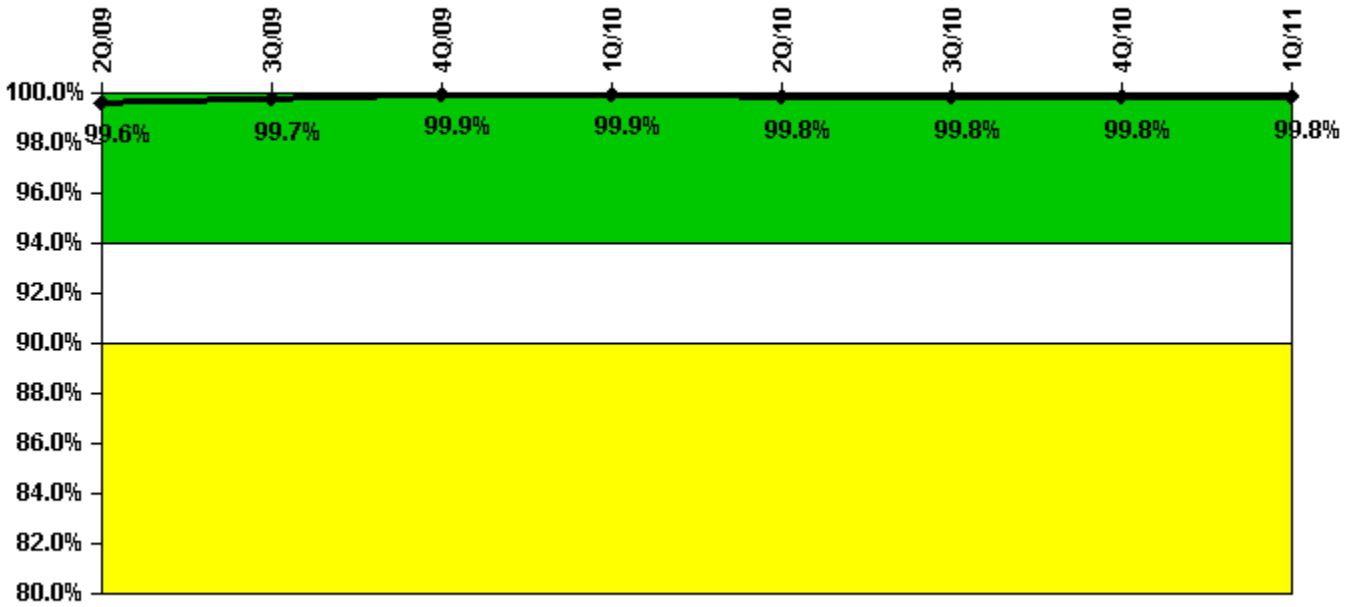


Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 3199 | 3246 | 3198 | 2139 | 2167 | 2205 | 2210 | 2173 |
| Total sirens-tests | 3200 | 3250 | 3200 | 2142 | 2176 | 2210 | 2210 | 2176 |
| | | | | | | | | |
| Indicator value | 99.6% | 99.7% | 99.9% | 99.9% | 99.8% | 99.8% | 99.8% | 99.8% |

Licensee Comments: none

Occupational Exposure Control Effectiveness

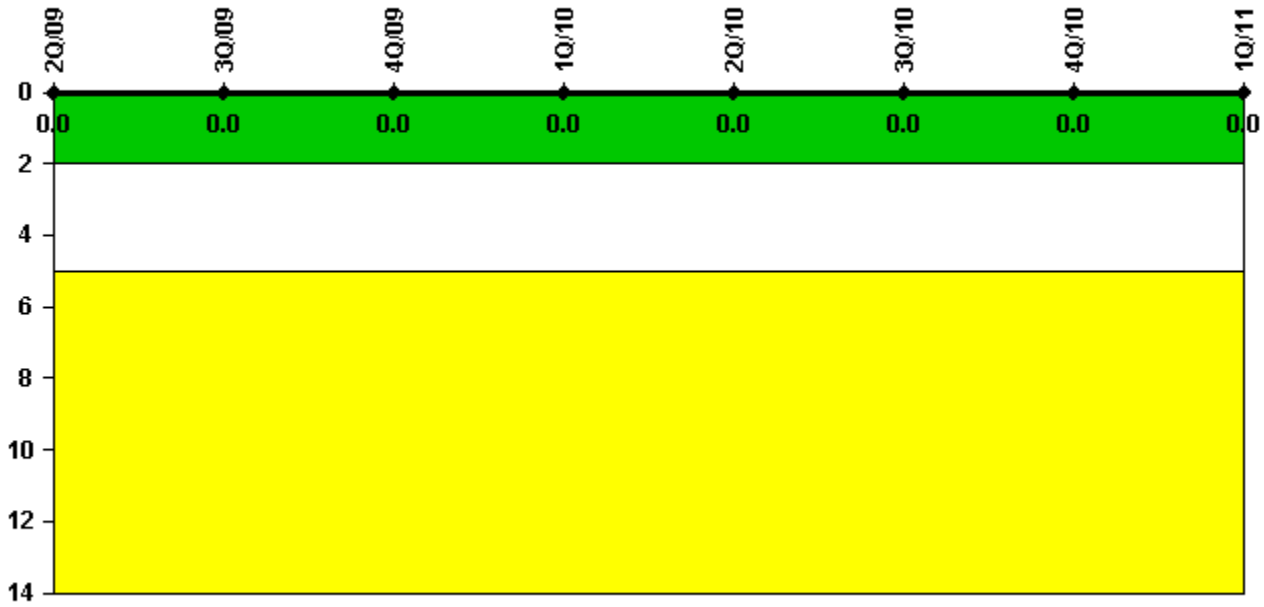


Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent

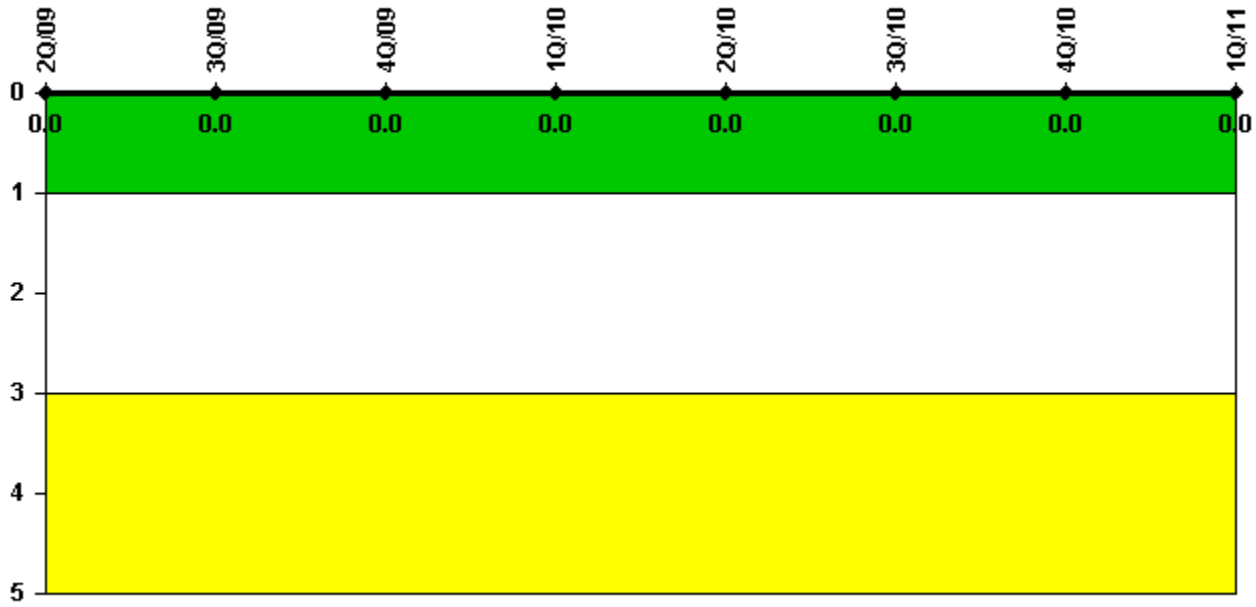

Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 2Q/09 | 3Q/09 | 4Q/09 | 1Q/10 | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

[Security](#) information not publicly available.