


Sequiah 2

1Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

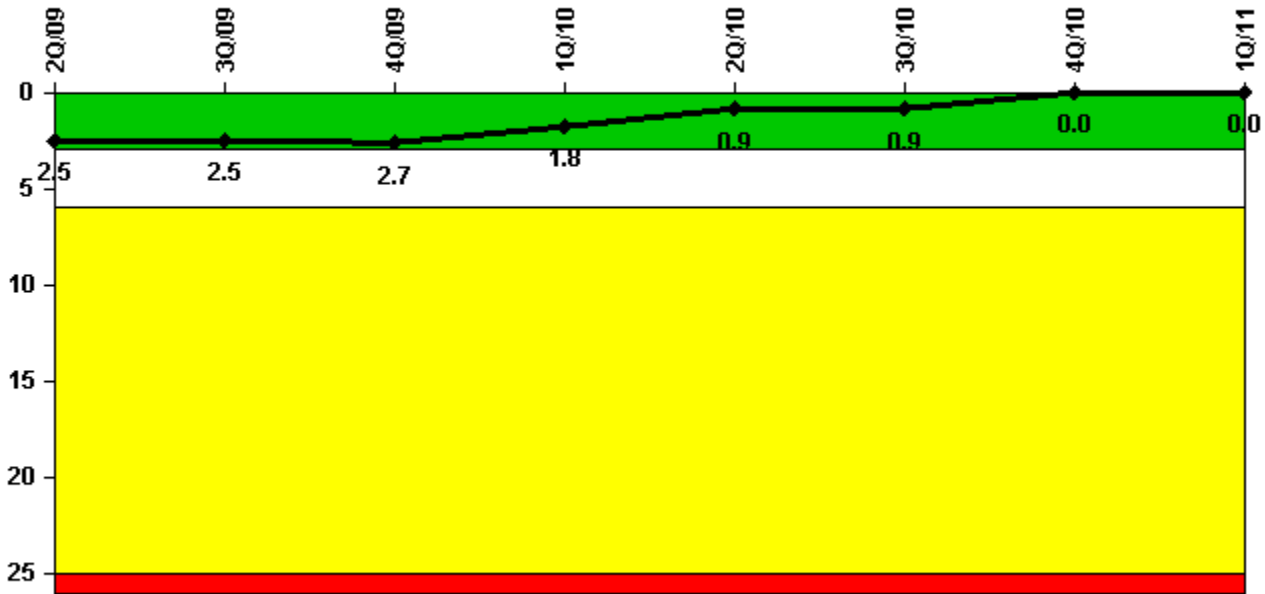


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Unplanned scrams	1.0	0	1.0	0	0	0	0	0
Critical hours	2117.7	2208.0	1486.8	2159.0	2008.3	2208.0	2209.0	2159.0
Indicator value	2.5	2.5	2.7	1.8	0.9	0.9	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

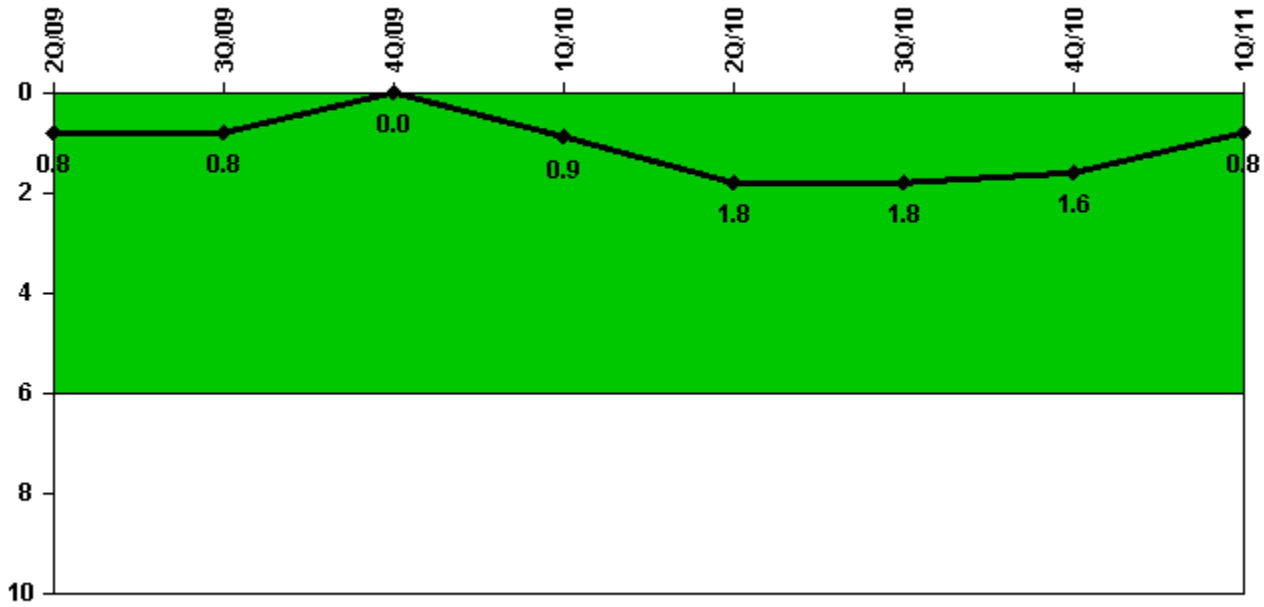


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Unplanned power changes	0	0	0	1.0	1.0	0	0	0
Critical hours	2117.7	2208.0	1486.8	2159.0	2008.3	2208.0	2209.0	2159.0
Indicator value	0.8	0.8	0	0.9	1.8	1.8	1.6	0.8

Licensee Comments: none

Unplanned Scrams with Complications

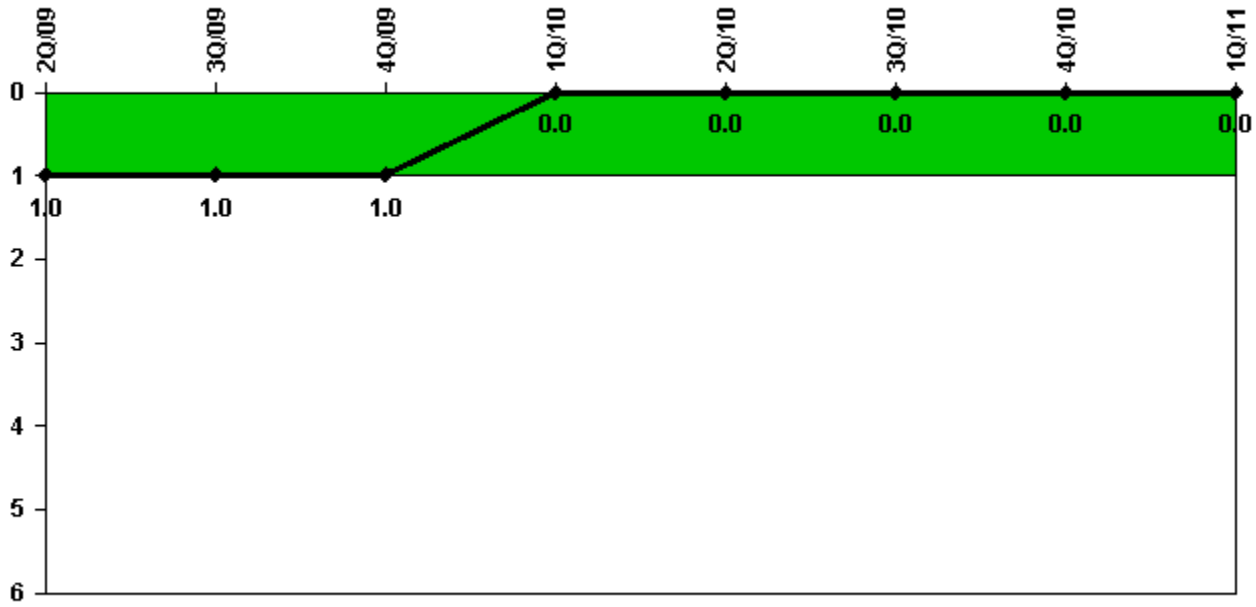


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

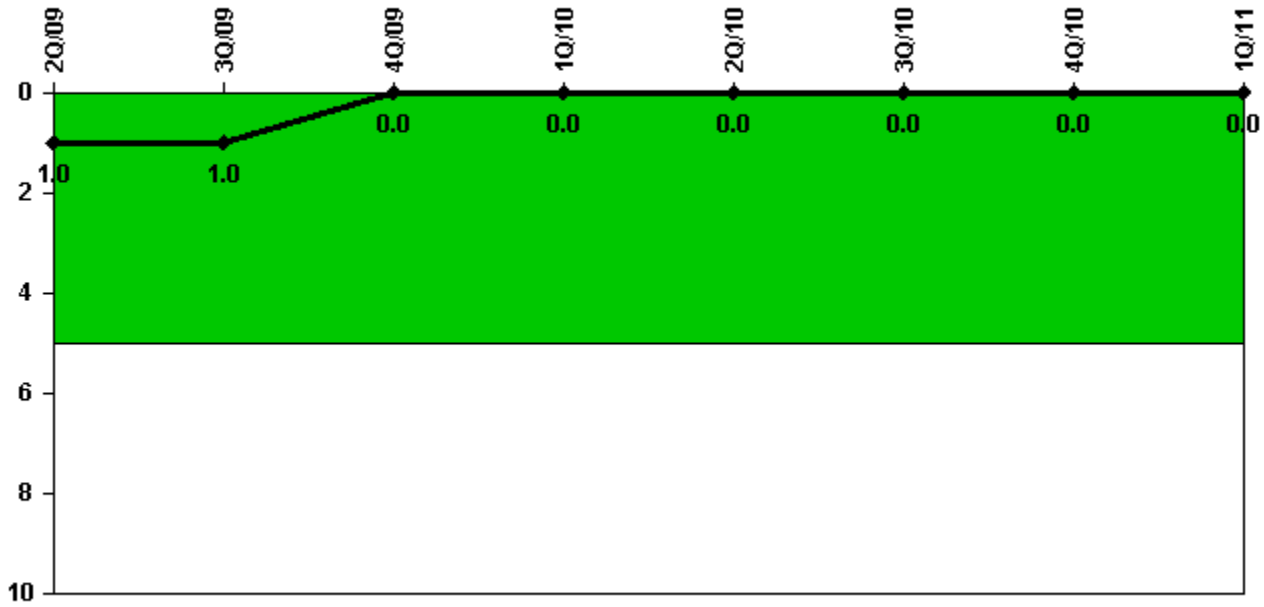


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	1	1	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

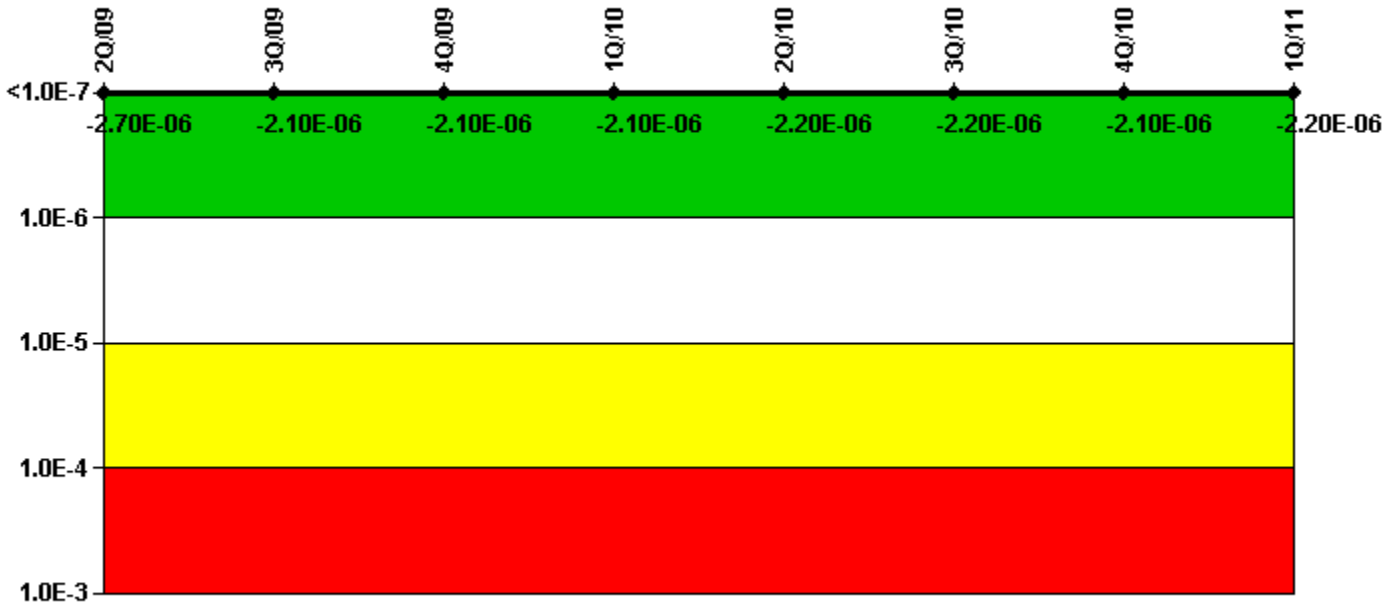


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-2.53E-07	-8.19E-08	-1.14E-07	-1.09E-07	-2.77E-07	-2.82E-07	-2.81E-07	-2.80E-07
URI (Δ CDF)	-2.42E-06	-2.00E-06	-1.95E-06	-1.98E-06	-1.90E-06	-1.90E-06	-1.83E-06	-1.90E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.70E-06	-2.10E-06	-2.10E-06	-2.10E-06	-2.20E-06	-2.20E-06	-2.10E-06	-2.20E-06

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

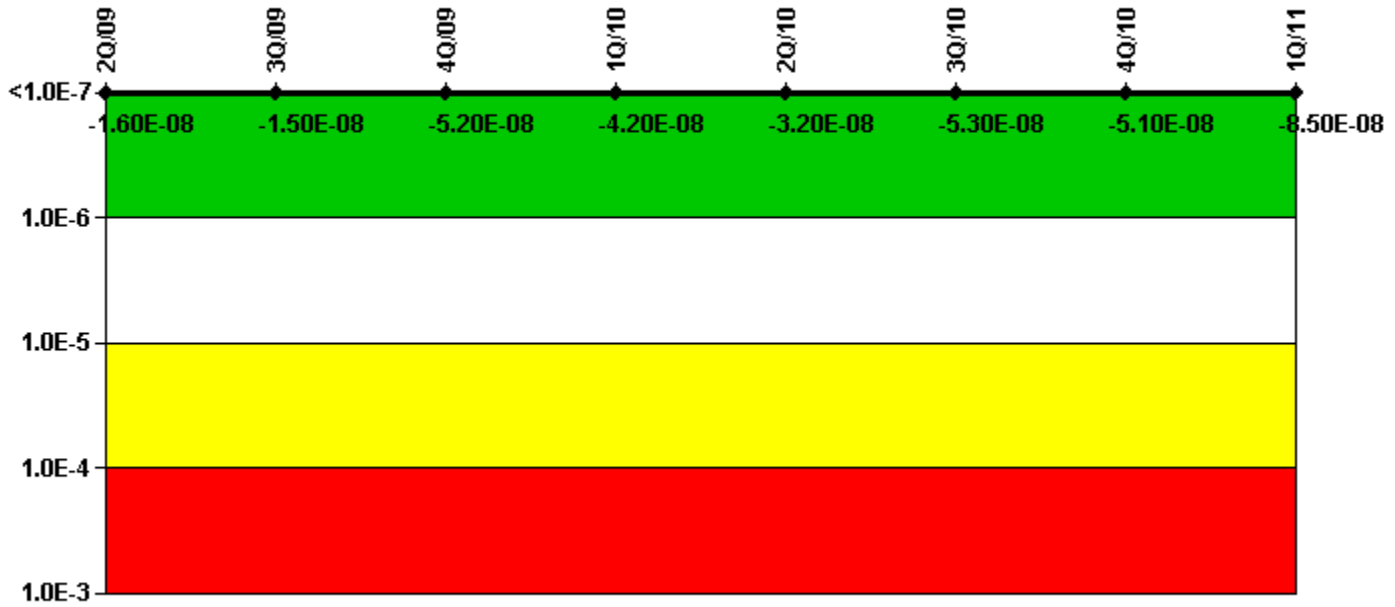


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (ΔCDF)	1.59E-07	1.59E-07	1.22E-07	1.32E-07	1.42E-07	1.22E-07	1.23E-07	8.91E-08
URI (ΔCDF)	-1.74E-07	-1.74E-07	-1.74E-07	-1.74E-07	-1.74E-07	-1.74E-07	-1.74E-07	-1.74E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.60E-08	-1.50E-08	-5.20E-08	-4.20E-08	-3.20E-08	-5.30E-08	-5.10E-08	-8.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

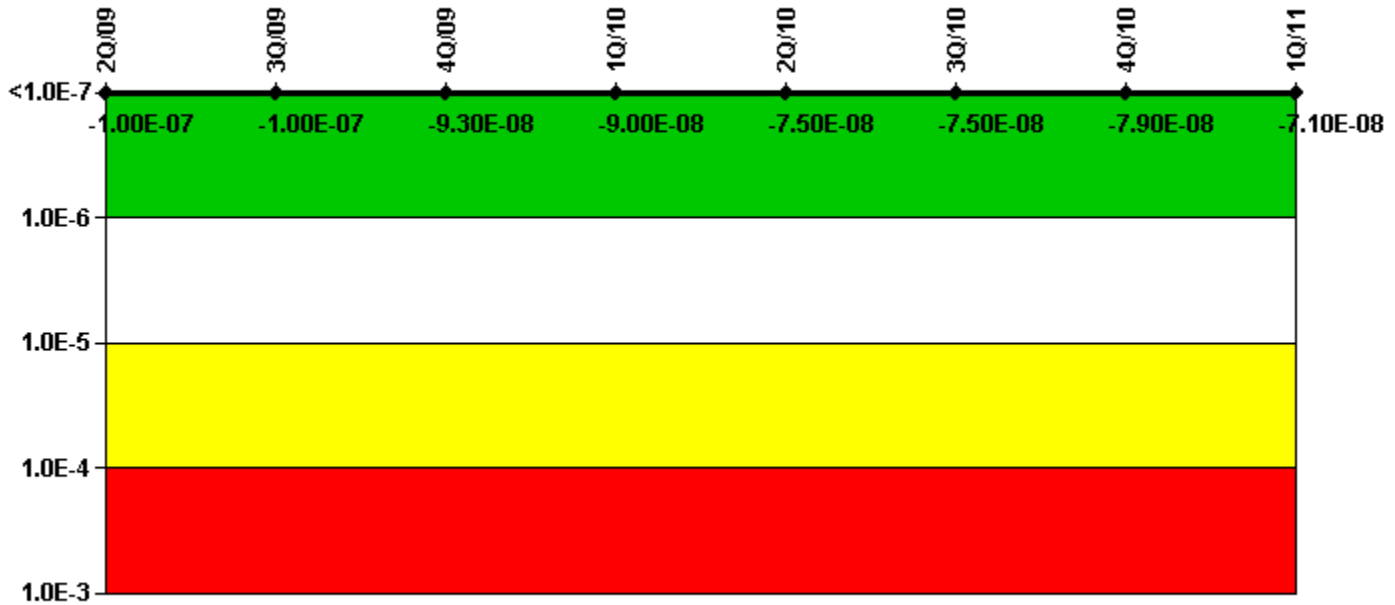


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-1.74E-08	-1.64E-08	-5.44E-09	-4.30E-09	1.15E-08	1.15E-08	7.54E-09	1.50E-08
URI (Δ CDF)	-8.60E-08	-8.60E-08	-8.74E-08	-8.60E-08	-8.62E-08	-8.62E-08	-8.62E-08	-8.62E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.00E-07	-1.00E-07	-9.30E-08	-9.00E-08	-7.50E-08	-7.50E-08	-7.90E-08	-7.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

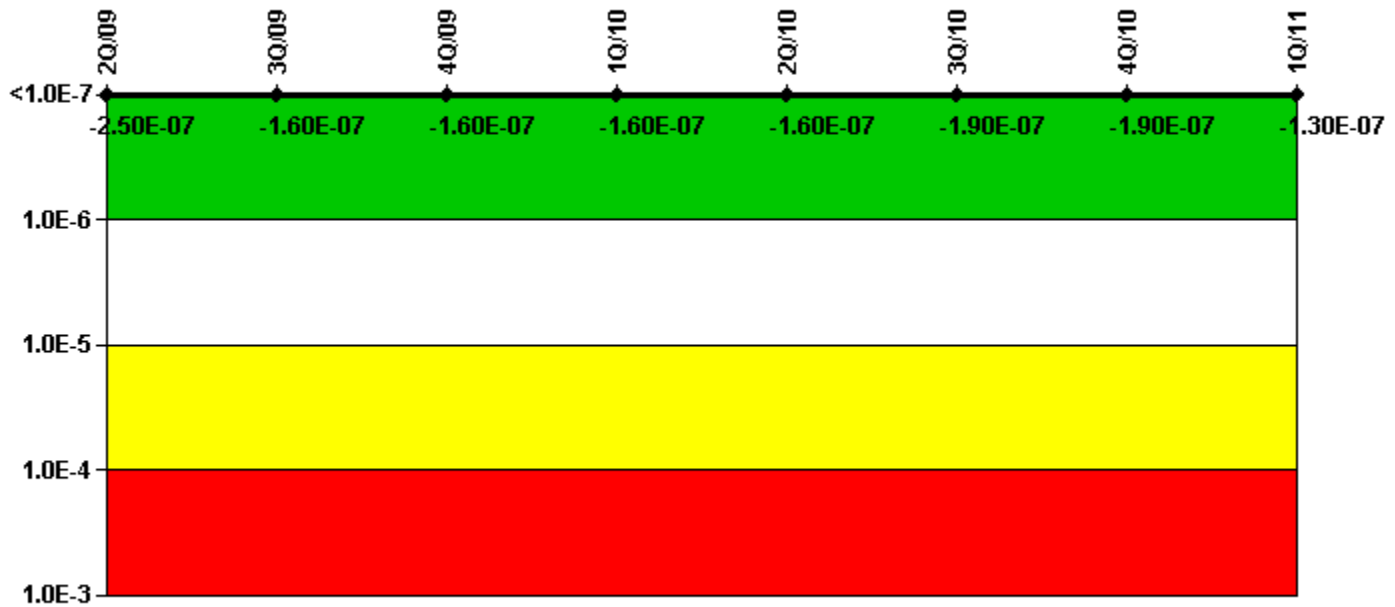


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	1.14E-07	2.00E-07	1.99E-07	1.98E-07	2.01E-07	1.75E-07	1.76E-07	2.36E-07
URI (Δ CDF)	-3.62E-07	-3.62E-07	-3.62E-07	-3.62E-07	-3.62E-07	-3.62E-07	-3.62E-07	-3.62E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.90E-07	-1.90E-07	-1.30E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

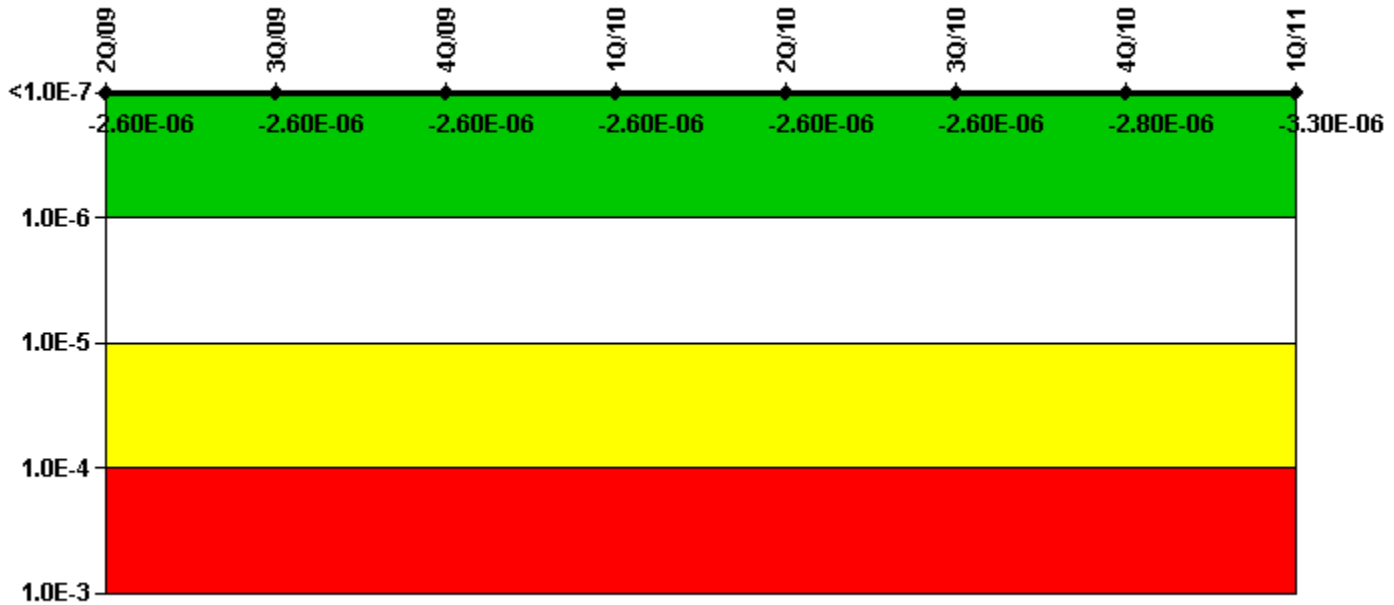

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
UAI (Δ CDF)	-2.92E-06	-2.86E-06	-2.91E-06	-2.94E-06	-2.92E-06	-2.92E-06	-3.07E-06	-3.07E-06
URI (Δ CDF)	2.99E-07	2.99E-07	2.99E-07	2.99E-07	2.99E-07	2.99E-07	2.99E-07	-2.01E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.60E-06	-2.60E-06	-2.60E-06	-2.60E-06	-2.60E-06	-2.60E-06	-2.80E-06	-3.30E-06

Licensee Comments:

1Q/11: Changed PRA Parameter(s). The planned unavailability baselines for all ERCW pumps were changed as needed to reflect past and current planned maintenance not performed every 3 years or less as specified by NEI 99-02.

4Q/10: Risk Cap Invoked. The planned unavailability baselines for all ERCW pumps were changed as needed to reflect past and current planned maintenance not performed every 3 years or less as specified by NEI 99-02.


3Q/10: Risk Cap Invoked. The planned unavailability baselines for all ERCW pumps were changed as needed to reflect past and current planned maintenance not performed every 3 years or less as specified by NEI 99-02.

2Q/10: Risk Cap Invoked. The planned unavailability baselines for all ERCW pumps were changed as needed to reflect past and current planned maintenance not performed every 3 years or less as specified by NEI 99-02.

1Q/10: Risk Cap Invoked. The planned unavailability baselines for all ERCW pumps were changed as needed to reflect past and current planned maintenance not performed every 3 years or less as specified by NEI 99-02.

4Q/09: Risk Cap Invoked. The planned unavailability baselines for all ERCW pumps were changed as needed to reflect past and current planned maintenance not performed every 3 years or less as specified by NEI 99-02.

Reactor Coolant System Activity

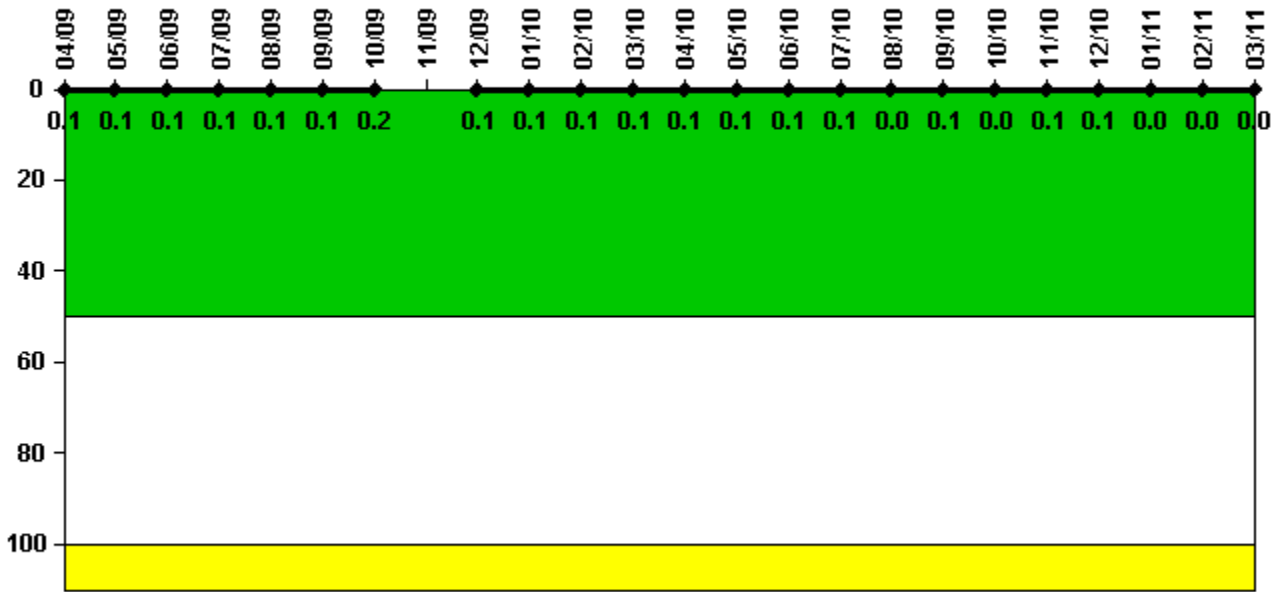


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum activity	0.000353	0.000356	0.000374	0.000394	0.000383	0.000417	0.000696	N/A	0.000318	0.000311	0.000343	0.000317
Technical specification limit	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.2	N/A	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum activity	0.000318	0.000349	0.000350	0.000333	0.000131	0.000289	0.000117	0.000279	0.000271	0.000149	0.000125	0.000156
Technical specification limit	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
Indicator value	0.1	0.1	0.1	0.1	0	0.1	0	0.1	0.1	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

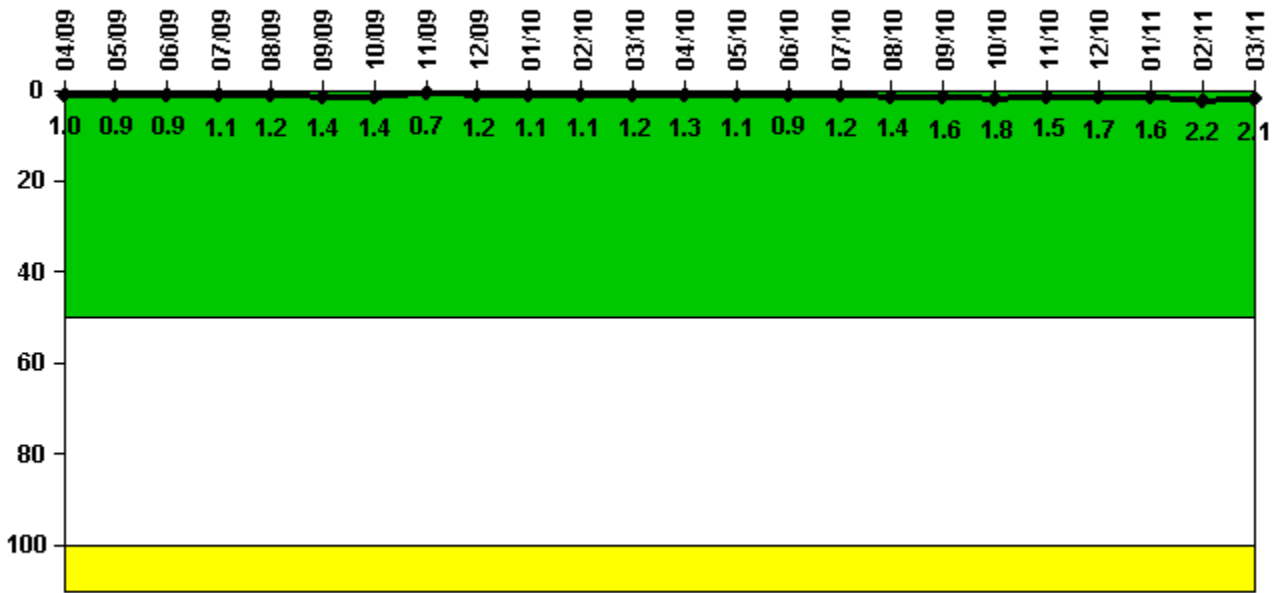


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/09	5/09	6/09	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10
Maximum leakage	0.100	0.090	0.090	0.110	0.120	0.140	0.140	0.070	0.120	0.110	0.110	0.120
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.0	0.9	0.9	1.1	1.2	1.4	1.4	0.7	1.2	1.1	1.1	1.2
Reactor Coolant System Leakage	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum leakage	0.130	0.110	0.090	0.120	0.140	0.160	0.180	0.150	0.170	0.160	0.220	0.210
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.3	1.1	0.9	1.2	1.4	1.6	1.8	1.5	1.7	1.6	2.2	2.1

Licensee Comments: none

Drill/Exercise Performance

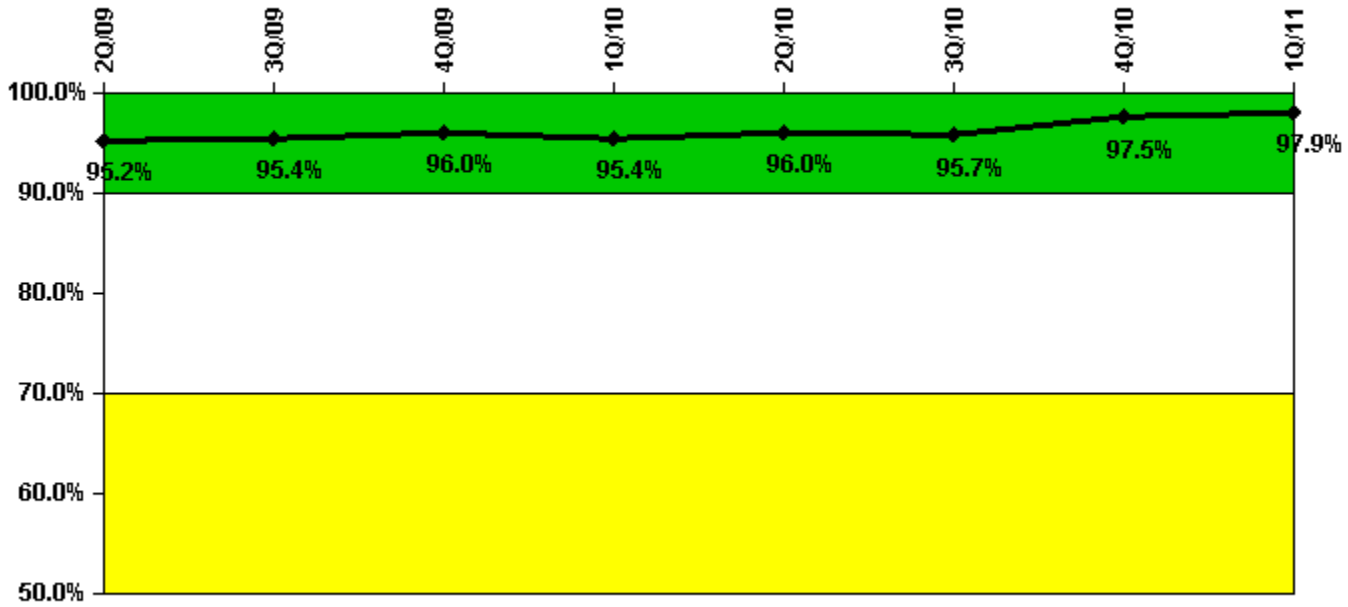


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Successful opportunities	40.0	41.0	16.0	20.0	22.0	26.0	45.0	18.0
Total opportunities	40.0	42.0	16.0	22.0	22.0	27.0	46.0	18.0
Indicator value	95.2%	95.4%	96.0%	95.4%	96.0%	95.7%	97.5%	97.9%

Licensee Comments: none

ERO Drill Participation

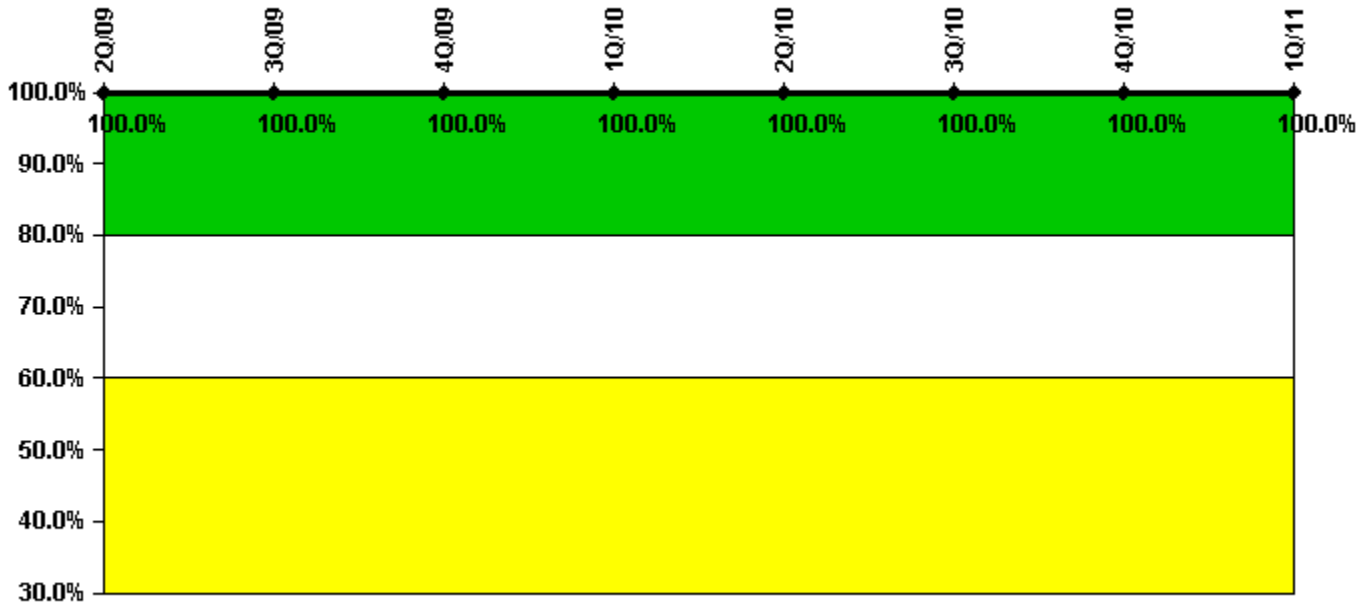


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Participating Key personnel	79.0	76.0	79.0	77.0	76.0	78.0	70.0	78.0
Total Key personnel	79.0	76.0	79.0	77.0	76.0	78.0	70.0	78.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

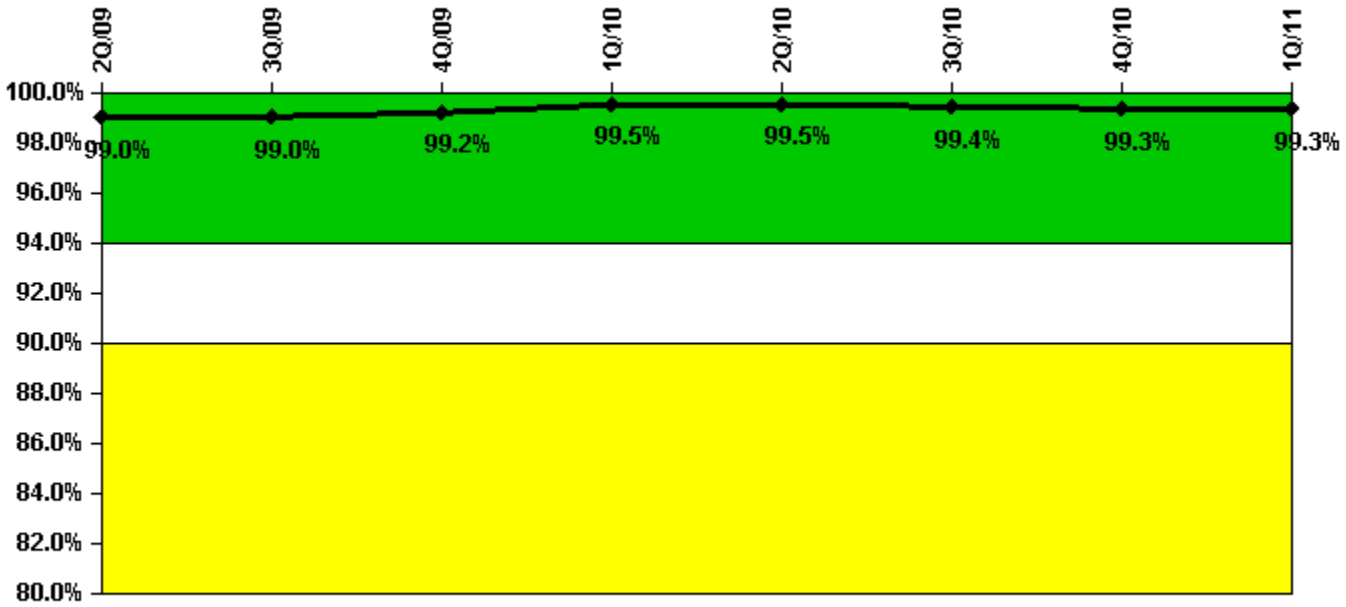

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
Successful siren-tests	969	858	969	751	967	747	967	752
Total sirens-tests	972	864	972	756	972	756	972	756
Indicator value	99.0%	99.0%	99.2%	99.5%	99.5%	99.4%	99.3%	99.3%

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/09	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.