


Browns Ferry 1

2Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

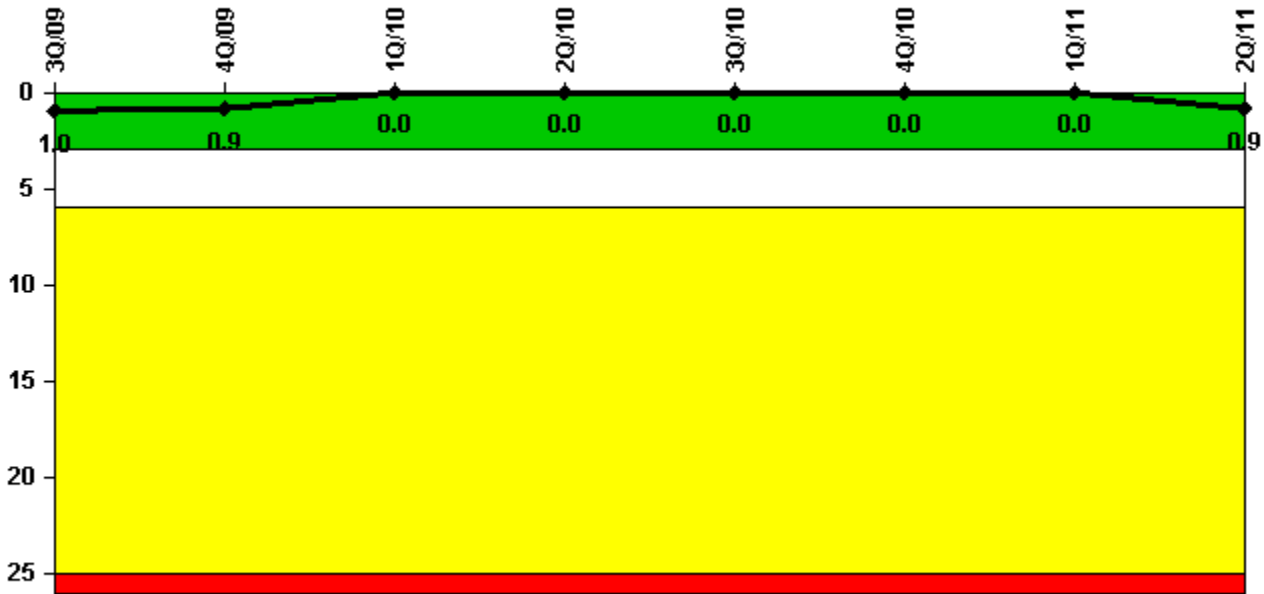


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Unplanned scrams	0	0	0	0	0	0	0	1.0
Critical hours	2208.0	2209.0	2159.0	2184.0	2208.0	1475.8	2159.0	1646.9
Indicator value	1.0	0.9	0	0	0	0	0	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

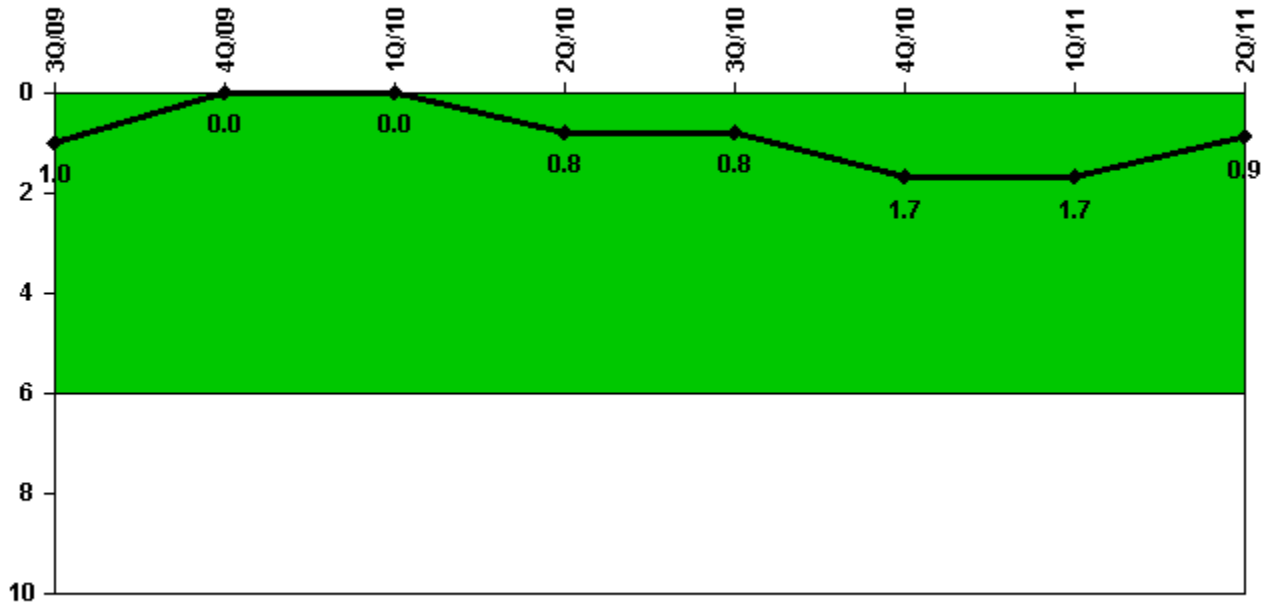


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Unplanned power changes	0	0	0	1.0	0	1.0	0	0
Critical hours	2208.0	2209.0	2159.0	2184.0	2208.0	1475.8	2159.0	1646.9
Indicator value	1.0	0	0	0.8	0.8	1.7	1.7	0.9

Licensee Comments: none

Unplanned Scrams with Complications

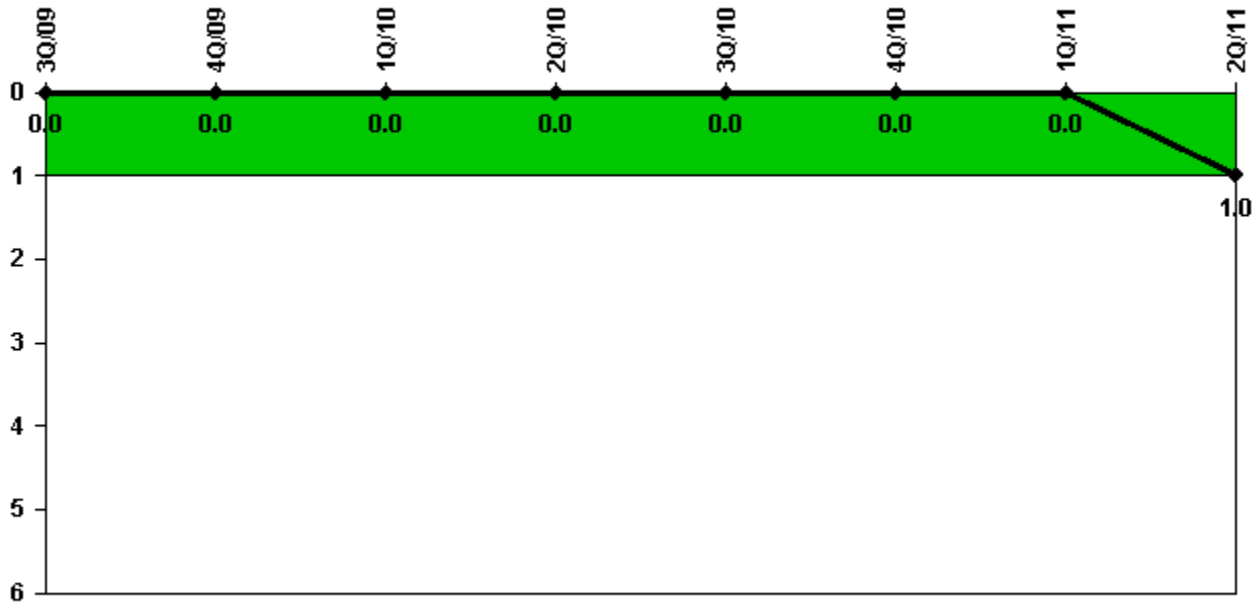


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Scrams with complications	0	0	0	0	0	0	0	1.0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0

Licensee Comments: none

Safety System Functional Failures (BWR)

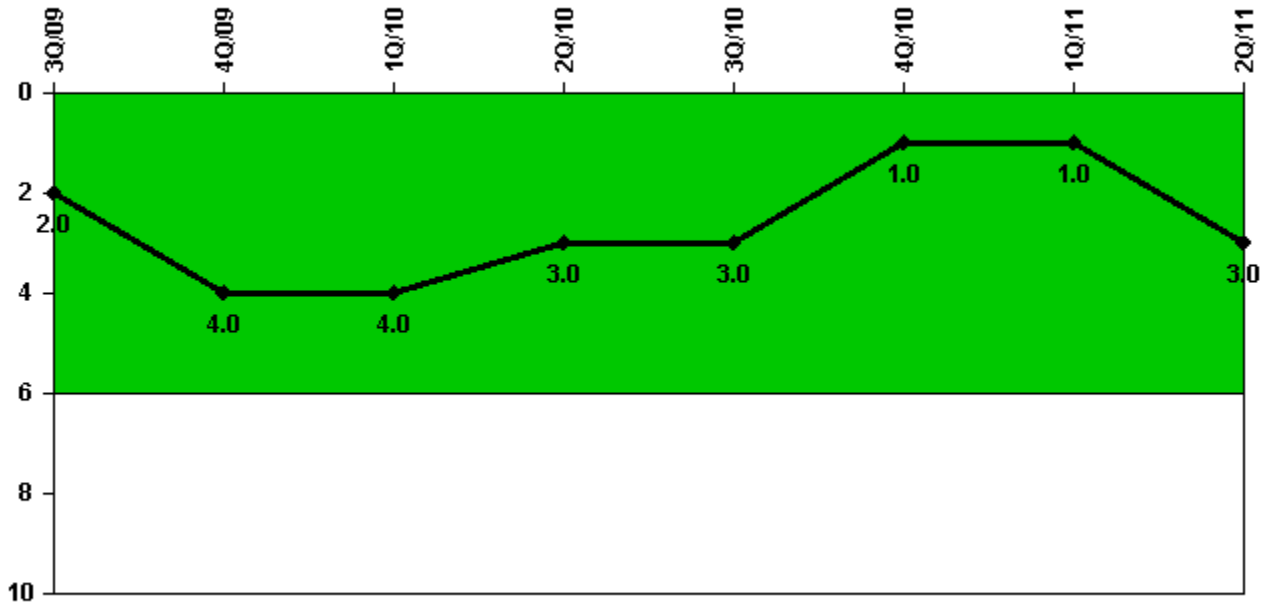

Thresholds: White > 6.0


Notes

Safety System Functional Failures (BWR)	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Safety System Functional Failures	0	3	0	0	0	1	0	2
Indicator value	2	4	4	3	3	1	1	3

Licensee Comments:

2Q/11: LER 259/2010-003-01, Failure of a Low Pressure Coolant Injection Flow Control Valve LER 259/2011-002-00, Loss of Safety Function (SDC) Resulting from Loss of Power from C EDG Due to Oil Leak

Mitigating Systems Performance Index, Emergency AC Power System

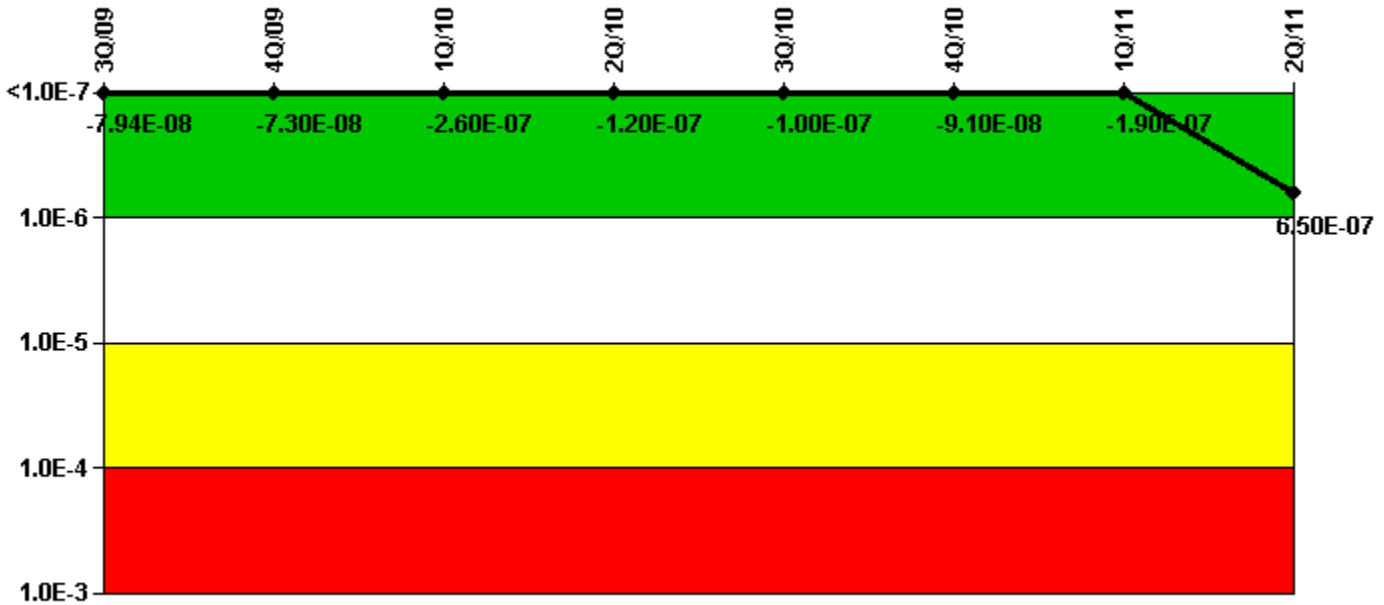


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	5.60E-09	1.10E-08	1.49E-07	1.49E-07	1.68E-07	7.59E-08	6.18E-08	5.65E-08
URI (Δ CDF)	-8.50E-08	-8.40E-08	-4.07E-07	-2.70E-07	-2.70E-07	-1.67E-07	-2.52E-07	5.90E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.94E-08	-7.30E-08	-2.60E-07	-1.20E-07	-1.00E-07	-9.10E-08	-1.90E-07	6.50E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

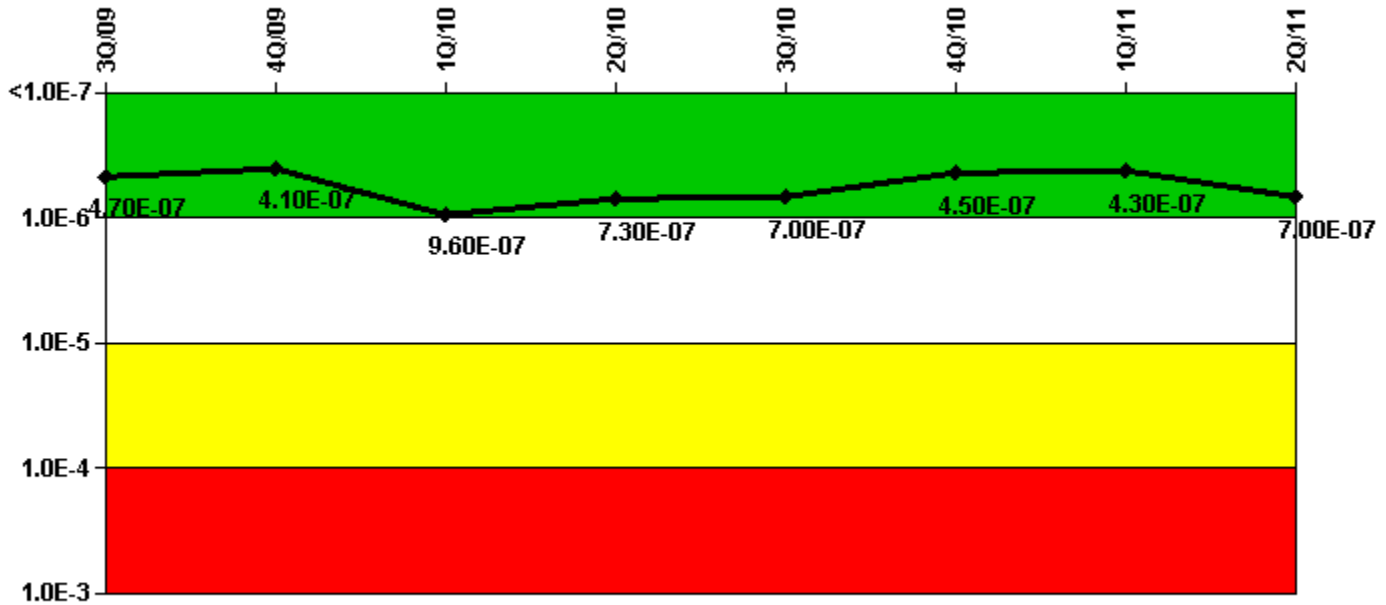

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	3.94E-07	3.38E-07	7.97E-07	5.65E-07	5.38E-07	3.49E-07	3.33E-07	2.23E-07
URI (Δ CDF)	7.97E-08	7.45E-08	1.64E-07	1.61E-07	1.60E-07	1.01E-07	1.00E-07	4.72E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.70E-07	4.10E-07	9.60E-07	7.30E-07	7.00E-07	4.50E-07	4.30E-07	7.00E-07

Licensee Comments:

2Q/11: Unpl Unav resulted from discharge check valve hanging open, causing pump suction overpressure event, causing external leakage, which caused DC motor on aux oil pump to fail. See report #678.

Mitigating Systems Performance Index, Heat Removal System

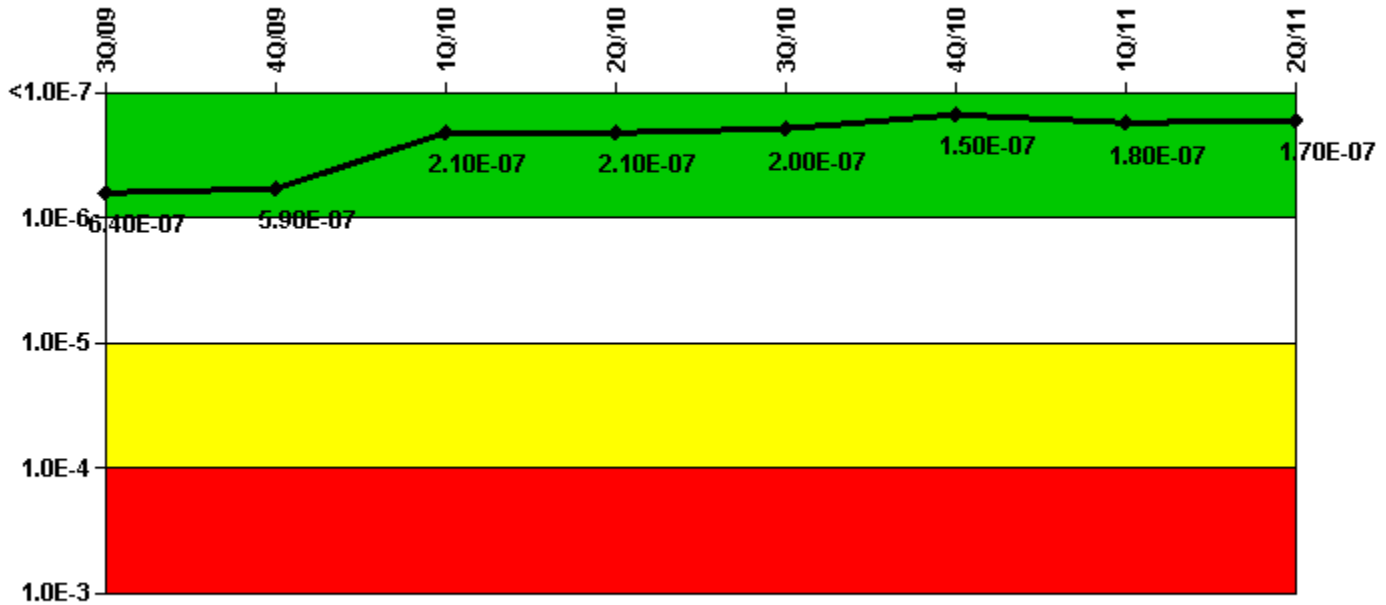

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	2.20E-07	1.90E-07	6.79E-08	6.25E-08	6.22E-08	3.16E-08	6.29E-08	5.82E-08
URI (Δ CDF)	4.20E-07	4.00E-07	1.46E-07	1.43E-07	1.42E-07	1.19E-07	1.17E-07	1.15E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.40E-07	5.90E-07	2.10E-07	2.10E-07	2.00E-07	1.50E-07	1.80E-07	1.70E-07

Licensee Comments:

1Q/11: Unit 1 RCIC Baseline Performance Data was revised effective January 2011 to reflect actual Unit 1 RCIC performance from October 2007 through September 2010. Previously, Unit 2 RCIC Baseline Performance Data was used for Unit 1 RCIC because Unit 1 lacked sufficient operating history to develop a 12 quarter performance baseline.

Mitigating Systems Performance Index, Residual Heat Removal System

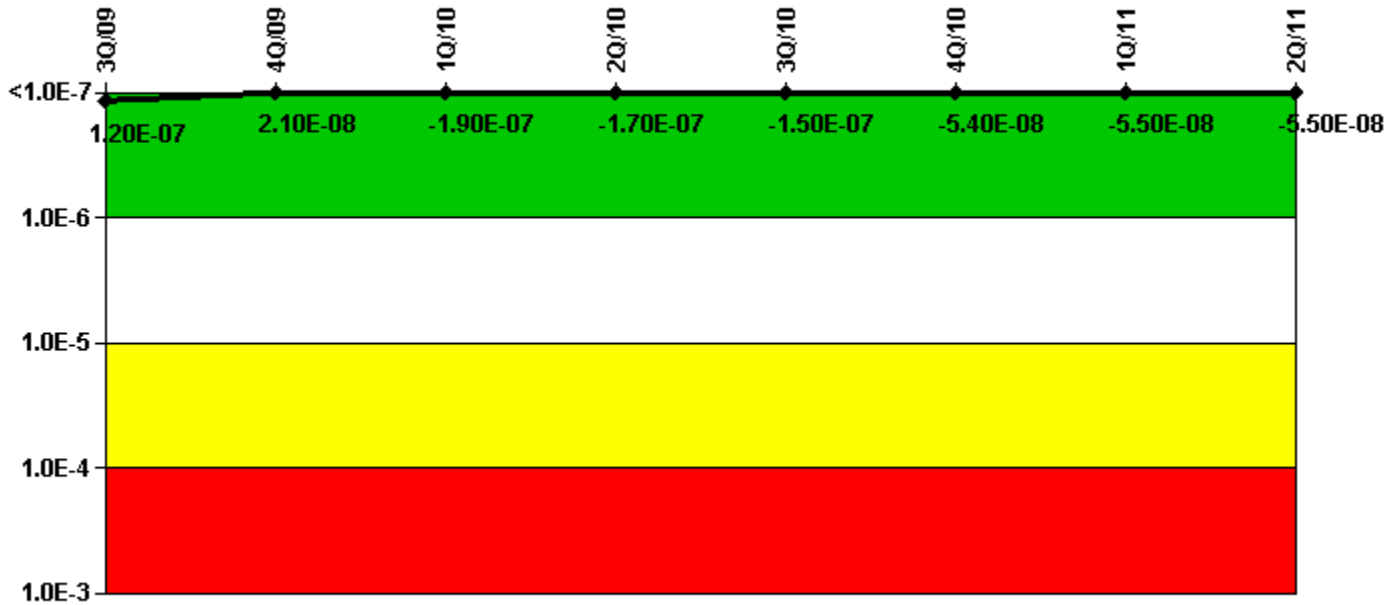


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (ΔCDF)	2.68E-07	1.68E-07	6.63E-09	6.78E-09	2.26E-08	1.77E-09	1.90E-09	1.80E-09
URI (ΔCDF)	-1.47E-07	-1.47E-07	-1.95E-07	-1.78E-07	-1.76E-07	-5.62E-08	-5.66E-08	-5.65E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.20E-07	2.10E-08	-1.90E-07	-1.70E-07	-1.50E-07	-5.40E-08	-5.50E-08	-5.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

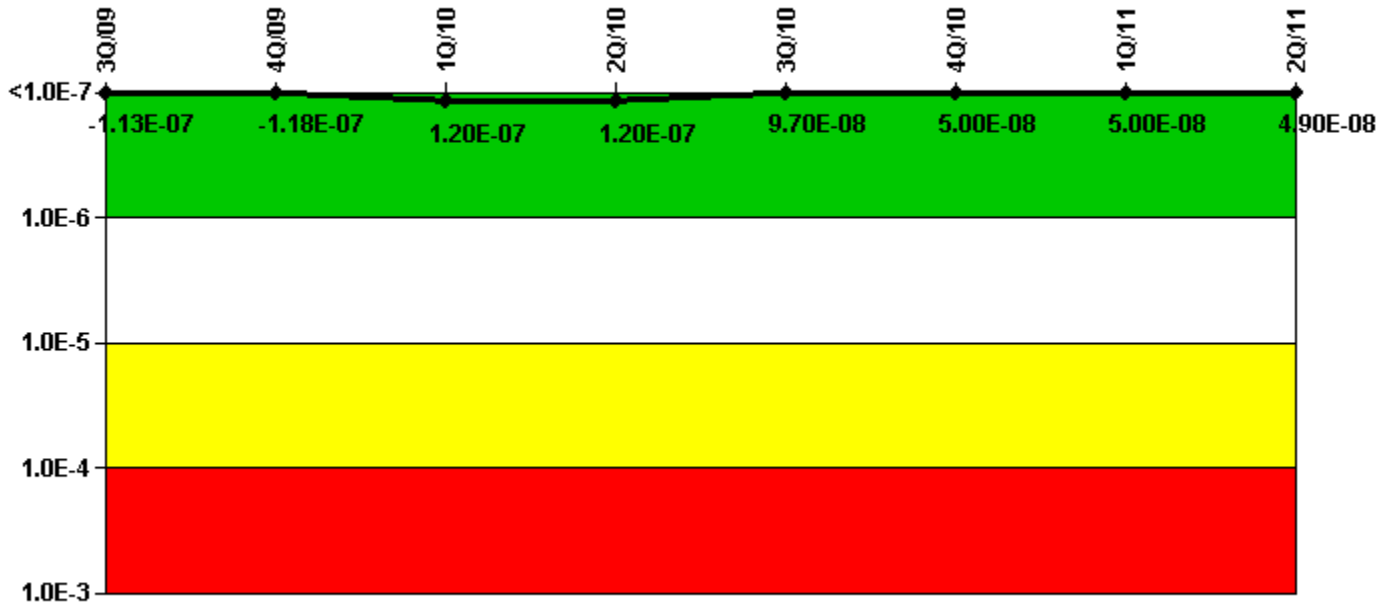


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	1.70E-08	1.20E-08	6.21E-08	5.72E-08	5.35E-08	3.46E-09	3.46E-09	2.84E-09
URI (Δ CDF)	-1.30E-07	-1.30E-07	5.99E-08	5.99E-08	4.40E-08	4.68E-08	4.68E-08	4.64E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.13E-07	-1.18E-07	1.20E-07	1.20E-07	9.70E-08	5.00E-08	5.00E-08	4.90E-08

Licensee Comments: none

Reactor Coolant System Activity

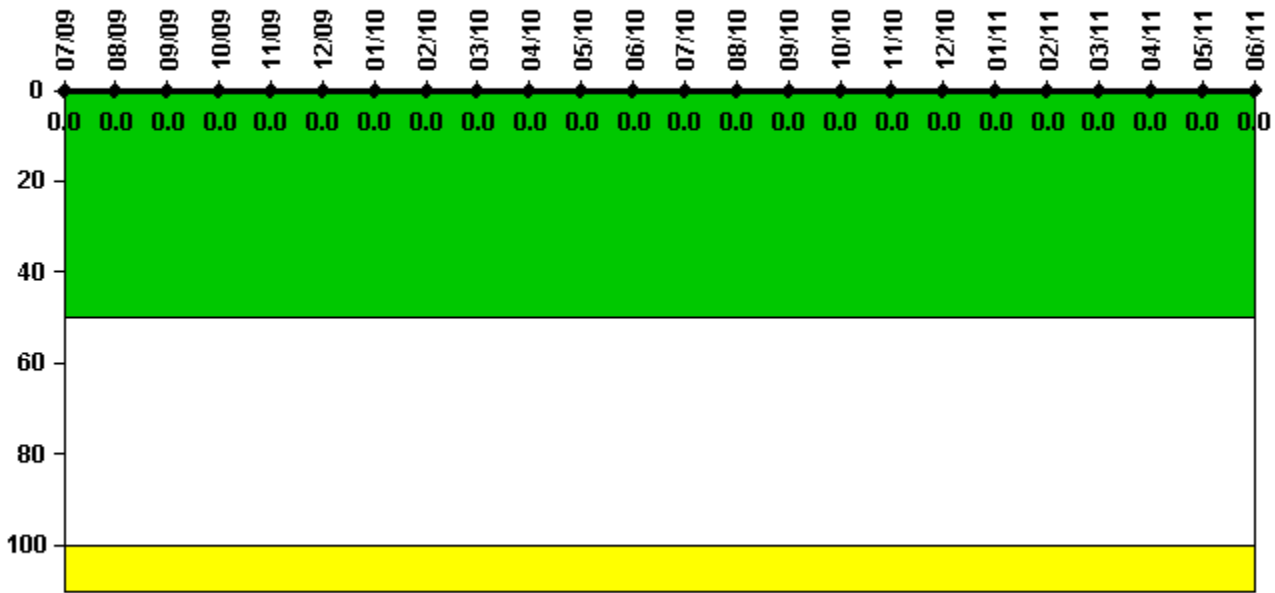


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum activity	0.000039	0.000035	0.000061	0.000046	0.000068	0.000078	0.000097	0.000086	0.000086	0.000052	0.000046	0.000044
Technical specification limit	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity	0.000049	0.000046	0.000103	0.000116	0.000067	0.000088	0.000073	0.000081	0.000067	0.000068	0.000055	0.000160
Technical specification limit	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

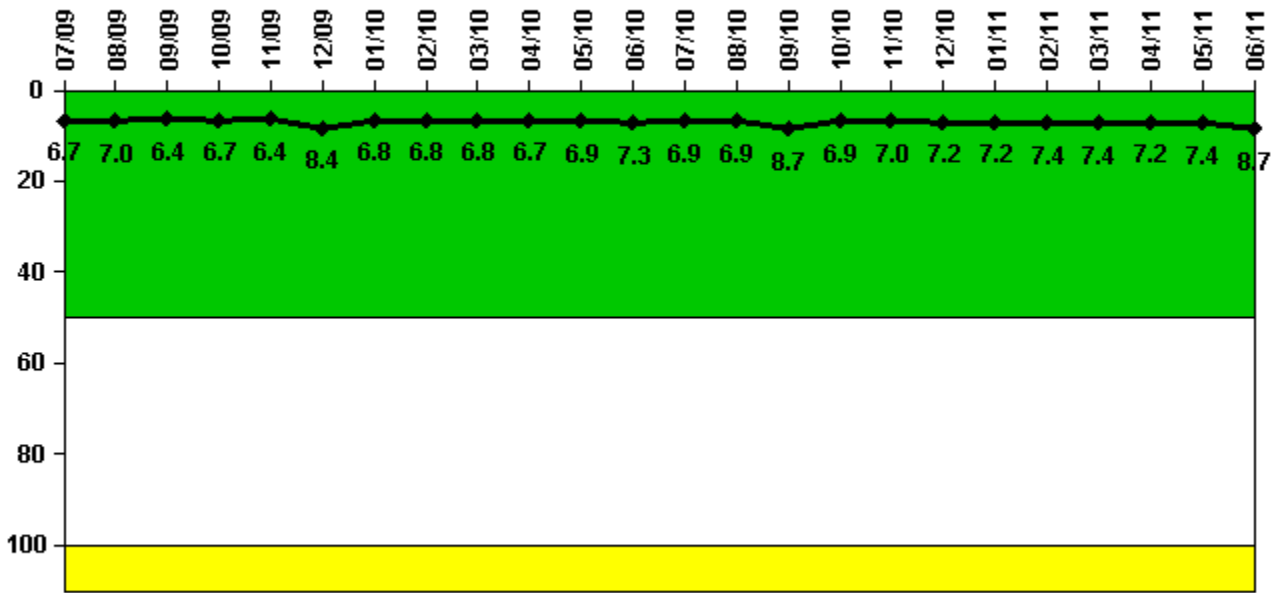


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum leakage	2.000	2.090	1.920	2.010	1.930	2.510	2.040	2.030	2.040	2.020	2.060	2.180
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	6.7	7.0	6.4	6.7	6.4	8.4	6.8	6.8	6.8	6.7	6.9	7.3
Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	2.080	2.080	2.600	2.070	2.110	2.150	2.170	2.230	2.220	2.170	2.230	2.600
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	6.9	6.9	8.7	6.9	7.0	7.2	7.2	7.4	7.4	7.2	7.4	8.7

Licensee Comments: none

Drill/Exercise Performance

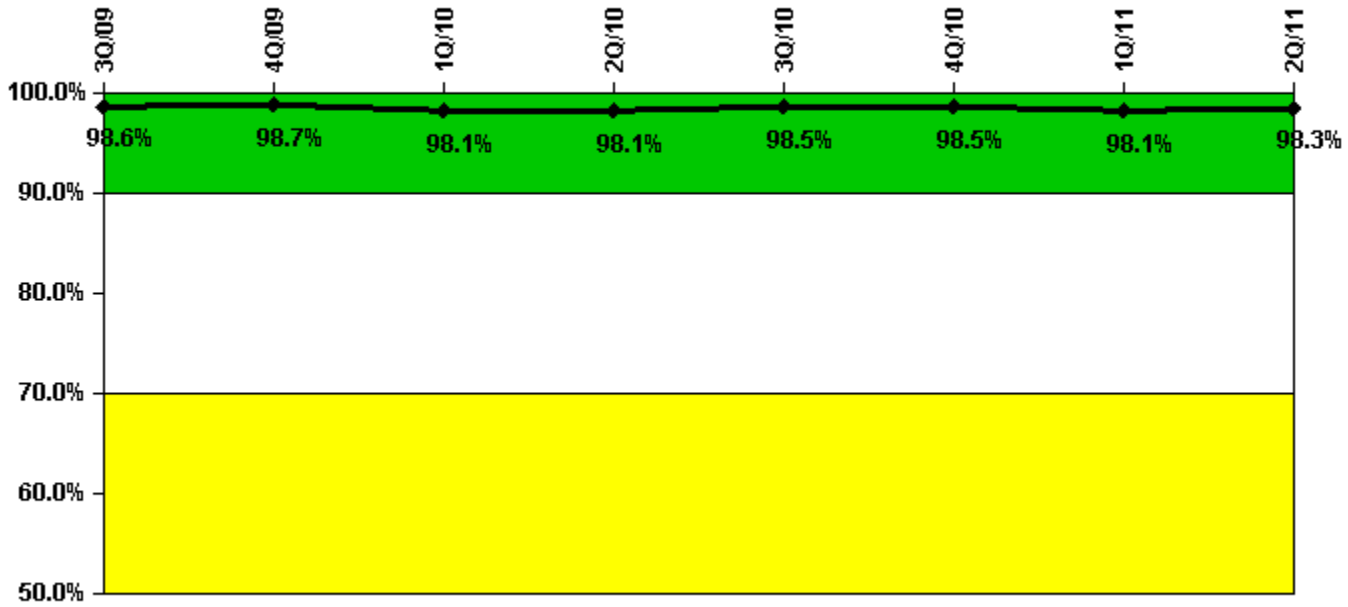


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Successful opportunities	8.0	71.0	5.0	8.0	50.0	39.0	25.0	24.0
Total opportunities	8.0	72.0	6.0	8.0	50.0	40.0	26.0	24.0
Indicator value	98.6%	98.7%	98.1%	98.1%	98.5%	98.5%	98.1%	98.3%

Licensee Comments: none

ERO Drill Participation

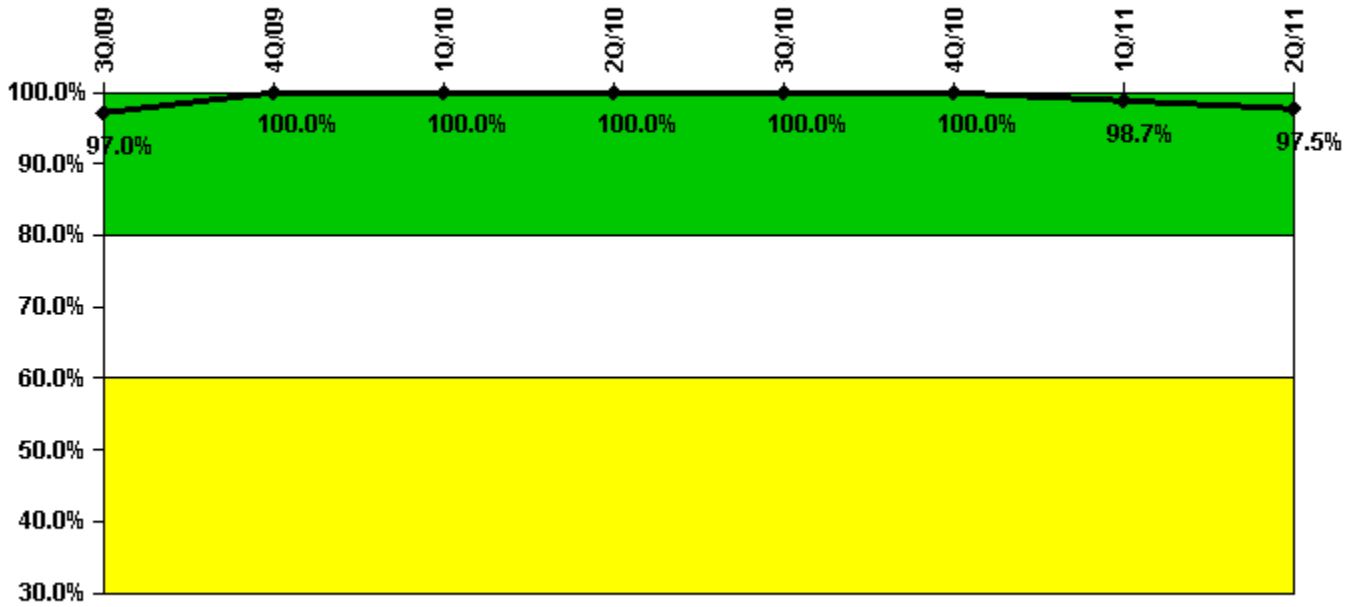


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Participating Key personnel	64.0	69.0	72.0	73.0	73.0	74.0	76.0	77.0
Total Key personnel	66.0	69.0	72.0	73.0	73.0	74.0	77.0	79.0
Indicator value	97.0%	100.0%	100.0%	100.0%	100.0%	100.0%	98.7%	97.5%

Licensee Comments: none

Alert & Notification System

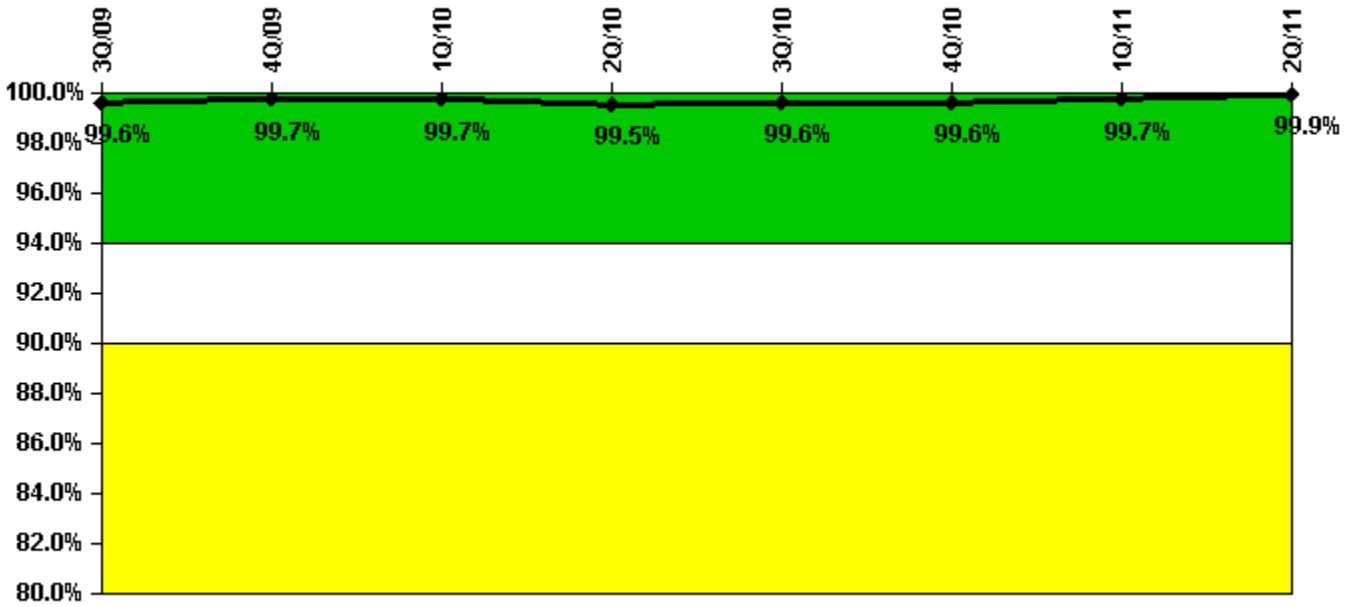


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Successful siren-tests	897	698	897	693	898	699	700	599
Total sirens-tests	900	700	900	700	900	700	700	600
Indicator value	99.6%	99.7%	99.7%	99.5%	99.6%	99.6%	99.7%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

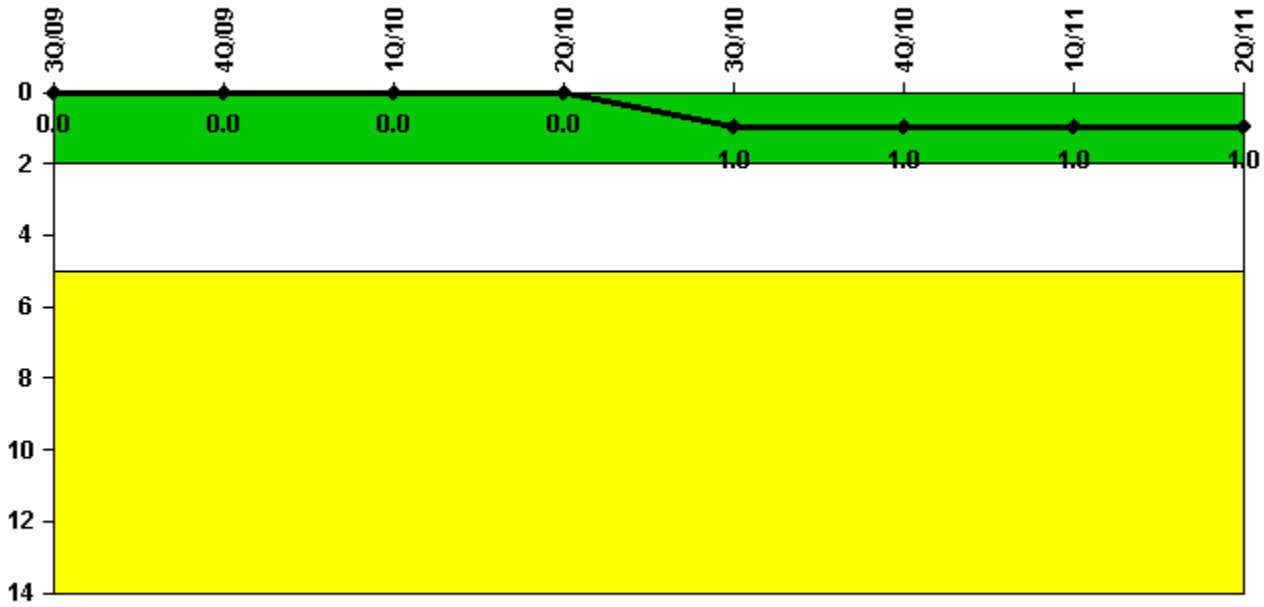

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
High radiation area occurrences	0	0	0	0	1	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	1	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.