


Braidwood 1

2Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

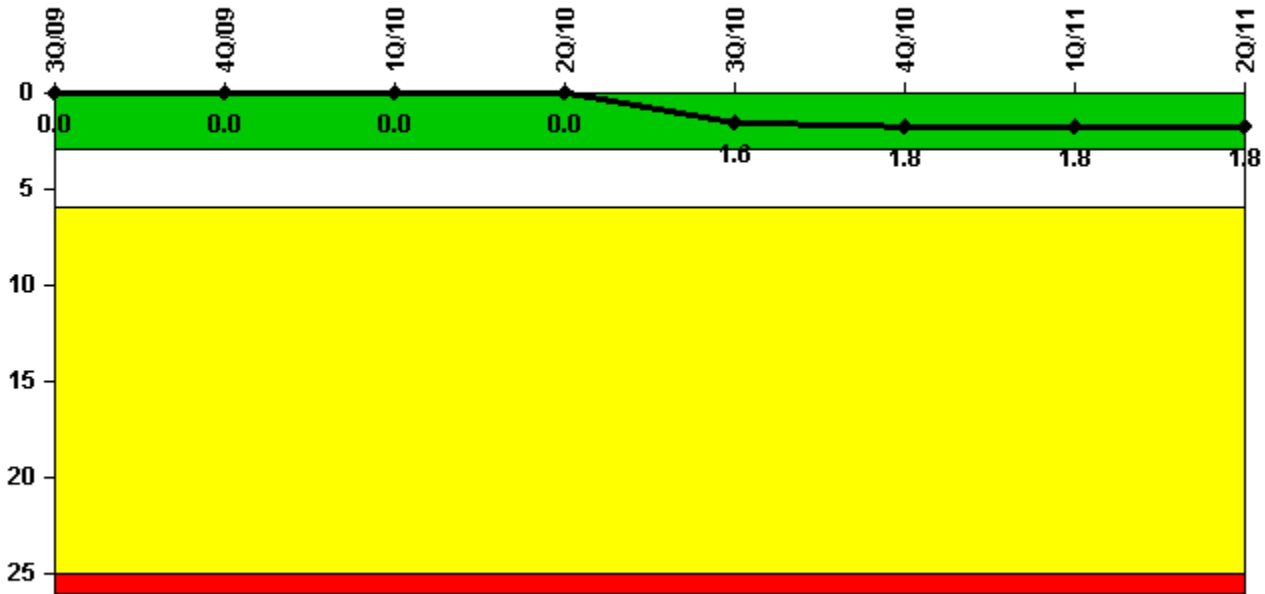


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Unplanned scrams	0	0	0	0	2.0	0	0	0
Critical hours	2208.0	2209.0	2159.0	2184.0	2069.2	1433.2	2159.0	2184.0
Indicator value	0	0	0	0	1.6	1.8	1.8	1.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

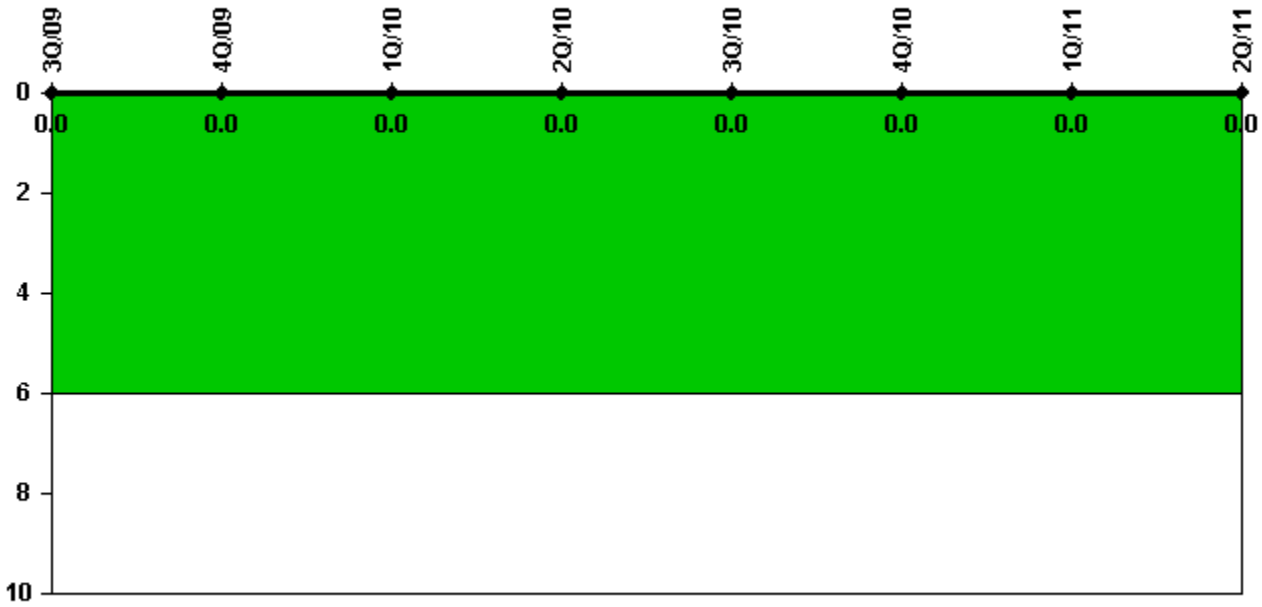

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	2159.0	2184.0	2069.2	1433.2	2159.0	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

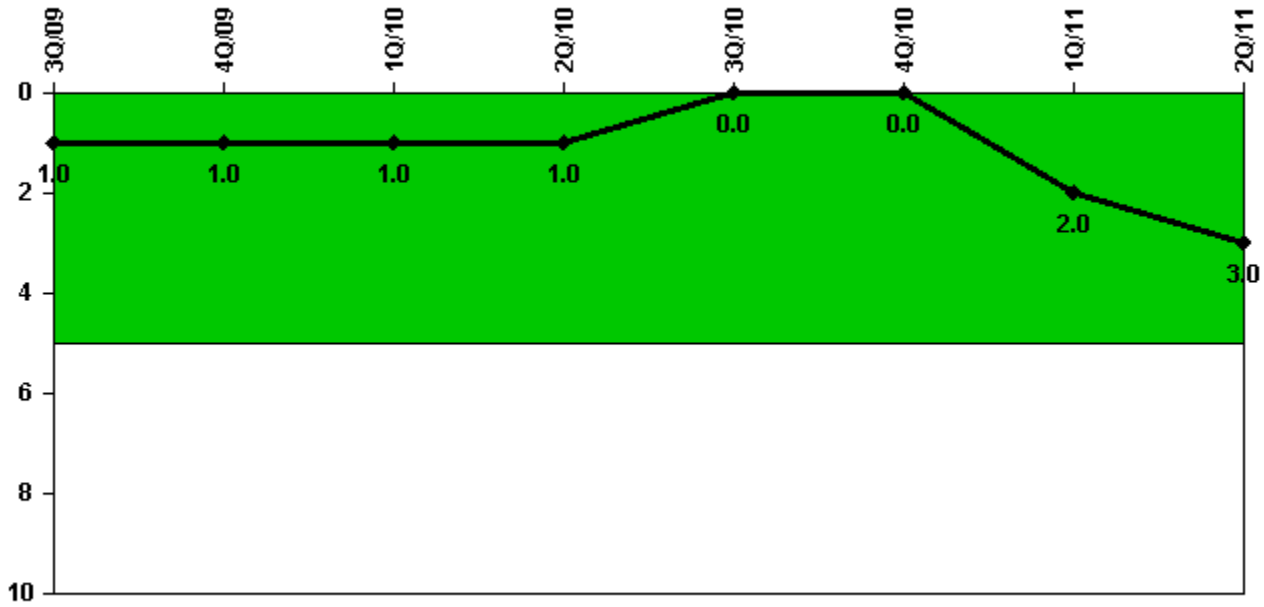

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Safety System Functional Failures	1	0	0	0	0	0	2	1
Indicator value	1	1	1	1	0	0	2	3

Licensee Comments:

2Q/11: 1 SSFF - LER 2011-003-00, Drained Sections of Piping in Auxiliary Feedwater Suction Lines Result in system Inoperability Due to Inadequate Technical Evaluation.

Mitigating Systems Performance Index, Emergency AC Power System

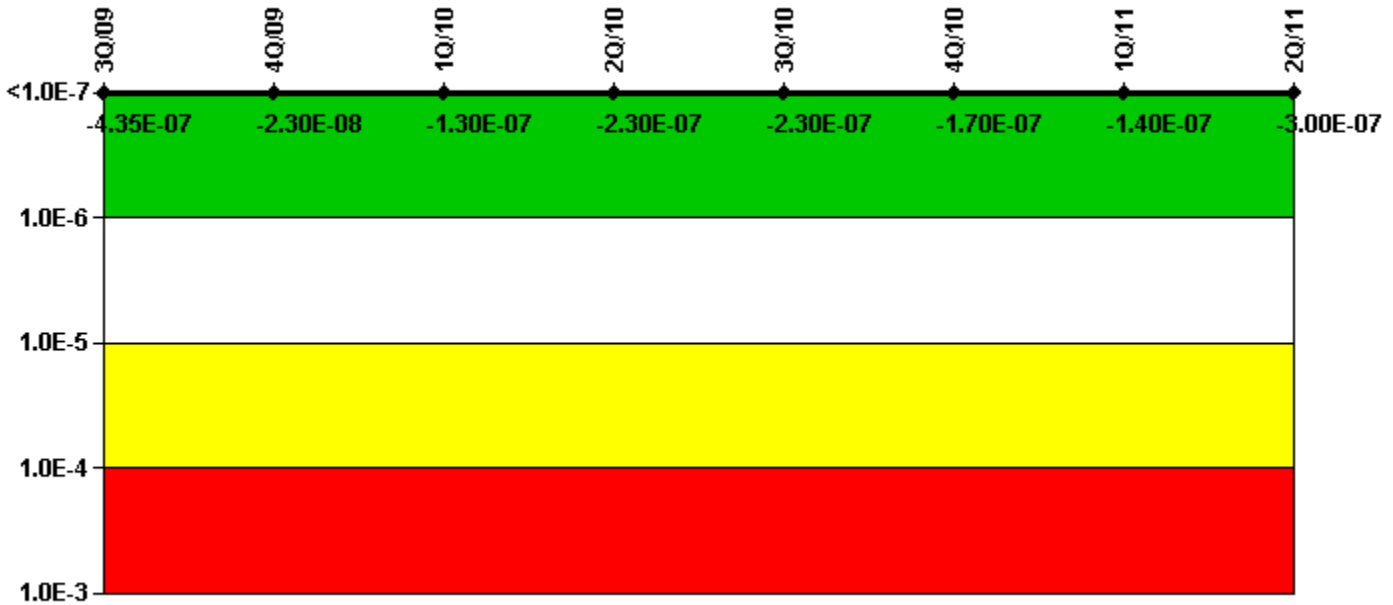


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	$5.50E-08$	$4.90E-08$	$3.86E-08$	$1.95E-08$	$1.74E-08$	$1.66E-08$	$4.30E-08$	$3.72E-09$
URI (Δ CDF)	$-4.90E-07$	$-7.20E-08$	$-1.72E-07$	$-2.46E-07$	$-2.46E-07$	$-1.84E-07$	$-1.80E-07$	$-3.03E-07$
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	$-4.35E-07$	$-2.30E-08$	$-1.30E-07$	$-2.30E-07$	$-2.30E-07$	$-1.70E-07$	$-1.40E-07$	$-3.00E-07$

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

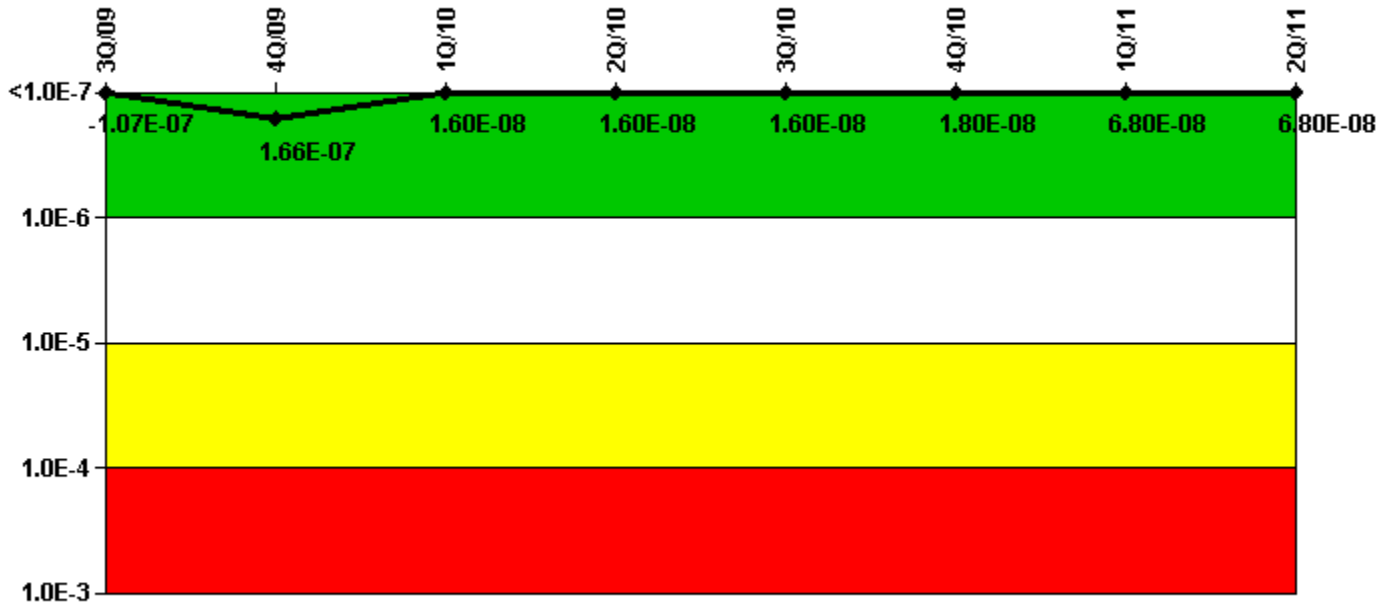

Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$


Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	-9.20E-08	1.80E-07	1.93E-08	1.93E-08	1.95E-08	2.15E-08	7.18E-08	7.18E-08
URI (Δ CDF)	-1.50E-08	-1.40E-08	-3.31E-09	-3.38E-09	-3.38E-09	-3.36E-09	-3.35E-09	-3.36E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.07E-07	1.66E-07	1.60E-08	1.60E-08	1.60E-08	1.80E-08	6.80E-08	6.80E-08

Licensee Comments:

1Q/11: Unit 1 revised unplanned unavailability on 1A safety injection pump from 82.7 to 77.5 hours, based on correction to LCO entry time.

Mitigating Systems Performance Index, Heat Removal System

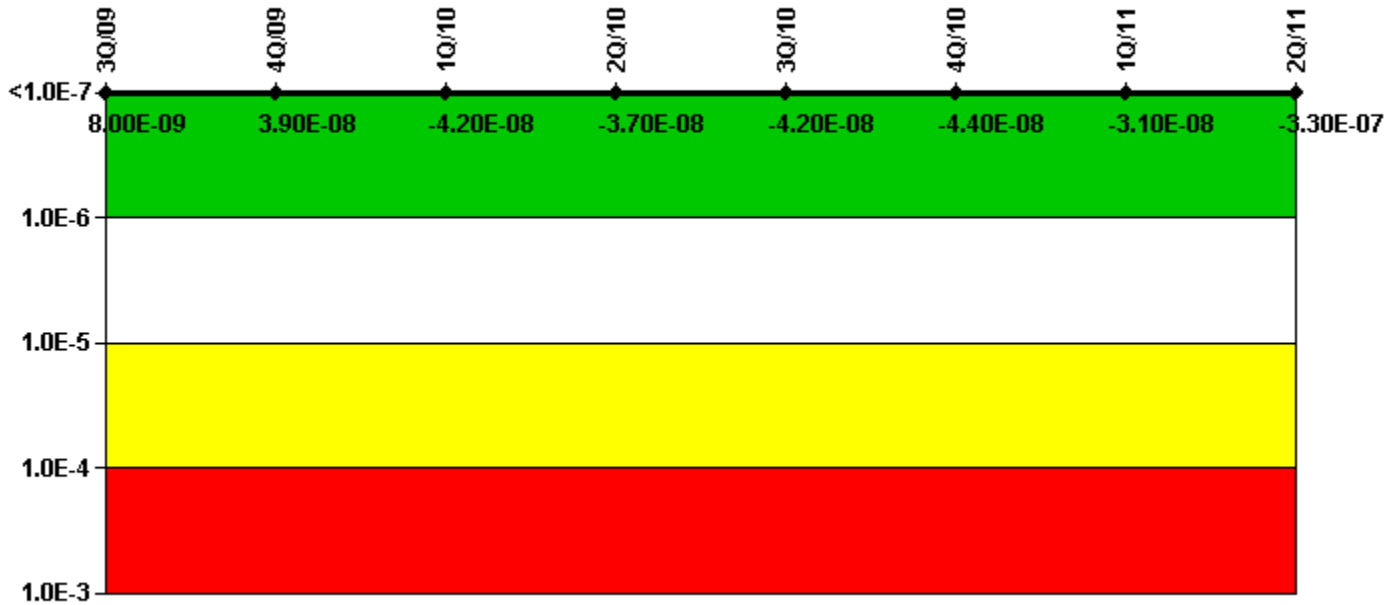


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	-1.50E-08	-1.50E-08	-5.04E-08	-5.05E-08	-5.00E-08	-4.94E-08	-3.56E-08	-4.92E-08
URI (Δ CDF)	2.30E-08	5.40E-08	8.14E-09	1.36E-08	7.92E-09	5.20E-09	5.07E-09	-2.80E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.00E-09	3.90E-08	-4.20E-08	-3.70E-08	-4.20E-08	-4.40E-08	-3.10E-08	-3.30E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

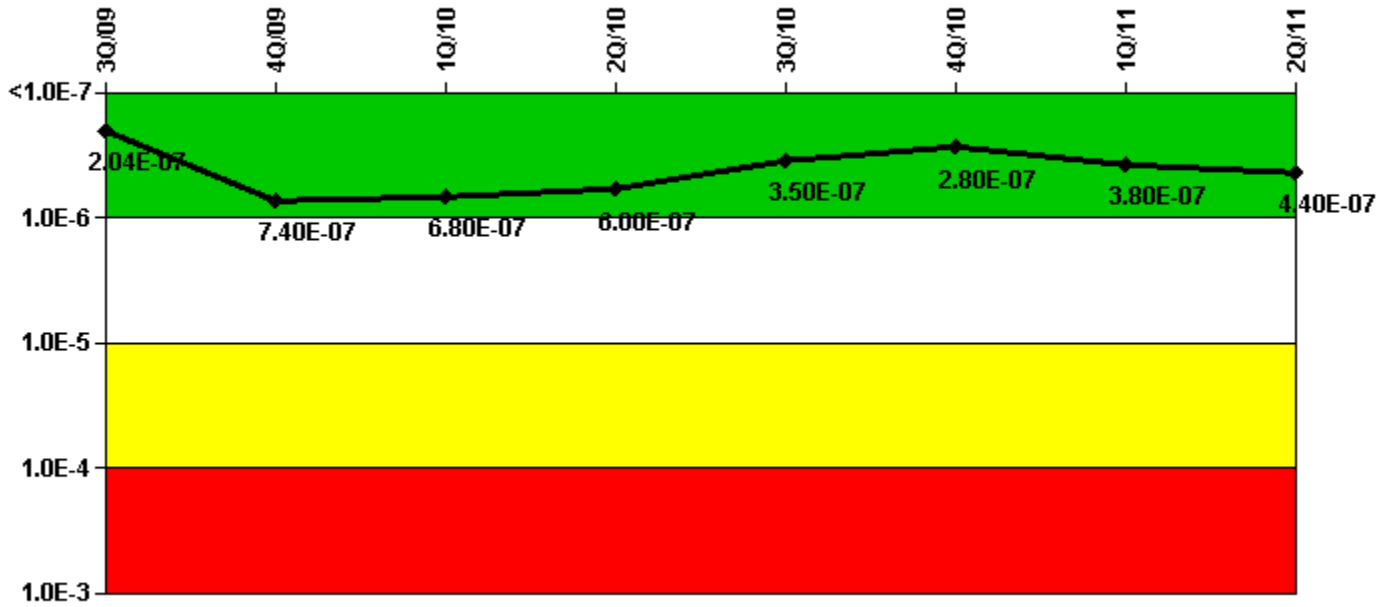

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	2.40E-08	2.20E-07	3.66E-07	2.89E-07	3.51E-08	-2.46E-08	6.52E-08	1.24E-07
URI (Δ CDF)	1.80E-07	5.20E-07	3.14E-07	3.15E-07	3.19E-07	3.09E-07	3.15E-07	3.17E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.04E-07	7.40E-07	6.80E-07	6.00E-07	3.50E-07	2.80E-07	3.80E-07	4.40E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	6.80E-07	6.80E-07	8.75E-08	2.41E-07	3.53E-07	3.02E-07	3.69E-07	2.97E-07
URI (Δ CDF)	-1.50E-06	-1.50E-06	-5.79E-07	-5.81E-07	-5.88E-07	-5.87E-07	-5.87E-07	-5.90E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.20E-07	-8.20E-07	-4.90E-07	-3.40E-07	-2.30E-07	-2.90E-07	-2.20E-07	-2.90E-07

Licensee Comments: none

Reactor Coolant System Activity

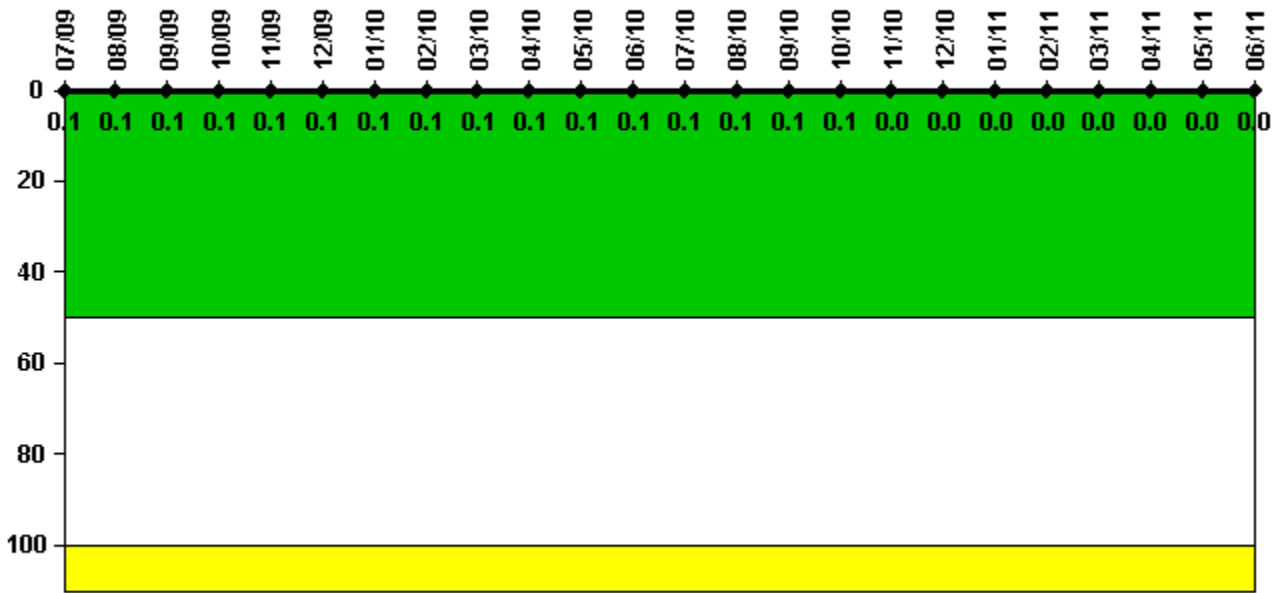


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum activity	0.000816	0.000864	0.000884	0.000951	0.000989	0.001030	0.001110	0.001100	0.000680	0.000694	0.000738	0.000750
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity	0.000768	0.000870	0.000829	0.000784	0.000265	0.000268	0.000288	0.000292	0.000325	0.000333	0.000345	0.000345
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

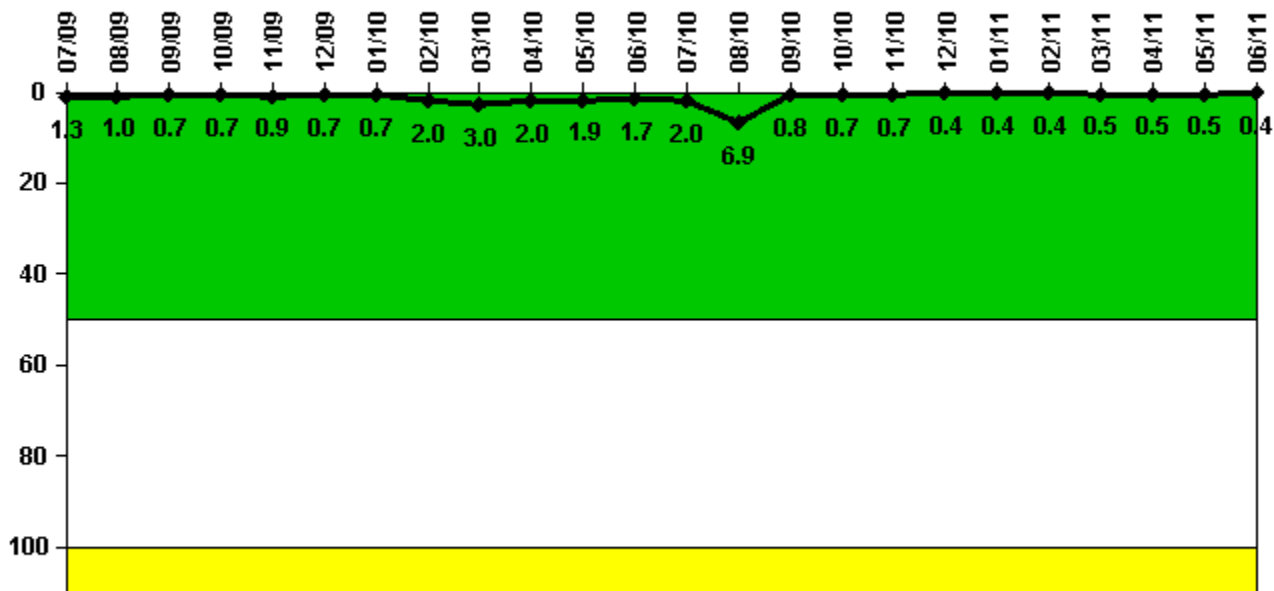


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum leakage	0.127	0.102	0.072	0.066	0.086	0.067	0.066	0.202	0.301	0.201	0.194	0.168
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.3	1.0	0.7	0.7	0.9	0.7	0.7	2.0	3.0	2.0	1.9	1.7
Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	0.196	0.688	0.078	0.069	0.066	0.042	0.039	0.041	0.047	0.048	0.045	0.042
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.0	6.9	0.8	0.7	0.7	0.4	0.4	0.4	0.5	0.5	0.5	0.4

Licensee Comments: none

Drill/Exercise Performance

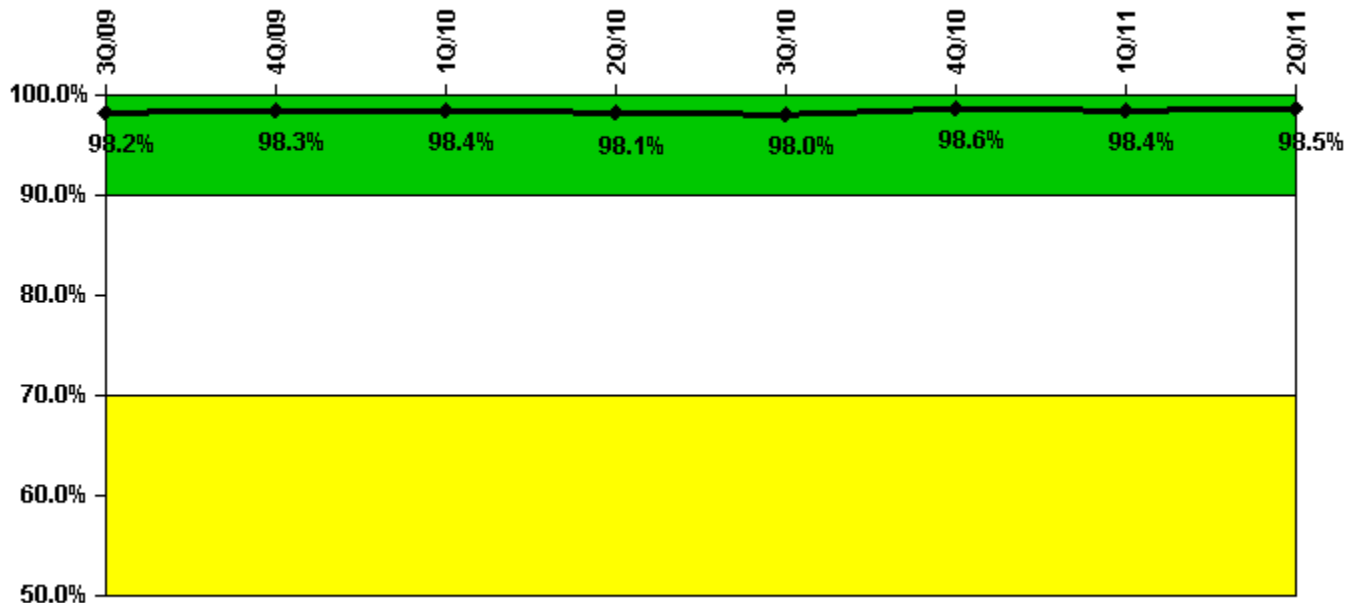

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Successful opportunities	117.0	0	30.0	27.0	55.0	114.0	39.0	16.0
Total opportunities	118.0	0	32.0	28.0	56.0	114.0	40.0	16.0
Indicator value	98.2%	98.3%	98.4%	98.1%	98.0%	98.6%	98.4%	98.5%

Licensee Comments:

1Q/11: March data revised to reflect a failed DEP for an actual event for late declaraton.

ERO Drill Participation

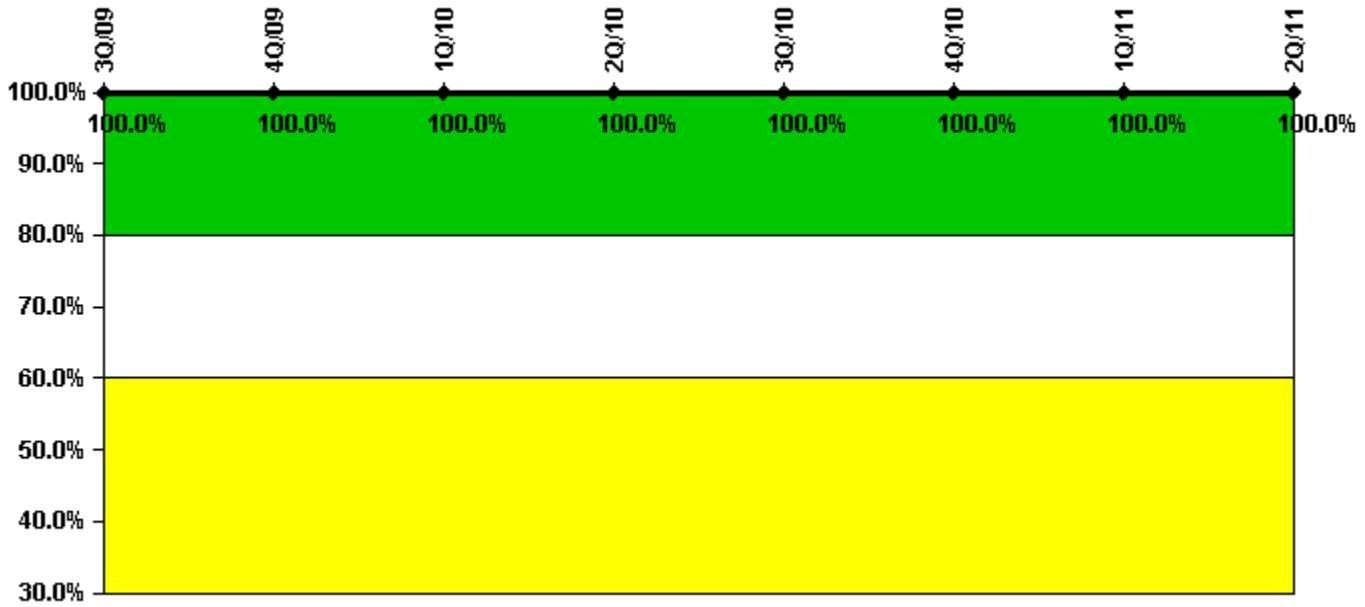


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Participating Key personnel	71.0	73.0	67.0	70.0	72.0	67.0	64.0	62.0
Total Key personnel	71.0	73.0	67.0	70.0	72.0	67.0	64.0	62.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

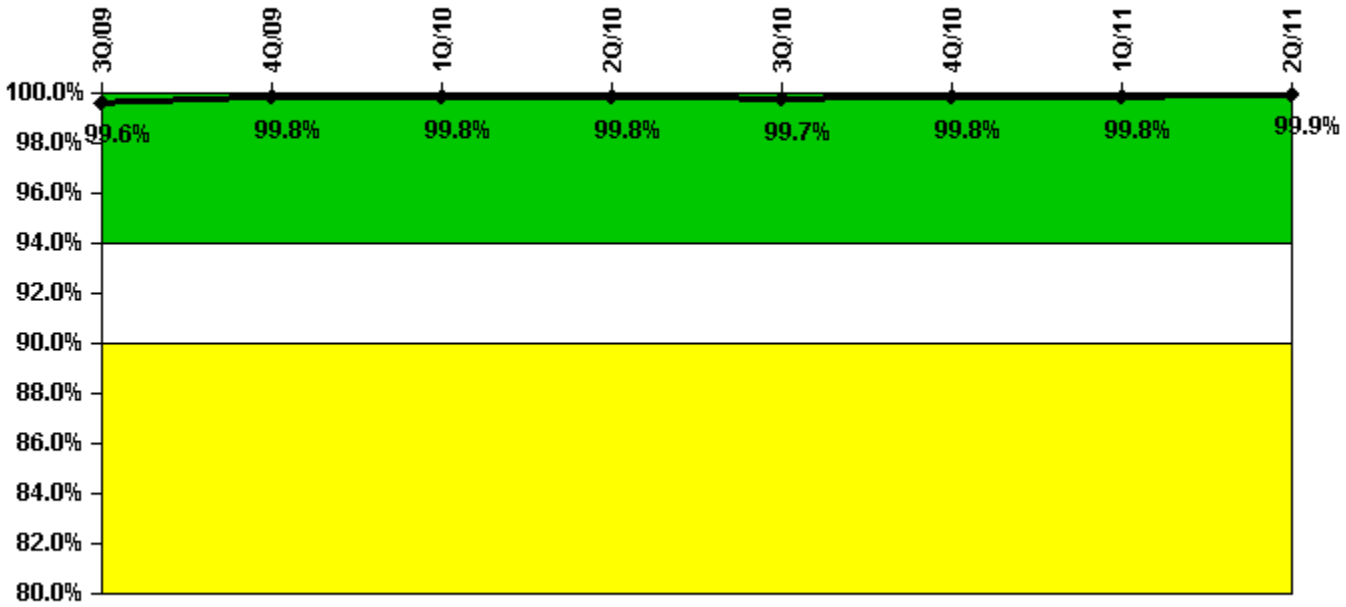

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Successful siren-tests	4544	4467	3020	3058	3116	3119	3068	3065
Total sirens-tests	4550	4480	3024	3072	3120	3120	3072	3072
Indicator value	99.6%	99.8%	99.8%	99.8%	99.7%	99.8%	99.8%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.