


D.C. Cook 1

2Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

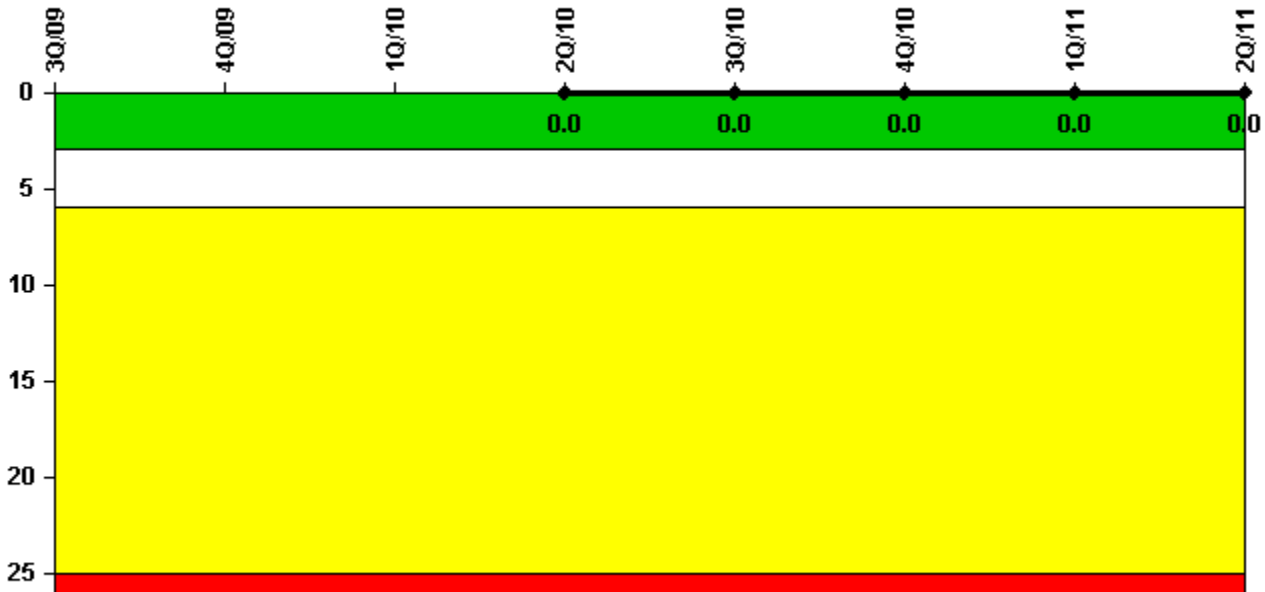


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	0	335.1	1464.0	1988.1	2208.0	2209.0	2031.6	2184.0
Indicator value	N/A	N/A	N/A	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

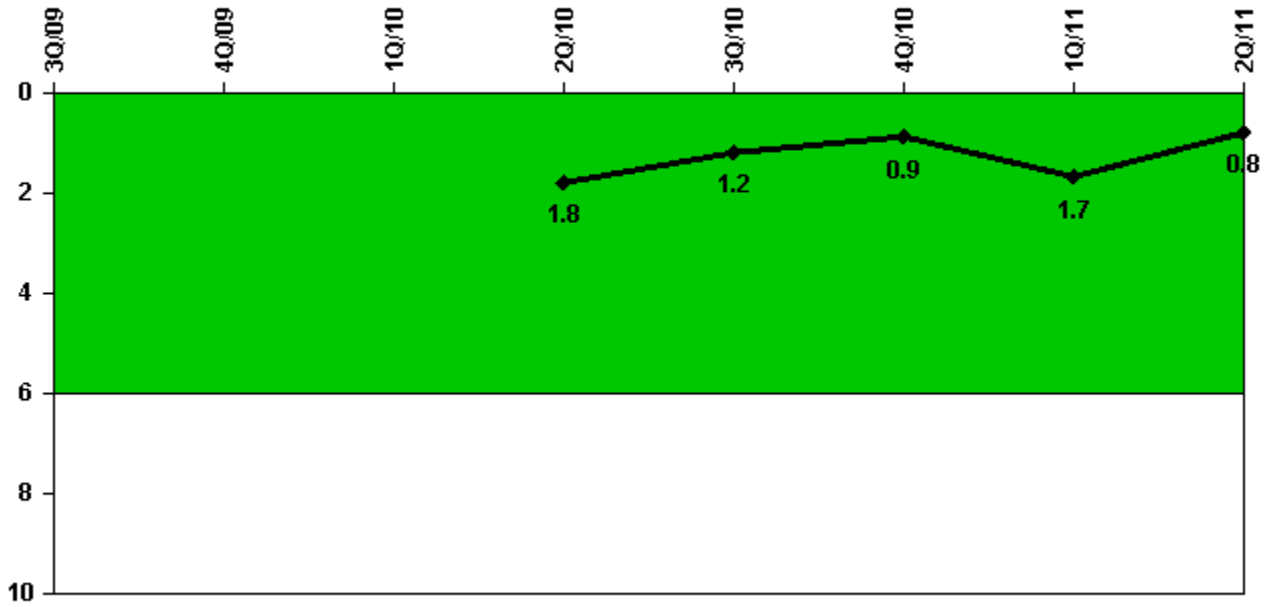

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Unplanned power changes	0	0	0	1.0	0	0	1.0	0
Critical hours	0	335.1	1464.0	1988.1	2208.0	2209.0	2031.6	2184.0
Indicator value	N/A	N/A	N/A	1.8	1.2	0.9	1.7	0.8

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

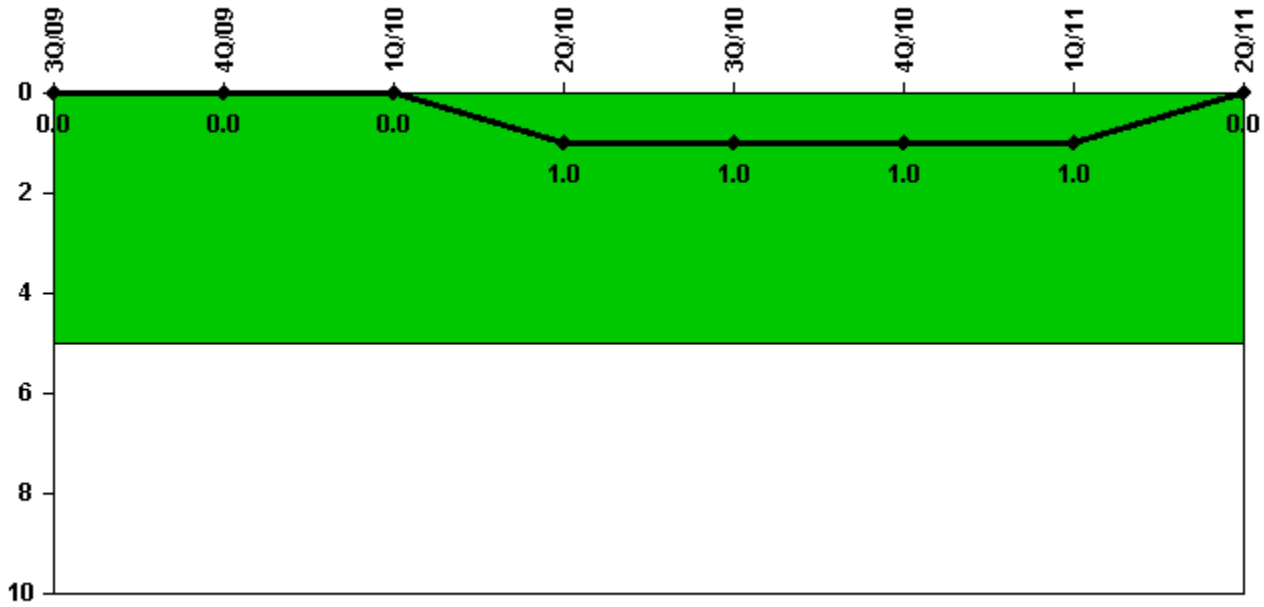


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Safety System Functional Failures	0	0	0	1	0	0	0	0
Indicator value	0	0	0	1	1	1	1	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

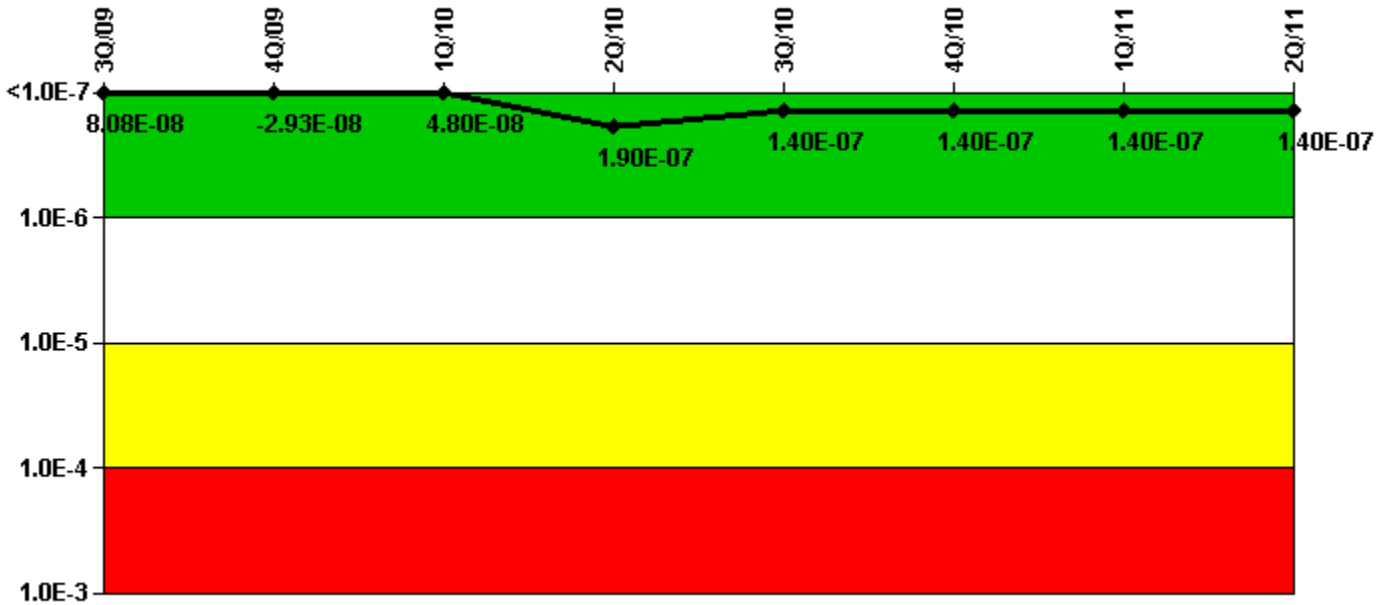


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	-1.80E-10	-2.60E-10	-2.53E-10	6.93E-10	6.21E-10	6.21E-10	6.19E-10	5.74E-10
URI (Δ CDF)	8.10E-08	-2.90E-08	4.82E-08	1.90E-07	1.35E-07	1.35E-07	1.35E-07	1.35E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.08E-08	-2.93E-08	4.80E-08	1.90E-07	1.40E-07	1.40E-07	1.40E-07	1.40E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

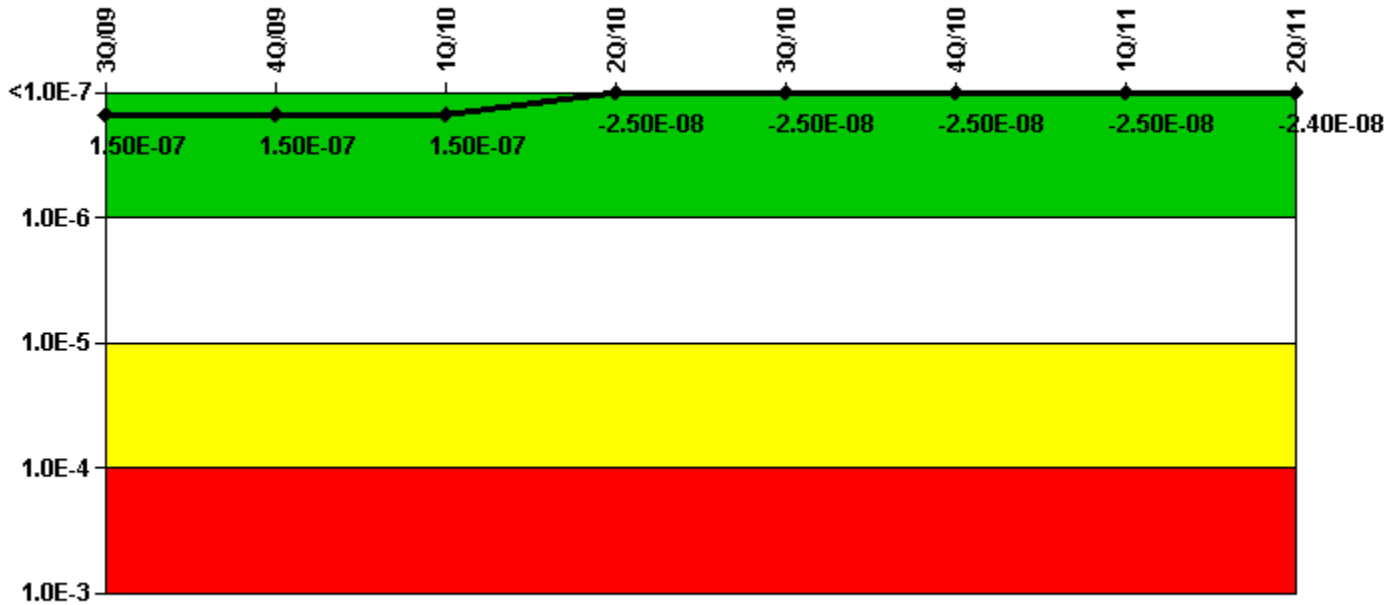


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	-1.20E-11	-1.10E-11	-1.07E-11	-2.67E-11	-2.67E-11	-2.67E-11	-2.67E-11	-3.65E-12
URI (Δ CDF)	1.50E-07	1.50E-07	1.48E-07	-2.51E-08	-2.51E-08	-2.51E-08	-2.51E-08	-2.41E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.50E-07	1.50E-07	1.50E-07	-2.50E-08	-2.50E-08	-2.50E-08	-2.50E-08	-2.40E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

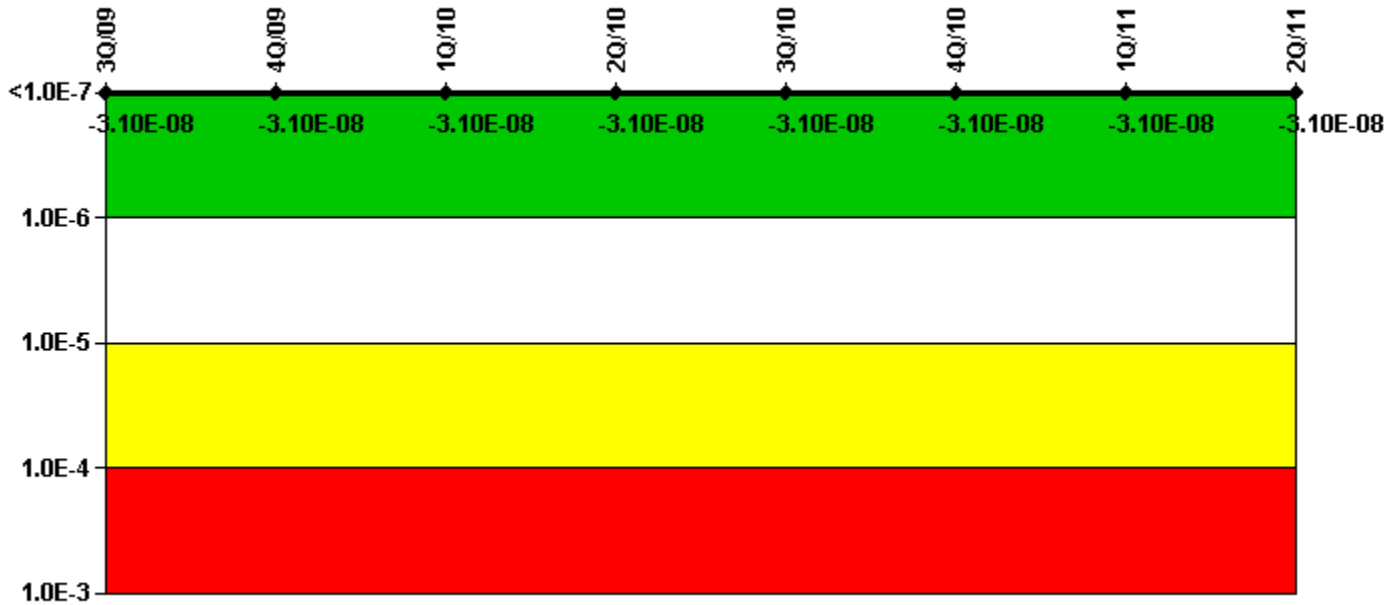


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	-2.90E-11	-2.90E-11	-2.86E-11	-2.86E-11	-2.86E-11	-2.86E-11	-2.86E-11	-2.15E-11
URI (Δ CDF)	-3.10E-08	-3.10E-08	-3.06E-08	-3.06E-08	-3.06E-08	-3.06E-08	-3.06E-08	-3.06E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

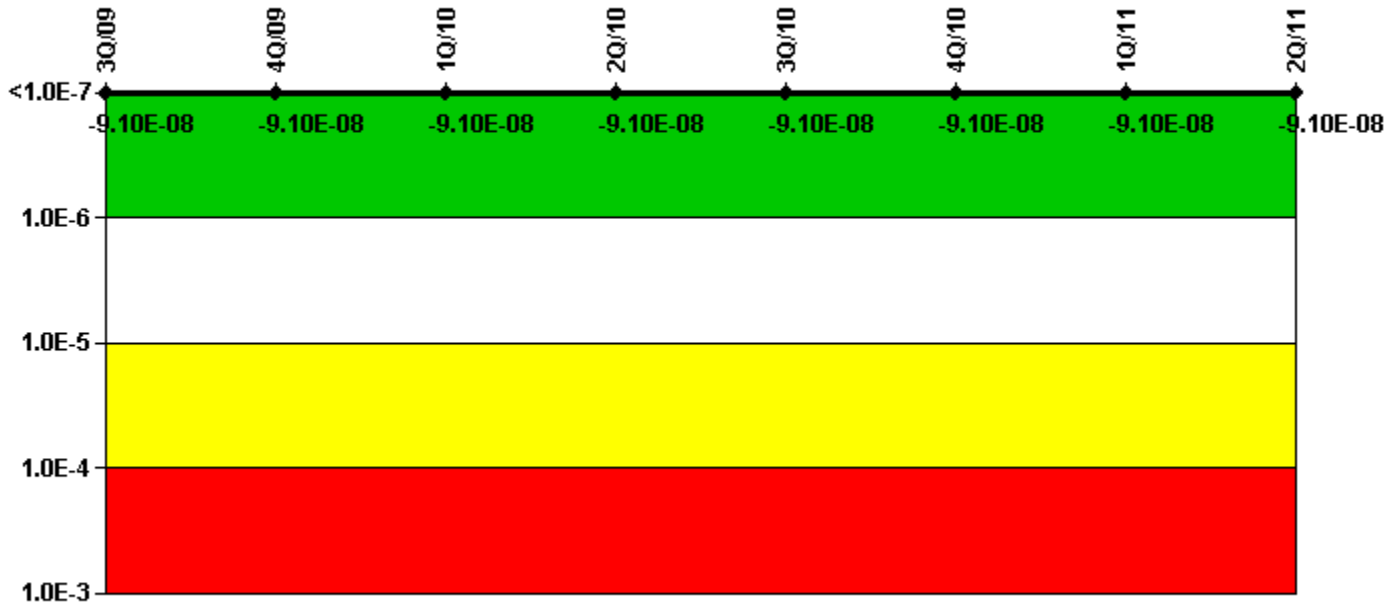


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	-3.20E-13	-3.20E-13	-2.12E-13	-2.00E-13	-3.23E-13	-3.23E-13	-3.23E-13	-3.23E-13
URI (Δ CDF)	-9.10E-08	-9.10E-08	-9.13E-08	-9.13E-08	-9.13E-08	-9.13E-08	-9.13E-08	-9.13E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.10E-08	-9.10E-08	-9.10E-08	-9.10E-08	-9.10E-08	-9.10E-08	-9.10E-08	-9.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

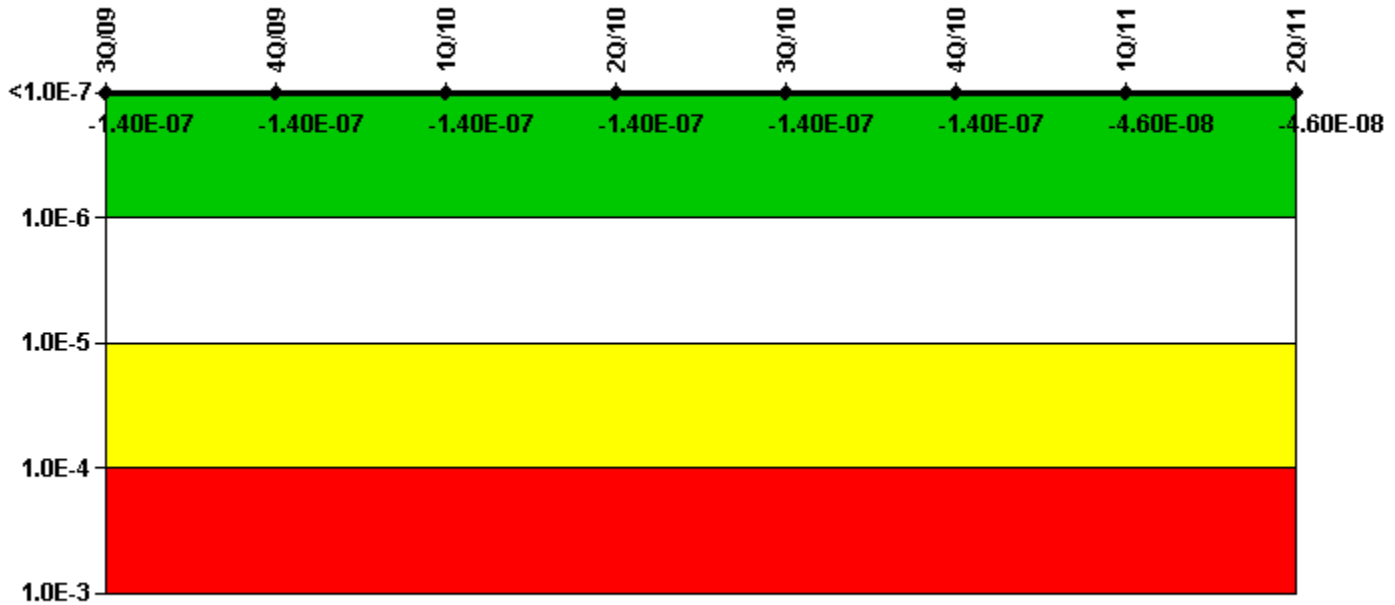


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
UAI (Δ CDF)	3.00E-11	3.30E-11	2.20E-11	2.27E-11	-3.23E-12	-3.23E-12	3.95E-11	6.25E-11
URI (Δ CDF)	-1.40E-07	-1.40E-07	-1.42E-07	-1.42E-07	-1.42E-07	-1.42E-07	-4.58E-08	-4.58E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.40E-07	-1.40E-07	-1.40E-07	-1.40E-07	-1.40E-07	-1.40E-07	-4.60E-08	-4.60E-08

Licensee Comments: none

Reactor Coolant System Activity

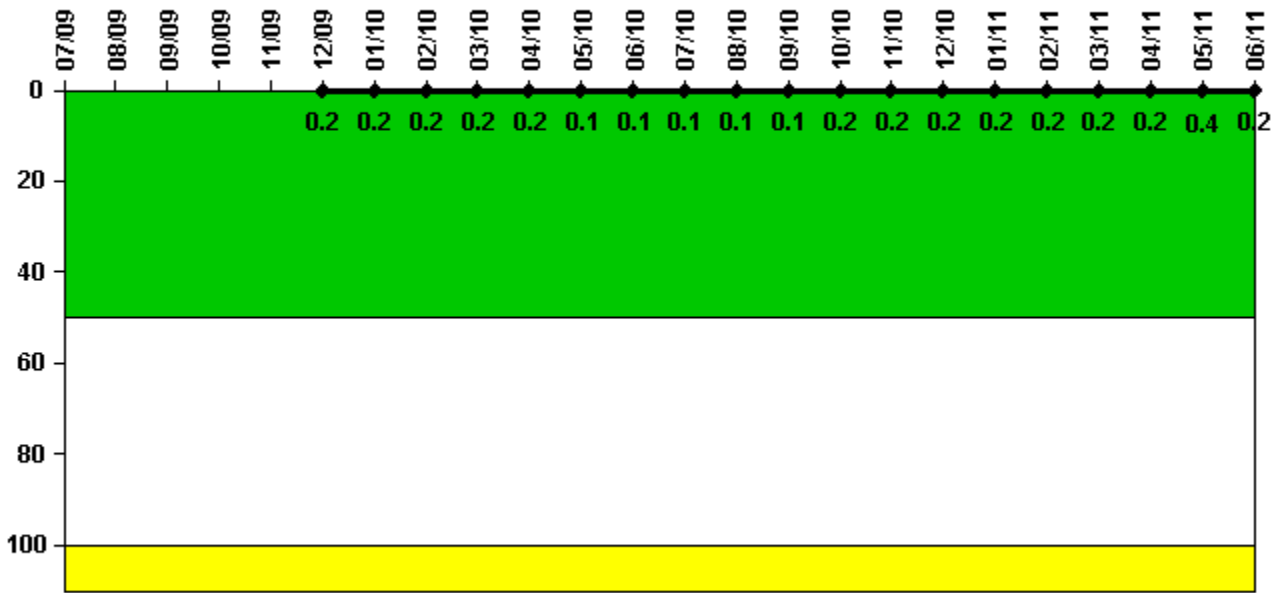

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity		7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum activity		N/A	N/A	N/A	N/A	N/A	0.002080	0.001980	0.002060	0.001630	0.001590	0.001170	0.001240
Technical specification limit		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value		N/A	N/A	N/A	N/A	N/A	0.2	0.2	0.2	0.2	0.2	0.1	0.1

Reactor Coolant System Activity		7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity		0.001330	0.001360	0.001420	0.001580	0.001560	0.001610	0.001680	0.001750	0.001760	0.002300	0.003800	0.002470
Technical specification limit		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value		0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.4	0.2

Licensee Comments: none

Reactor Coolant System Leakage

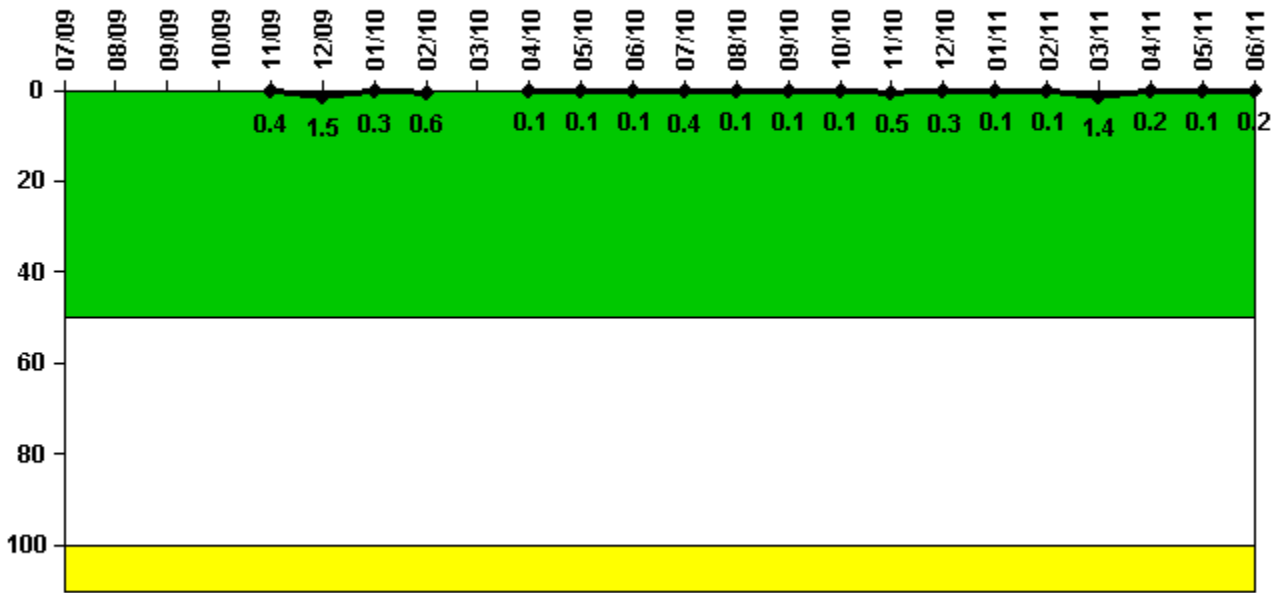


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/09	8/09	9/09	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10
Maximum leakage	N/A	N/A	N/A	N/A	0.041	0.166	0.029	0.068	N/A	0.012	0.014	0.016
Technical specification limit	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8
Indicator value	N/A	N/A	N/A	N/A	0.4	1.5	0.3	0.6	N/A	0.1	0.1	0.1
Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	0.047	0.006	0.009	0.013	0.057	0.028	0.011	0.015	0.150	0.026	0.015	0.024
Technical specification limit	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8	10.8
Indicator value	0.4	0.1	0.1	0.1	0.5	0.3	0.1	0.1	1.4	0.2	0.1	0.2

Licensee Comments: none

Drill/Exercise Performance

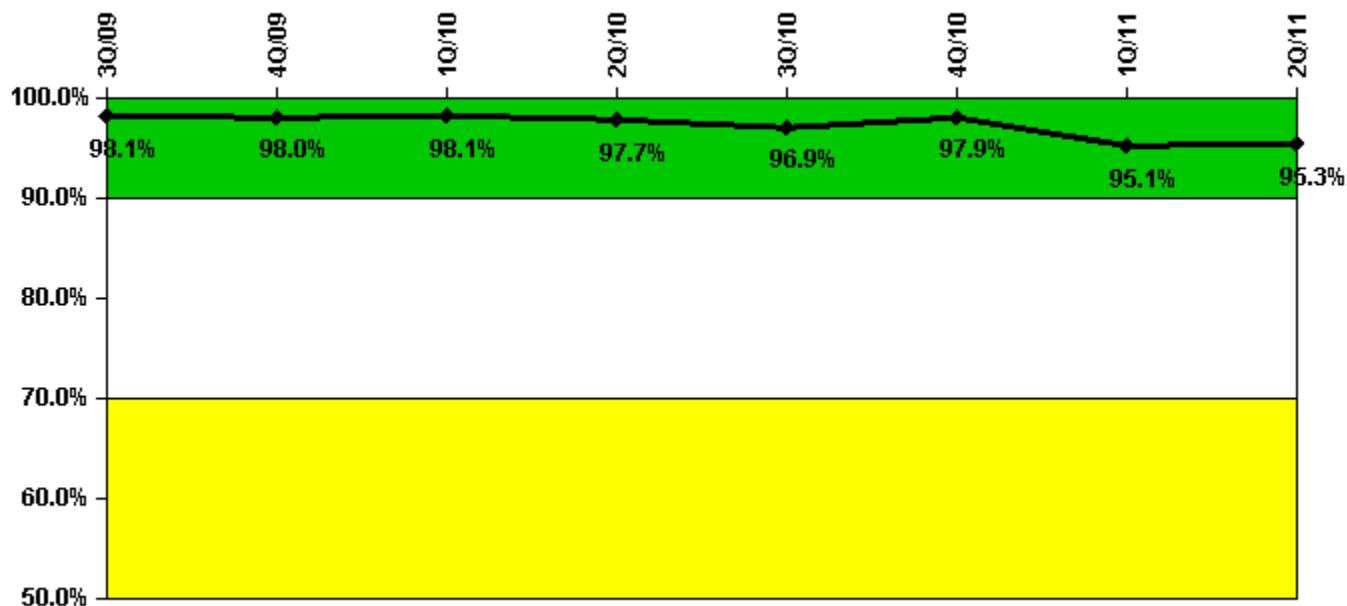

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Successful opportunities	82.0	16.0	12.0	26.0	29.0	19.0	43.0	16.0
Total opportunities	85.0	16.0	12.0	28.0	29.0	19.0	50.0	16.0
Indicator value	98.1%	98.0%	98.1%	97.7%	96.9%	97.9%	95.1%	95.3%

Licensee Comments:

1Q/11: Previously submitted data for February 2011 was revised to correct an error in grading drill results. Data was changed from "19 of 21 successful" to "18 of 21 successful". This changes the first quarter 2011 total from "44 of 50 successful" to "43 of 50 successful". This change has no impact on performance indicator color.

ERO Drill Participation

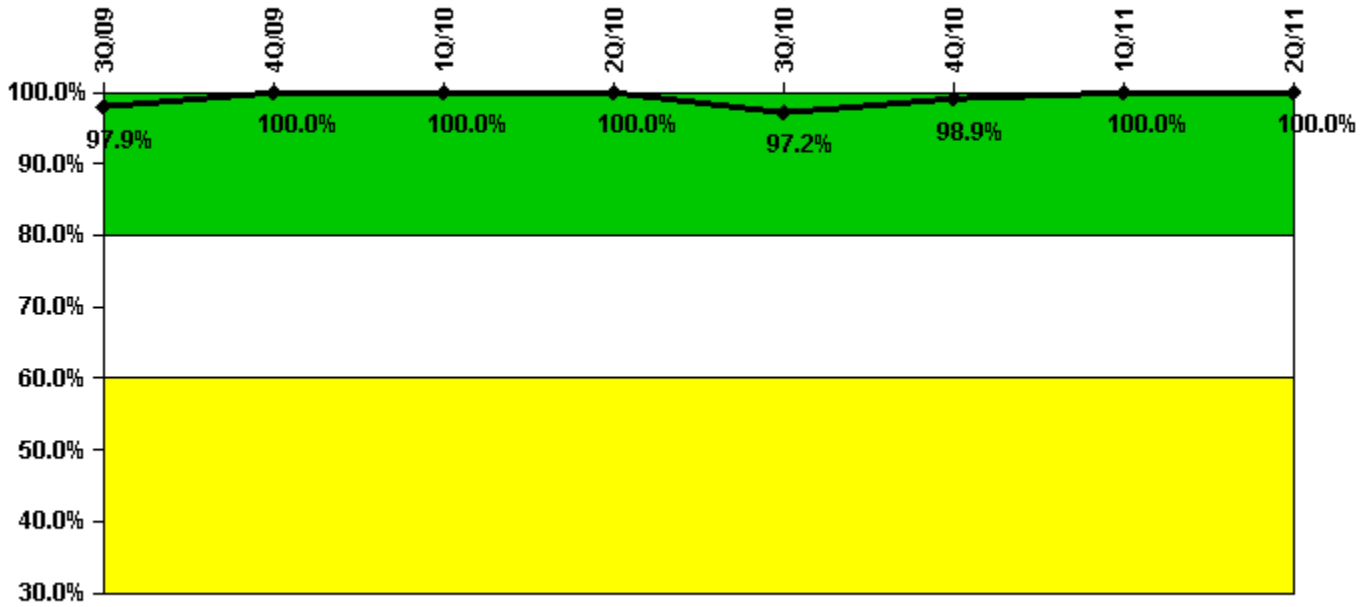


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Participating Key personnel	140.0	144.0	95.0	96.0	103.0	94.0	92.0	92.0
Total Key personnel	143.0	144.0	95.0	96.0	106.0	95.0	92.0	92.0
Indicator value	97.9%	100.0%	100.0%	100.0%	97.2%	98.9%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

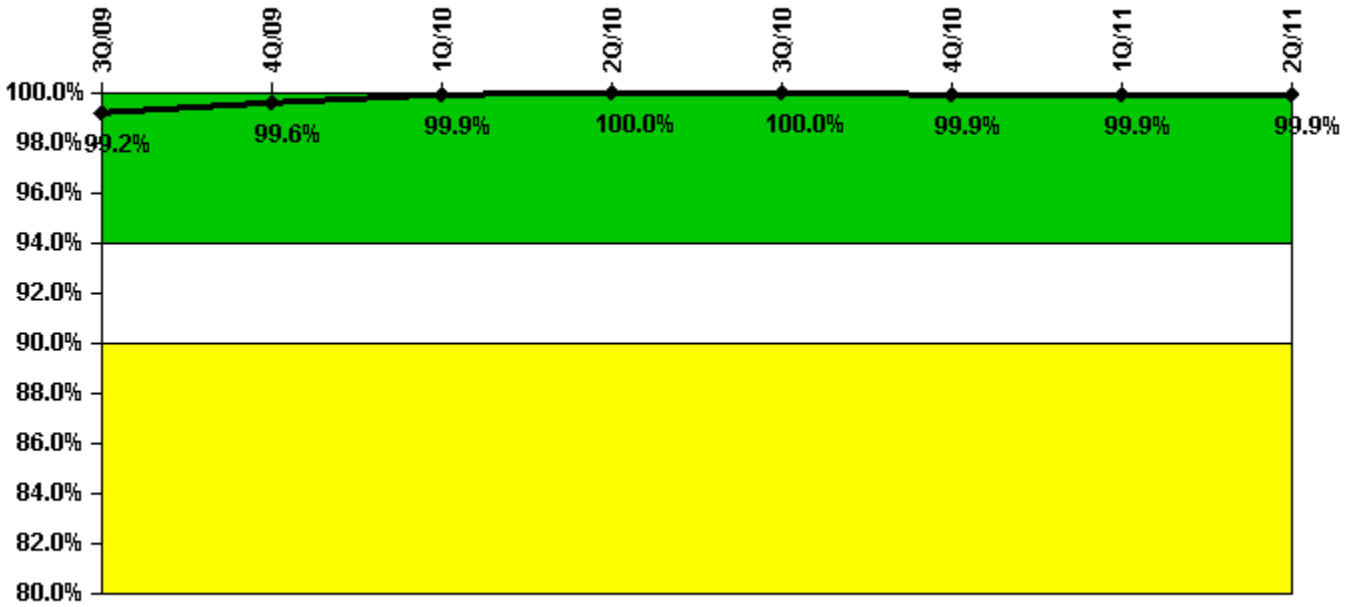

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
Successful siren-tests	1190	1115	1119	1119	1118	1118	1119	1117
Total sirens-tests	1190	1116	1119	1119	1119	1120	1120	1119
Indicator value	99.2%	99.6%	99.9%	100.0%	100.0%	99.9%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/09	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.