


D.C. Cook 2

3Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

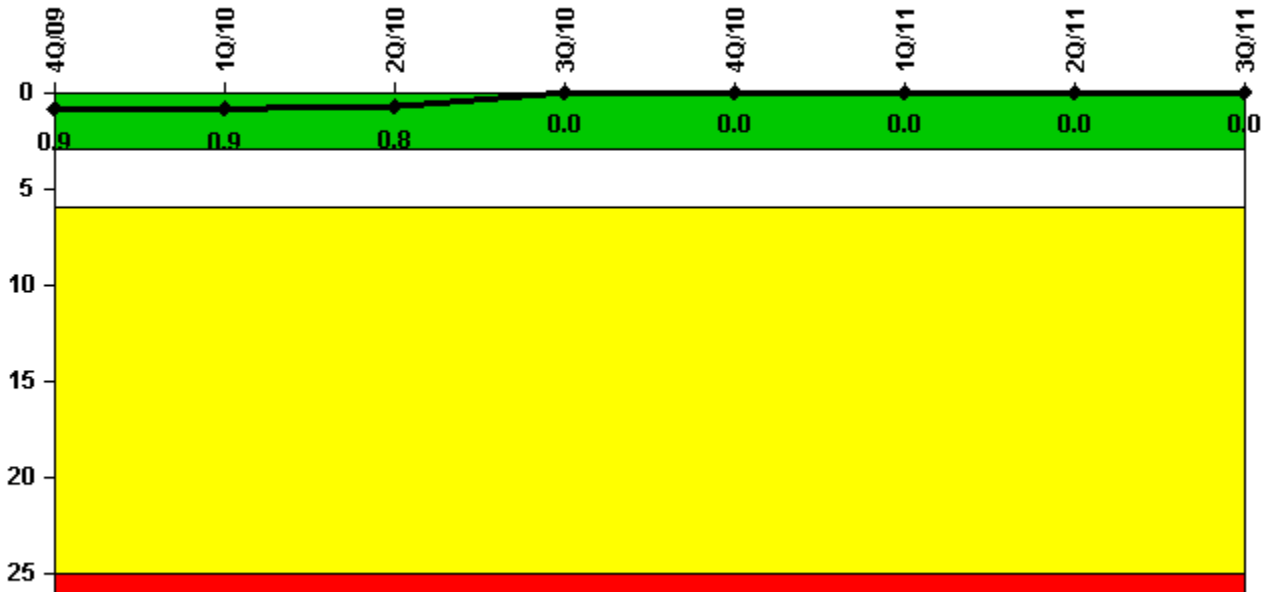


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2209.0	2159.0	2184.0	2208.0	767.4	2159.0	2184.0	2208.0
Indicator value	0.9	0.9	0.8	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

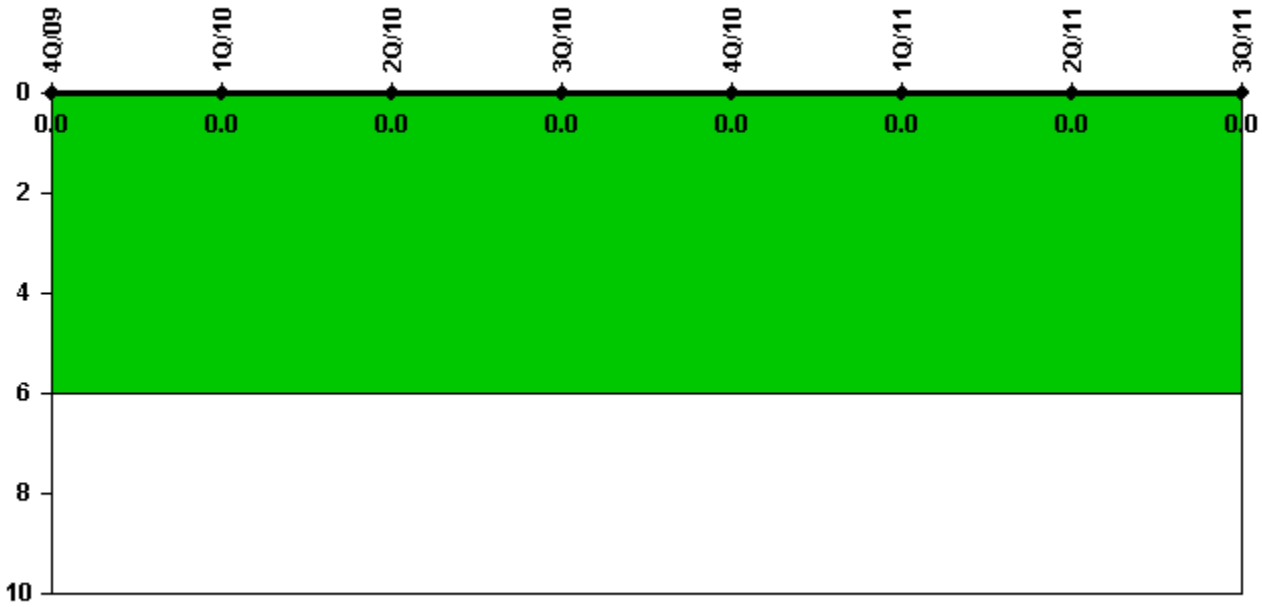


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2209.0	2159.0	2184.0	2208.0	767.4	2159.0	2184.0	2208.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

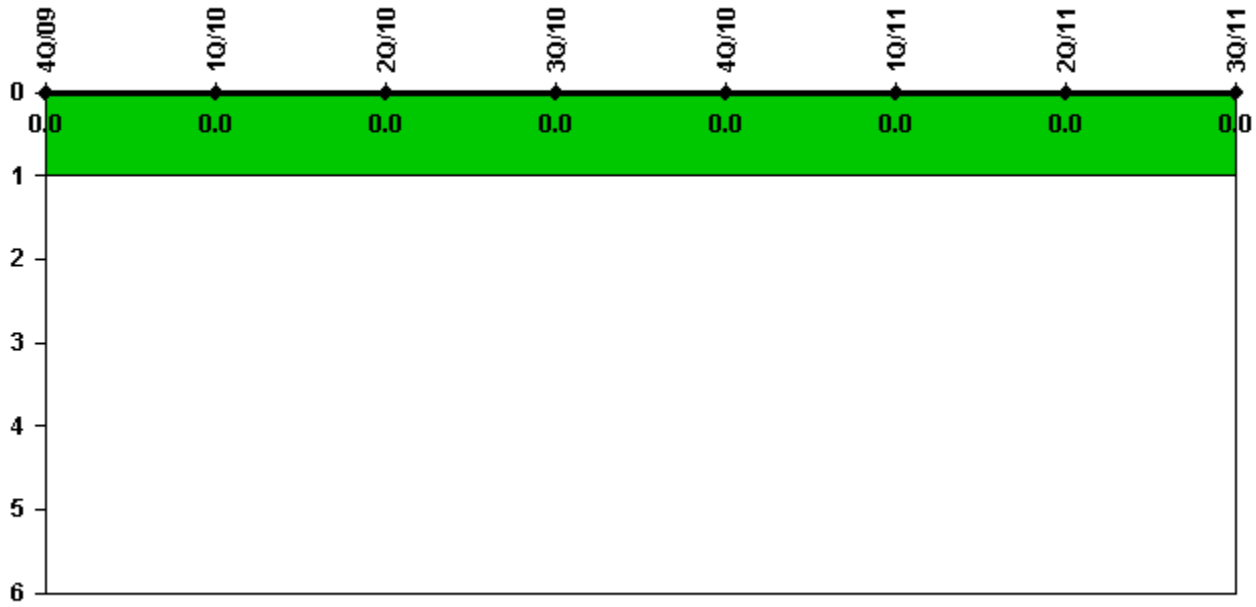


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

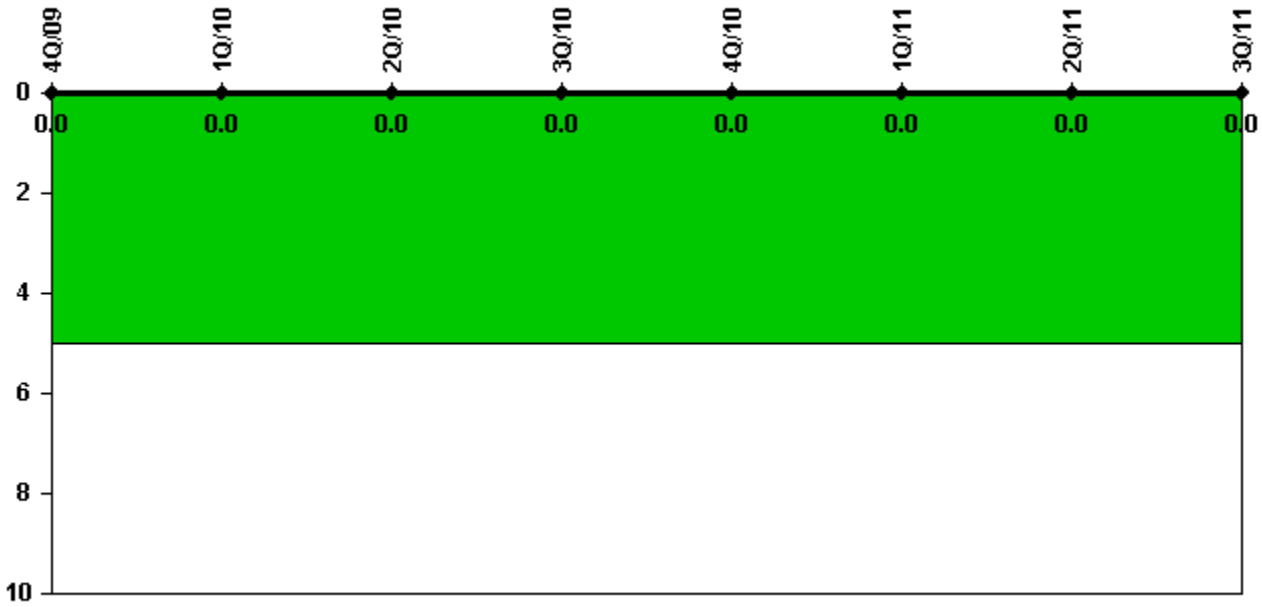


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

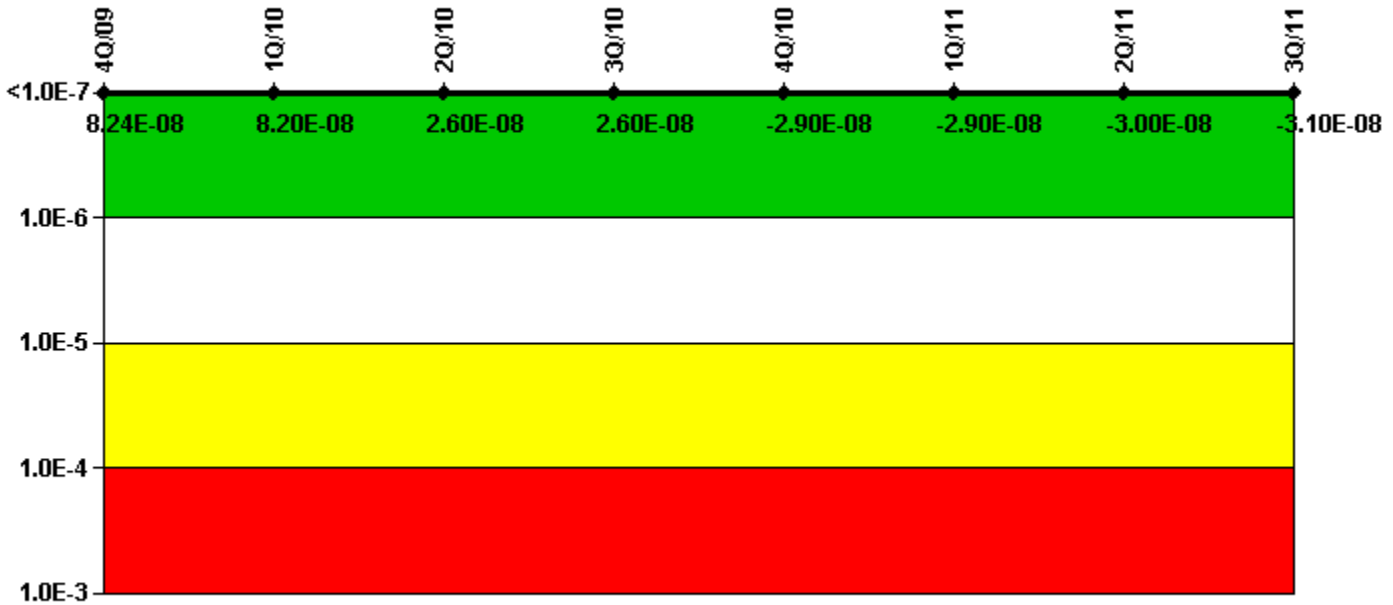


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	3.70E-10	3.49E-10	2.06E-10	5.69E-10	5.80E-10	6.00E-10	3.07E-10	-2.13E-10
URI (Δ CDF)	8.20E-08	8.16E-08	2.58E-08	2.58E-08	-2.99E-08	-2.99E-08	-2.99E-08	-3.11E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.24E-08	8.20E-08	2.60E-08	2.60E-08	-2.90E-08	-2.90E-08	-3.00E-08	-3.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

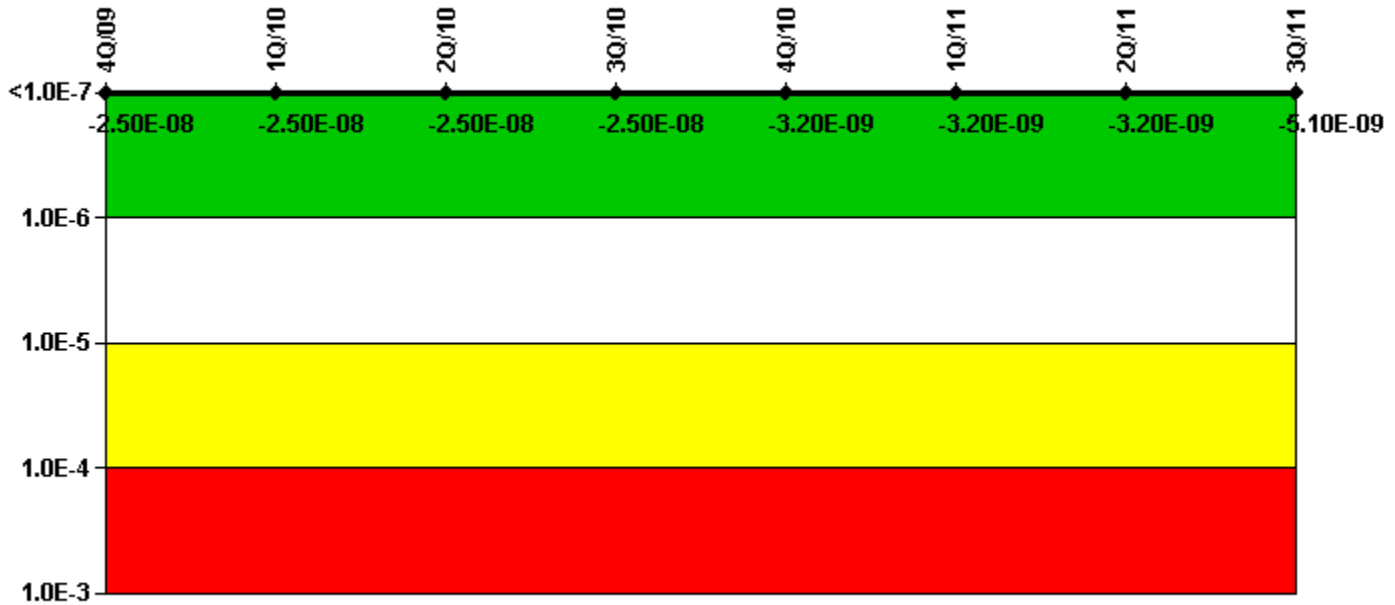


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-2.70E-11	-2.66E-11	-2.66E-11	-2.66E-11	-2.66E-11	-2.66E-11	-2.66E-11	-2.66E-11
URI (Δ CDF)	-2.50E-08	-2.49E-08	-2.49E-08	-2.49E-08	-3.19E-09	-3.19E-09	-3.19E-09	-5.04E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-08	-2.50E-08	-2.50E-08	-2.50E-08	-3.20E-09	-3.20E-09	-3.20E-09	-5.10E-09

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

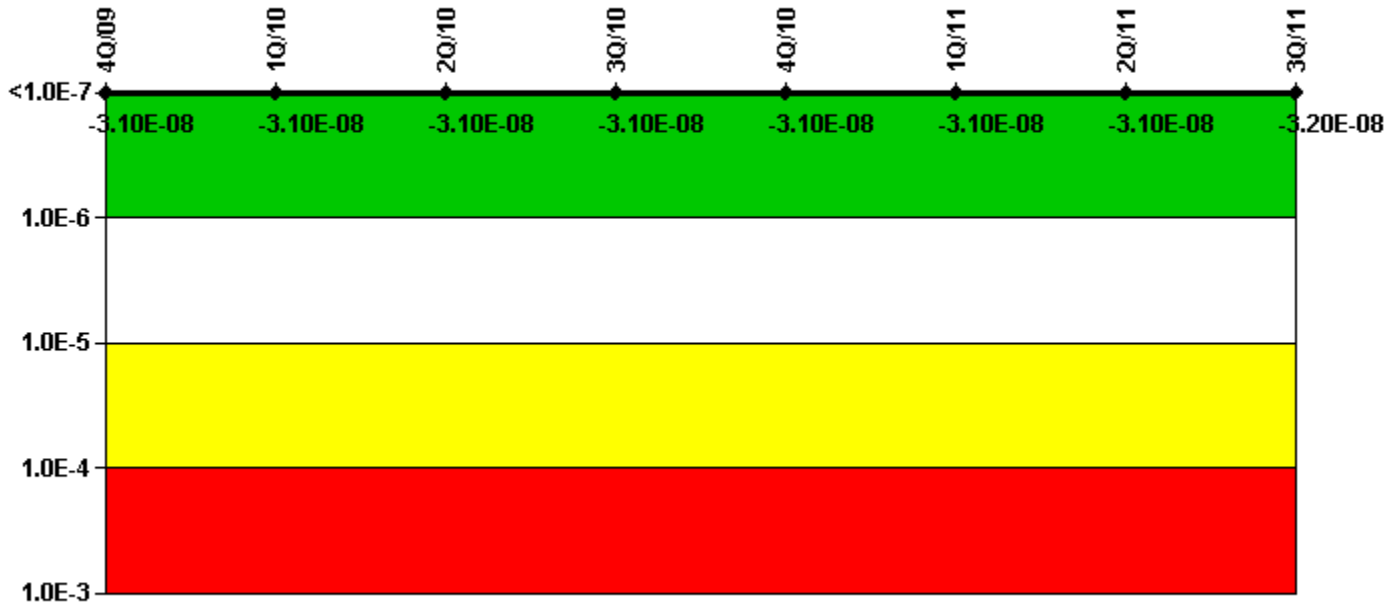


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-2.90E-11	-2.85E-11	-2.85E-11	-2.85E-11	-2.85E-11	-2.85E-11	-2.85E-11	-2.85E-11
URI (Δ CDF)	-3.10E-08	-3.05E-08	-3.05E-08	-3.05E-08	-3.12E-08	-3.12E-08	-3.12E-08	-3.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.10E-08	-3.20E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

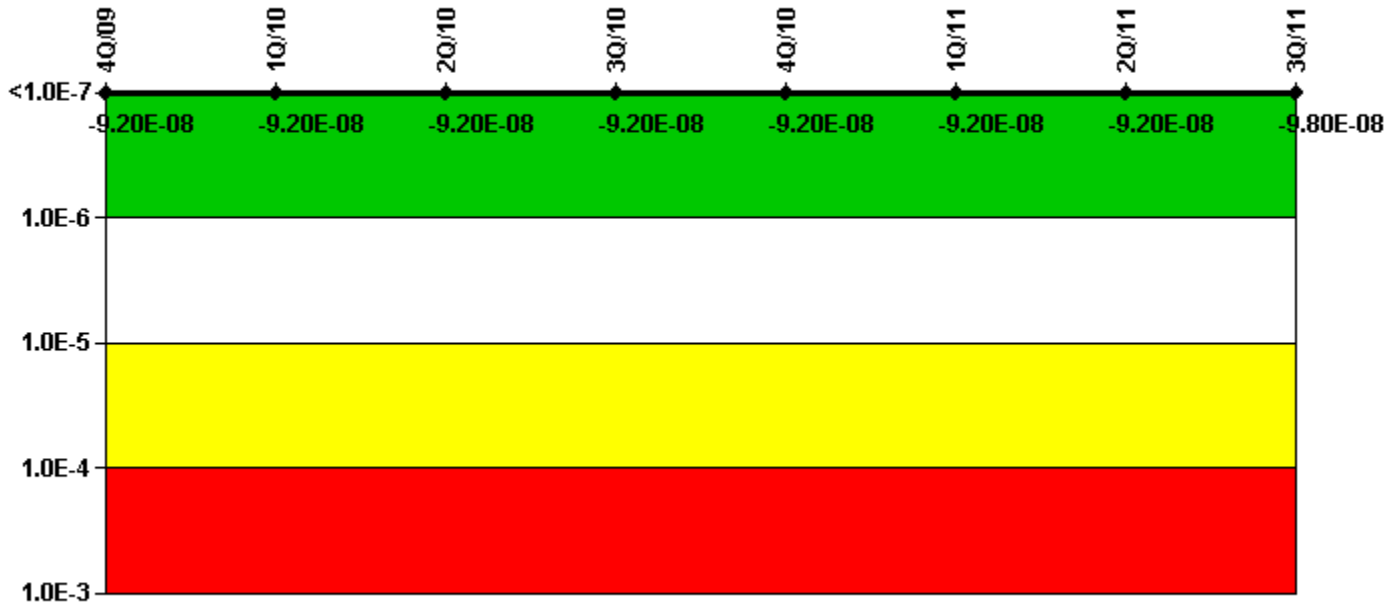


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-3.20E-13	-3.23E-13	-3.23E-13	-3.23E-13	-3.23E-13	-3.23E-13	-3.23E-13	-3.23E-13
URI (Δ CDF)	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.83E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

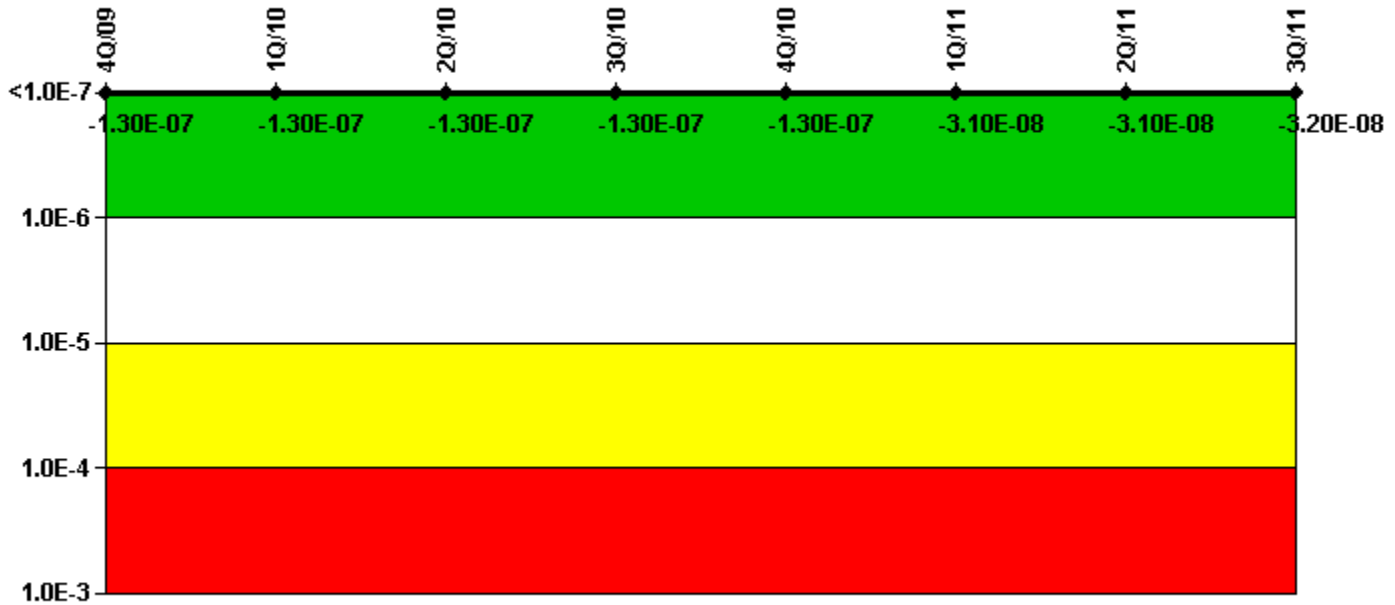


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-3.50E-11	-2.20E-12	-6.80E-12	-3.53E-11	-3.31E-11	8.50E-12	8.50E-12	2.08E-12
URI (Δ CDF)	-1.30E-07	-1.27E-07	-1.27E-07	-1.27E-07	-1.27E-07	-3.06E-08	-3.07E-08	-3.19E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-3.10E-08	-3.10E-08	-3.20E-08

Licensee Comments: none

Reactor Coolant System Activity

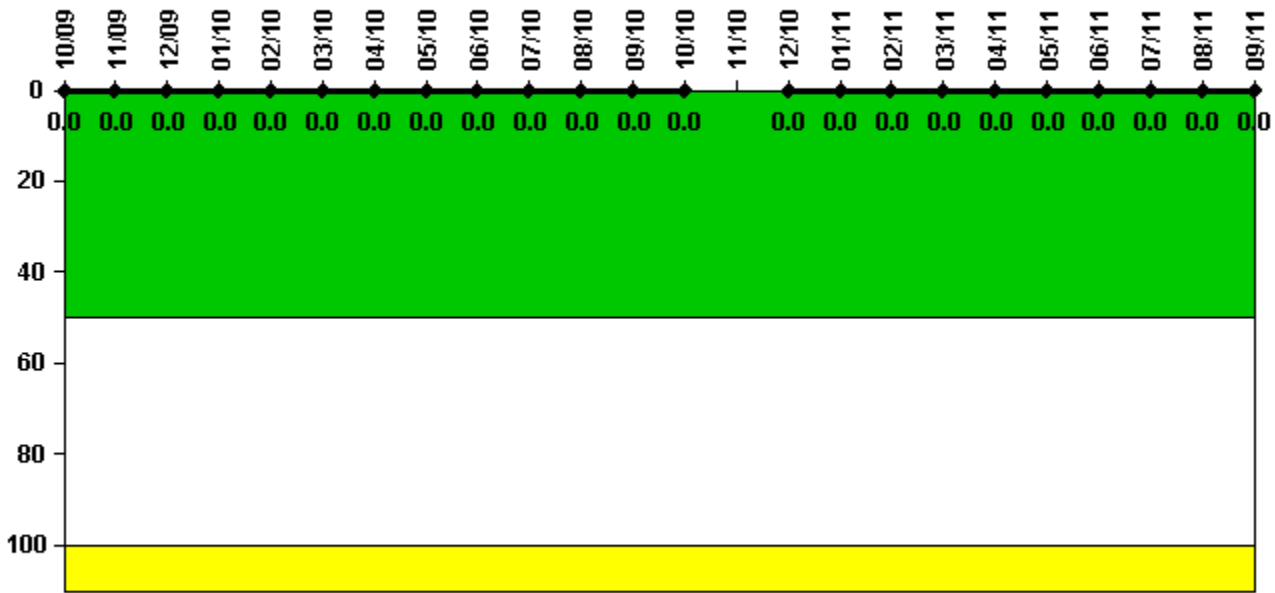


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum activity	0.000139	0.000143	0.000148	0.000151	0.000164	0.000162	0.000163	0.000180	0.000171	0.000178	0.000178	0.000205
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum activity	0.000350	N/A	0.000168	0.000094	0.000098	0.000100	0.000146	0.000152	0.000167	0.000163	0.000167	0.000170
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	N/A	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

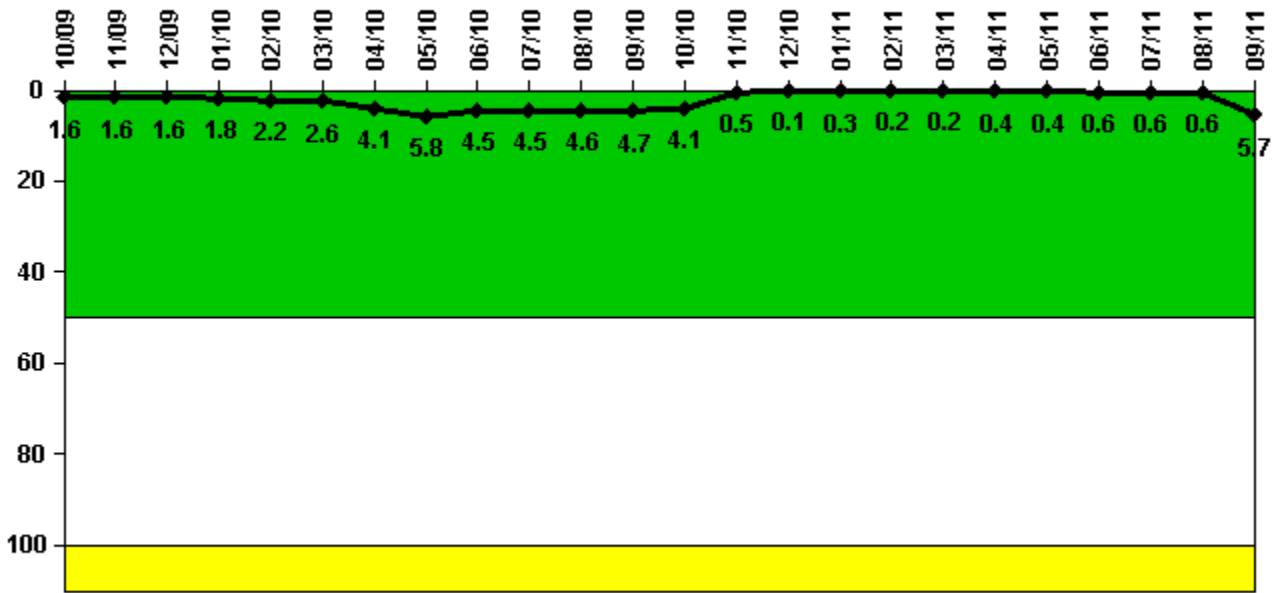

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum leakage	0.171	0.176	0.181	0.201	0.243	0.291	0.447	0.636	0.500	0.497	0.502	0.515
Technical specification limit	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0
Indicator value	1.6	1.6	1.6	1.8	2.2	2.6	4.1	5.8	4.5	4.5	4.6	4.7
Reactor Coolant System Leakage	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum leakage	0.448	0.050	0.016	0.038	0.027	0.025	0.041	0.048	0.061	0.062	0.068	0.622
Technical specification limit	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0
Indicator value	4.1	0.5	0.1	0.3	0.2	0.2	0.4	0.4	0.6	0.6	0.6	5.7

Licensee Comments:

9/11: Elevated (0.6 gpm) RCS leak rate in September due to apparent packing leak occurring during pressurizer PORV block valve stroke test on September 22; leak was isolated the following day.

Drill/Exercise Performance

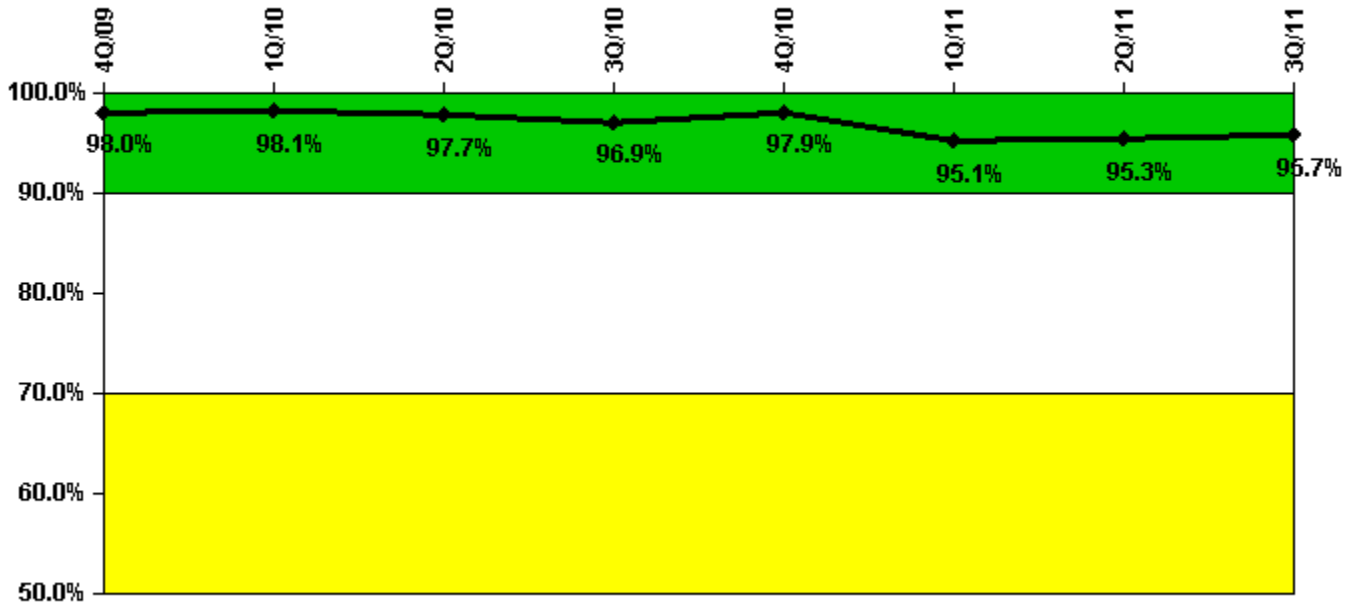


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Successful opportunities	16.0	12.0	26.0	29.0	19.0	43.0	16.0	41.0
Total opportunities	16.0	12.0	28.0	29.0	19.0	50.0	16.0	41.0
Indicator value	98.0%	98.1%	97.7%	96.9%	97.9%	95.1%	95.3%	95.7%

Licensee Comments: none

ERO Drill Participation

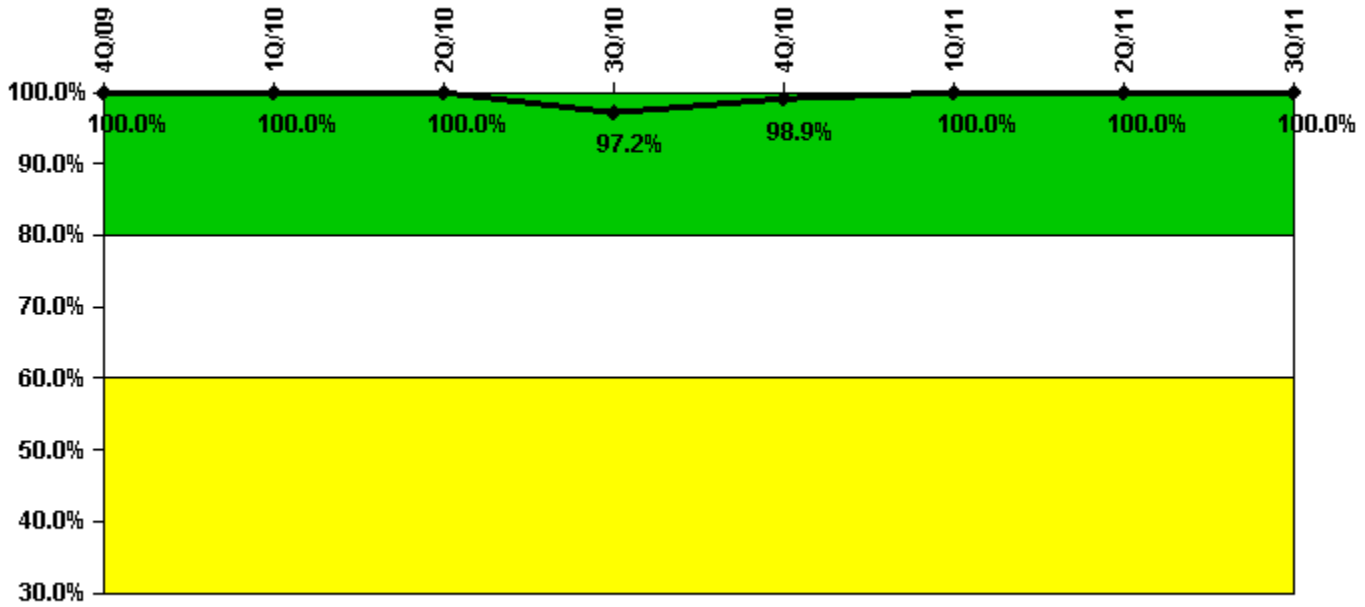


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Participating Key personnel	144.0	95.0	96.0	103.0	94.0	92.0	92.0	91.0
Total Key personnel	144.0	95.0	96.0	106.0	95.0	92.0	92.0	91.0
Indicator value	100.0%	100.0%	100.0%	97.2%	98.9%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

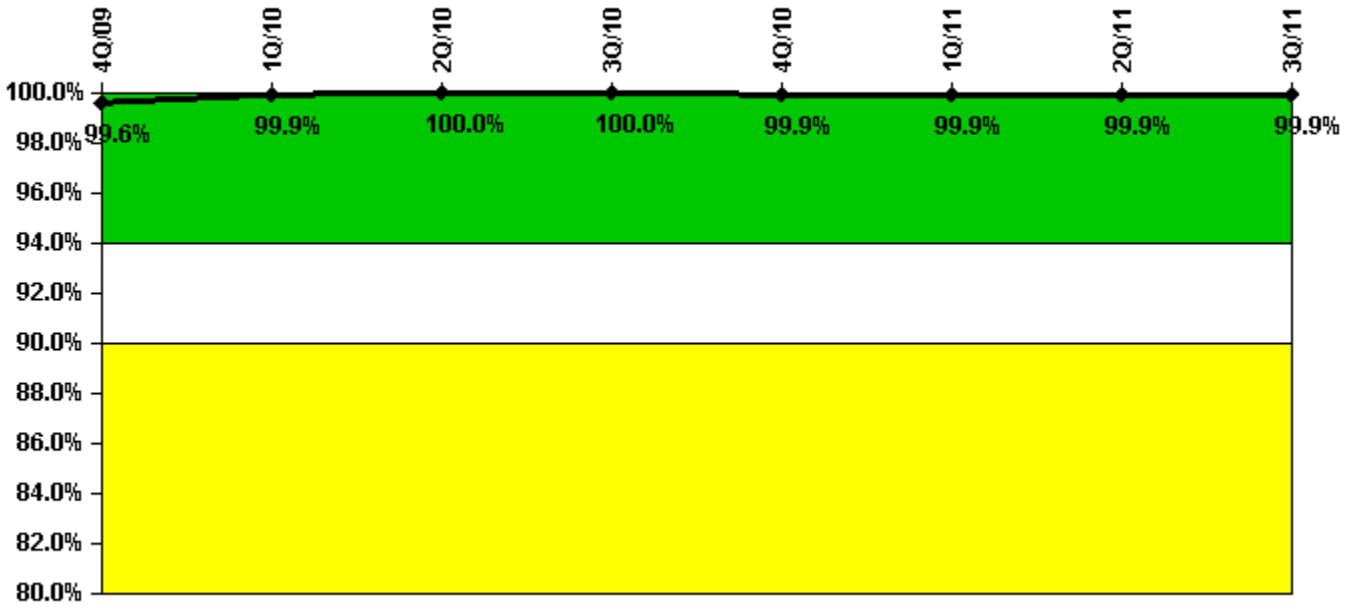


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Successful siren-tests	1115	1119	1119	1118	1118	1119	1117	1120
Total sirens-tests	1116	1119	1119	1119	1120	1120	1119	1120
Indicator value	99.6%	99.9%	100.0%	100.0%	99.9%	99.9%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

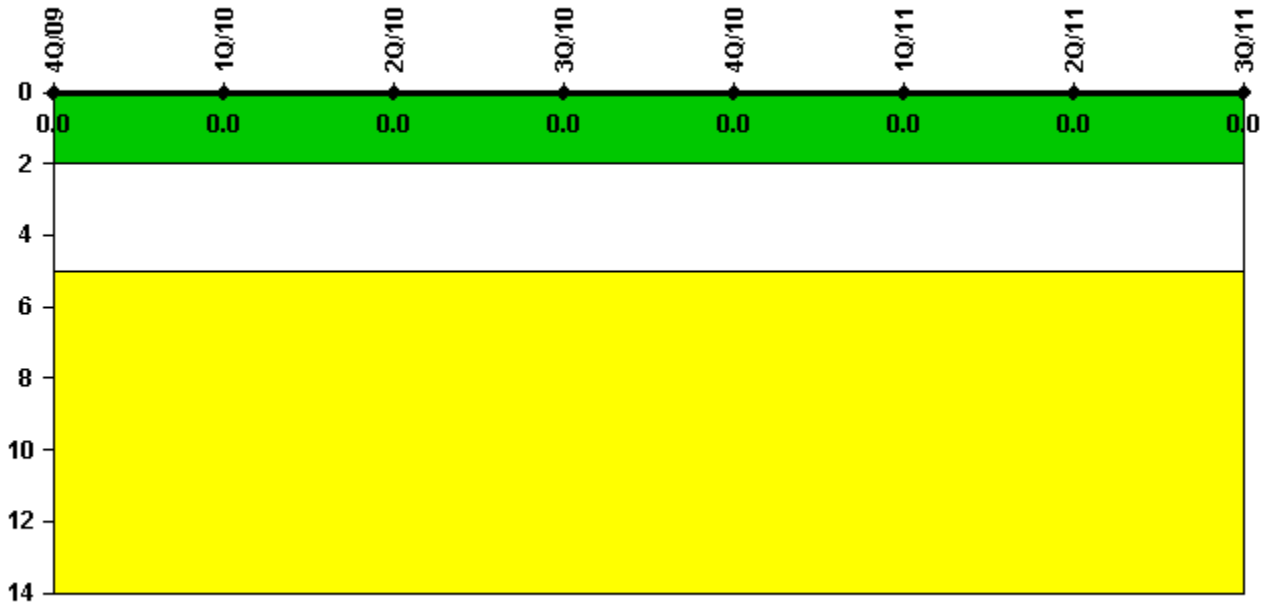


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

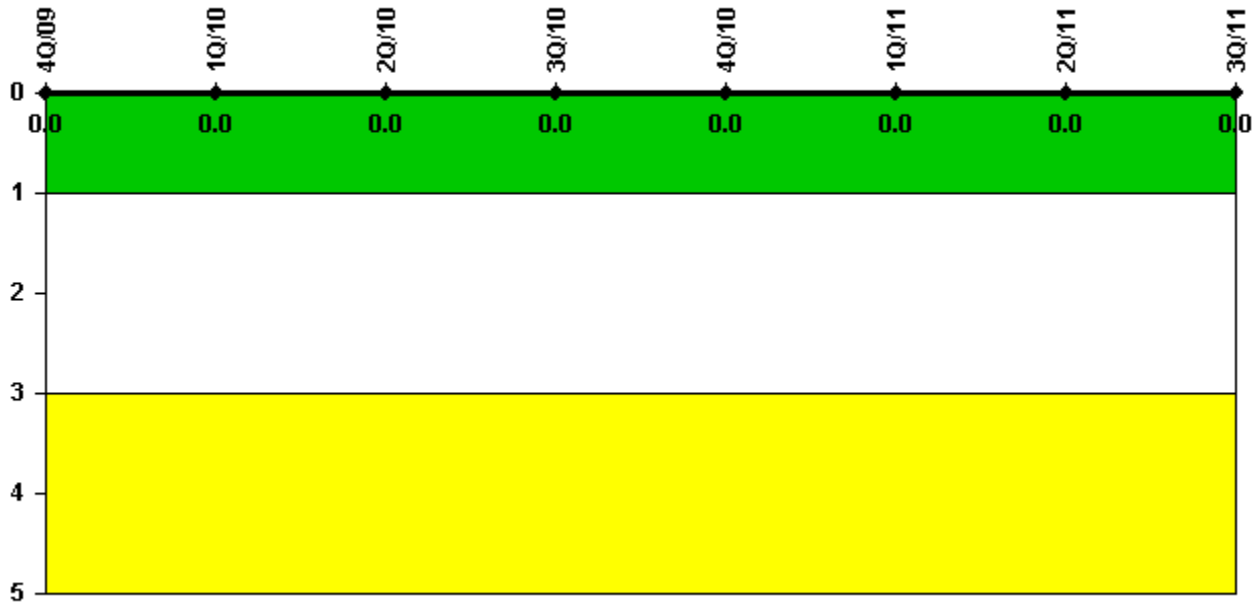

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.