


Fort Calhoun

3Q/2011 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

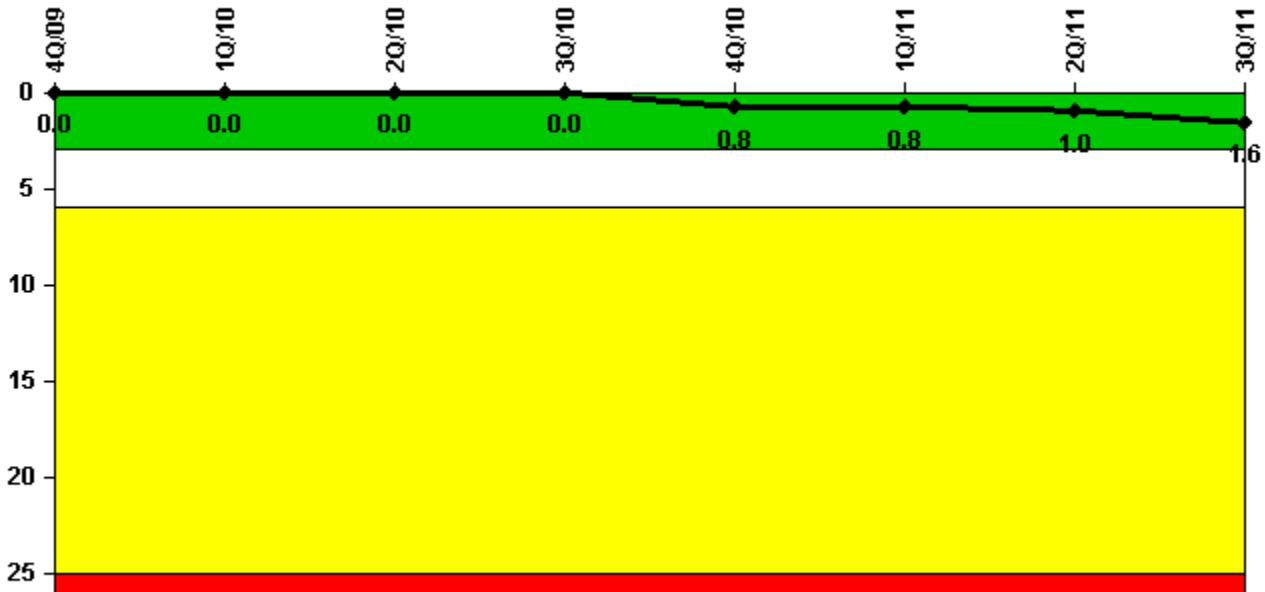


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	1071.8	2159.0	2105.6	2208.0	2160.0	2135.4	215.8	0
Indicator value	0	0	0	0	0.8	0.8	1.0	1.6

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

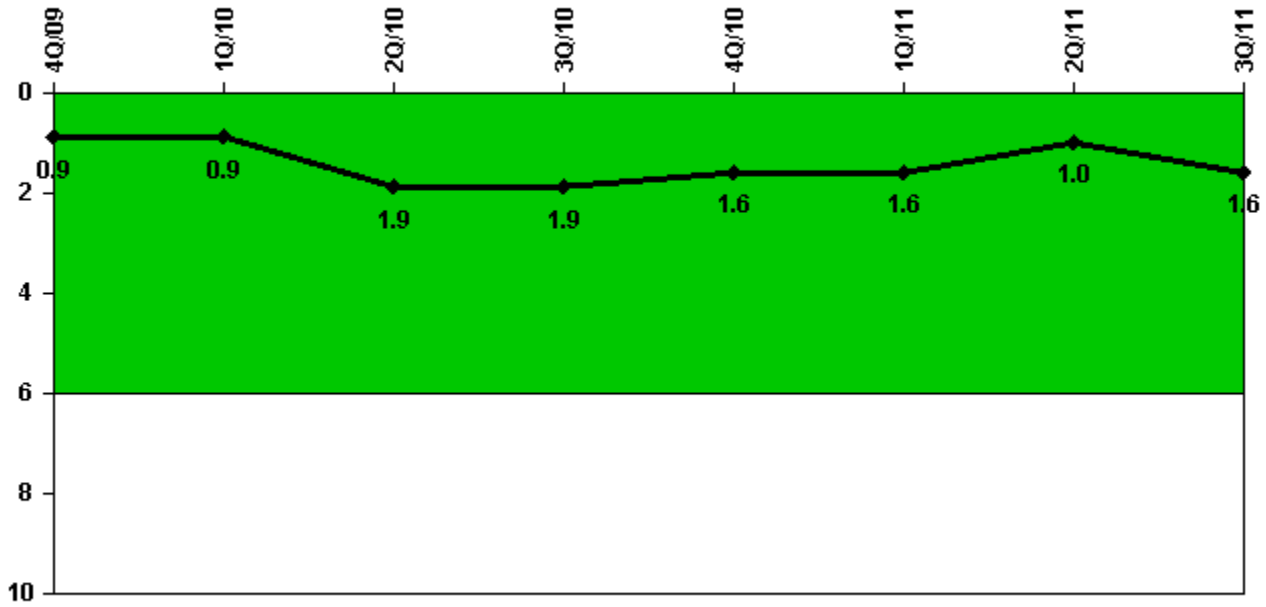

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Unplanned power changes	1.0	0	1.0	0	1.0	0	0	0
Critical hours	1071.8	2159.0	2105.6	2208.0	2160.0	2135.4	215.8	0
Indicator value	0.9	0.9	1.9	1.9	1.6	1.6	1.0	1.6

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

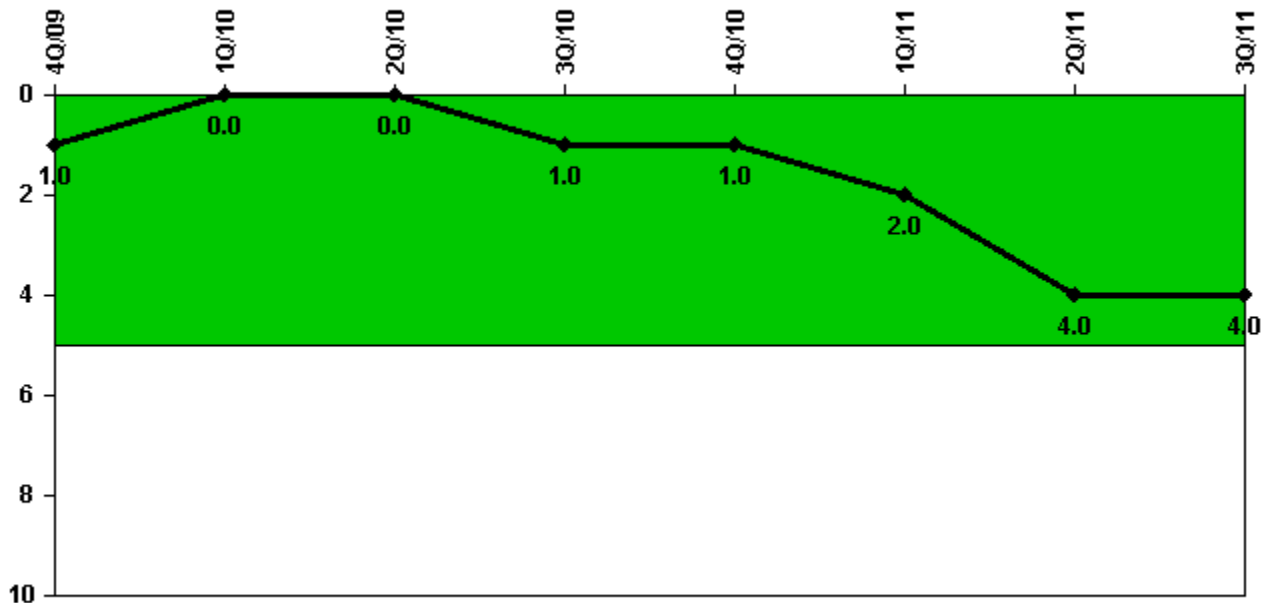

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Safety System Functional Failures	0	0	0	1	0	1	2	1
Indicator value	1	0	0	1	1	2	4	4

Licensee Comments:

3Q/11: The following information is being provided to correct an oversight in the original submittals. LER 2011-003, "Inadequate Flooding Protection Due To Ineffective Oversight," effective first quarter 2011. LER 2011-004, "Isolation of Both Trains of Safety Related Auxiliary Feedwater," effective second quarter 2011. LER 2011-006, "Inoperability of Both Trains of Containment Coolers Due to a Mispositioned Valve," effective second quarter 2011. LER 2011-008, "Fire in Safety Related 480 Volt Electrical Bus" effective third quarter 2011.

Mitigating Systems Performance Index, Emergency AC Power System

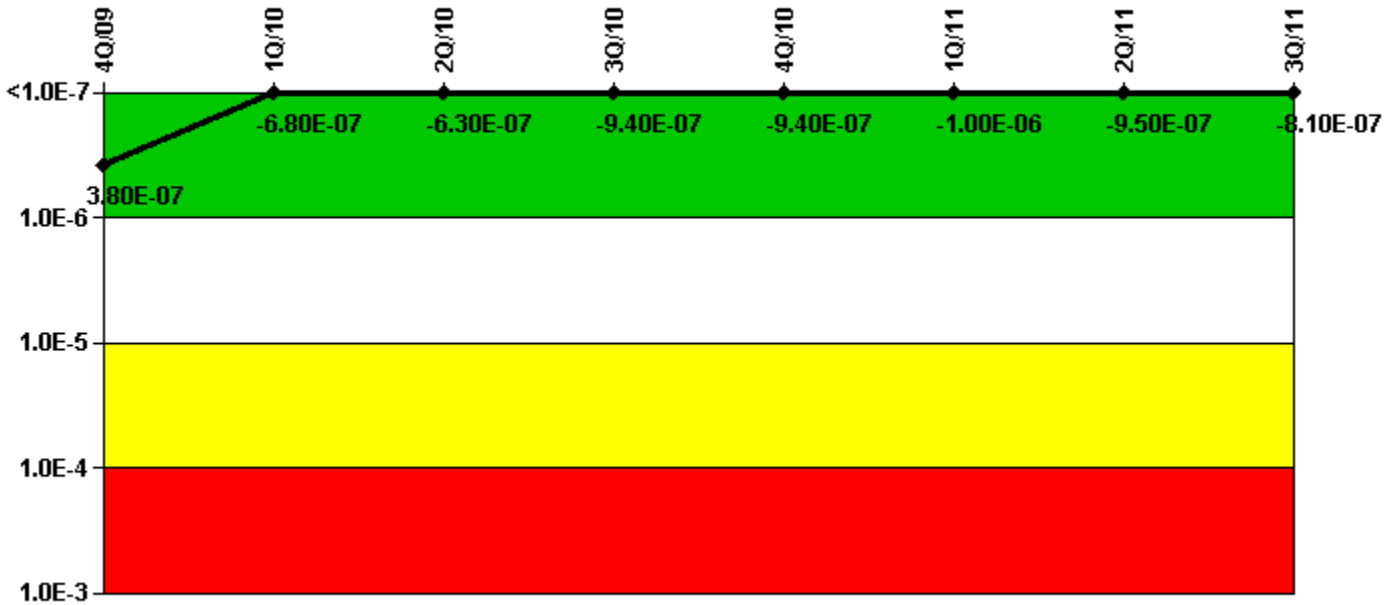


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	4.90E-07	3.69E-07	5.46E-07	1.93E-07	1.76E-07	1.89E-08	4.38E-08	1.14E-07
URI (Δ CDF)	-1.10E-07	-1.05E-06	-1.18E-06	-1.13E-06	-1.11E-06	-1.01E-06	-9.90E-07	-9.27E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.80E-07	-6.80E-07	-6.30E-07	-9.40E-07	-9.40E-07	-1.00E-06	-9.50E-07	-8.10E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

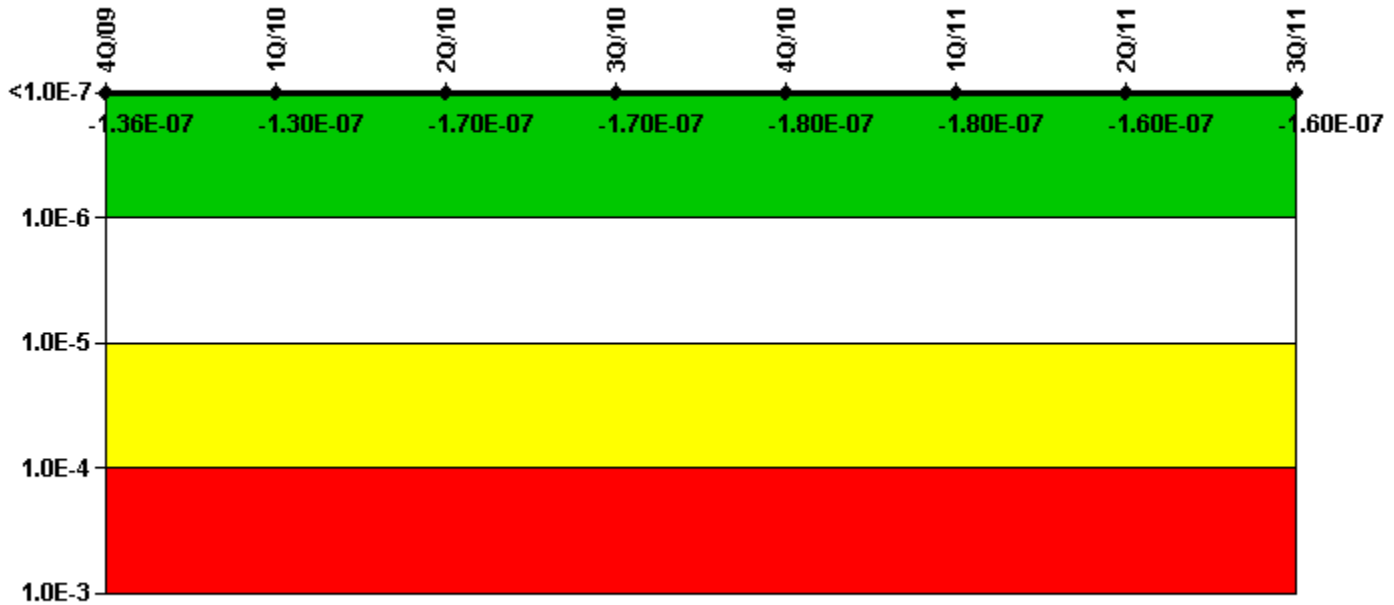


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-6.50E-08	-6.19E-08	-8.98E-08	-8.92E-08	-8.90E-08	-8.65E-08	-6.91E-08	-7.33E-08
URI (Δ CDF)	-7.10E-08	-7.23E-08	-8.21E-08	-8.46E-08	-9.21E-08	-9.22E-08	-9.10E-08	-9.02E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.36E-07	-1.30E-07	-1.70E-07	-1.70E-07	-1.80E-07	-1.80E-07	-1.60E-07	-1.60E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

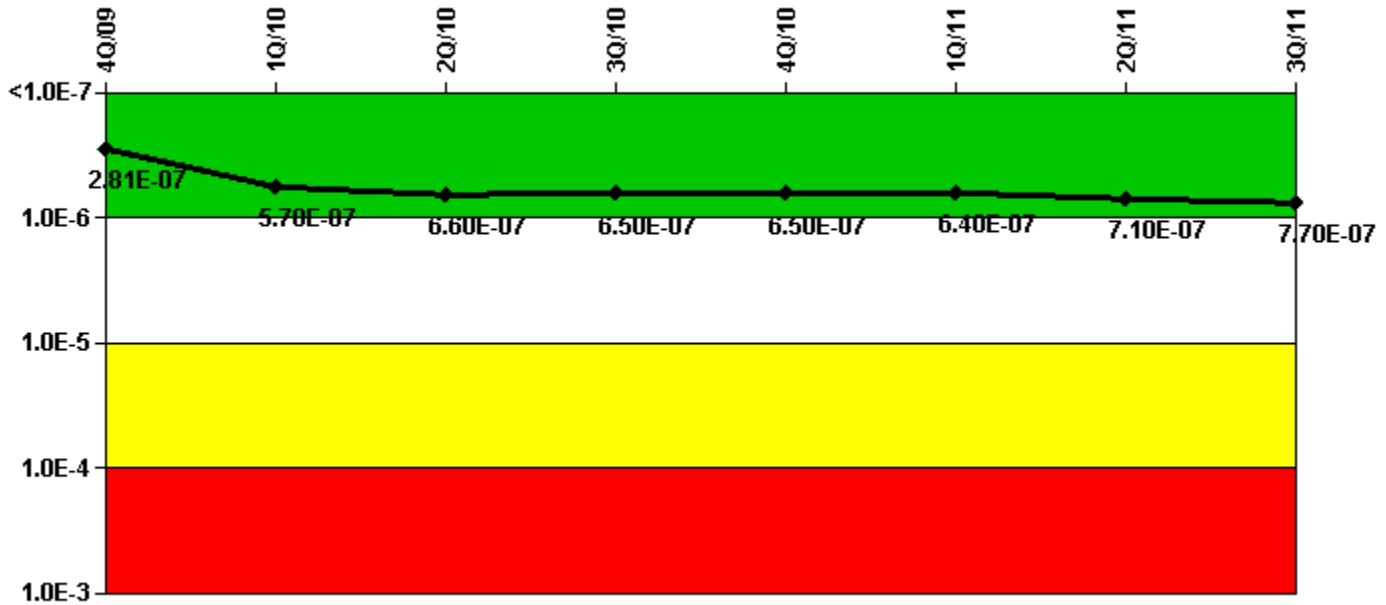


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-1.90E-08	1.04E-08	4.54E-09	-1.38E-09	-6.39E-09	-3.49E-08	-3.47E-08	-2.78E-08
URI (Δ CDF)	3.00E-07	5.62E-07	6.54E-07	6.47E-07	6.57E-07	6.77E-07	7.49E-07	7.95E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.81E-07	5.70E-07	6.60E-07	6.50E-07	6.50E-07	6.40E-07	7.10E-07	7.70E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

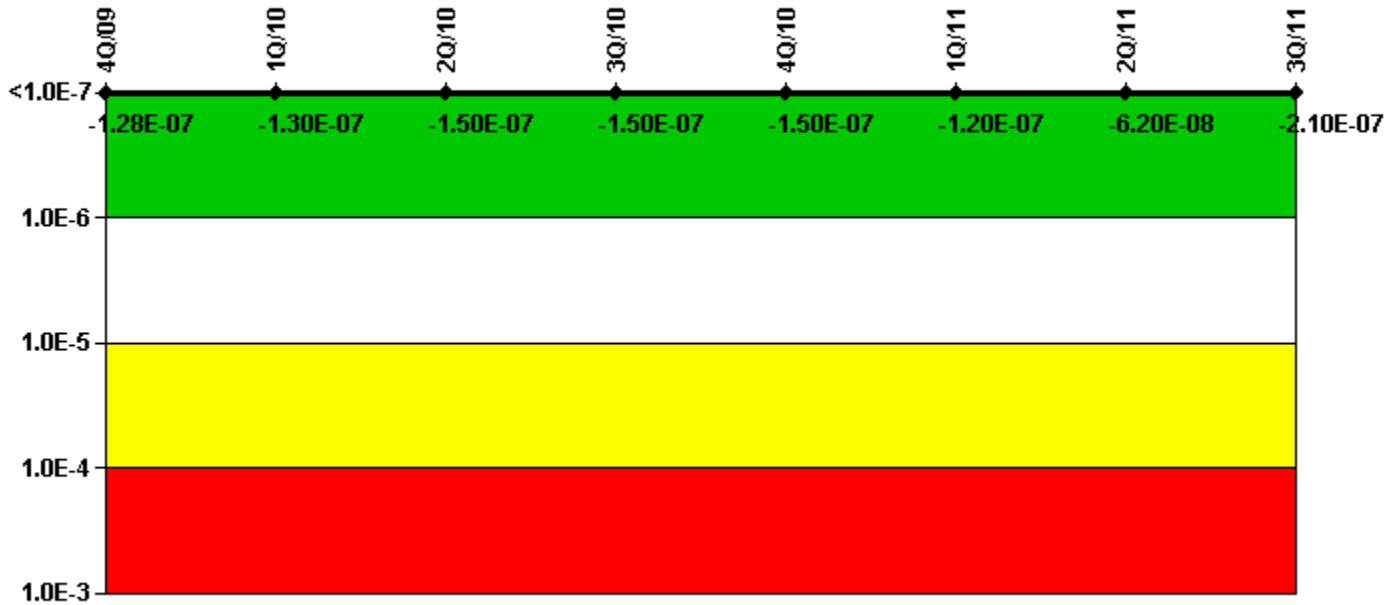


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-7.80E-08	-7.77E-08	-8.67E-08	-8.67E-08	-8.65E-08	-5.36E-08	3.84E-09	-1.48E-07
URI (Δ CDF)	-5.00E-08	-5.08E-08	-6.53E-08	-6.45E-08	-6.48E-08	-6.51E-08	-6.62E-08	-6.70E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.28E-07	-1.30E-07	-1.50E-07	-1.50E-07	-1.50E-07	-1.20E-07	-6.20E-08	-2.10E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

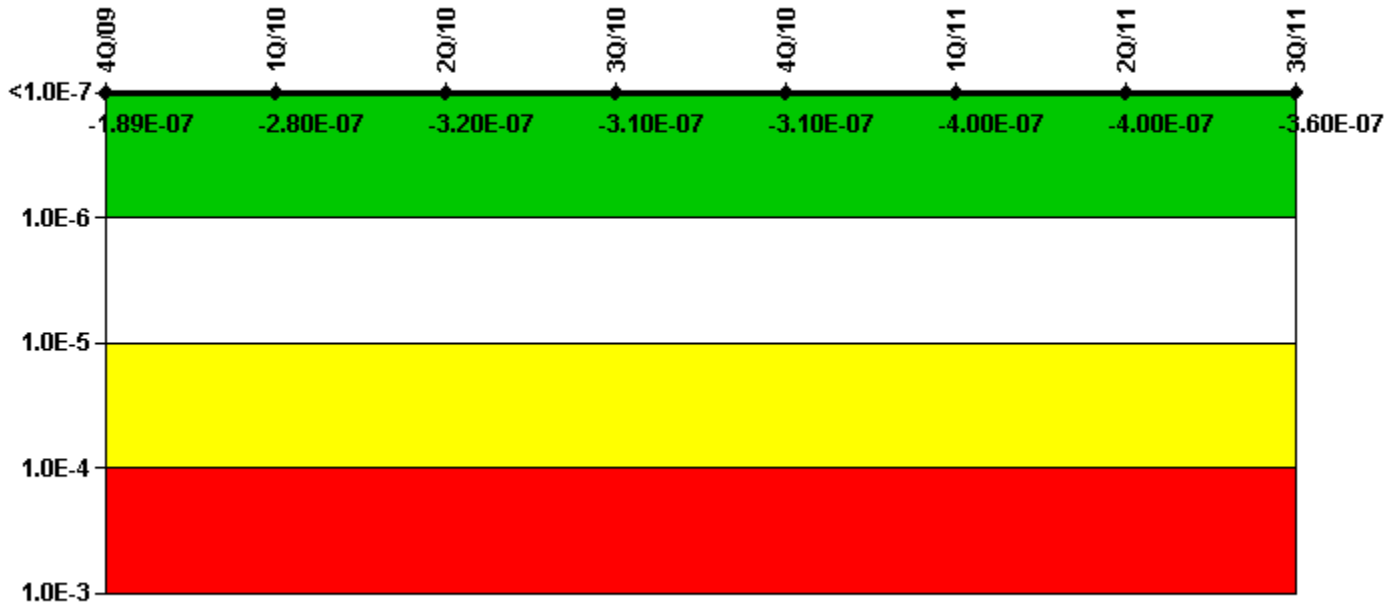


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI (Δ CDF)	-2.40E-07	-2.84E-07	-3.22E-07	-3.14E-07	-2.95E-07	-3.52E-07	-3.53E-07	-3.17E-07
URI (Δ CDF)	5.10E-08	4.07E-09	4.58E-09	4.96E-09	-1.98E-08	-4.71E-08	-4.64E-08	-4.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.89E-07	-2.80E-07	-3.20E-07	-3.10E-07	-3.10E-07	-4.00E-07	-4.00E-07	-3.60E-07

Licensee Comments: none

Reactor Coolant System Activity

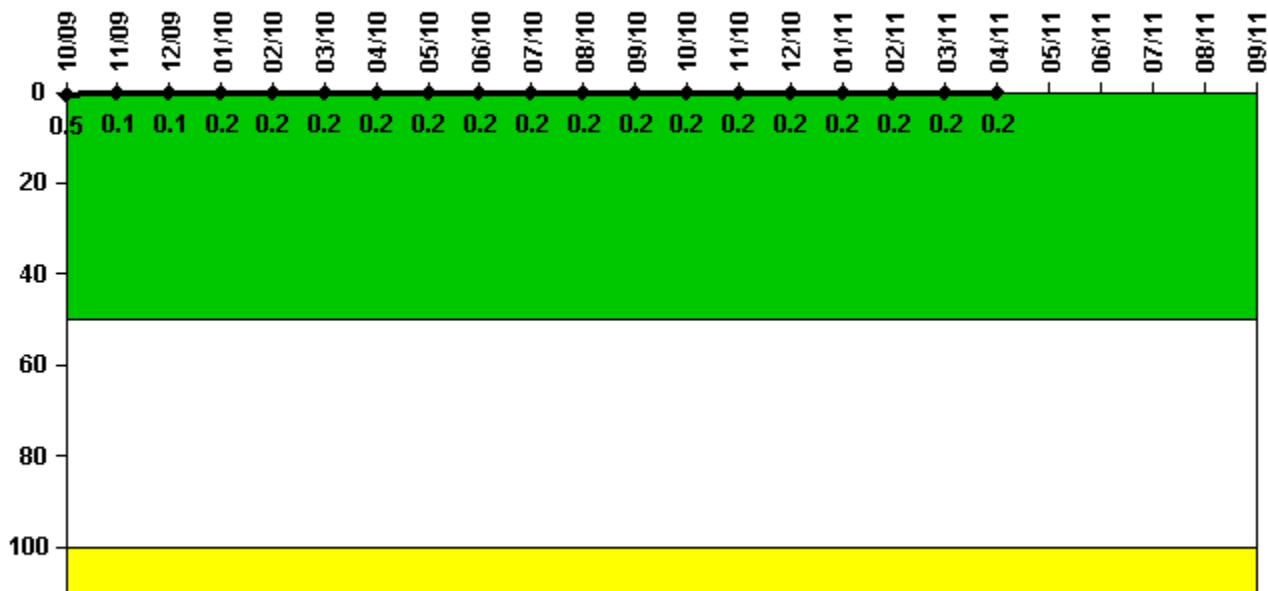


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum activity	0.004690	0.000973	0.001130	0.001530	0.001590	0.001640	0.001710	0.001760	0.002170	0.001780	0.001950	0.001990
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.5	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Reactor Coolant System Activity	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum activity	0.001960	0.002010	0.002140	0.002140	0.002110	0.002290	0.002090	N/A	N/A	N/A	N/A	N/A
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	N/A	N/A	N/A	N/A	N/A

Licensee Comments: none

Reactor Coolant System Leakage

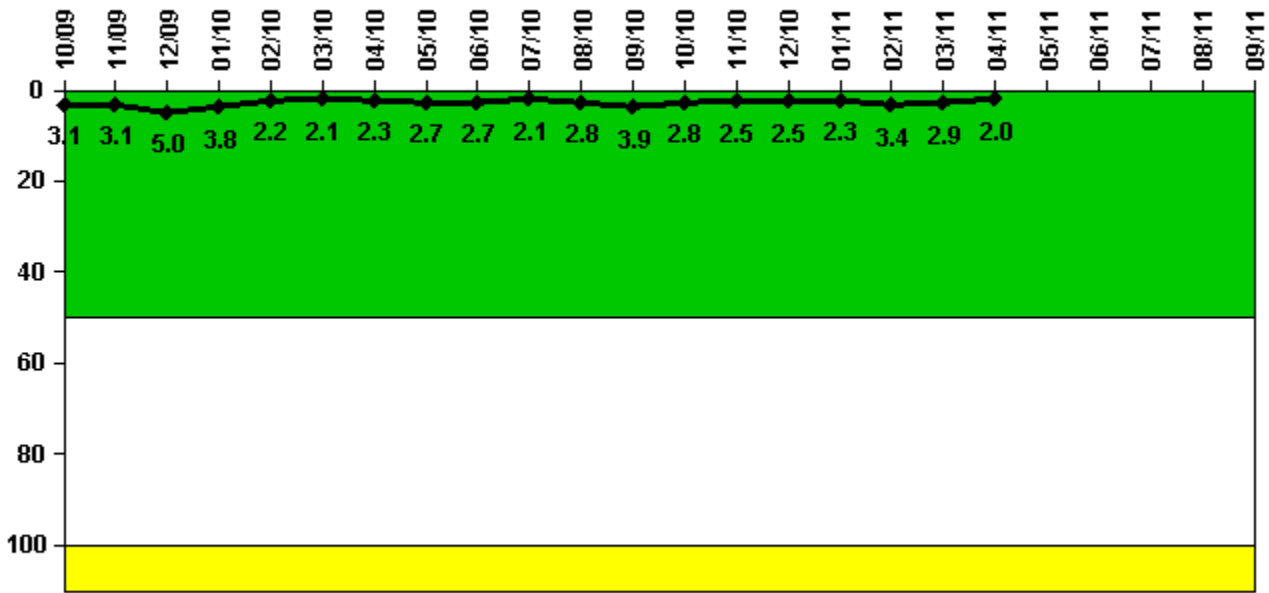


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum leakage	0.307	0.307	0.496	0.380	0.224	0.207	0.231	0.269	0.273	0.213	0.277	0.386
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	3.1	3.1	5.0	3.8	2.2	2.1	2.3	2.7	2.7	2.1	2.8	3.9
Reactor Coolant System Leakage	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum leakage	0.284	0.248	0.245	0.231	0.336	0.286	0.196	N/A	N/A	N/A	N/A	N/A
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.8	2.5	2.5	2.3	3.4	2.9	2.0	N/A	N/A	N/A	N/A	N/A

Licensee Comments: none

Drill/Exercise Performance

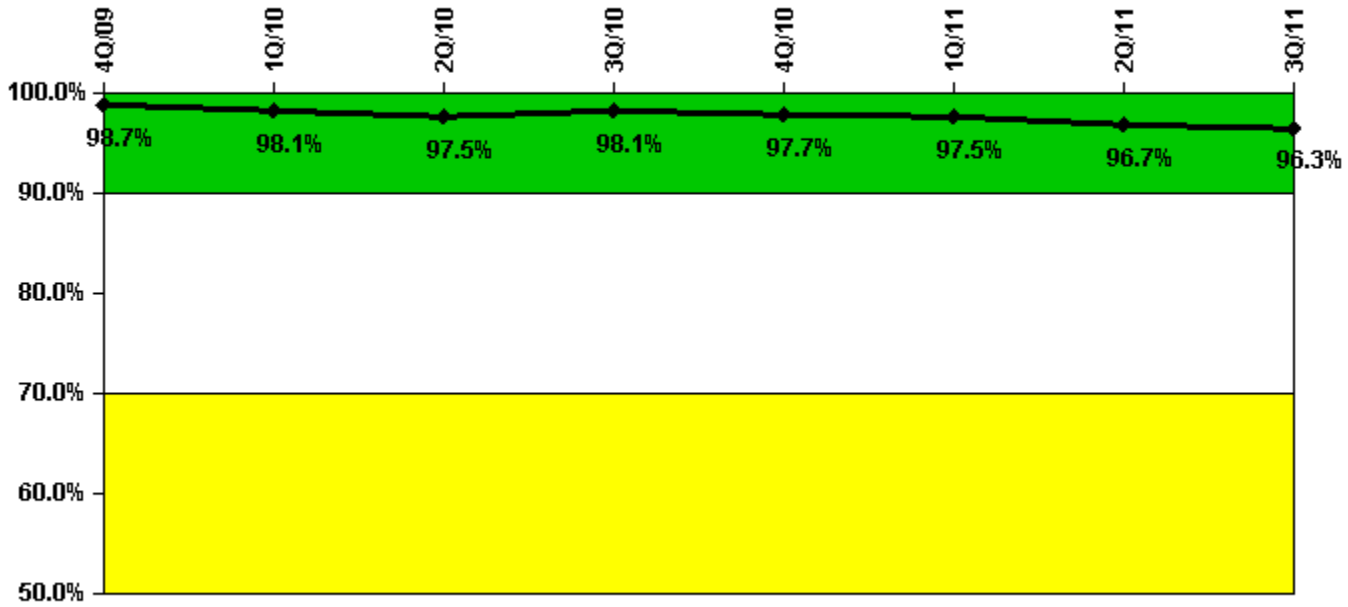


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Successful opportunities	4.0	23.0	58.0	73.0	49.0	61.0	11.0	33.0
Total opportunities	4.0	25.0	61.0	73.0	50.0	62.0	13.0	36.0
Indicator value	98.7%	98.1%	97.5%	98.1%	97.7%	97.5%	96.7%	96.3%

Licensee Comments: none

ERO Drill Participation

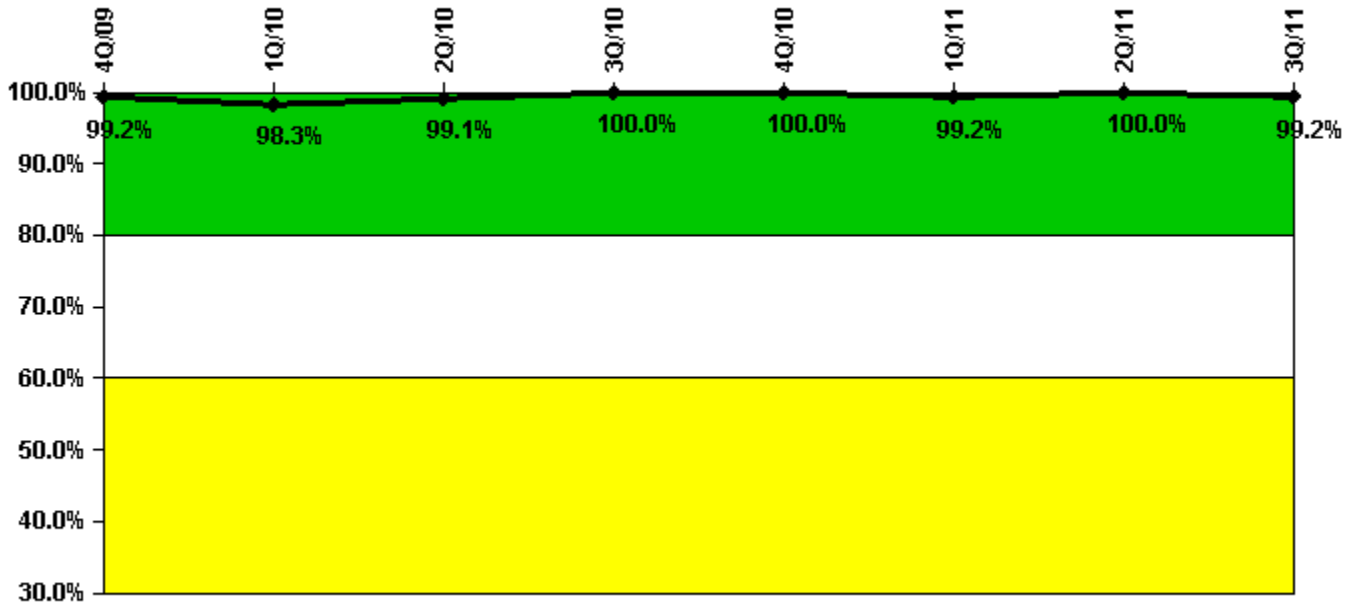


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Participating Key personnel	117.0	116.0	116.0	122.0	118.0	123.0	124.0	118.0
Total Key personnel	118.0	118.0	117.0	122.0	118.0	124.0	124.0	119.0
Indicator value	99.2%	98.3%	99.1%	100.0%	100.0%	99.2%	100.0%	99.2%

Licensee Comments: none

Alert & Notification System

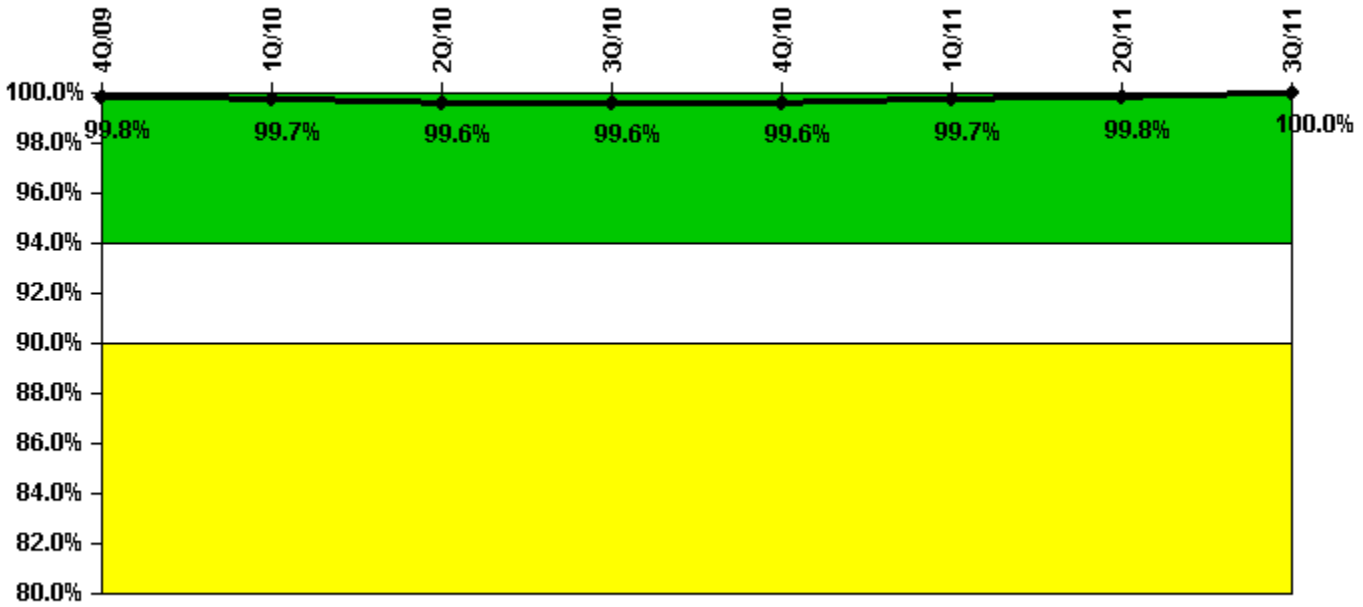


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Successful siren-tests	808	703	803	804	808	707	801	737
Total sirens-tests	808	707	808	808	808	707	802	737
Indicator value	99.8%	99.7%	99.6%	99.6%	99.6%	99.7%	99.8%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

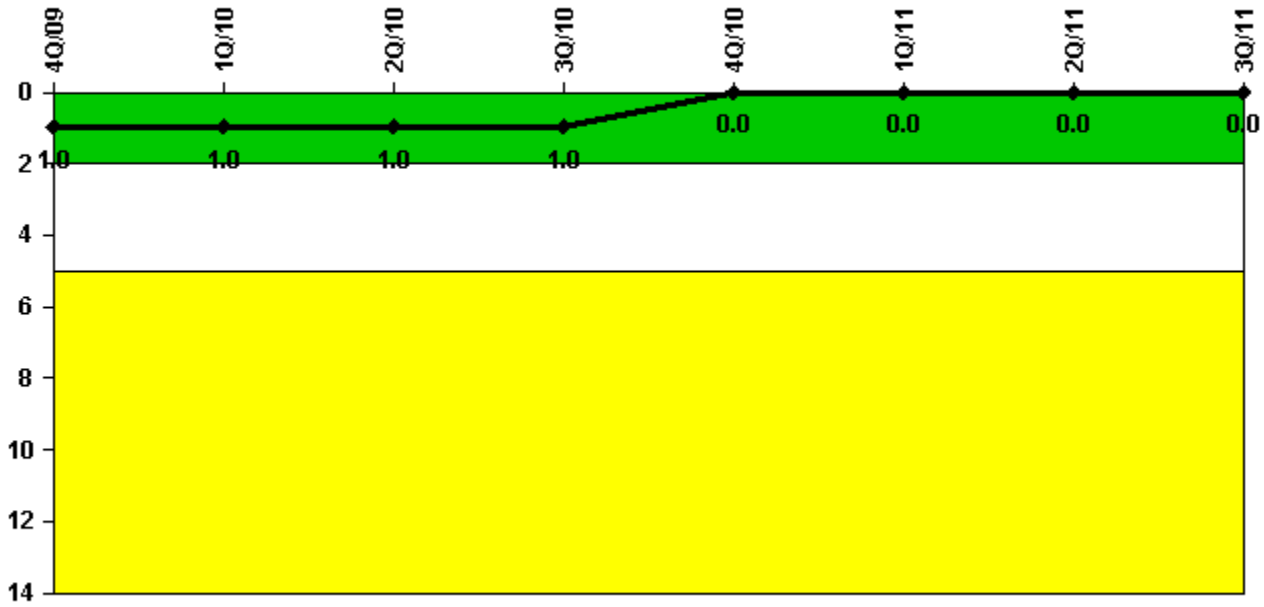

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
High radiation area occurrences	1	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	1	1	1	1	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.