


# McGuire 2

## 3Q/2011 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

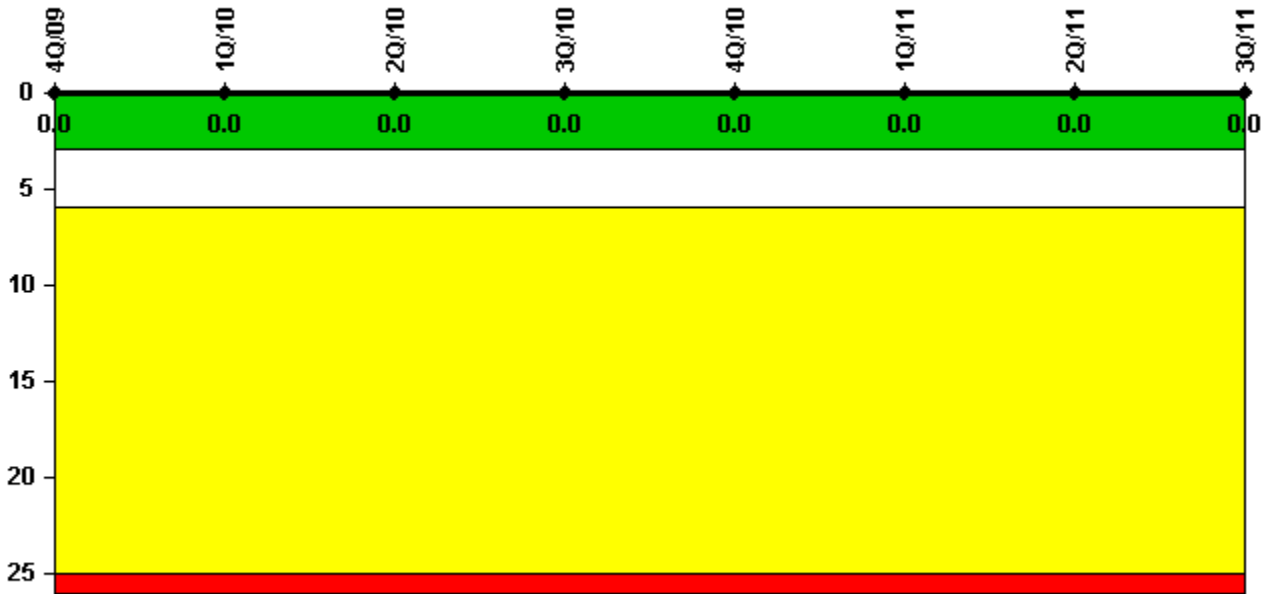

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


### Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1996.8	2159.0	2184.0	2208.0	2209.0	1220.0	2111.8	2208.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

---

## Unplanned Power Changes per 7000 Critical Hrs

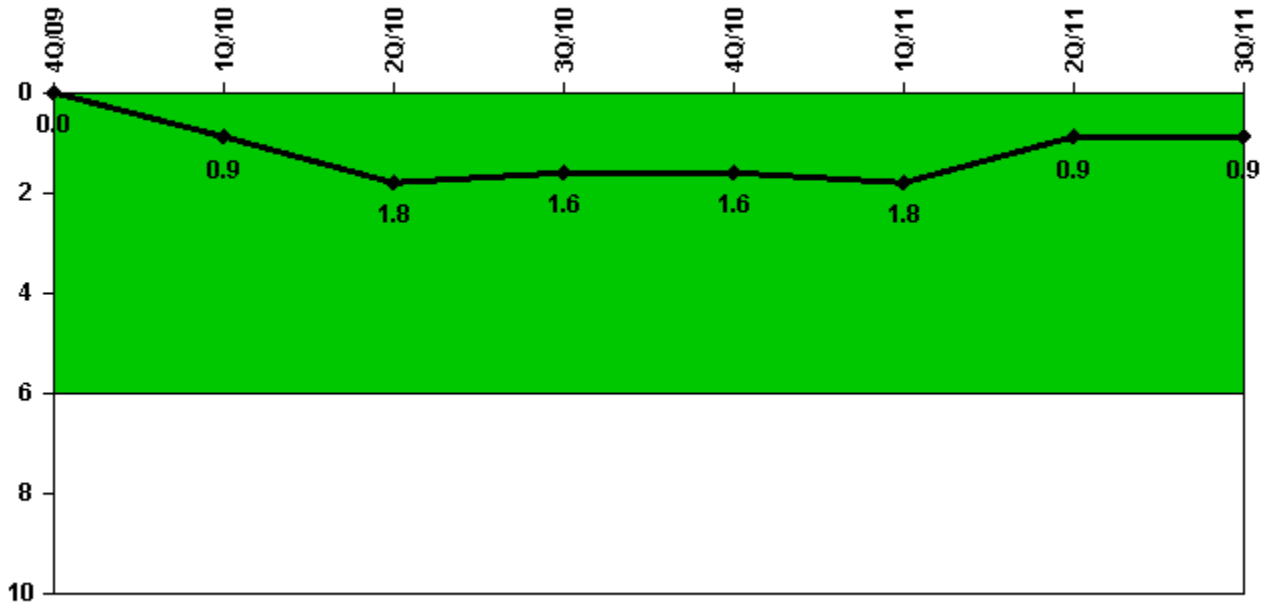


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Unplanned power changes	0	1.0	1.0	0	0	1.0	0	0
Critical hours	1996.8	2159.0	2184.0	2208.0	2209.0	1220.0	2111.8	2208.0
Indicator value	0	0.9	1.8	1.6	1.6	1.8	0.9	0.9

Licensee Comments: none

# Unplanned Scrams with Complications

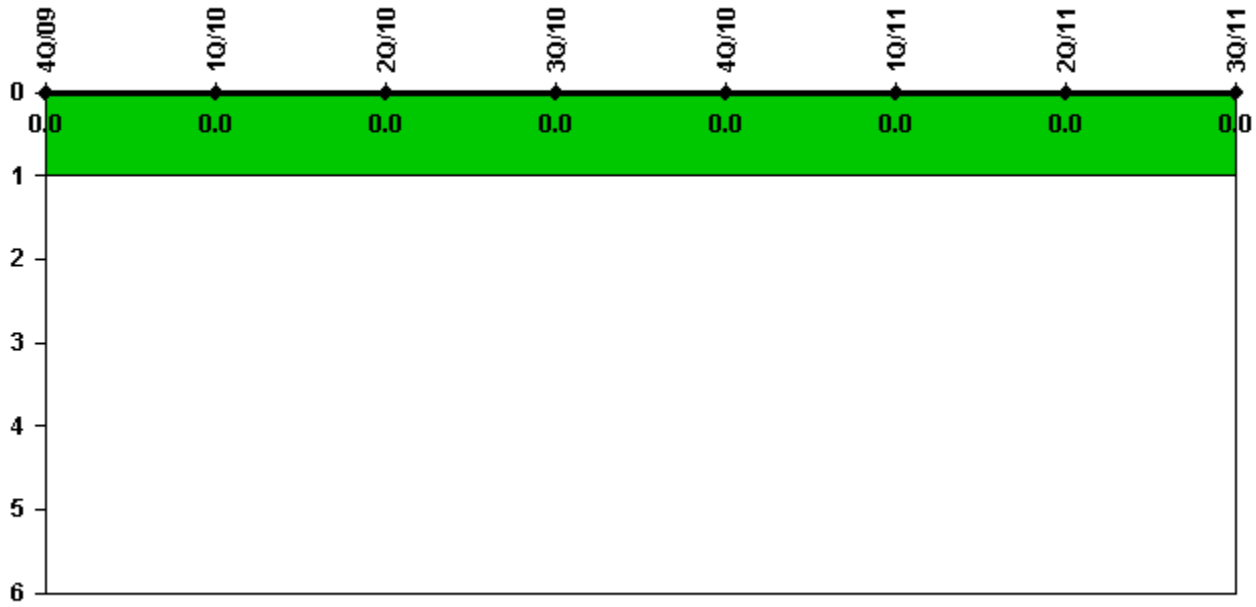


Thresholds: White > 1.0

## Notes

Unplanned Scrams with Complications	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (PWR)

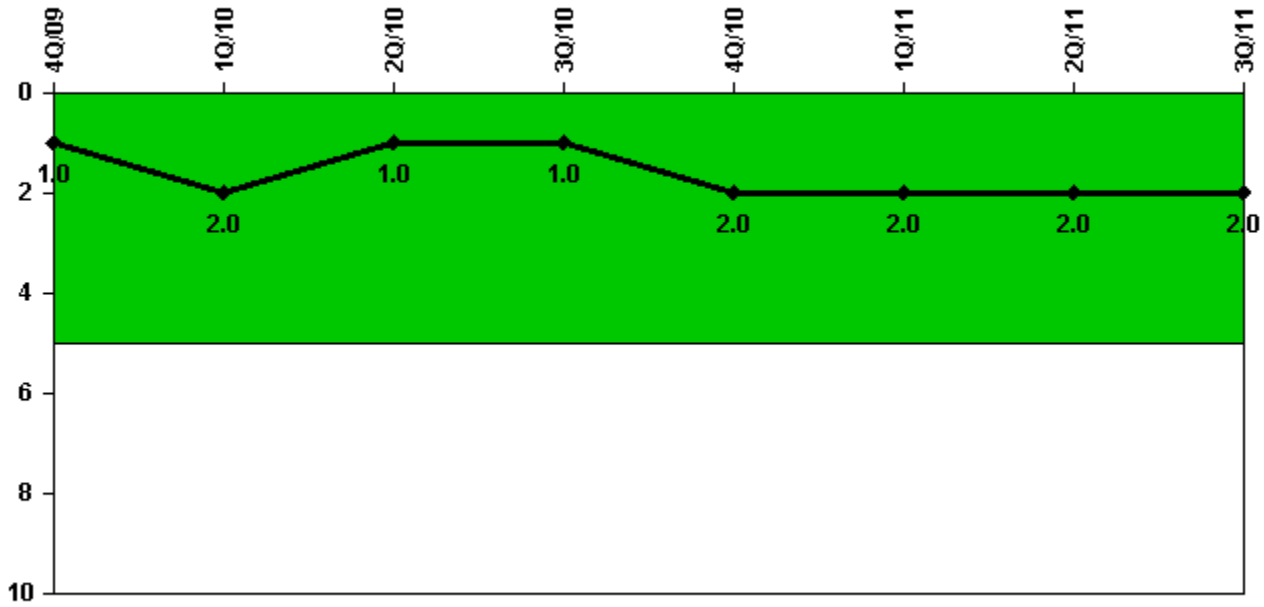


Thresholds: White > 5.0

### Notes

Safety System Functional Failures (PWR)	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Safety System Functional Failures	0	1	0	0	1	1	0	0
Indicator value	1	2	1	1	2	2	2	2

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

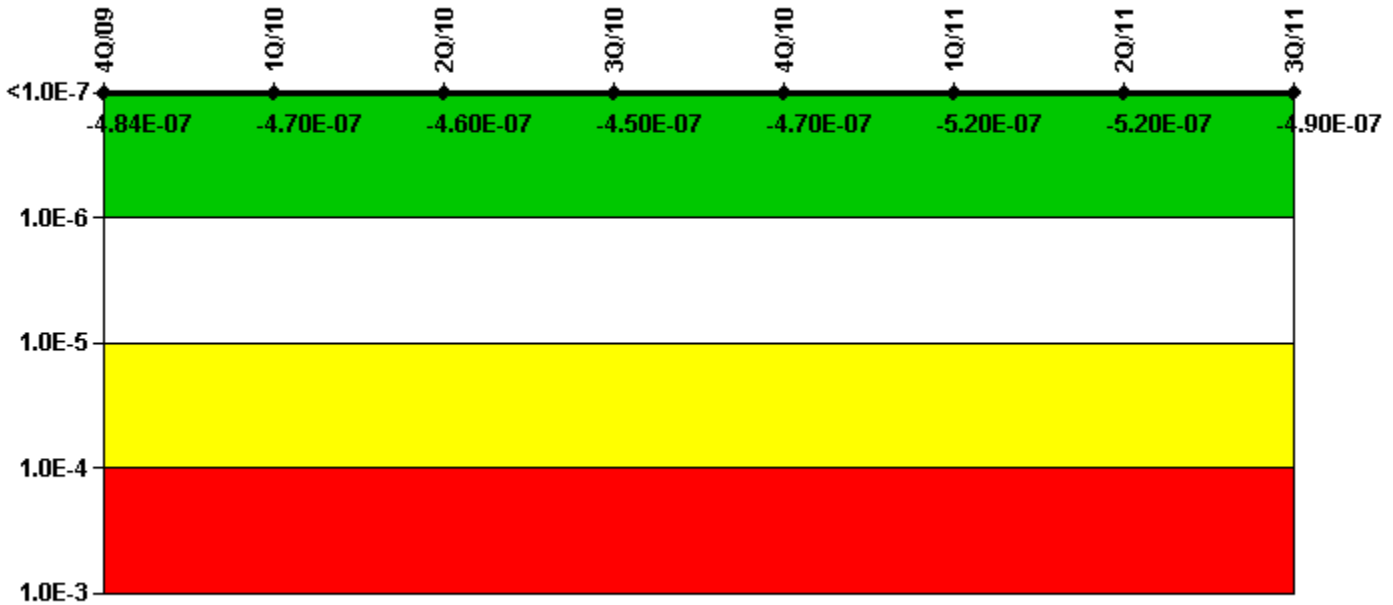


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI ( $\Delta$ CDF)	1.60E-08	2.73E-08	4.47E-08	4.64E-08	2.99E-08	-1.62E-08	-1.59E-08	1.14E-08
URI ( $\Delta$ CDF)	-5.00E-07	-5.01E-07	-5.01E-07	-5.01E-07	-5.01E-07	-5.01E-07	-5.01E-07	-5.01E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.84E-07	-4.70E-07	-4.60E-07	-4.50E-07	-4.70E-07	-5.20E-07	-5.20E-07	-4.90E-07

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

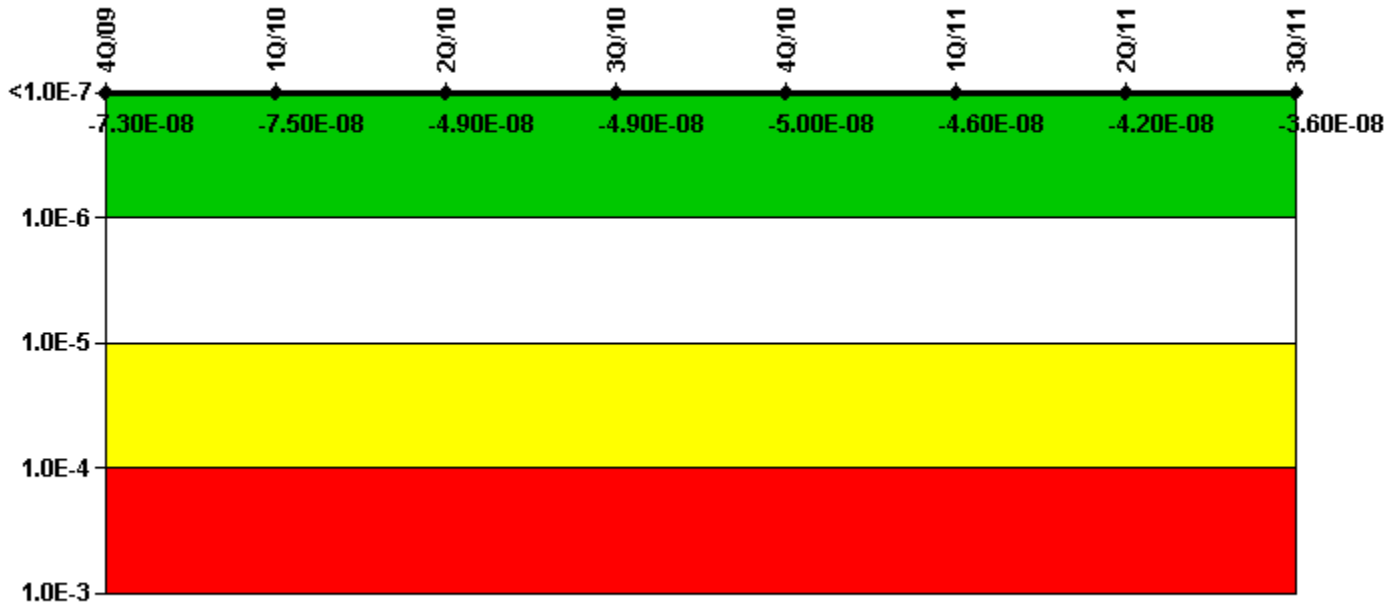


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI ( $\Delta$ CDF)	2.00E-09	1.60E-10	1.59E-11	-1.74E-10	-7.82E-10	2.96E-09	7.09E-09	1.32E-08
URI ( $\Delta$ CDF)	-7.50E-08	-7.53E-08	-4.91E-08	-4.91E-08	-4.91E-08	-4.91E-08	-4.91E-08	-4.91E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.30E-08	-7.50E-08	-4.90E-08	-4.90E-08	-5.00E-08	-4.60E-08	-4.20E-08	-3.60E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

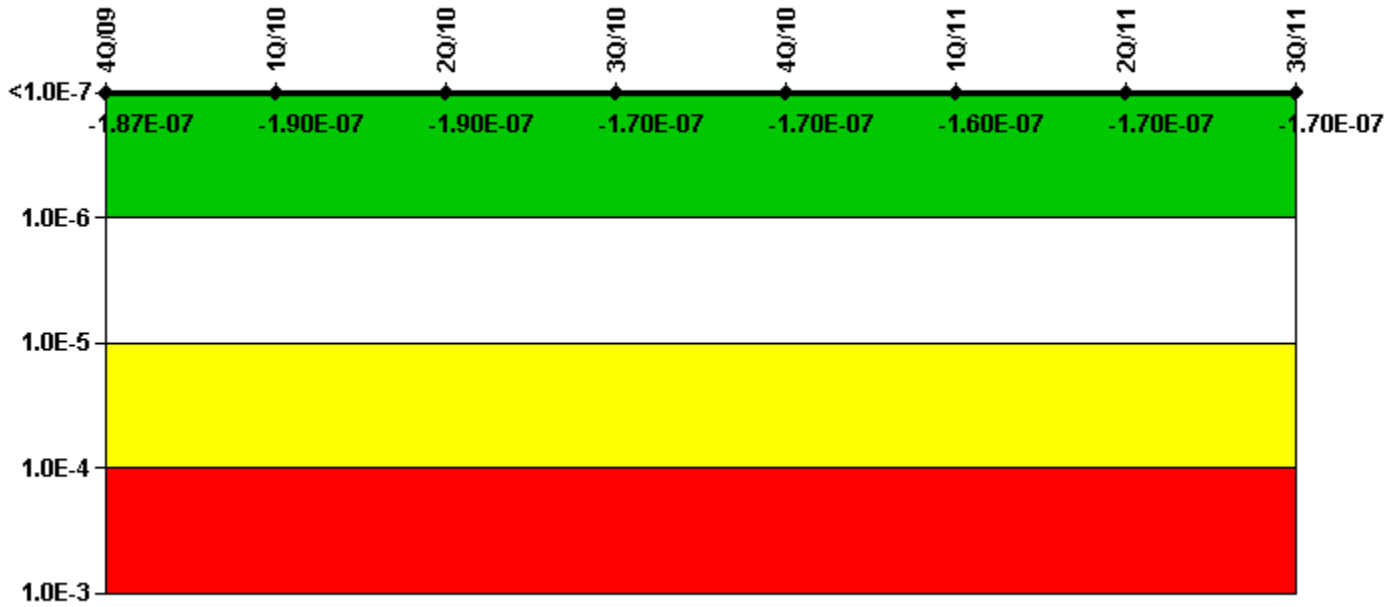


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI ( $\Delta$ CDF)	-2.70E-08	-2.54E-08	-2.31E-08	-2.68E-09	-1.81E-09	7.32E-09	-3.02E-09	-1.39E-10
URI ( $\Delta$ CDF)	-1.60E-07	-1.61E-07	-1.67E-07	-1.67E-07	-1.67E-07	-1.67E-07	-1.67E-07	-1.67E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.87E-07	-1.90E-07	-1.90E-07	-1.70E-07	-1.70E-07	-1.60E-07	-1.70E-07	-1.70E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

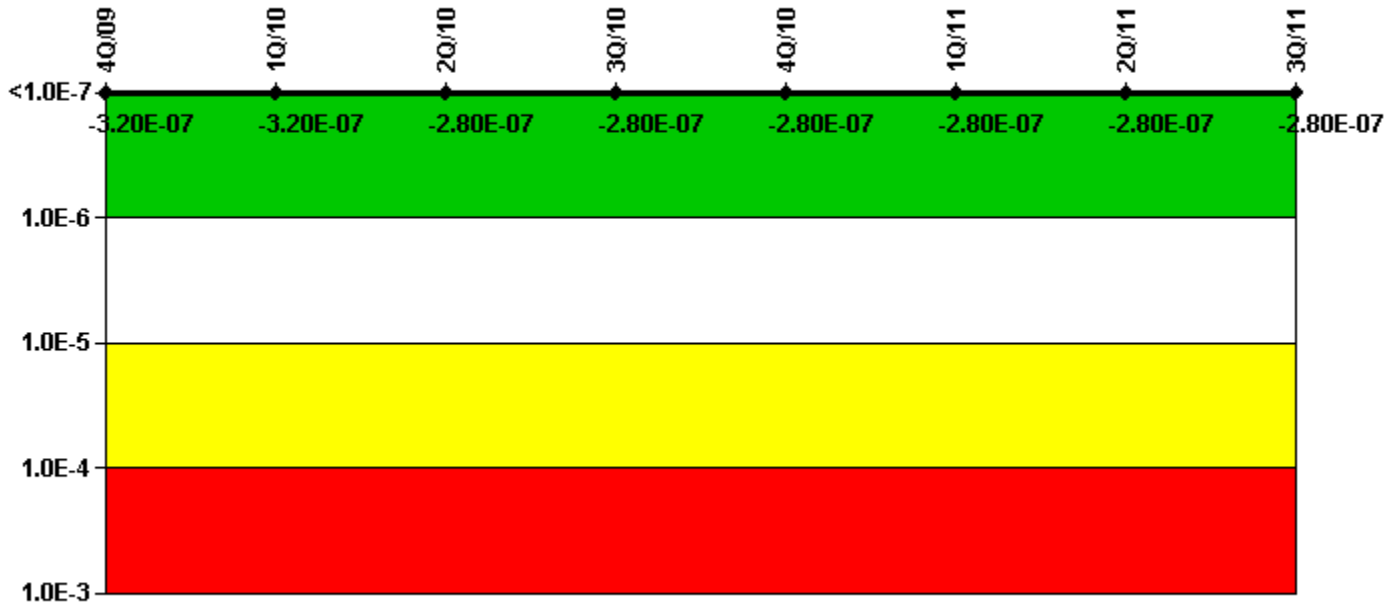

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI ( $\Delta$ CDF)	-3.02E-08	-3.02E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08
URI ( $\Delta$ CDF)	-2.85E-07	-2.85E-07	-2.47E-07	-2.47E-07	-2.47E-07	-2.47E-07	-2.47E-07	-2.47E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.20E-07	-3.20E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

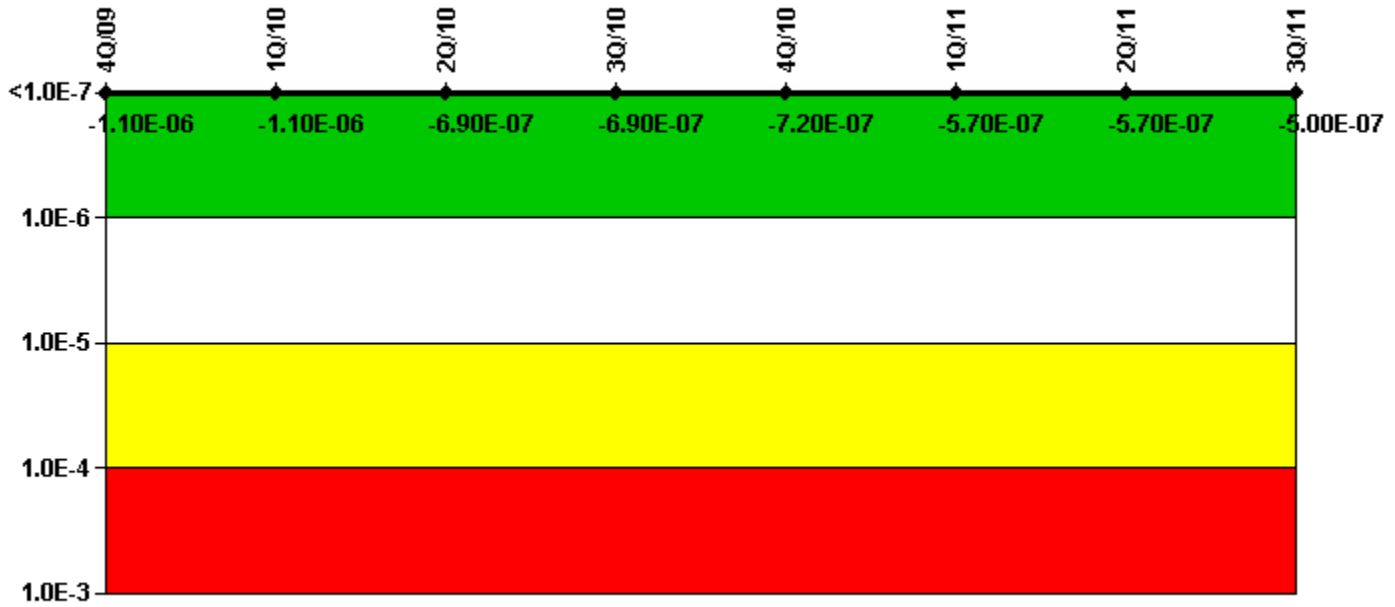


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
UAI ( $\Delta$ CDF)	1.53E-07	1.57E-07	4.18E-07	4.18E-07	3.87E-07	5.41E-07	5.37E-07	6.02E-07
URI ( $\Delta$ CDF)	-1.26E-06	-1.26E-06	-1.11E-06	-1.11E-06	-1.11E-06	-1.11E-06	-1.11E-06	-1.11E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.10E-06	-1.10E-06	-6.90E-07	-6.90E-07	-7.20E-07	-5.70E-07	-5.70E-07	-5.00E-07

Licensee Comments: none

# Reactor Coolant System Activity

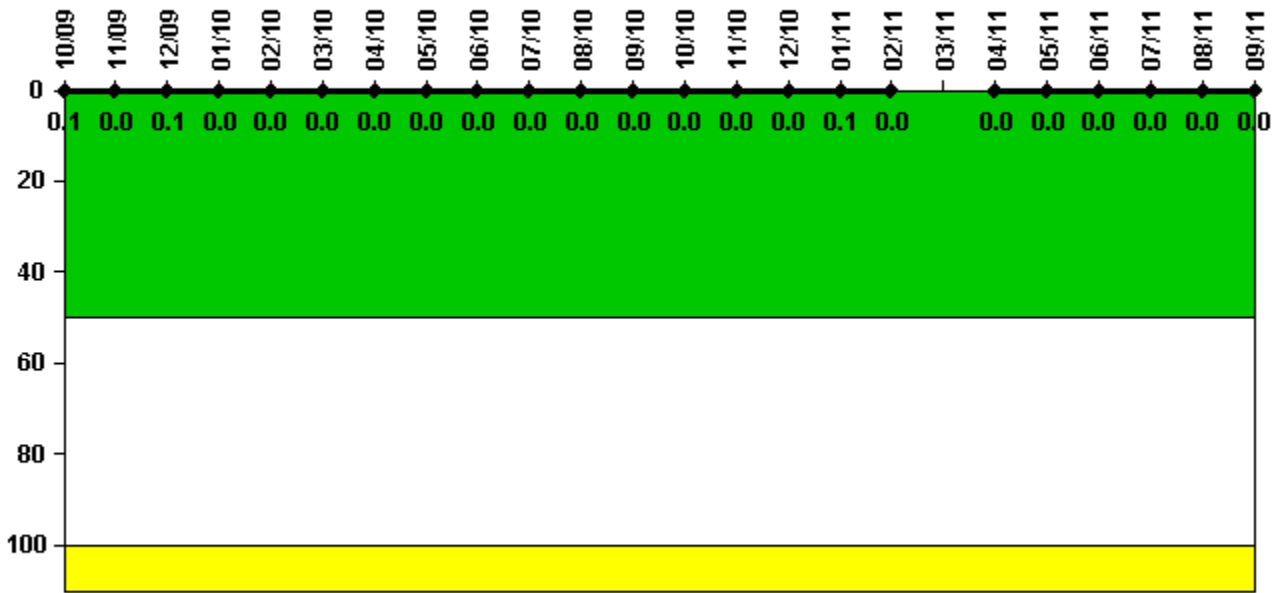


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum activity	0.000728	0.000237	0.000540	0.000243	0.000255	0.000261	0.000275	0.000313	0.000341	0.000296	0.000292	0.000333
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0	0.1	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum activity	0.000342	0.000331	0.000408	0.000764	0.000468	N/A	0.000492	0.000208	0.000390	0.000217	0.000367	0.000317
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0.1	0	N/A	0	0	0	0	0	0

Licensee Comments: none

## Reactor Coolant System Leakage

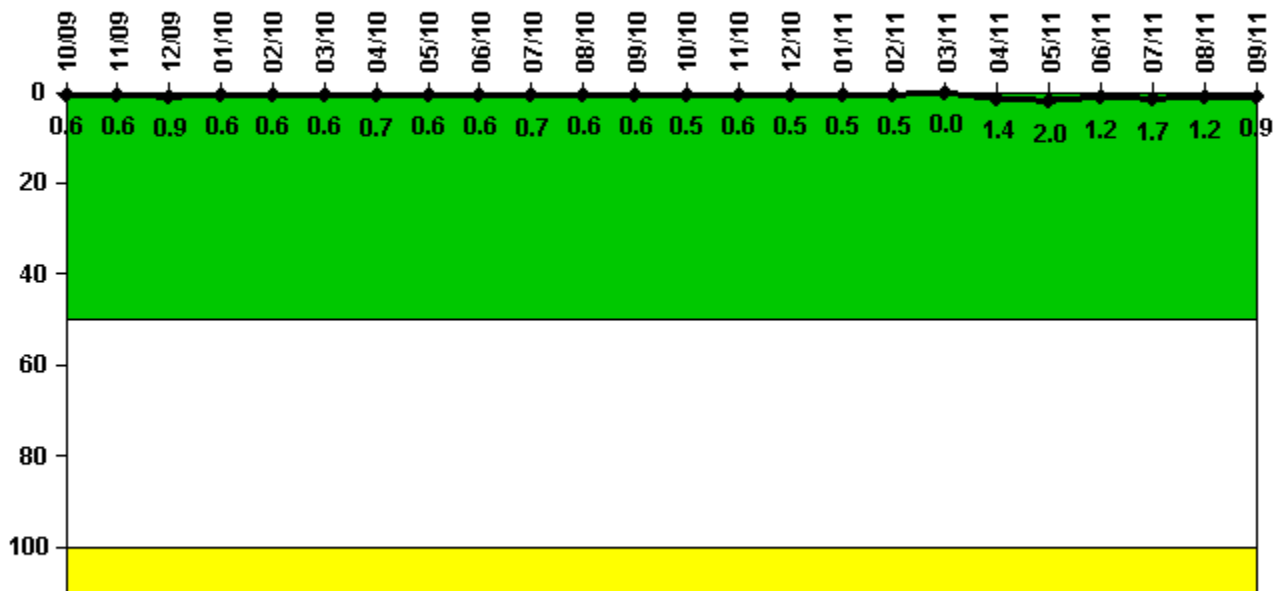


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	10/09	11/09	12/09	1/10	2/10	3/10	4/10	5/10	6/10	7/10	8/10	9/10
Maximum leakage	0.063	0.062	0.092	0.060	0.055	0.062	0.066	0.058	0.058	0.067	0.057	0.061
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.6	0.9	0.6	0.6	0.6	0.7	0.6	0.6	0.7	0.6	0.6
Reactor Coolant System Leakage	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum leakage	0.053	0.058	0.048	0.048	0.051	0	0.141	0.195	0.124	0.165	0.122	0.085
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.6	0.5	0.5	0.5	0	1.4	2.0	1.2	1.7	1.2	0.9

Licensee Comments: none

## Drill/Exercise Performance

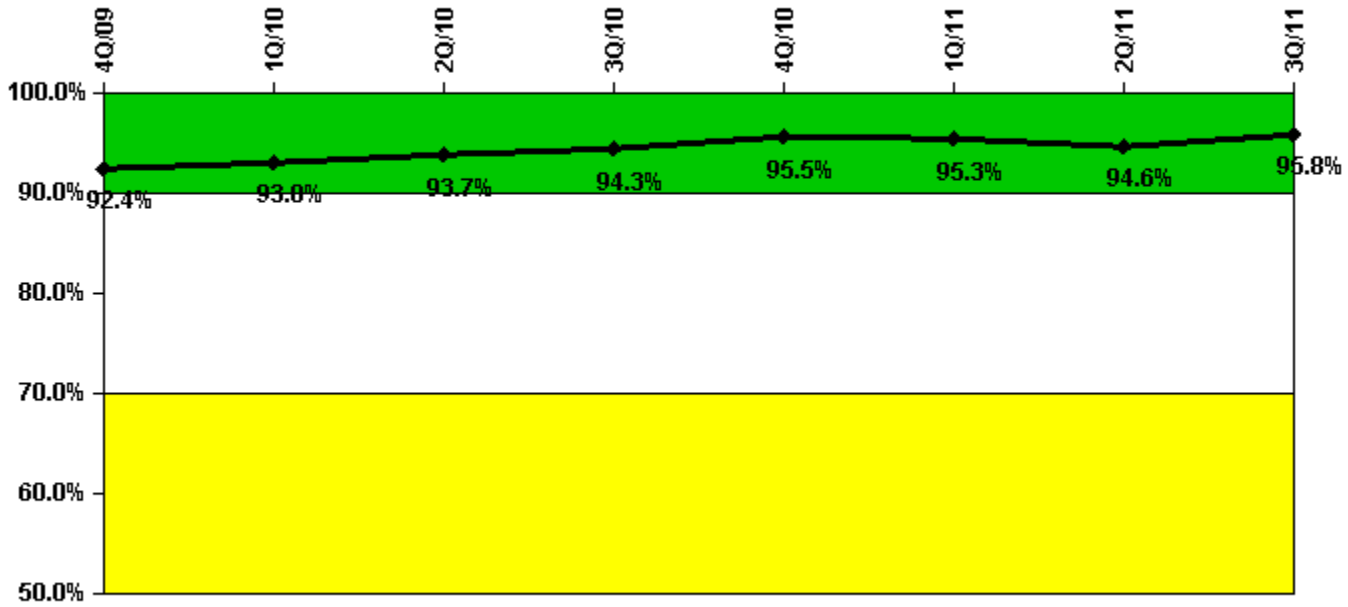


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Successful opportunities	50.0	8.0	8.0	17.0	51.0	0	30.0	40.0
Total opportunities	56.0	8.0	8.0	17.0	52.0	0	32.0	40.0
Indicator value	92.4%	93.0%	93.7%	94.3%	95.5%	95.3%	94.6%	95.8%

License Comments: none

# ERO Drill Participation

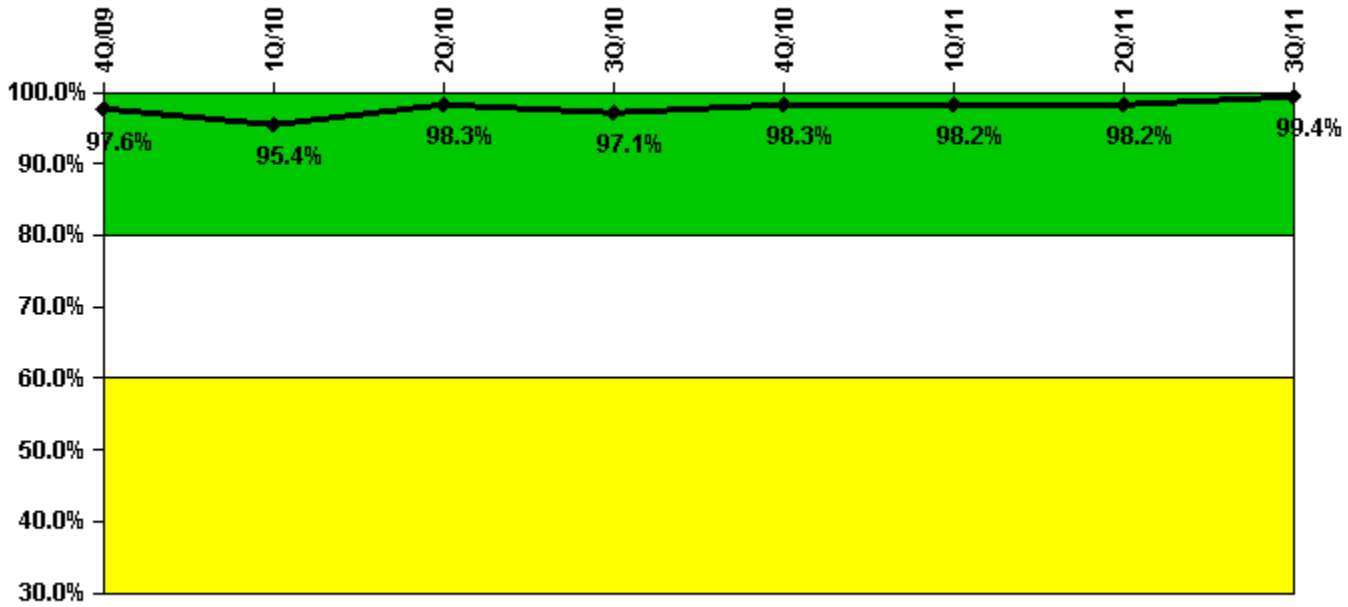


Thresholds: White < 80.0% Yellow < 60.0%

## Notes

ERO Drill Participation	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Participating Key personnel	165.0	166.0	169.0	167.0	171.0	167.0	165.0	168.0
Total Key personnel	169.0	174.0	172.0	172.0	174.0	170.0	168.0	169.0
Indicator value	97.6%	95.4%	98.3%	97.1%	98.3%	98.2%	98.2%	99.4%

Licensee Comments: none

# Alert & Notification System

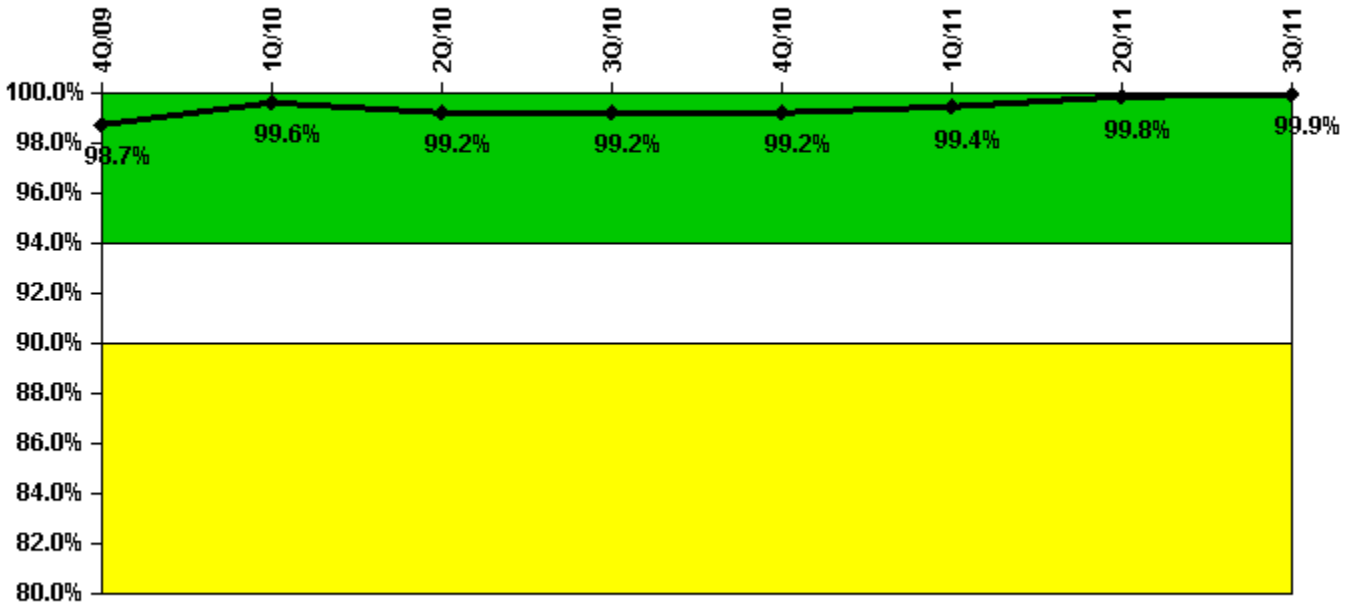


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
Successful siren-tests	1873	1731	1774	1868	1807	1808	1803	1808
Total sirens-tests	1876	1742	1809	1876	1809	1809	1809	1809
Indicator value	98.7%	99.6%	99.2%	99.2%	99.2%	99.4%	99.8%	99.9%

Licensee Comments: none

## Occupational Exposure Control Effectiveness

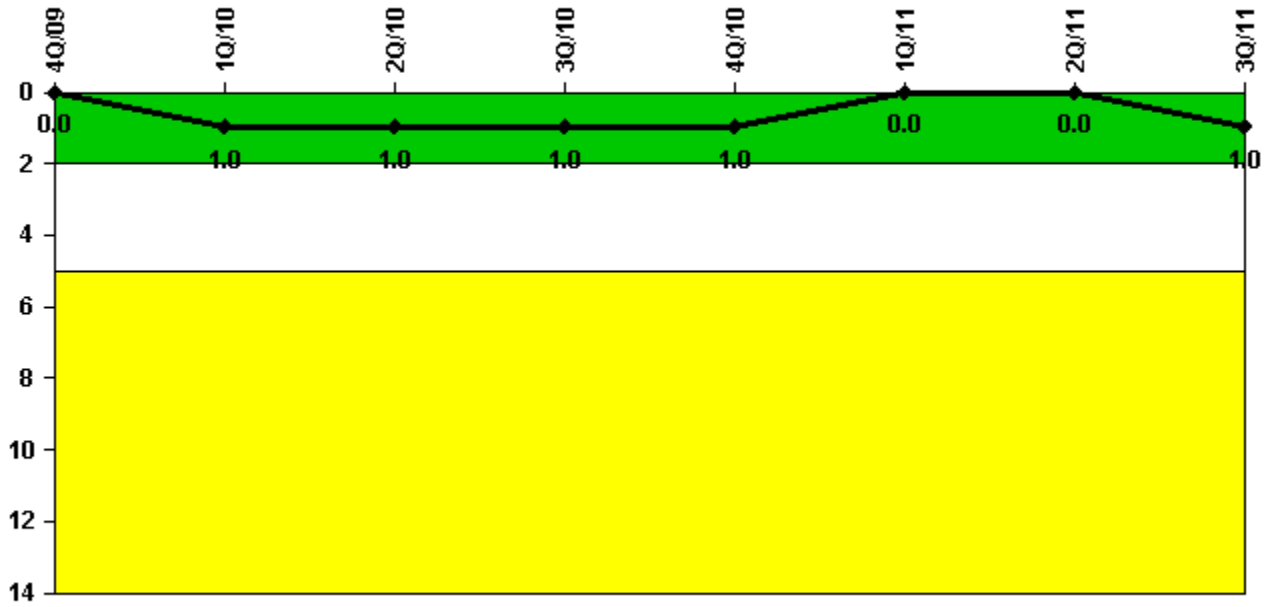


Thresholds: White > 2.0 Yellow > 5.0

### Notes

Occupational Exposure Control Effectiveness	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
High radiation area occurrences	0	1	0	0	0	0	0	1
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>1</b>

Licensee Comments: none

# RETS/ODCM Radiological Effluent

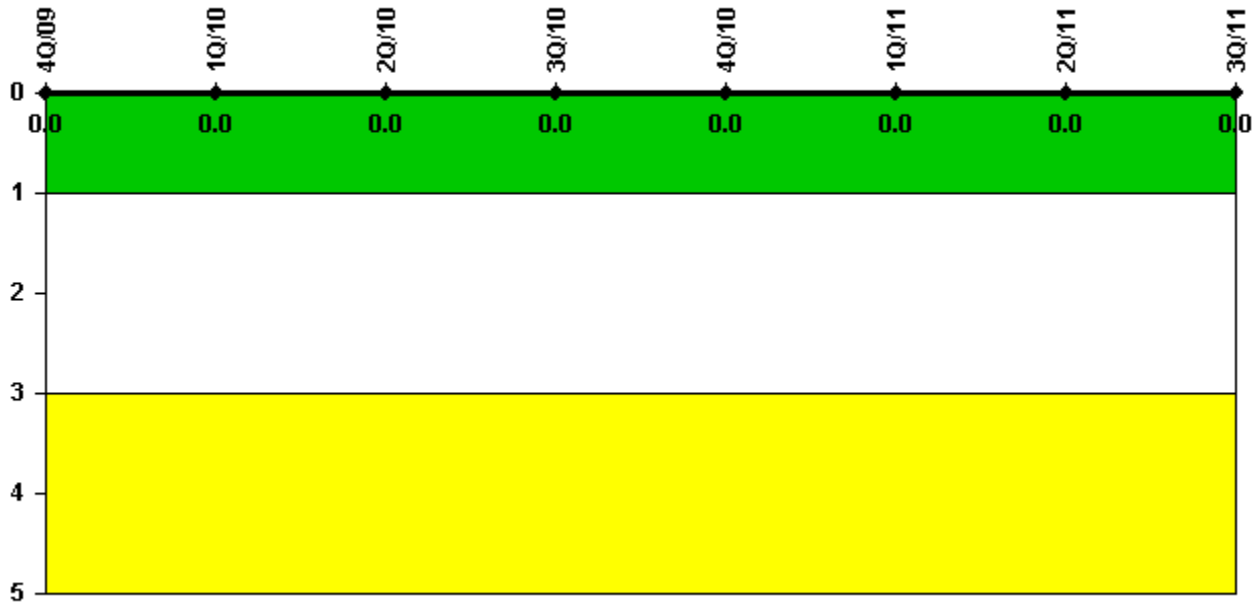

Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	4Q/09	1Q/10	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.