


# Ginna

## 1Q/2012 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

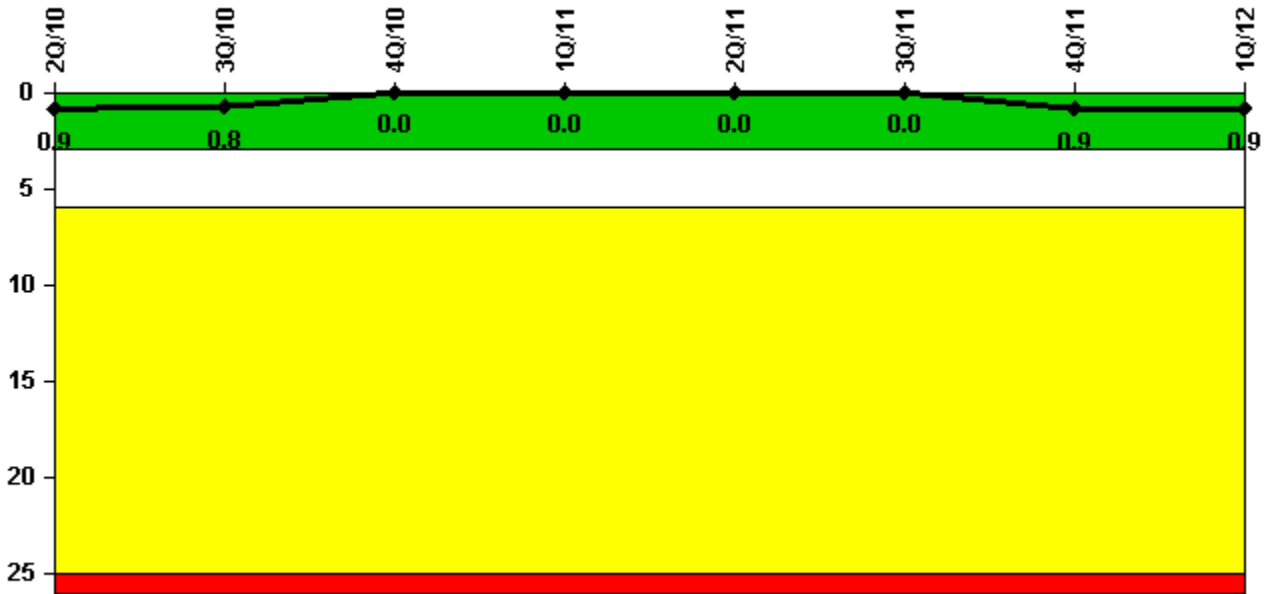


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Unplanned scrams	0	0	0	0	0	0	1.0	0
Critical hours	2184.0	2208.0	2209.0	2159.0	1075.4	2208.0	2125.2	2183.0
Indicator value	0.9	0.8	0	0	0	0	0.9	0.9

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

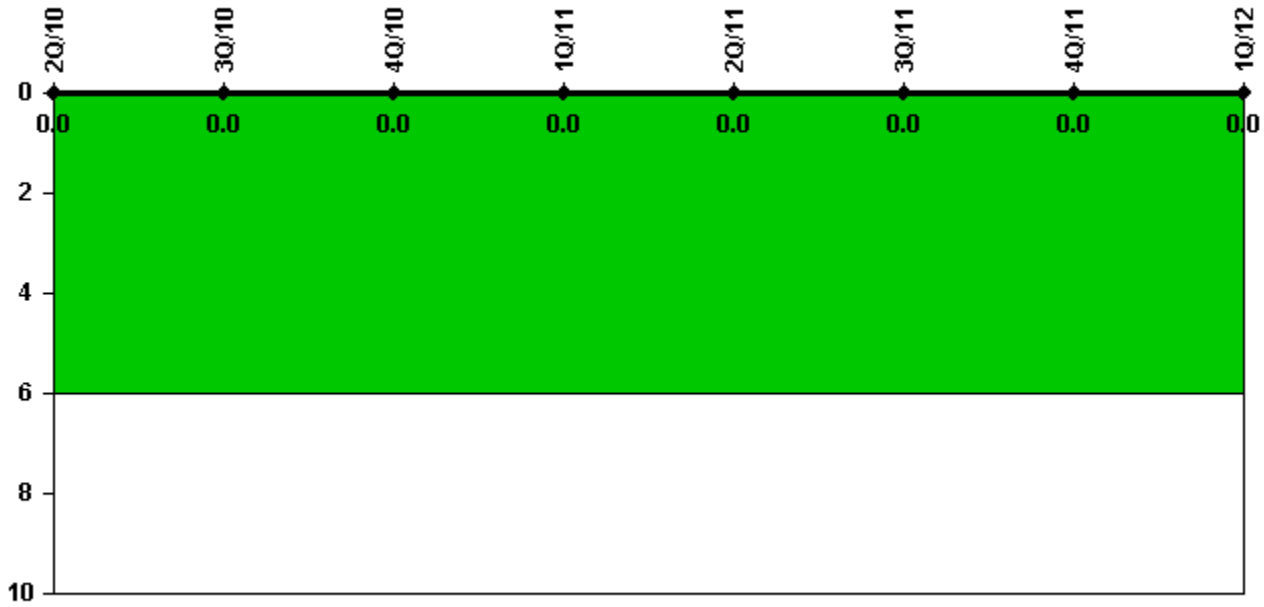


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2184.0	2208.0	2209.0	2159.0	1075.4	2208.0	2125.2	2183.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# Unplanned Scrams with Complications

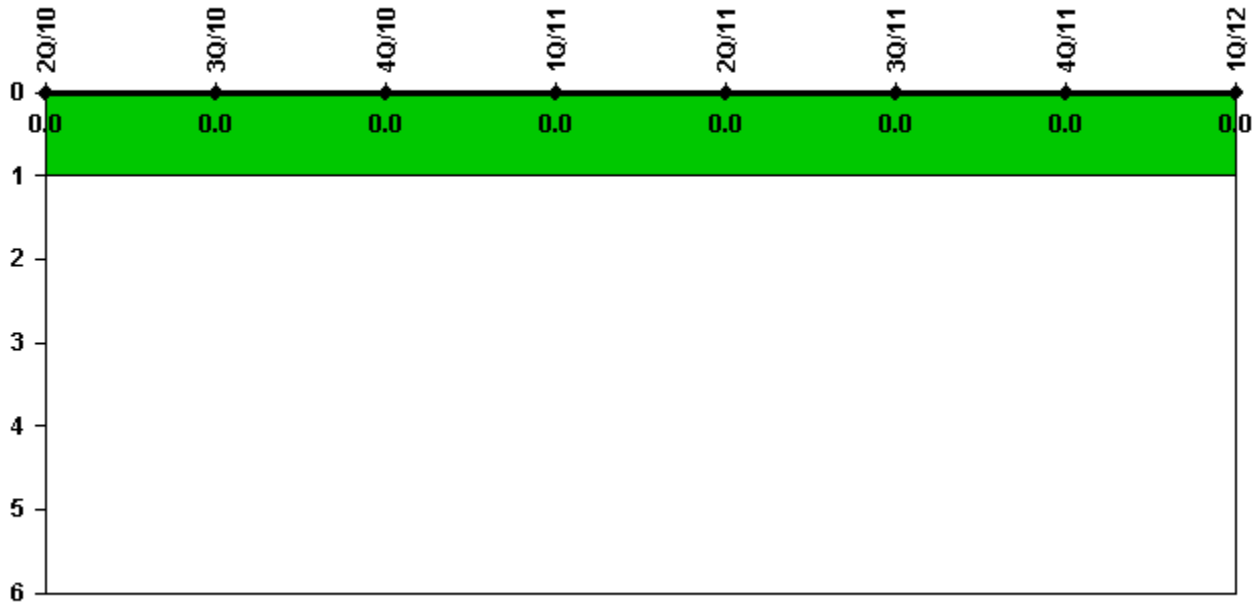


Thresholds: White > 1.0

## Notes

Unplanned Scrams with Complications	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (PWR)

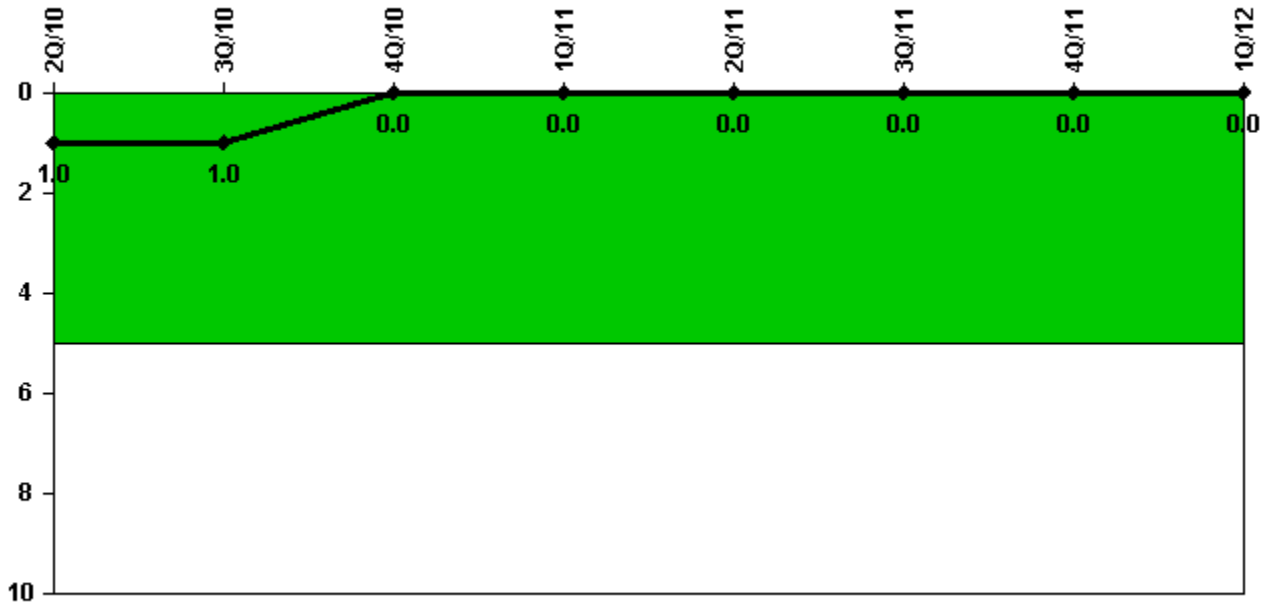


Thresholds: White > 5.0

### Notes

Safety System Functional Failures (PWR)	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	1	1	0	0	0	0	0	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

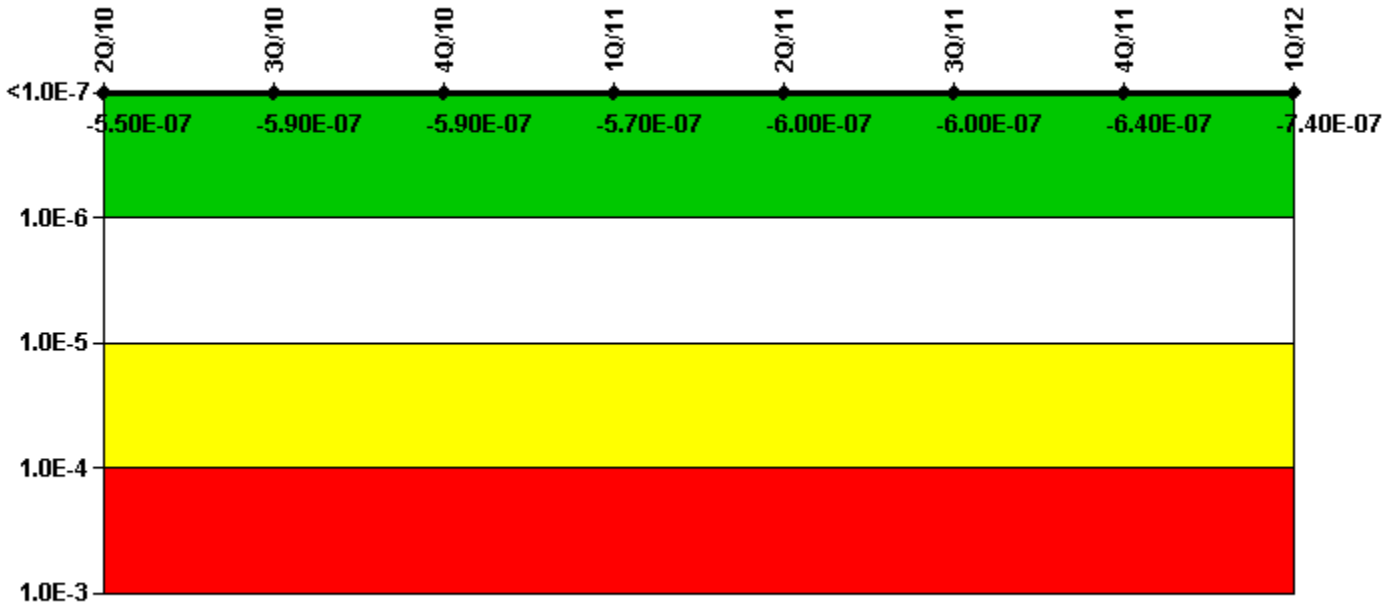


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	1.67E-08	-2.54E-08	5.11E-09	2.45E-08	1.65E-08	8.01E-09	-1.41E-08	-1.21E-07
URI ( $\Delta$ CDF)	-5.65E-07	-5.68E-07	-5.91E-07	-5.94E-07	-6.17E-07	-6.12E-07	-6.23E-07	-6.16E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.50E-07	-5.90E-07	-5.90E-07	-5.70E-07	-6.00E-07	-6.00E-07	-6.40E-07	-7.40E-07

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

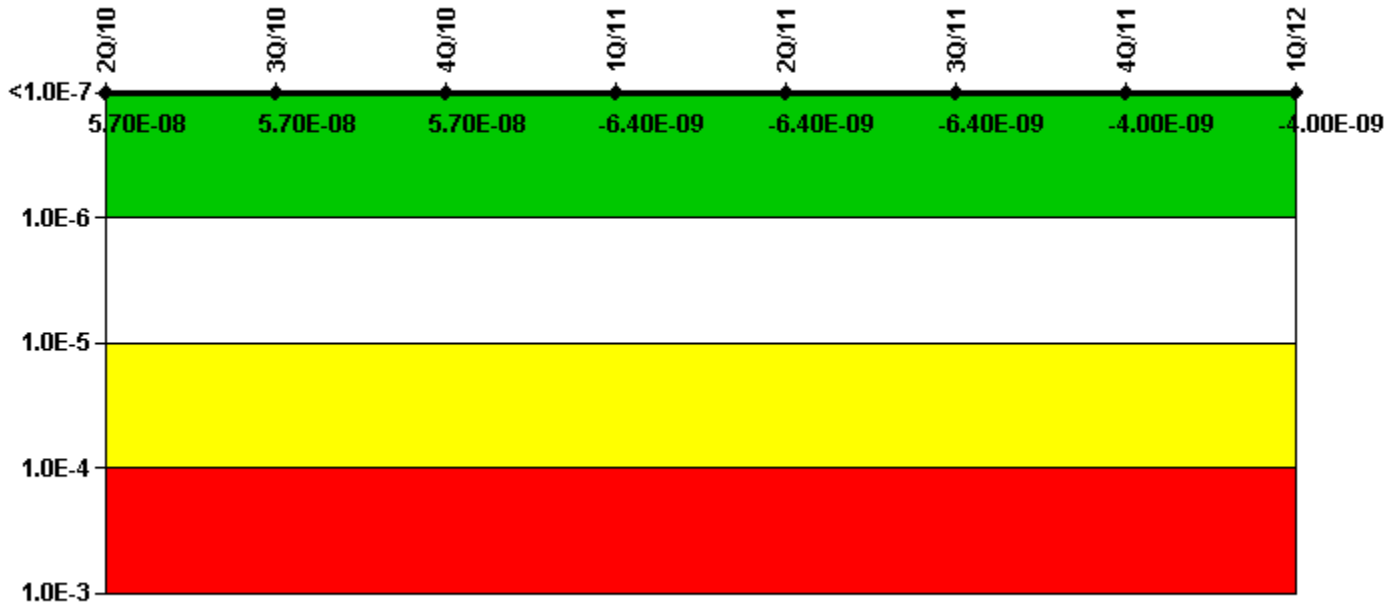


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	6.15E-08	6.15E-08	6.13E-08	-1.94E-09	-1.93E-09	-1.93E-09	4.53E-10	4.51E-10
URI ( $\Delta$ CDF)	-4.52E-09	-4.47E-09	-4.47E-09	-4.47E-09	-4.47E-09	-4.47E-09	-4.47E-09	-4.47E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	5.70E-08	5.70E-08	5.70E-08	-6.40E-09	-6.40E-09	-6.40E-09	-4.00E-09	-4.00E-09

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

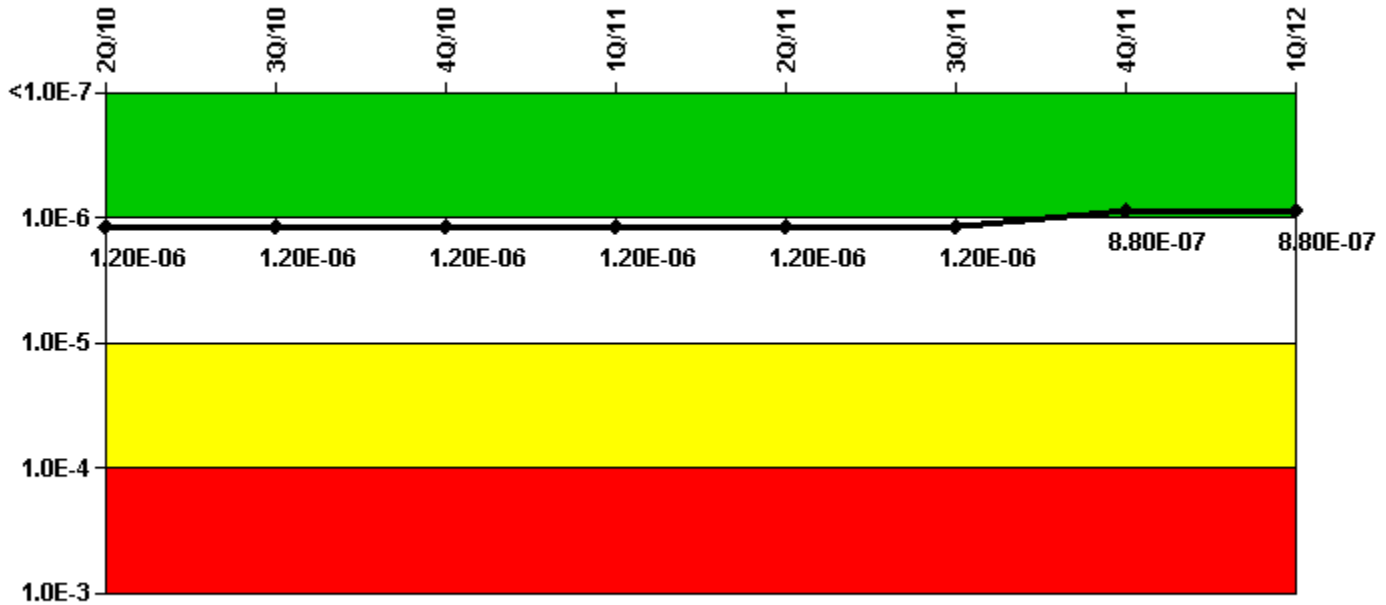

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	3.32E-07	3.73E-07	4.00E-07	3.88E-07	3.91E-07	3.92E-07	3.98E-07	3.91E-07
URI ( $\Delta$ CDF)	8.27E-07	8.08E-07	7.90E-07	7.81E-07	7.70E-07	7.69E-07	4.77E-07	4.89E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.20E-06	1.20E-06	1.20E-06	1.20E-06	1.20E-06	1.20E-06	8.80E-07	8.80E-07

Licensee Comments:

1Q/11: Changed PRA Parameter(s).

# Mitigating Systems Performance Index, Residual Heat Removal System

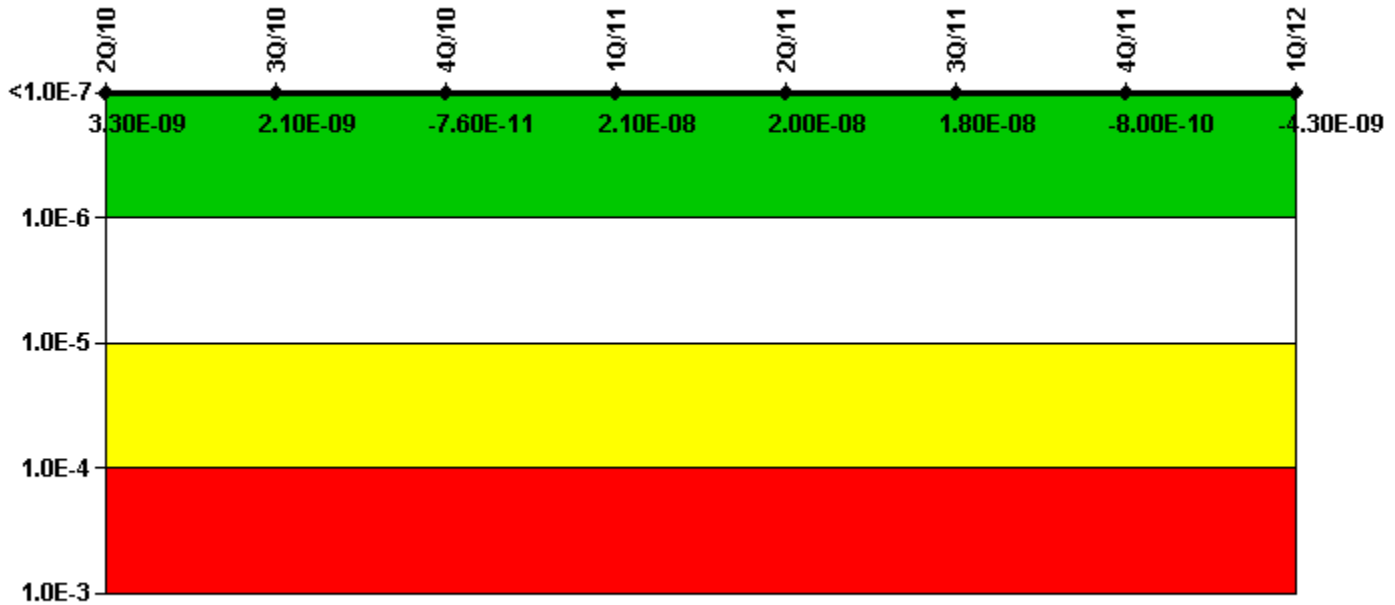

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	2.40E-08	2.37E-08	2.15E-08	4.24E-08	4.12E-08	3.93E-08	2.08E-08	1.73E-08
URI ( $\Delta$ CDF)	-2.08E-08	-2.16E-08	-2.16E-08	-2.16E-08	-2.16E-08	-2.16E-08	-2.16E-08	-2.16E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.30E-09	2.10E-09	-7.60E-11	2.10E-08	2.00E-08	1.80E-08	-8.00E-10	-4.30E-09

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

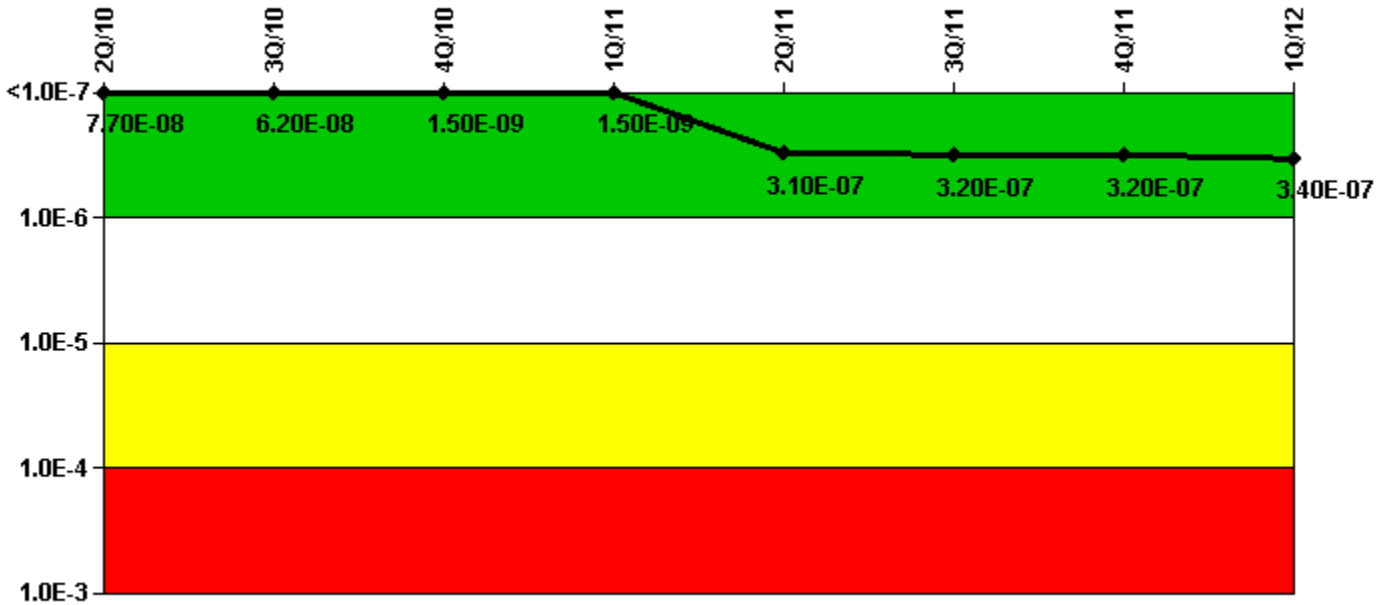


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	1.04E-07	8.88E-08	2.86E-08	2.86E-08	1.66E-08	1.94E-08	2.00E-08	4.50E-08
URI ( $\Delta$ CDF)	-2.75E-08	-2.71E-08	-2.71E-08	-2.71E-08	2.97E-07	2.97E-07	2.97E-07	2.97E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.70E-08	6.20E-08	1.50E-09	1.50E-09	3.10E-07	3.20E-07	3.20E-07	3.40E-07

Licensee Comments: none

# Reactor Coolant System Activity

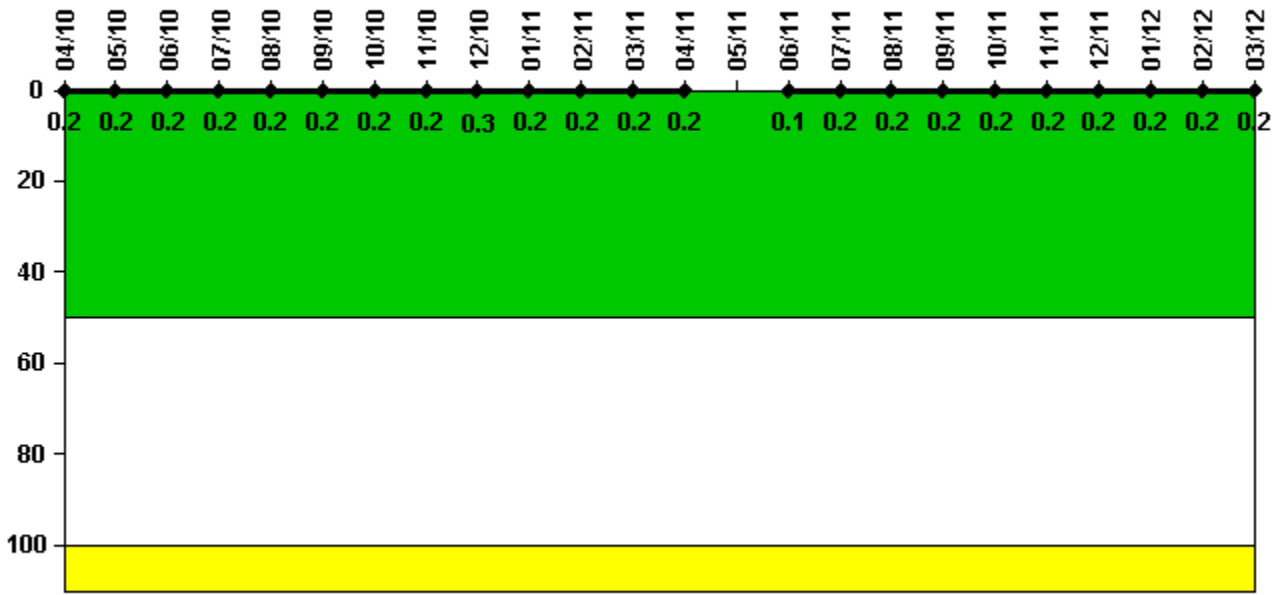


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum activity	0.001890	0.001880	0.001980	0.002120	0.002220	0.002190	0.002300	0.002290	0.002510	0.002260	0.002290	0.001880
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.2	0.2	0.2
Reactor Coolant System Activity	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12
Maximum activity	0.001920		0.001400	0.001590	0.001570	0.001760	0.001740	0.001840	0.001840	0.001940	0.001980	0.002300
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2		0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2

Licensee Comments: none

# Reactor Coolant System Leakage

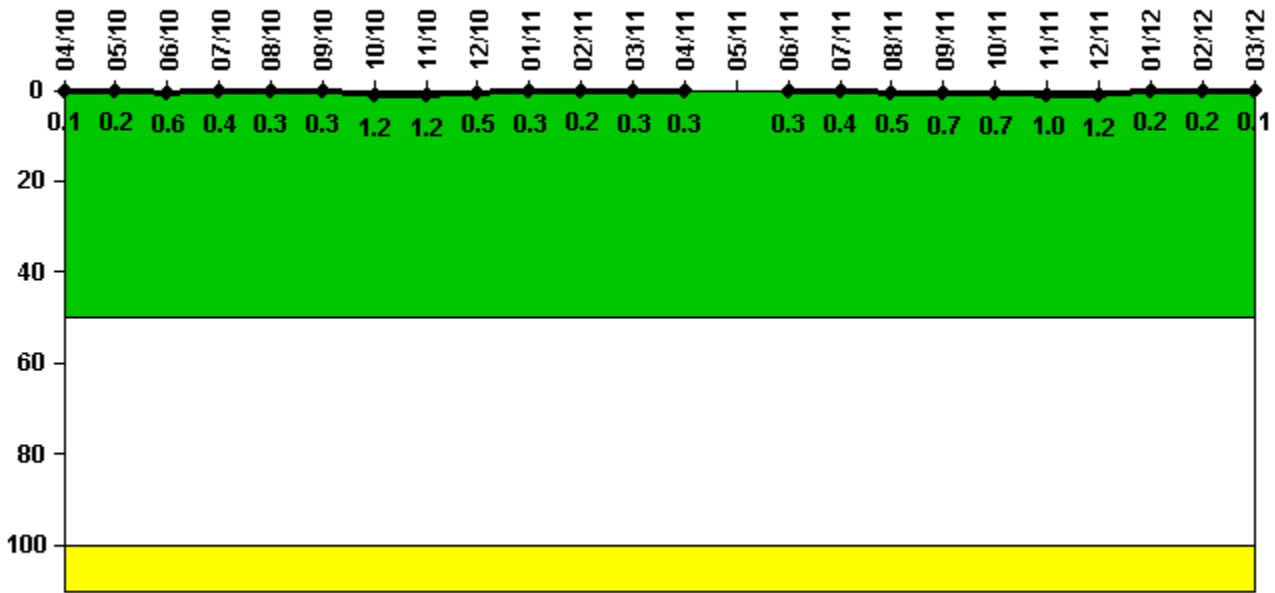


Thresholds: White > 50.0 Yellow > 100.0

## Notes

<b>Reactor Coolant System Leakage</b>	<b>4/10</b>	<b>5/10</b>	<b>6/10</b>	<b>7/10</b>	<b>8/10</b>	<b>9/10</b>	<b>10/10</b>	<b>11/10</b>	<b>12/10</b>	<b>1/11</b>	<b>2/11</b>	<b>3/11</b>
Maximum leakage	0.011	0.022	0.056	0.041	0.026	0.028	0.124	0.119	0.050	0.026	0.017	0.028
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.2	0.6	0.4	0.3	0.3	1.2	1.2	0.5	0.3	0.2	0.3
<b>Reactor Coolant System Leakage</b>	<b>4/11</b>	<b>5/11</b>	<b>6/11</b>	<b>7/11</b>	<b>8/11</b>	<b>9/11</b>	<b>10/11</b>	<b>11/11</b>	<b>12/11</b>	<b>1/12</b>	<b>2/12</b>	<b>3/12</b>
Maximum leakage	0.029		0.029	0.038	0.050	0.066	0.069	0.101	0.120	0.020	0.017	0.011
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3		0.3	0.4	0.5	0.7	0.7	1.0	1.2	0.2	0.2	0.1

Licensee Comments: none

## Drill/Exercise Performance

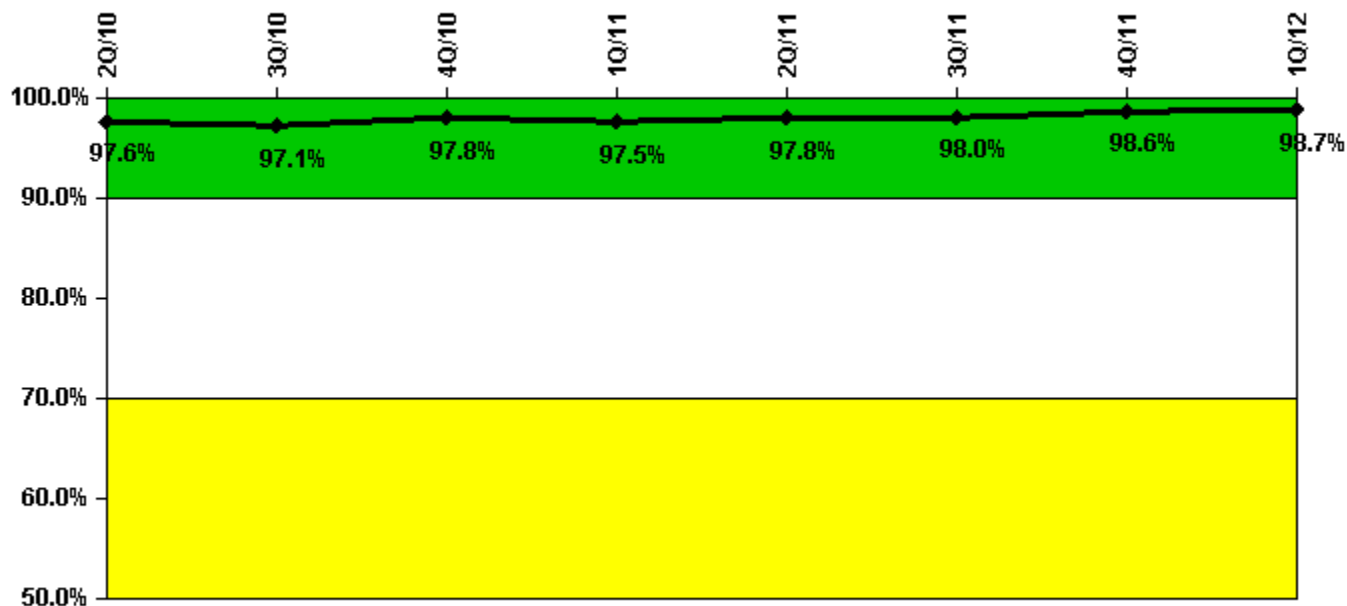

Thresholds: White < 90.0% Yellow < 70.0%

### Notes


Drill/Exercise Performance	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Successful opportunities	12.0	33.0	103.0	16.0	6.0	30.0	69.0	32.0
Total opportunities	12.0	34.0	103.0	16.0	6.0	30.0	71.0	33.0
Indicator value	97.6%	97.1%	97.8%	97.5%	97.8%	98.0%	98.6%	98.7%

Licensee Comments:

4Q/11: Upon review of previously submitted data for the month of December 2011, it was determined that 2 additional opportunities and 2 additional successes existed.

2Q/10: Incorrect data was submitted. Two additional successful opportunities were found during review of data. The color of this performance indicator remains green.

## ERO Drill Participation

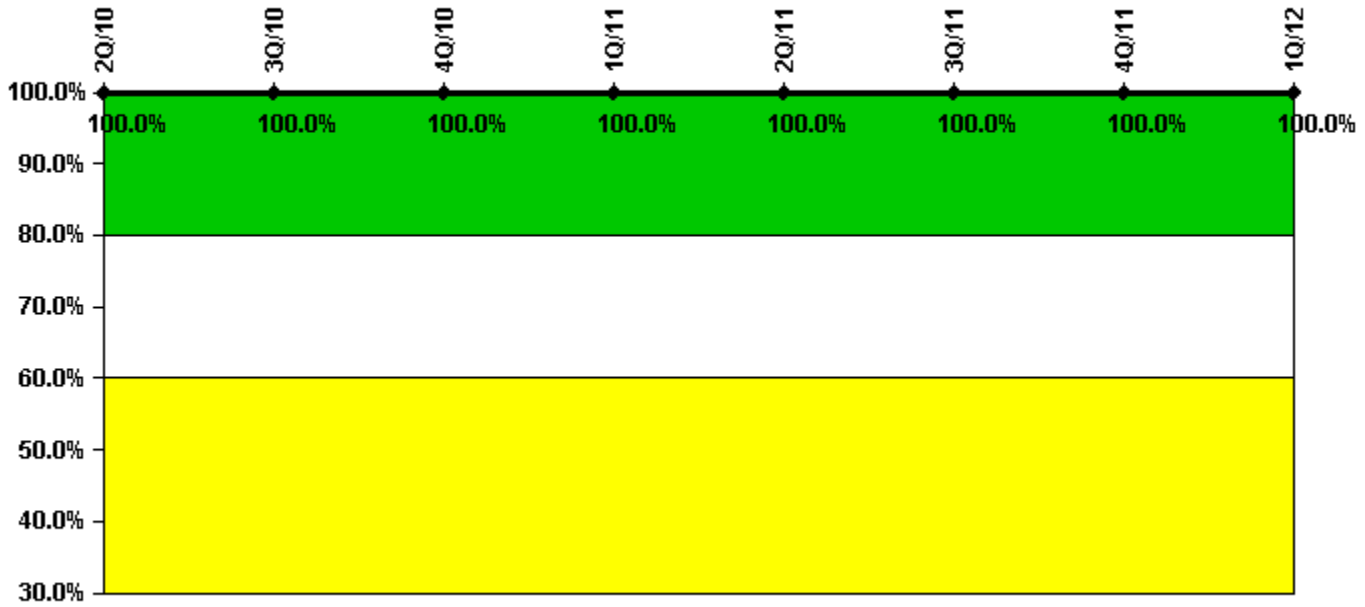


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Participating Key personnel	56.0	55.0	63.0	63.0	55.0	58.0	60.0	60.0
Total Key personnel	56.0	55.0	63.0	63.0	55.0	58.0	60.0	60.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

# Alert & Notification System

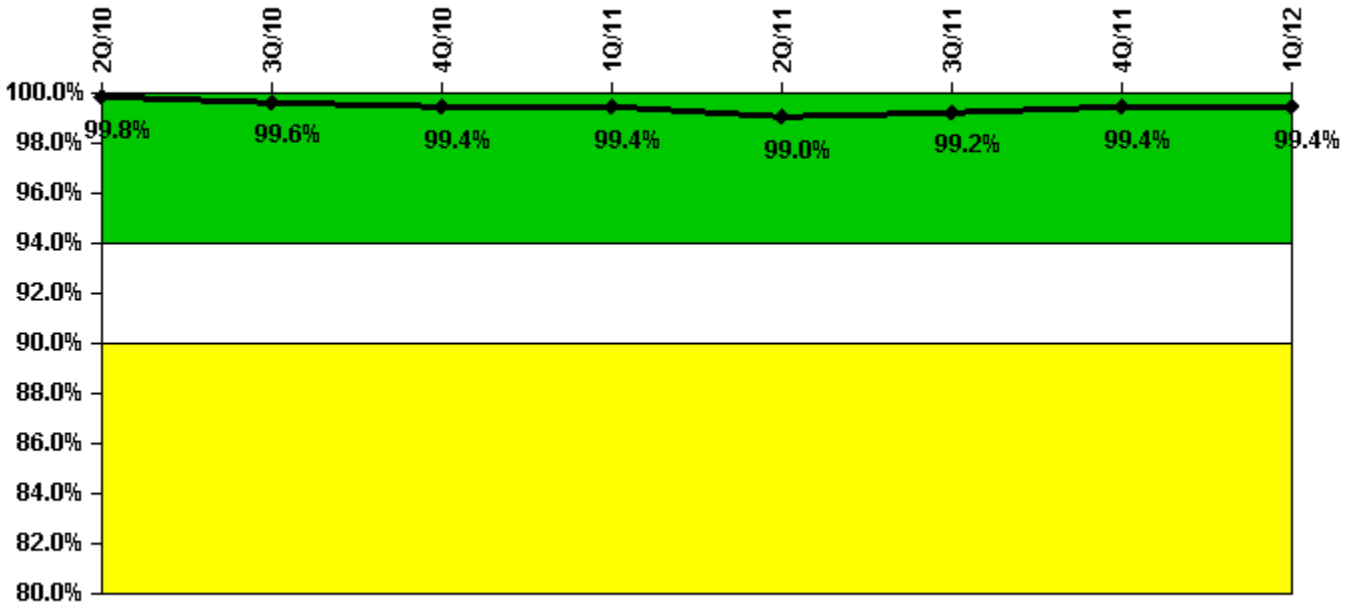


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Successful siren-tests	1245	1234	1239	1245	1226	1242	1246	1247
Total sirens-tests	1248	1248	1248	1248	1248	1248	1246	1248
Indicator value	99.8%	99.6%	99.4%	99.4%	99.0%	99.2%	99.4%	99.4%

Licensee Comments: none

# Occupational Exposure Control Effectiveness

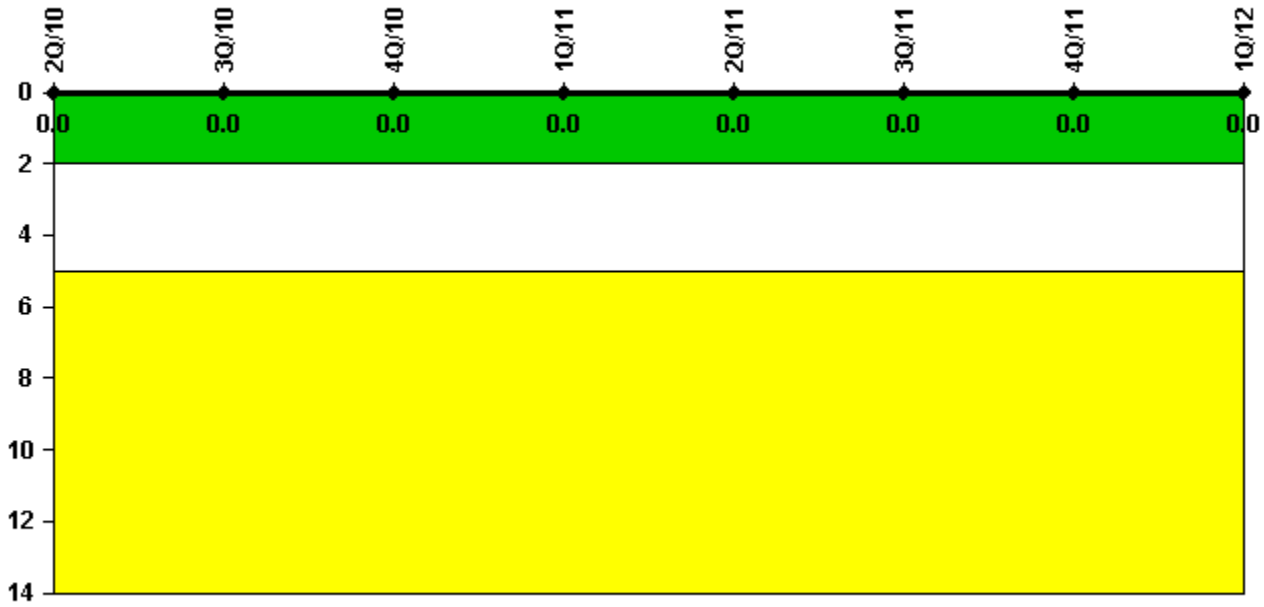


Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

## RETS/ODCM Radiological Effluent

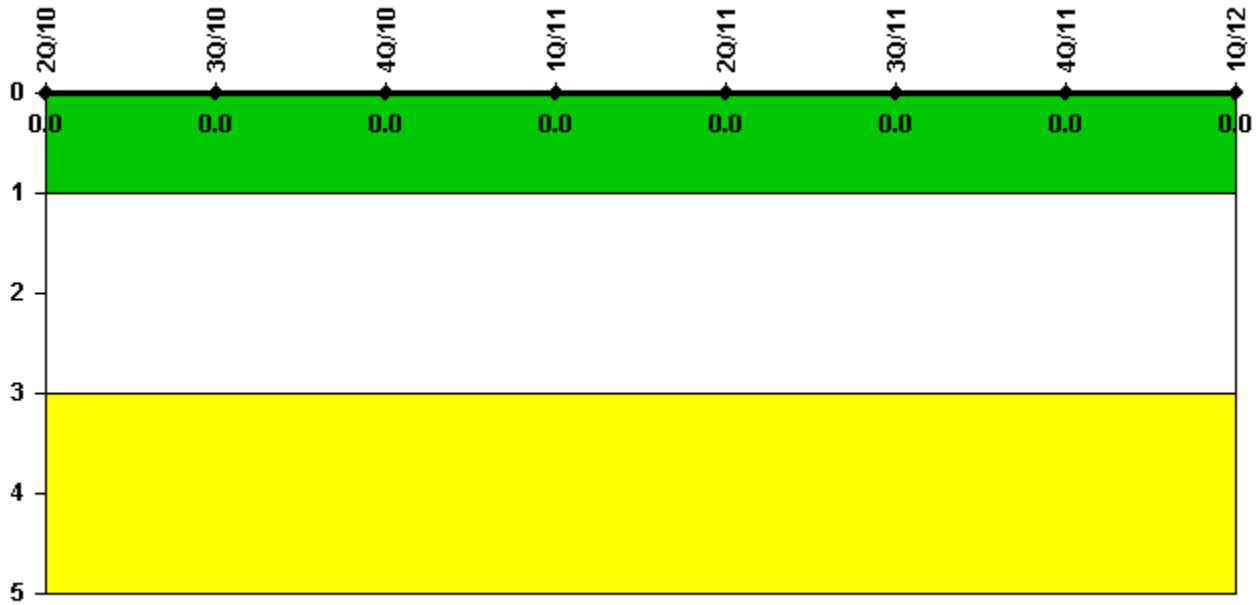

Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.