


La Salle 2

1Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

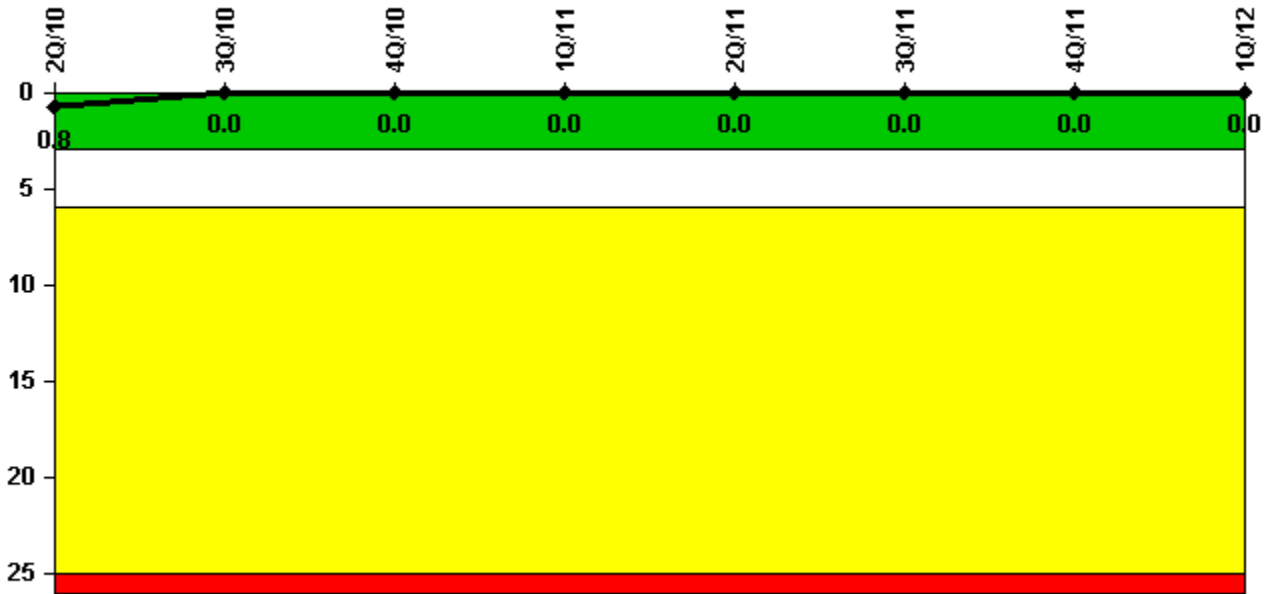


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|----------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2208.0 | 2209.0 | 1666.4 | 2184.0 | 2208.0 | 2209.0 | 2183.0 |
| Indicator value | 0.8 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

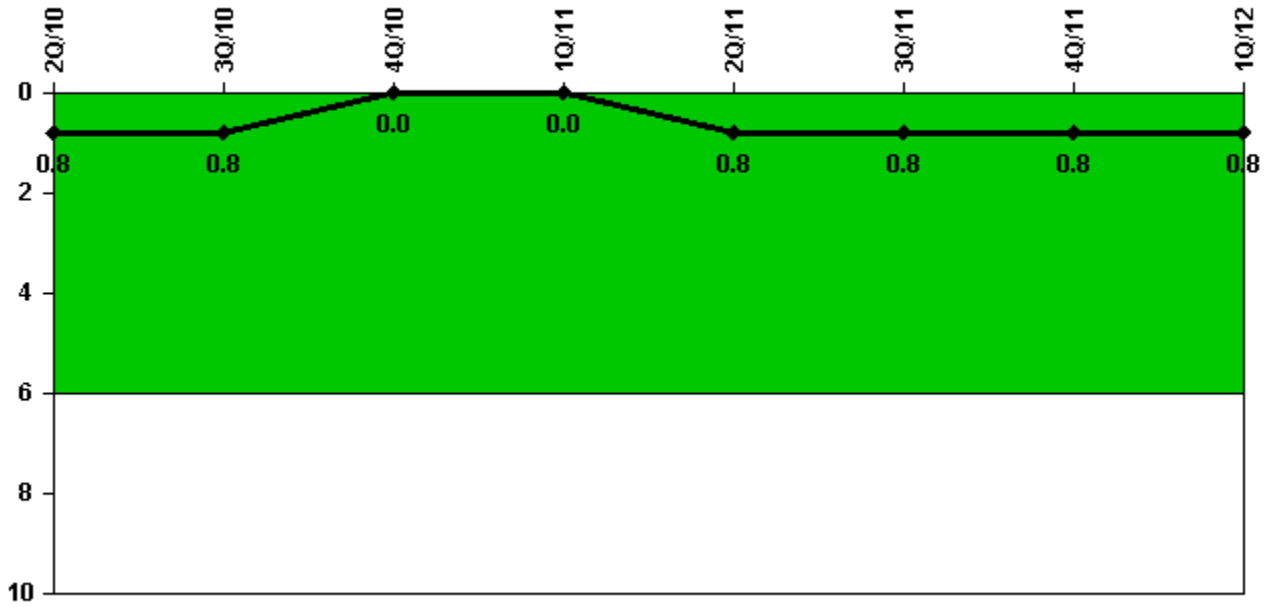

Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-----------------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 0 | 0 | 0 | 1.0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2208.0 | 2209.0 | 1666.4 | 2184.0 | 2208.0 | 2209.0 | 2183.0 |
| Indicator value | 0.8 | 0.8 | 0 | 0 | 0.8 | 0.8 | 0.8 | 0.8 |

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (BWR)

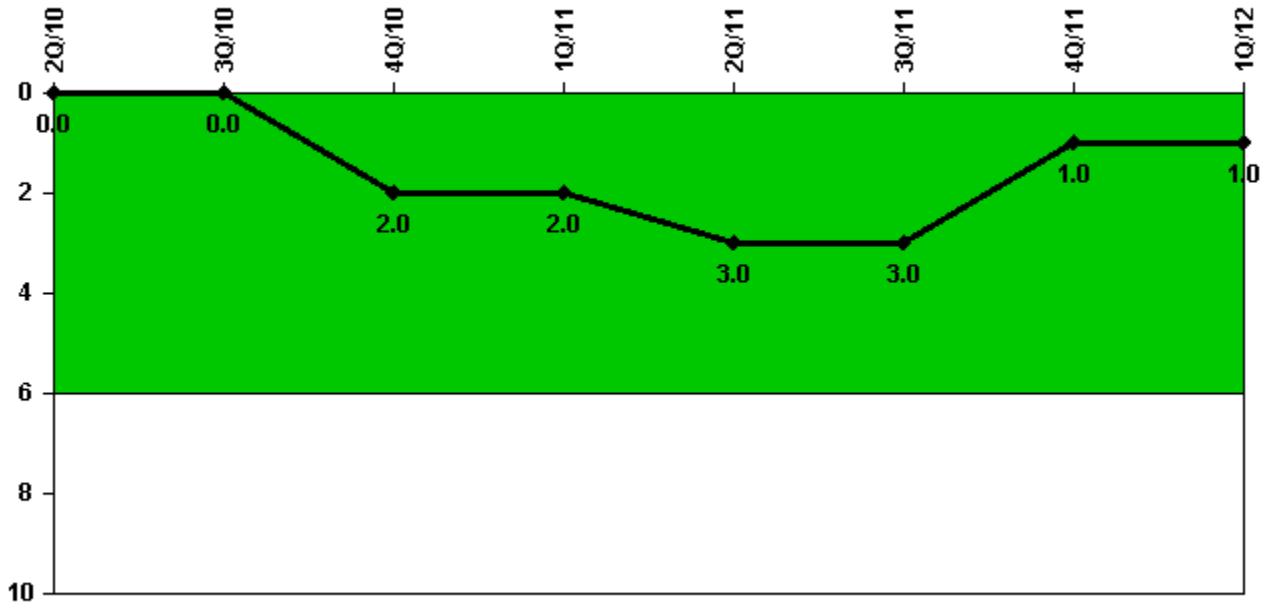

Thresholds: White > 6.0


Notes

| Safety System Functional Failures (BWR) | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-----------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 0 | 2 | 0 | 1 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 2 | 2 | 3 | 3 | 1 | 1 |

Licensee Comments:

4Q/10: LER 374-10001

Mitigating Systems Performance Index, Emergency AC Power System

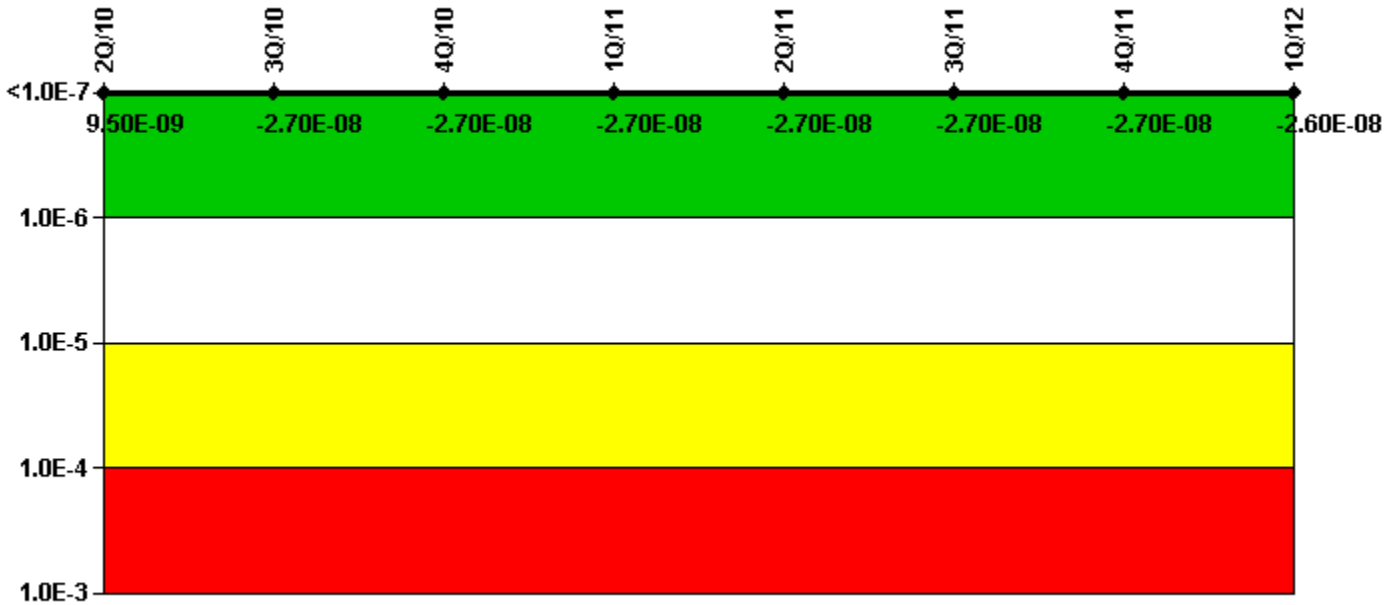


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-----------------------------------------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -2.23E-09 | -3.99E-09 | -3.99E-09 | -3.98E-09 | -4.09E-09 | -4.09E-09 | -4.08E-09 | -4.07E-09 |
| URI (Δ CDF) | 1.17E-08 | -2.25E-08 | -2.25E-08 | -2.25E-08 | -2.25E-08 | -2.25E-08 | -2.25E-08 | -2.24E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 9.50E-09 | -2.70E-08 | -2.70E-08 | -2.70E-08 | -2.70E-08 | -2.70E-08 | -2.70E-08 | -2.60E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

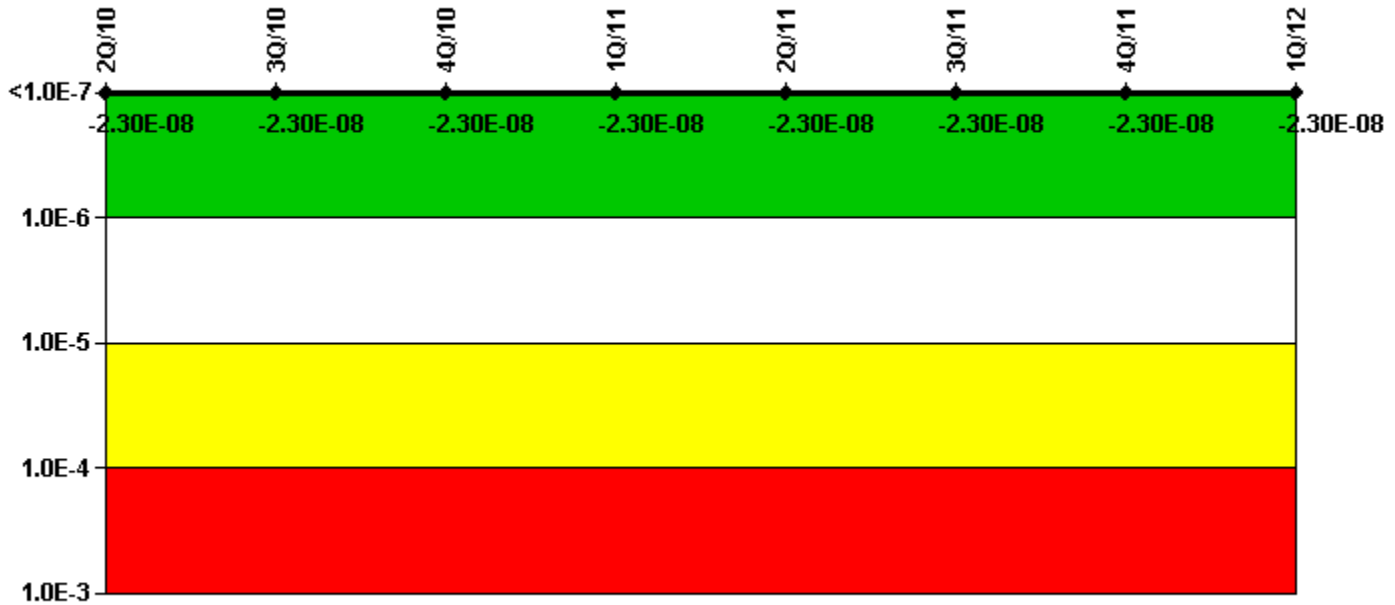


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|----------------------------------------------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 | -2.20E-09 |
| URI (Δ CDF) | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.08E-08 | -2.05E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

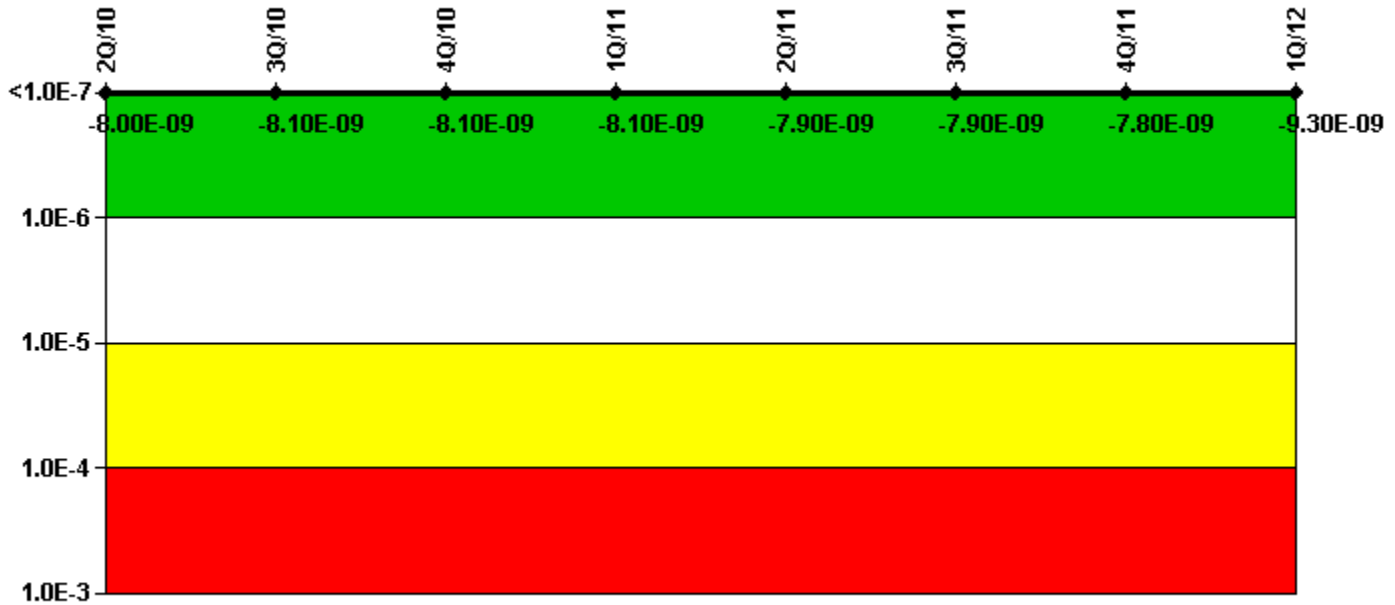


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-----------------------------------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.23E-09 | -1.30E-09 | -1.30E-09 | -1.28E-09 | -1.17E-09 | -1.12E-09 | -9.83E-10 | -2.54E-09 |
| URI (Δ CDF) | -6.77E-09 | -6.78E-09 | -6.78E-09 | -6.78E-09 | -6.78E-09 | -6.78E-09 | -6.78E-09 | -6.78E-09 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -8.00E-09 | -8.10E-09 | -8.10E-09 | -8.10E-09 | -7.90E-09 | -7.90E-09 | -7.80E-09 | -9.30E-09 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

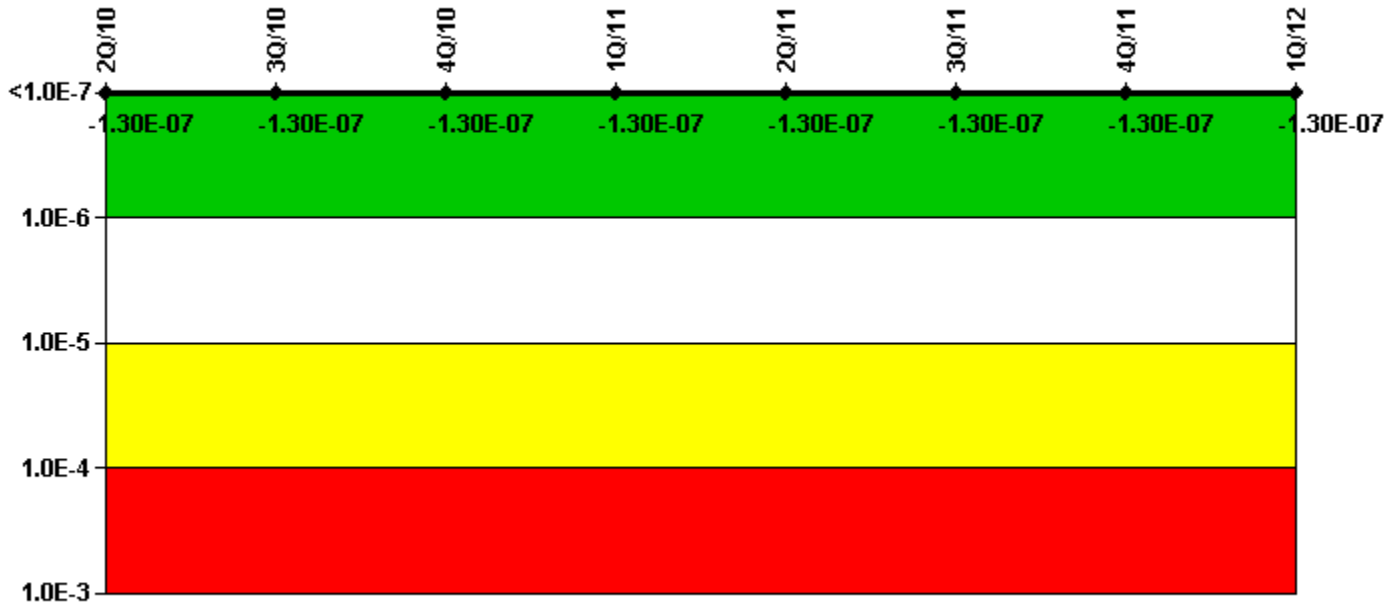


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|--------------------------------------------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 | -4.99E-08 |
| URI (Δ CDF) | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 | -8.15E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 | -1.30E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

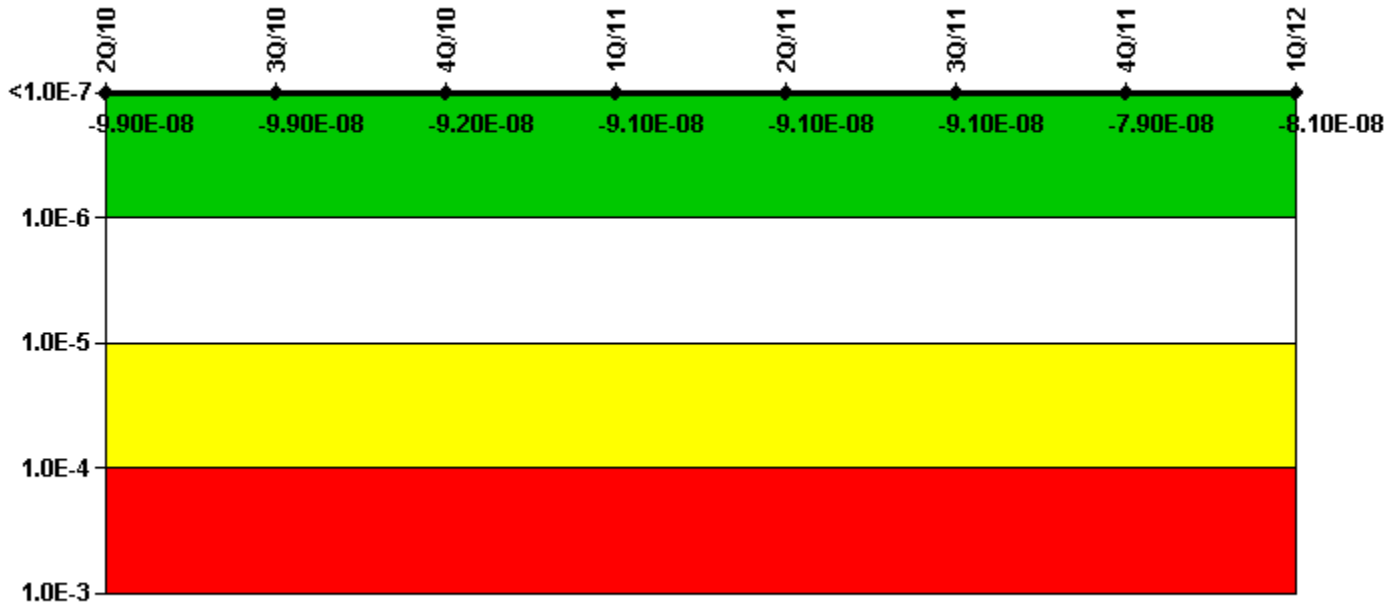


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-------------------------------------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 4.92E-09 | 4.92E-09 | 1.17E-08 | 1.31E-08 | 1.31E-08 | 1.31E-08 | 2.51E-08 | 2.35E-08 |
| URI (Δ CDF) | -1.04E-07 | -1.04E-07 | -1.04E-07 | -1.04E-07 | -1.04E-07 | -1.04E-07 | -1.05E-07 | -1.05E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -9.90E-08 | -9.90E-08 | -9.20E-08 | -9.10E-08 | -9.10E-08 | -9.10E-08 | -7.90E-08 | -8.10E-08 |

Licensee Comments: none

Reactor Coolant System Activity

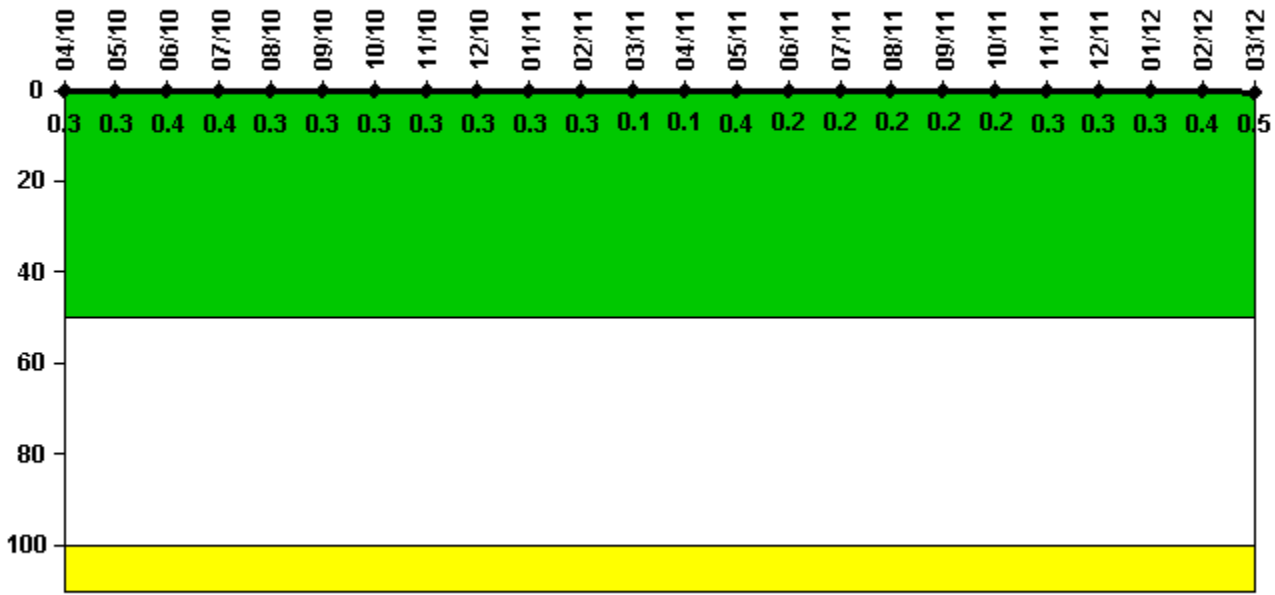


Thresholds: White > 50.0 Yellow > 100.0

Notes

| | | | | | | | | | | | | |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Reactor Coolant System Activity | 4/10 | 5/10 | 6/10 | 7/10 | 8/10 | 9/10 | 10/10 | 11/10 | 12/10 | 1/11 | 2/11 | 3/11 |
| Maximum activity | 0.000595 | 0.000556 | 0.000836 | 0.000713 | 0.000601 | 0.000596 | 0.000597 | 0.000592 | 0.000622 | 0.000559 | 0.000572 | 0.000177 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0.3 | 0.3 | 0.4 | 0.4 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.1 |
| Reactor Coolant System Activity | 4/11 | 5/11 | 6/11 | 7/11 | 8/11 | 9/11 | 10/11 | 11/11 | 12/11 | 1/12 | 2/12 | 3/12 |
| Maximum activity | 0.000159 | 0.000726 | 0.000318 | 0.000417 | 0.000349 | 0.000374 | 0.000454 | 0.000518 | 0.000626 | 0.000635 | 0.000788 | 0.000994 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0.1 | 0.4 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.3 | 0.3 | 0.3 | 0.4 | 0.5 |

Licensee Comments: none

Reactor Coolant System Leakage

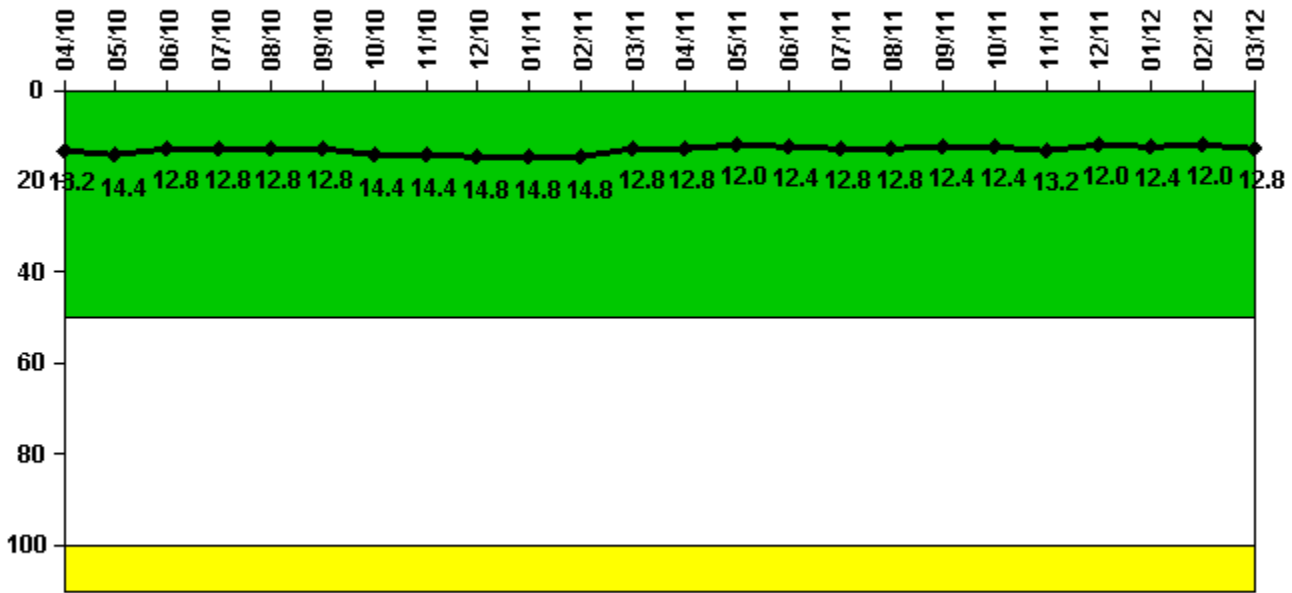


Thresholds: White > 50.0 Yellow > 100.0

Notes

| | | | | | | | | | | | | |
|---------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Reactor Coolant System Leakage | 4/10 | 5/10 | 6/10 | 7/10 | 8/10 | 9/10 | 10/10 | 11/10 | 12/10 | 1/11 | 2/11 | 3/11 |
| Maximum leakage | 3.300 | 3.600 | 3.200 | 3.200 | 3.200 | 3.200 | 3.600 | 3.600 | 3.700 | 3.700 | 3.700 | 3.200 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 13.2 | 14.4 | 12.8 | 12.8 | 12.8 | 12.8 | 14.4 | 14.4 | 14.8 | 14.8 | 14.8 | 12.8 |
| Reactor Coolant System Leakage | 4/11 | 5/11 | 6/11 | 7/11 | 8/11 | 9/11 | 10/11 | 11/11 | 12/11 | 1/12 | 2/12 | 3/12 |
| Maximum leakage | 3.200 | 3.000 | 3.100 | 3.200 | 3.200 | 3.100 | 3.100 | 3.300 | 3.000 | 3.100 | 3.000 | 3.200 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 12.8 | 12.0 | 12.4 | 12.8 | 12.8 | 12.4 | 12.4 | 13.2 | 12.0 | 12.4 | 12.0 | 12.8 |

Licensee Comments: none

Drill/Exercise Performance

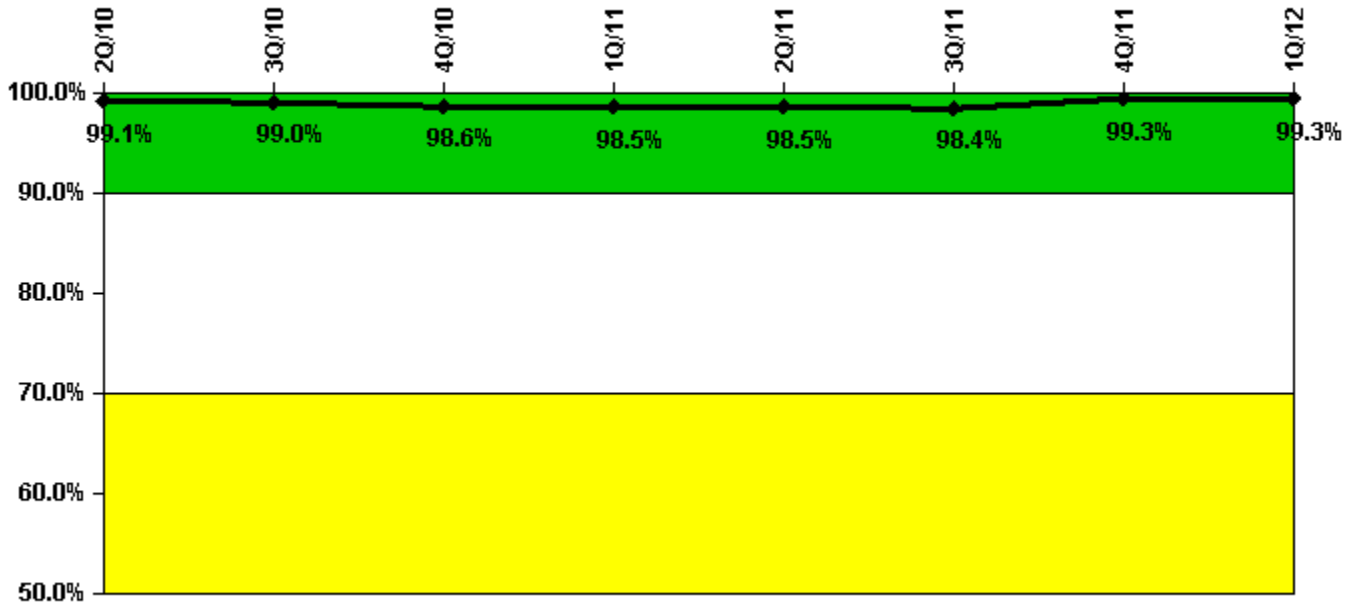


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 55.0 | 16.0 | 36.0 | 0 | 40.0 | 39.0 | 64.0 | 24.0 |
| Total opportunities | 56.0 | 16.0 | 37.0 | 0 | 40.0 | 39.0 | 64.0 | 24.0 |
| | | | | | | | | |
| Indicator value | 99.1% | 99.0% | 98.6% | 98.5% | 98.5% | 98.4% | 99.3% | 99.3% |

Licensee Comments: none

ERO Drill Participation

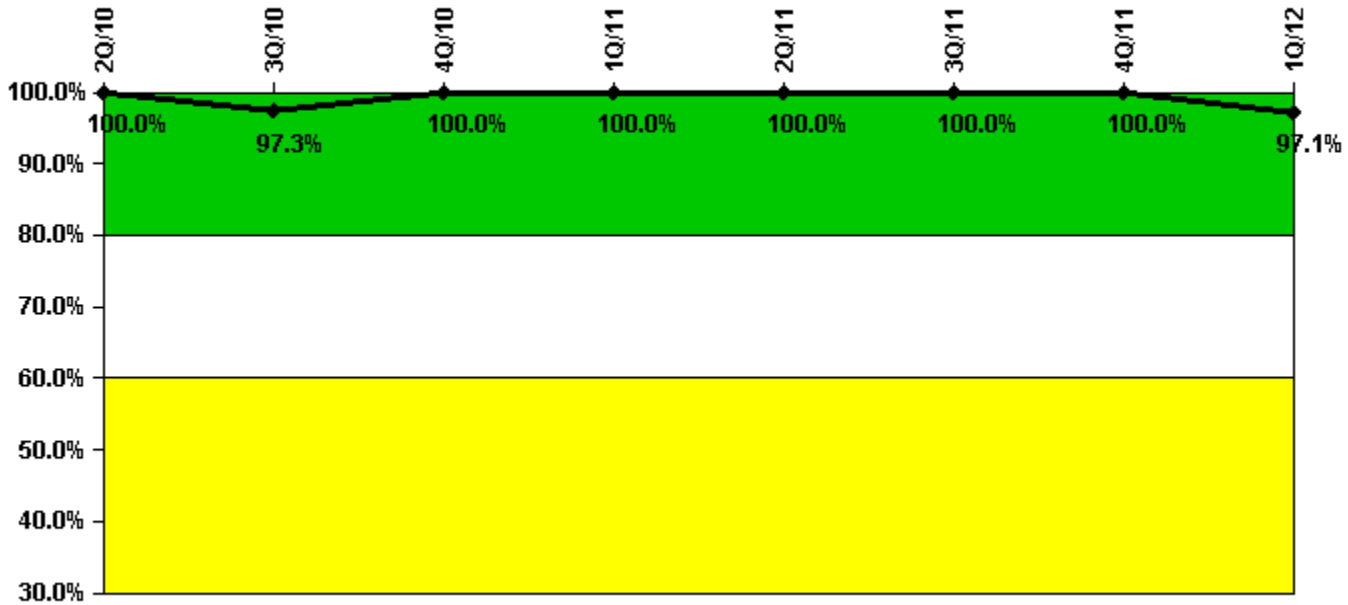


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-----------------------------|--------|-------|--------|--------|--------|--------|--------|-------|
| Participating Key personnel | 77.0 | 72.0 | 70.0 | 65.0 | 63.0 | 68.0 | 70.0 | 68.0 |
| Total Key personnel | 77.0 | 74.0 | 70.0 | 65.0 | 63.0 | 68.0 | 70.0 | 70.0 |
| Indicator value | 100.0% | 97.3% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 97.1% |

Licensee Comments: none

Alert & Notification System

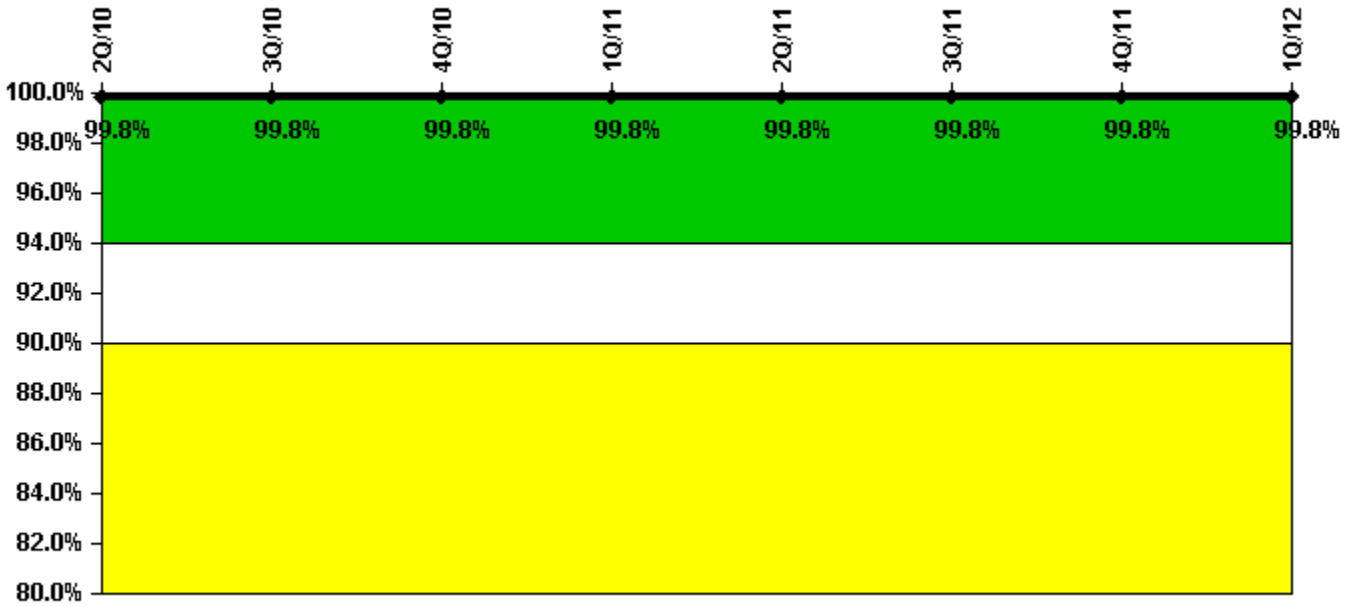

Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 2167 | 2205 | 2210 | 2173 | 2170 | 2170 | 2171 | 2207 |
| Total sirens-tests | 2176 | 2210 | 2210 | 2176 | 2176 | 2176 | 2176 | 2210 |
| | | | | | | | | |
| Indicator value | 99.8% | 99.8% | 99.8% | 99.8% | 99.8% | 99.8% | 99.8% | 99.8% |

Licensee Comments: none

Occupational Exposure Control Effectiveness




Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|---------------------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent

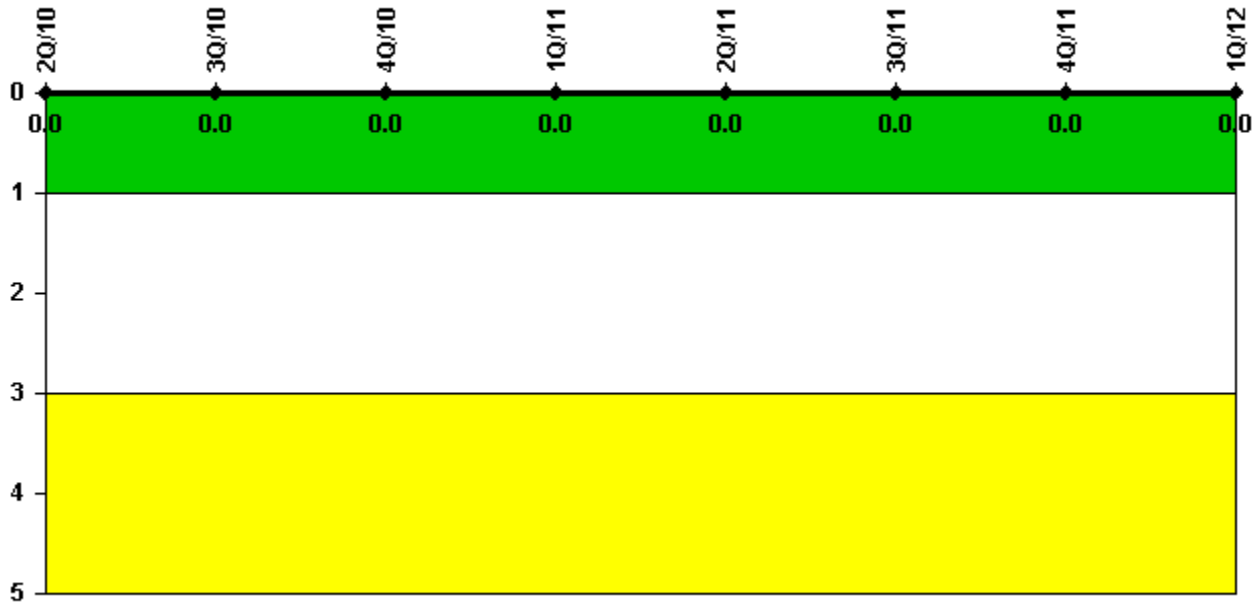

Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 2Q/10 | 3Q/10 | 4Q/10 | 1Q/11 | 2Q/11 | 3Q/11 | 4Q/11 | 1Q/12 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

[Security](#) information not publicly available.