


# Ocone 1

## 1Q/2012 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

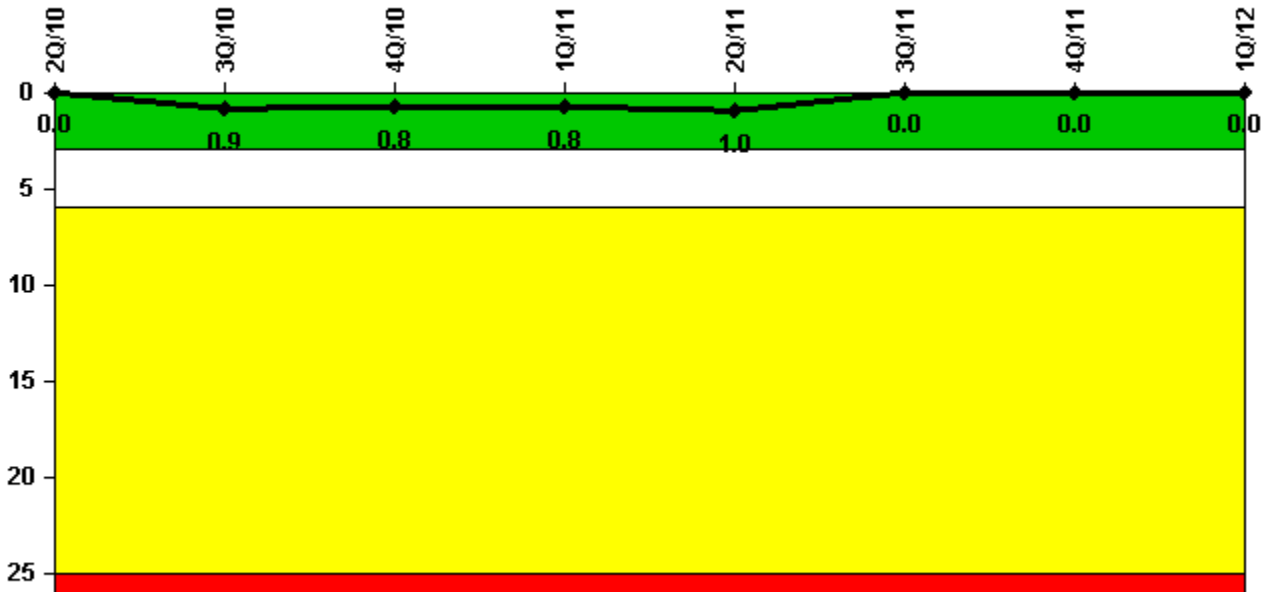


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Unplanned scrams	0	1.0	0	0	0	0	0	0
Critical hours	2184.0	2170.9	2209.0	1976.6	553.6	2208.0	2209.0	2183.0
Indicator value	0	0.9	0.8	0.8	1.0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

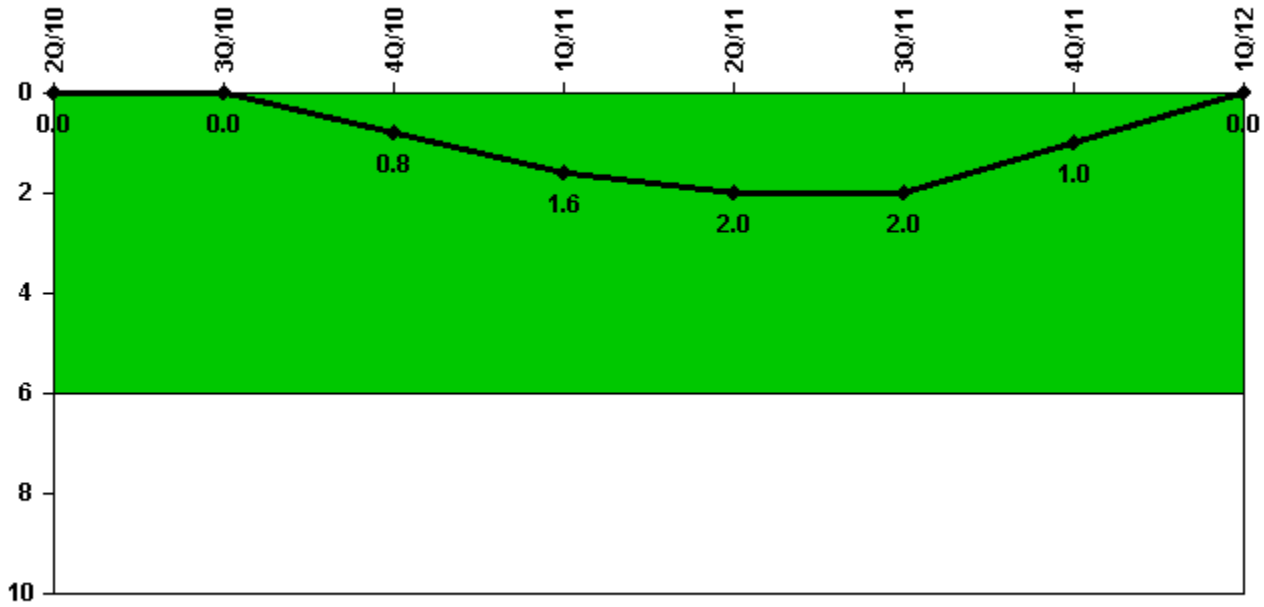

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Unplanned power changes	0	0	1.0	1.0	0	0	0	0
Critical hours	2184.0	2170.9	2209.0	1976.6	553.6	2208.0	2209.0	2183.0
Indicator value	0	0	0.8	1.6	2.0	2.0	1.0	0

Licensee Comments: none

## Unplanned Scrams with Complications



Thresholds: White > 1.0


### Notes

Unplanned Scrams with Complications	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

---

## Safety System Functional Failures (PWR)

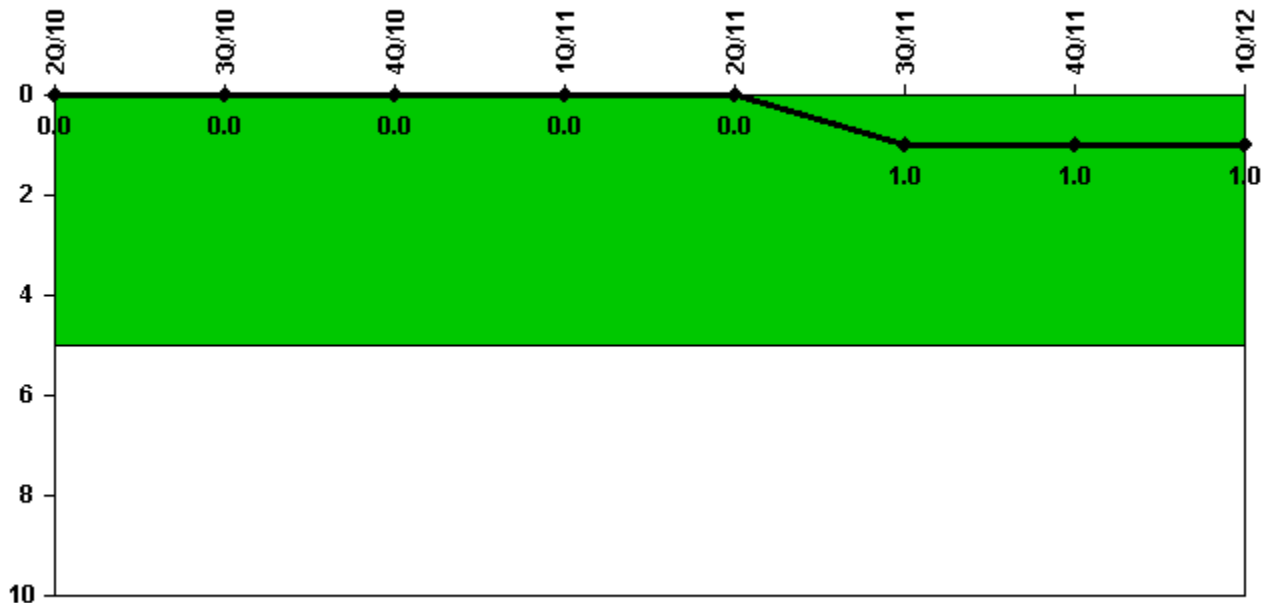

Thresholds: White > 5.0

### Notes


Safety System Functional Failures (PWR)	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Safety System Functional Failures	0	0	0	0	0	1	0	0
Indicator value	0	0	0	0	0	1	1	1

Licensee Comments:

3Q/11: Unit 1 LER 269/2011-05, Reactor Protection System Overpower Flux/Flow Imbalance Channels Inoperable

---

# Mitigating Systems Performance Index, Emergency AC Power System

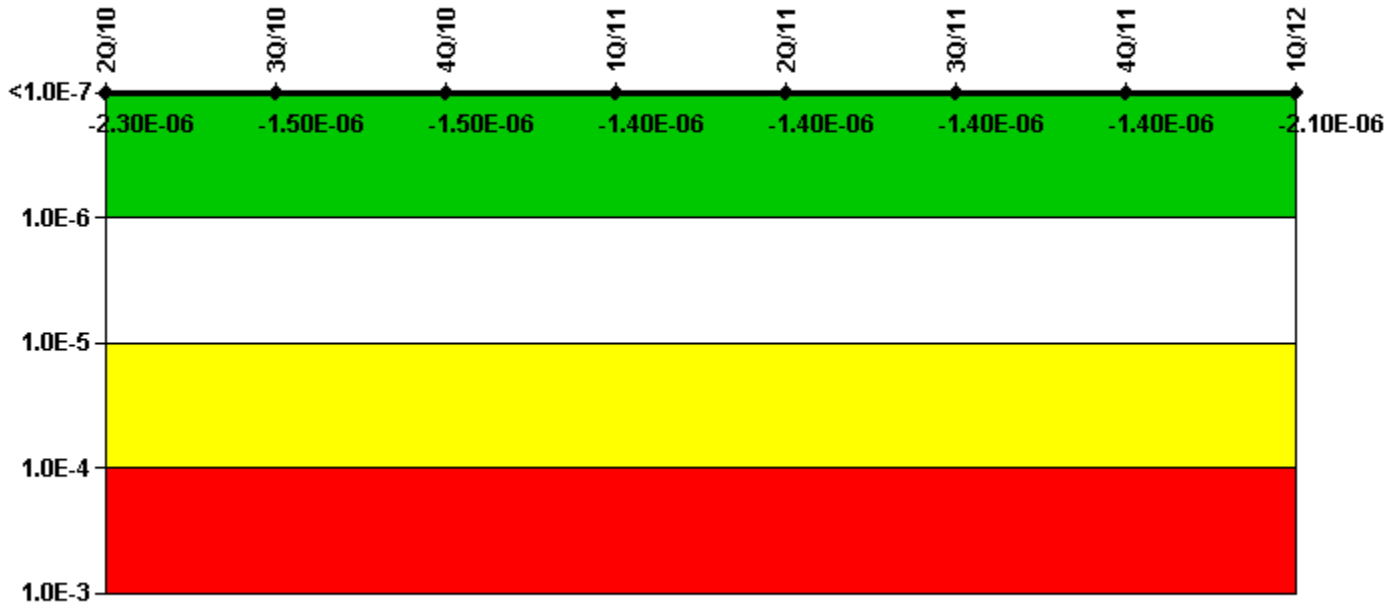

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	-2.18E-07	3.52E-07	3.75E-07	6.36E-07	5.98E-07	4.57E-07	5.01E-07	-2.76E-08
URI ( $\Delta$ CDF)	-2.04E-06	-1.86E-06	-1.86E-06	-2.04E-06	-2.04E-06	-1.86E-06	-1.86E-06	-2.04E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-06	-1.50E-06	-1.50E-06	-1.40E-06	-1.40E-06	-1.40E-06	-1.40E-06	-2.10E-06

Licensee Comments:

1Q/12: Changed PRA Parameter(s). Grayed unckecked MSPI & URI being investigated, no errors in Deriavtion Reports

4Q/11: Changed PRA Parameter(s).

3Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).


1Q/11: Changed PRA Parameter(s).

4Q/10: Changed PRA Parameter(s).

3Q/10: Changed PRA Parameter(s).

2Q/10: Changed PRA Parameter(s).

# Mitigating Systems Performance Index, High Pressure Injection System

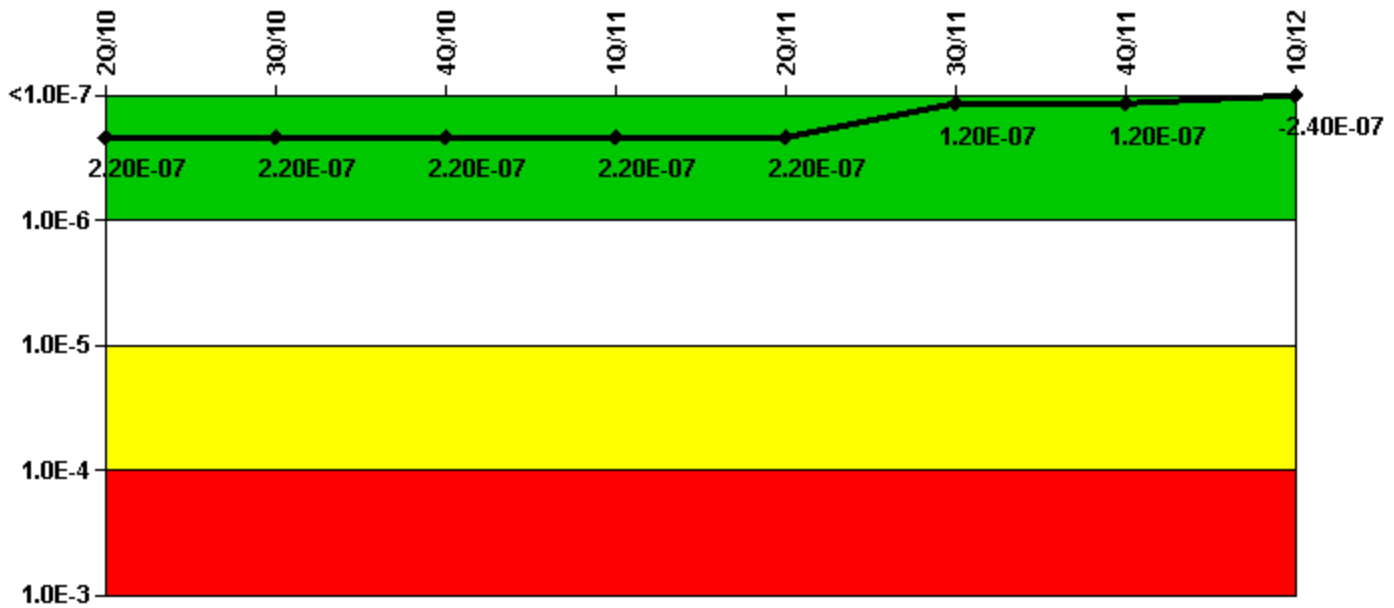


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	-2.72E-08	-2.72E-08	-2.72E-08	-2.67E-08	-2.58E-08	-3.16E-08	-3.16E-08	-6.19E-08
URI ( $\Delta$ CDF)	2.50E-07	2.50E-07	2.50E-07	2.50E-07	2.50E-07	1.50E-07	1.50E-07	-1.73E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.20E-07	2.20E-07	2.20E-07	2.20E-07	2.20E-07	1.20E-07	1.20E-07	-2.40E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

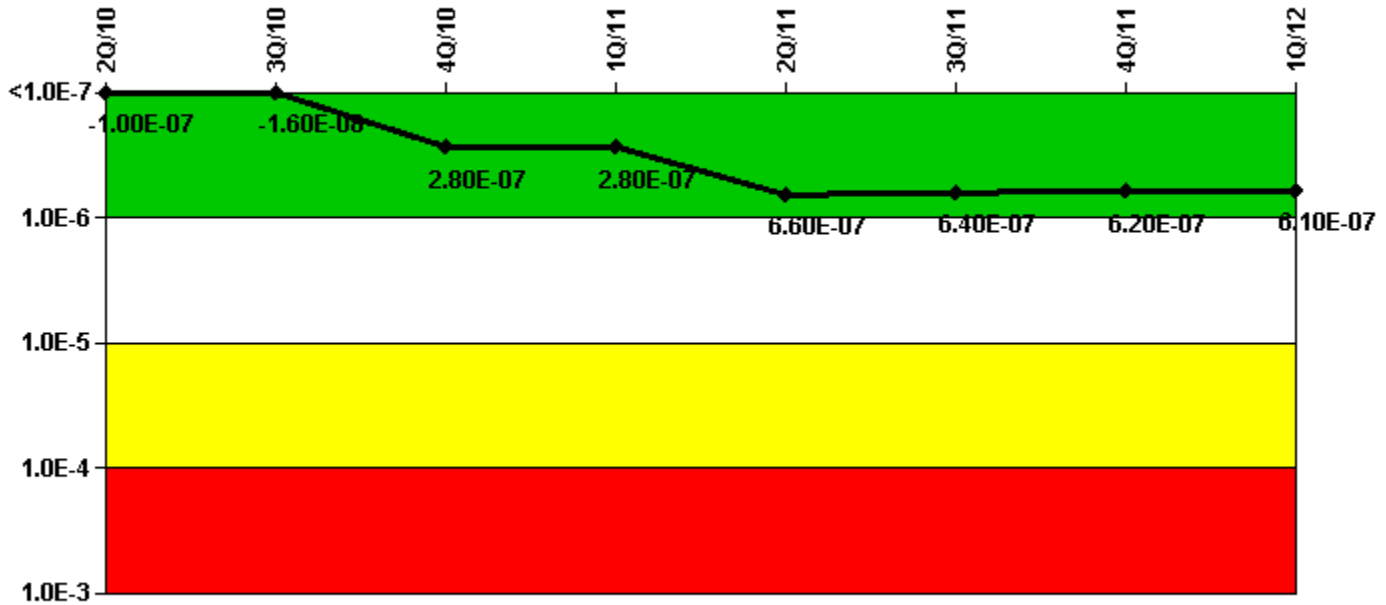


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	8.44E-08	1.72E-07	1.82E-07	1.81E-07	1.41E-07	1.21E-07	9.94E-08	9.57E-08
URI ( $\Delta$ CDF)	-1.88E-07	-1.88E-07	1.03E-07	1.03E-07	5.19E-07	5.19E-07	5.19E-07	5.19E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.00E-07	-1.60E-08	2.80E-07	2.80E-07	6.60E-07	6.40E-07	6.20E-07	6.10E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

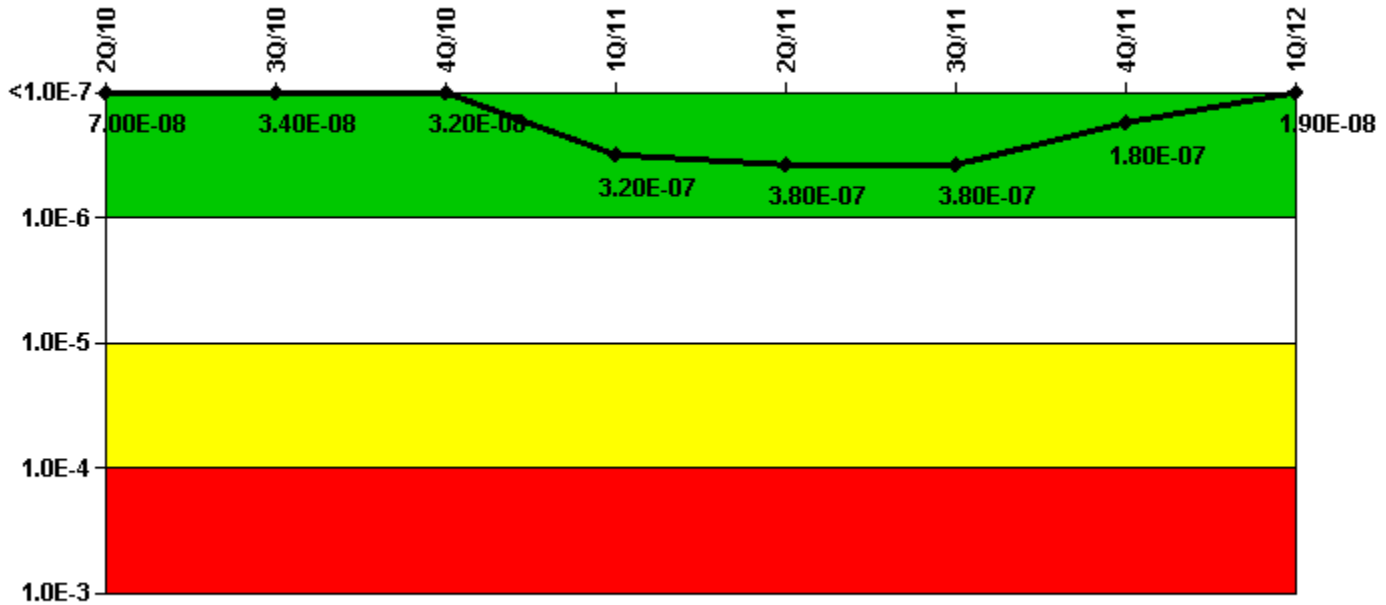

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	1.95E-07	1.59E-07	1.57E-07	4.44E-07	5.06E-07	5.07E-07	3.04E-07	1.45E-07
URI ( $\Delta$ CDF)	-1.25E-07	-1.25E-07	-1.25E-07	-1.25E-07	-1.25E-07	-1.25E-07	-1.25E-07	-1.25E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.00E-08	3.40E-08	3.20E-08	3.20E-07	3.80E-07	3.80E-07	1.80E-07	1.90E-08

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

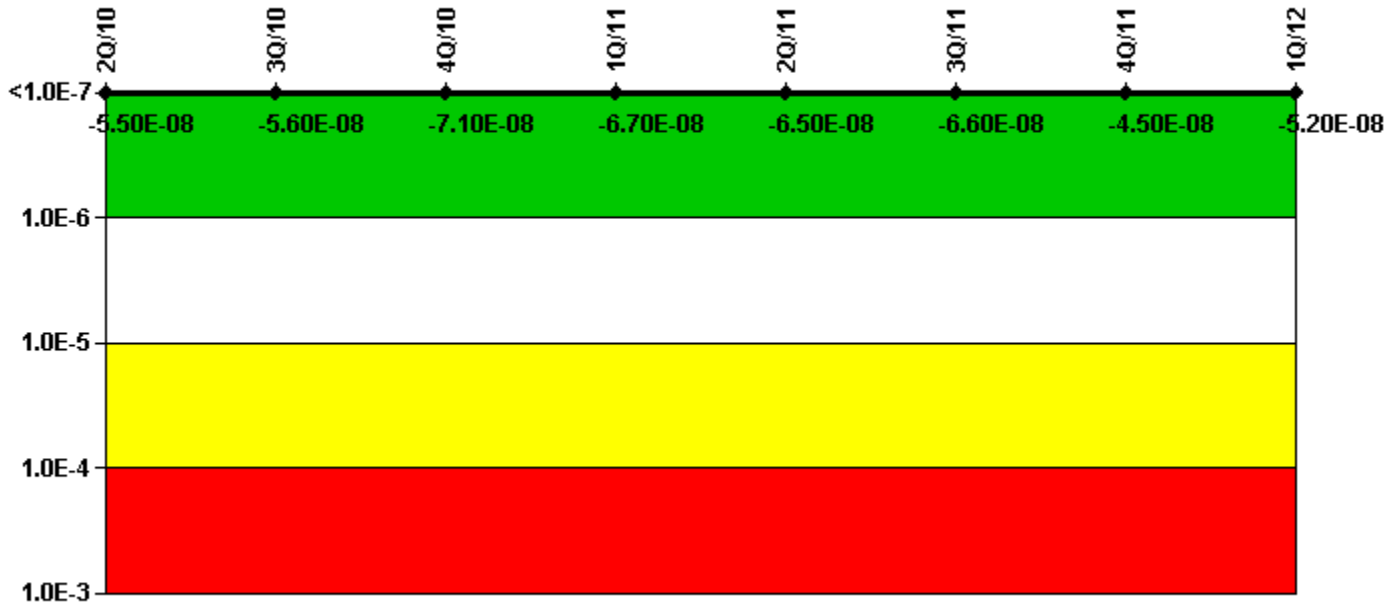


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
UAI ( $\Delta$ CDF)	-1.27E-08	-1.35E-08	-2.94E-08	-2.51E-08	-2.30E-08	-2.41E-08	-3.38E-09	-9.75E-09
URI ( $\Delta$ CDF)	-4.20E-08	-4.20E-08	-4.20E-08	-4.20E-08	-4.20E-08	-4.20E-08	-4.20E-08	-4.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.50E-08	-5.60E-08	-7.10E-08	-6.70E-08	-6.50E-08	-6.60E-08	-4.50E-08	-5.20E-08

Licensee Comments: none

# Reactor Coolant System Activity

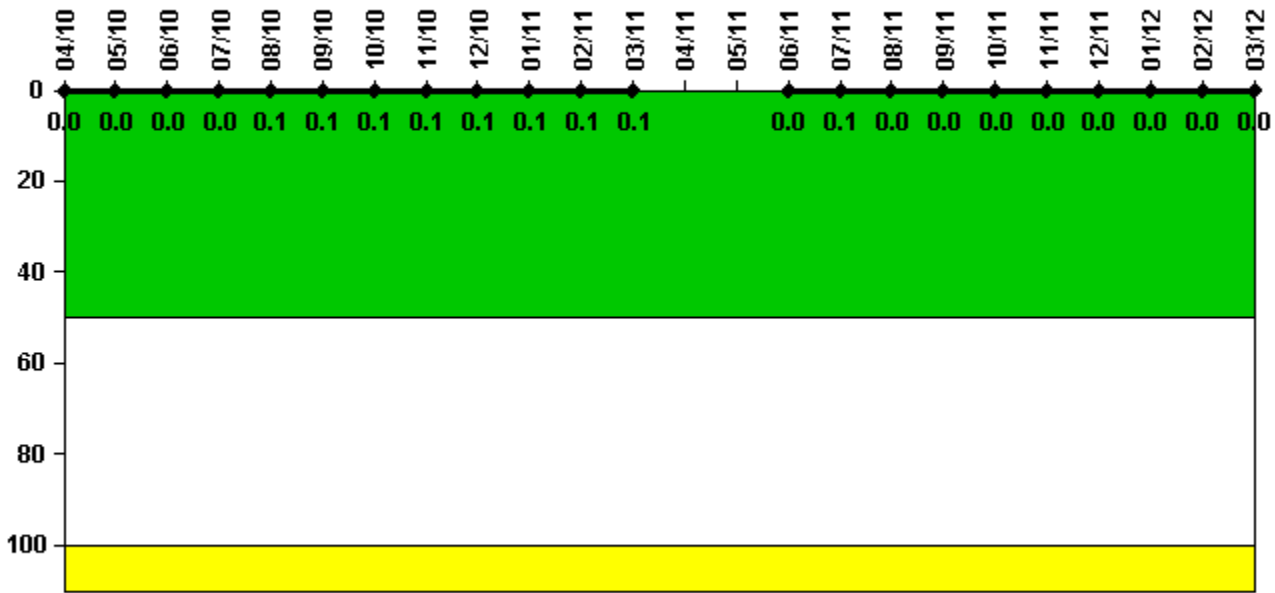


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum activity	0.000418	0.000356	0.000321	0.000347	0.000893	0.000788	0.000618	0.000731	0.000750	0.000868	0.000844	0.000849
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12
Maximum activity	N/A	N/A	0.000334	0.000542	0.000300	0.000266	0.000229	0.000315	0.000375	0.000279	0.000295	0.000289
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	N/A	N/A	0	0.1	0	0	0	0	0	0	0	0

Licensee Comments: none

## Reactor Coolant System Leakage

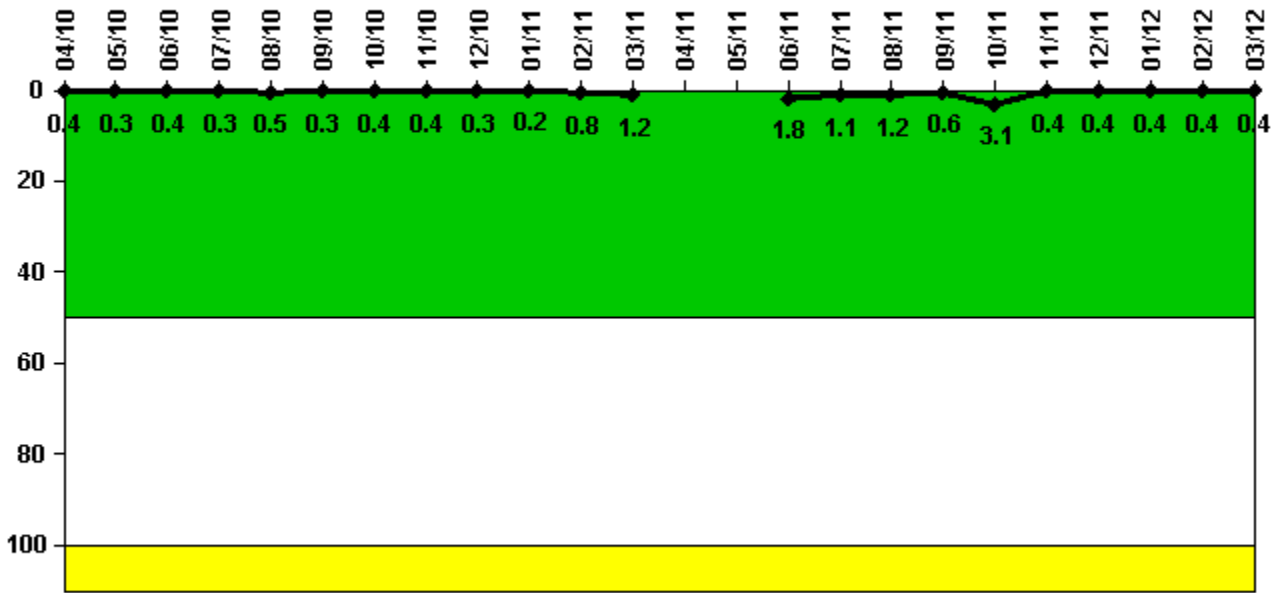


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	4/10	5/10	6/10	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11
Maximum leakage	0.044	0.028	0.037	0.032	0.047	0.028	0.039	0.038	0.031	0.022	0.076	0.121
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.3	0.4	0.3	0.5	0.3	0.4	0.4	0.3	0.2	0.8	1.2
Reactor Coolant System Leakage	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12
Maximum leakage	N/A	N/A	0.180	0.107	0.124	0.058	0.314	0.036	0.041	0.039	0.044	0.038
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	N/A	N/A	1.8	1.1	1.2	0.6	3.1	0.4	0.4	0.4	0.4	0.4

Licensee Comments: none

## Drill/Exercise Performance

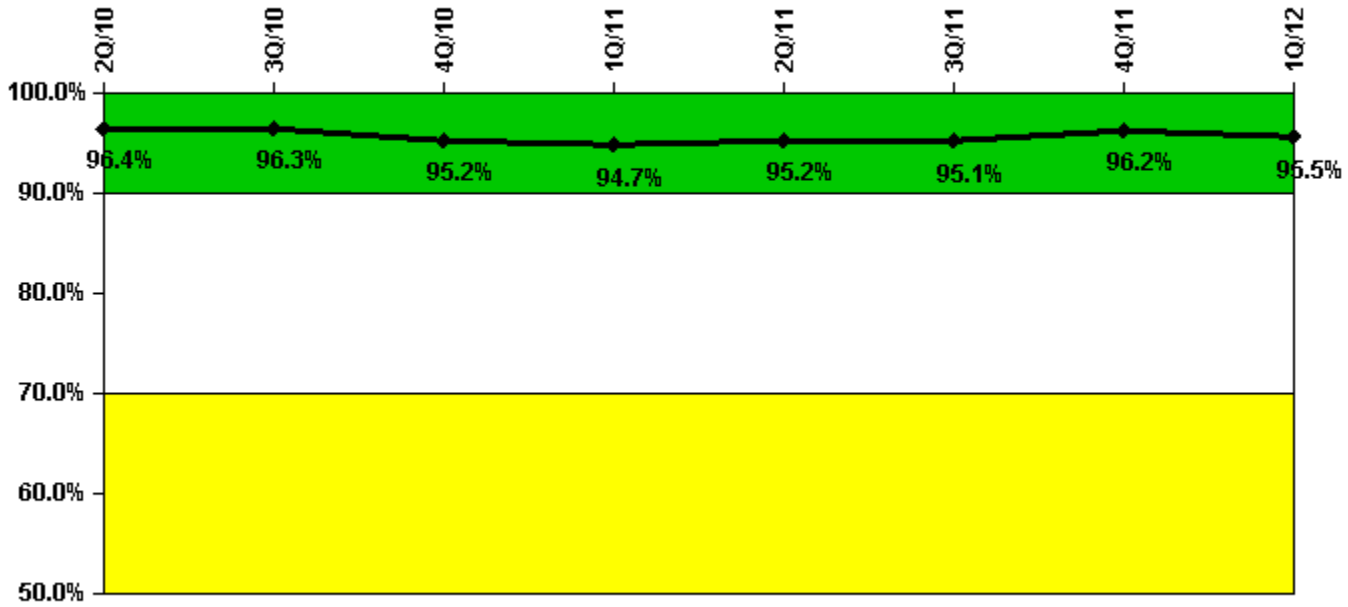


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Successful opportunities	4.0	24.0	13.0	28.0	16.0	39.0	18.0	48.0
Total opportunities	4.0	27.0	15.0	29.0	16.0	40.0	18.0	50.0
Indicator value	96.4%	96.3%	95.2%	94.7%	95.2%	95.1%	96.2%	95.5%

Licensee Comments: none

## ERO Drill Participation

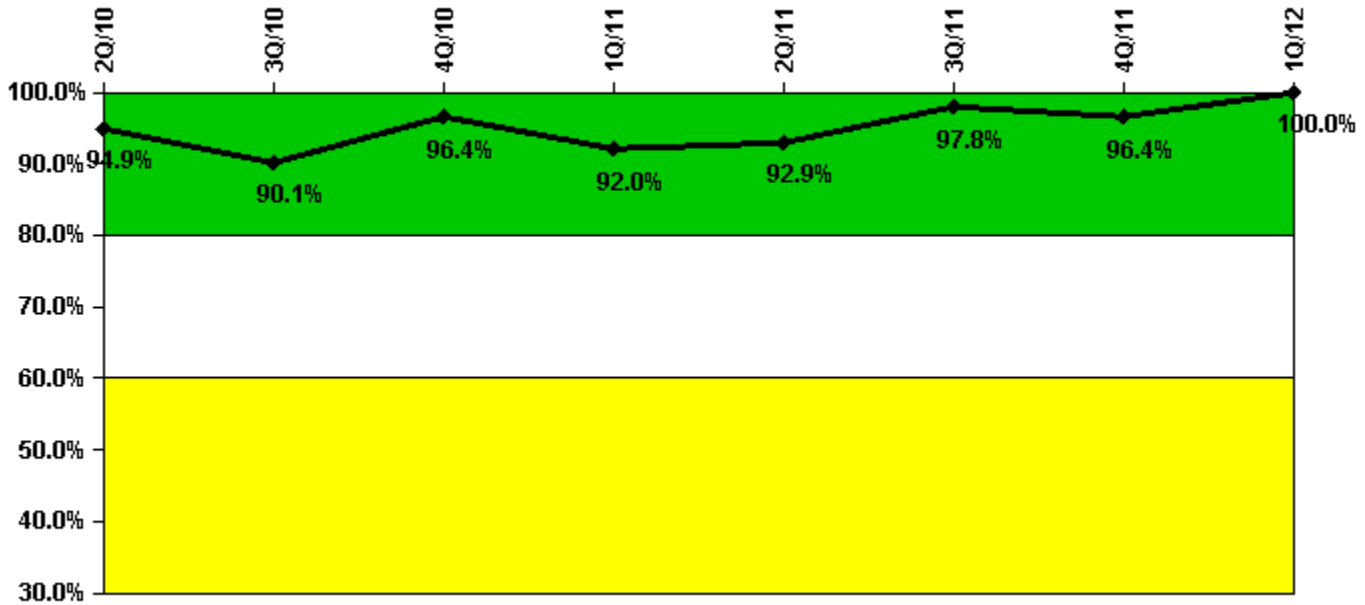


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Participating Key personnel	131.0	127.0	132.0	127.0	130.0	136.0	135.0	133.0
Total Key personnel	138.0	141.0	137.0	138.0	140.0	139.0	140.0	133.0
Indicator value	94.9%	90.1%	96.4%	92.0%	92.9%	97.8%	96.4%	100.0%

Licensee Comments: none

# Alert & Notification System

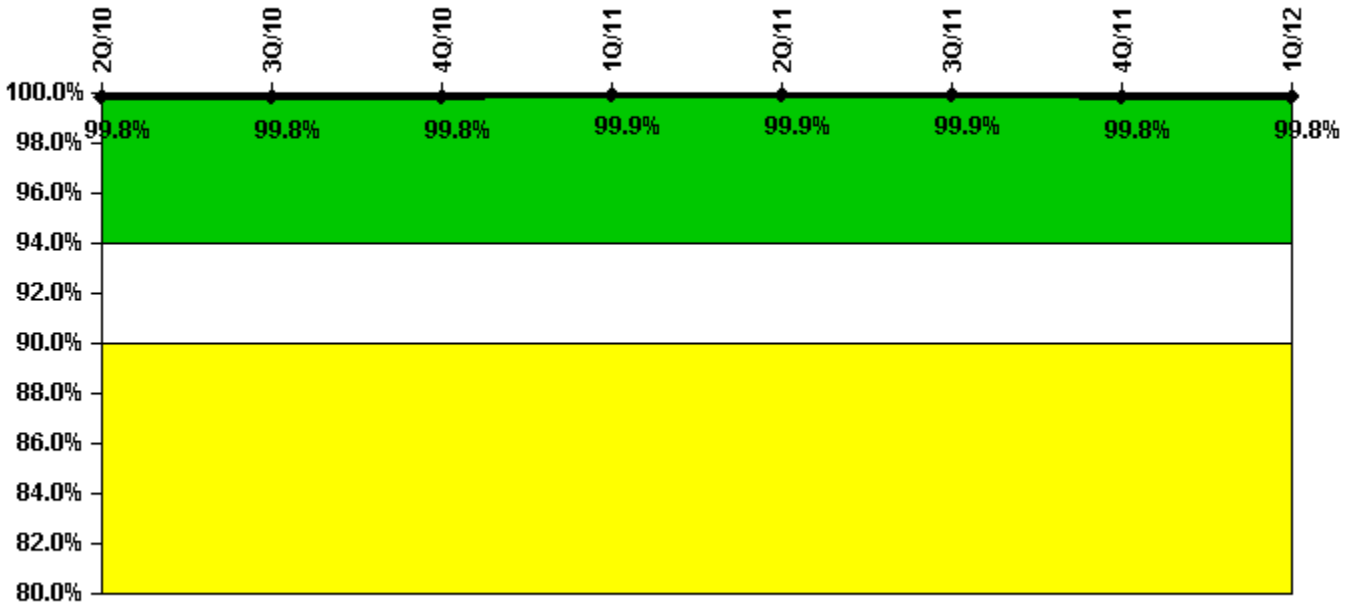


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
Successful siren-tests	1752	1753	1752	1753	1751	1753	1687	1753
Total sirens-tests	1755	1755	1752	1755	1755	1755	1690	1755
Indicator value	99.8%	99.8%	99.8%	99.9%	99.9%	99.9%	99.8%	99.8%

Licensee Comments: none

## Occupational Exposure Control Effectiveness

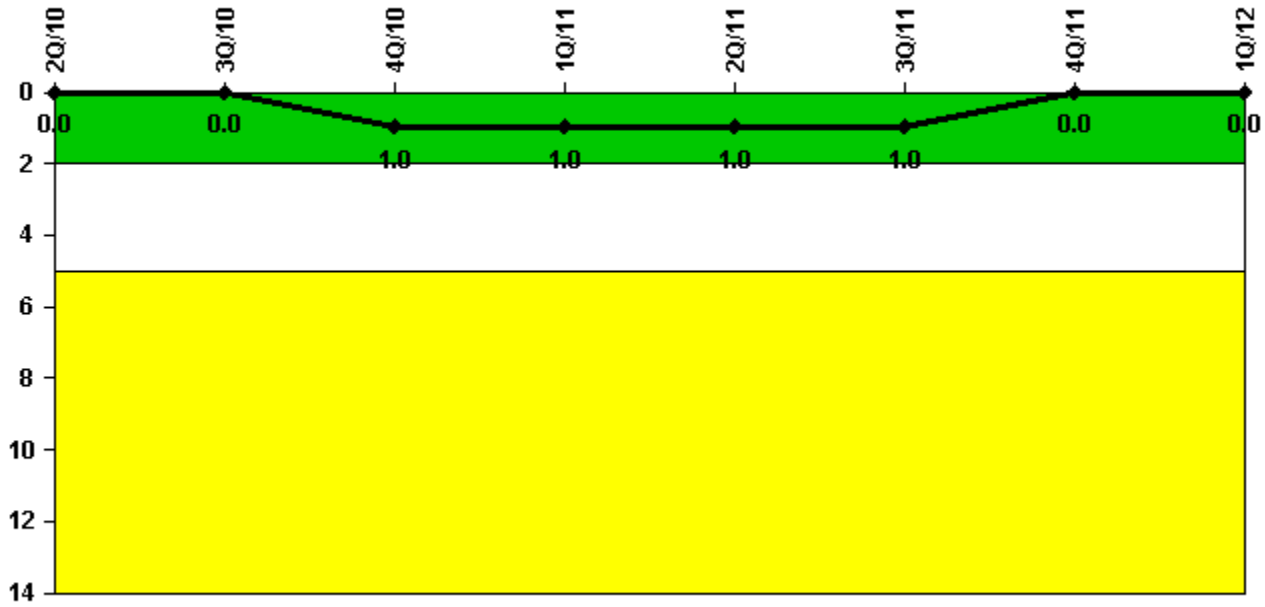


Thresholds: White > 2.0 Yellow > 5.0

### Notes

Occupational Exposure Control Effectiveness	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
High radiation area occurrences	0	0	1	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

# RETS/ODCM Radiological Effluent

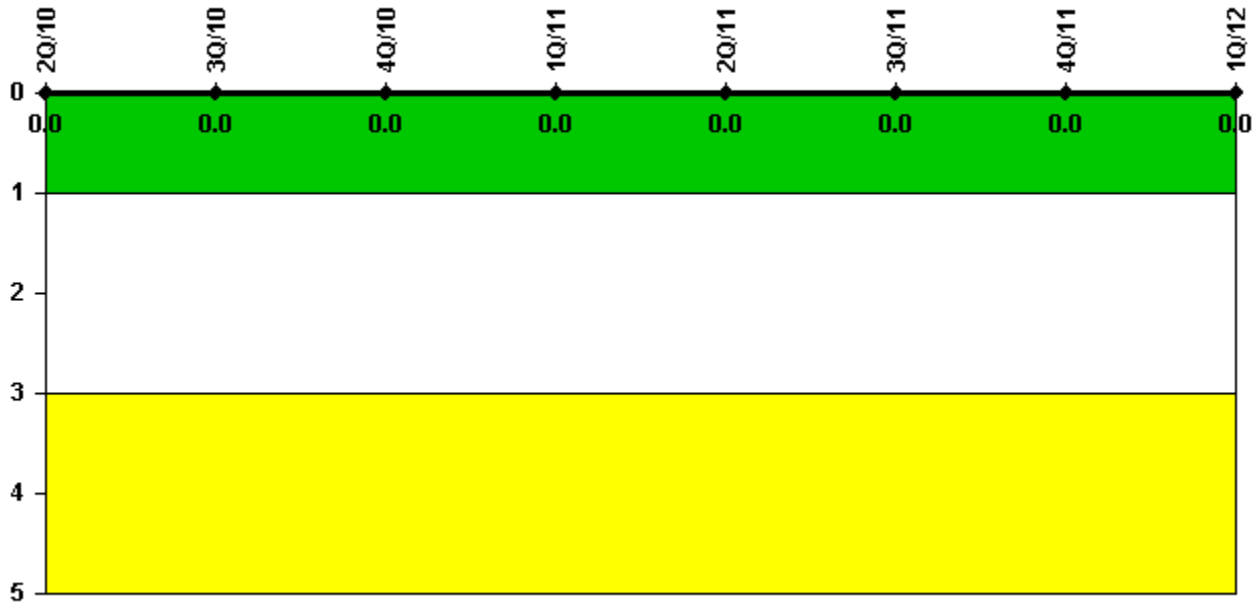

Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	2Q/10	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.