


Oyster Creek

2Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

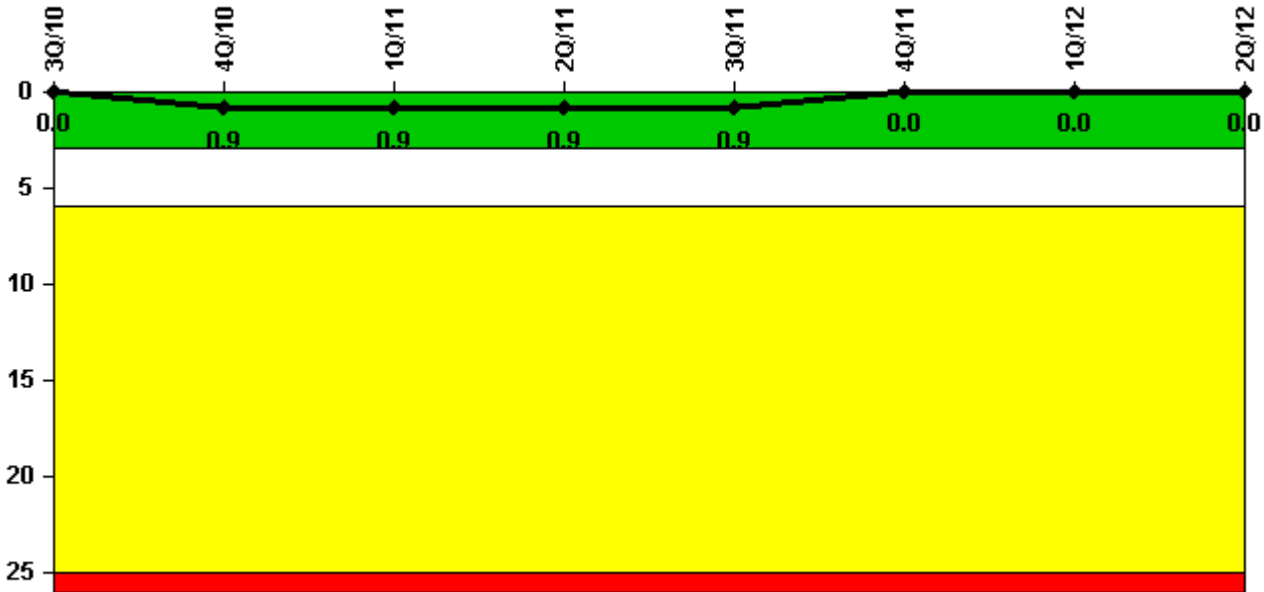


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned scrams	0	1.0	0	0	0	0	0	0
Critical hours	2208.0	1404.6	2159.0	2047.2	2168.3	2209.0	2183.0	2184.0
Indicator value	0	0.9	0.9	0.9	0.9	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

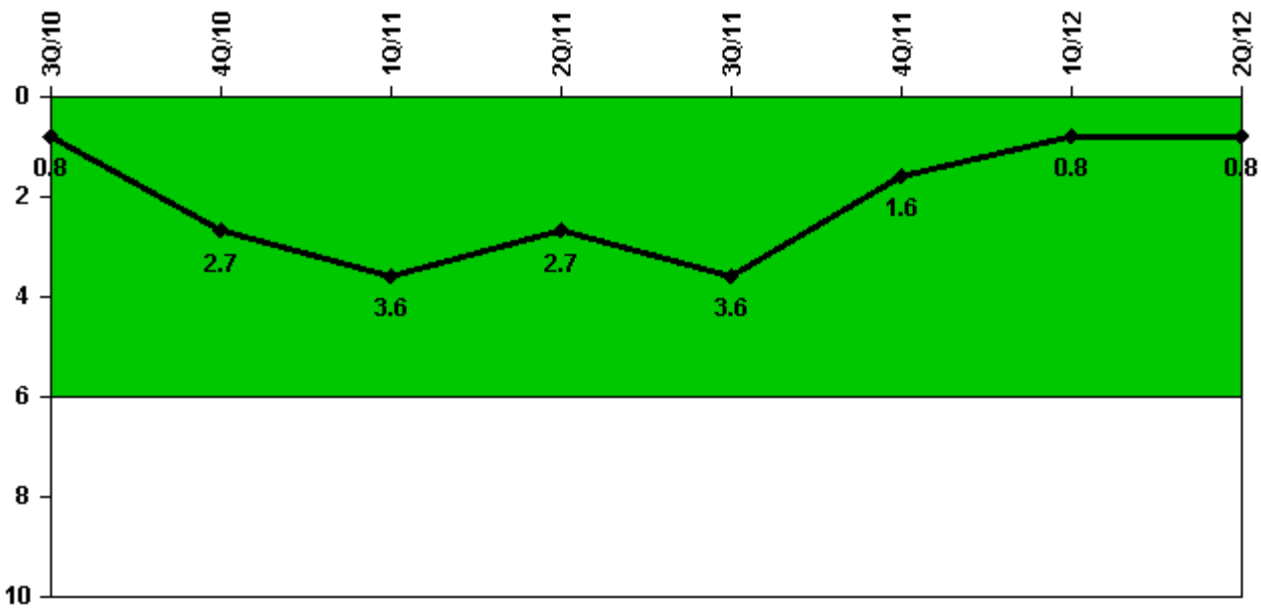

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned power changes	0	2.0	1.0	0	1.0	0	0	0
Critical hours	2208.0	1404.6	2159.0	2047.2	2168.3	2209.0	2183.0	2184.0
Indicator value	0.8	2.7	3.6	2.7	3.6	1.6	0.8	0.8

Licensee Comments:

4Q/10: As a result of the ROP task force FAQ process (FAQ #11-04), the station has revised the number of unplanned power changes from 1 to 2 for the period of December 2010. PI color remains GREEN for the affected period.

Unplanned Scrams with Complications

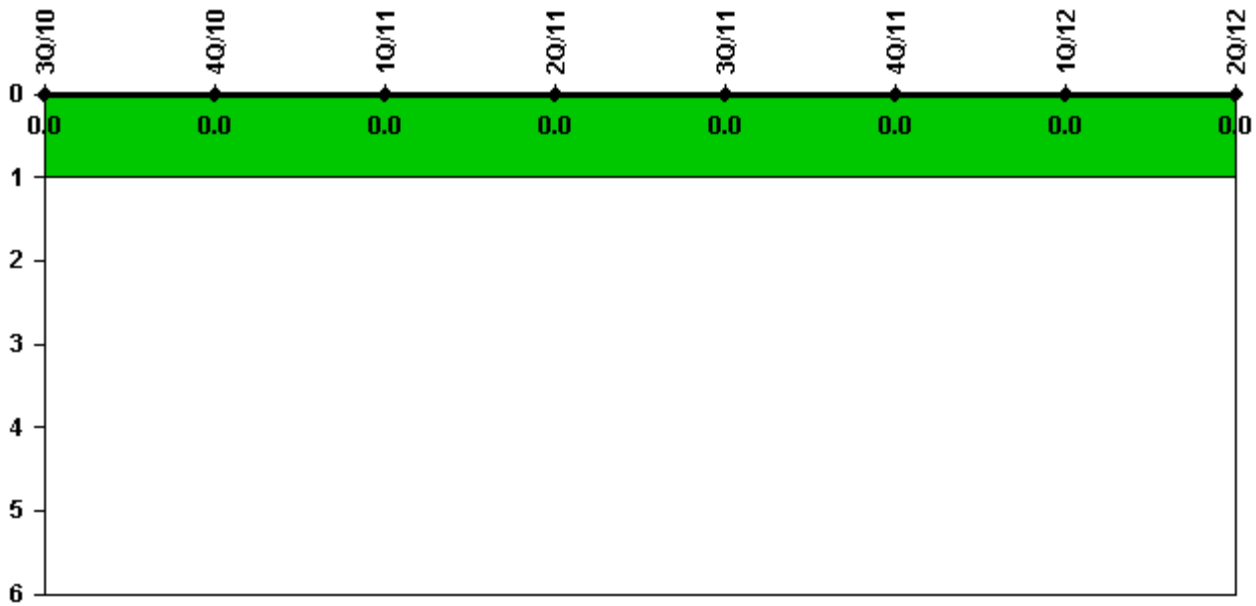


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

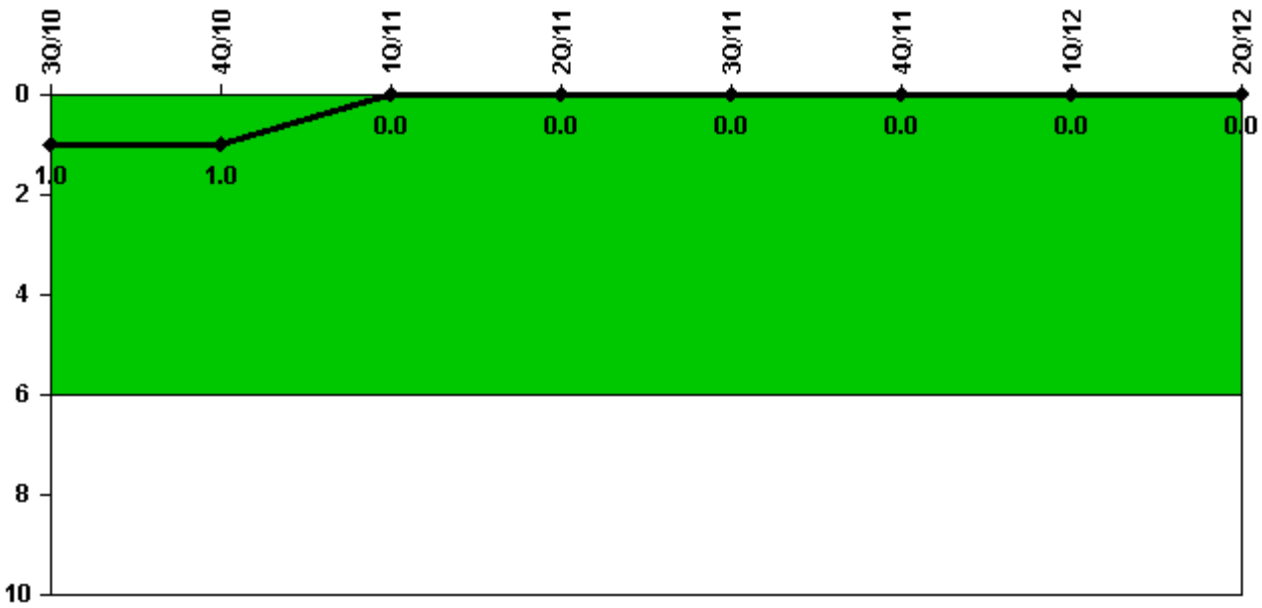


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	1	1	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

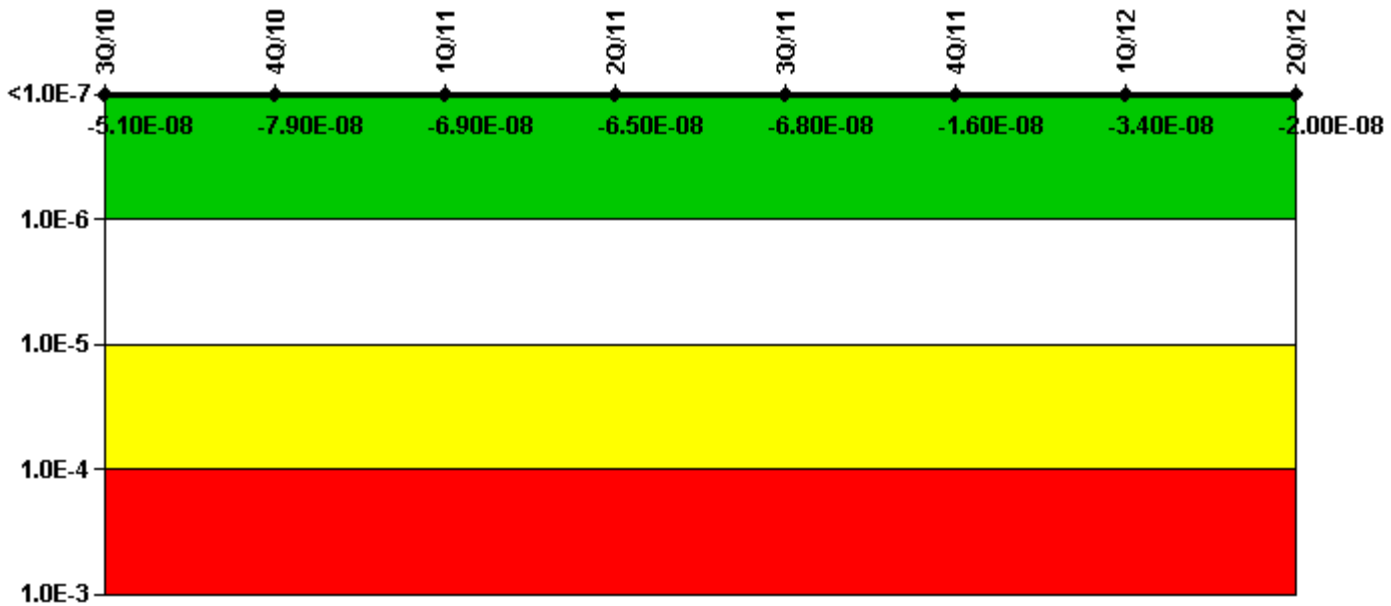

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	6.87E-08	2.82E-08	2.83E-08	2.85E-08	2.86E-08	8.51E-08	5.23E-08	6.02E-08
URI (Δ CDF)	-1.19E-07	-1.07E-07	-9.68E-08	-9.30E-08	-9.67E-08	-1.01E-07	-8.63E-08	-7.99E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.10E-08	-7.90E-08	-6.90E-08	-6.50E-08	-6.80E-08	-1.60E-08	-3.40E-08	-2.00E-08

Licensee Comments:

4Q/10: Engineering evaluation 1155861-11 in progress to review EDG battery charger card failure for MSPI applicability.

3Q/10: Changed PRA Parameter(s). MSPI basis document changed EDG Mission Time from 8 to 6 hours. Does not affect indicator color for previous quarters.

Mitigating Systems Performance Index, High Pressure Injection System

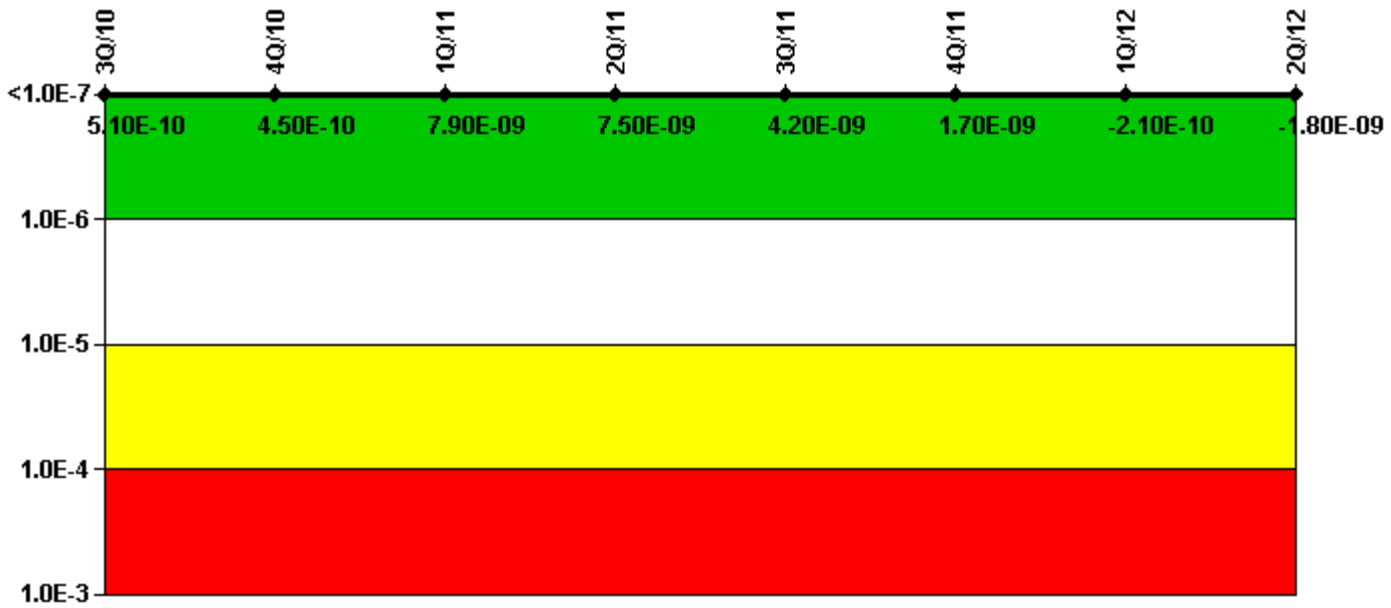


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	1.90E-09	1.81E-09	9.27E-09	8.87E-09	5.42E-09	2.92E-09	9.70E-10	-5.85E-10
URI (Δ CDF)	-1.39E-09	-1.36E-09	-1.37E-09	-1.36E-09	-1.25E-09	-1.19E-09	-1.18E-09	-1.18E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	5.10E-10	4.50E-10	7.90E-09	7.50E-09	4.20E-09	1.70E-09	-2.10E-10	-1.80E-09

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

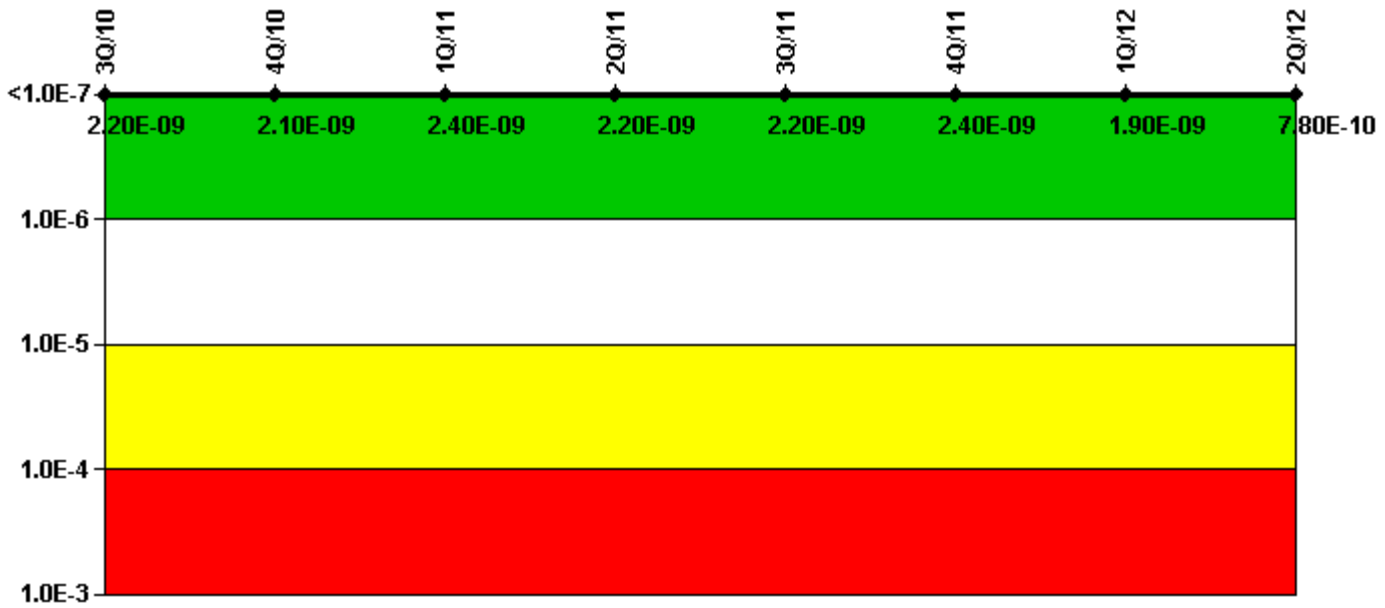


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	2.28E-09	2.23E-09	2.49E-09	2.31E-09	2.30E-09	2.50E-09	2.02E-09	8.74E-10
URI (Δ CDF)	-9.97E-11	-1.01E-10	-1.01E-10	-1.01E-10	-1.01E-10	-9.97E-11	-9.89E-11	-9.49E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.20E-09	2.10E-09	2.40E-09	2.20E-09	2.20E-09	2.40E-09	1.90E-09	7.80E-10

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

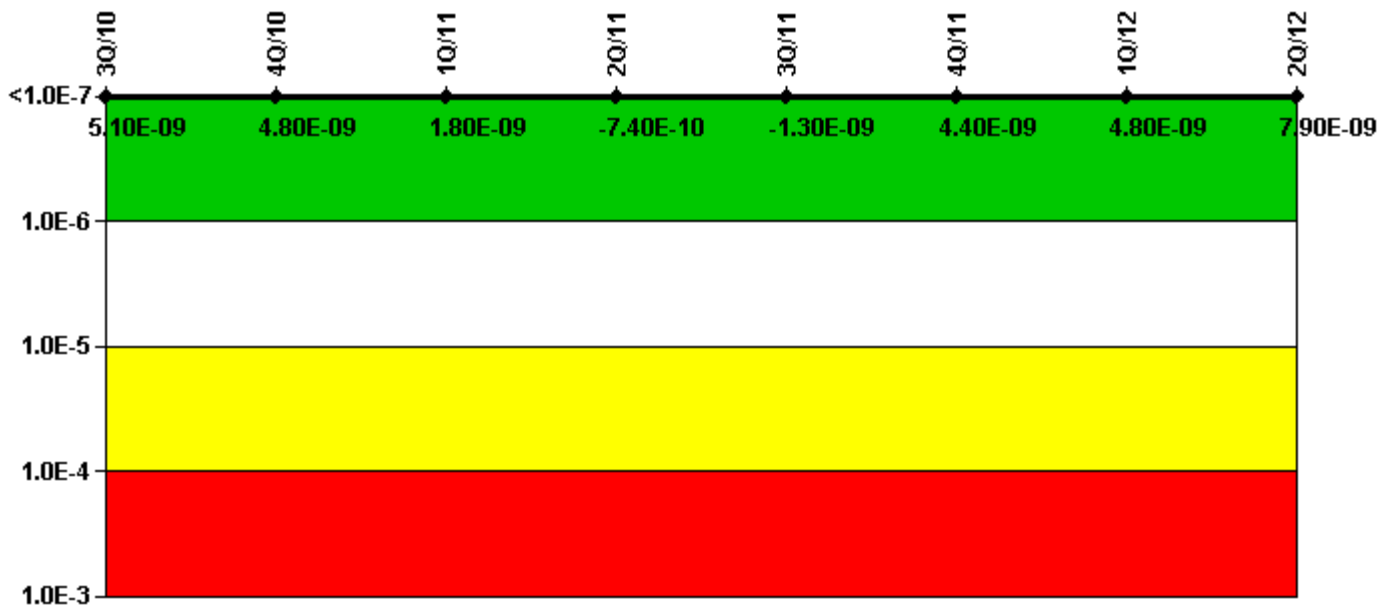


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	5.13E-09	4.78E-09	1.82E-09	-7.30E-10	-1.25E-09	4.43E-09	4.79E-09	7.96E-09
URI (Δ CDF)	-1.24E-11	-1.24E-11	-1.25E-11	-1.26E-11	-1.24E-11	-1.25E-11	-1.26E-11	-1.28E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	5.10E-09	4.80E-09	1.80E-09	-7.40E-10	-1.30E-09	4.40E-09	4.80E-09	7.90E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

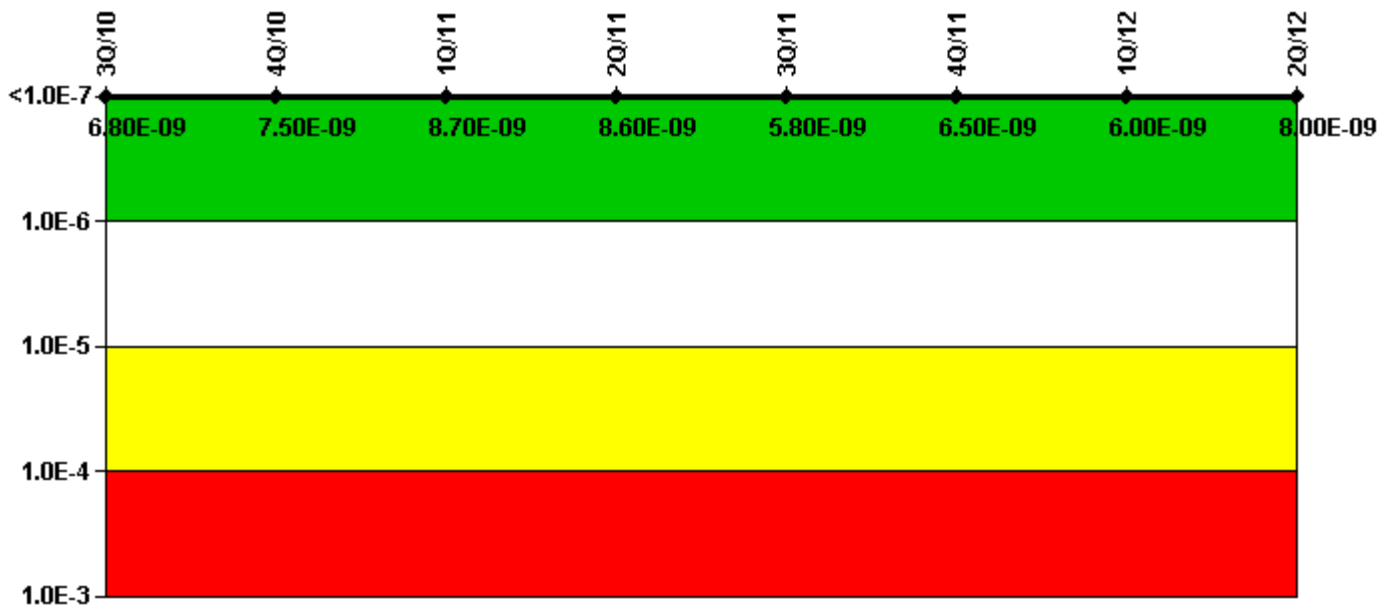


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	6.89E-09	7.53E-09	8.74E-09	8.68E-09	5.88E-09	6.51E-09	6.05E-09	8.06E-09
URI (Δ CDF)	-5.04E-11	-5.04E-11	-4.99E-11	-5.04E-11	-5.07E-11	-5.01E-11	-4.98E-11	-4.98E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.80E-09	7.50E-09	8.70E-09	8.60E-09	5.80E-09	6.50E-09	6.00E-09	8.00E-09

Licensee Comments: none

Reactor Coolant System Activity

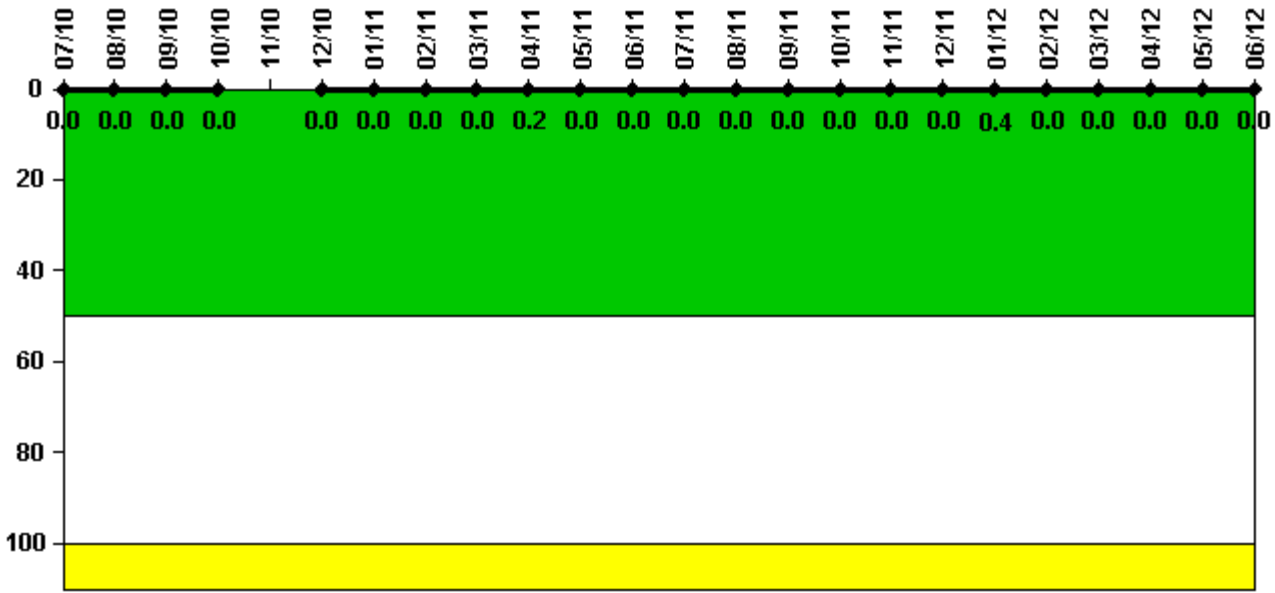

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity	0.000016	0.000015	0.000030	0.000020	N/A	0.000089	0.000013	0.000008	0.000007	0.000312	0.000047	0.000007
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	N/A	0	0	0	0	0.2	0	0

Reactor Coolant System Activity	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum activity	0.000025	0.000066	0.000012	0.000007	0.000009	0.000008	0.000887	0.000008	0.000010	0.000009	0.000010	0.000013
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0.4	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

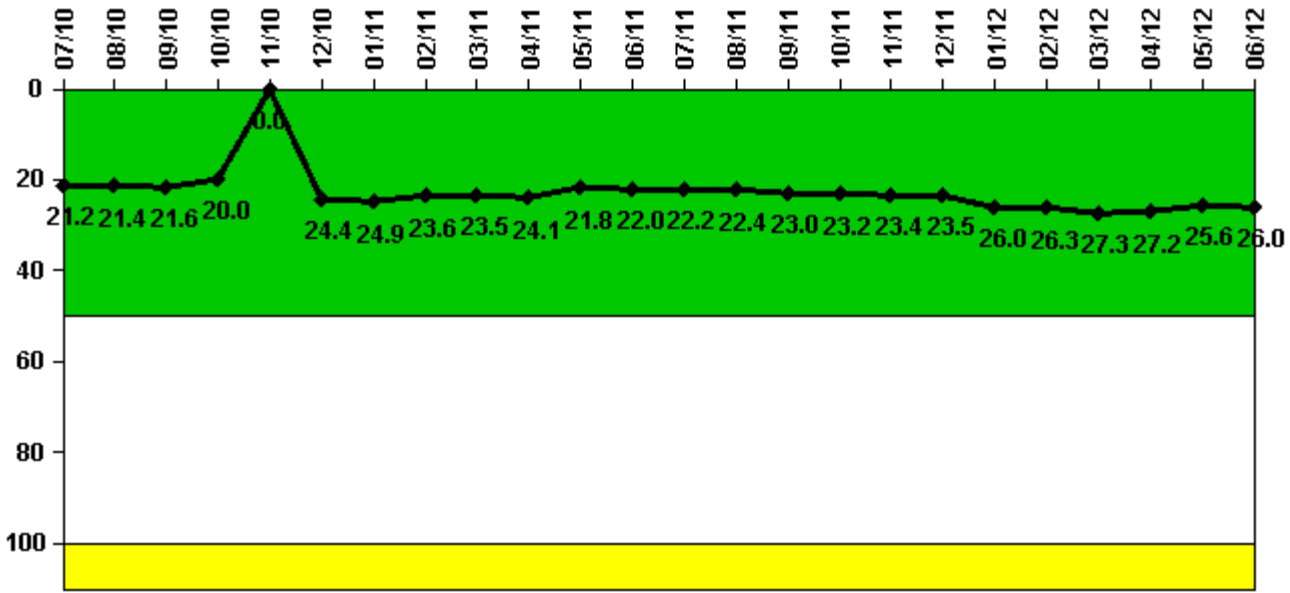


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	5.310	5.360	5.400	5.010	0	6.090	6.220	5.910	5.880	6.030	5.450	5.490
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	21.2	21.4	21.6	20.0	0	24.4	24.9	23.6	23.5	24.1	21.8	22.0
Reactor Coolant System Leakage	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum leakage	5.560	5.610	5.760	5.790	5.850	5.870	6.510	6.580	6.820	6.790	6.410	6.510
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	22.2	22.4	23.0	23.2	23.4	23.5	26.0	26.3	27.3	27.2	25.6	26.0

Licensee Comments: none

Drill/Exercise Performance

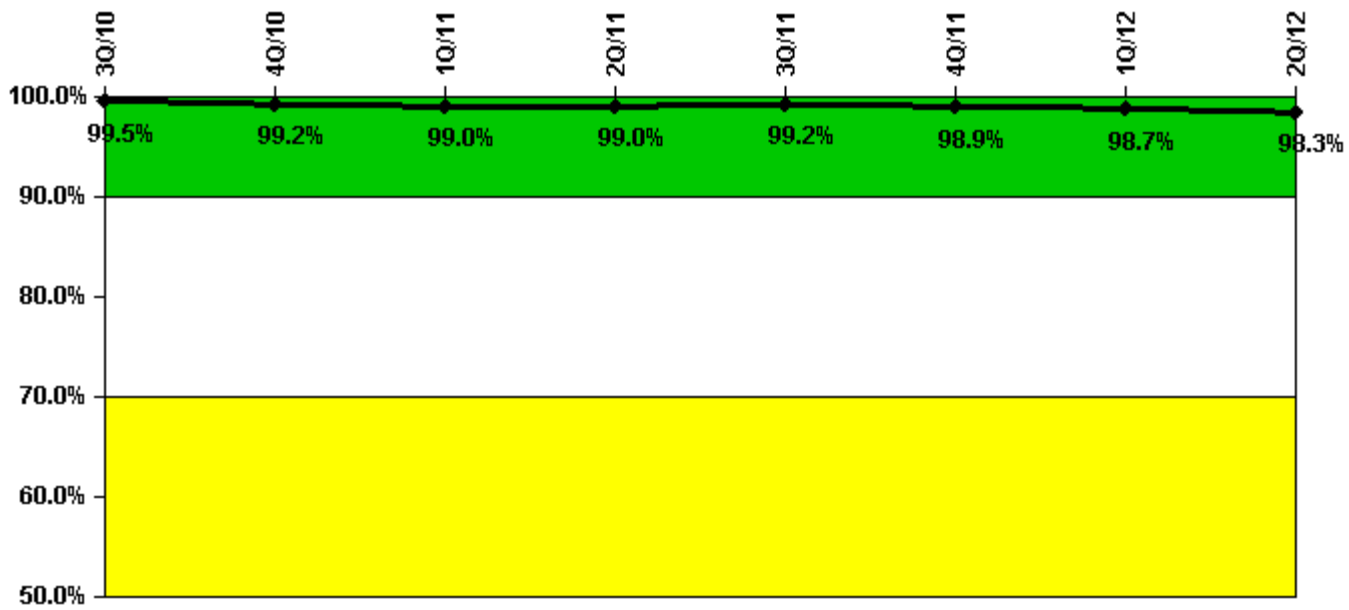


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful opportunities	45.0	23.0	77.0	10.0	48.0	37.0	14.0	31.0
Total opportunities	46.0	24.0	78.0	10.0	48.0	38.0	14.0	32.0
Indicator value	99.5%	99.2%	99.0%	99.0%	99.2%	98.9%	98.7%	98.3%

Licensee Comments: none

ERO Drill Participation

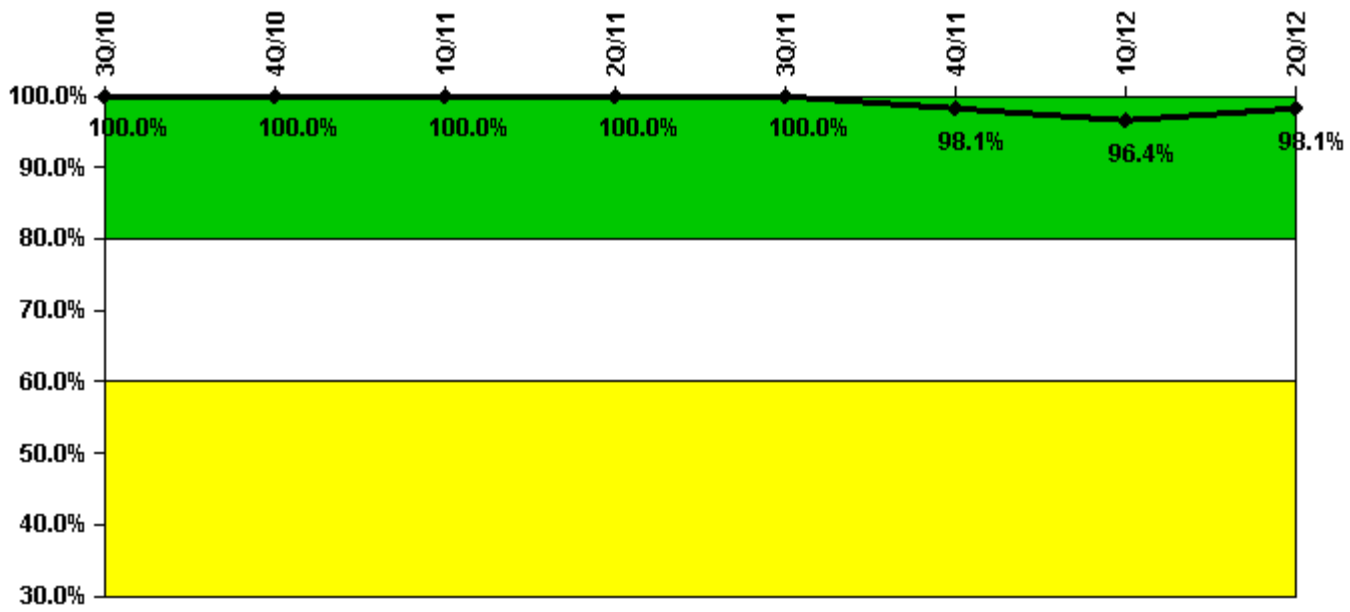


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Participating Key personnel	61.0	61.0	60.0	55.0	54.0	52.0	54.0	53.0
Total Key personnel	61.0	61.0	60.0	55.0	54.0	53.0	56.0	54.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	98.1%	96.4%	98.1%

Licensee Comments: none

Alert & Notification System

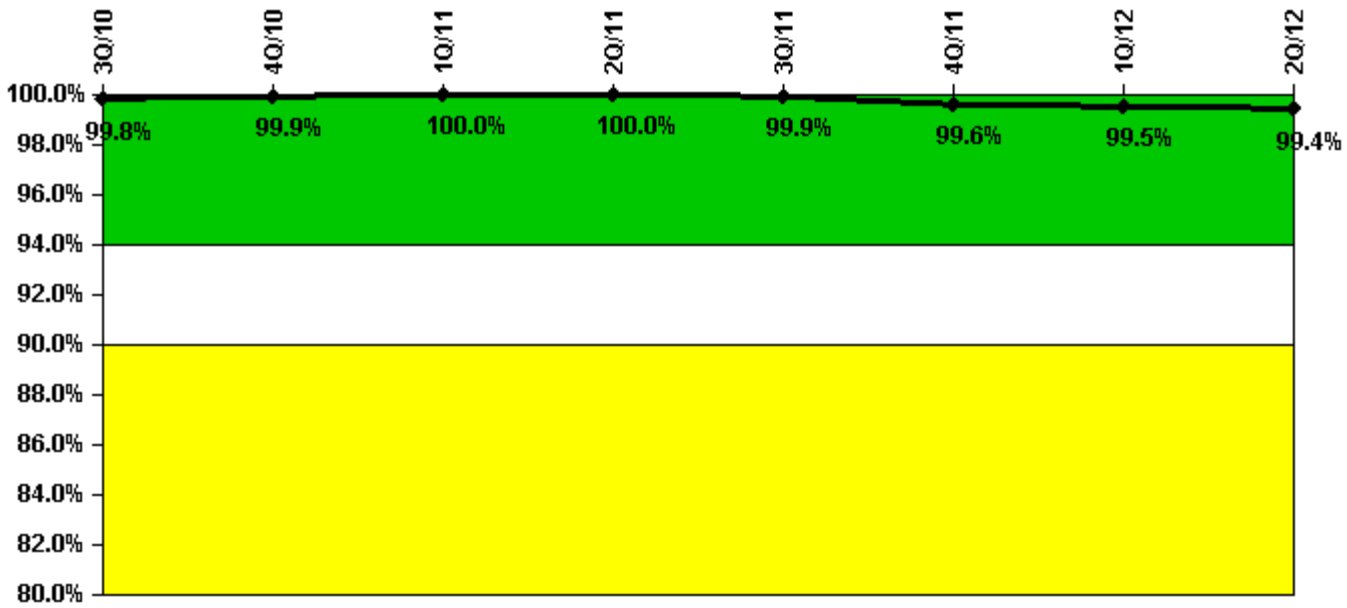


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful siren-tests	546	546	546	546	543	540	544	543
Total sirens-tests	546	546	546	546	546	546	546	546
Indicator value	99.8%	99.9%	100.0%	100.0%	99.9%	99.6%	99.5%	99.4%

Licensee Comments: none

Occupational Exposure Control Effectiveness

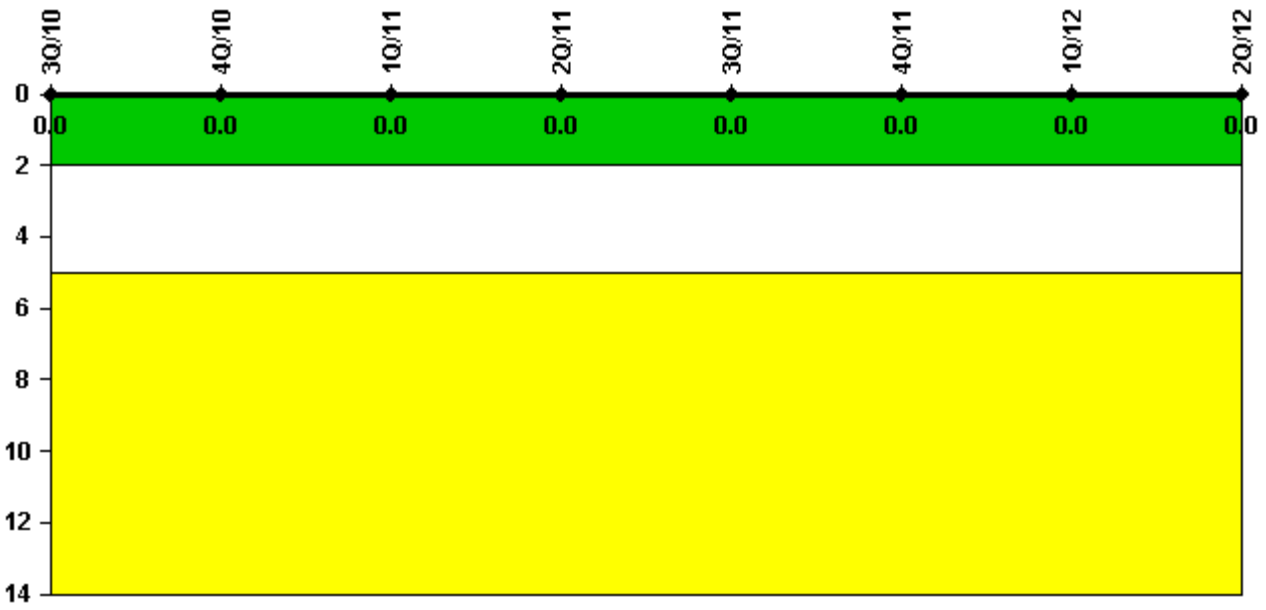


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

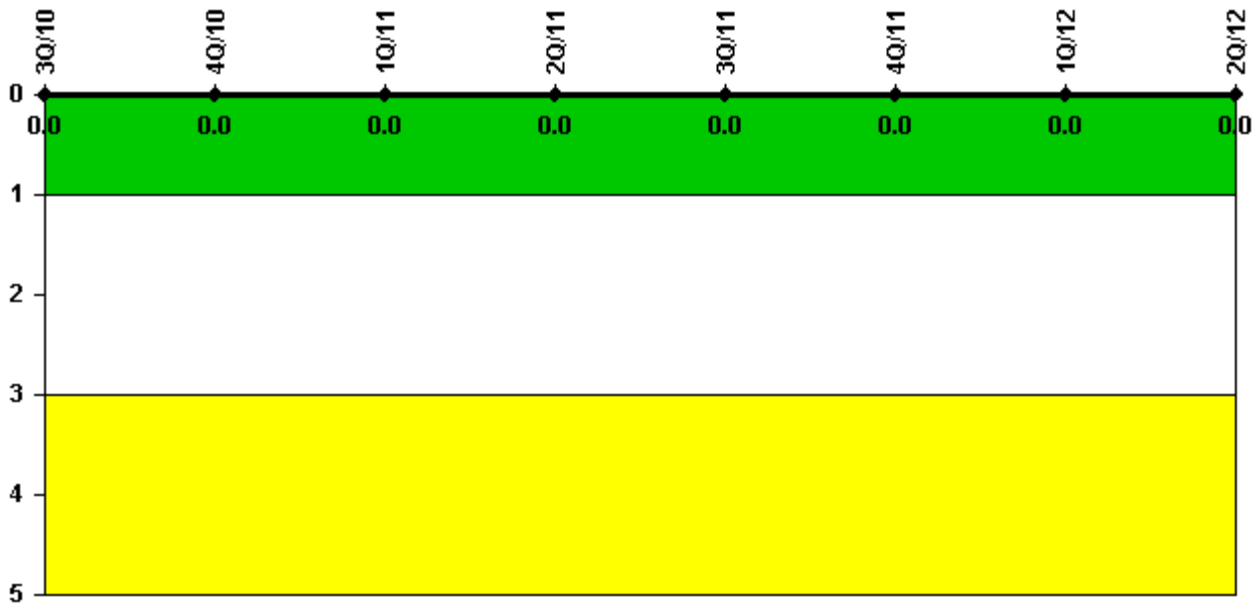

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.
