


# Turkey Point 3

## 2Q/2012 Performance Indicators

Licensee's General Comments: Unit 3 has been in extended power uprate outage for the entire 2nd quarter 2012

### Unplanned Scrams per 7000 Critical Hrs

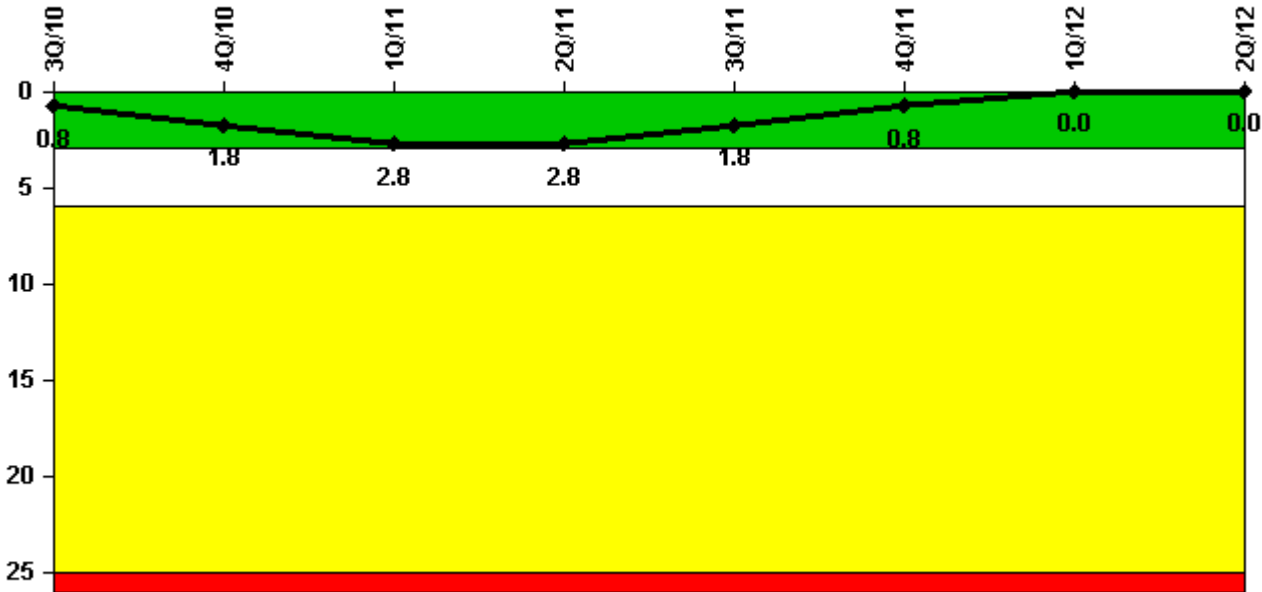


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned scrams	1.0	1.0	1.0	0	0	0	0	0
Critical hours	2033.2	1285.7	2006.9	2184.0	2208.0	1941.2	1344.1	0
Indicator value	0.8	1.8	2.8	2.8	1.8	0.8	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

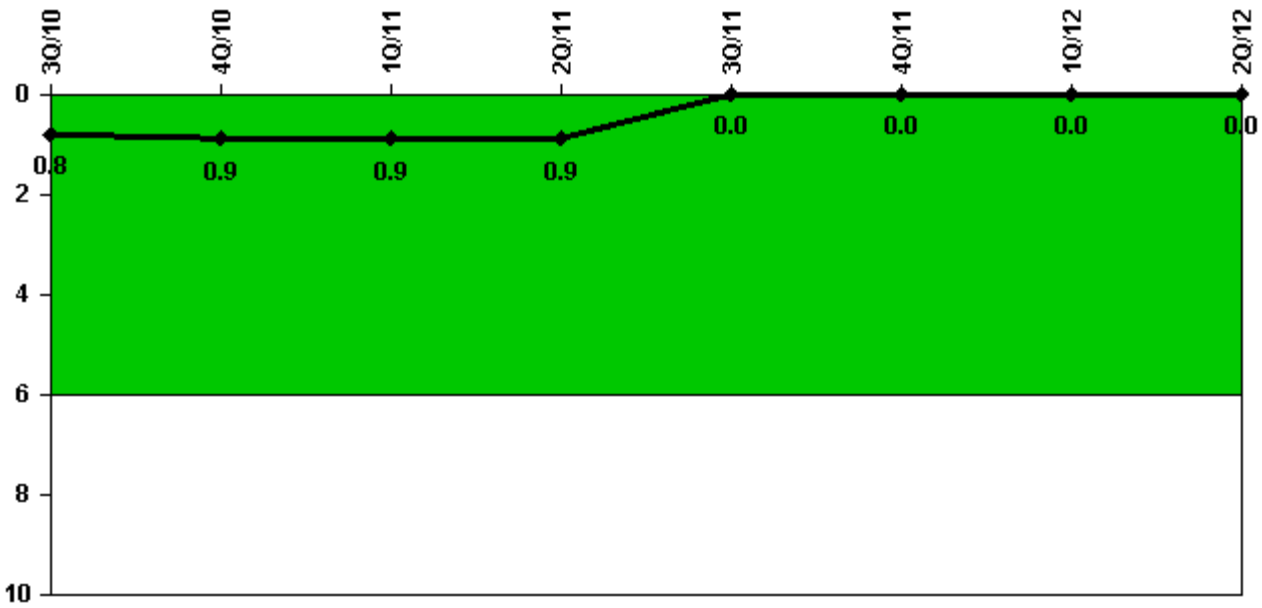


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned power changes	1.0	0	0	0	0	0	0	0
Critical hours	2033.2	1285.7	2006.9	2184.0	2208.0	1941.2	1344.1	0
Indicator value	0.8	0.9	0.9	0.9	0	0	0	0

Licensee Comments: none

## Unplanned Scrams with Complications

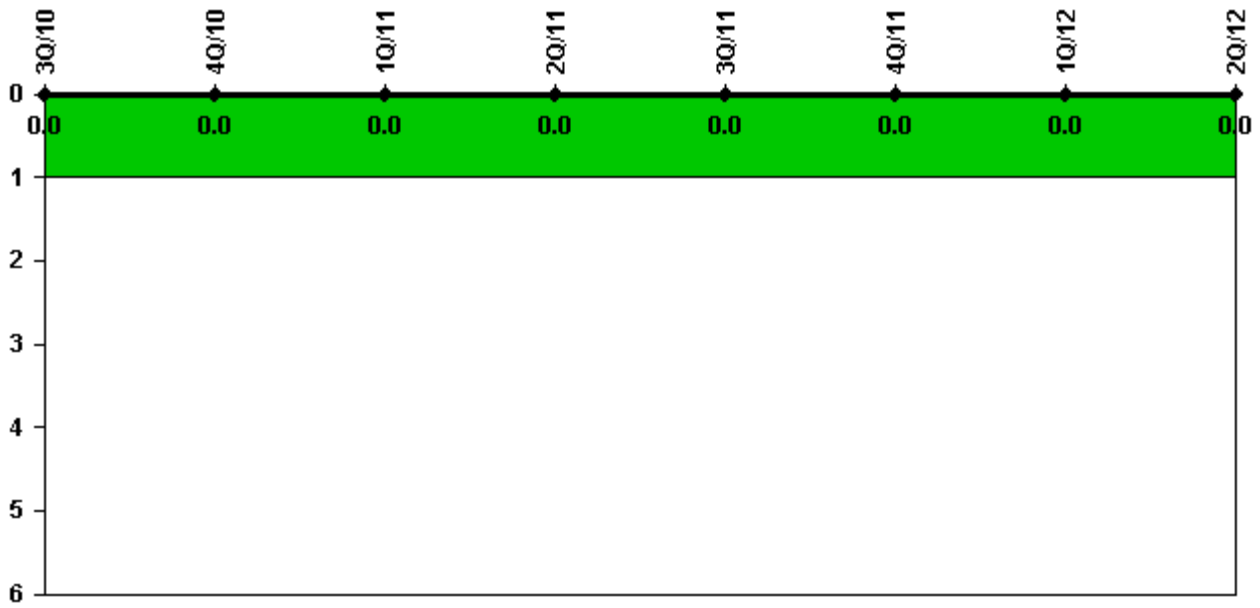


Thresholds: White > 1.0

### Notes

Unplanned Scrams with Complications	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (PWR)

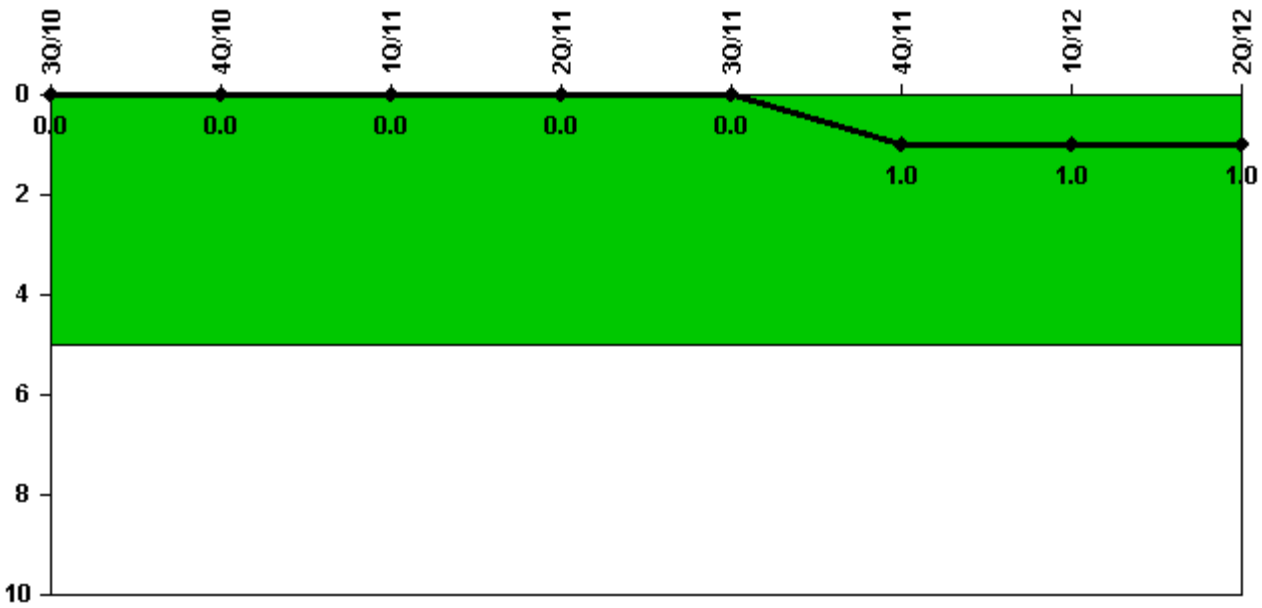

Thresholds: White > 5.0


### Notes

Safety System Functional Failures (PWR)	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Safety System Functional Failures	0	0	0	0	0	1	0	0
Indicator value	0	0	0	0	0	1	1	1

Licensee Comments:

4Q/11: LER 2011-002-00

# Mitigating Systems Performance Index, Emergency AC Power System

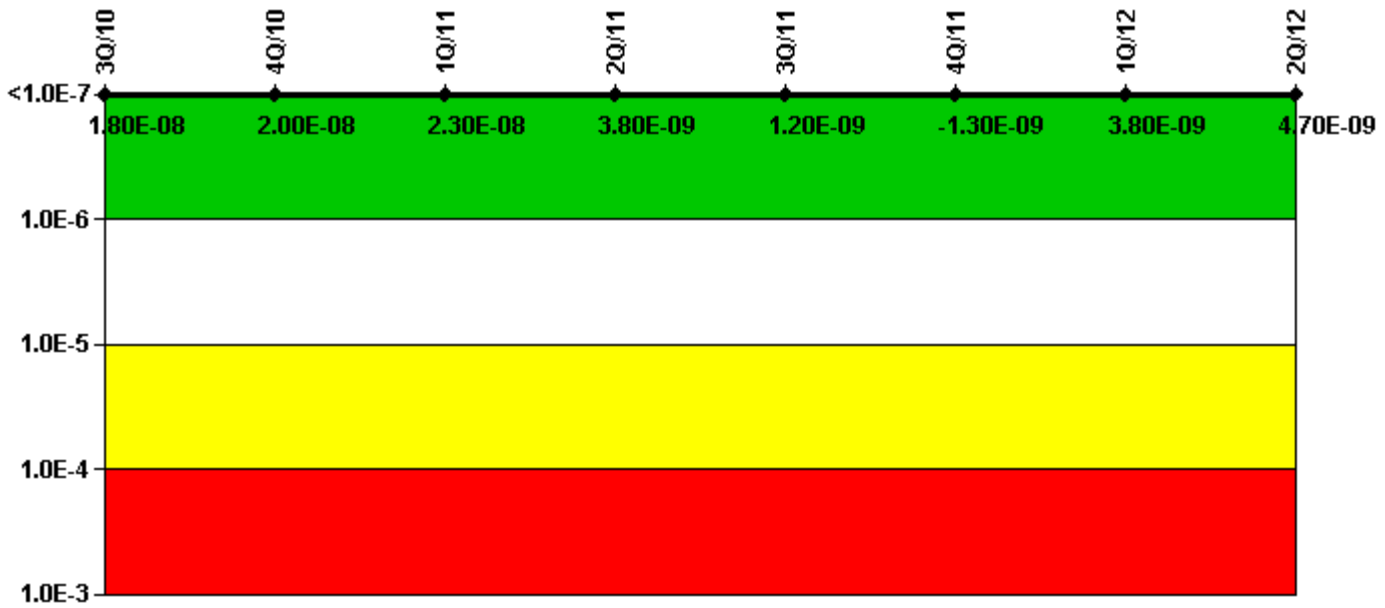

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI ( $\Delta$ CDF)	4.56E-09	7.12E-09	1.10E-08	1.08E-08	8.32E-09	5.50E-09	8.64E-09	9.31E-09
URI ( $\Delta$ CDF)	1.38E-08	1.28E-08	1.23E-08	-6.94E-09	-7.07E-09	-6.77E-09	-4.85E-09	-4.64E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.80E-08	2.00E-08	2.30E-08	3.80E-09	1.20E-09	-1.30E-09	3.80E-09	4.70E-09

Licensee Comments:

1Q/12: Changed PRA Parameter(s).

# Mitigating Systems Performance Index, High Pressure Injection System

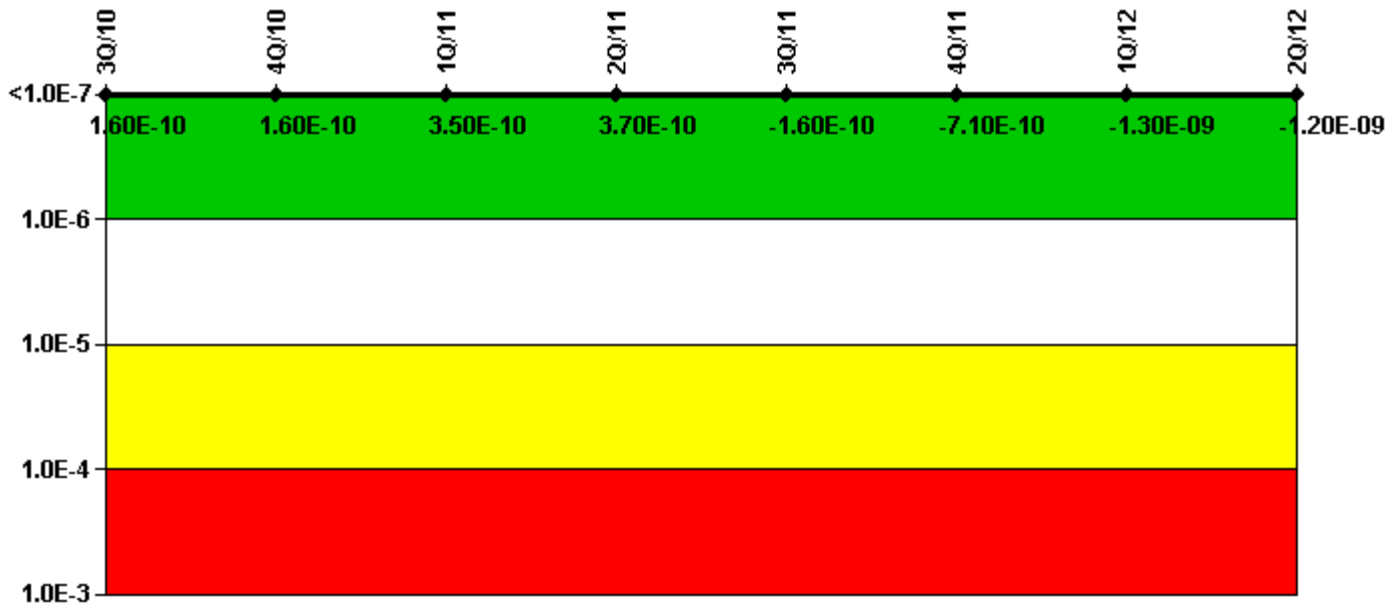

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI ( $\Delta$ CDF)	1.19E-09	1.17E-09	1.36E-09	1.38E-09	8.44E-10	2.95E-10	4.65E-10	6.67E-10
URI ( $\Delta$ CDF)	-1.02E-09	-1.02E-09	-1.01E-09	-1.01E-09	-1.00E-09	-1.00E-09	-1.80E-09	-1.86E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.60E-10	1.60E-10	3.50E-10	3.70E-10	-1.60E-10	-7.10E-10	-1.30E-09	-1.20E-09

Licensee Comments:

1Q/12: Changed PRA Parameter(s).

# Mitigating Systems Performance Index, Heat Removal System

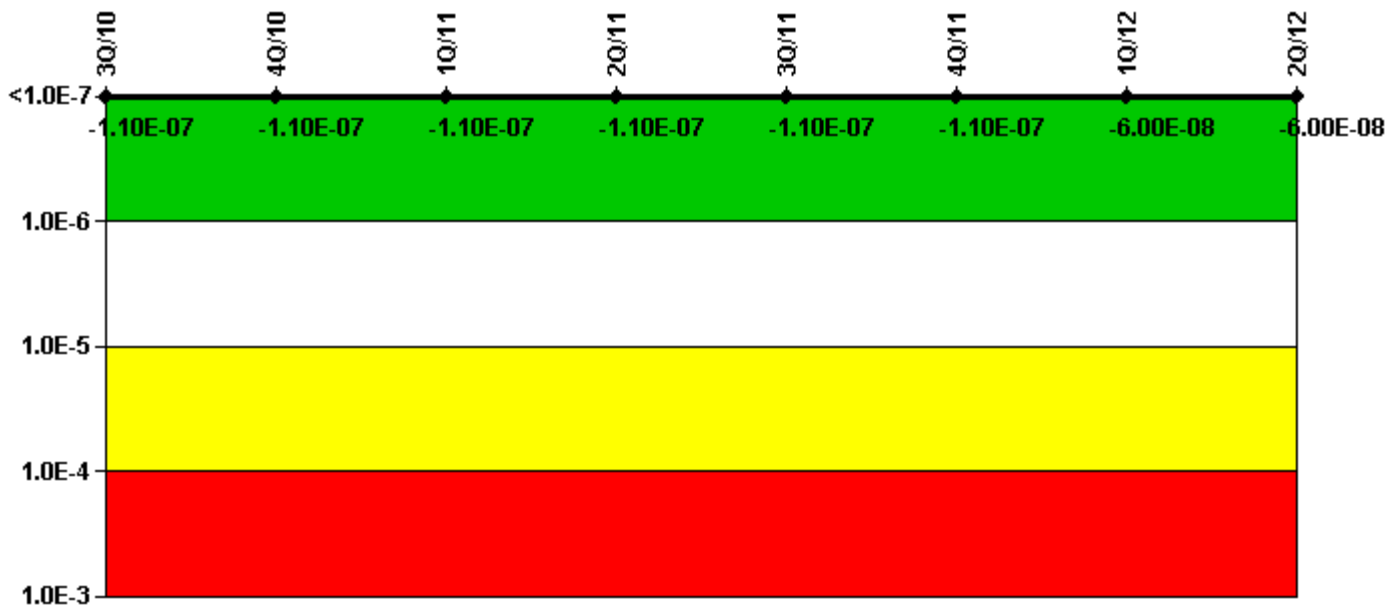

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI ( $\Delta$ CDF)	3.32E-09	3.78E-09	5.34E-09	3.66E-09	2.55E-09	2.93E-09	5.18E-10	6.47E-10
URI ( $\Delta$ CDF)	-1.09E-07	-1.11E-07	-1.12E-07	-1.13E-07	-1.14E-07	-1.14E-07	-6.07E-08	-6.07E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-6.00E-08	-6.00E-08

Licensee Comments:

1Q/12: Changed PRA Parameter(s).

# Mitigating Systems Performance Index, Residual Heat Removal System

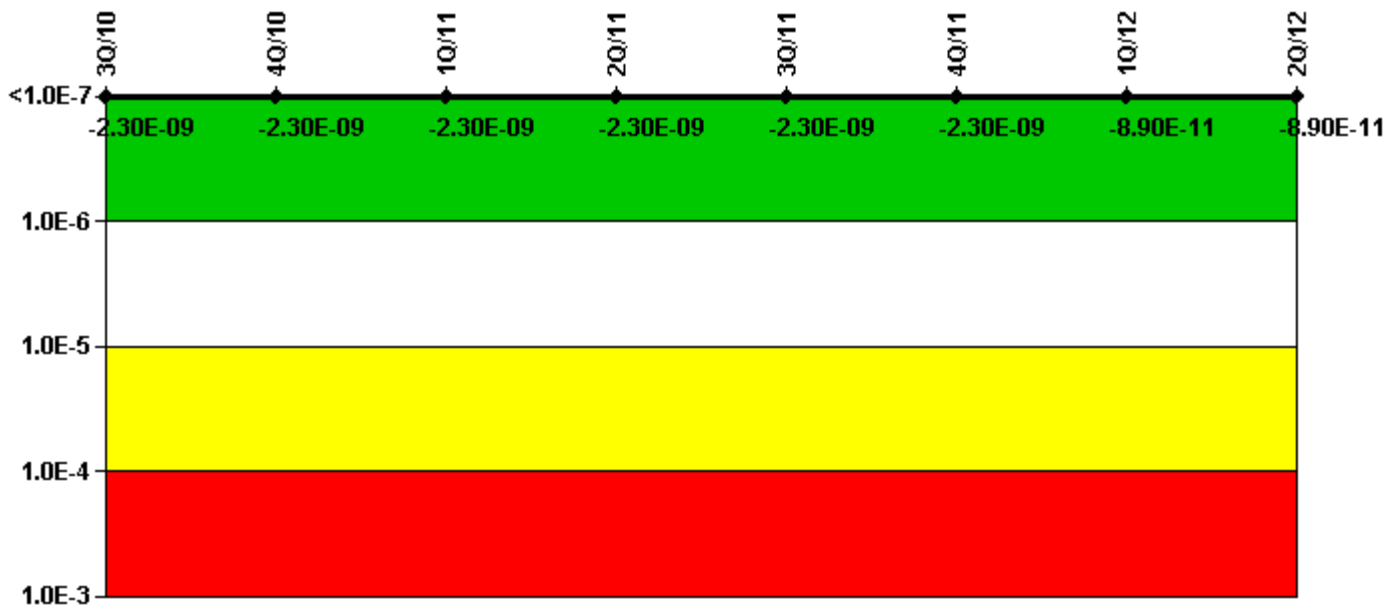

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes


Mitigating Systems Performance Index, Residual Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI ( $\Delta$ CDF)	-4.70E-10	-4.70E-10	-4.70E-10	-4.70E-10	-4.70E-10	-4.70E-10	-1.99E-11	-1.99E-11
URI ( $\Delta$ CDF)	-1.84E-09	-1.84E-09	-1.84E-09	-1.84E-09	-1.84E-09	-1.84E-09	-6.95E-11	-6.95E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-09	-2.30E-09	-2.30E-09	-2.30E-09	-2.30E-09	-2.30E-09	-8.90E-11	-8.90E-11

Licensee Comments:

1Q/12: Changed PRA Parameter(s).



# Mitigating Systems Performance Index, Cooling Water Systems

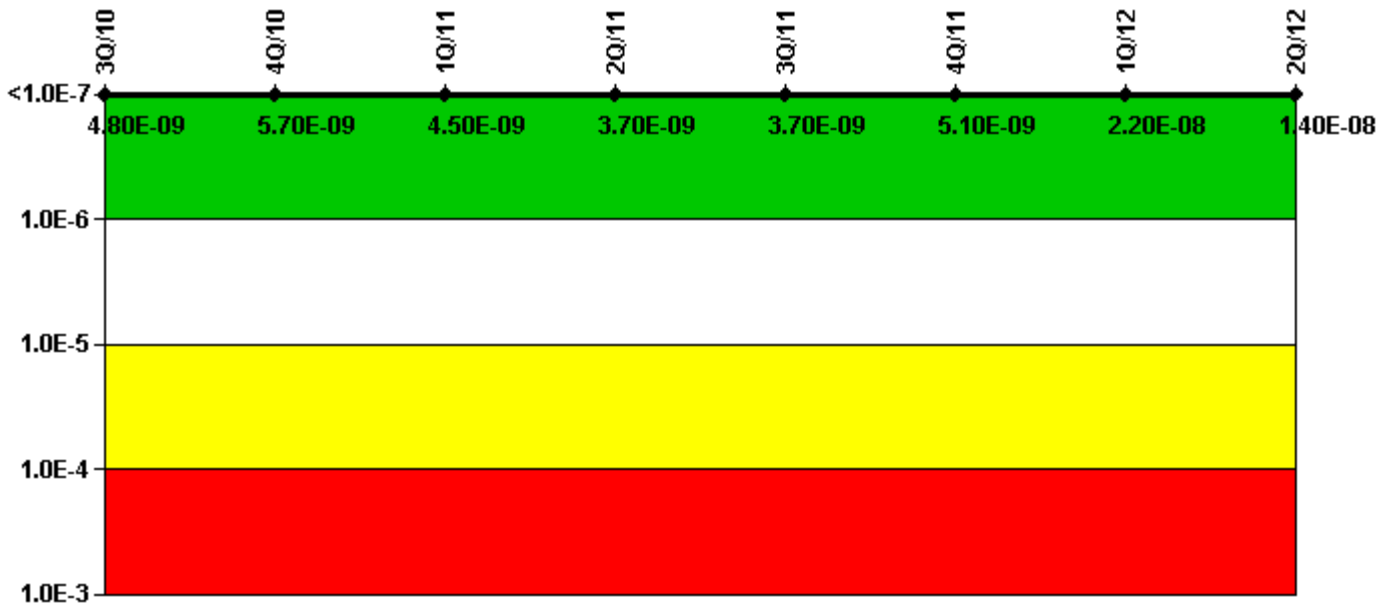

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI ( $\Delta$ CDF)	4.82E-09	5.69E-09	4.80E-09	4.04E-09	3.98E-09	5.40E-09	2.57E-08	1.82E-08
URI ( $\Delta$ CDF)	1.14E-11	1.14E-11	-2.90E-10	-2.90E-10	-2.90E-10	-2.90E-10	-3.85E-09	-3.85E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.80E-09	5.70E-09	4.50E-09	3.70E-09	3.70E-09	5.10E-09	2.20E-08	1.40E-08

Licensee Comments:

1Q/12: Changed PRA Parameter(s).

## Reactor Coolant System Activity

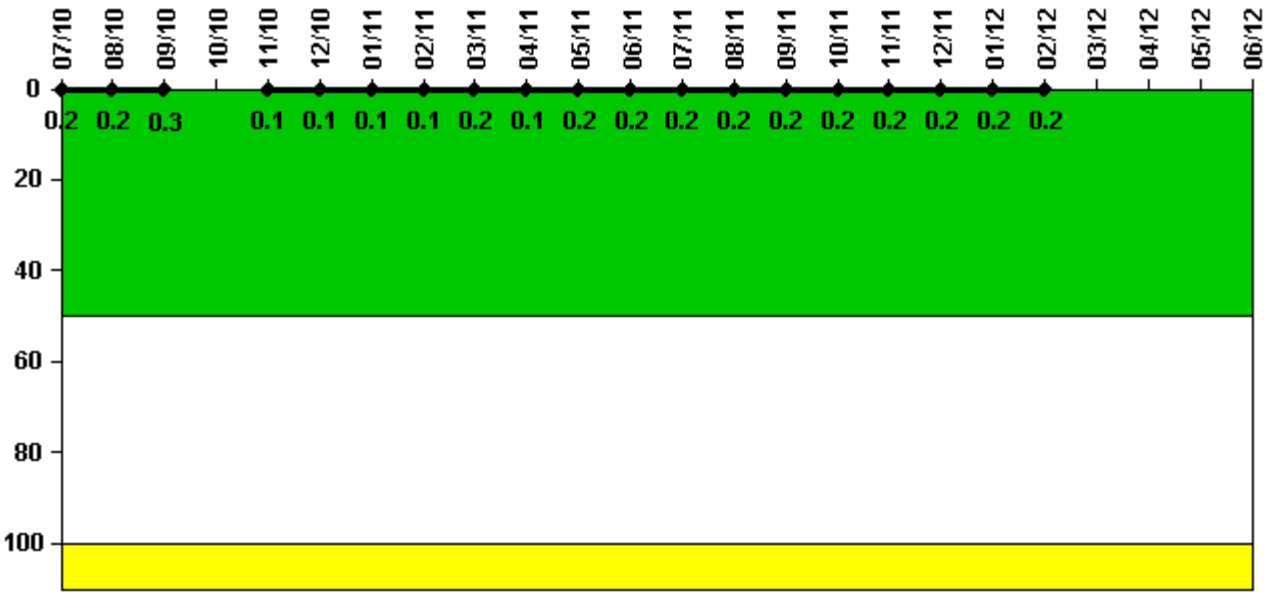

Thresholds: White > 50.0 Yellow > 100.0

### Notes


Reactor Coolant System Activity	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity	0.002180	0.002370	0.002590	N/A	0.001180	0.001410	0.001370	0.001490	0.001520	0.001490	0.001600	0.001610
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.3	N/A	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.2

Reactor Coolant System Activity	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum activity	0.001870	0.001810	0.001670	0.001700	0.001890	0.002160	0.002070	0.002020	N/A	N/A	N/A	N/A
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	N/A	N/A	N/A	N/A

Licensee Comments: none

## Reactor Coolant System Leakage

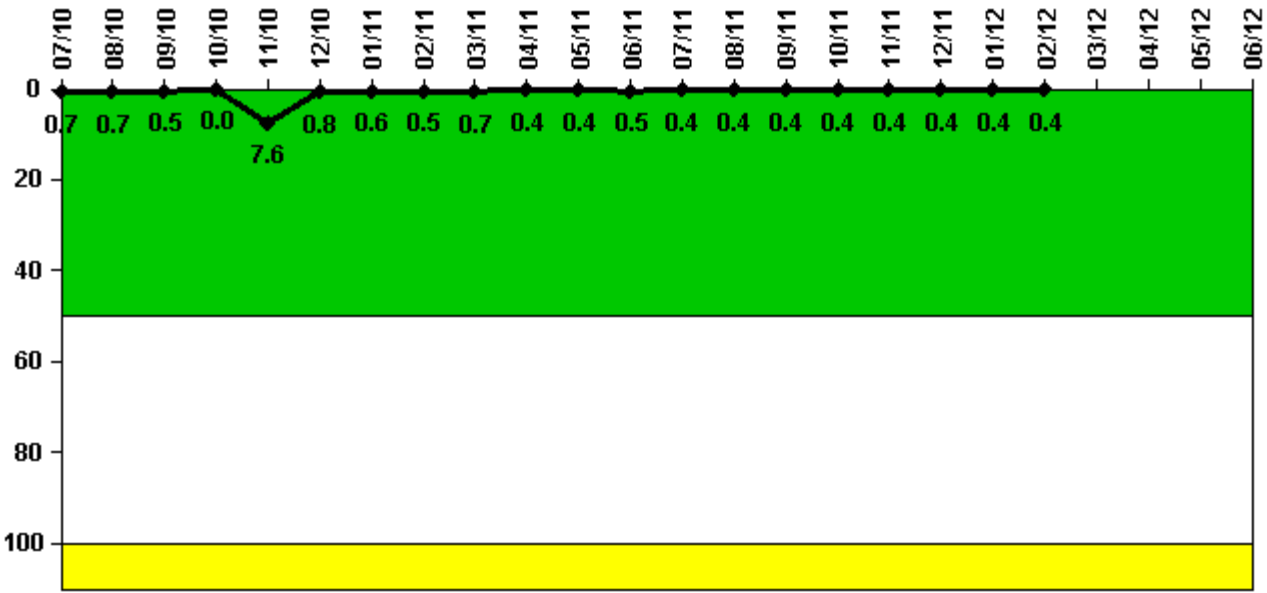


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	0.070	0.070	0.050	0	0.760	0.080	0.060	0.050	0.070	0.040	0.040	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	0.7	0.5	0	7.6	0.8	0.6	0.5	0.7	0.4	0.4	0.5
Reactor Coolant System Leakage	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum leakage	0.042	0.040	0.040	0.040	0.040	0.040	0.040	0.040	N/A	N/A	N/A	N/A
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	N/A	N/A	N/A	N/A

Licensee Comments: none

## Drill/Exercise Performance

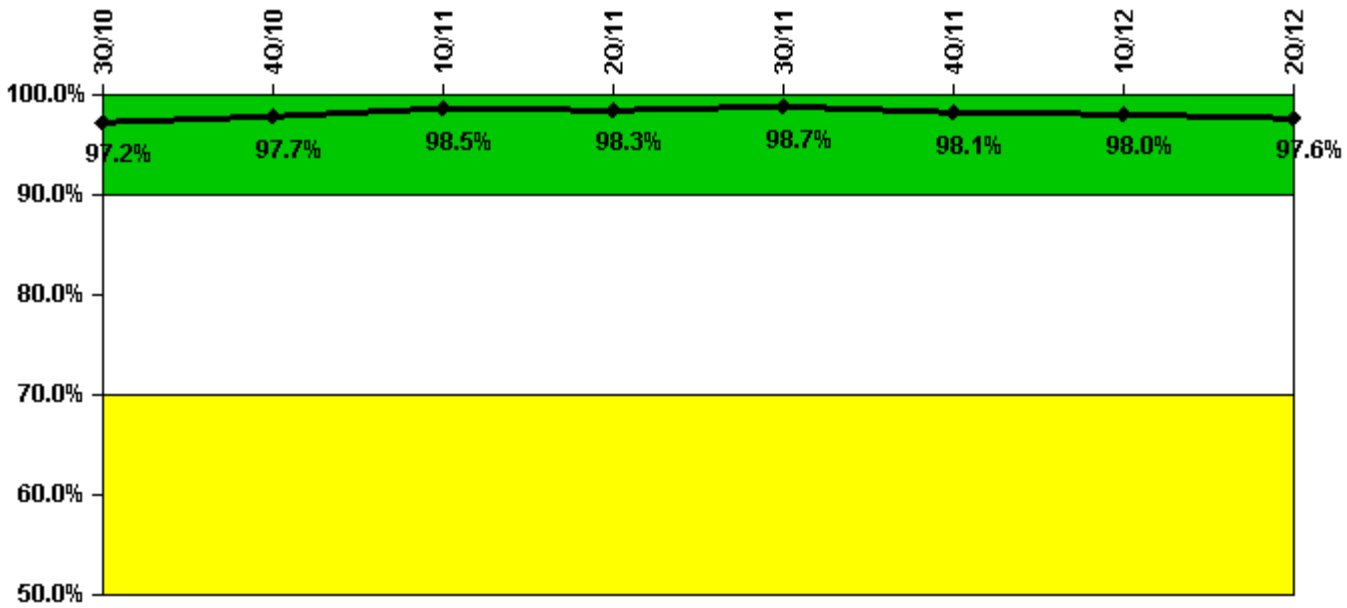


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful opportunities	18.0	35.0	45.0	7.0	58.0	40.0	24.0	22.0
Total opportunities	18.0	36.0	46.0	7.0	59.0	42.0	24.0	23.0
Indicator value	97.2%	97.7%	98.5%	98.3%	98.7%	98.1%	98.0%	97.6%

Licensee Comments: none

## ERO Drill Participation

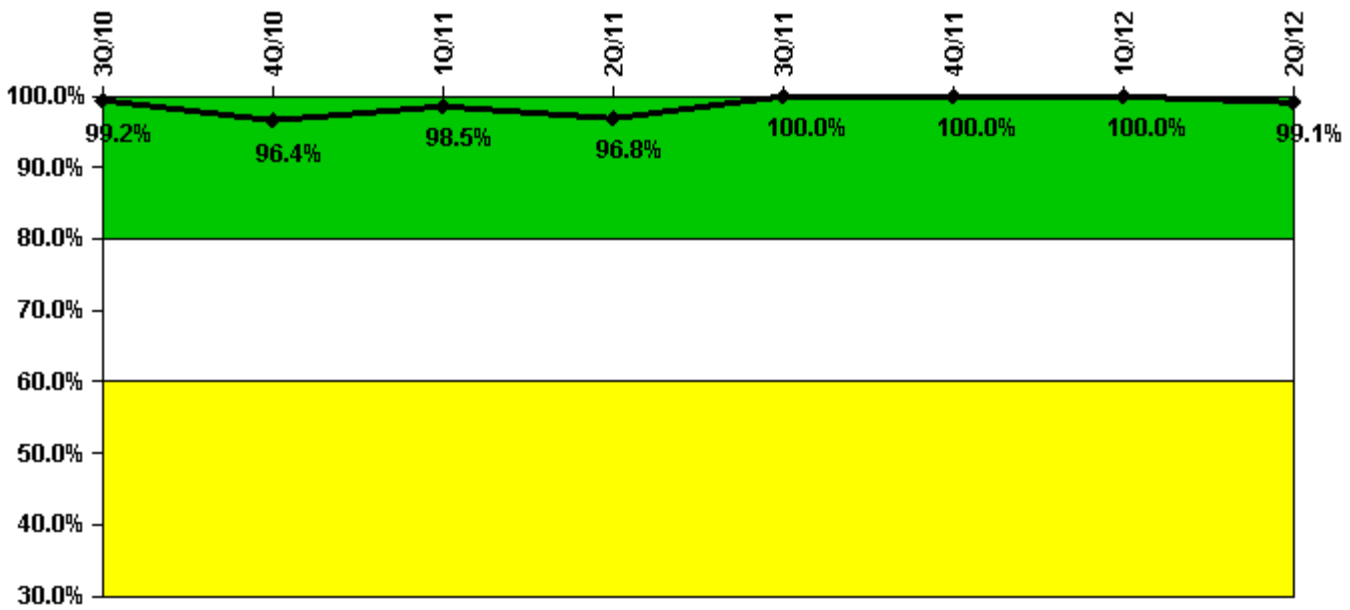


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Participating Key personnel	126.0	135.0	128.0	121.0	117.0	113.0	104.0	106.0
Total Key personnel	127.0	140.0	130.0	125.0	117.0	113.0	104.0	107.0
Indicator value	99.2%	96.4%	98.5%	96.8%	100.0%	100.0%	100.0%	99.1%

Licensee Comments: none

## Alert & Notification System

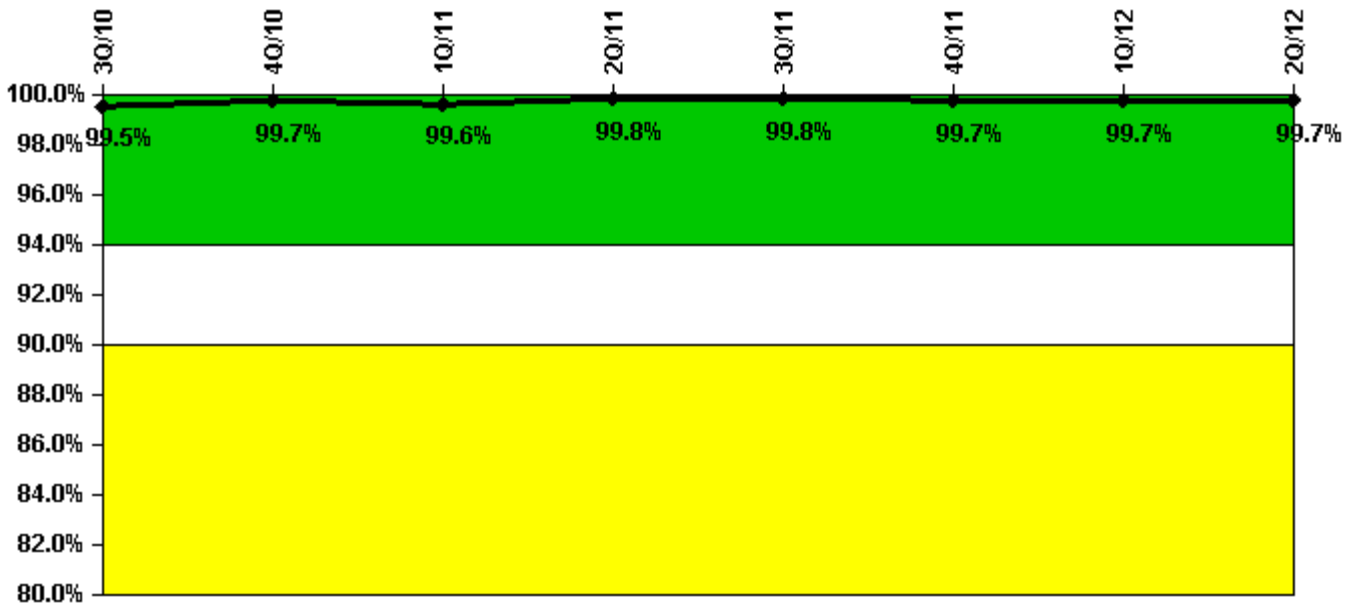


Thresholds: **White** < 94.0% **Yellow** < 90.0%

### Notes

Alert & Notification System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful siren-tests	375	329	375	328	375	328	375	328
Total sirens-tests	376	329	376	329	376	329	376	329
Indicator value	99.5%	99.7%	99.6%	99.8%	99.8%	99.7%	99.7%	99.7%

Licensee Comments: none

## Occupational Exposure Control Effectiveness

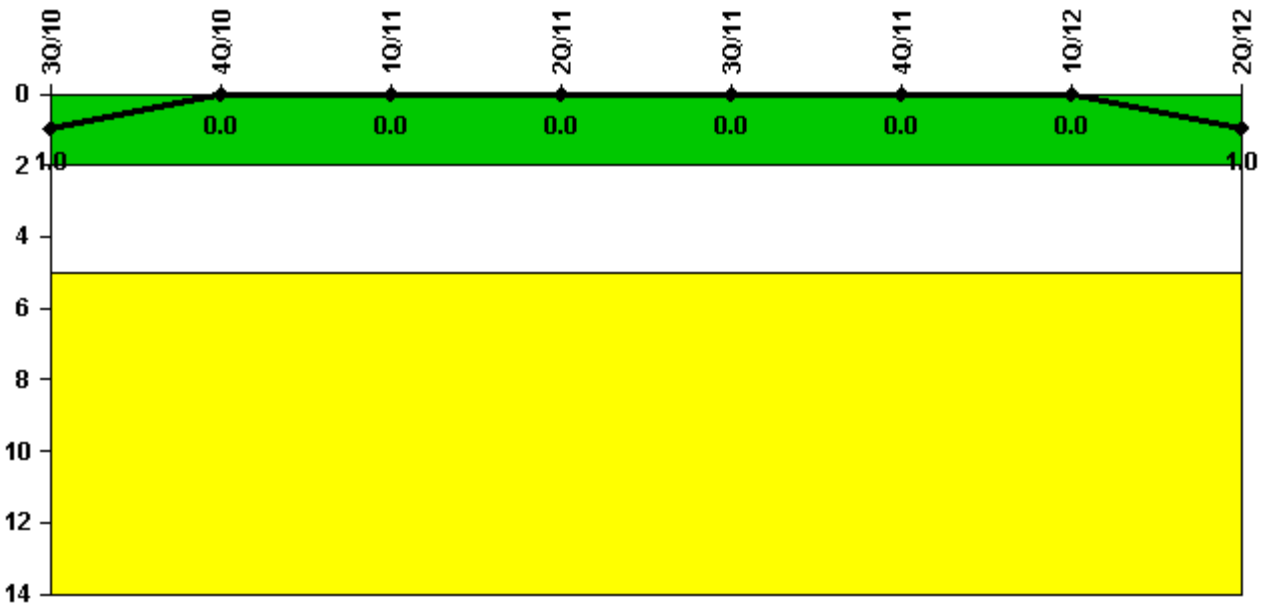

Thresholds: White > 2.0 Yellow > 5.0

### Notes

Occupational Exposure Control Effectiveness	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
High radiation area occurrences	0	0	0	0	0	0	0	1
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	1	0	0	0	0	0	0	1

Licensee Comments:

2Q/12: Turkey Point Unit 3 High Radiation Occurrence on 4-28-12; Condition Report 1760652

## RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

---

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

---