


Vogle 1

2Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

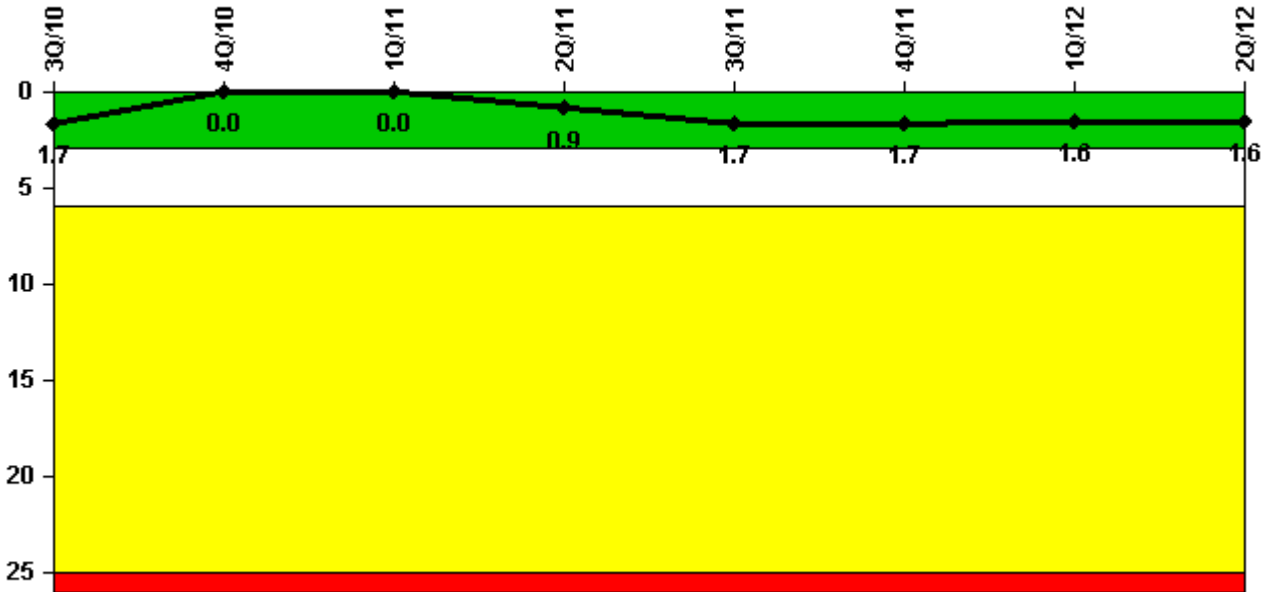


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned scrams	0	0	0	1.0	1.0	0	0	1.0
Critical hours	2208.0	2209.0	1544.5	2105.8	2174.6	2209.0	2183.0	2156.5
Indicator value	1.7	0	0	0.9	1.7	1.7	1.6	1.6

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

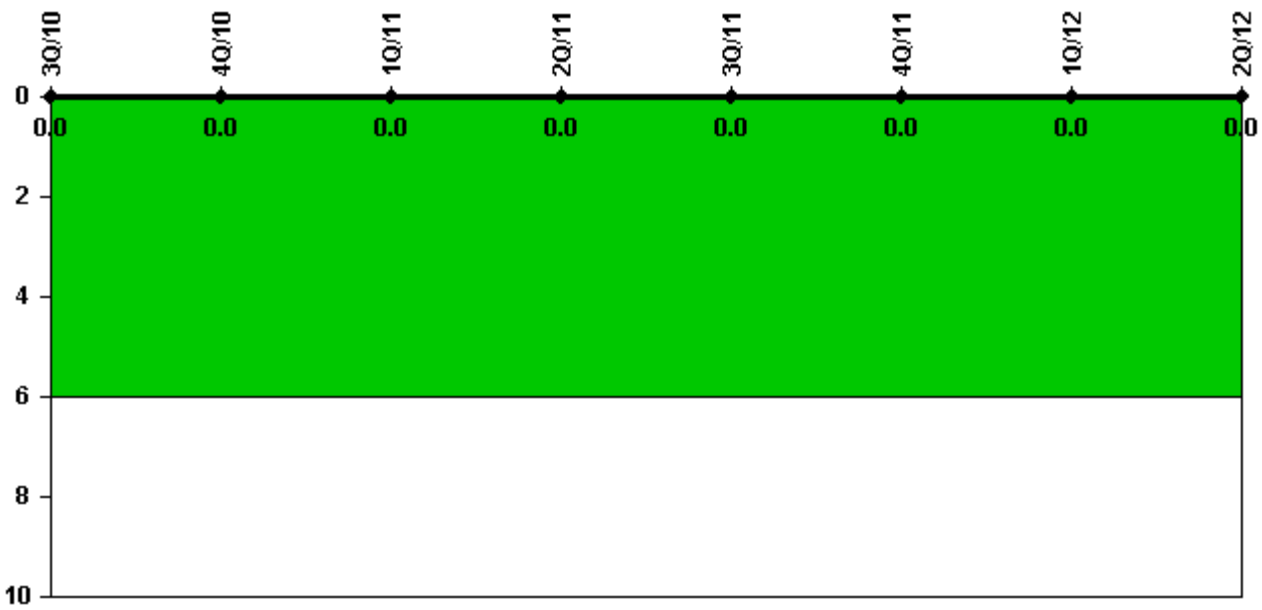


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	1544.5	2105.8	2174.6	2209.0	2183.0	2156.5
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

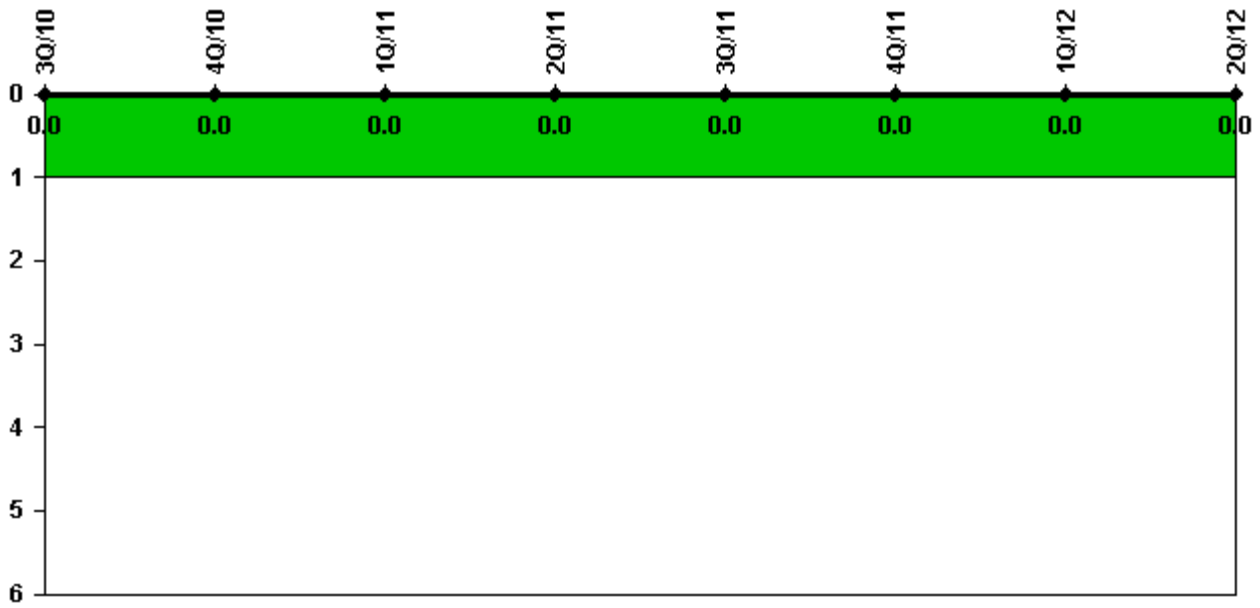


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

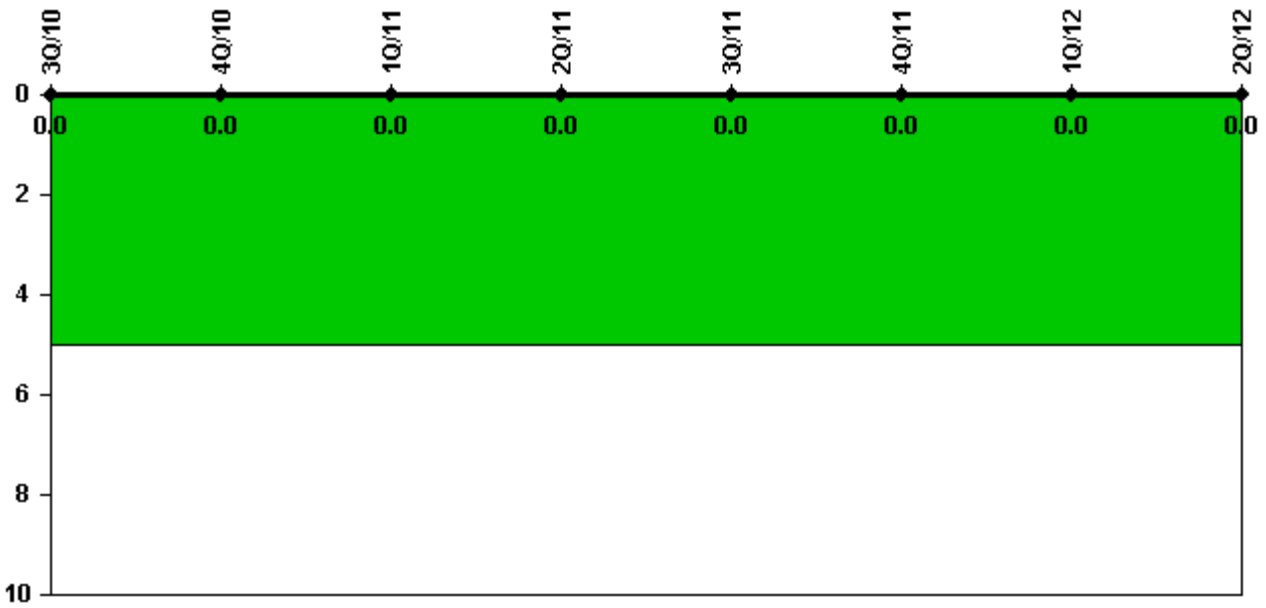


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

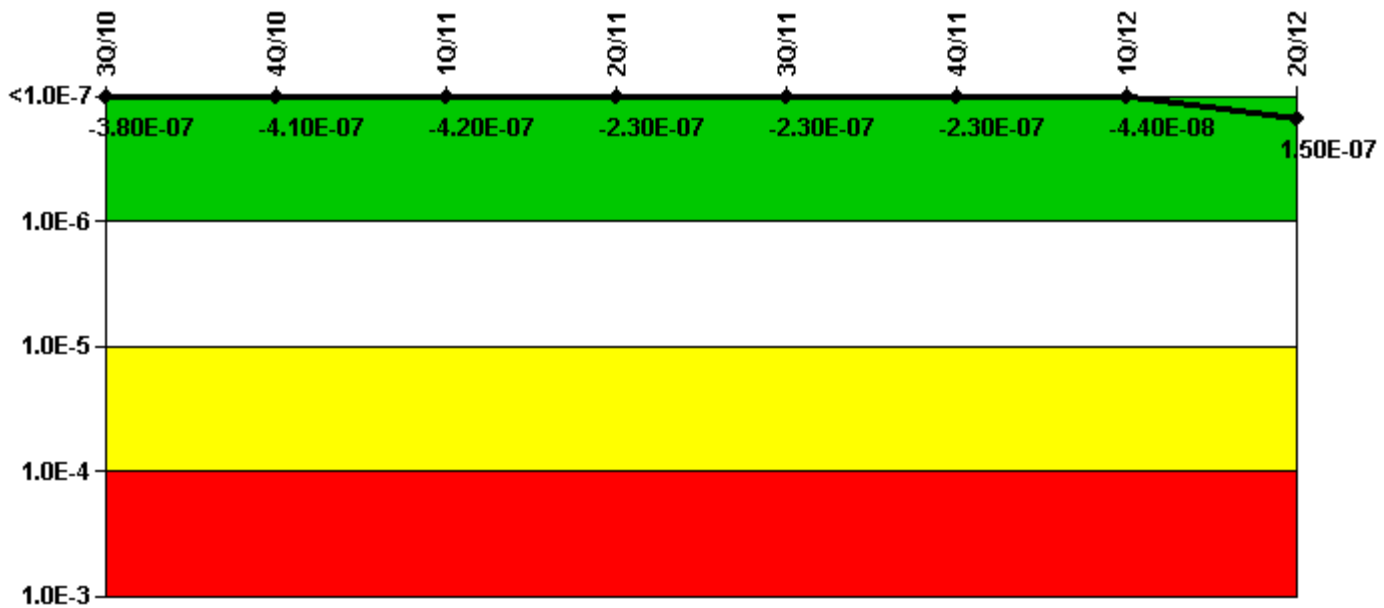

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	-1.31E-07	-1.31E-07	-1.30E-07	-8.03E-08	-8.01E-08	-8.24E-08	1.10E-07	-5.98E-08
URI (Δ CDF)	-2.54E-07	-2.76E-07	-2.86E-07	-1.51E-07	-1.52E-07	-1.49E-07	-1.55E-07	2.13E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.80E-07	-4.10E-07	-4.20E-07	-2.30E-07	-2.30E-07	-2.30E-07	-4.40E-08	1.50E-07

Licensee Comments:

2Q/12: Changed PRA Parameter(s).

3Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

1Q/11: Risk Cap Invoked. Changed PRA Parameter(s).

1Q/11: Risk Cap Invoked.


4Q/10: Risk Cap Invoked.

4Q/10: Risk Cap Invoked. Changed PRA Parameter(s).

3Q/10: Risk Cap Invoked. Changed PRA Parameter(s).

3Q/10: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

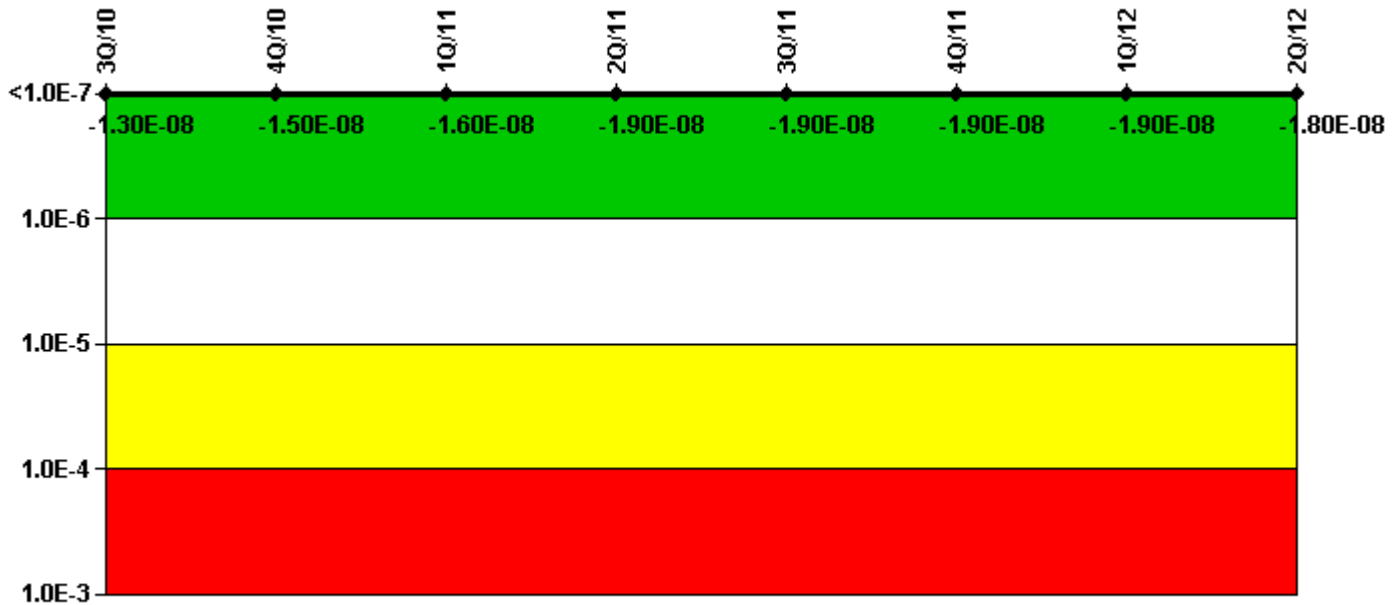

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	-3.40E-09	-5.44E-09	-5.07E-09	-5.67E-09	-5.66E-09	-5.75E-09	-5.85E-09	-5.96E-09
URI (Δ CDF)	-9.66E-09	-9.70E-09	-1.08E-08	-1.33E-08	-1.32E-08	-1.30E-08	-1.28E-08	-1.25E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.30E-08	-1.50E-08	-1.60E-08	-1.90E-08	-1.90E-08	-1.90E-08	-1.90E-08	-1.80E-08


Licensee Comments:

3Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Heat Removal System

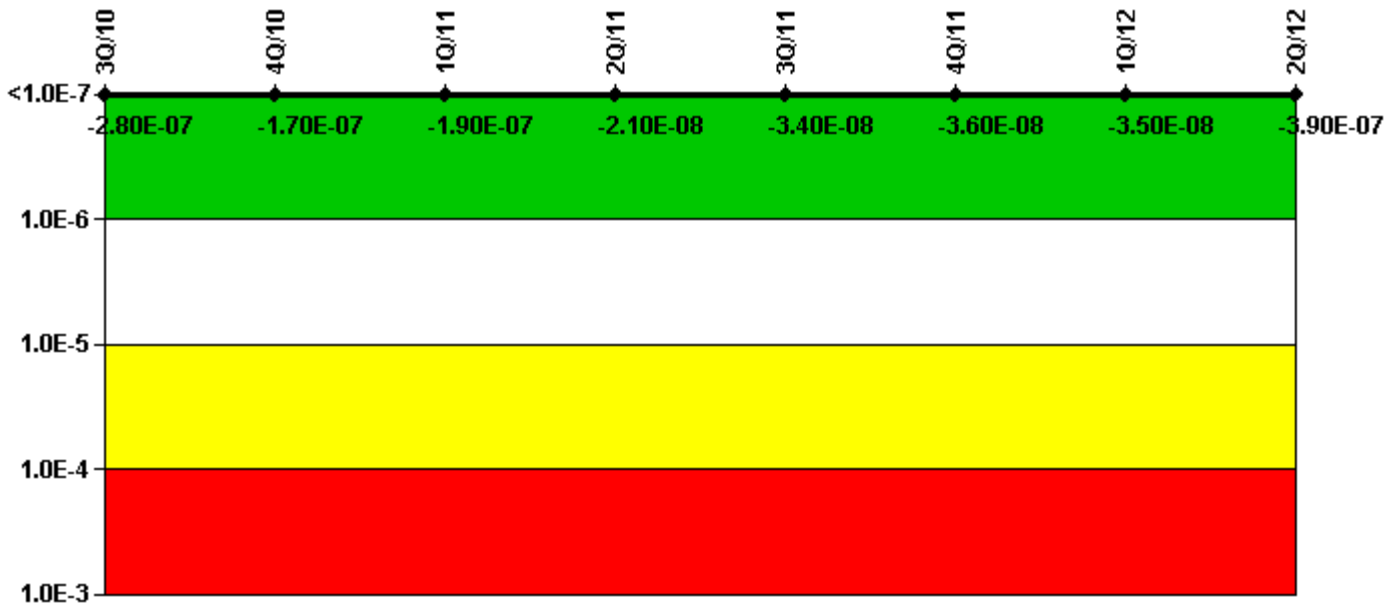

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	-6.57E-09	1.04E-07	1.05E-07	5.65E-09	1.37E-09	-4.61E-10	1.37E-10	-5.36E-08
URI (Δ CDF)	-2.77E-07	-2.77E-07	-2.93E-07	-2.68E-08	-3.52E-08	-3.52E-08	-3.52E-08	-3.38E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.80E-07	-1.70E-07	-1.90E-07	-2.10E-08	-3.40E-08	-3.60E-08	-3.50E-08	-3.90E-07

Licensee Comments:

3Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

1Q/11: Risk Cap Invoked.

1Q/11: Risk Cap Invoked.

1Q/11: Risk Cap Invoked.

4Q/10: Risk Cap Invoked.


4Q/10: Risk Cap Invoked.

4Q/10: Risk Cap Invoked.

3Q/10: Risk Cap Invoked.

3Q/10: Risk Cap Invoked.

Mitigating Systems Performance Index, Residual Heat Removal System

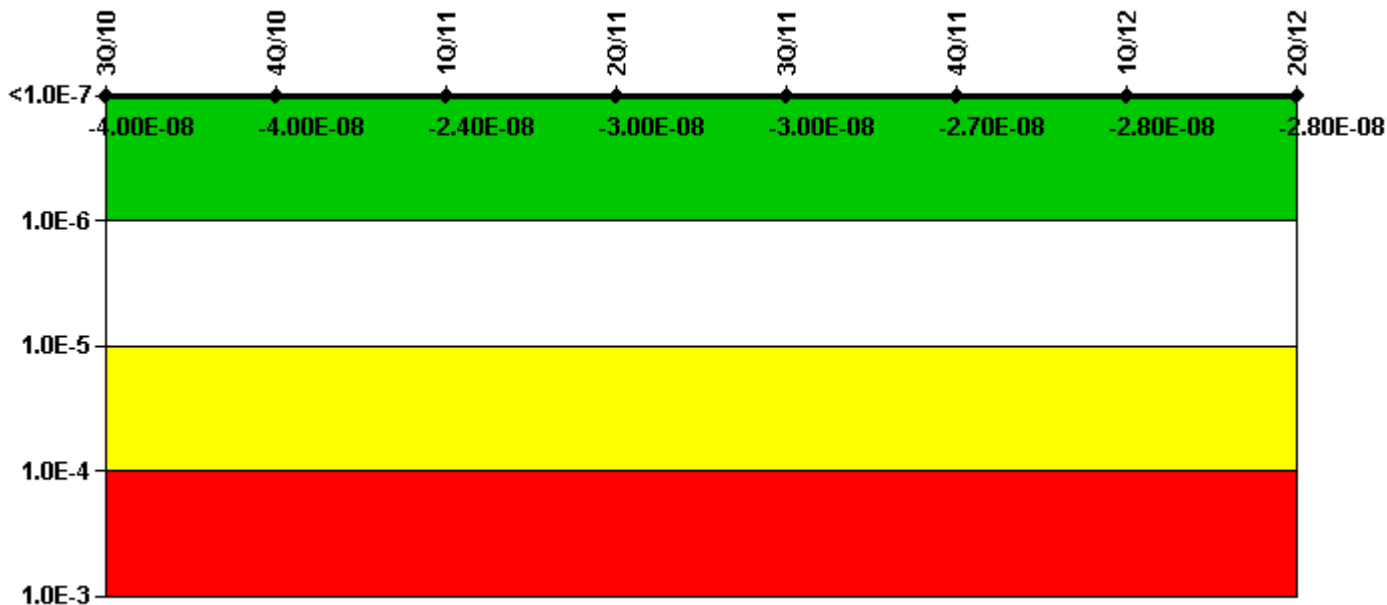

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	-9.57E-09	-9.57E-09	8.25E-09	7.60E-09	7.87E-09	1.07E-08	1.02E-08	1.01E-08
URI (Δ CDF)	-3.07E-08	-3.07E-08	-3.19E-08	-3.76E-08	-3.77E-08	-3.79E-08	-3.81E-08	-3.83E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.00E-08	-4.00E-08	-2.40E-08	-3.00E-08	-3.00E-08	-2.70E-08	-2.80E-08	-2.80E-08


Licensee Comments:

3Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

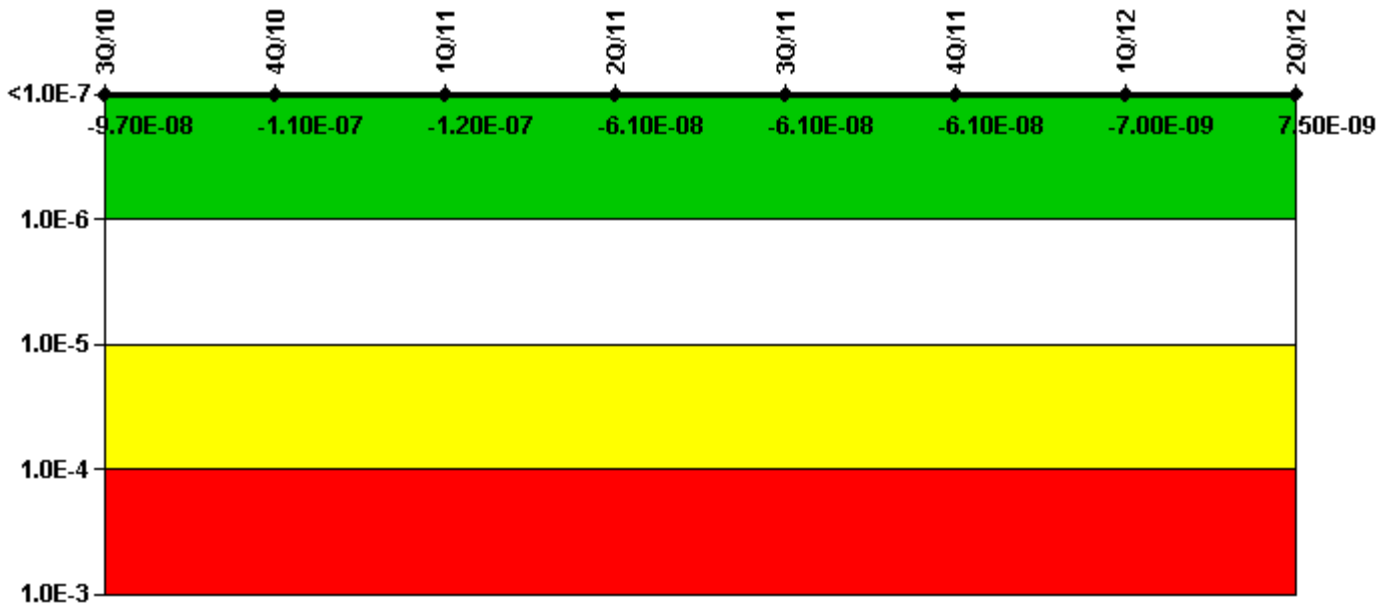

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	2.78E-08	1.10E-08	1.13E-08	2.73E-08	2.73E-08	2.73E-08	3.44E-08	3.45E-08
URI (Δ CDF)	-1.25E-07	-1.26E-07	-1.26E-07	-8.82E-08	-8.84E-08	-8.84E-08	-4.14E-08	-2.70E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.70E-08	-1.10E-07	-1.20E-07	-6.10E-08	-6.10E-08	-6.10E-08	-7.00E-09	7.50E-09

Licensee Comments:


3Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

2Q/11: Changed PRA Parameter(s).

3Q/10: While researching equipment history, discovered that while one NSCW fan was down for maintenance, a second NSCW fan was placed in pull-to-lock which prevents an auto start of that fan, with more than one fan out of service the train was unavailable. The performance level for this indicator remains green.

Reactor Coolant System Activity

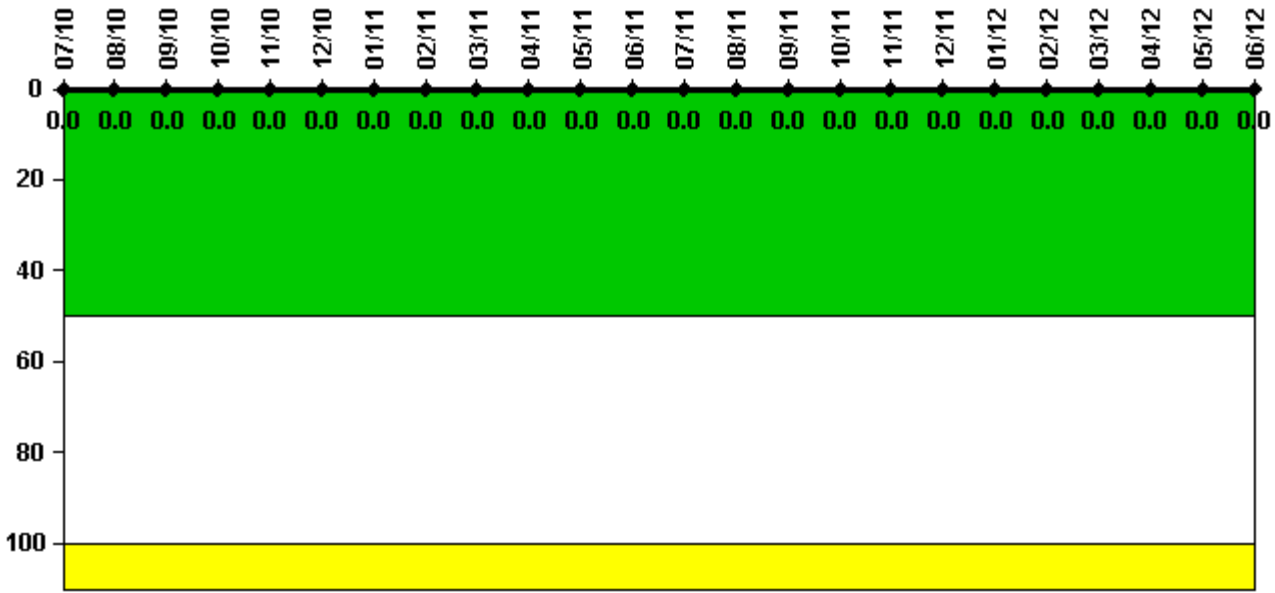

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity	0.000110	0.000111	0.000117	0.000125	0.000129	0.000137	0.000150	0.000163	0.000316	0.000063	0.000058	0.000094
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum activity	0.000057	0.000073	0.000065	0.000073	0.000090	0.000104	0.000095	0.000093	0.000099	0.000102	0.000093	0.000135
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

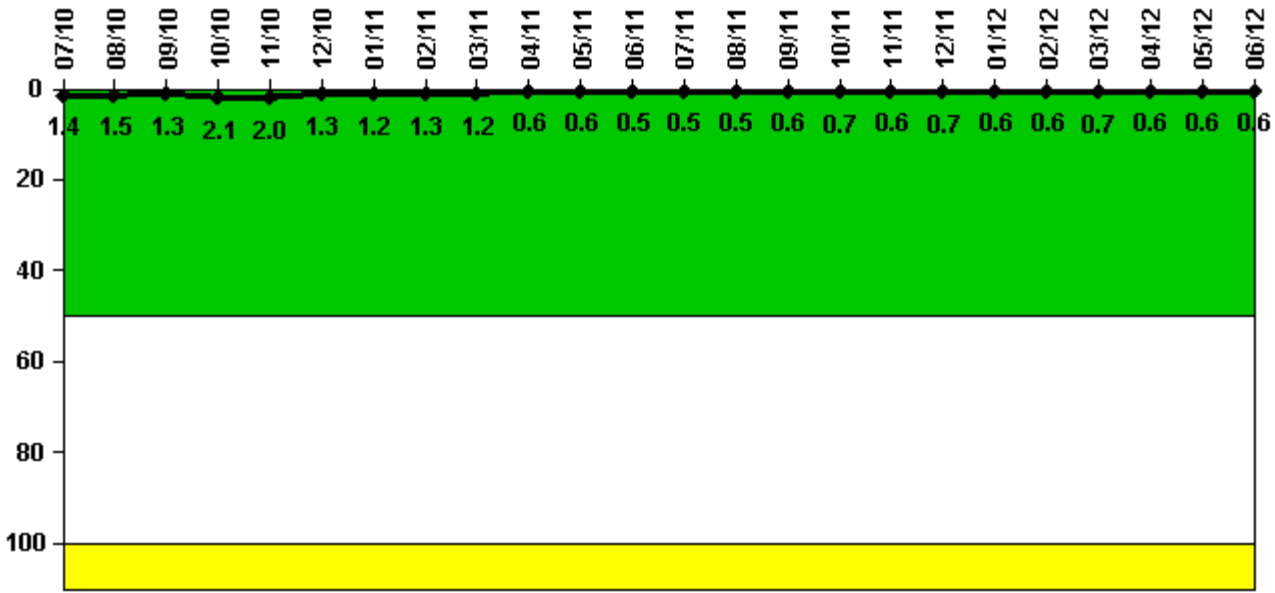


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	0.137	0.149	0.125	0.211	0.195	0.128	0.122	0.131	0.116	0.057	0.057	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.4	1.5	1.3	2.1	2.0	1.3	1.2	1.3	1.2	0.6	0.6	0.5
Reactor Coolant System Leakage	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum leakage	0.048	0.049	0.060	0.065	0.059	0.068	0.062	0.063	0.070	0.057	0.064	0.062
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.5	0.6	0.7	0.6	0.7	0.6	0.6	0.7	0.6	0.6	0.6

Licensee Comments: none

Drill/Exercise Performance

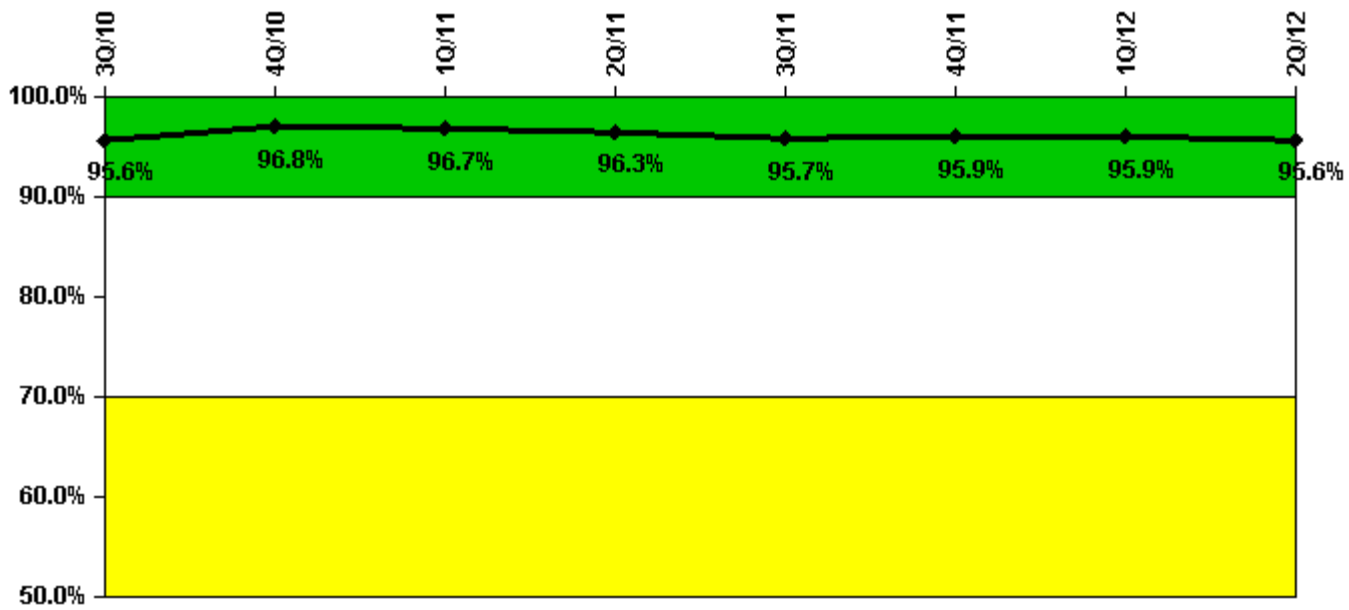


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful opportunities	35.0	30.0	52.0	66.0	38.0	25.0	55.0	50.0
Total opportunities	35.0	32.0	54.0	70.0	41.0	26.0	56.0	53.0
Indicator value	95.6%	96.8%	96.7%	96.3%	95.7%	95.9%	95.9%	95.6%

Licensee Comments: none

ERO Drill Participation

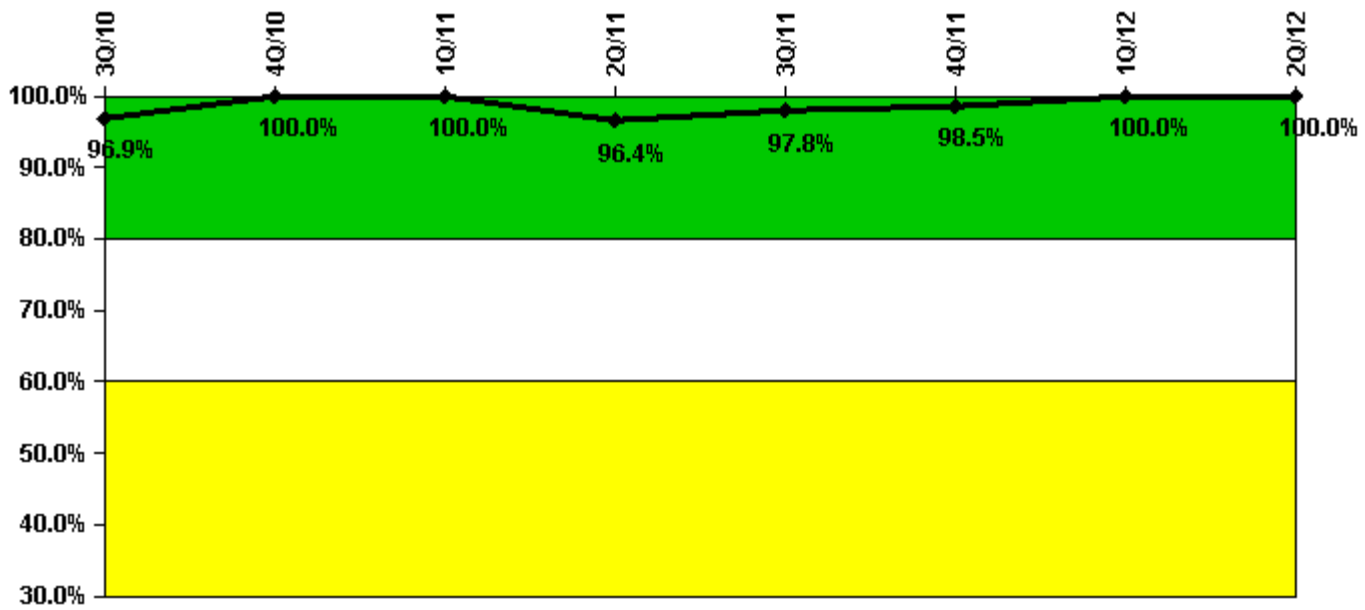


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Participating Key personnel	126.0	132.0	140.0	133.0	132.0	132.0	130.0	123.0
Total Key personnel	130.0	132.0	140.0	138.0	135.0	134.0	130.0	123.0
Indicator value	96.9%	100.0%	100.0%	96.4%	97.8%	98.5%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

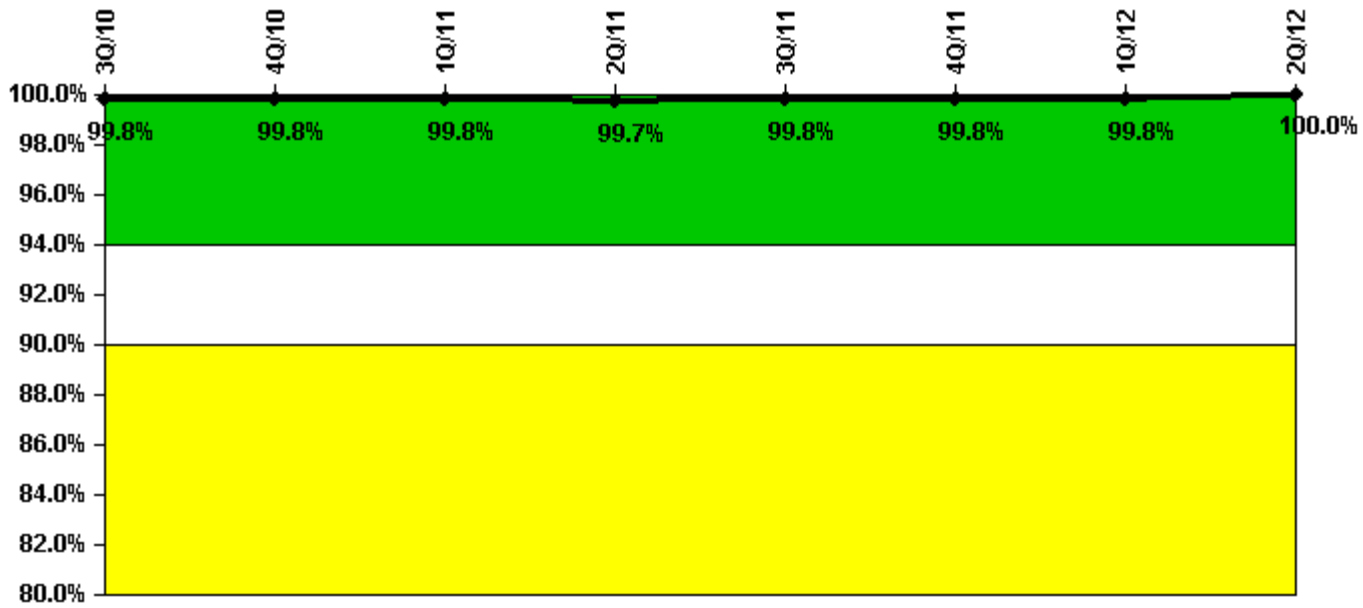


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful siren-tests	608	611	610	608	611	611	610	564
Total sirens-tests	611	611	611	611	611	611	611	564
Indicator value	99.8%	99.8%	99.8%	99.7%	99.8%	99.8%	99.8%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

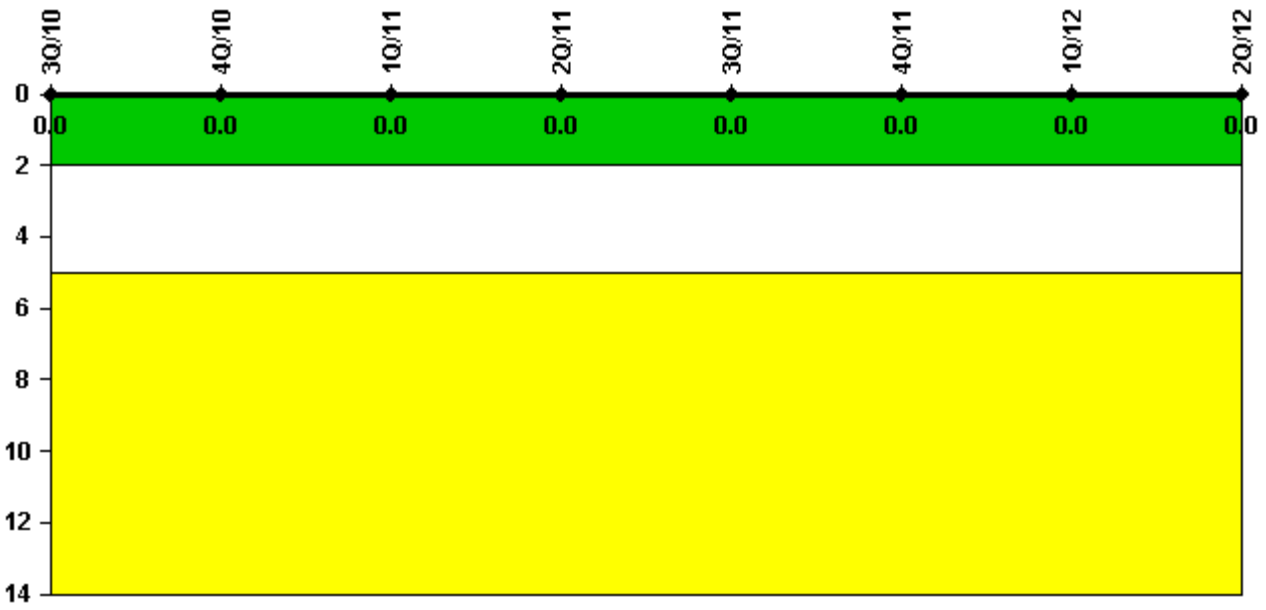

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.
