


Indian Point 2

3Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

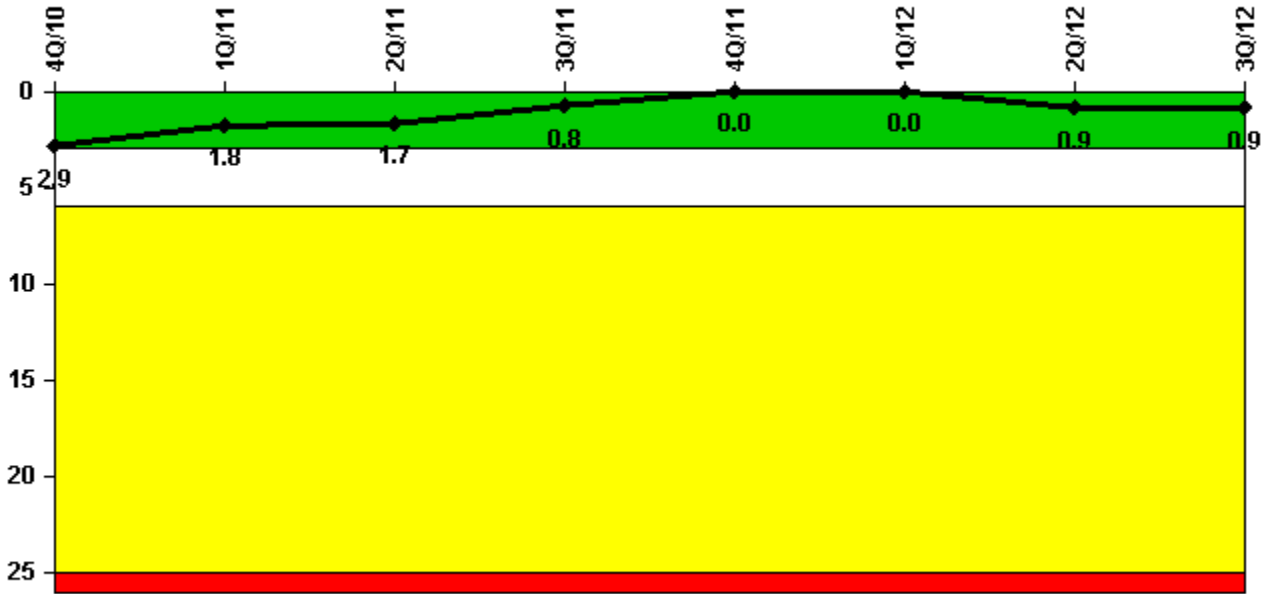


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Unplanned scrams	1.0	0	0	0	0	0	1.0	0
Critical hours	1832.8	2159.0	2087.1	2208.0	2209.0	1368.1	2154.6	2208.0
Indicator value	2.9	1.8	1.7	0.8	0	0	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

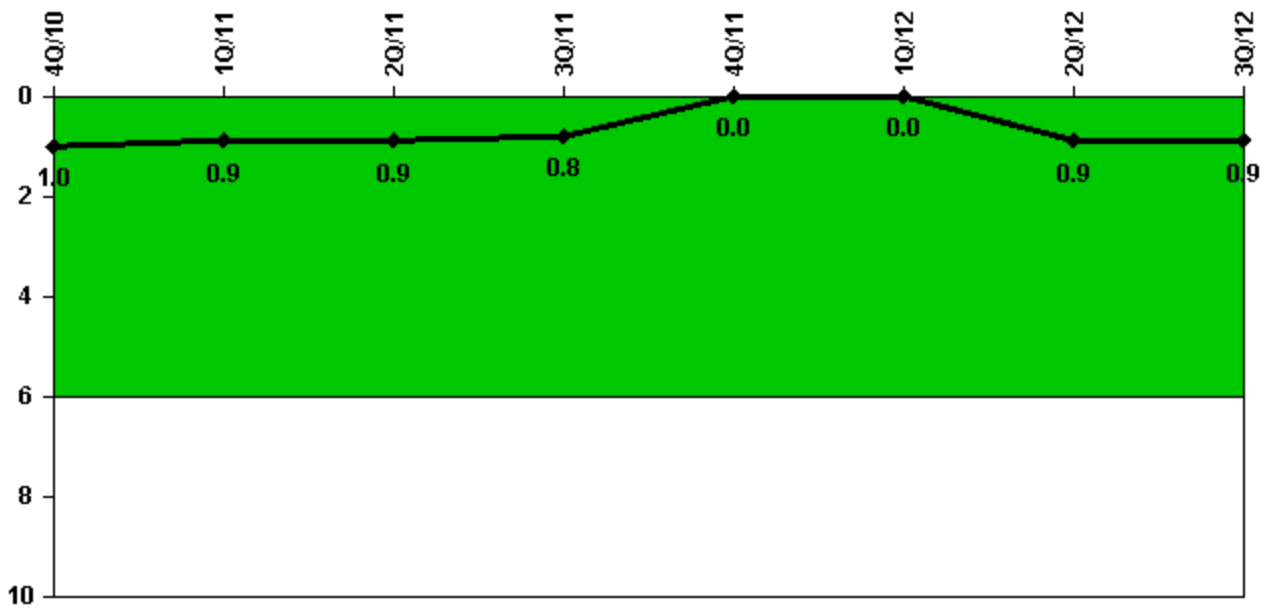


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Unplanned power changes	1.0	0	0	0	0	0	1.0	0
Critical hours	1832.8	2159.0	2087.1	2208.0	2209.0	1368.1	2154.6	2208.0
Indicator value	1.0	0.9	0.9	0.8	0	0	0.9	0.9

Licensee Comments: none

Unplanned Scrams with Complications

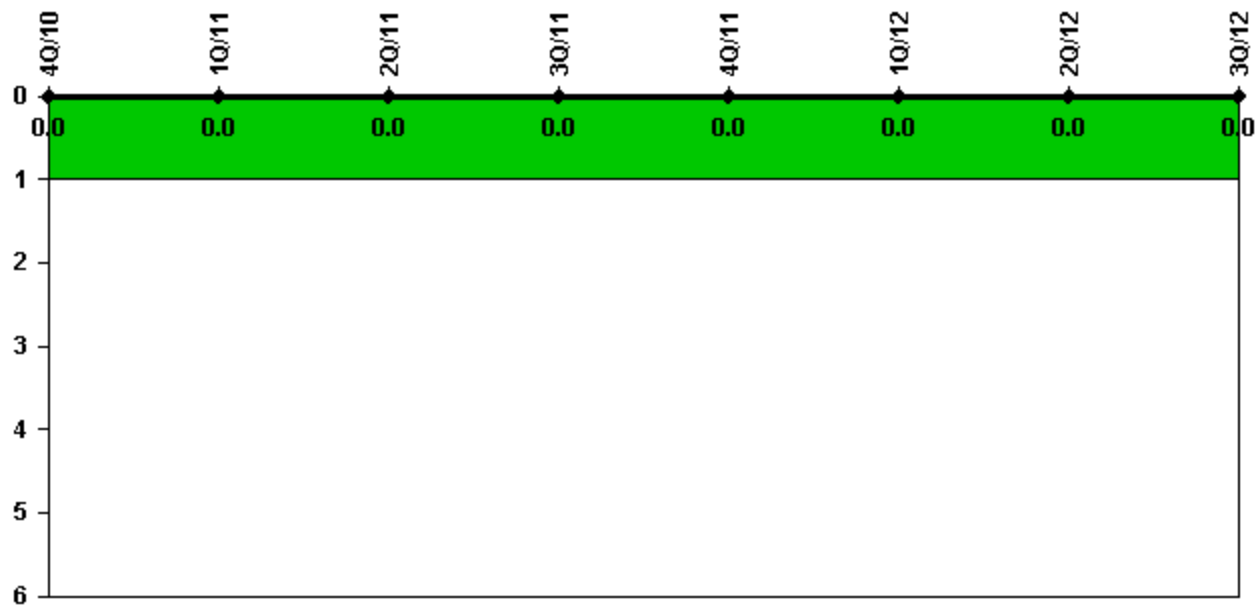


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

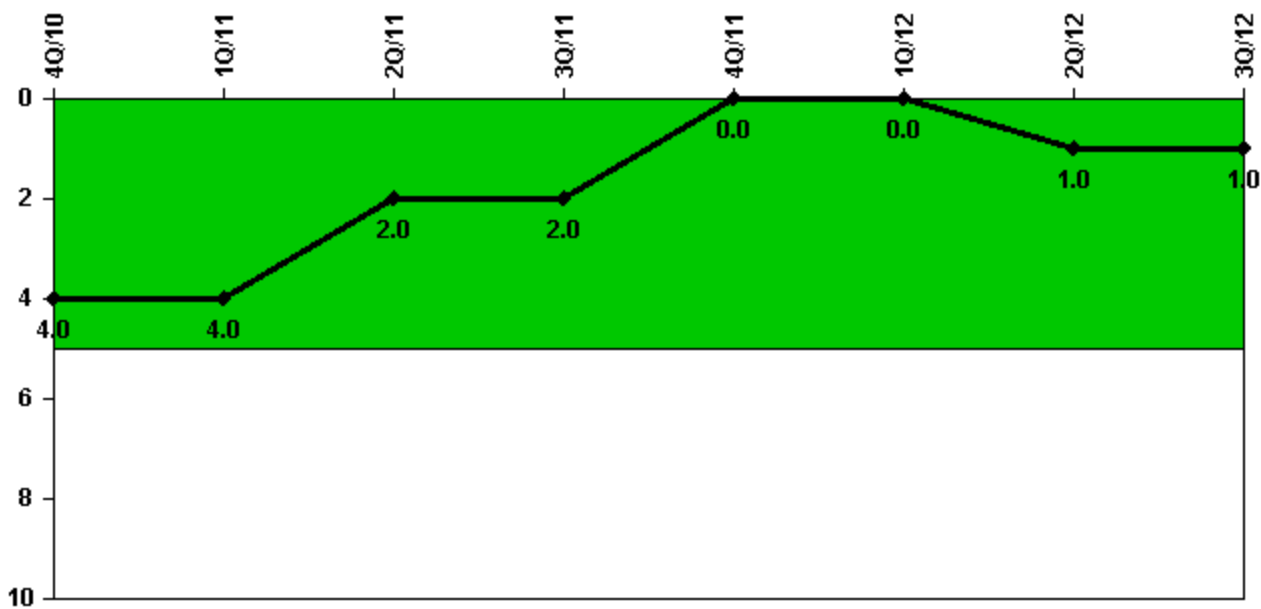

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Safety System Functional Failures	2	0	0	0	0	0	1	0
Indicator value	4	4	2	2	0	0	1	1

Licensee Comments:

2Q/12: LER-2012-004 reported a SSFF for one motor driven Auxiliary Feedwater Pump out of service during testing during the time liquid radiation monitor calibration was being performed which results in a Rad Bypass switch position for steam generator (SG)blowdown isolation valves being defeated for automatic isolation for degraded heat sink events. Condition can result in inadequate maintenance of SG inventory.

Mitigating Systems Performance Index, Emergency AC Power System

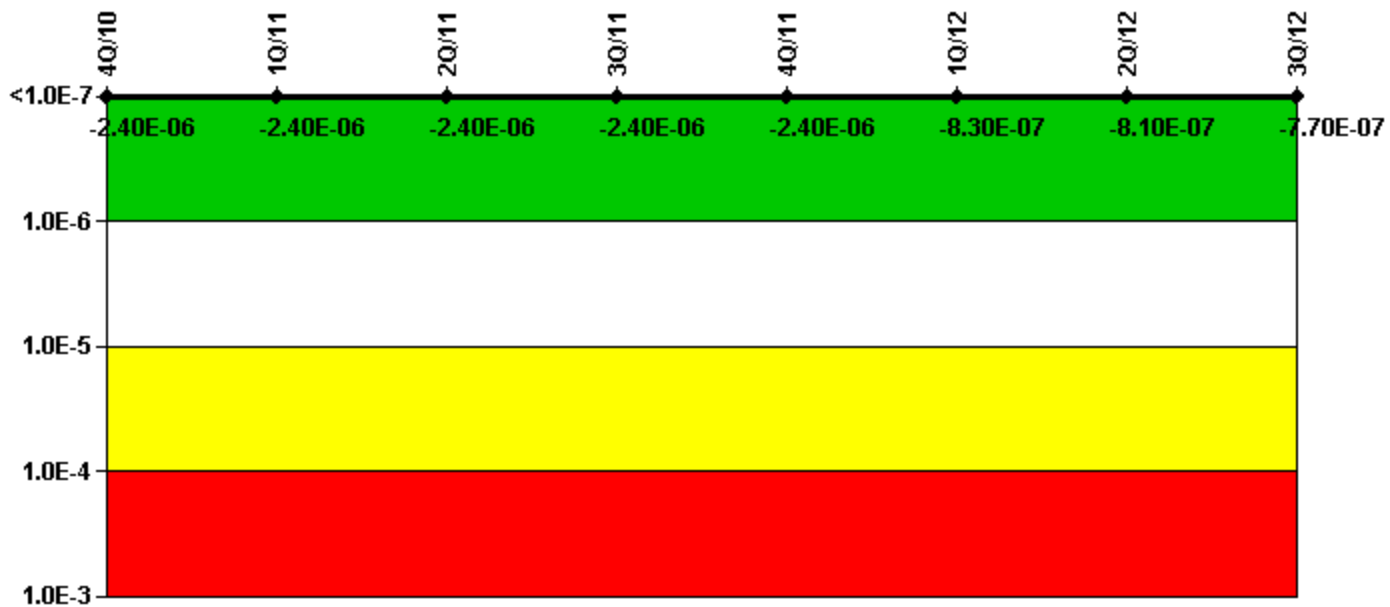

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
UAI (Δ CDF)	7.42E-07	6.97E-07	6.06E-07	6.11E-07	5.48E-07	7.71E-08	1.19E-07	1.28E-07
URI (Δ CDF)	-3.13E-06	-3.12E-06	-2.98E-06	-3.00E-06	-2.97E-06	-9.11E-07	-9.27E-07	-8.94E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.40E-06	-2.40E-06	-2.40E-06	-2.40E-06	-2.40E-06	-8.30E-07	-8.10E-07	-7.70E-07

Licensee Comments:

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s).

4Q/11: Risk Cap Invoked.


3Q/11: Risk Cap Invoked.

2Q/11: Risk Cap Invoked.

1Q/11: Risk Cap Invoked.

4Q/10: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

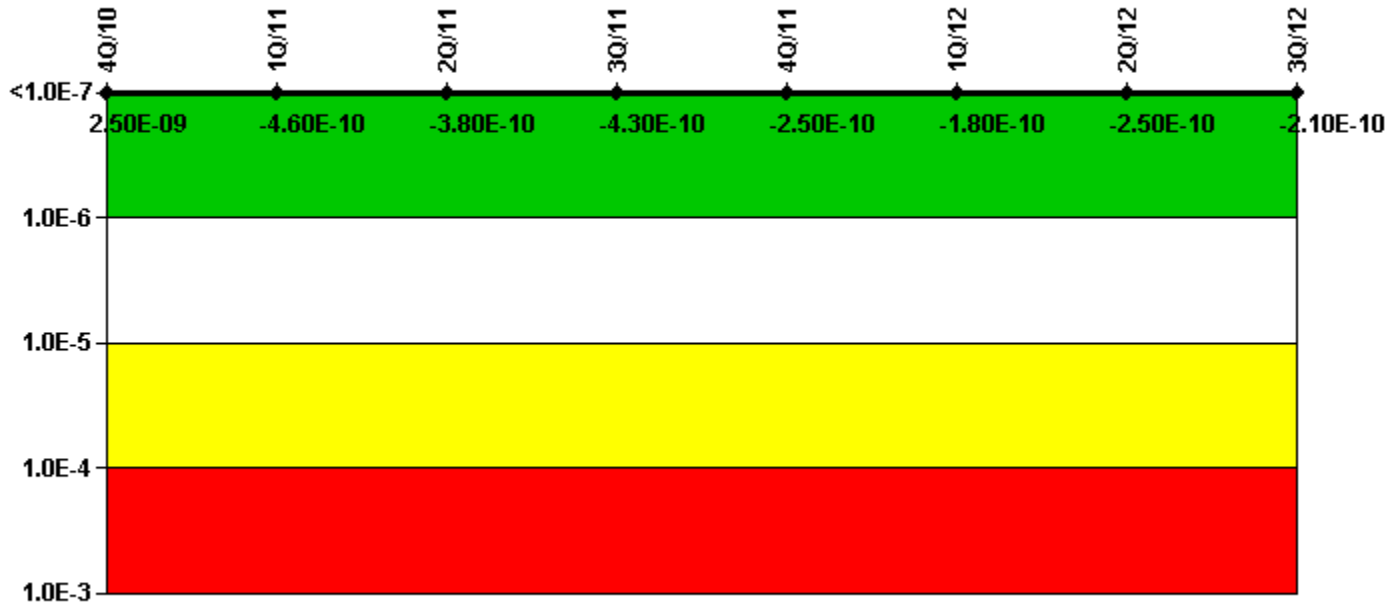

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, High Pressure Injection System	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
UAI (Δ CDF)	-2.03E-10	-2.03E-10	-1.44E-10	-2.03E-10	-7.35E-12	-2.90E-11	-2.90E-11	2.23E-11
URI (Δ CDF)	2.71E-09	-2.56E-10	-2.36E-10	-2.31E-10	-2.46E-10	-1.53E-10	-2.20E-10	-2.31E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.50E-09	-4.60E-10	-3.80E-10	-4.30E-10	-2.50E-10	-1.80E-10	-2.50E-10	-2.10E-10

Licensee Comments:

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Heat Removal System

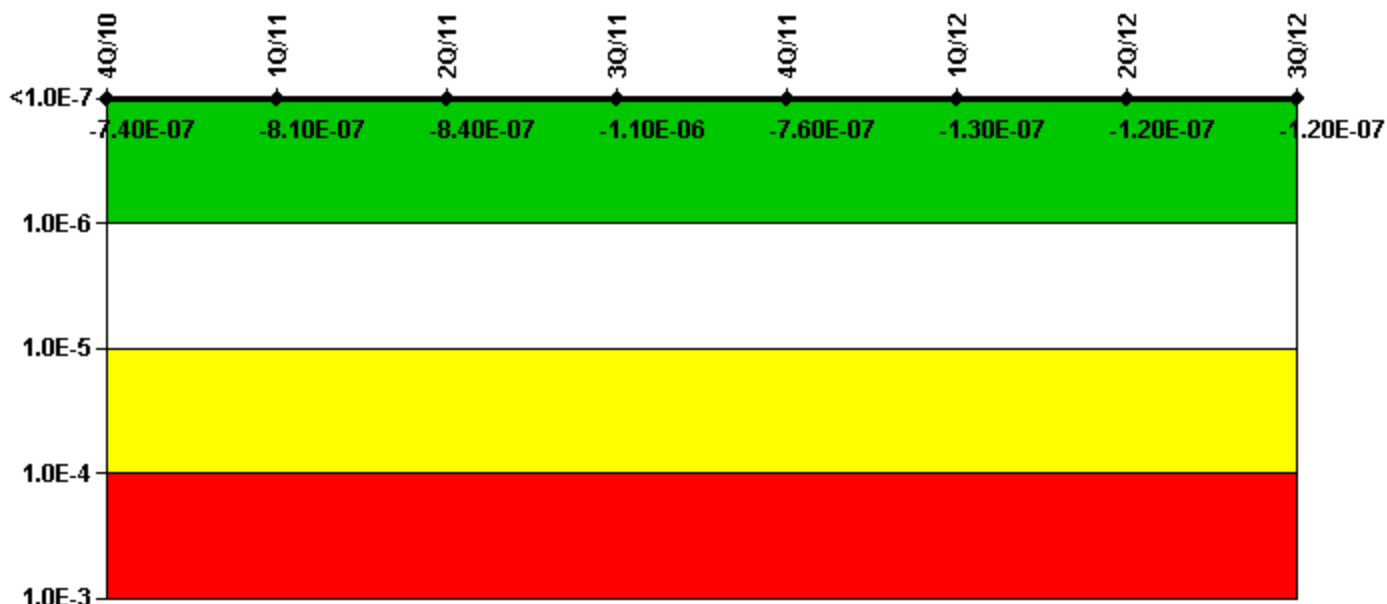

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Heat Removal System	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
UAI (Δ CDF)	3.16E-07	2.08E-07	1.39E-07	-8.04E-08	-1.90E-07	-1.80E-08	-2.19E-08	-2.10E-08
URI (Δ CDF)	-1.05E-06	-1.02E-06	-9.79E-07	-9.76E-07	-5.68E-07	-1.15E-07	-9.75E-08	-9.64E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.40E-07	-8.10E-07	-8.40E-07	-1.10E-06	-7.60E-07	-1.30E-07	-1.20E-07	-1.20E-07

Licensee Comments:

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Residual Heat Removal System

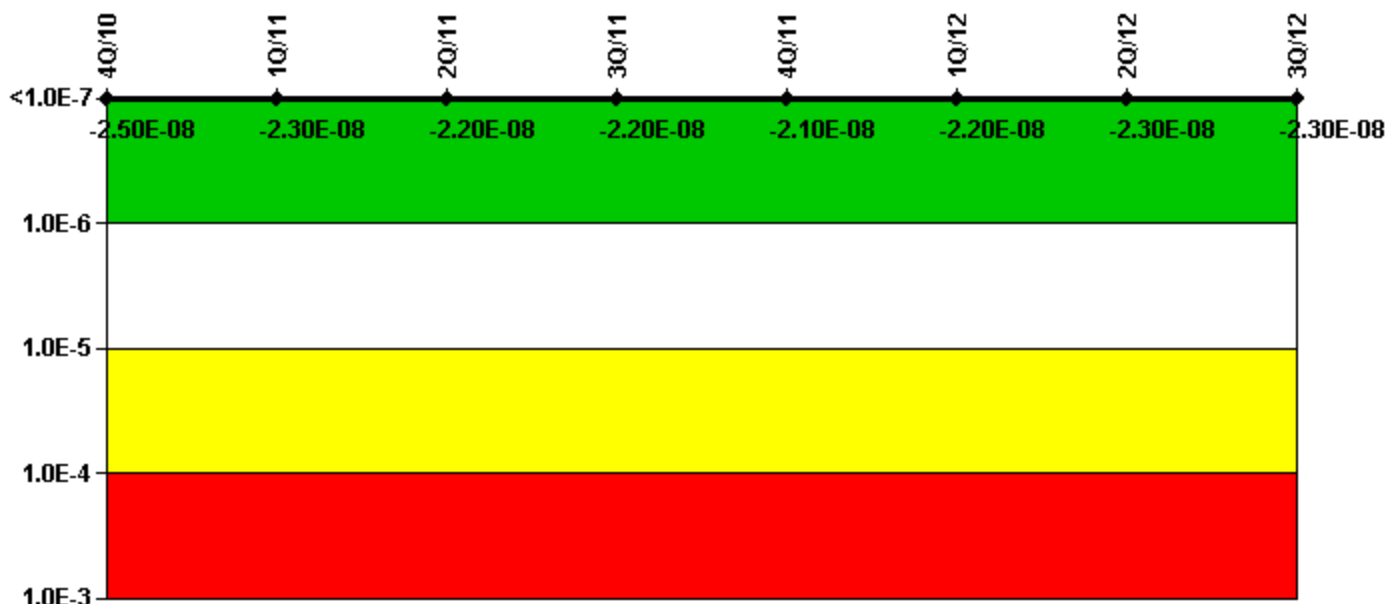

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Residual Heat Removal System	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
UAI (Δ CDF)	-1.09E-08	-1.09E-08	-1.09E-08	-1.10E-08	-1.09E-08	-8.82E-09	-8.80E-09	-8.71E-09
URI (Δ CDF)	-1.37E-08	-1.24E-08	-1.11E-08	-1.09E-08	-1.05E-08	-1.36E-08	-1.37E-08	-1.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-08	-2.30E-08	-2.20E-08	-2.20E-08	-2.10E-08	-2.20E-08	-2.30E-08	-2.30E-08

Licensee Comments:

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

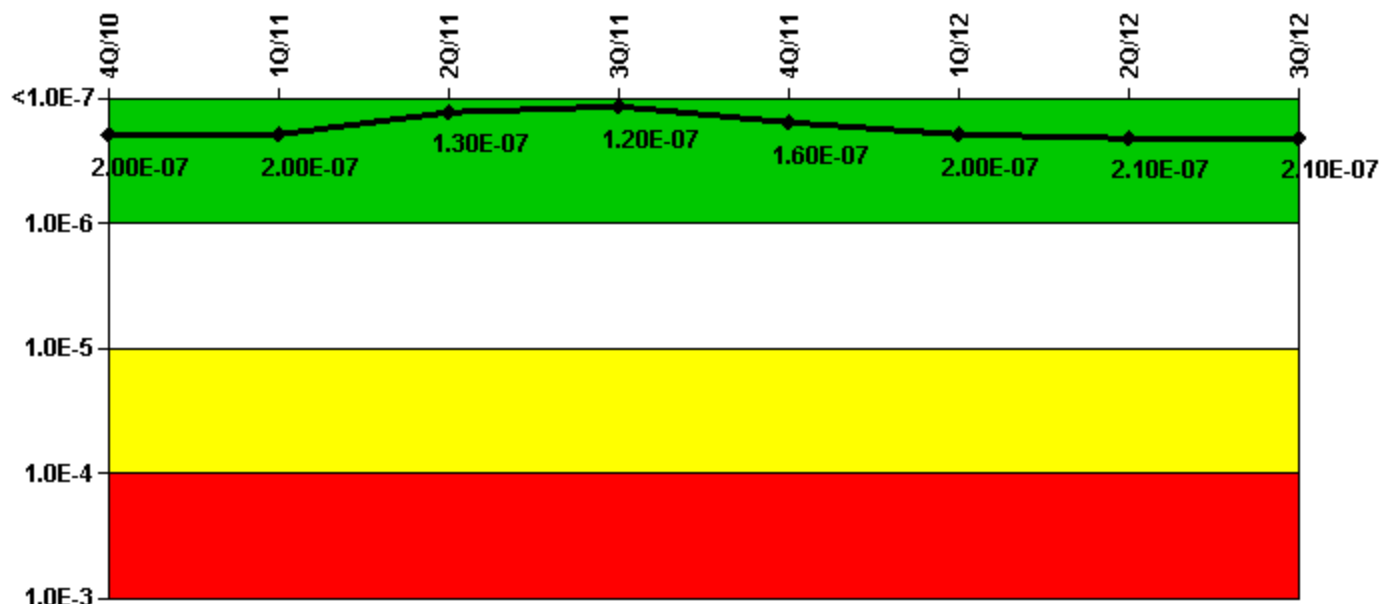

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Cooling Water Systems	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
UAI (ΔCDF)	1.01E-07	1.27E-07	7.99E-08	7.49E-08	7.59E-08	2.06E-08	2.10E-08	2.04E-08
URI (ΔCDF)	1.03E-07	7.15E-08	4.61E-08	4.59E-08	8.02E-08	1.76E-07	1.90E-07	1.88E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.00E-07	2.00E-07	1.30E-07	1.20E-07	1.60E-07	2.00E-07	2.10E-07	2.10E-07

Licensee Comments:

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s).

Reactor Coolant System Activity

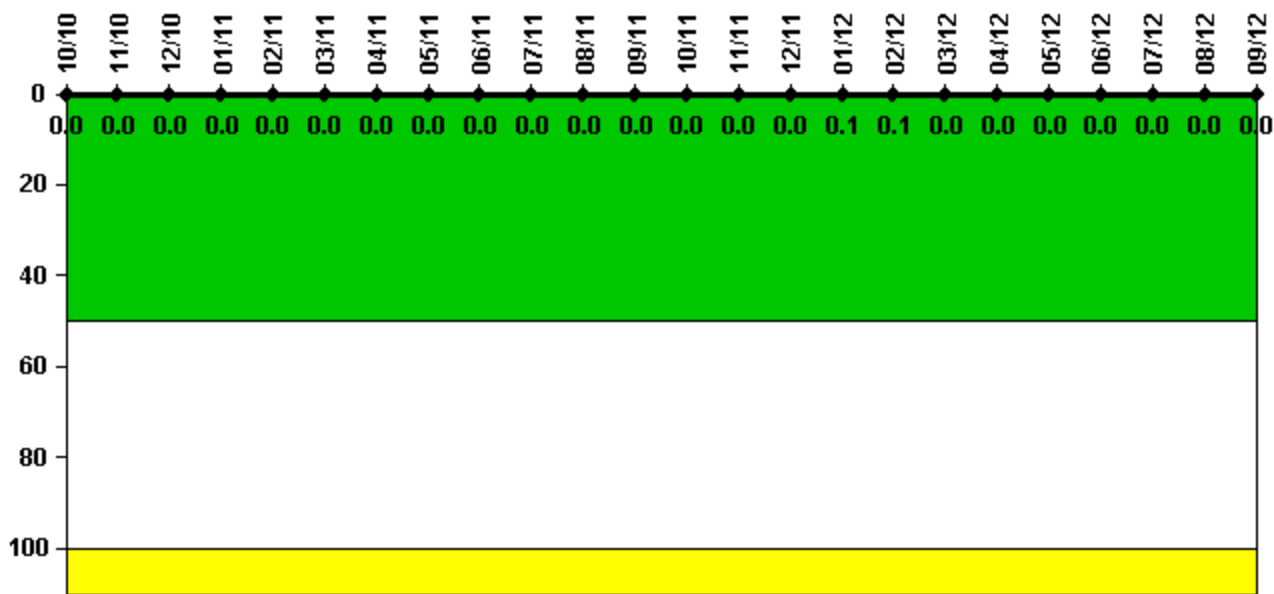


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum activity	0.000333	0.000325	0.000350	0.000362	0.000333	0.000389	0.000370	0.000411	0.000398	0.000446	0.000450	0.000474
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12
Maximum activity	0.000472	0.000467	0.000476	0.000500	0.000509	0.000459	0.000198	0.000189	0.000187	0.000196	0.000215	0.000217
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0.1	0.1	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

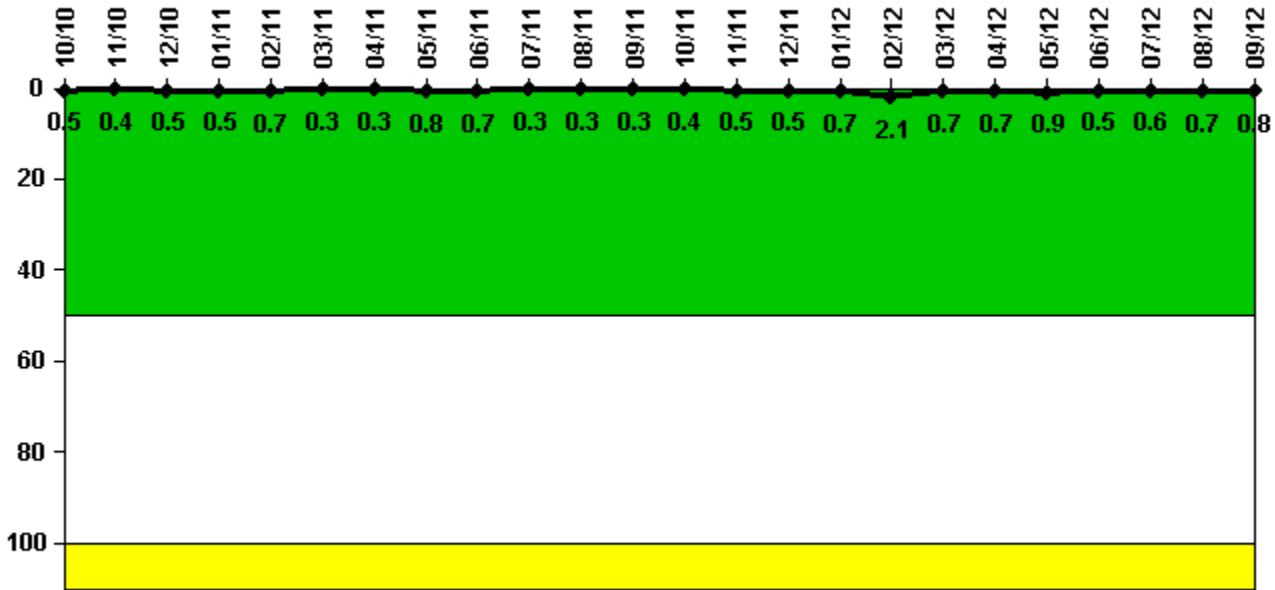


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11
Maximum leakage	0.050	0.040	0.050	0.050	0.070	0.030	0.030	0.080	0.070	0.030	0.030	0.030
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.4	0.5	0.5	0.7	0.3	0.3	0.8	0.7	0.3	0.3	0.3
Reactor Coolant System Leakage	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12
Maximum leakage	0.040	0.050	0.050	0.070	0.210	0.070	0.070	0.090	0.050	0.060	0.070	0.080
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.5	0.5	0.7	2.1	0.7	0.7	0.9	0.5	0.6	0.7	0.8

Licensee Comments: none

Drill/Exercise Performance

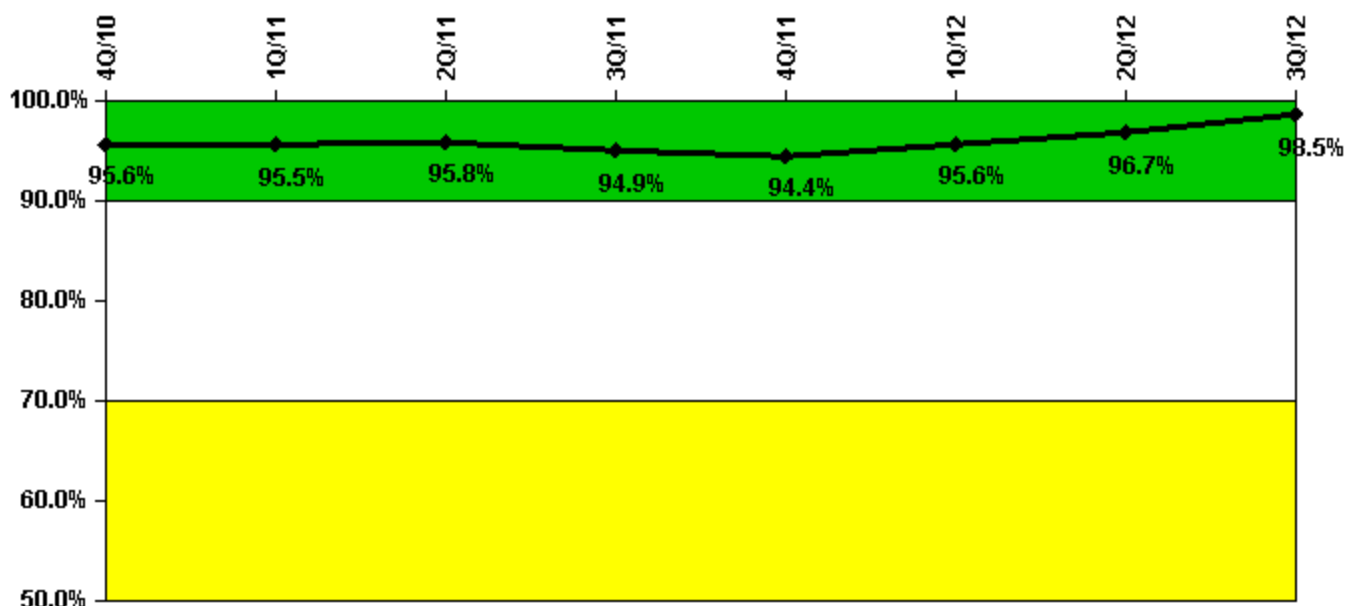


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Successful opportunities	55.0	19.0	66.0	143.0	14.0	131.0	289.0	374.0
Total opportunities	56.0	21.0	66.0	151.0	16.0	131.0	293.0	374.0
Indicator value	95.6%	95.5%	95.8%	94.9%	94.4%	95.6%	96.7%	98.5%

Licensee Comments: none

ERO Drill Participation

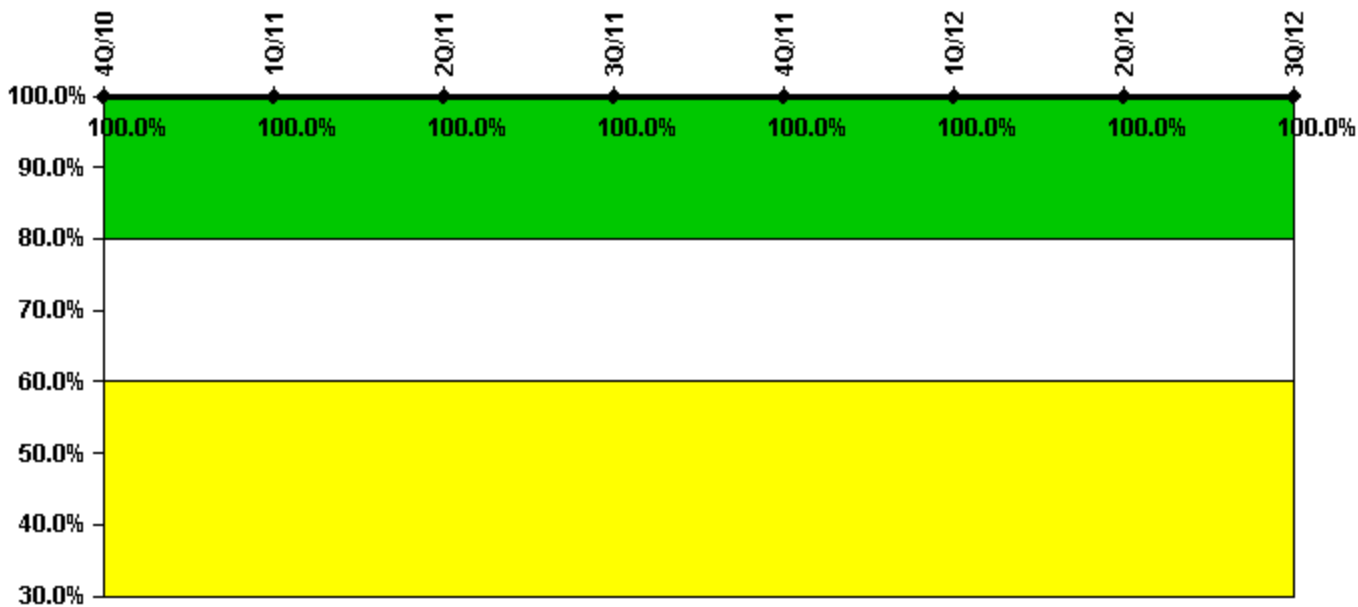


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Participating Key personnel	104.0	102.0	102.0	105.0	104.0	106.0	105.0	106.0
Total Key personnel	104.0	102.0	102.0	105.0	104.0	106.0	105.0	106.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

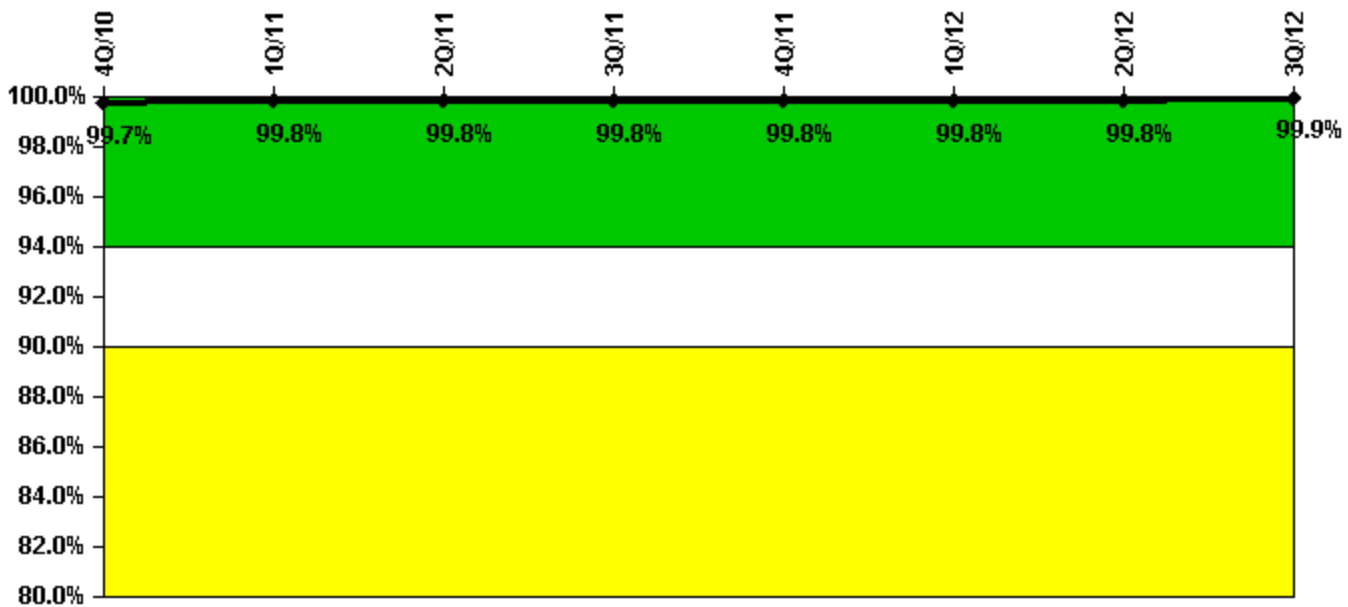


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
Successful siren-tests	956	1012	1176	1201	993	956	787	1415
Total sirens-tests	957	1013	1179	1204	996	957	789	1415
Indicator value	99.7%	99.8%	99.8%	99.8%	99.8%	99.8%	99.8%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

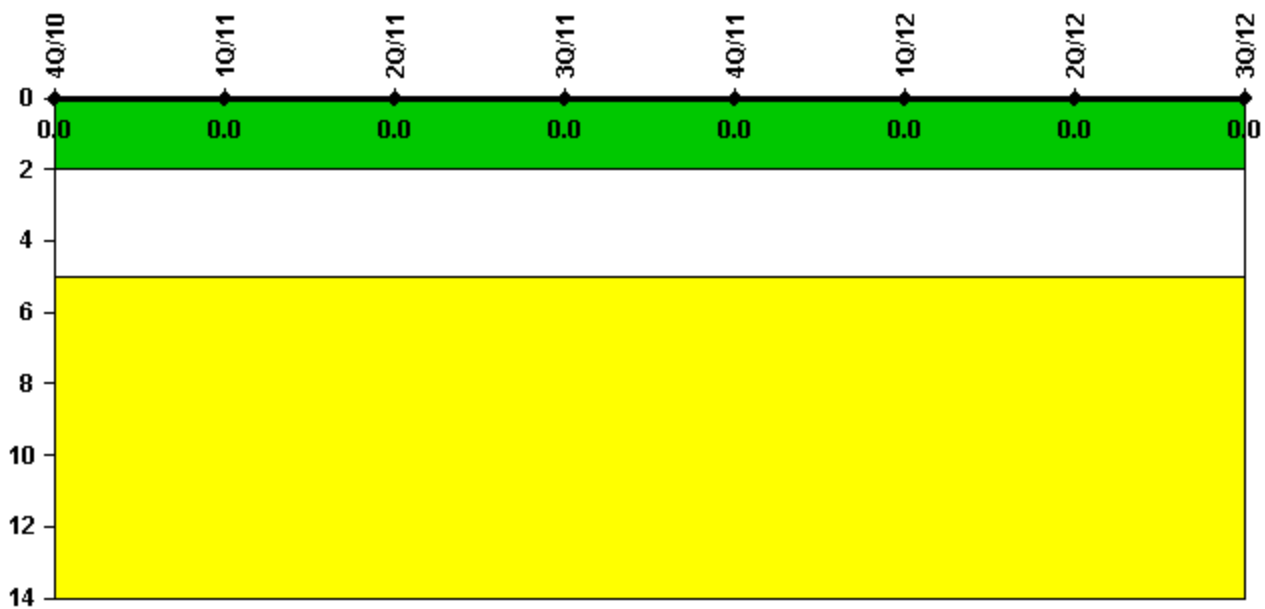


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

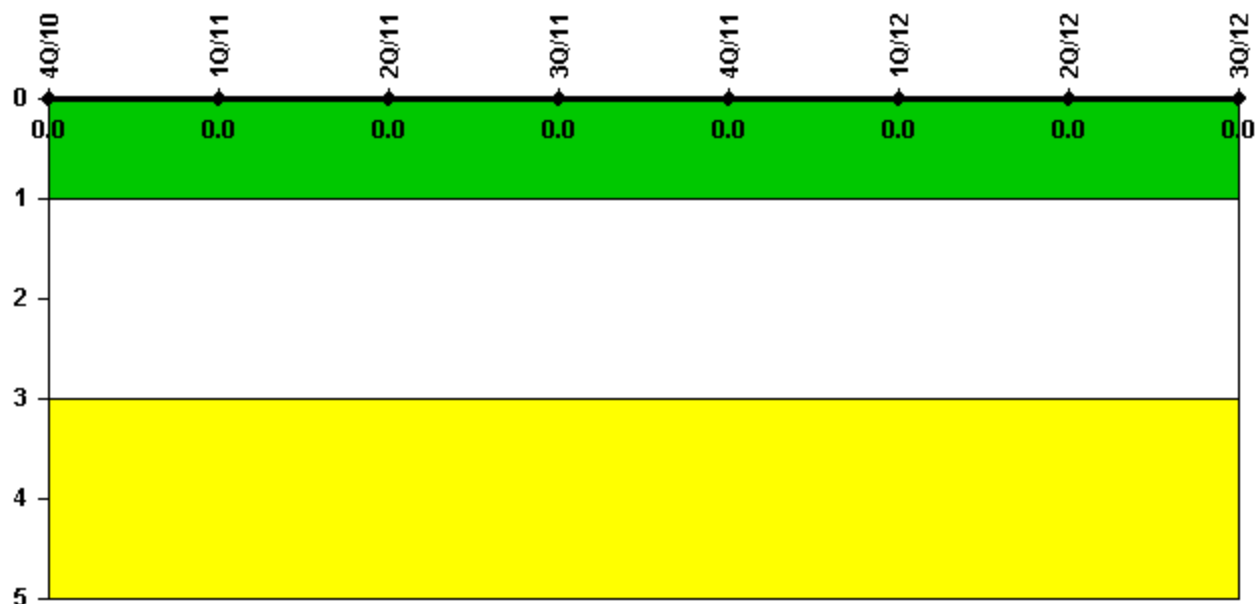

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: October 24, 2012