


La Salle 2

4Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

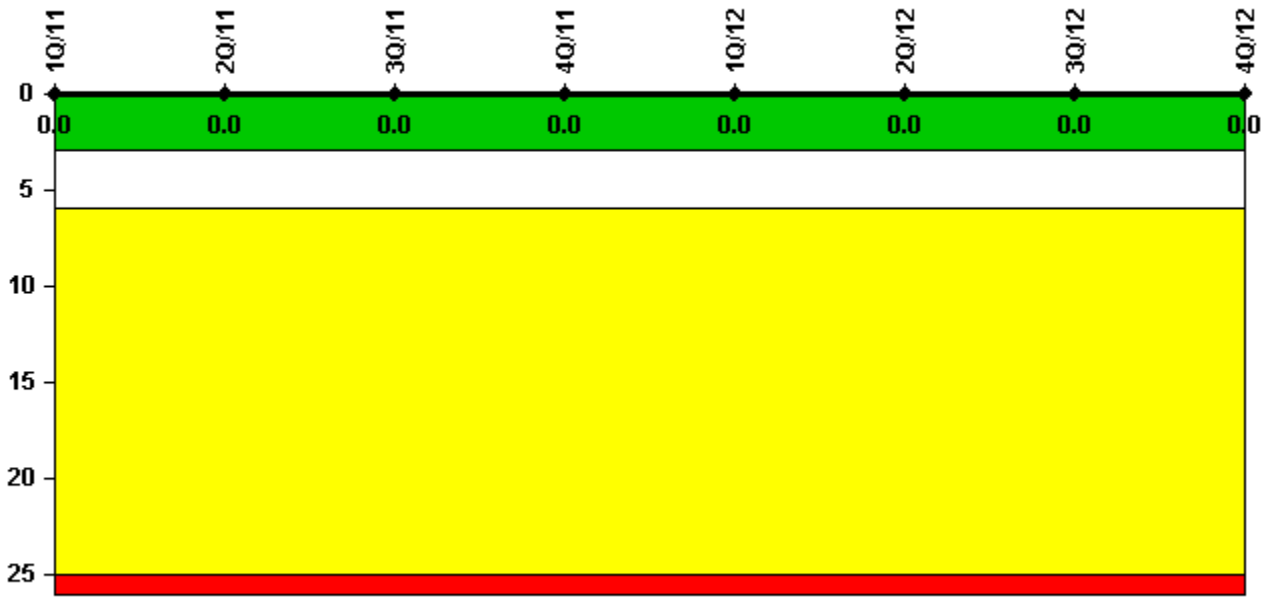


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1666.4	2184.0	2208.0	2209.0	2183.0	2184.0	2208.0	2209.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

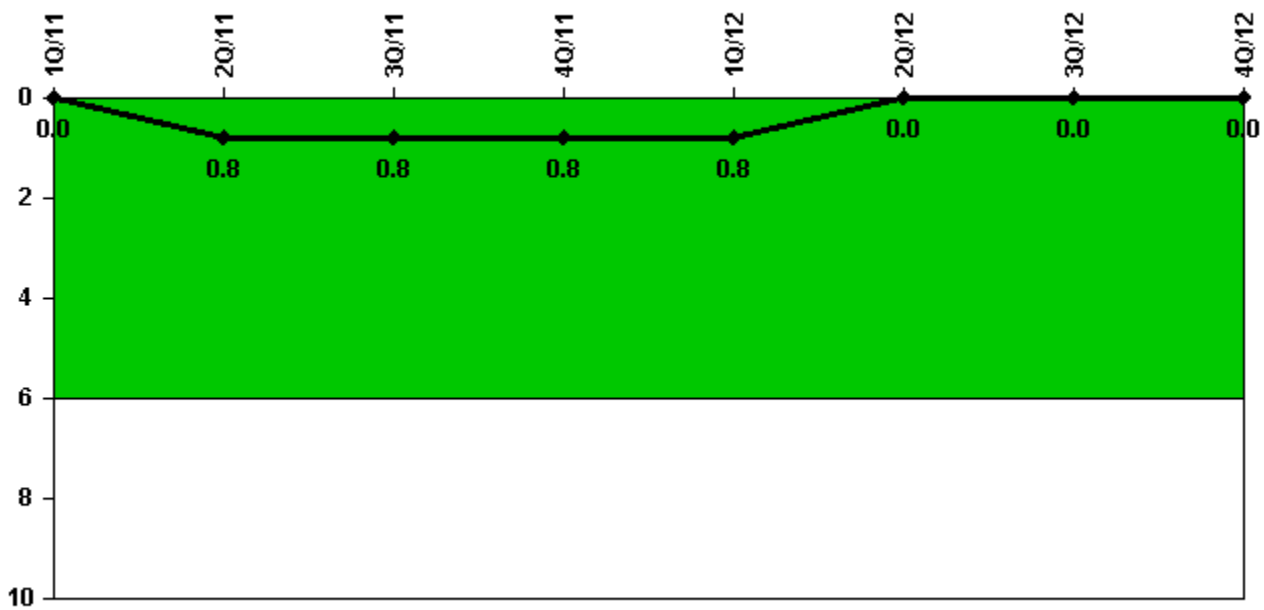


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Unplanned power changes	0	1.0	0	0	0	0	0	0
Critical hours	1666.4	2184.0	2208.0	2209.0	2183.0	2184.0	2208.0	2209.0
Indicator value	0	0.8	0.8	0.8	0.8	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

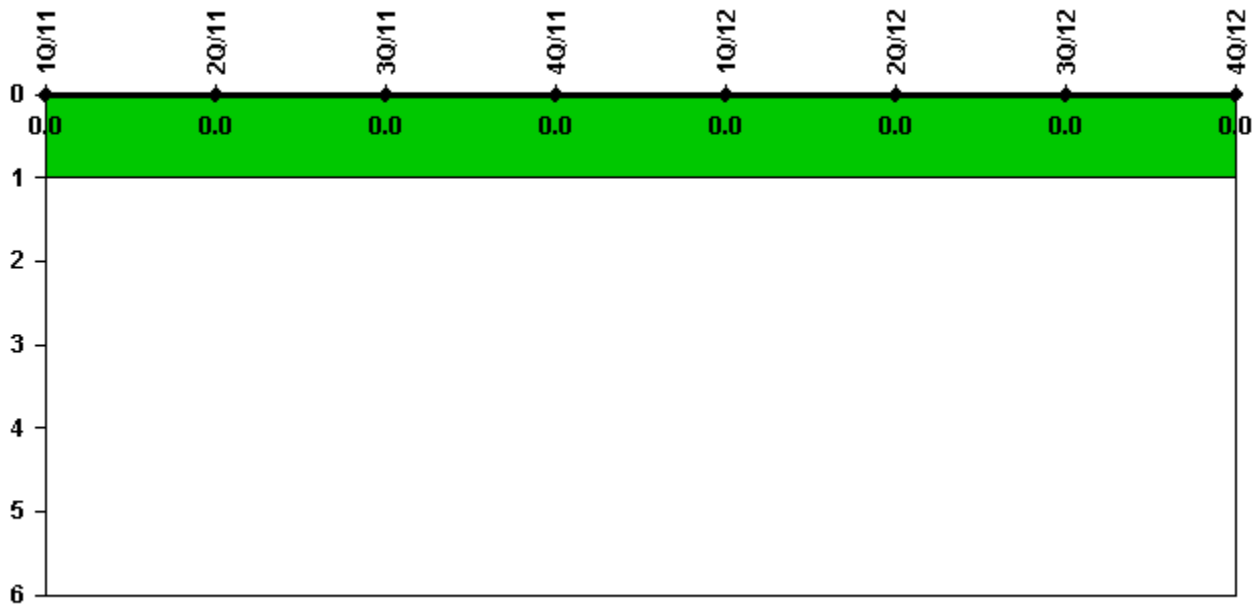


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

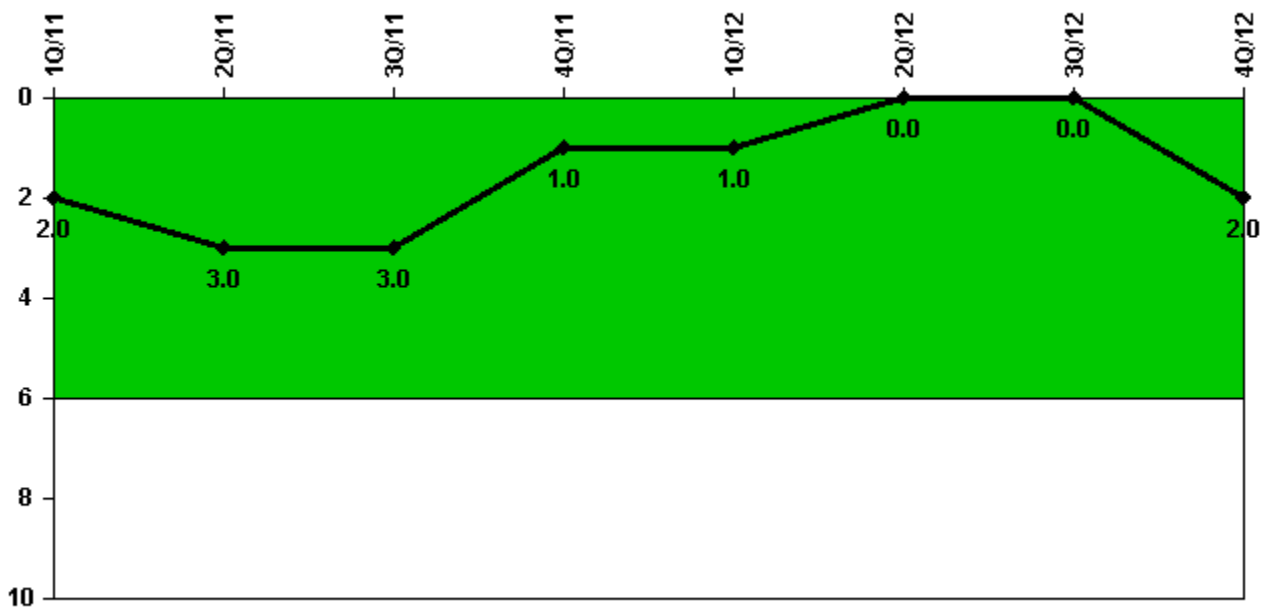

Thresholds: White > 6.0


Notes

Safety System Functional Failures (BWR)	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Safety System Functional Failures	0	1	0	0	0	0	0	2
Indicator value	2	3	3	1	1	0	0	2

Licensee Comments:

4Q/12: LER 374-2012-001-00; LER 373-2012-001-00

Mitigating Systems Performance Index, Emergency AC Power System

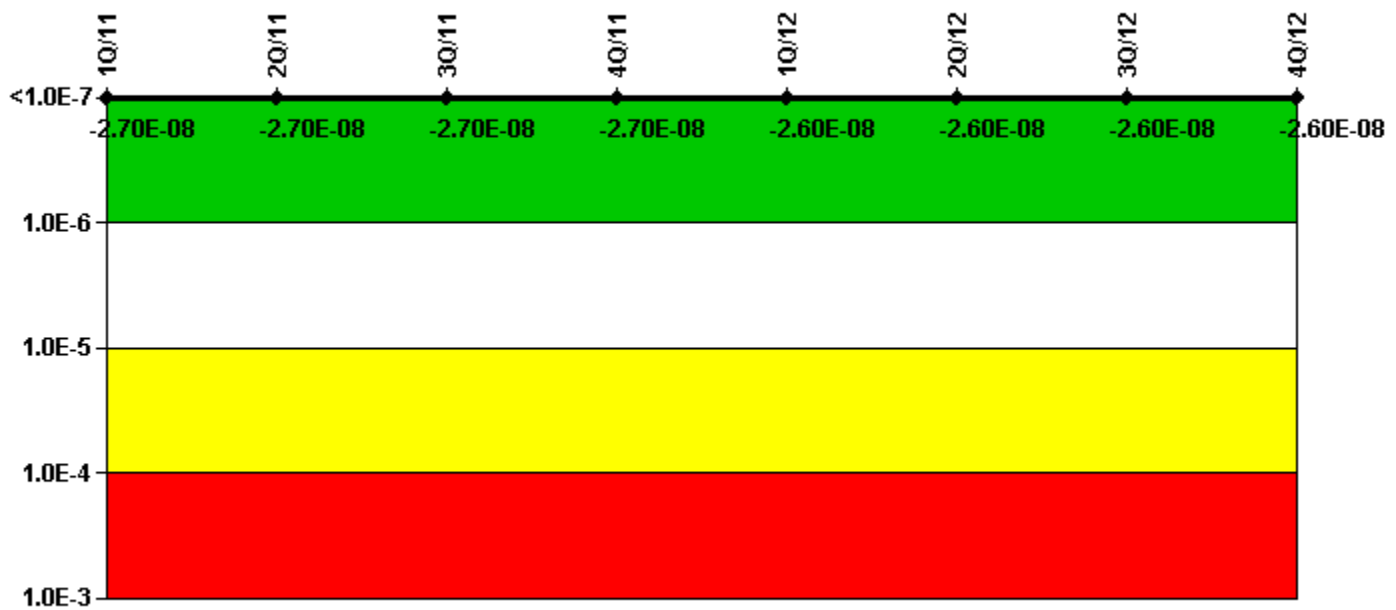


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (Δ CDF)	-3.98E-09	-4.09E-09	-4.09E-09	-4.08E-09	-4.07E-09	-4.07E-09	-4.09E-09	-4.09E-09
URI (Δ CDF)	-2.25E-08	-2.25E-08	-2.25E-08	-2.25E-08	-2.24E-08	-2.22E-08	-2.20E-08	-2.19E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.70E-08	-2.70E-08	-2.70E-08	-2.70E-08	-2.60E-08	-2.60E-08	-2.60E-08	-2.60E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

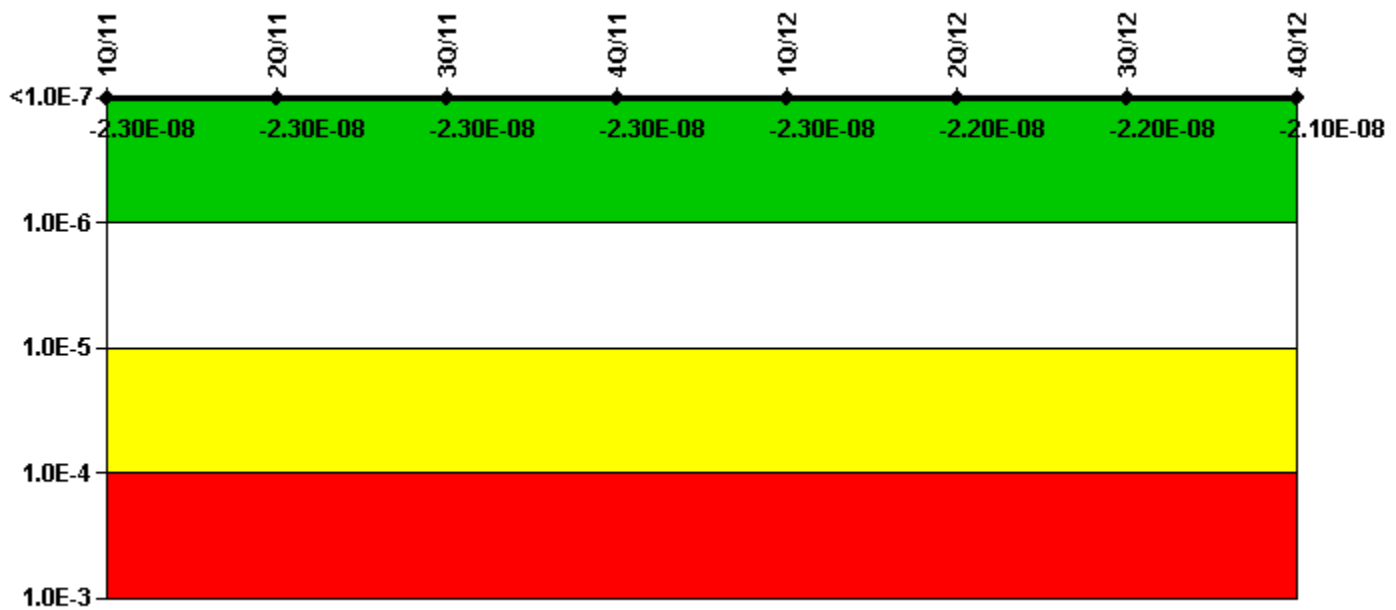


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (Δ CDF)	-2.20E-09	-2.20E-09	-2.20E-09	-2.20E-09	-2.20E-09	-2.20E-09	-2.20E-09	-1.49E-09
URI (Δ CDF)	-2.08E-08	-2.08E-08	-2.08E-08	-2.08E-08	-2.05E-08	-2.03E-08	-2.00E-08	-1.98E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-08	-2.30E-08	-2.30E-08	-2.30E-08	-2.30E-08	-2.20E-08	-2.20E-08	-2.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

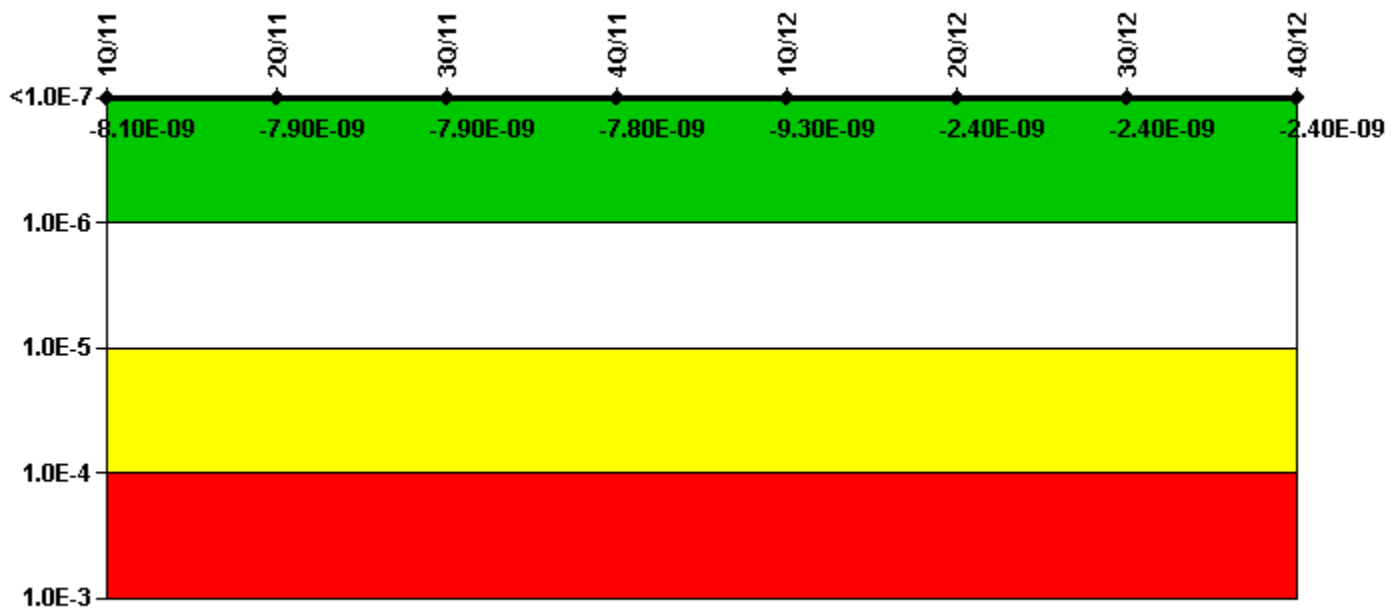


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (Δ CDF)	-1.28E-09	-1.17E-09	-1.12E-09	-9.83E-10	-2.54E-09	-2.19E-09	-2.19E-09	-2.19E-09
URI (Δ CDF)	-6.78E-09	-6.78E-09	-6.78E-09	-6.78E-09	-6.78E-09	-1.92E-10	-1.92E-10	-1.92E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.10E-09	-7.90E-09	-7.90E-09	-7.80E-09	-9.30E-09	-2.40E-09	-2.40E-09	-2.40E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

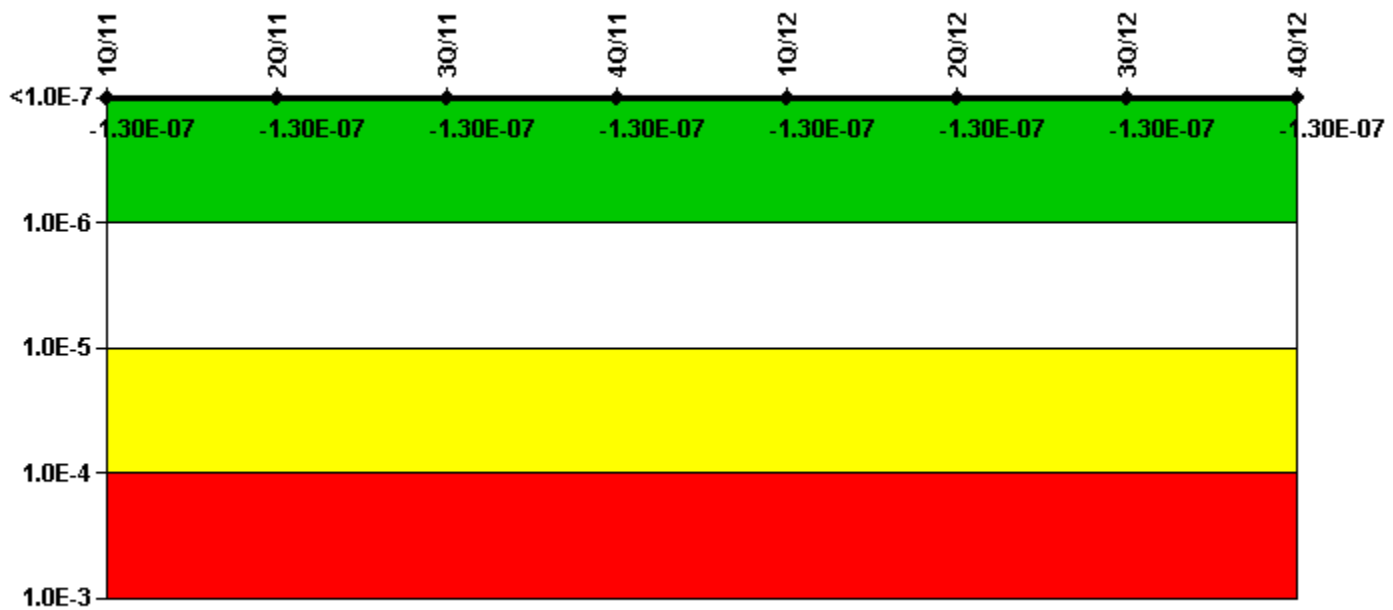


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (Δ CDF)	-4.99E-08	-4.99E-08	-4.99E-08	-4.99E-08	-4.99E-08	-4.99E-08	-4.99E-08	-4.99E-08
URI (Δ CDF)	-8.15E-08	-8.15E-08	-8.15E-08	-8.15E-08	-8.15E-08	-8.15E-08	-8.15E-08	-8.15E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07	-1.30E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

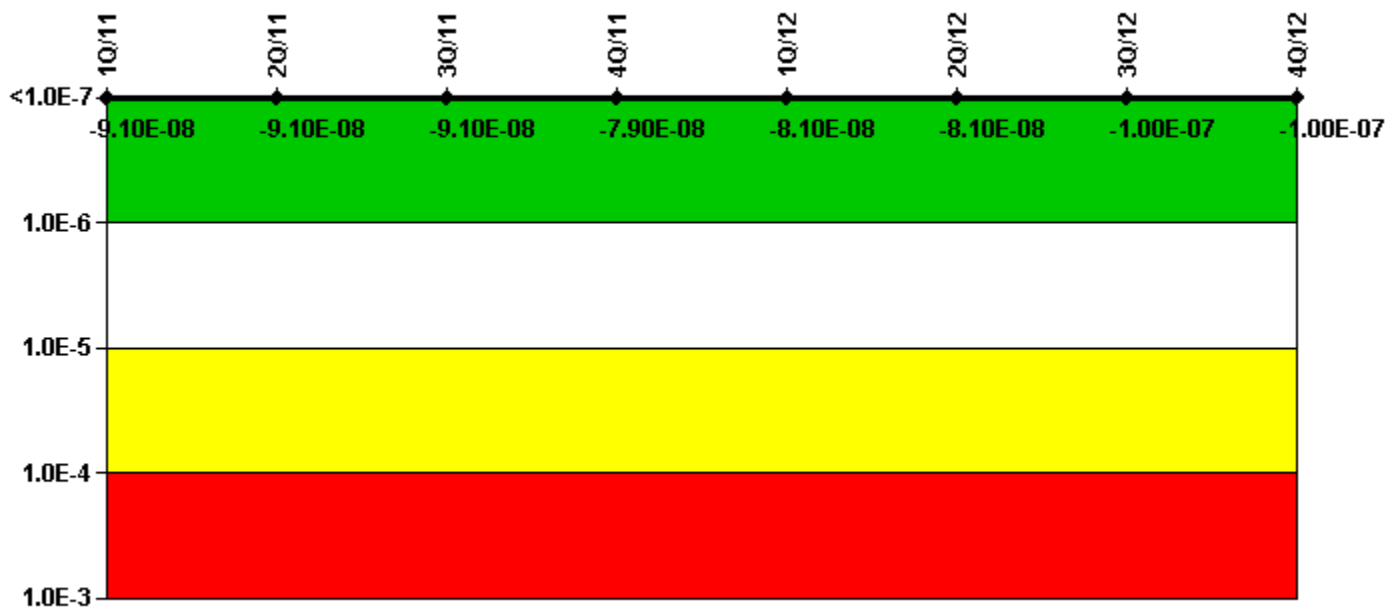

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (Δ CDF)	1.31E-08	1.31E-08	1.31E-08	2.51E-08	2.35E-08	2.35E-08	0.00E+00	0.00E+00
URI (Δ CDF)	-1.04E-07	-1.04E-07	-1.04E-07	-1.05E-07	-1.05E-07	-1.05E-07	-1.05E-07	-1.05E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.10E-08	-9.10E-08	-9.10E-08	-7.90E-08	-8.10E-08	-8.10E-08	-1.00E-07	-1.00E-07

Licensee Comments:

4Q/12: During a routine review, it was identified that 10.6 hours of planned unavailability incurred in September 2012 for the Common Diesel Generator Cooling Water Pump (0DG01P) was inadvertently only counted for Unit 1. To correct this error, 10.6 hours of planned unavailability has been added to the Unit 2 September 2012 data. This change did not result in a change in performance indicator color, which is Green. This occurrence has been entered into the Station's corrective action program.

Reactor Coolant System Activity

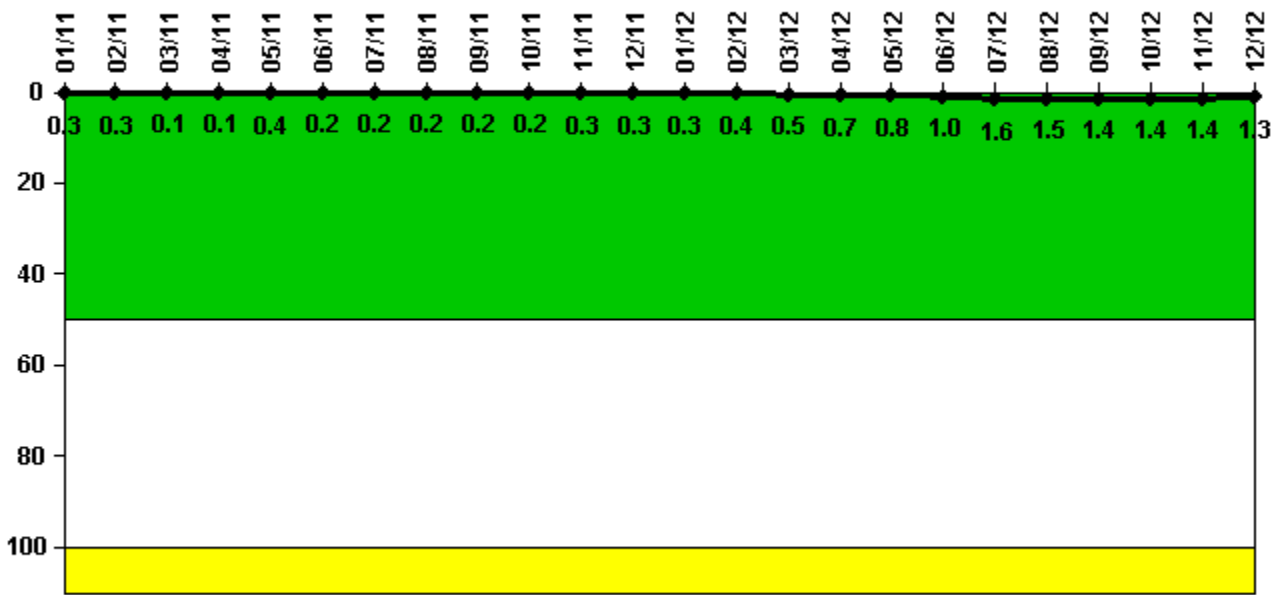


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11
Maximum activity	0.000559	0.000572	0.000177	0.000159	0.000726	0.000318	0.000417	0.000349	0.000374	0.000454	0.000518	0.000626
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.3	0.3	0.1	0.1	0.4	0.2	0.2	0.2	0.2	0.2	0.3	0.3
Reactor Coolant System Activity	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum activity	0.000635	0.000788	0.000994	0.001488	0.001653	0.001954	0.003267	0.003087	0.002840	0.002792	0.002709	0.002664
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.3	0.4	0.5	0.7	0.8	1.0	1.6	1.5	1.4	1.4	1.4	1.3

Licensee Comments: none

Reactor Coolant System Leakage

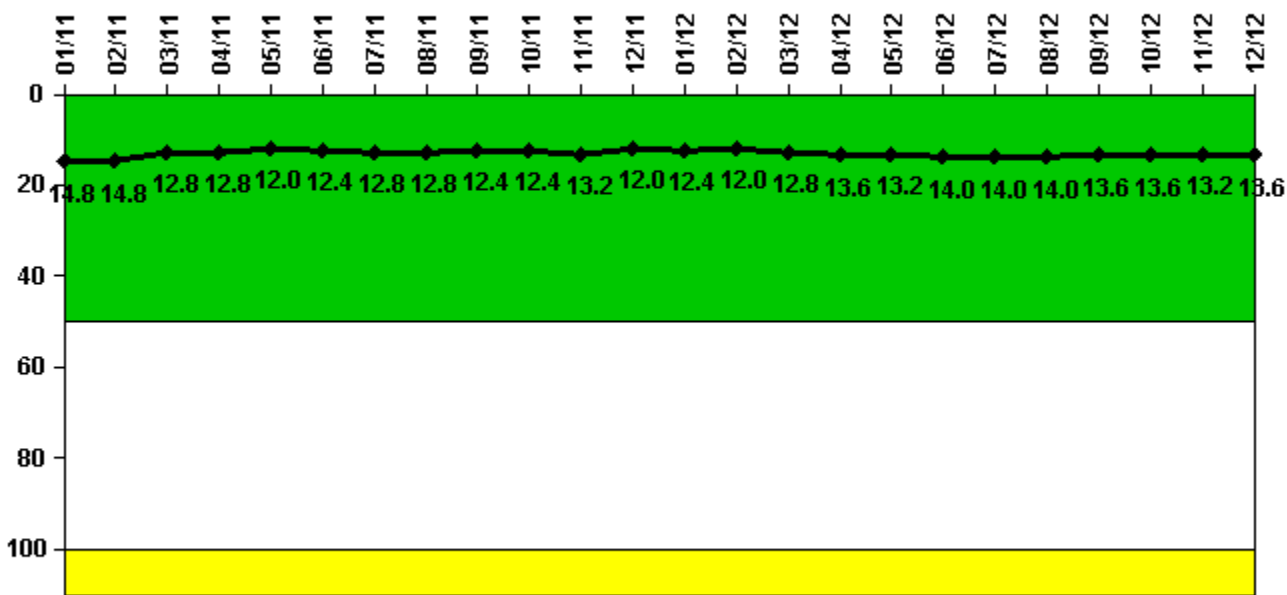

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11
Maximum leakage	3.700	3.700	3.200	3.200	3.000	3.100	3.200	3.200	3.100	3.100	3.300	3.000
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	14.8	14.8	12.8	12.8	12.0	12.4	12.8	12.8	12.4	12.4	13.2	12.0

Reactor Coolant System Leakage	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum leakage	3.100	3.000	3.200	3.400	3.300	3.500	3.500	3.500	3.400	3.400	3.300	3.400
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	12.4	12.0	12.8	13.6	13.2	14.0	14.0	14.0	13.6	13.6	13.2	13.6

Licensee Comments: none

Drill/Exercise Performance

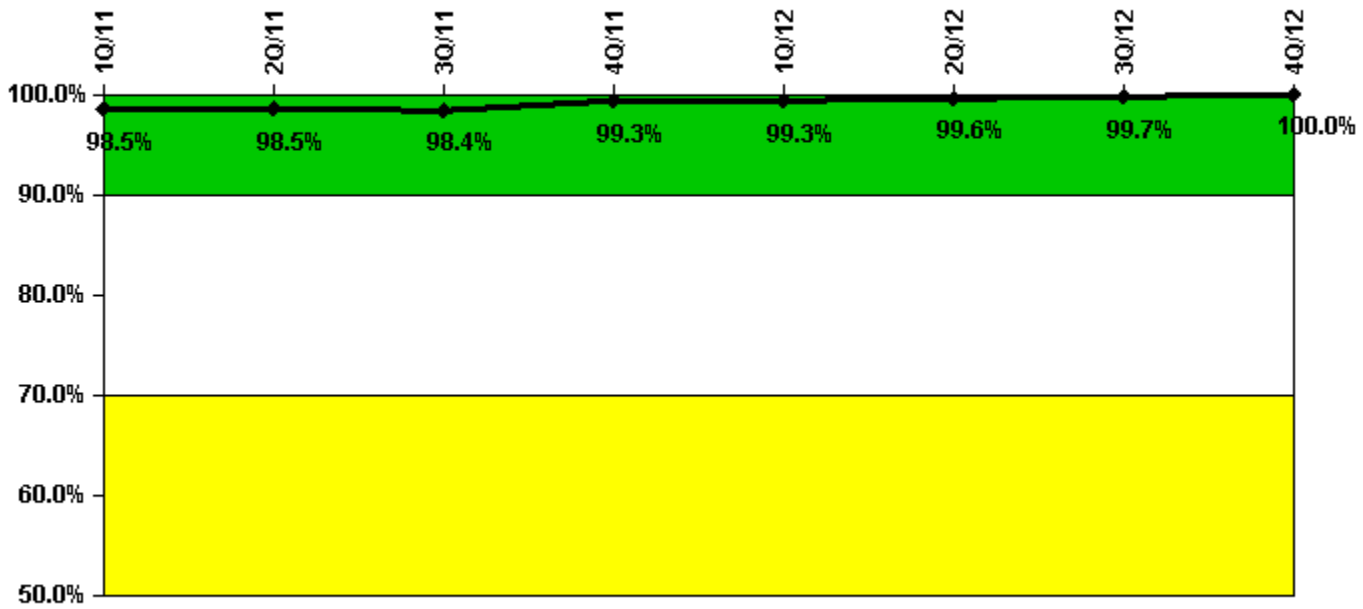


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Successful opportunities	0	40.0	39.0	64.0	24.0	64.0	23.0	33.0
Total opportunities	0	40.0	39.0	64.0	24.0	64.0	23.0	33.0
Indicator value	98.5%	98.5%	98.4%	99.3%	99.3%	99.6%	99.7%	100.0%

Licensee Comments: none

ERO Drill Participation

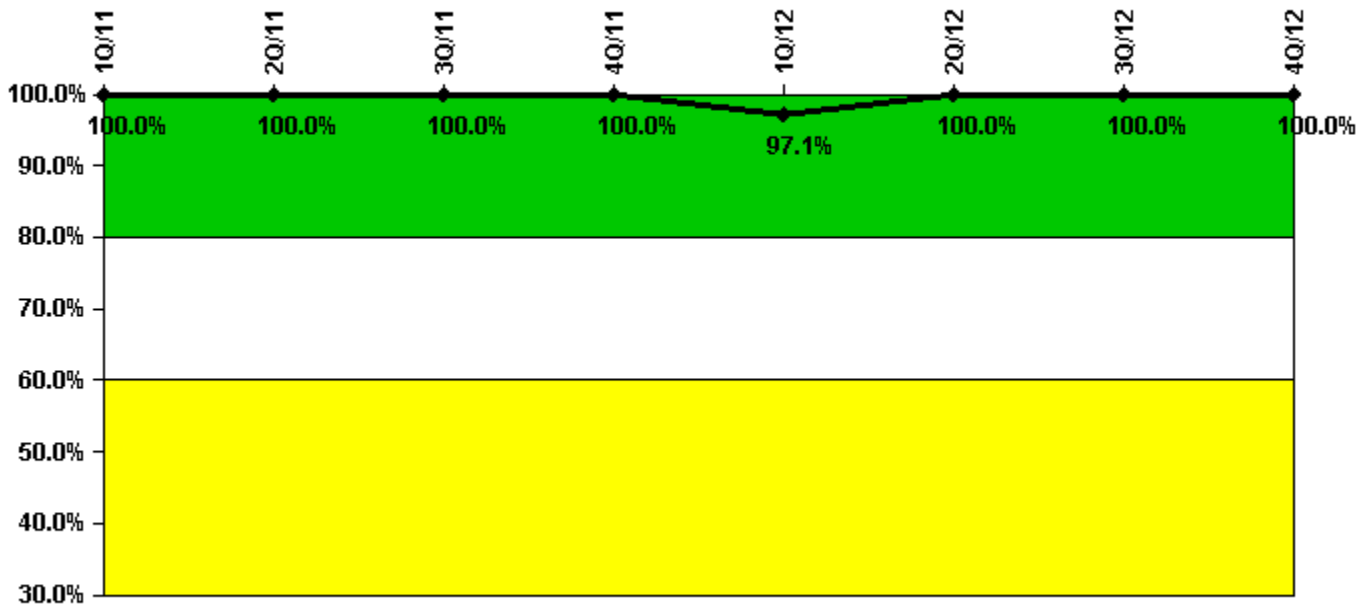


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Participating Key personnel	65.0	63.0	68.0	70.0	68.0	68.0	69.0	71.0
Total Key personnel	65.0	63.0	68.0	70.0	70.0	68.0	69.0	71.0
Indicator value	100.0%	100.0%	100.0%	100.0%	97.1%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

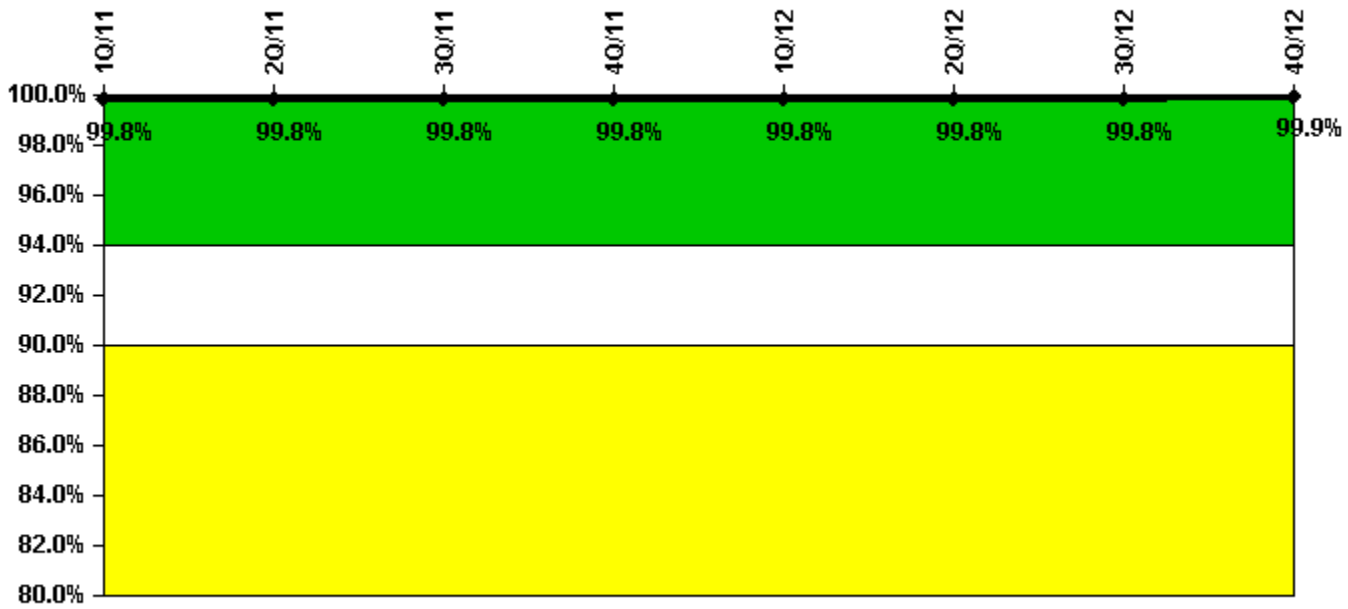


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Successful siren-tests	2173	2170	2170	2171	2207	2172	2137	2175
Total sirens-tests	2176	2176	2176	2176	2210	2176	2142	2176
Indicator value	99.8%	99.8%	99.8%	99.8%	99.8%	99.8%	99.8%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

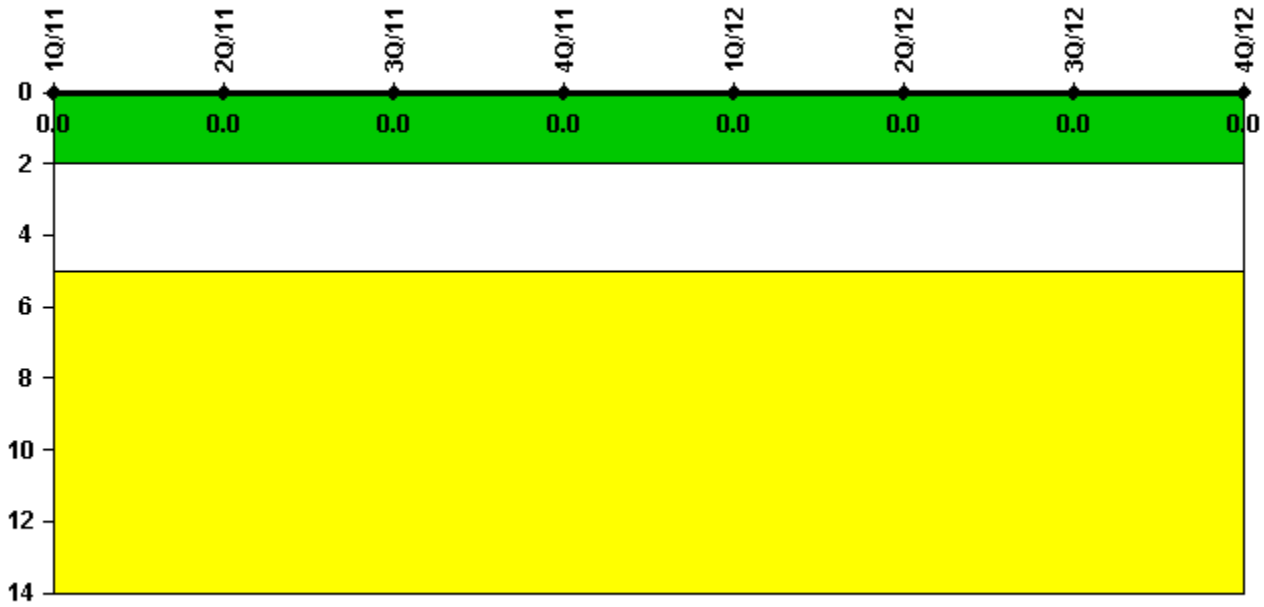


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

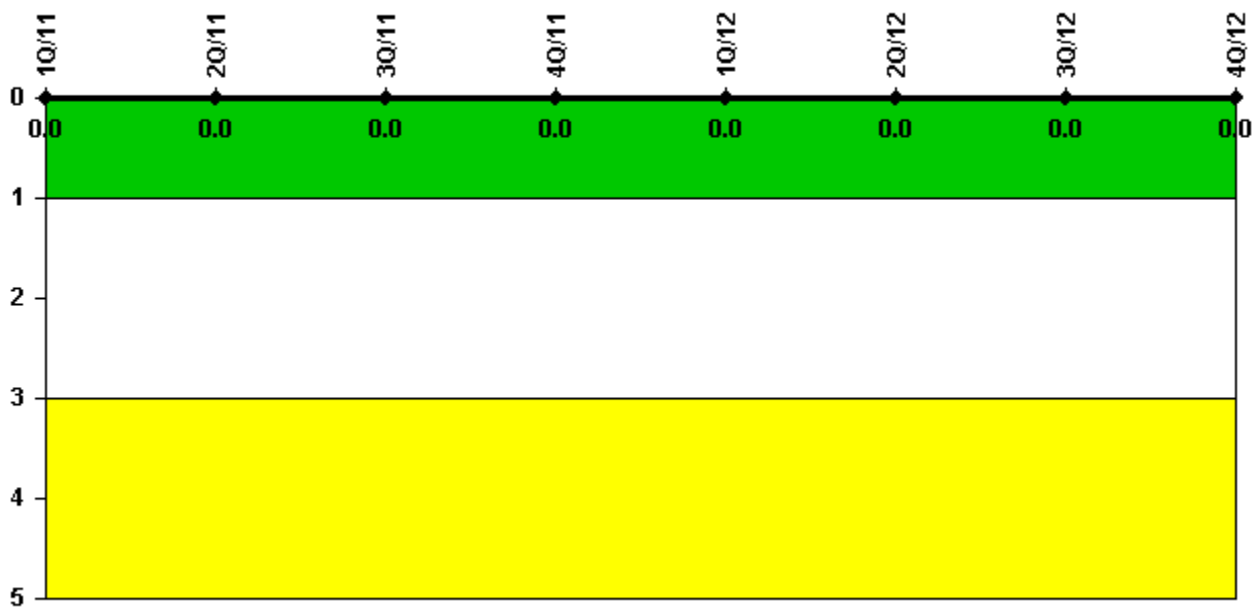

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.