


Watts Bar 1

4Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

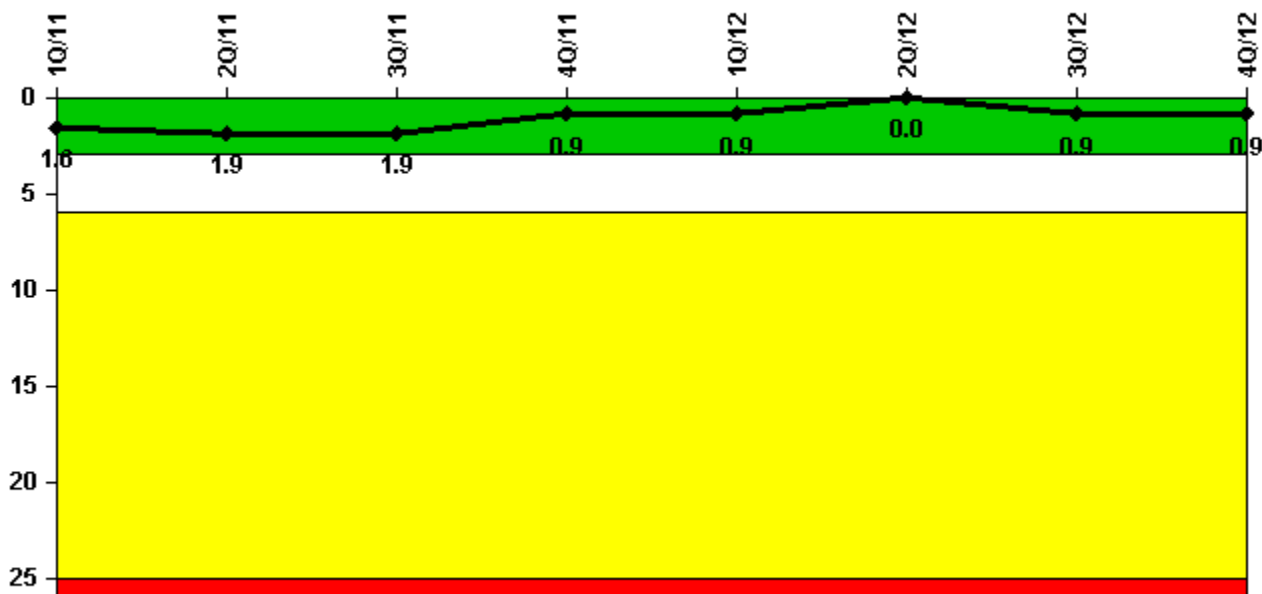

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Unplanned scrams	0	1.0	0	0	0	0	1.0	0
Critical hours	2159.0	1054.1	2208.0	2058.5	2183.0	2184.0	1667.4	1559.8
Indicator value	1.6	1.9	1.9	0.9	0.9	0	0.9	0.9

Licensee Comments:

2Q/11: Automatic reactor trip May 29, 2011 due to turbine trip from Automatic Voltage Regulator.

Unplanned Power Changes per 7000 Critical Hrs

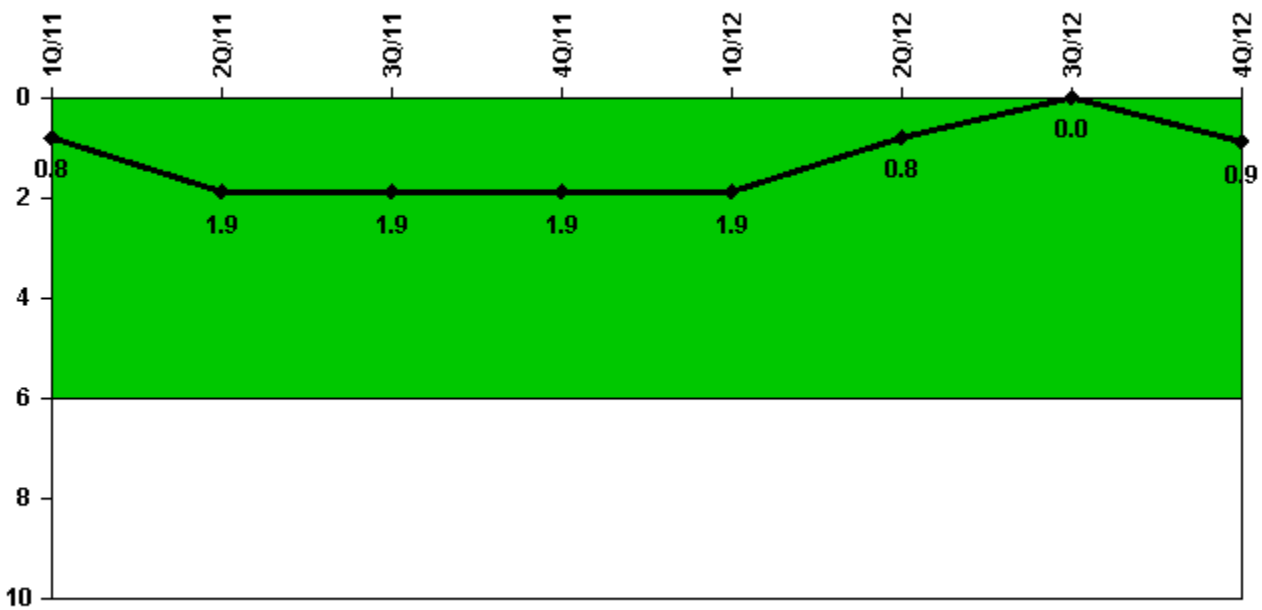

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Unplanned power changes	0	1.0	1.0	0	0	0	0	1.0
Critical hours	2159.0	1054.1	2208.0	2058.5	2183.0	2184.0	1667.4	1559.8
Indicator value	0.8	1.9	1.9	1.9	1.9	0.8	0	0.9

Licensee Comments:

2Q/11: Manual turbine trip May 23, 2011 to repair EHC weld failure. Reactor remained critical.

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

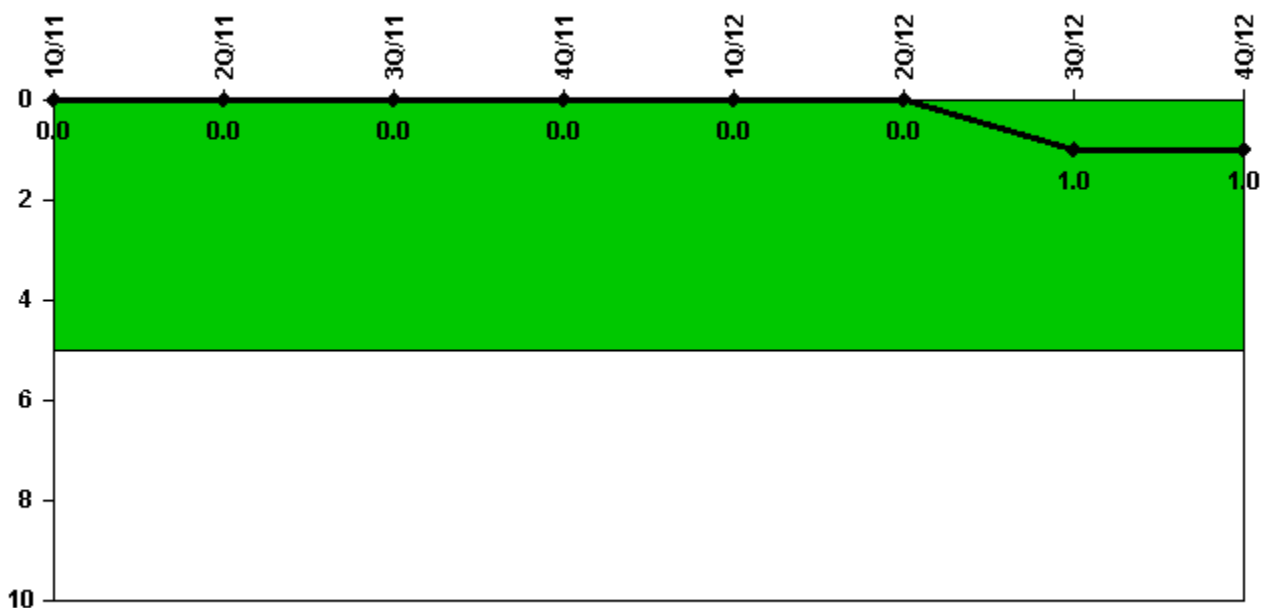

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Safety System Functional Failures	0	0	0	0	0	0	1	0
Indicator value	0	0	0	0	0	0	1	1

Licensee Comments:

3Q/12: LER 2012-002 (B) Remove residual heat If the probable maximum flood level had occurred while raw water was required for shutdown cooling then WBNs ability to remove residual heat would have been lost; therefore, this is a reported as a safety system functional failure.

Mitigating Systems Performance Index, Emergency AC Power System

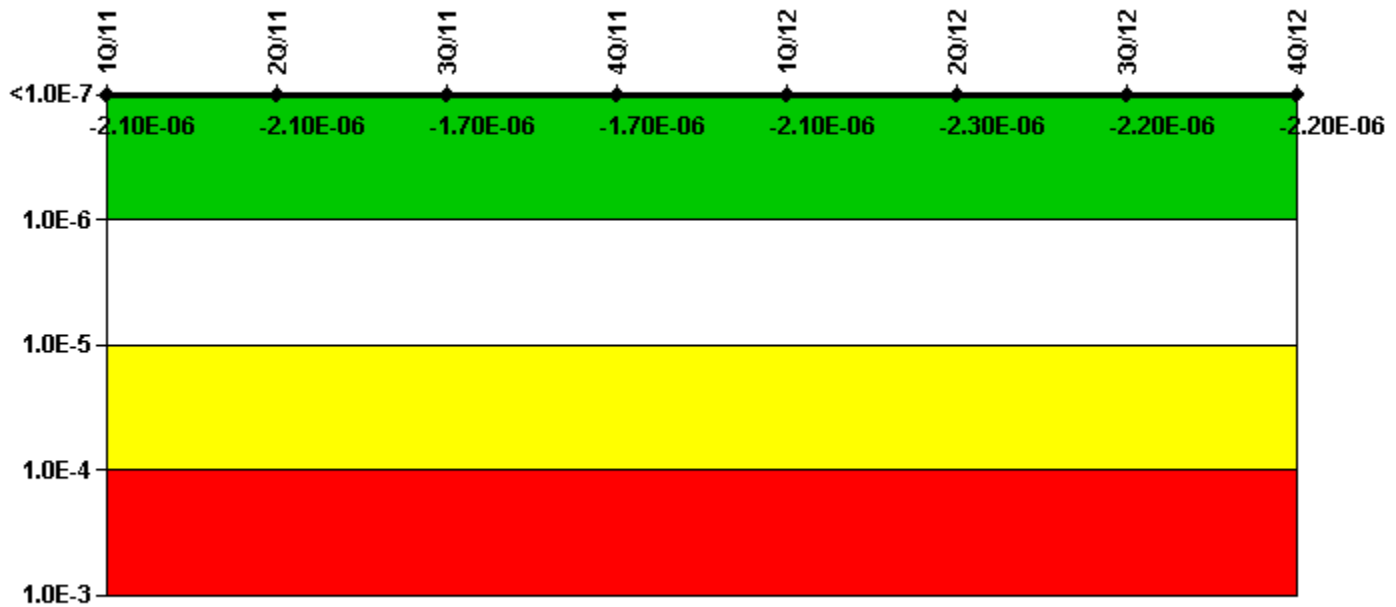

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (ΔCDF)	4.69E-07	5.10E-07	8.31E-07	9.20E-07	9.10E-07	7.44E-07	7.16E-07	7.53E-07
URI (ΔCDF)	-2.58E-06	-2.58E-06	-2.58E-06	-2.58E-06	-3.06E-06	-3.03E-06	-2.94E-06	-2.93E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.10E-06	-2.10E-06	-1.70E-06	-1.70E-06	-2.10E-06	-2.30E-06	-2.20E-06	-2.20E-06

Licensee Comments:

4Q/11: Risk Cap Invoked.

4Q/11: Risk Cap Invoked.


3Q/11: Risk Cap Invoked.

3Q/11: Risk Cap Invoked.

2Q/11: Risk Cap Invoked.

1Q/11: Risk Cap Invoked. During the 4Q2010 Watts Bar issued a CAFTA PRA model. The revision changed the PRA values for the MSPI Core Damage Frequency and the unavailability and unreliability values. This change is effective 1Q2011. The details are available in the Watts Bar Basis Document.

Mitigating Systems Performance Index, High Pressure Injection System

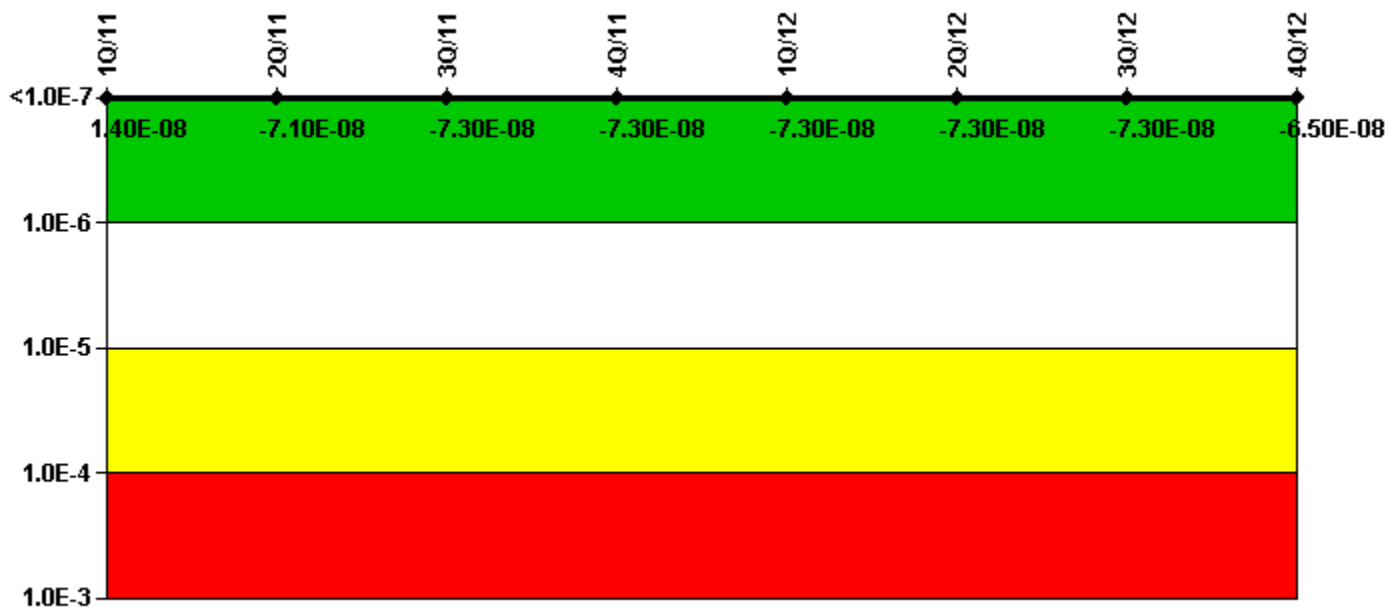

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (ΔCDF)	-2.90E-08	-5.79E-08	-5.94E-08	-5.92E-08	-5.94E-08	-5.87E-08	-5.85E-08	-5.03E-08
URI (ΔCDF)	4.34E-08	-1.36E-08	-1.37E-08	-1.39E-08	-1.40E-08	-1.42E-08	-1.43E-08	-1.45E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.40E-08	-7.10E-08	-7.30E-08	-7.30E-08	-7.30E-08	-7.30E-08	-7.30E-08	-6.50E-08

Licensee Comments:

1Q/11: During Fourth quarter of 2010 Watts Bar issued a CAFTA PRA model. The revision changed the PRA values for the MSPI Core Damage Frequency, and the unavailability and unreliability values. This change is effective first quarter 2011. The details are available in Watts Bar Basis Document.

Mitigating Systems Performance Index, Heat Removal System

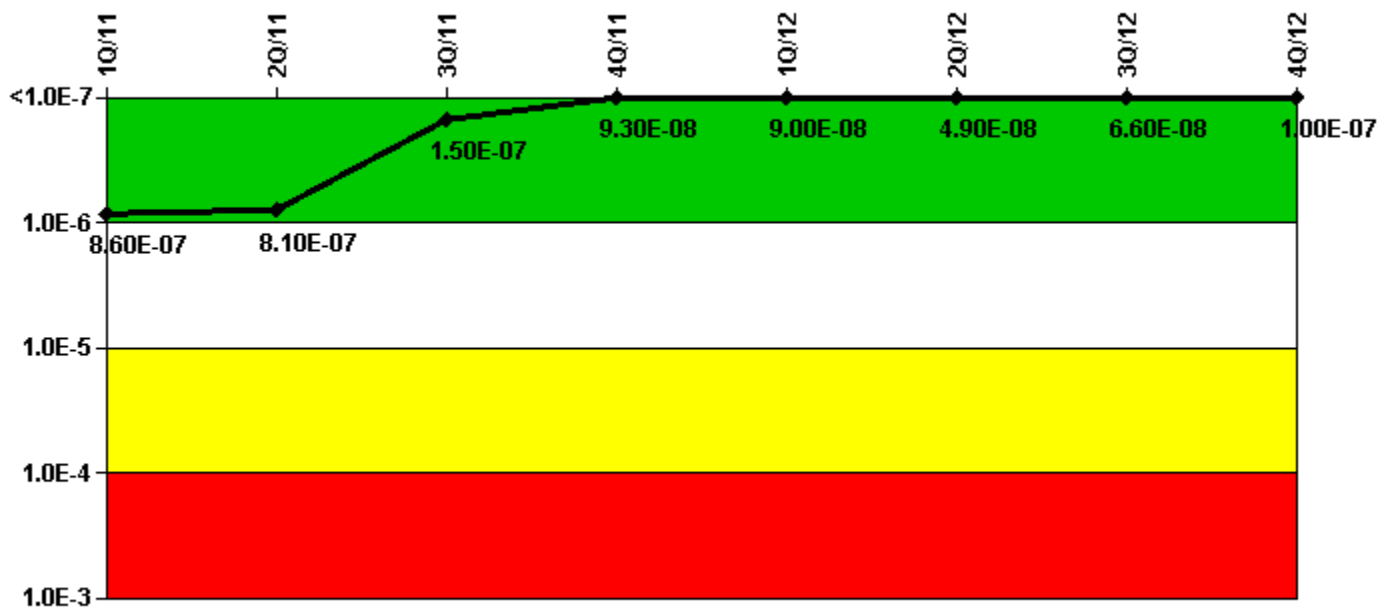

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Heat Removal System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (ΔCDF)	7.39E-07	6.84E-07	5.29E-07	4.71E-07	4.68E-07	4.27E-07	4.48E-07	4.85E-07
URI (ΔCDF)	1.22E-07	1.22E-07	-3.78E-07	-3.78E-07	-3.78E-07	-3.78E-07	-3.82E-07	-3.82E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.60E-07	8.10E-07	1.50E-07	9.30E-08	9.00E-08	4.90E-08	6.60E-08	1.00E-07

Licensee Comments:

2Q/11: Risk Cap Invoked.

1Q/11: Risk Cap Invoked. PRA recalculated their models and made AFW much more risk significant. Hours lost after remodeling on MDAFW Trains A and C and TDAFW Train C caused the drop close to White.

Mitigating Systems Performance Index, Residual Heat Removal System

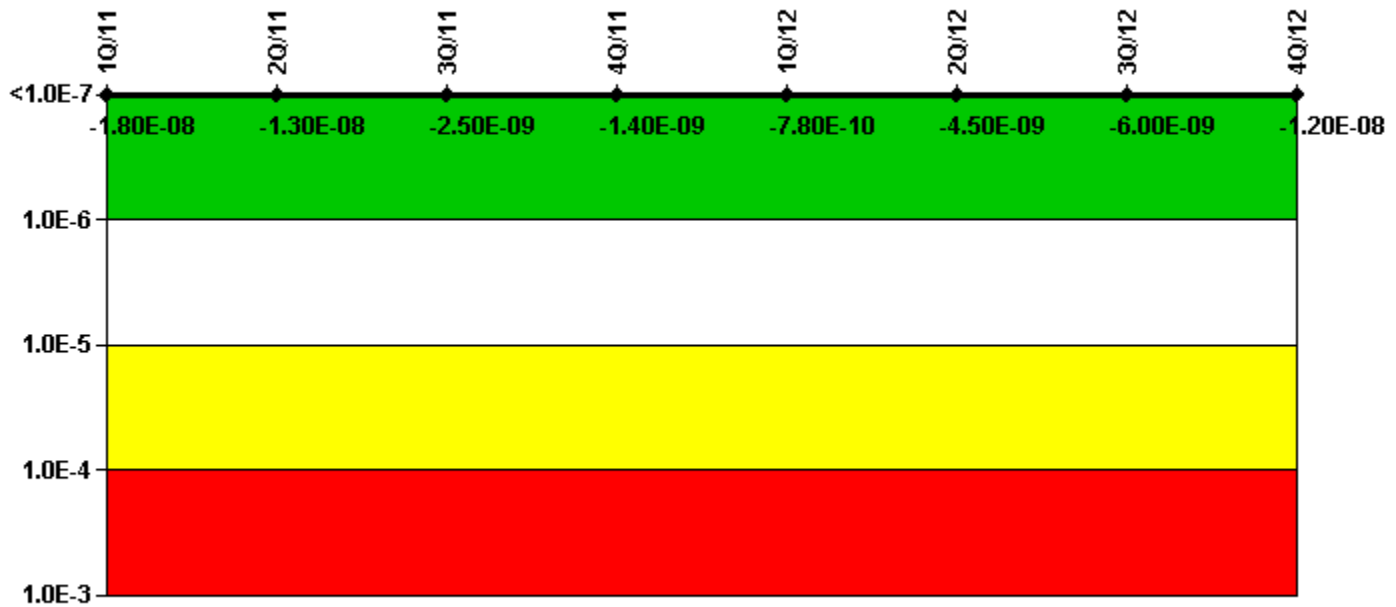

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (ΔCDF)	2.27E-08	2.84E-08	3.91E-08	4.06E-08	4.17E-08	3.83E-08	3.72E-08	3.20E-08
URI (ΔCDF)	-4.08E-08	-4.12E-08	-4.16E-08	-4.20E-08	-4.24E-08	-4.28E-08	-4.32E-08	-4.36E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.80E-08	-1.30E-08	-2.50E-09	-1.40E-09	-7.80E-10	-4.50E-09	-6.00E-09	-1.20E-08

Licensee Comments:

1Q/11: During Fourth quarter of 2010 Watts Bar issued a CAFTA PRA model. The revision changed the PRA values for the MSPI Core Damage Frequency, and the unavailability and unreliability values. This change is effective first quarter 2011. The details are available in Watts Bar Basis Document.

Mitigating Systems Performance Index, Cooling Water Systems

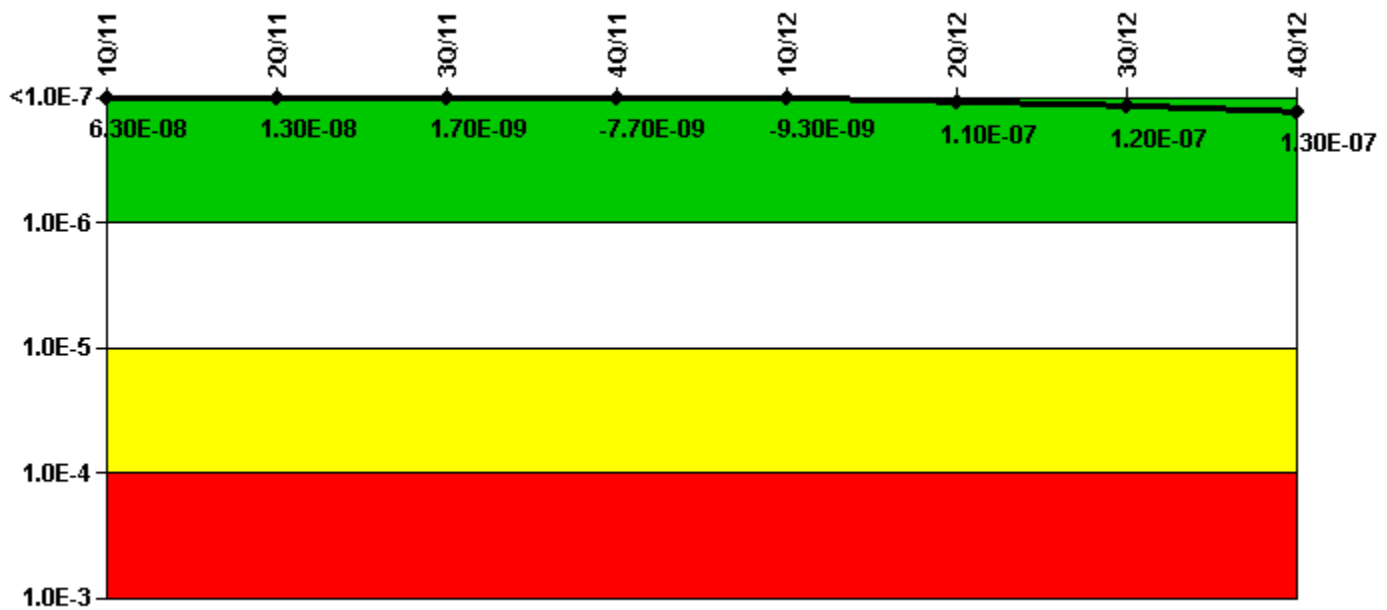

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Cooling Water Systems	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
UAI (ΔCDF)	4.97E-08	5.47E-08	5.02E-08	4.08E-08	3.92E-08	1.63E-07	1.65E-07	1.75E-07
URI (ΔCDF)	1.29E-08	-4.16E-08	-4.85E-08	-4.85E-08	-4.85E-08	-4.85E-08	-4.85E-08	-4.85E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.30E-08	1.30E-08	1.70E-09	-7.70E-09	-9.30E-09	1.10E-07	1.20E-07	1.30E-07

Licensee Comments:

3Q/12: Change July 2011 MSPI value for G-B ERCW pump from planned to unplanned hours of 52.33.

1Q/11: During Fourth quarter of 2010 Watts Bar issued a CAFTA PRA model. The revision changed the PRA values for the MSPI Core Damage Frequency, and the unavailability and unreliability values. This change is effective first quarter 2011. The details are available in Watts Bar Basis Document.

Reactor Coolant System Activity

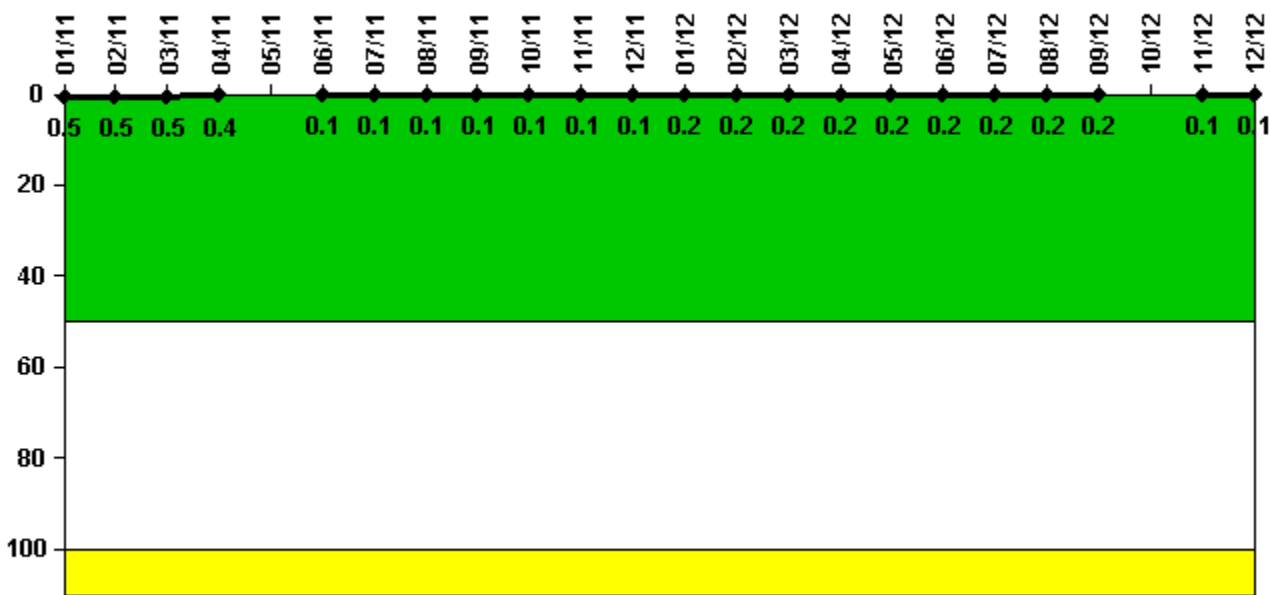

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11
Maximum activity	0.001240	0.001306	0.001271	0.001073	N/A	0.000326	0.000338	0.000329	0.000336	0.000358	0.000360	0.000388
Technical specification limit	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Indicator value	0.5	0.5	0.5	0.4	N/A	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Reactor Coolant System Activity	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum activity	0.000401	0.000405	0.000417	0.000434	0.000442	0.000450	0.000466	0.000480	0.000491	N/A	0.000149	0.000160
Technical specification limit	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	N/A	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

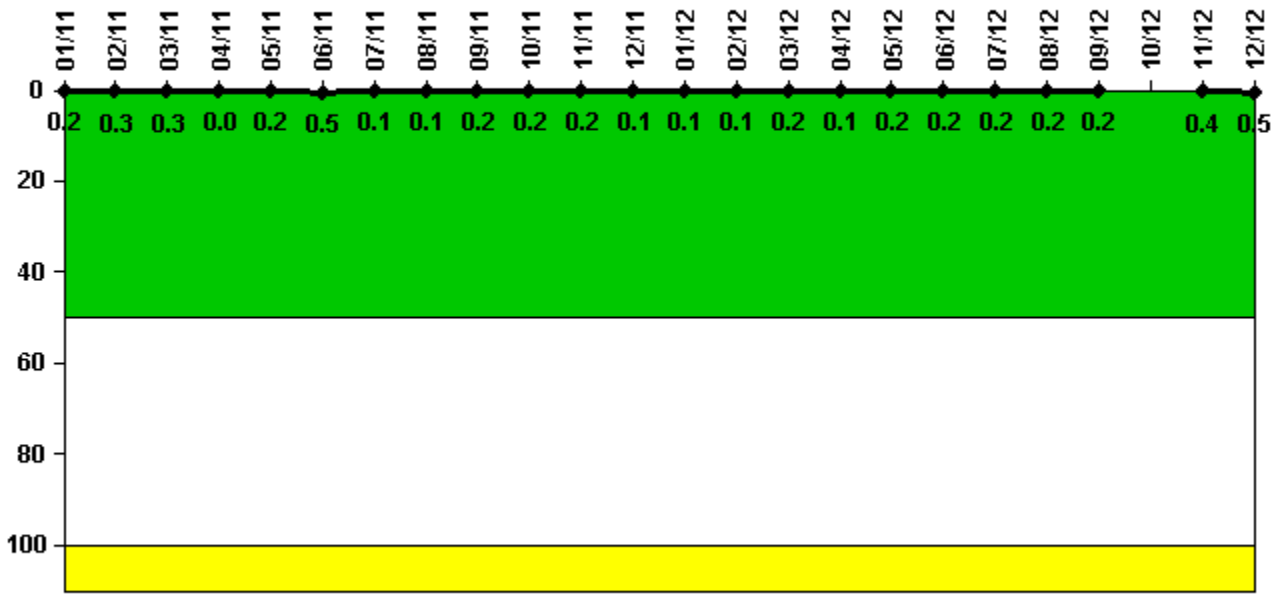


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/11	2/11	3/11	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11
Maximum leakage	0.020	0.030	0.030	0	0.020	0.050	0.010	0.010	0.020	0.020	0.020	0.010
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.3	0.3	0	0.2	0.5	0.1	0.1	0.2	0.2	0.2	0.1
Reactor Coolant System Leakage	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum leakage	0.010	0.010	0.020	0.010	0.020	0.020	0.020	0.020	0.020	N/A	0.040	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.1	0.2	0.1	0.2	0.2	0.2	0.2	0.2	N/A	0.4	0.5

Licensee Comments: none

Drill/Exercise Performance

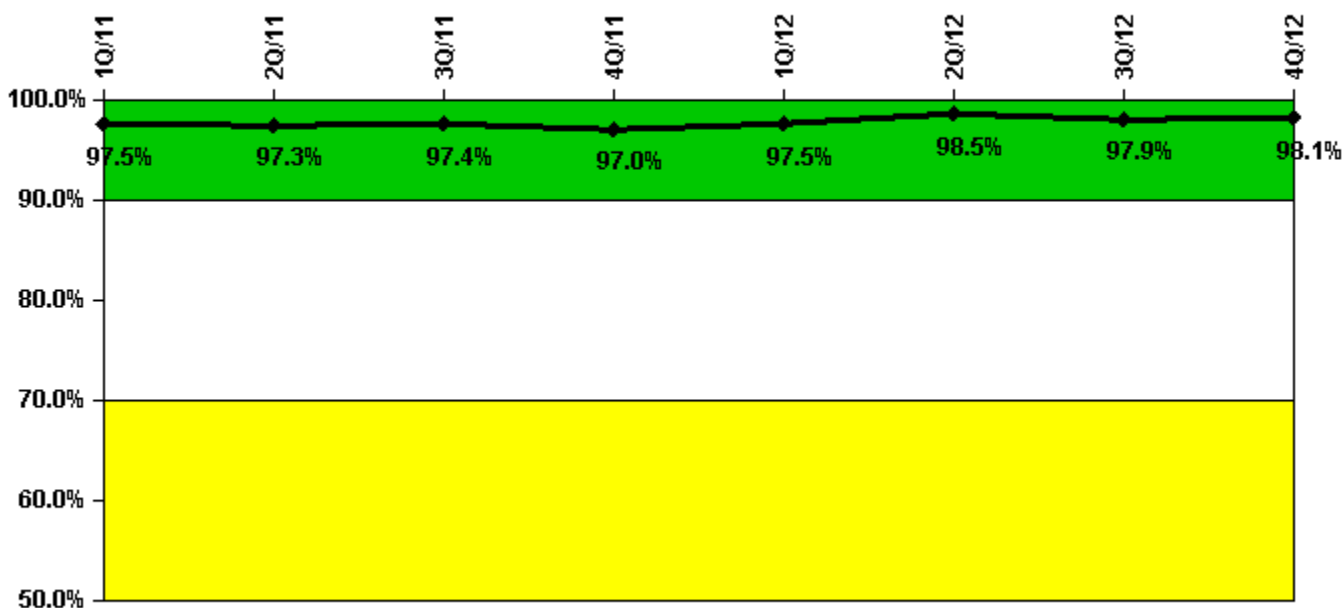


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Successful opportunities	32.0	49.0	60.0	64.0	35.0	25.0	1.0	44.0
Total opportunities	32.0	50.0	60.0	67.0	35.0	26.0	2.0	44.0
Indicator value	97.5%	97.3%	97.4%	97.0%	97.5%	98.5%	97.9%	98.1%

Licensee Comments: none

ERO Drill Participation

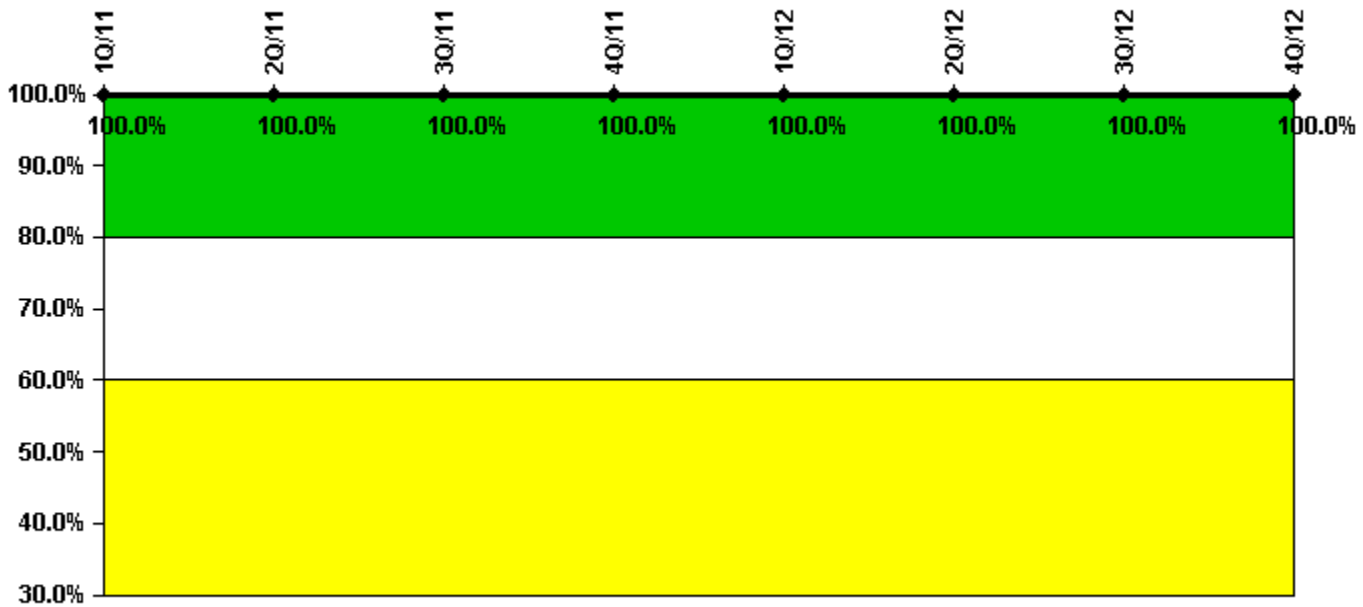


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Participating Key personnel	78.0	74.0	74.0	70.0	69.0	71.0	69.0	72.0
Total Key personnel	78.0	74.0	74.0	70.0	69.0	71.0	69.0	72.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

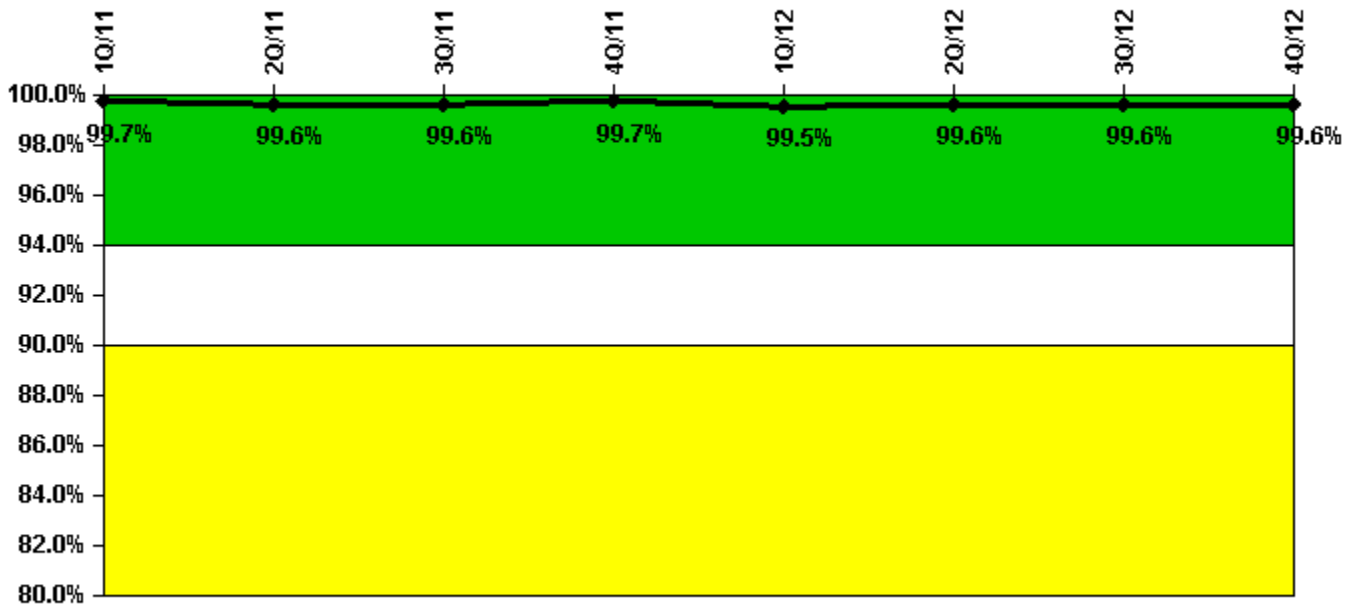


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
Successful siren-tests	692	887	788	790	787	787	789	692
Total sirens-tests	693	891	792	792	792	790	792	693
Indicator value	99.7%	99.6%	99.6%	99.7%	99.5%	99.6%	99.6%	99.6%

Licensee Comments: none

Occupational Exposure Control Effectiveness

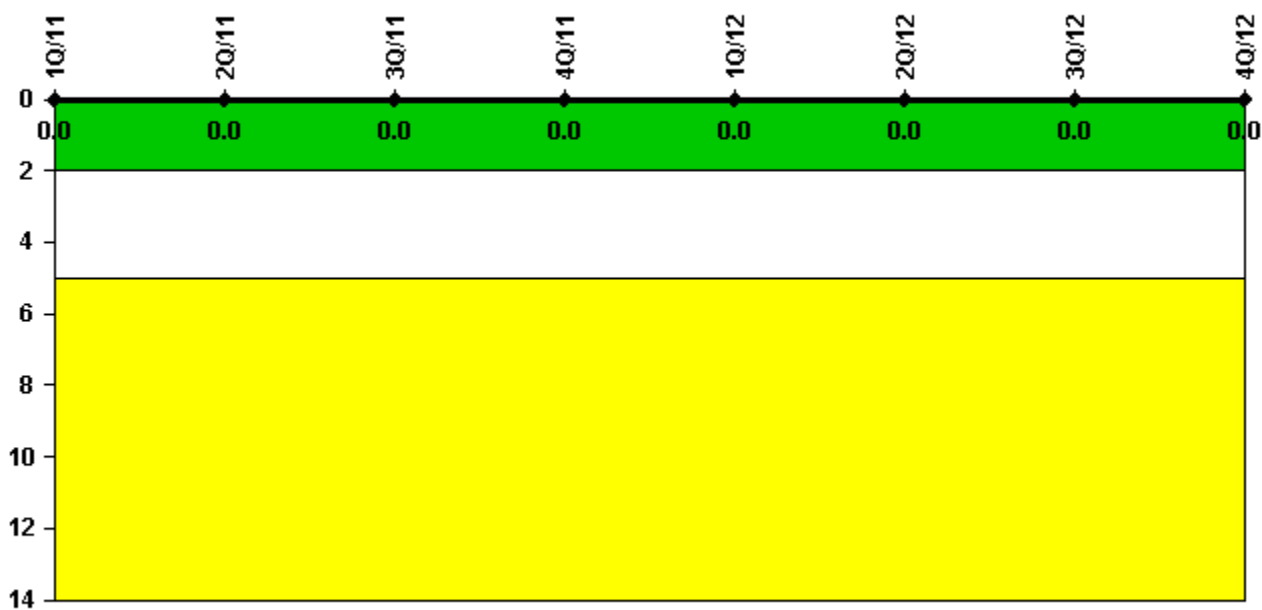


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

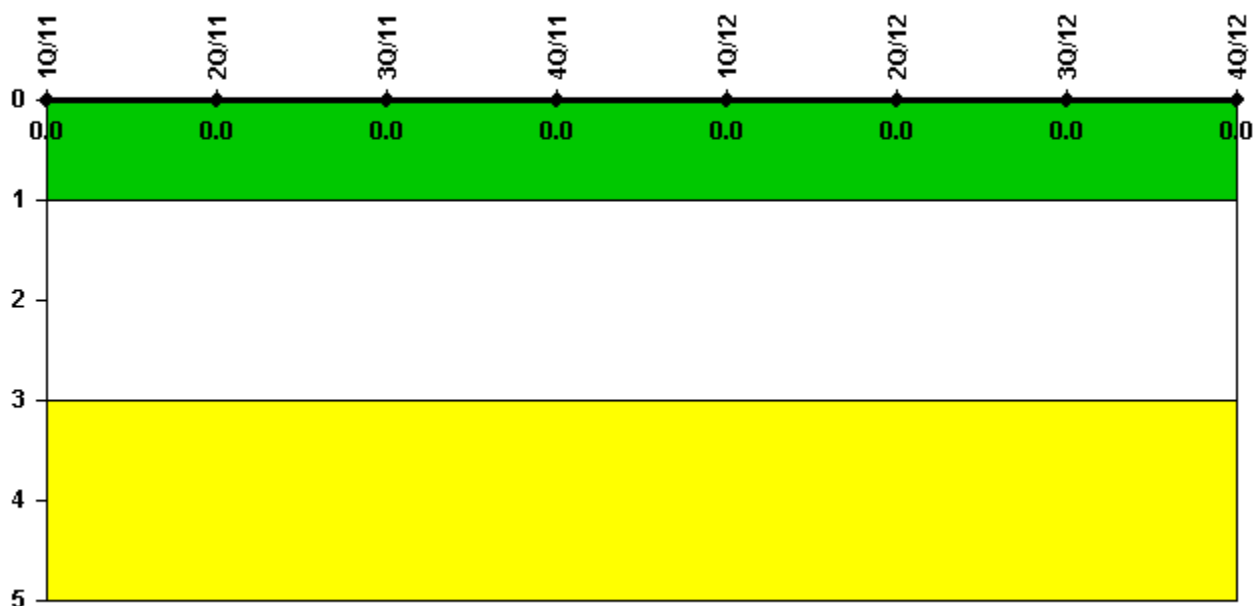

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.