


# Nine Mile Point 1

## 1Q/2013 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

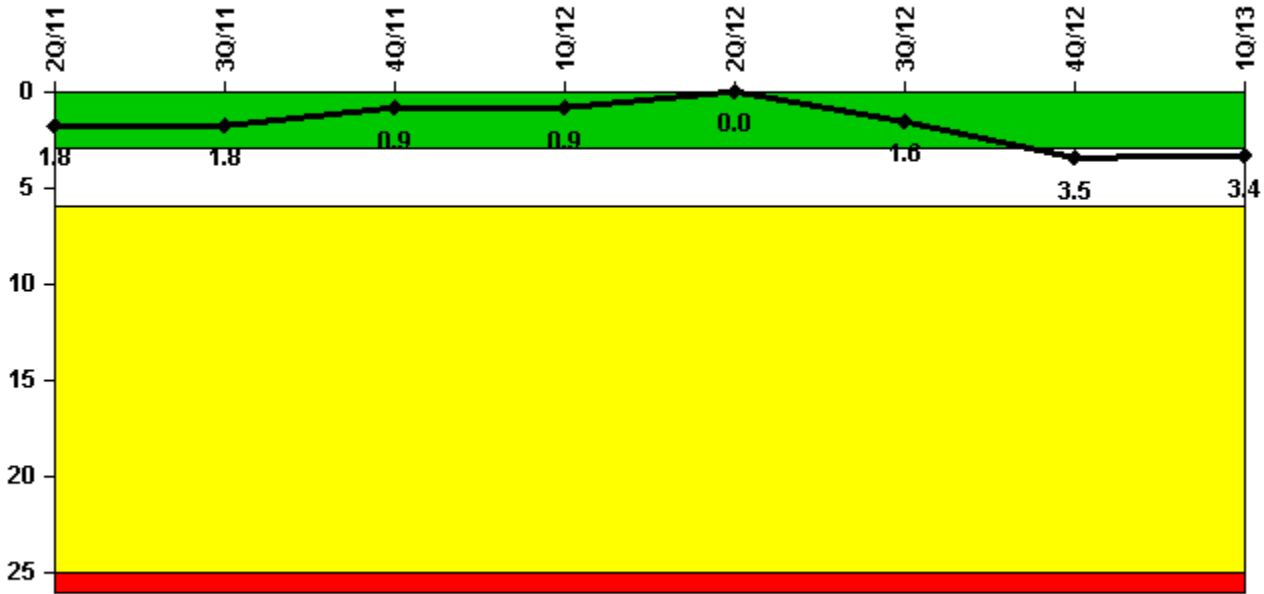


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Unplanned scrams	1.0	0	0	0	0	2.0	2.0	0
Critical hours	1390.7	2208.0	2209.0	2065.3	2184.0	2037.5	1793.2	2159.0
<b>Indicator value</b>	<b>1.8</b>	<b>1.8</b>	<b>0.9</b>	<b>0.9</b>	<b>0</b>	<b>1.6</b>	<b>3.5</b>	<b>3.4</b>

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

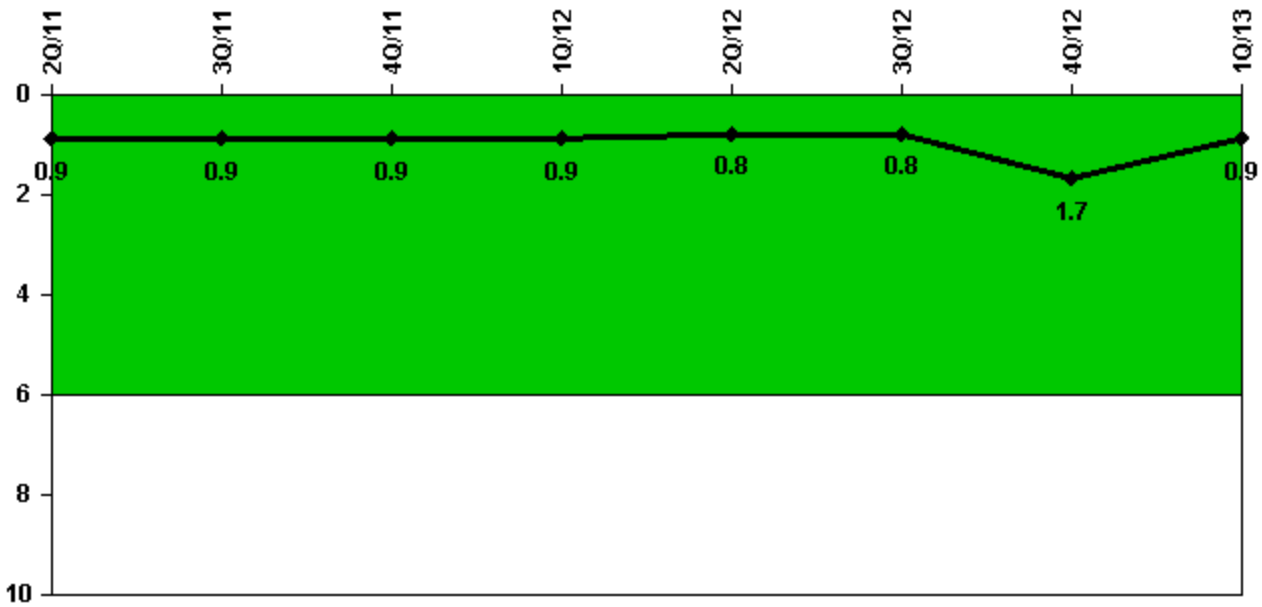


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Unplanned power changes	0	0	0	1.0	0	0	1.0	0
Critical hours	1390.7	2208.0	2209.0	2065.3	2184.0	2037.5	1793.2	2159.0
<b>Indicator value</b>	<b>0.9</b>	<b>0.9</b>	<b>0.9</b>	<b>0.9</b>	<b>0.8</b>	<b>0.8</b>	<b>1.7</b>	<b>0.9</b>

Licensee Comments: none

### Unplanned Scrams with Complications

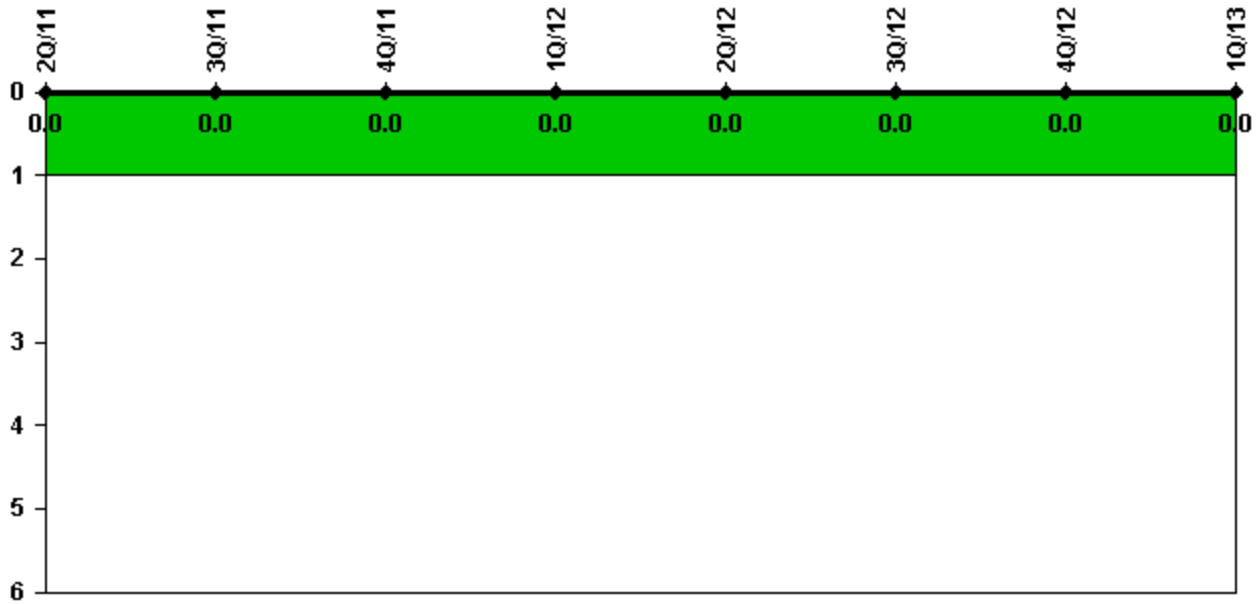


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (BWR)

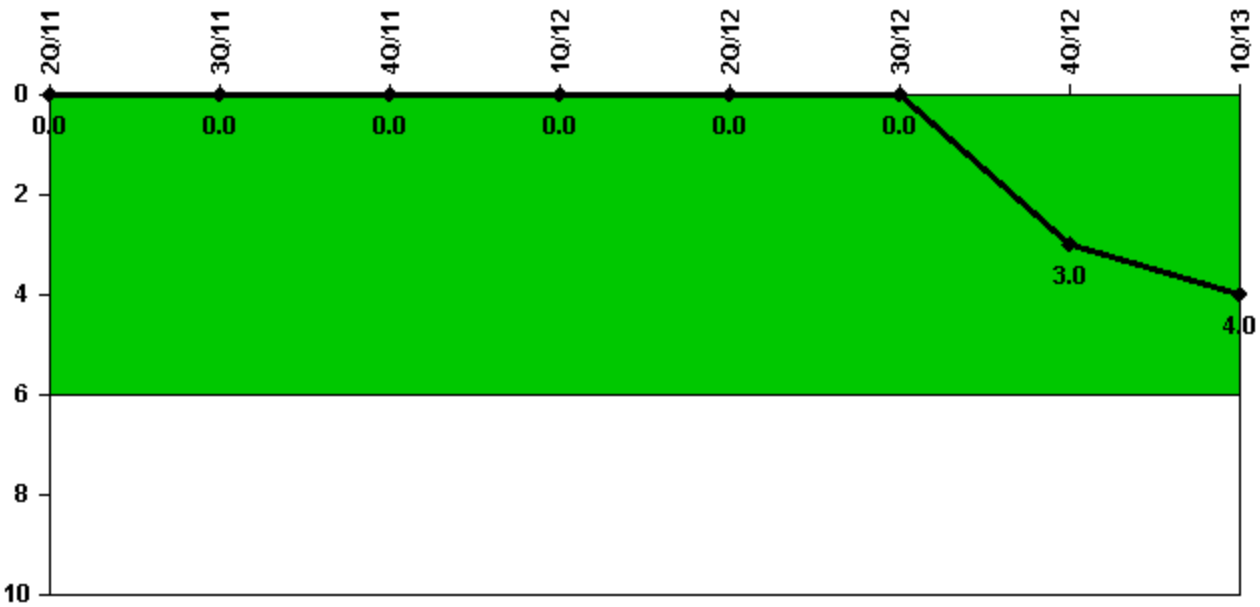

Thresholds: White > 6.0

#### Notes


Safety System Functional Failures (BWR)	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Safety System Functional Failures	0	0	0	0	0	0	3	1
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>3</b>	<b>4</b>

Licensee Comments:

1Q/13: LER 2012-006

4Q/12: LER 2012-003

### Mitigating Systems Performance Index, Emergency AC Power System

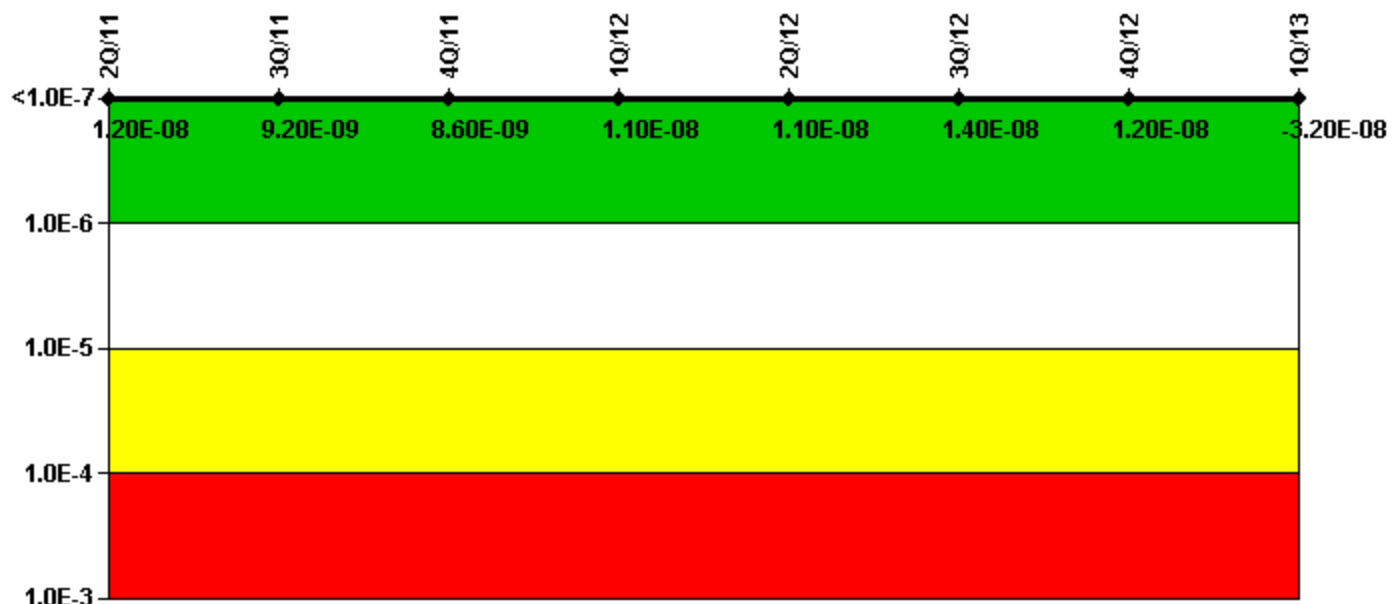


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
UAI ( $\Delta$ CDF)	-4.18E-09	-3.27E-09	-3.28E-09	-2.95E-09	-2.84E-09	2.35E-10	-3.26E-09	-4.69E-09
URI ( $\Delta$ CDF)	1.62E-08	1.25E-08	1.19E-08	1.35E-08	1.39E-08	1.36E-08	1.48E-08	-2.75E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.20E-08	9.20E-09	8.60E-09	1.10E-08	1.10E-08	1.40E-08	1.20E-08	-3.20E-08

Licensee Comments: none

### Mitigating Systems Performance Index, High Pressure Injection System

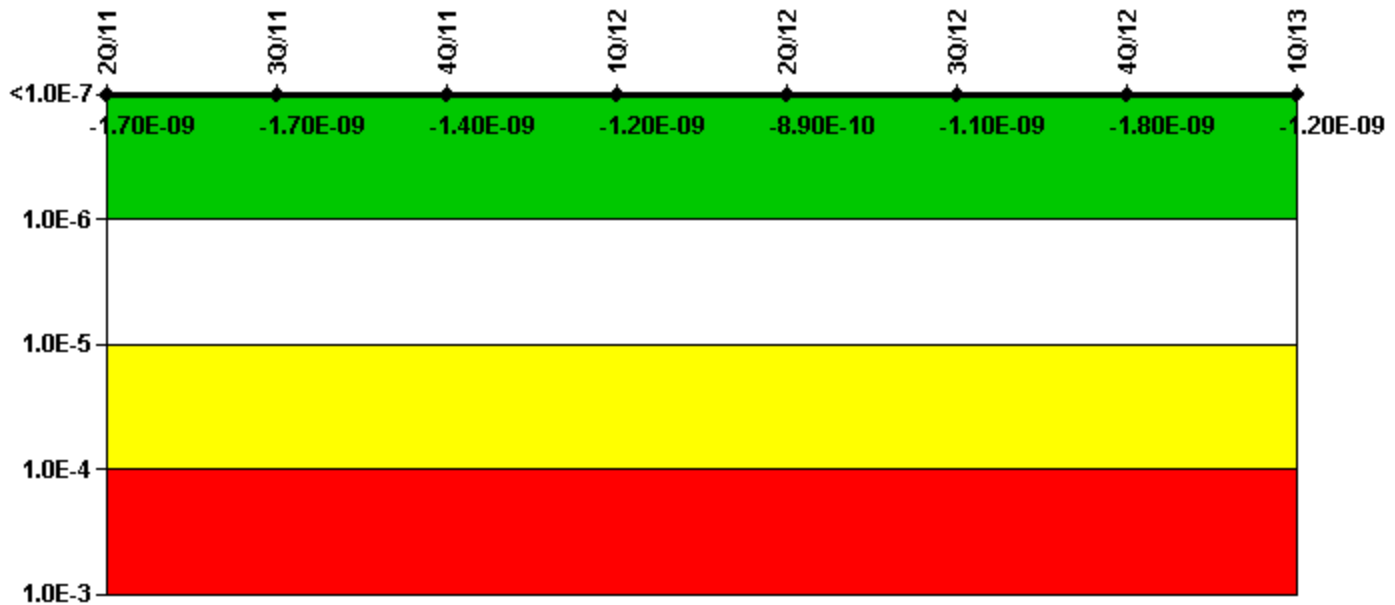


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
UAI ( $\Delta$ CDF)	-1.09E-08	-1.09E-08	-1.09E-08	-1.09E-08	-1.09E-08	-1.09E-08	-1.09E-08	-1.03E-08
URI ( $\Delta$ CDF)	9.18E-09	9.15E-09	9.51E-09	9.69E-09	9.99E-09	9.78E-09	9.09E-09	9.14E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.70E-09	-1.70E-09	-1.40E-09	-1.20E-09	-8.90E-10	-1.10E-09	-1.80E-09	-1.20E-09

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

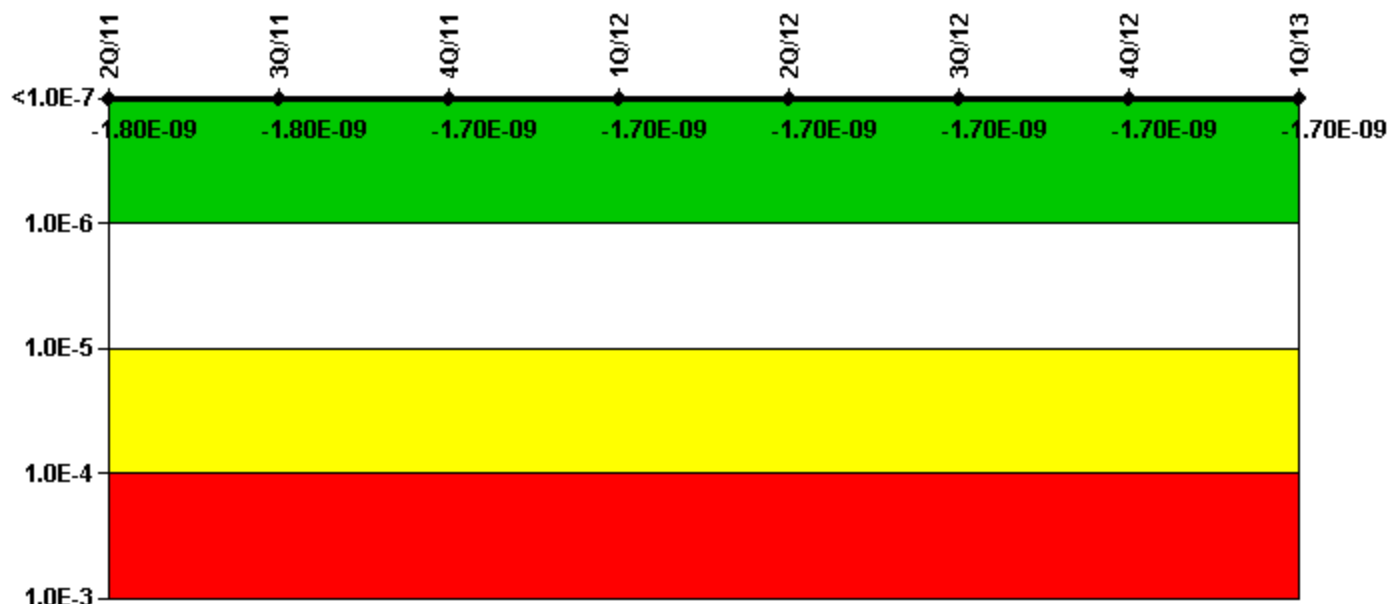


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
UAI ( $\Delta$ CDF)	-1.24E-09	-1.24E-09	-1.24E-09	-1.24E-09	-1.24E-09	-1.24E-09	-1.24E-09	-1.24E-09
URI ( $\Delta$ CDF)	-5.25E-10	-5.14E-10	-5.06E-10	-4.69E-10	-4.42E-10	-4.54E-10	-4.48E-10	-4.36E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.80E-09	-1.80E-09	-1.70E-09	-1.70E-09	-1.70E-09	-1.70E-09	-1.70E-09	-1.70E-09

Licensee Comments: none

### Mitigating Systems Performance Index, Residual Heat Removal System

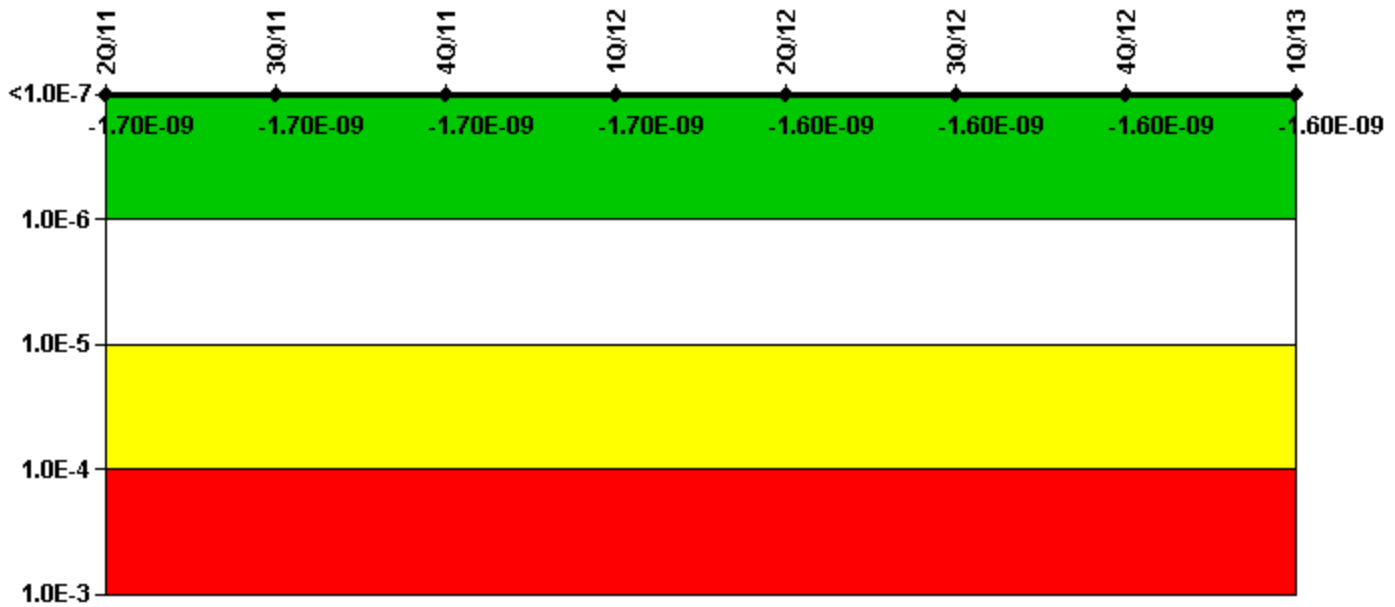

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
UAI ( $\Delta$ CDF)	-1.46E-10	-1.46E-10	-1.46E-10	-1.46E-10	-1.46E-10	-1.49E-10	-1.49E-10	-1.49E-10
URI ( $\Delta$ CDF)	-1.54E-09	-1.53E-09	-1.54E-09	-1.55E-09	-1.46E-09	-1.46E-09	-1.46E-09	-1.48E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.70E-09	-1.70E-09	-1.70E-09	-1.70E-09	-1.60E-09	-1.60E-09	-1.60E-09	-1.60E-09

Licensee Comments: none



### Mitigating Systems Performance Index, Cooling Water Systems

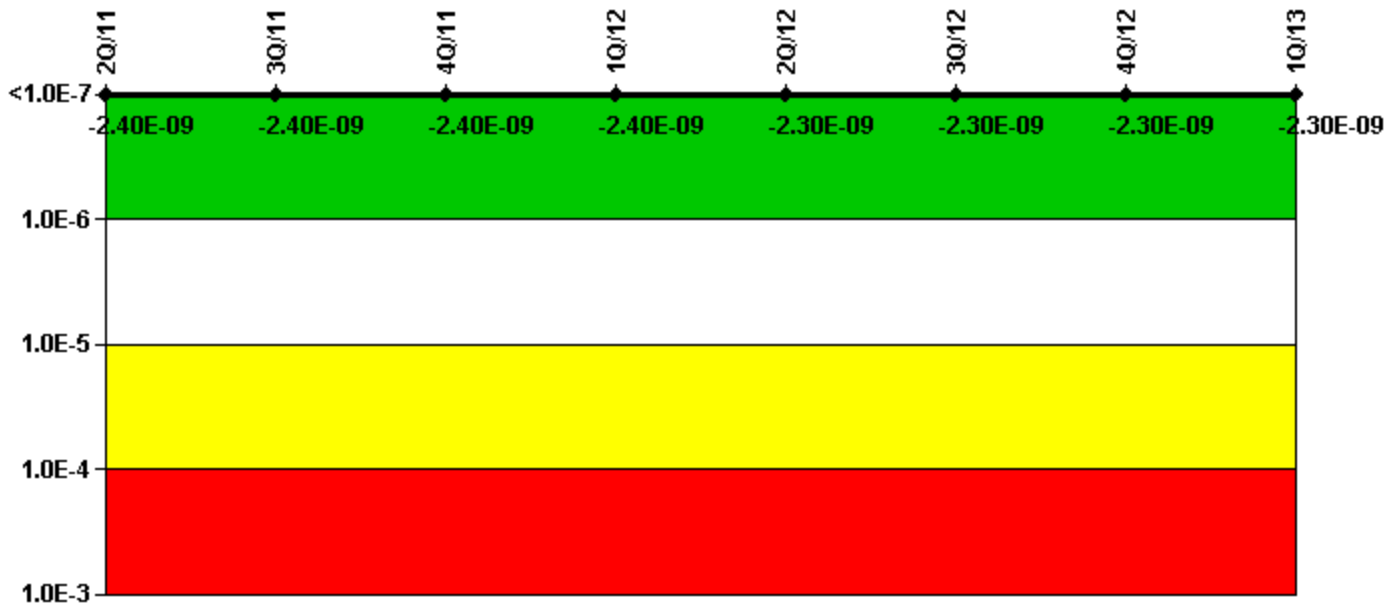


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
UAI ( $\Delta$ CDF)	-1.57E-08	-1.57E-08	-1.57E-08	-1.57E-08	-1.57E-08	-1.57E-08	-1.57E-08	-1.57E-08
URI ( $\Delta$ CDF)	1.33E-08	1.33E-08	1.33E-08	1.33E-08	1.34E-08	1.34E-08	1.34E-08	1.34E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.40E-09	-2.40E-09	-2.40E-09	-2.40E-09	-2.30E-09	-2.30E-09	-2.30E-09	-2.30E-09

Licensee Comments: none

### Reactor Coolant System Activity

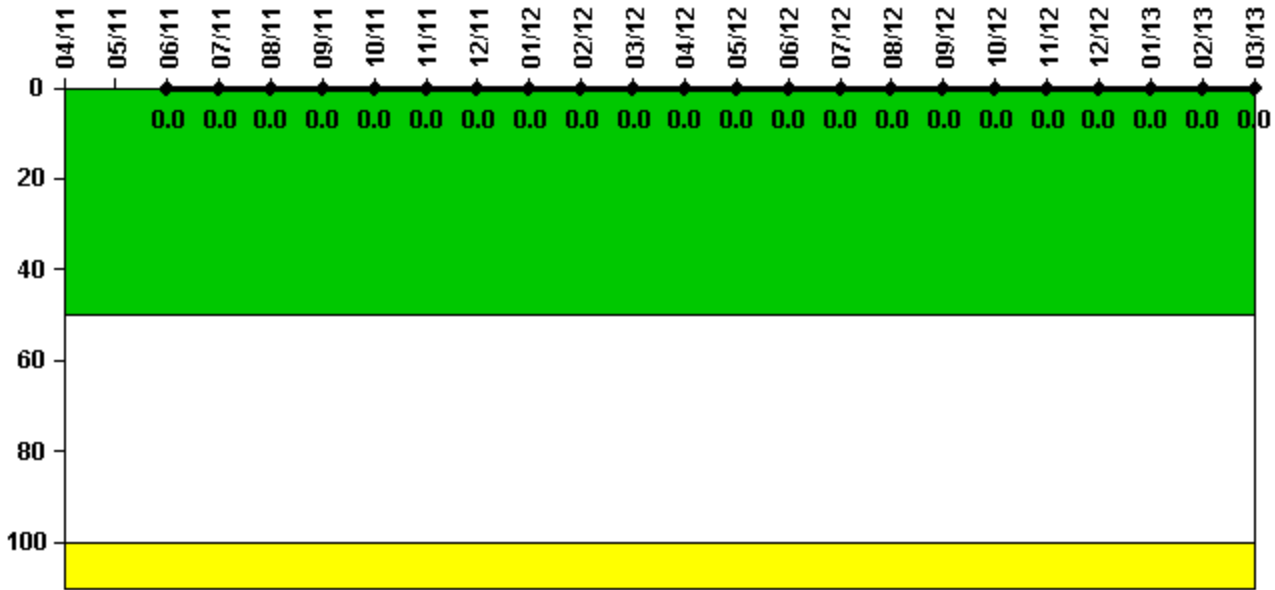

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12
Maximum activity	N/A	N/A	0.000009	0.000008	0.000007	0.000006	0.000007	0.000007	0.000009	0.000007	0.000007	0.000007
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	N/A	N/A	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum activity	0.000016	0.000007	0.000008	0.000008	0.000010	0.000009	0.000006	0.000009	0.000008	0.000010	0.000008	0.000007
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

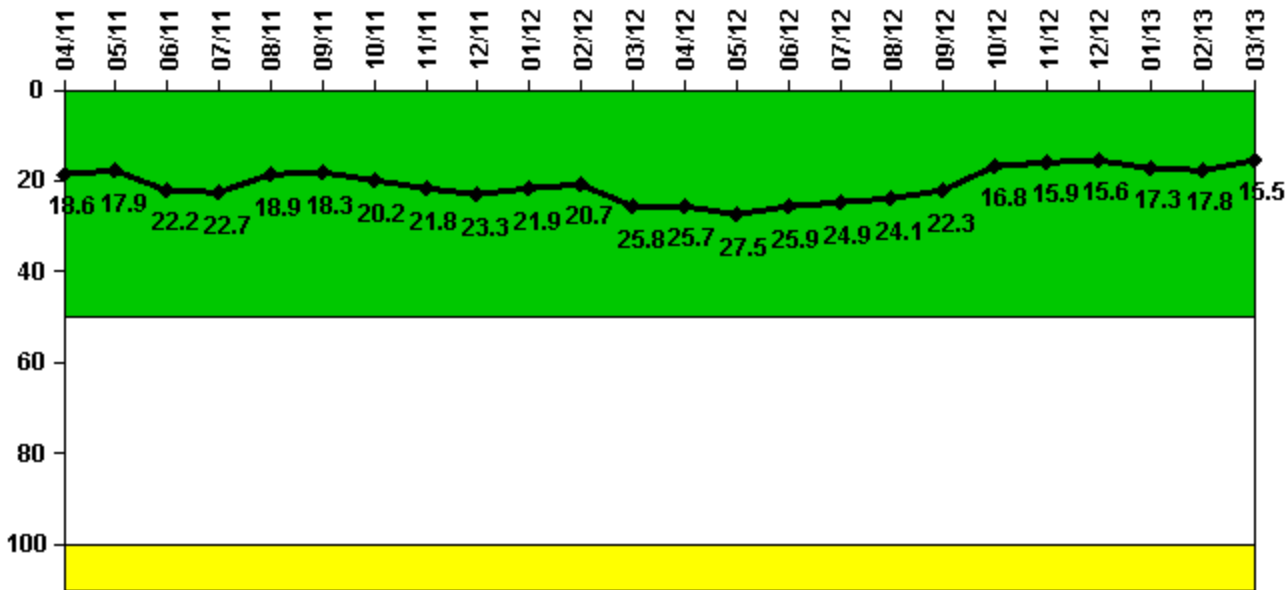

Thresholds: White > 50.0 Yellow > 100.0


#### Notes

Reactor Coolant System Leakage	4/11	5/11	6/11	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12
Maximum leakage	4.657	4.480	5.562	5.664	4.717	4.583	5.057	5.452	5.834	5.469	5.174	6.457
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
<b>Indicator value</b>	<b>18.6</b>	<b>17.9</b>	<b>22.2</b>	<b>22.7</b>	<b>18.9</b>	<b>18.3</b>	<b>20.2</b>	<b>21.8</b>	<b>23.3</b>	<b>21.9</b>	<b>20.7</b>	<b>25.8</b>
Reactor Coolant System Leakage	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum leakage	6.434	6.881	6.480	6.229	6.026	5.572	4.192	3.967	3.908	4.326	4.459	3.886
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
<b>Indicator value</b>	<b>25.7</b>	<b>27.5</b>	<b>25.9</b>	<b>24.9</b>	<b>24.1</b>	<b>22.3</b>	<b>16.8</b>	<b>15.9</b>	<b>15.6</b>	<b>17.3</b>	<b>17.8</b>	<b>15.5</b>

#### Licensee Comments:

6/11: Change reflects Maximum RCS Identified leakage value since 1Q2010. Unit 1 does not have a technical specification limit on identified leakage. Per NEI 99-02, the total leakage must be entered instead of the identified leakage. However, identified leakage was entered since 1Q2010. This was corrected in 3Q2011. This change has no impact on the color of the indicator.

### Drill/Exercise Performance

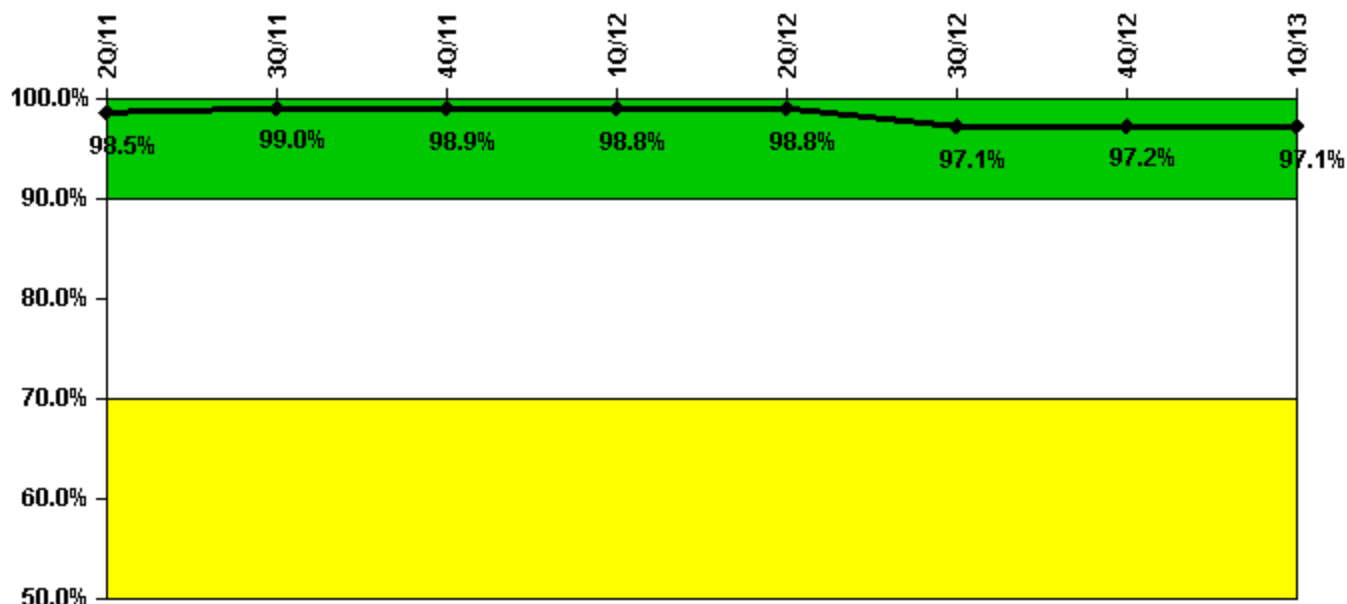


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Successful opportunities	11.0	26.0	60.0	37.0	3.0	79.0	60.0	25.0
Total opportunities	11.0	26.0	61.0	38.0	3.0	85.0	61.0	25.0
Indicator value	98.5%	99.0%	98.9%	98.8%	98.8%	97.1%	97.2%	97.1%

Licensee Comments: none

### ERO Drill Participation

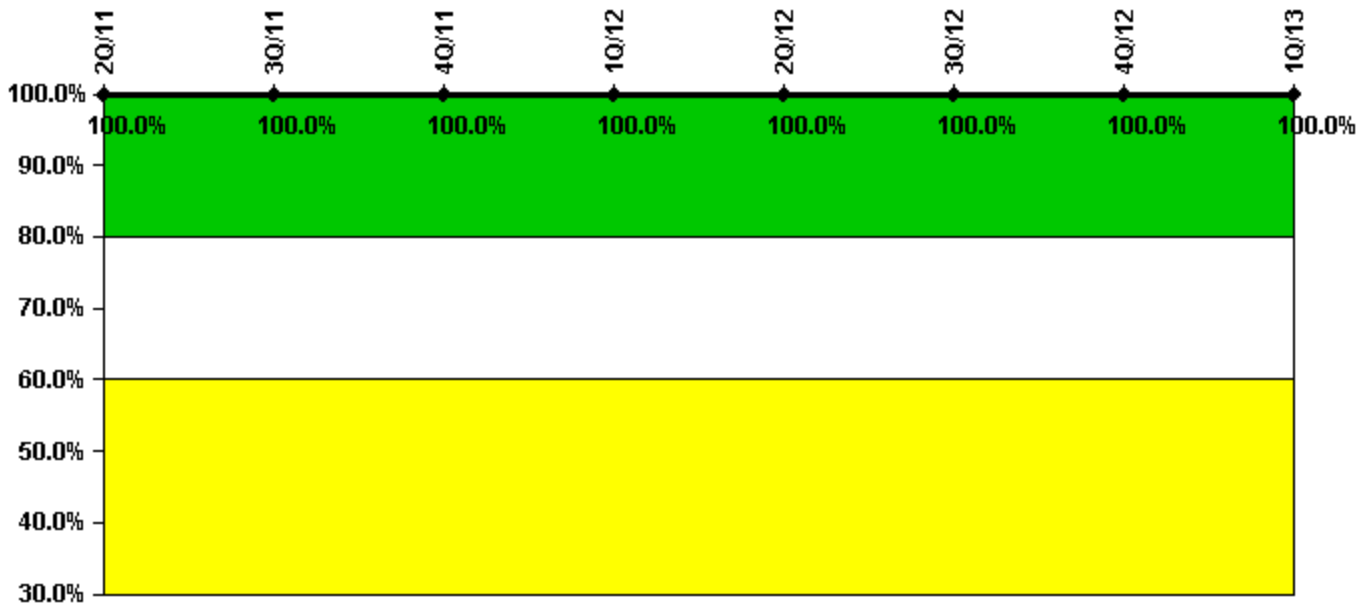


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Participating Key personnel	102.0	97.0	90.0	88.0	83.0	86.0	84.0	87.0
Total Key personnel	102.0	97.0	90.0	88.0	83.0	86.0	84.0	87.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Alert & Notification System

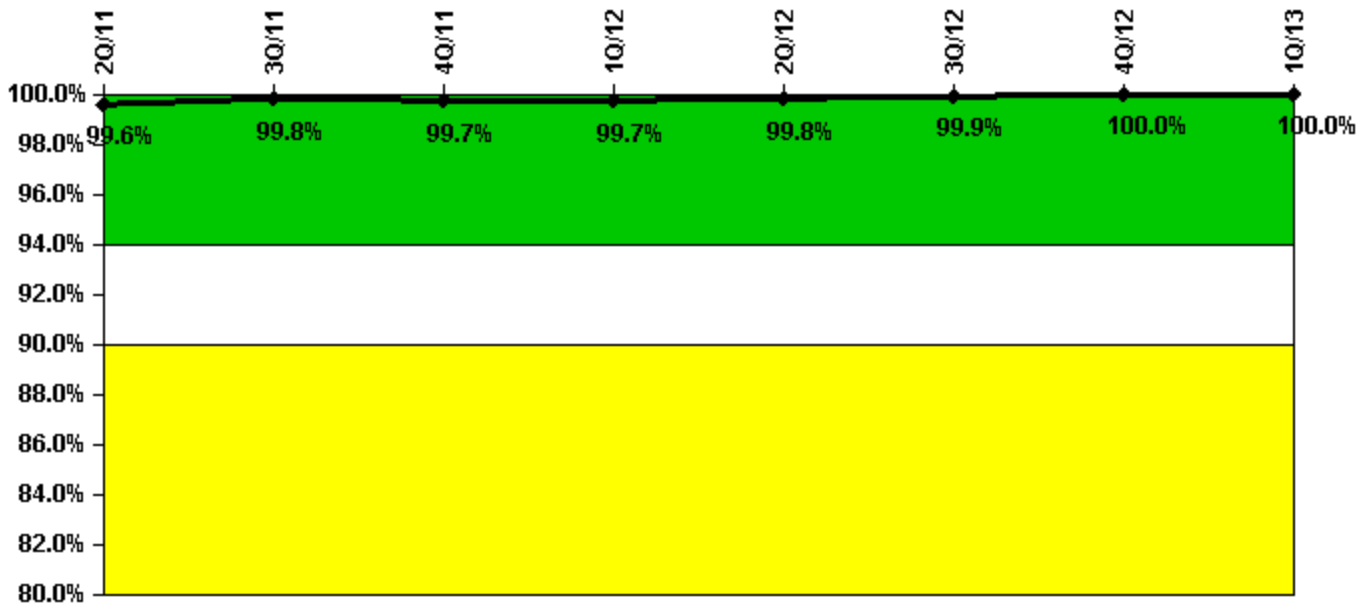


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
Successful siren-tests	258	258	295	222	296	222	333	222
Total sirens-tests	259	259	296	222	296	222	333	222
Indicator value	99.6%	99.8%	99.7%	99.7%	99.8%	99.9%	100.0%	100.0%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

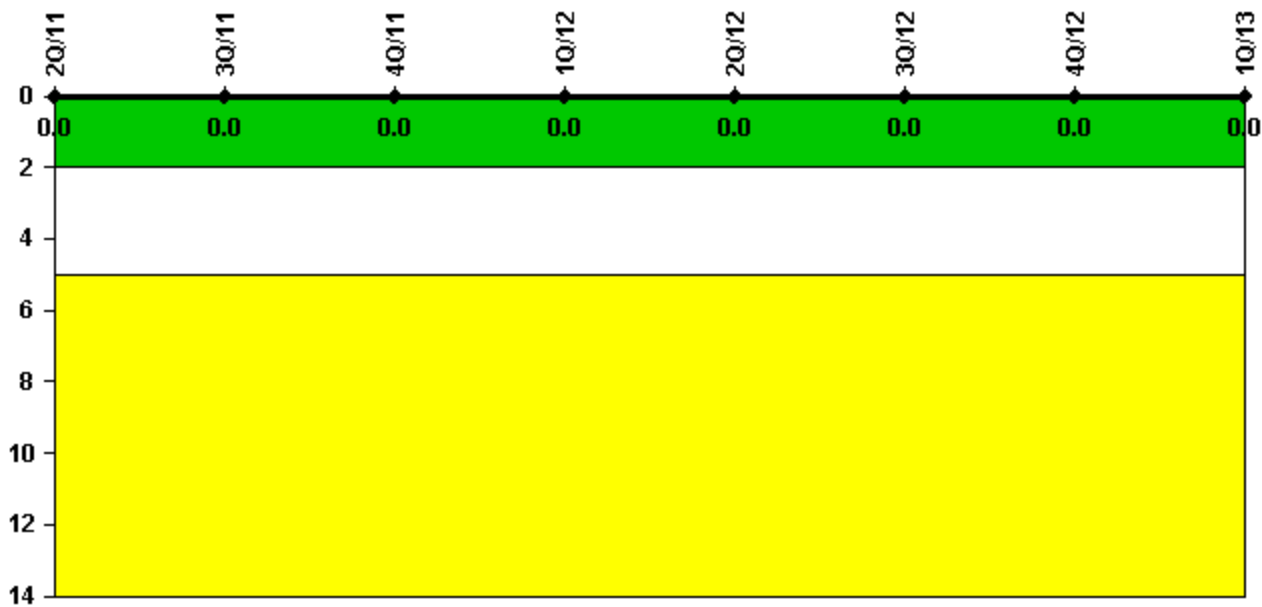


Thresholds: White > 2.0 Yellow > 5.0

**Notes**

Occupational Exposure Control Effectiveness	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

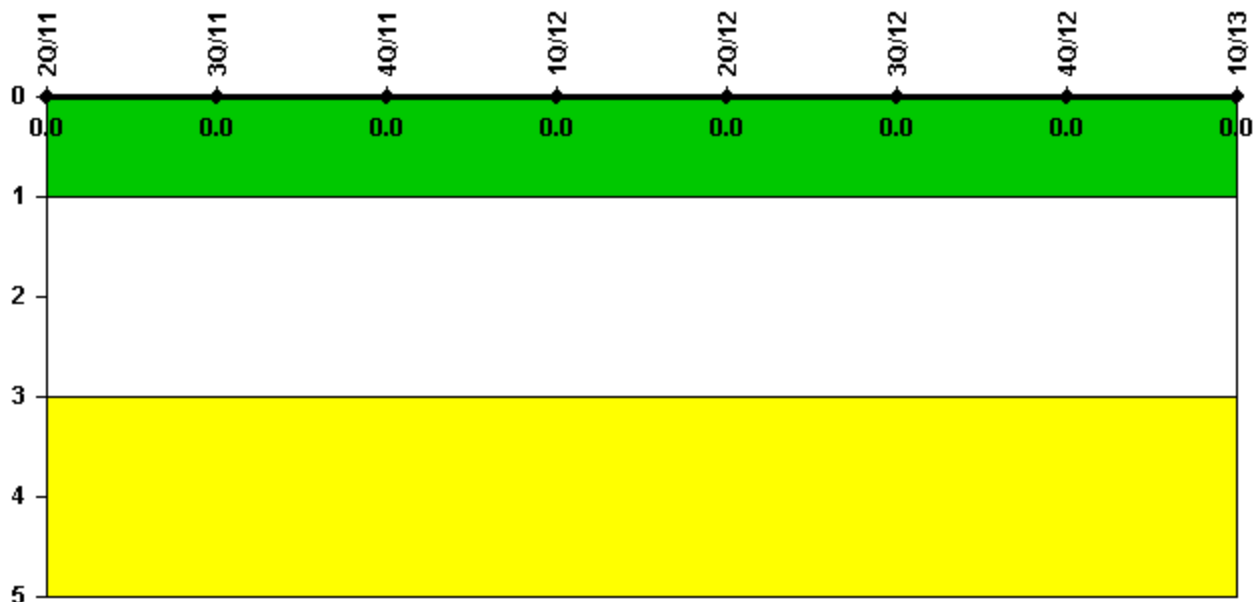

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: April 23, 2013*