


## Farley 2

### 2Q/2013 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

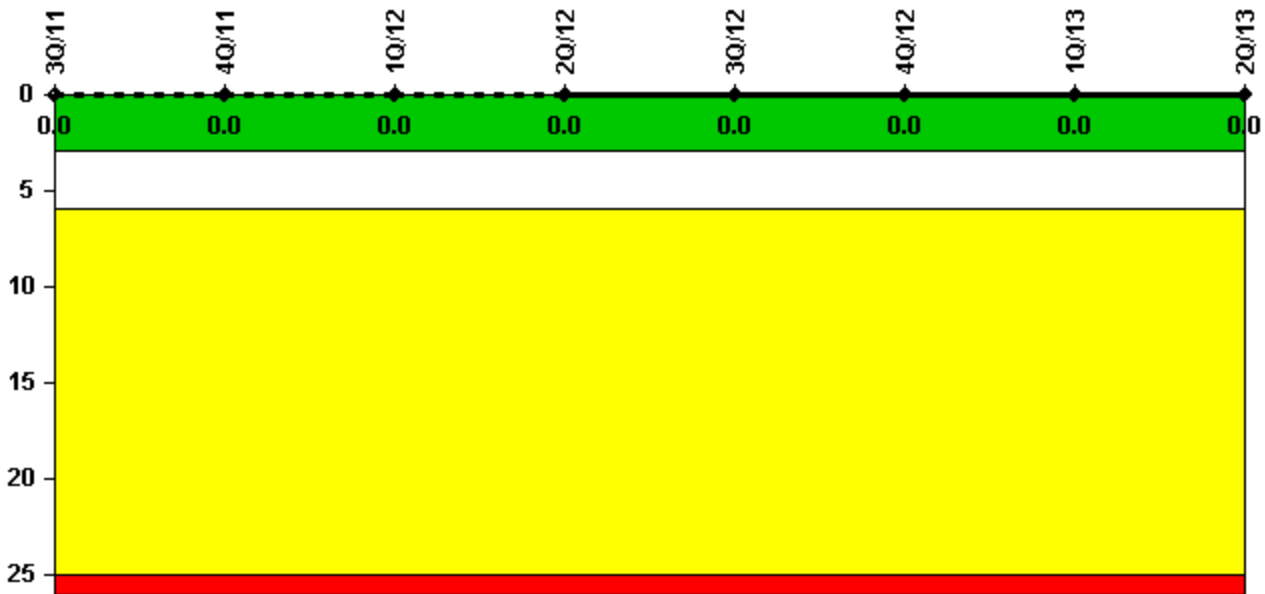


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

#### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2208.0	1483.2	2183.0	2184.0	2208.0	2209.0	2159.0	1600.1
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

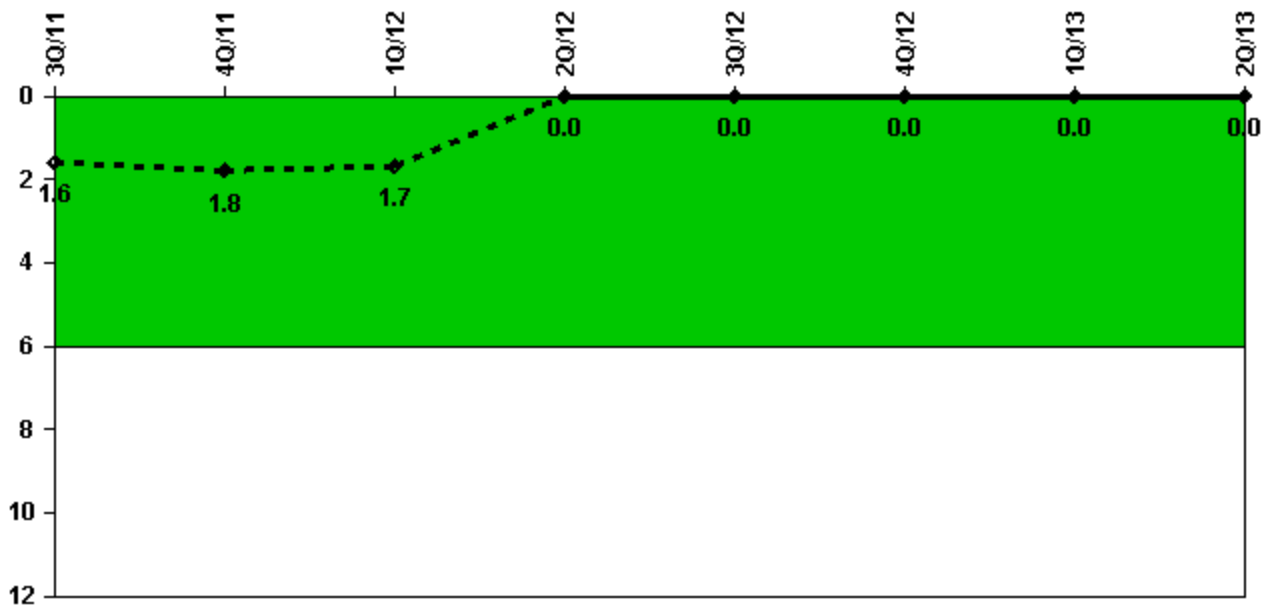


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	1483.2	2183.0	2184.0	2208.0	2209.0	2159.0	1600.1
<b>Indicator value</b>	<b>1.6</b>	<b>1.8</b>	<b>1.7</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Unplanned Scrams with Complications

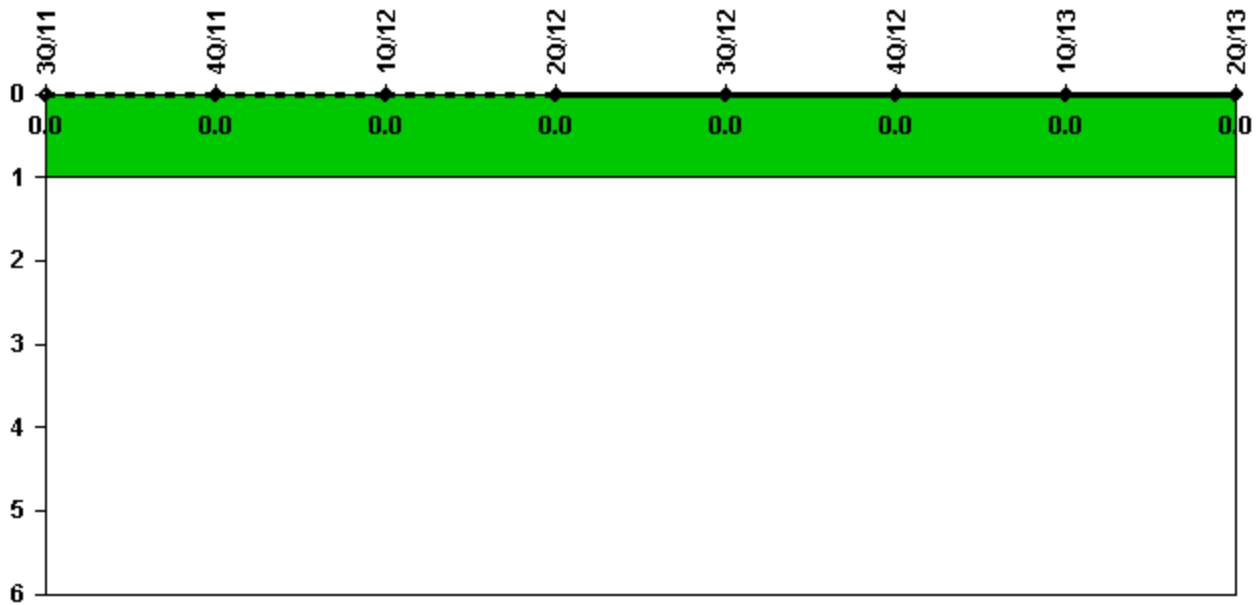


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

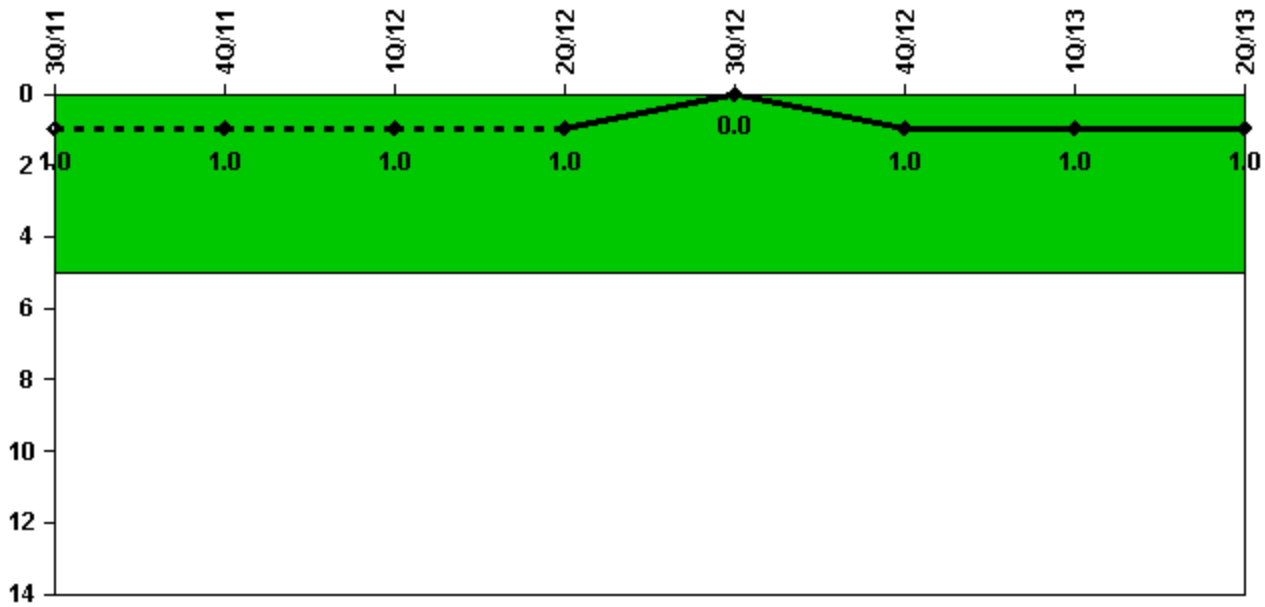

Thresholds: White > 5.0


#### Notes

Safety System Functional Failures (PWR)	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Safety System Functional Failures	1	0	0	0	0	1	0	0
<b>Indicator value</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>1</b>

Licensee Comments:

3Q/11: LER - 2011-001-00 Turbine Driven Auxiliary Feedwater Pump Inoperable

### Mitigating Systems Performance Index, Emergency AC Power System

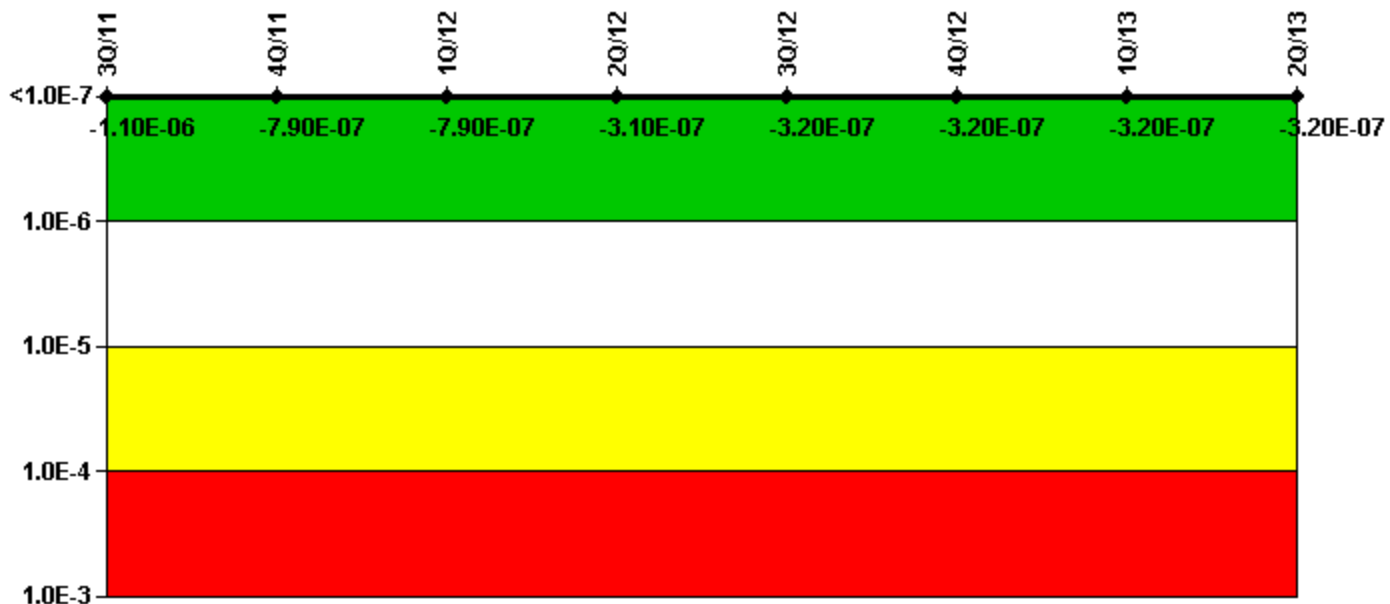

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI ( $\Delta$ CDF)	-9.41E-08	-6.57E-08	-6.80E-08	-9.00E-09	-2.58E-08	-2.58E-08	-2.58E-08	-2.59E-08
URI ( $\Delta$ CDF)	-9.97E-07	-7.21E-07	-7.19E-07	-2.98E-07	-2.98E-07	-2.98E-07	-2.98E-07	-2.98E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.10E-06	-7.90E-07	-7.90E-07	-3.10E-07	-3.20E-07	-3.20E-07	-3.20E-07	-3.20E-07

Licensee Comments:

2Q/12: MSPI Basis document was changed due to a Unit 2 PRA update. Effective 2Q2012.

### Mitigating Systems Performance Index, High Pressure Injection System

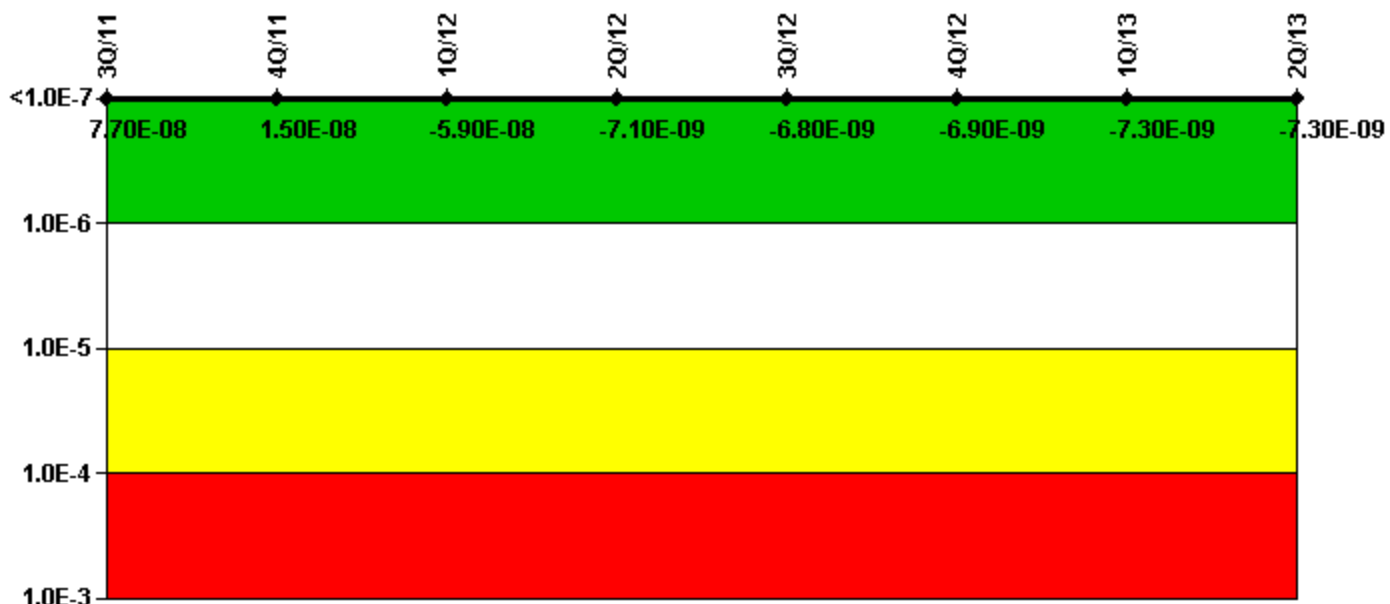

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI ( $\Delta$ CDF)	4.69E-08	-1.48E-08	-2.68E-08	-2.60E-10	7.84E-11	1.94E-11	-4.00E-10	-4.17E-10
URI ( $\Delta$ CDF)	3.01E-08	3.01E-08	-3.22E-08	-6.89E-09	-6.89E-09	-6.89E-09	-6.89E-09	-6.89E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	<b>7.70E-08</b>	<b>1.50E-08</b>	<b>-5.90E-08</b>	<b>-7.10E-09</b>	<b>-6.80E-09</b>	<b>-6.90E-09</b>	<b>-7.30E-09</b>	<b>-7.30E-09</b>

Licensee Comments:

2Q/12: MSPI Basis document was changed due to a Unit 2 PRA update. Effective 2Q2012.

### Mitigating Systems Performance Index, Heat Removal System

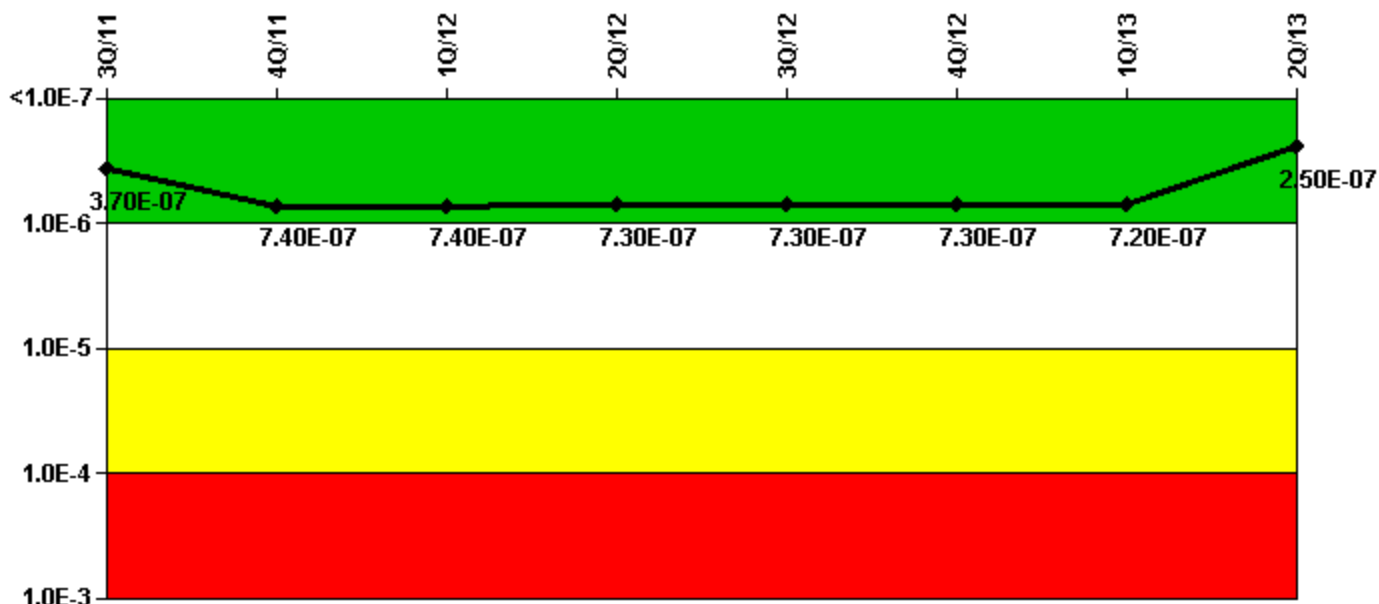

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI ( $\Delta$ CDF)	-9.74E-08	-3.15E-08	-3.48E-08	-3.71E-10	-3.71E-10	-6.13E-10	-3.95E-09	-5.32E-09
URI ( $\Delta$ CDF)	4.63E-07	7.74E-07	7.74E-07	7.28E-07	7.28E-07	7.28E-07	7.28E-07	2.53E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.70E-07	7.40E-07	7.40E-07	7.30E-07	7.30E-07	7.30E-07	7.20E-07	2.50E-07

Licensee Comments:


2Q/12: MSPI Basis document was changed due to a Unit 2 PRA update. Effective 2Q2012.

1Q/12: Risk Cap Invoked.

4Q/11: Risk Cap Invoked.

3Q/11: Risk Cap Invoked.

### Mitigating Systems Performance Index, Residual Heat Removal System

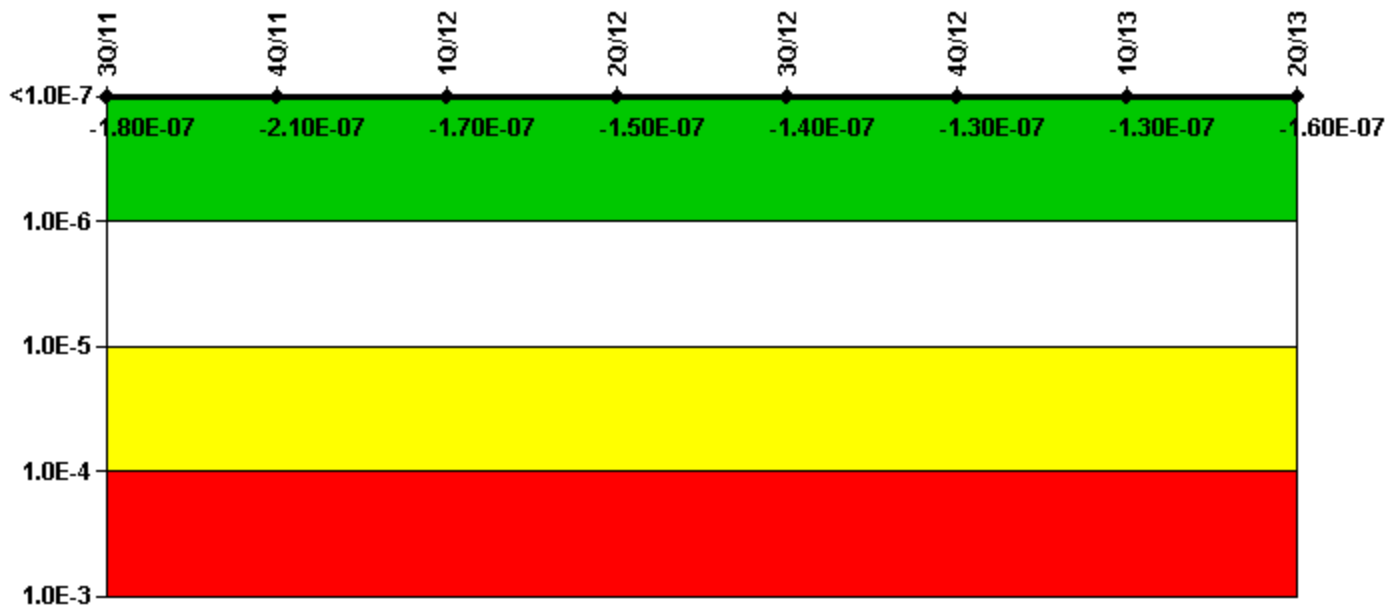

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes


Mitigating Systems Performance Index, Residual Heat Removal System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI ( $\Delta$ CDF)	4.59E-09	-2.61E-08	1.39E-08	-3.84E-09	4.34E-09	1.48E-08	1.81E-08	-1.45E-08
URI ( $\Delta$ CDF)	-1.84E-07	-1.84E-07	-1.84E-07	-1.47E-07	-1.47E-07	-1.47E-07	-1.47E-07	-1.47E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.80E-07	-2.10E-07	-1.70E-07	-1.50E-07	-1.40E-07	-1.30E-07	-1.30E-07	-1.60E-07

Licensee Comments:

2Q/12: MSPI Basis document was changed due to a Unit 2 PRA update. Effective 2Q2012.



### Mitigating Systems Performance Index, Cooling Water Systems

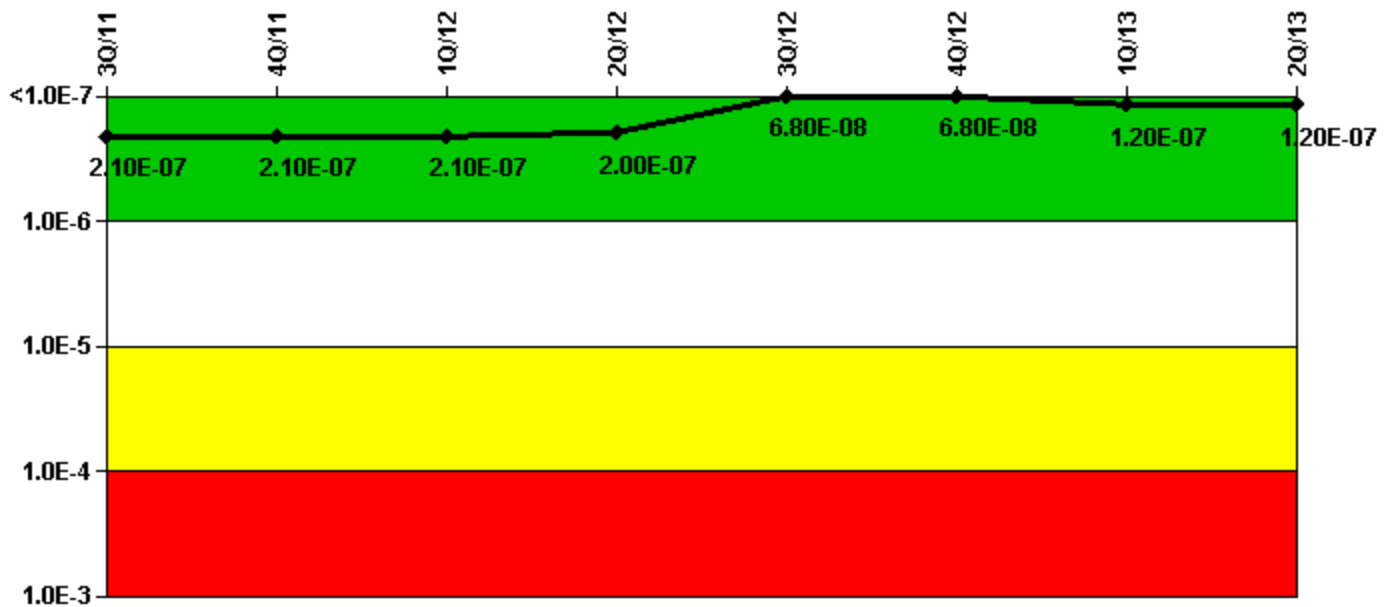

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI ( $\Delta$ CDF)	4.28E-08	4.25E-08	4.82E-08	4.10E-08	-1.07E-08	-1.07E-08	-1.14E-08	-1.04E-08
URI ( $\Delta$ CDF)	1.64E-07	1.64E-07	1.64E-07	1.58E-07	7.88E-08	7.88E-08	1.34E-07	1.34E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.10E-07	2.10E-07	2.10E-07	2.00E-07	6.80E-08	6.80E-08	1.20E-07	1.20E-07

Licensee Comments:

2Q/12: MSPI Basis document was changed due to a Unit 2 PRA update. Effective 2Q2012.

### Reactor Coolant System Activity

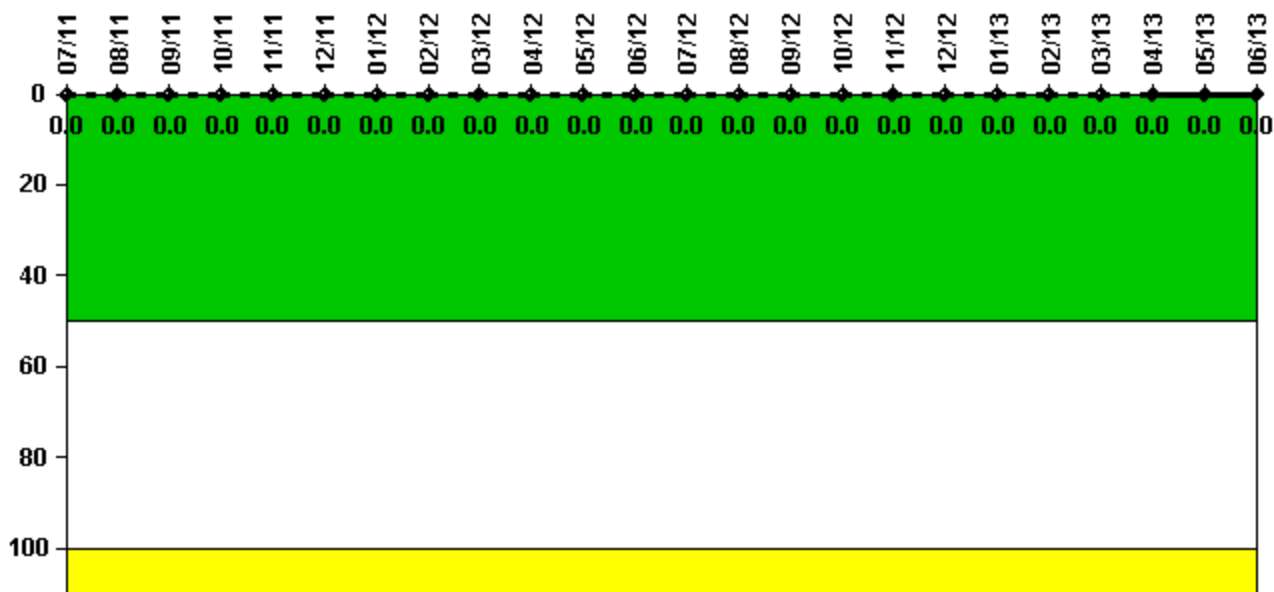

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum activity	0.000058	0.000054	0.000057	0.000054	0.000030	0.000031	0.000034	0.000035	0.000040	0.000040	0.000037	0.000038
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum activity	0.000038	0.000046	0.000045	0.000041	0.000046	0.000045	0.000046	0.000162	0.000048	0.000050	0.000028	0
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

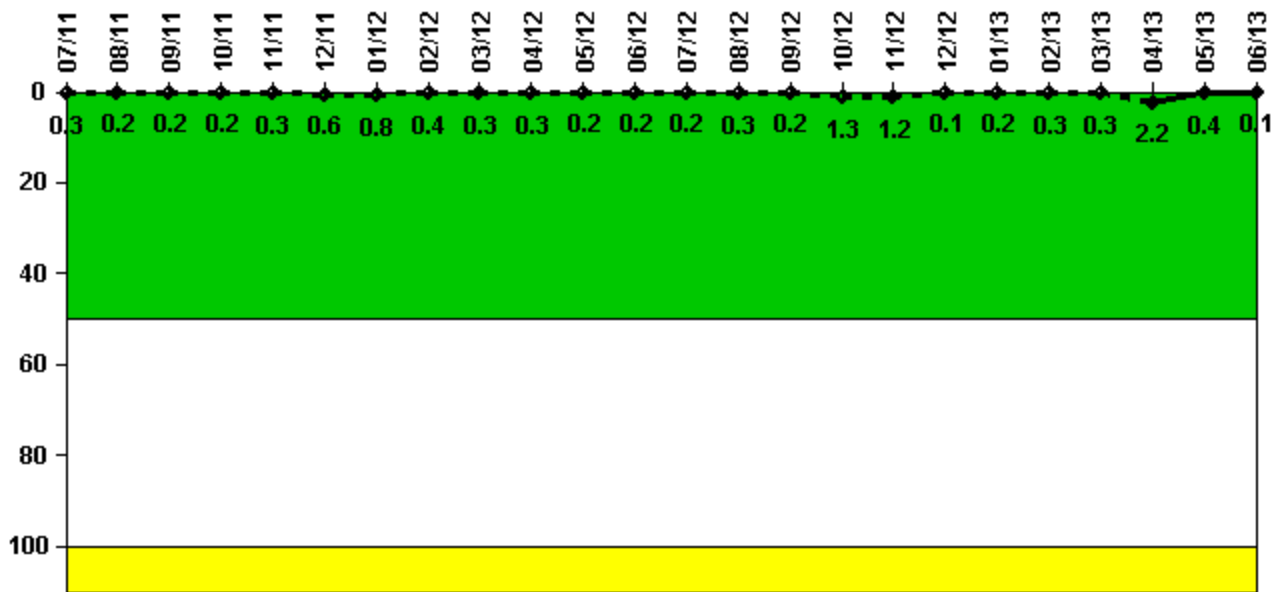


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum leakage	0.030	0.016	0.019	0.017	0.032	0.059	0.079	0.044	0.034	0.025	0.022	0.021
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.3</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.3</b>	<b>0.6</b>	<b>0.8</b>	<b>0.4</b>	<b>0.3</b>	<b>0.3</b>	<b>0.2</b>	<b>0.2</b>
Reactor Coolant System Leakage	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum leakage	0.015	0.025	0.019	0.125	0.121	0.014	0.019	0.025	0.029	0.216	0.036	0.014
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.2</b>	<b>0.3</b>	<b>0.2</b>	<b>1.3</b>	<b>1.2</b>	<b>0.1</b>	<b>0.2</b>	<b>0.3</b>	<b>0.3</b>	<b>2.2</b>	<b>0.4</b>	<b>0.1</b>

Licensee Comments: none

### Drill/Exercise Performance

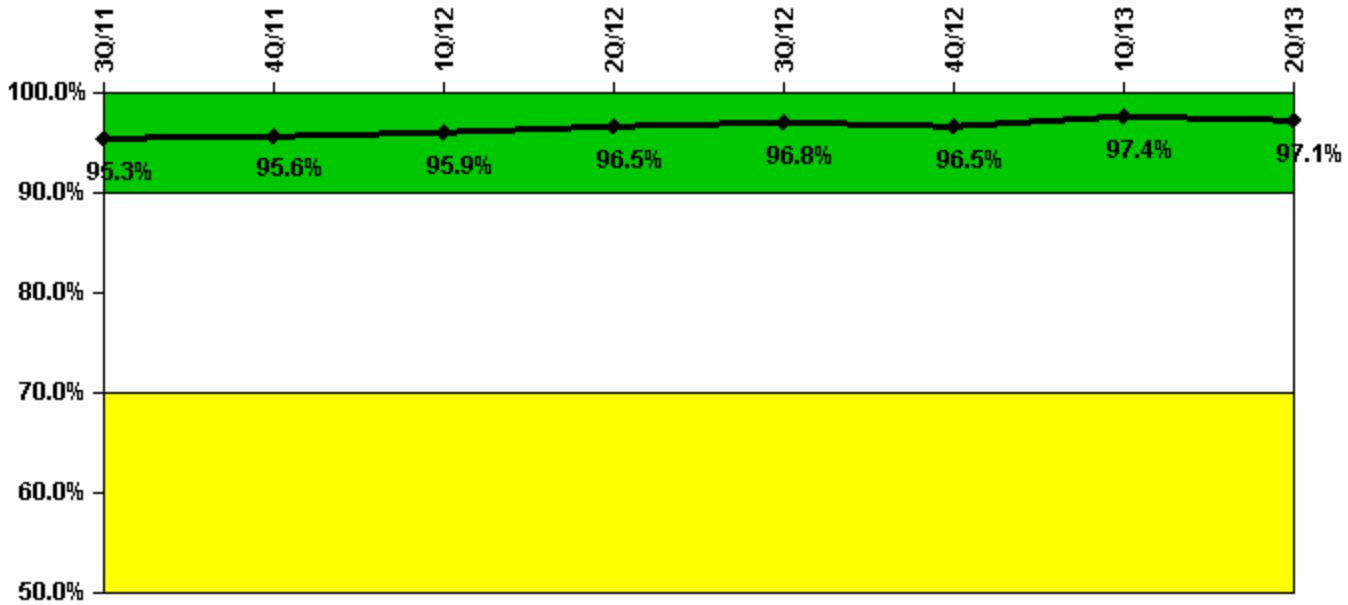

Thresholds: White < 90.0% Yellow < 70.0%


#### Notes

Drill/Exercise Performance	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Successful opportunities	55.0	28.0	39.0	14.0	62.0	45.0	40.0	47.0
Total opportunities	56.0	28.0	40.0	15.0	64.0	47.0	40.0	50.0
<b>Indicator value</b>	<b>95.3%</b>	<b>95.6%</b>	<b>95.9%</b>	<b>96.5%</b>	<b>96.8%</b>	<b>96.5%</b>	<b>97.4%</b>	<b>97.1%</b>

Licensee Comments:

1Q/12: Data changed due to an entry error at the site.

### ERO Drill Participation

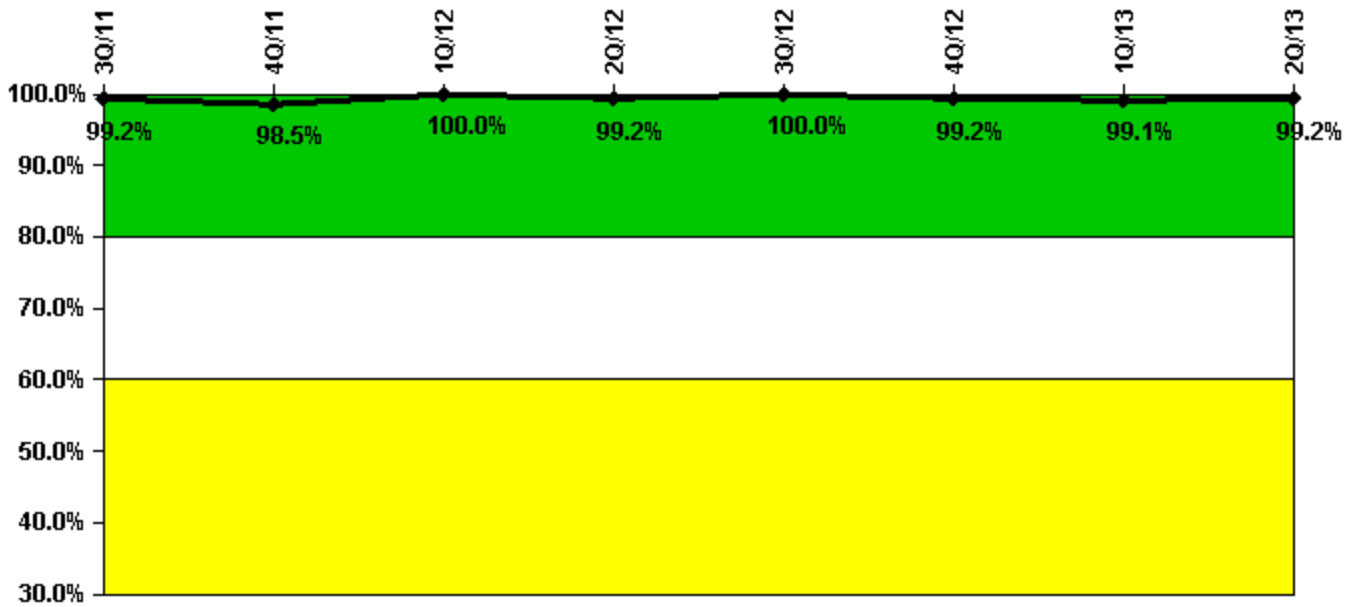


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Participating Key personnel	128.0	134.0	130.0	127.0	123.0	122.0	108.0	117.0
Total Key personnel	129.0	136.0	130.0	128.0	123.0	123.0	109.0	118.0
Indicator value	99.2%	98.5%	100.0%	99.2%	100.0%	99.2%	99.1%	99.2%

Licensee Comments: none

### Alert & Notification System

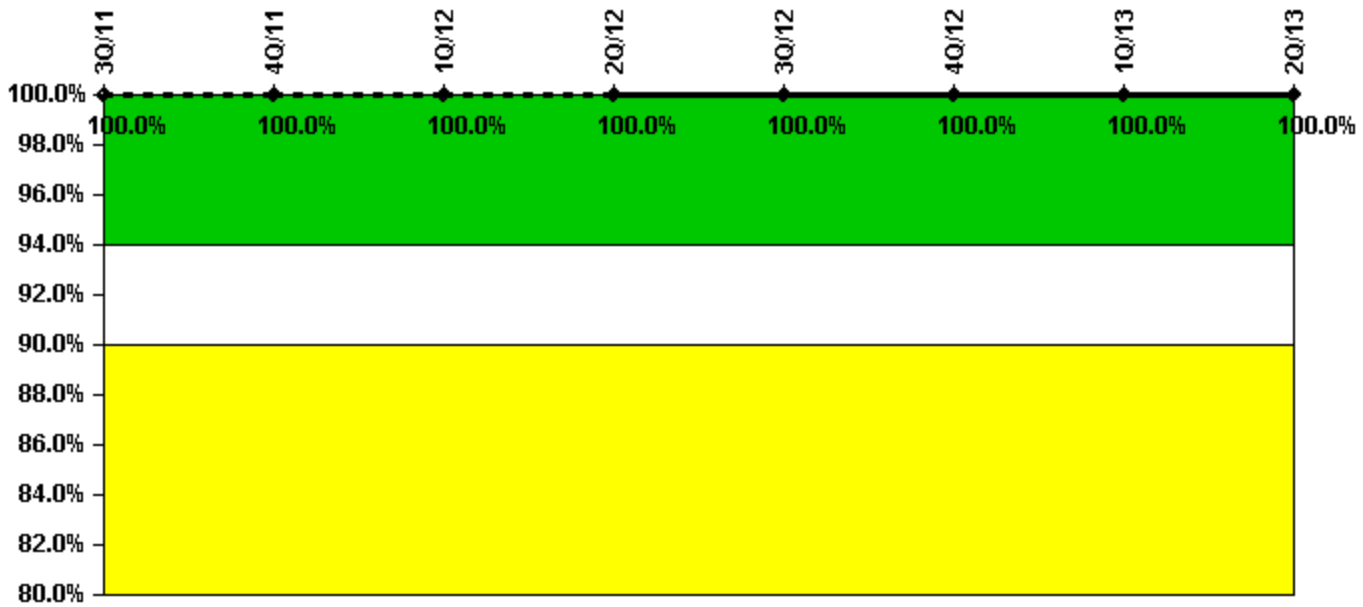


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Successful siren-tests	42	42	42	42	39	42	42	42
Total sirens-tests	42	42	42	42	39	42	42	42
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

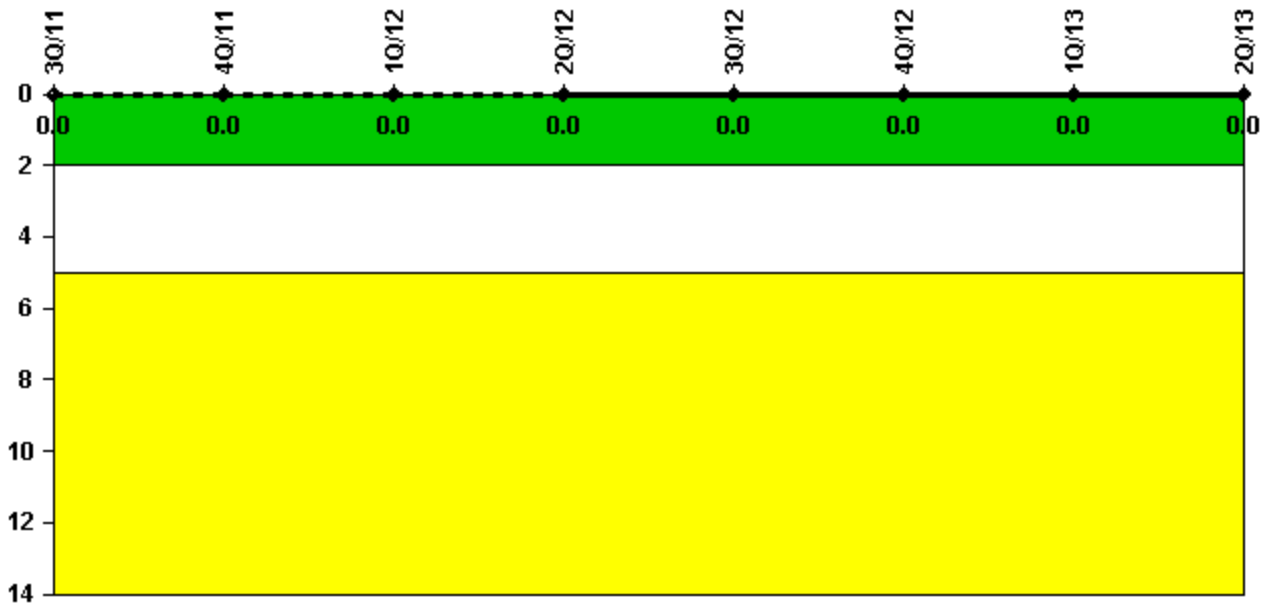


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

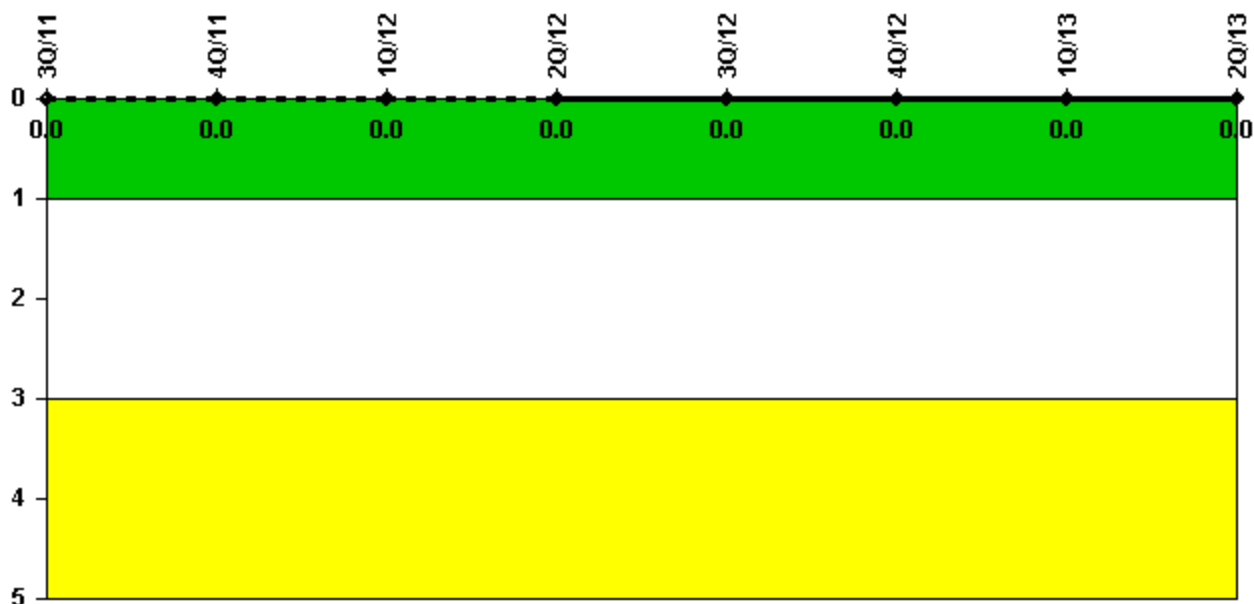

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: August 19, 2013*