


Susquehanna 1

3Q/2013 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

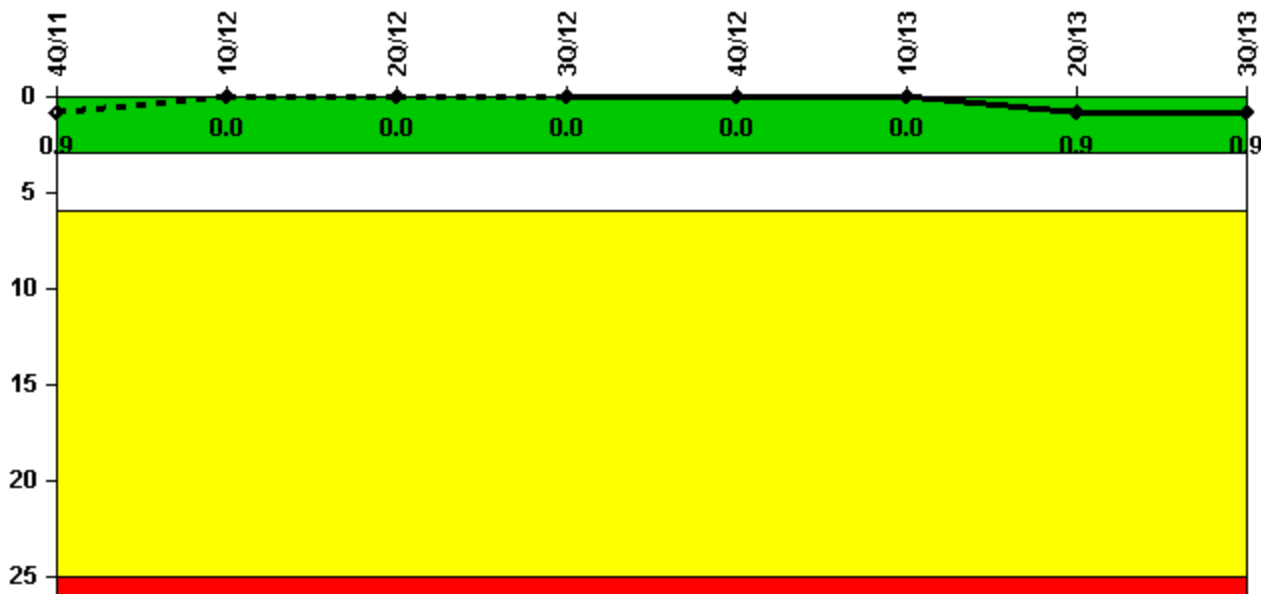

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Unplanned scrams	0	0	0	0	0	0	1.0	0
Critical hours	2209.0	2165.2	353.0	2208.0	1792.2	2159.0	1491.3	2208.0
Indicator value	0.9	0	0	0	0	0	0.9	0.9

Licensee Comments:

1Q/12: Supplemental LER's 50-387/2011-002-01, 50-387/2010-002-02, and 50-387/2010-003-03 were submitted in February 2012 to provide updated information related to the previously reported unplanned scrams at Susquehanna Unit 1 in April, May, July 2010, and January 2011.

Unplanned Power Changes per 7000 Critical Hrs

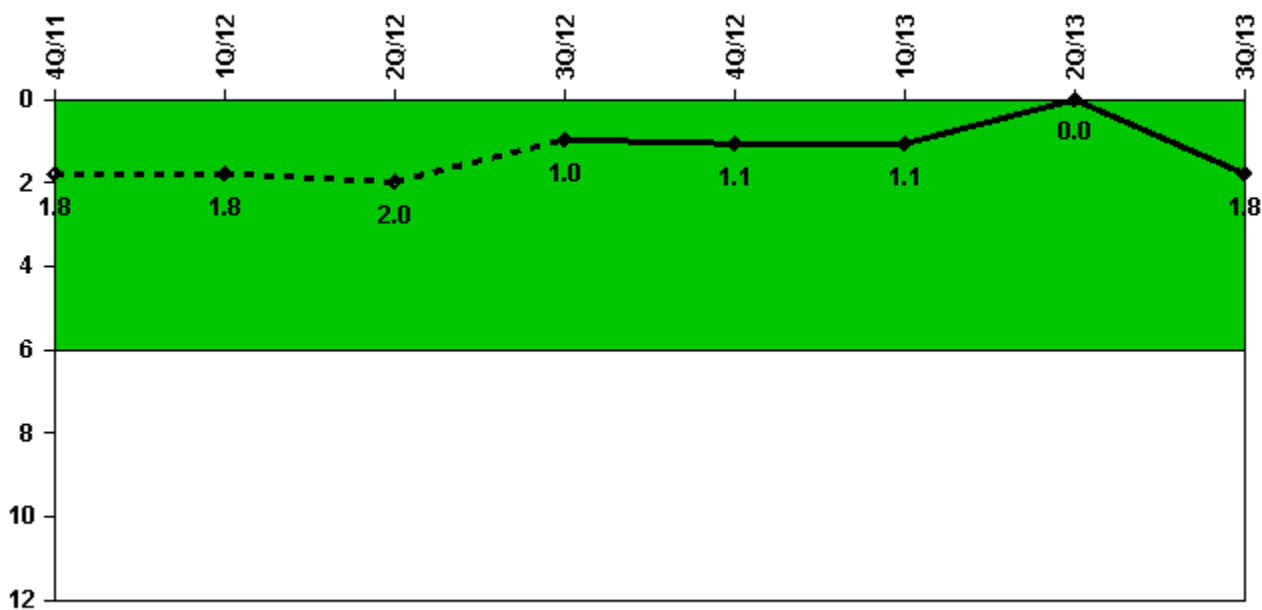


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Unplanned power changes	0	0	1.0	0	0	0	0	2.0
Critical hours	2209.0	2165.2	353.0	2208.0	1792.2	2159.0	1491.3	2208.0
Indicator value	1.8	1.8	2.0	1.0	1.1	1.1	0	1.8

Licensee Comments: none

Unplanned Scrams with Complications

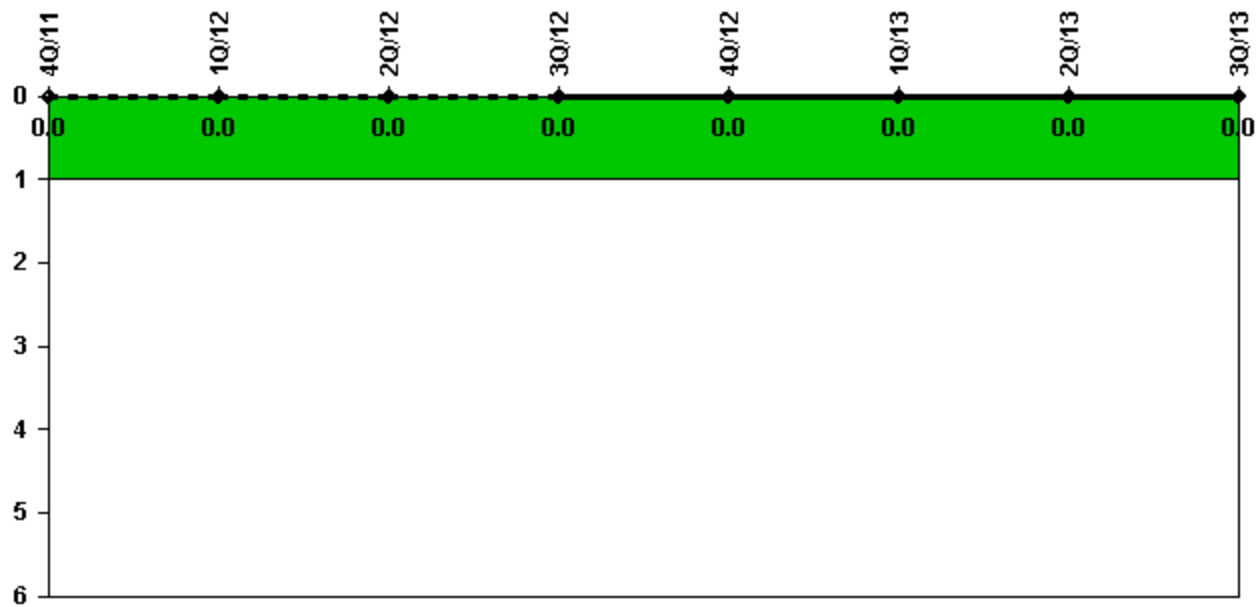


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

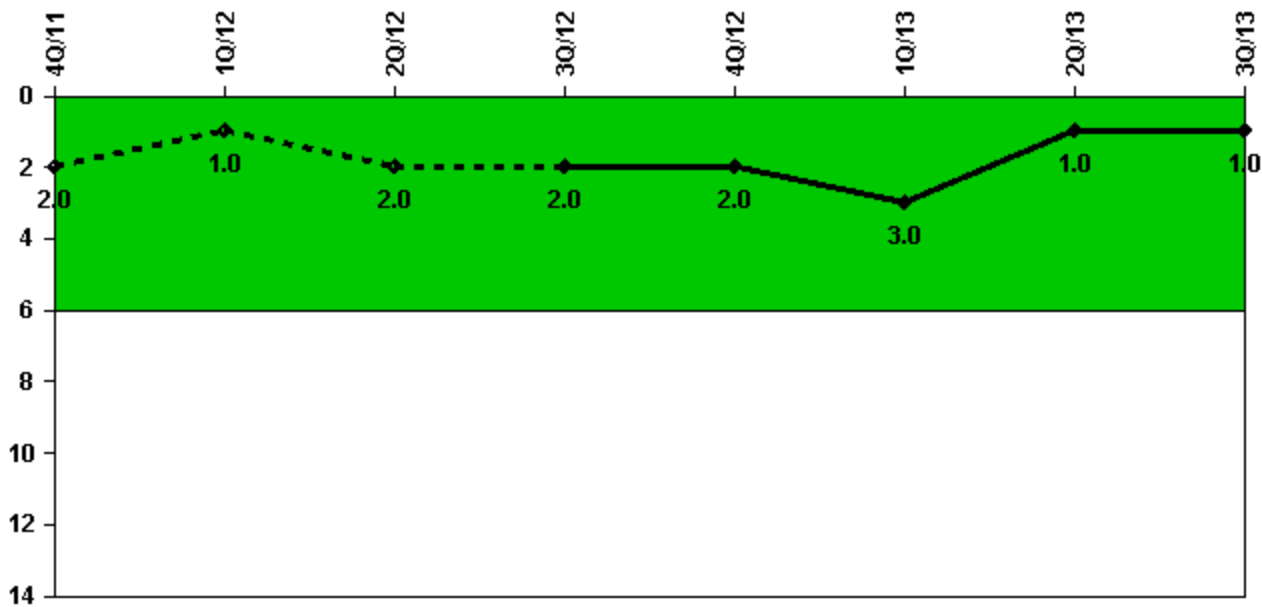

Thresholds: White > 6.0

Notes


Safety System Functional Failures (BWR)	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Safety System Functional Failures	0	0	2	0	0	1	0	0
Indicator value	2	1	2	2	2	3	1	1

Licensee Comments:

1Q/13: LER 387/2012-010-00:Both Trains of Control Structure HVAC at Susquehanna Were Rendered Inoperable, submitted on February 12, 2013

2Q/12: LER 387/2012-001-00, Both Control Structure Chillers Inoperable, was submitted on May 23, 2012. LER 387/2012-002-00, "B" Control Structure Chiller Inoperable Concurrent with "A" Emergency Diesel Generator Out of Service, was submitted to the NRC on June 4, 2012.

Mitigating Systems Performance Index, Emergency AC Power System

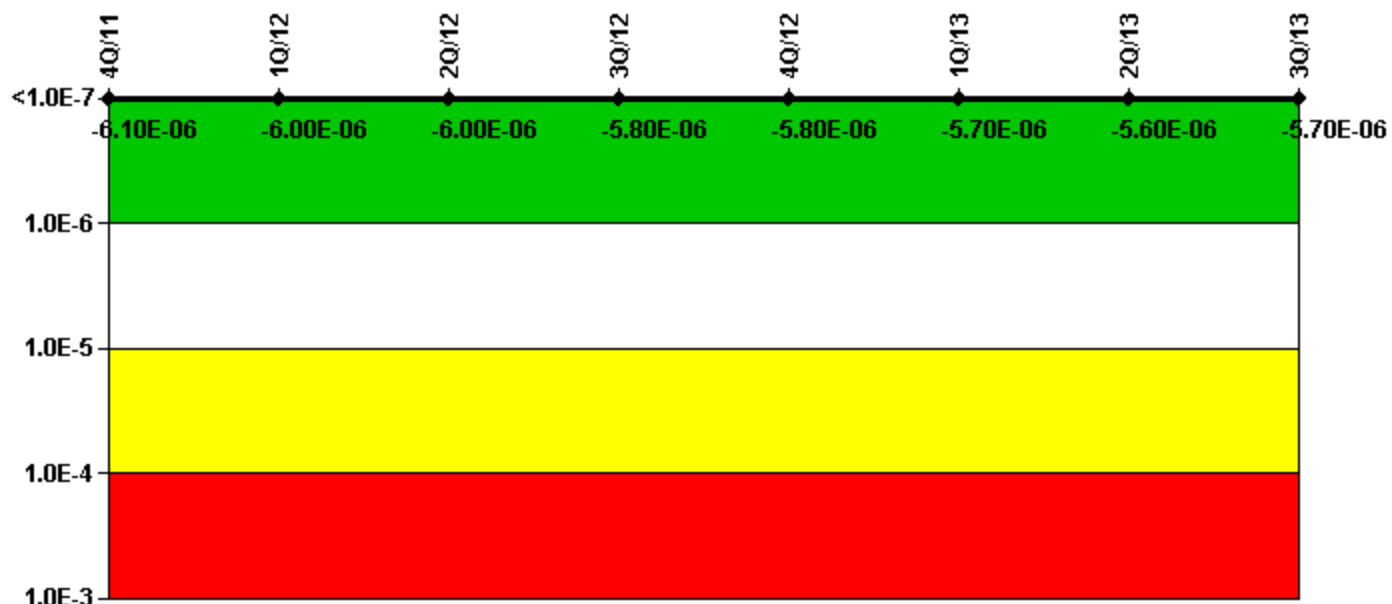

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
UAI (Δ CDF)	1.92E-07	1.92E-07	2.13E-07	2.04E-07	2.07E-07	2.14E-07	2.16E-07	2.13E-07
URI (Δ CDF)	-6.25E-06	-6.24E-06	-6.18E-06	-6.03E-06	-5.96E-06	-5.87E-06	-5.83E-06	-5.88E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.10E-06	-6.00E-06	-6.00E-06	-5.80E-06	-5.80E-06	-5.70E-06	-5.60E-06	-5.70E-06

Licensee Comments:

3Q/13: Risk Cap Invoked.

2Q/13: Risk Cap Invoked.

1Q/13: Risk Cap Invoked.

4Q/12: Risk Cap Invoked.

4Q/12: Risk Cap Invoked.


3Q/12: Risk Cap Invoked.

2Q/12: Risk Cap Invoked.

1Q/12: Risk Cap Invoked.

4Q/11: Risk Cap Invoked. The 3Q2011 Emergency AC Power System data is revised to include additional unavailable hours for the "C" diesel generator in September 2011. There is no safety significance associated with this change. The PI color was green before the data revision and it remains green after the change.

Mitigating Systems Performance Index, High Pressure Injection System

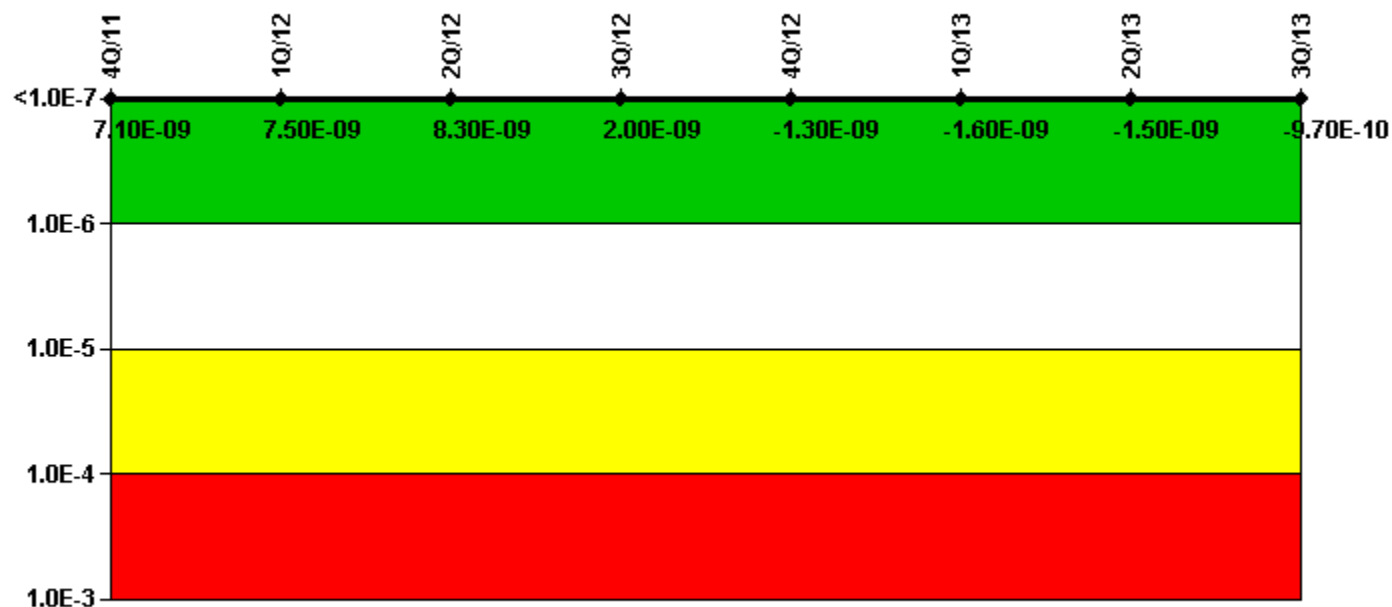

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
UAI (Δ CDF)	1.40E-08	1.42E-08	1.50E-08	8.70E-09	5.38E-09	5.07E-09	5.14E-09	4.97E-09
URI (Δ CDF)	-6.89E-09	-6.67E-09	-6.71E-09	-6.71E-09	-6.71E-09	-6.65E-09	-6.65E-09	-5.94E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.10E-09	7.50E-09	8.30E-09	2.00E-09	-1.30E-09	-1.60E-09	-1.50E-09	-9.70E-10

Licensee Comments:

4Q/11: The 3Q2010 data is revised due to a data entry error for ESF Non-Test demands. There is no safety significance associated with this change. The PI color was green before the data revision and it remains green after the change

Mitigating Systems Performance Index, Heat Removal System

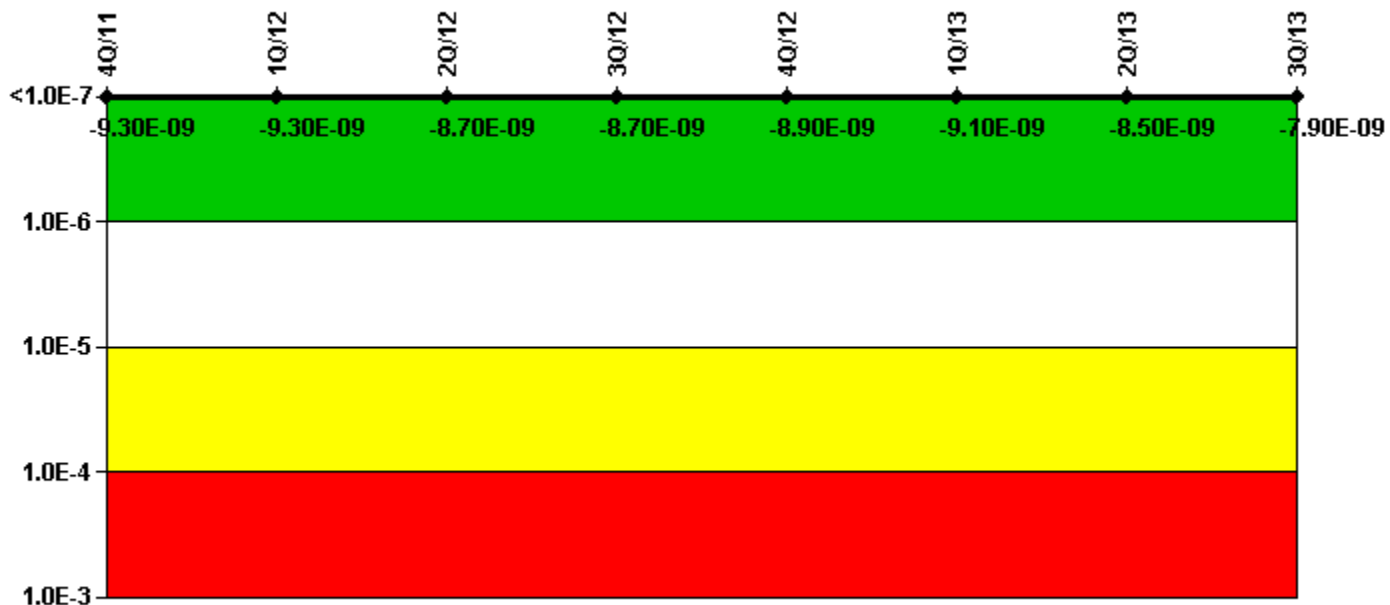


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
UAI (Δ CDF)	-8.88E-10	-8.89E-10	-2.68E-10	-2.62E-10	-5.55E-10	-6.68E-10	-6.41E-10	-7.05E-10
URI (Δ CDF)	-8.39E-09	-8.39E-09	-8.39E-09	-8.39E-09	-8.39E-09	-8.39E-09	-7.84E-09	-7.15E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.30E-09	-9.30E-09	-8.70E-09	-8.70E-09	-8.90E-09	-9.10E-09	-8.50E-09	-7.90E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

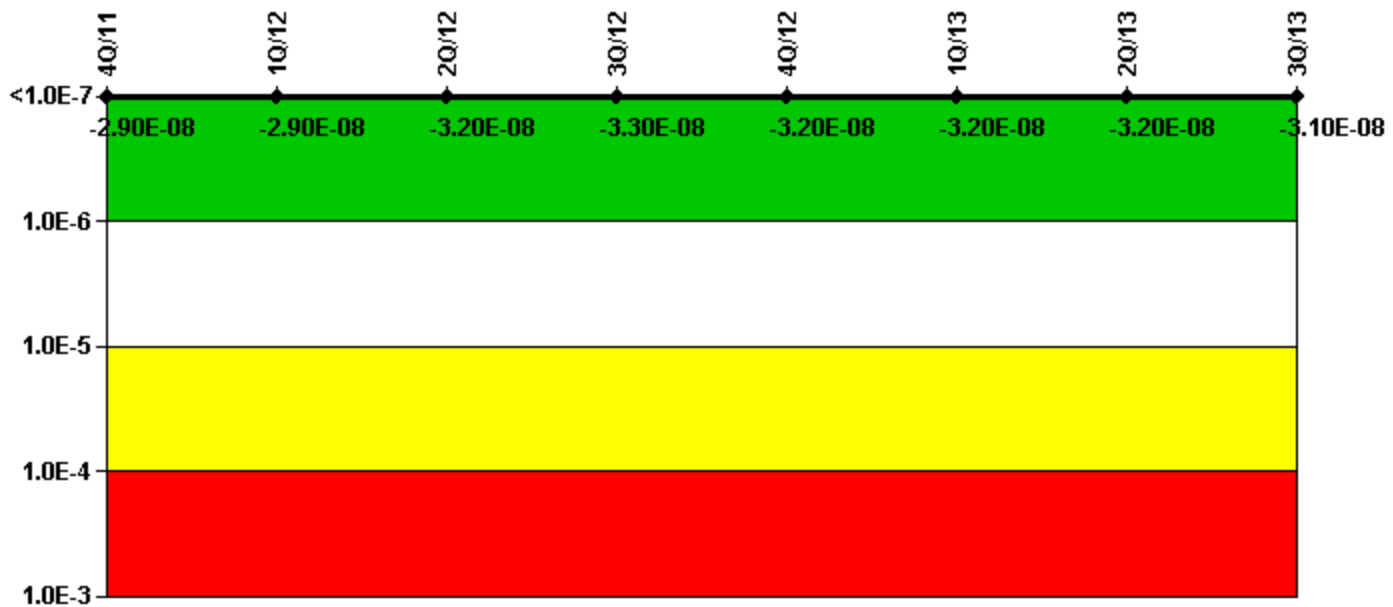


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
UAI (Δ CDF)	1.85E-09	1.85E-09	2.25E-09	1.38E-09	2.40E-09	1.58E-09	1.62E-09	1.53E-09
URI (Δ CDF)	-3.07E-08	-3.13E-08	-3.40E-08	-3.40E-08	-3.43E-08	-3.34E-08	-3.35E-08	-3.27E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.90E-08	-2.90E-08	-3.20E-08	-3.30E-08	-3.20E-08	-3.20E-08	-3.20E-08	-3.10E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

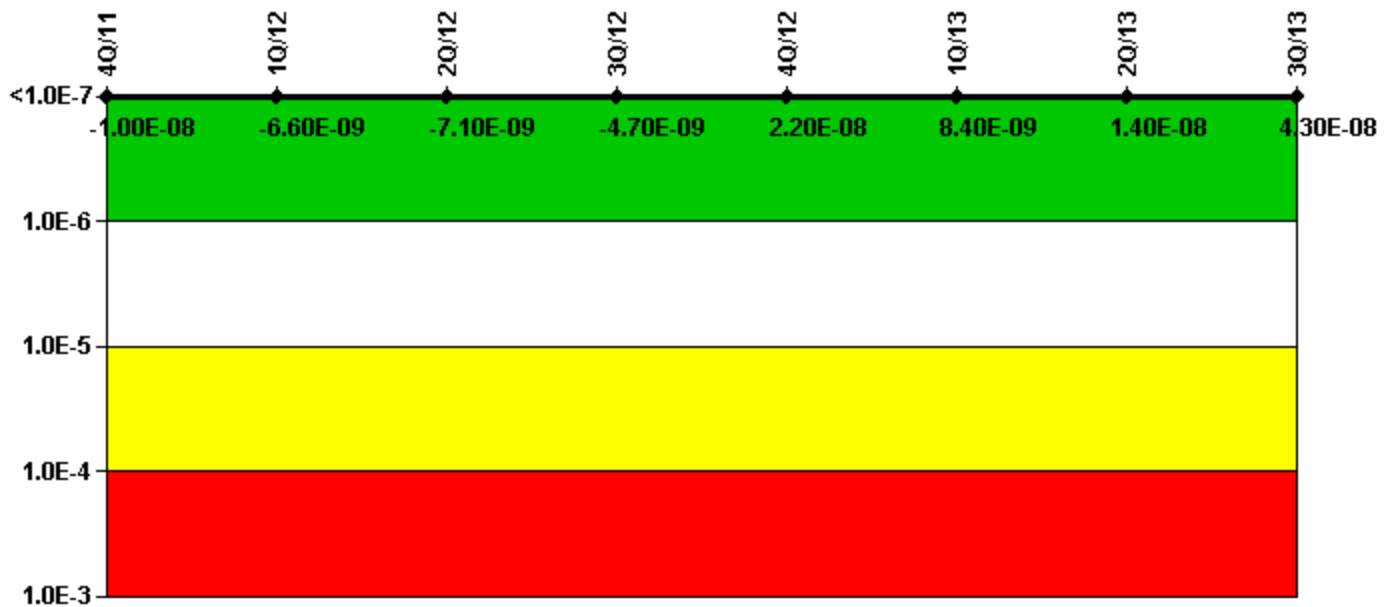

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
UAI (Δ CDF)	2.25E-08	2.64E-08	2.68E-08	2.94E-08	5.67E-08	4.30E-08	4.84E-08	7.77E-08
URI (Δ CDF)	-3.30E-08	-3.30E-08	-3.38E-08	-3.42E-08	-3.47E-08	-3.46E-08	-3.48E-08	-3.50E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.00E-08	-6.60E-09	-7.10E-09	-4.70E-09	2.20E-08	8.40E-09	1.40E-08	4.30E-08

Licensee Comments:

4Q/11: Previously reported data for 3Q2009, 2Q2010, and 3Q2010 is revised for operational non-test strokes of valves HV01224A1 and HV01224B1. This change provides more conservative values for the stroke count. There is no safety significance associated with this change. The PI color was green before the data revision and it remains green after the change.

Reactor Coolant System Activity

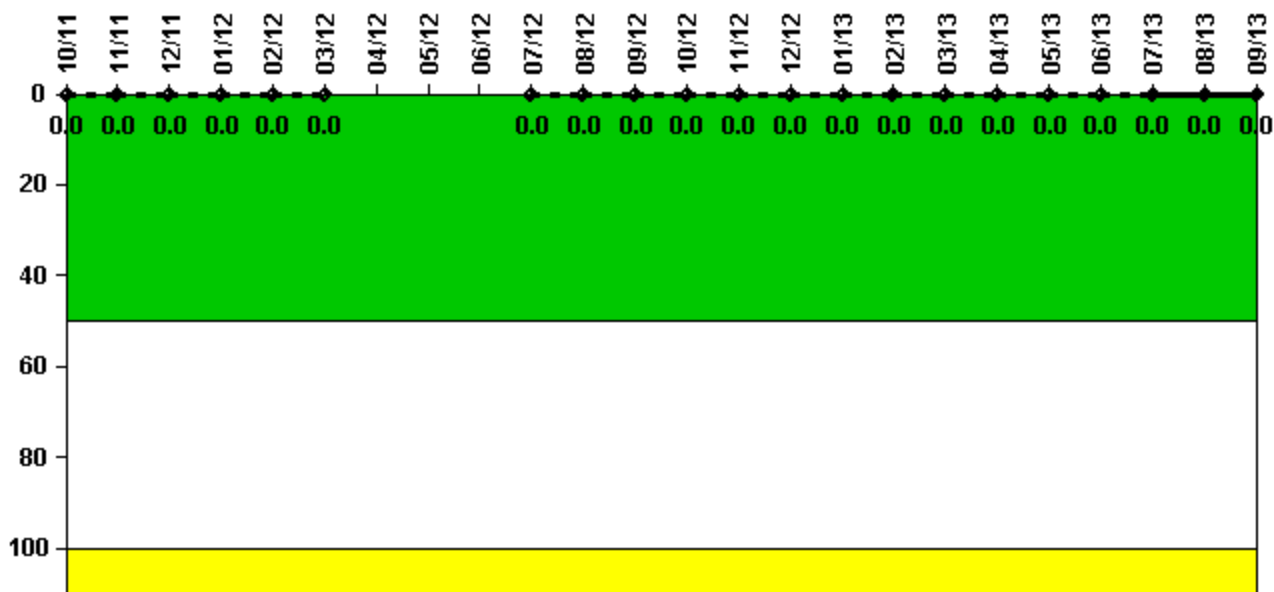

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12
Maximum activity	0.000007	0.000007	0.000007	0.000008	0.000008	0.000007	N/A	N/A	N/A	0.000003	0.000005	0.000006
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	N/A	N/A	N/A	0	0	0

Reactor Coolant System Activity	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13
Maximum activity	0.000005	0.000006	0.000007	0.000006	0.000007	0.000007	0.000007	0.000007	0.000007	0.000007	0.000007	0.000008
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

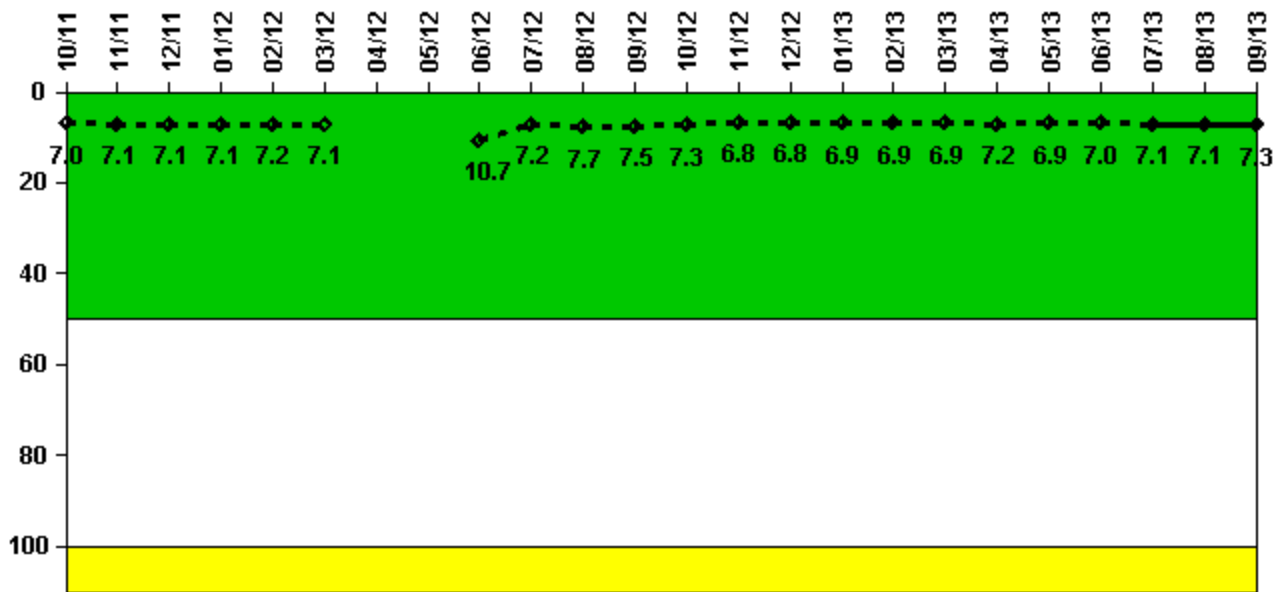

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12
Maximum leakage	1.760	1.770	1.770	1.770	1.790	1.780	N/A	N/A	2.680	1.800	1.920	1.880
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.0	7.1	7.1	7.1	7.2	7.1	N/A	N/A	10.7	7.2	7.7	7.5


Reactor Coolant System Leakage	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13
Maximum leakage	1.830	1.710	1.710	1.730	1.720	1.720	1.810	1.720	1.740	1.770	1.770	1.820
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.3	6.8	6.8	6.9	6.9	6.9	7.2	6.9	7.0	7.1	7.1	7.3

Licensee Comments:

6/13: Previously reported data for Reactor Coolant System Leakage for the months of July 2012, October 2012, December 2012, and February 2013 is revised due to data entry errors. There is no safety significance associated with these changes. The PI color was green before the data revision and it remains green after the changes.

12/11: Previously reported data for Reactor Coolant System Leakage for the period from 1Q2010 through 2Q2011 is revised to provide the correct value for maximum monthly identified leakage. There is no safety significance associated with this change. The PI color was green before the data revision and it remains green after the change.

Drill/Exercise Performance

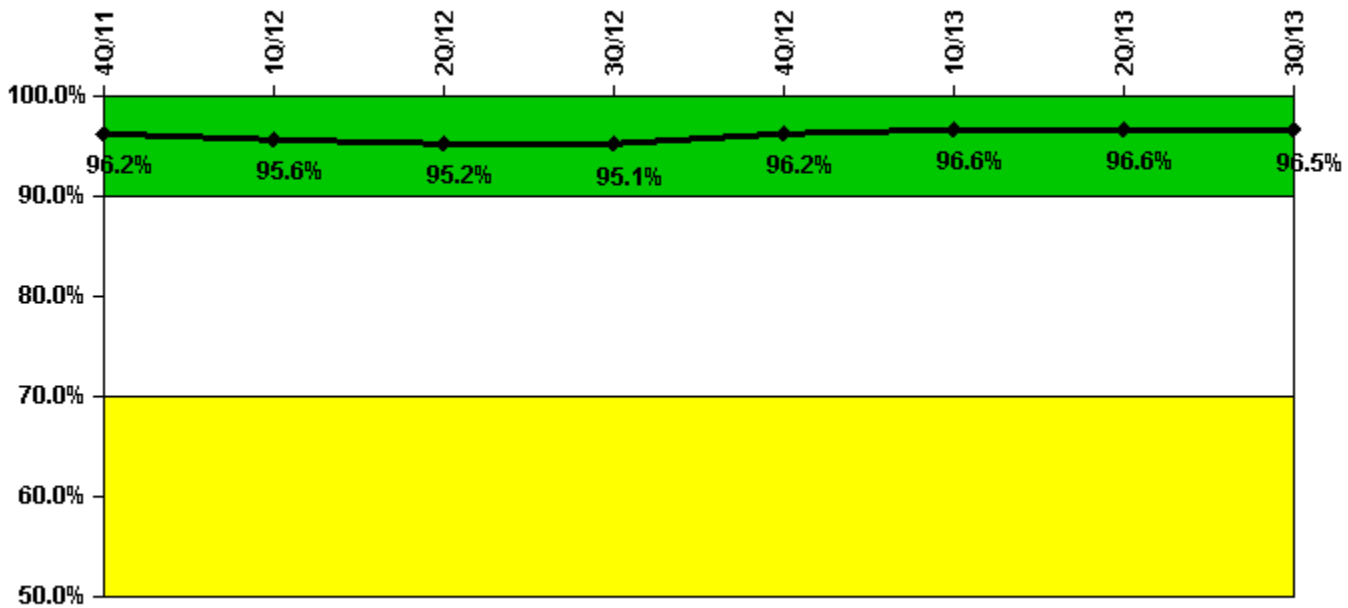


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Successful opportunities	10.0	23.0	12.0	32.0	7.0	18.0	18.0	19.0
Total opportunities	10.0	25.0	12.0	33.0	8.0	18.0	18.0	20.0
Indicator value	96.2%	95.6%	95.2%	95.1%	96.2%	96.6%	96.6%	96.5%

Licensee Comments: none

ERO Drill Participation

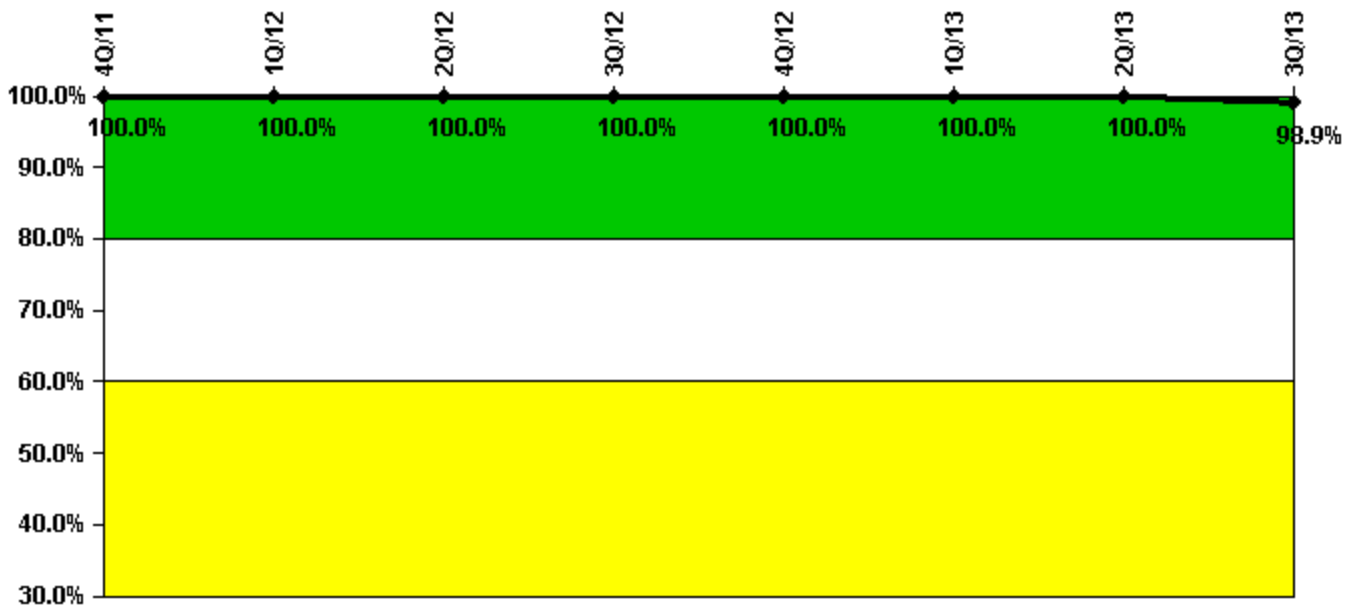


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Participating Key personnel	71.0	75.0	75.0	74.0	77.0	80.0	82.0	86.0
Total Key personnel	71.0	75.0	75.0	74.0	77.0	80.0	82.0	87.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	98.9%

Licensee Comments: none

Alert & Notification System

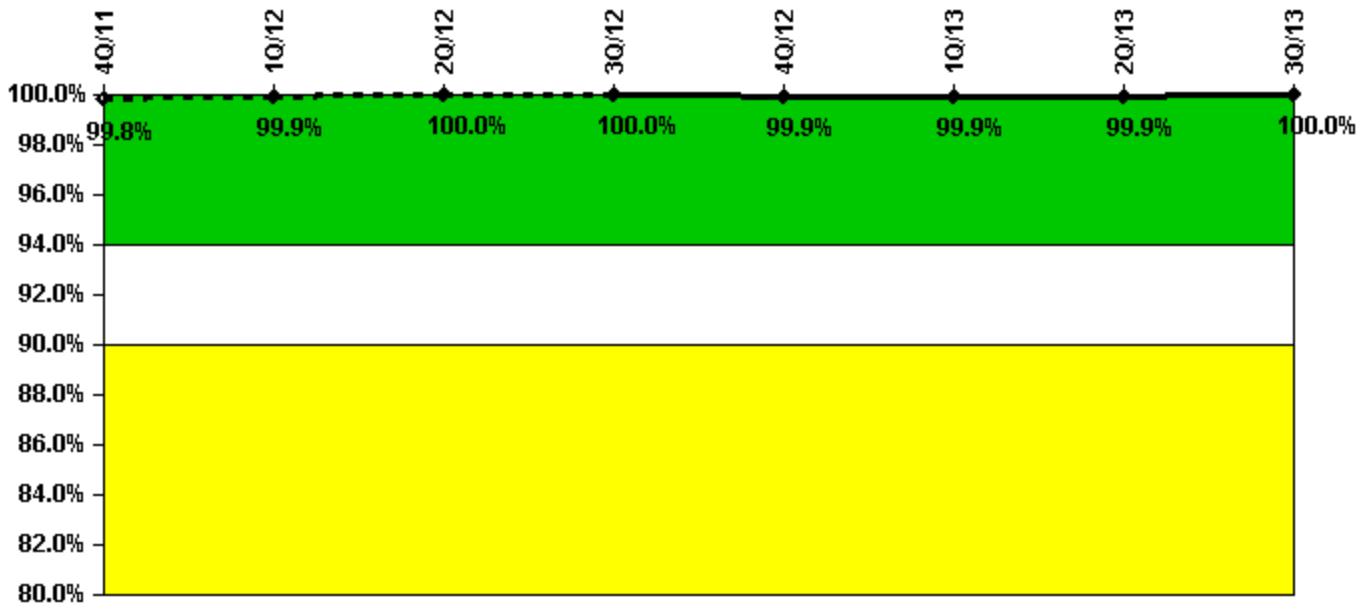


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
Successful siren-tests	608	608	532	607	531	608	532	608
Total sirens-tests	608	608	532	608	532	608	532	608
Indicator value	99.8%	99.9%	100.0%	100.0%	99.9%	99.9%	99.9%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

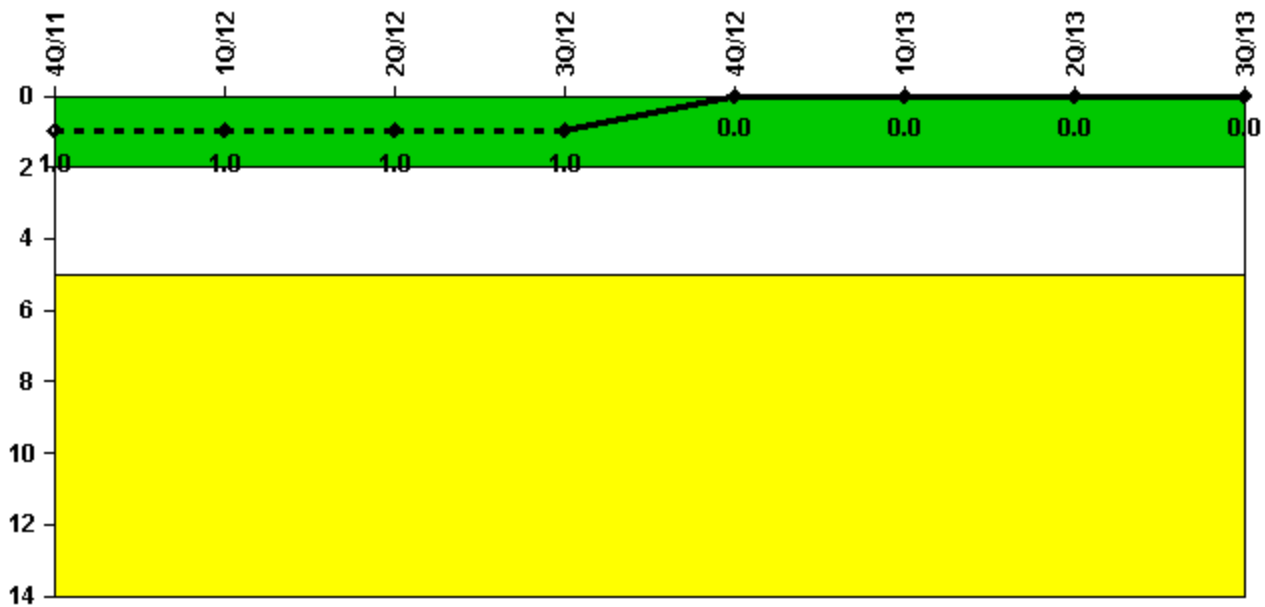


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
High radiation area occurrences	1	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	1	1	1	1	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

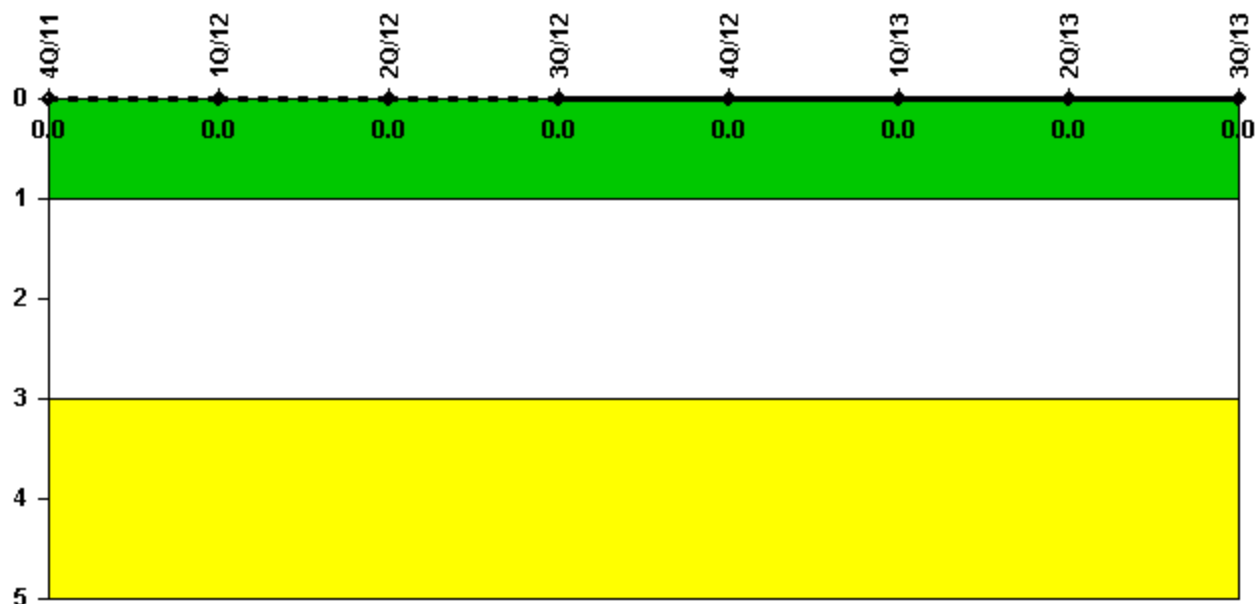

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: October 22, 2013