


Clinton

4Q/2013 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

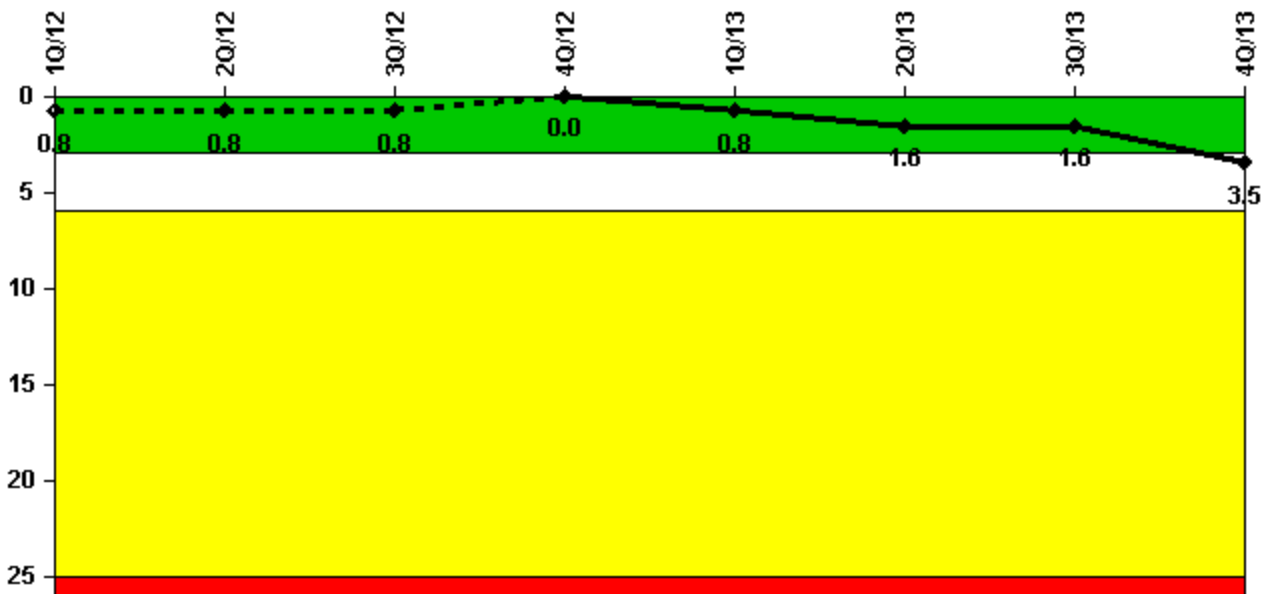

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Unplanned scrams	0	0	0	0	1.0	1.0	0	2.0
Critical hours	2183.0	2184.0	2208.0	2209.0	2112.0	2161.5	2208.0	1565.5
Indicator value	0.8	0.8	0.8	0	0.8	1.6	1.6	3.5

Licensee Comments:

4Q/13: Station experienced 2 unplanned scrams in December 2013. These combined with unplanned scrams in March and April 2013 results in this indicator being rated white.

Unplanned Power Changes per 7000 Critical Hrs

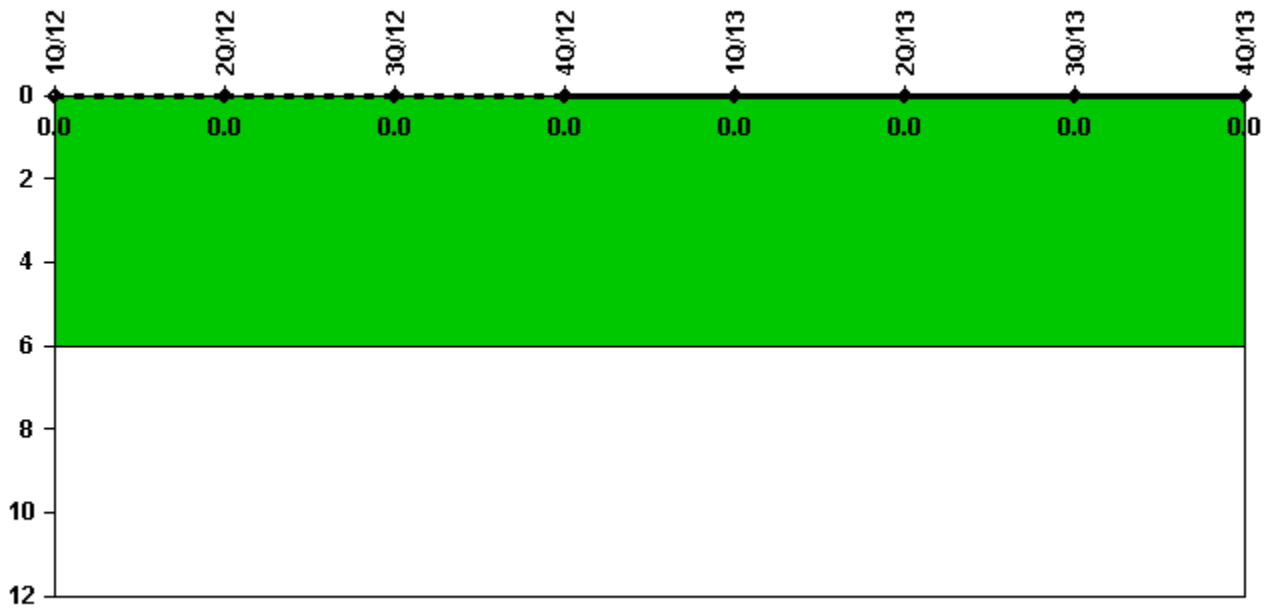


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2183.0	2184.0	2208.0	2209.0	2112.0	2161.5	2208.0	1565.5
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

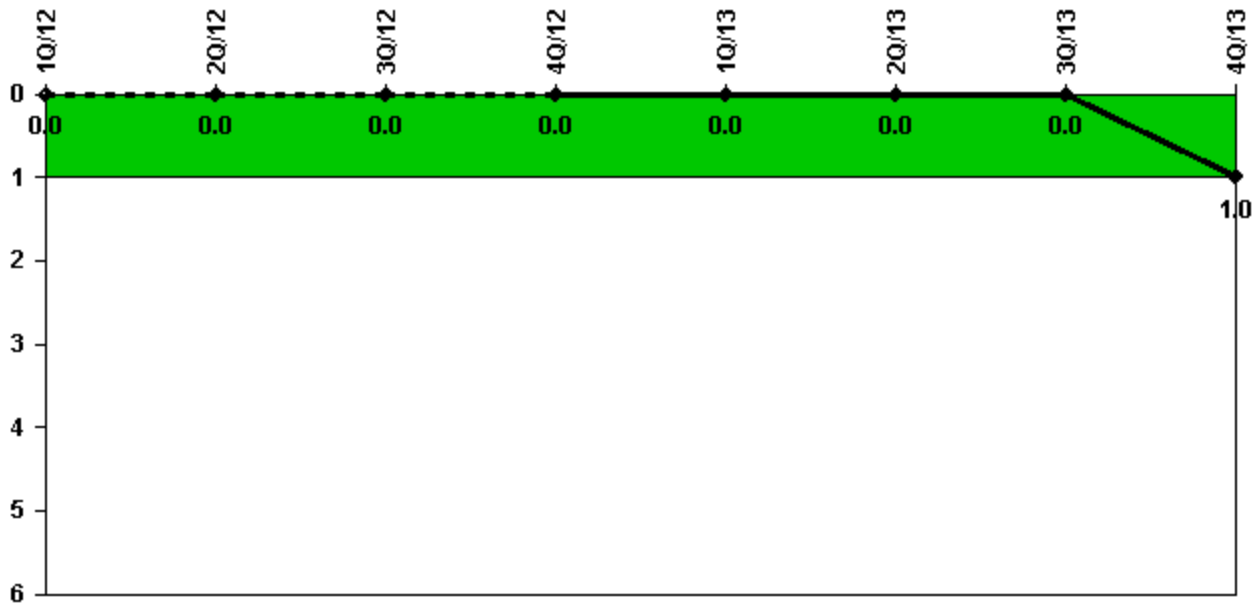


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Scrams with complications	0	0	0	0	0	0	0	1.0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0

Licensee Comments: none

Safety System Functional Failures (BWR)

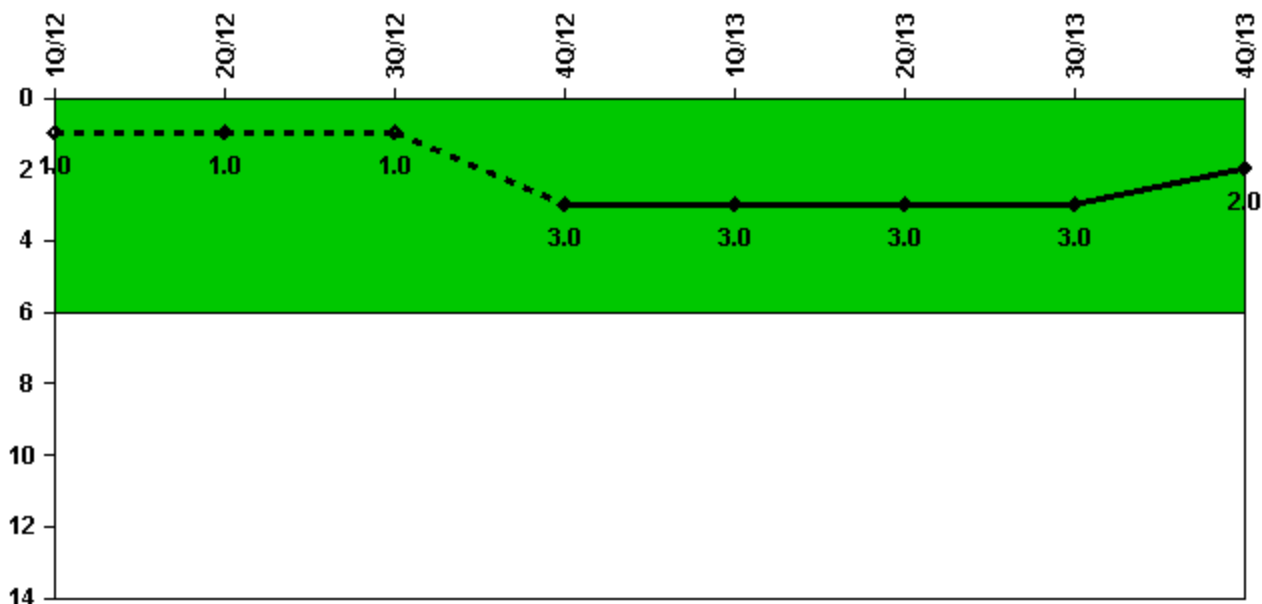

Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Safety System Functional Failures	1	0	0	2	1	0	0	1
Indicator value	1	1	1	3	3	3	3	2

Licensee Comments:

4Q/13: Safety System Functional Failure reported to NRC under LER 2013-004-00, issued 10/11/13.

2Q/13: Safety System Functional Failure reported to NRC under LER 2013-001-00 issued on 4/17/13


2Q/13: A loss of safety function reported to NRC under LER 2013-001-00 issued on 4/17/13 was counted as a second quarter 2013 safety system functional failure (SSFF) performance indicator occurrence. An engineering evaluation has concluded that this event was not a SSFF, therefore the second quarter 2013 data has been changed from 1 to 0. This change does not affect the indicator color of green.

1Q/13: Safety System Functional Failure reported to NRC under LER 2012-003-00 issued on 1/17/13

4Q/12: Safety System Functional Failures reported to NRC: LER 2012-001-00 issued on 10/26/12; LER 2012-002-00 issued on 11/27/12

1Q/12: Safety System Functional Failure reported to NRC 2/6/2012 under LER 2011-008-00

Mitigating Systems Performance Index, Emergency AC Power System

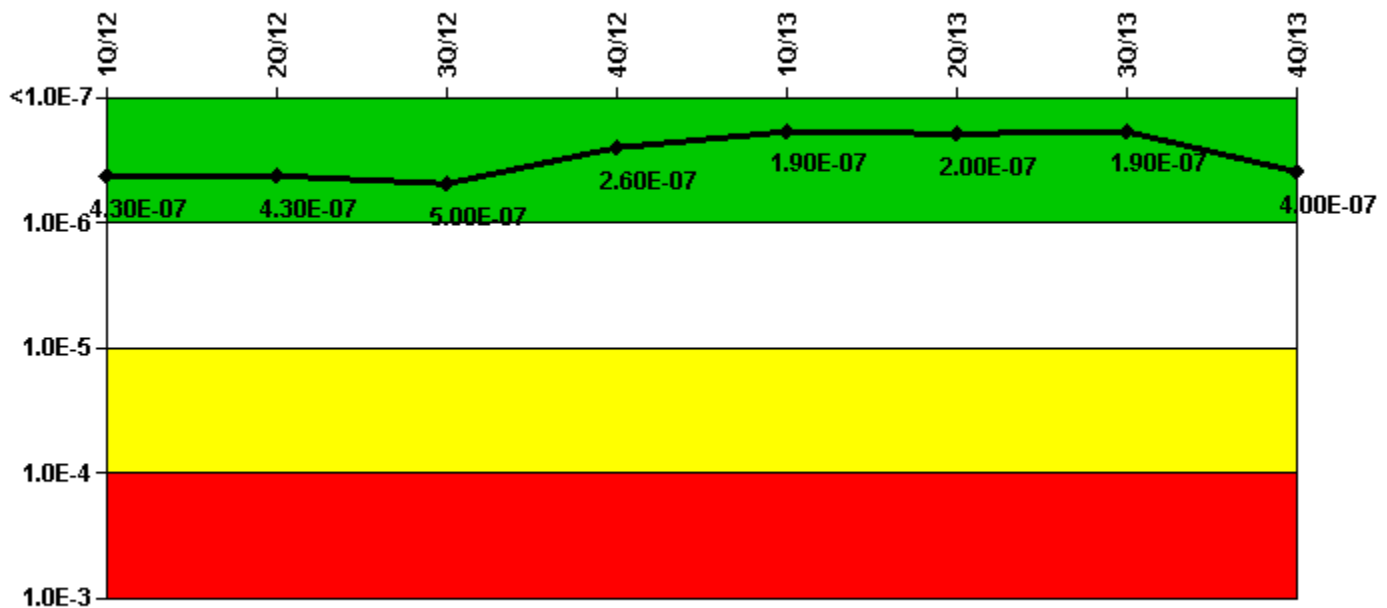

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI (ΔCDF)	-5.52E-09	-6.09E-09	5.52E-08	5.95E-08	-9.39E-09	-4.20E-09	-1.82E-08	-1.11E-08
URI (ΔCDF)	4.36E-07	4.38E-07	4.41E-07	1.97E-07	2.00E-07	2.05E-07	2.09E-07	4.15E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.30E-07	4.30E-07	5.00E-07	2.60E-07	1.90E-07	2.00E-07	1.90E-07	4.00E-07

Licensee Comments:


2Q/13: Updated PRA values from 2 significant digits to 3 significant digits, Site specific Basis Document Rev 9

1Q/13: Division 1 Emergency Diesel Generator baseline Planned Unavailability hours updated for 12-year scheduled maintenance outage

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s). Clinton first quarter 2012 MSPI values changed as a result of PRA model revision CL011A and associated revision of the Clinton Site Basis Document.

Mitigating Systems Performance Index, High Pressure Injection System

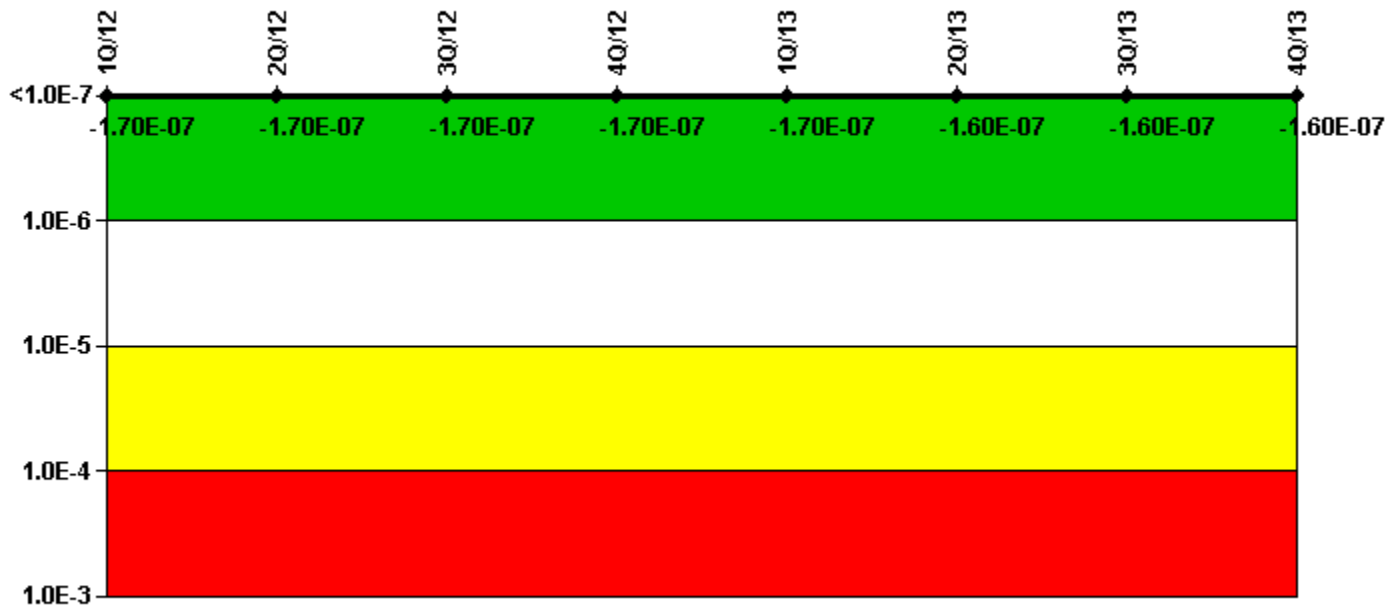

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI (Δ CDF)	-3.91E-08	-3.91E-08	-3.91E-08	-3.91E-08	-3.91E-08	-3.88E-08	-3.88E-08	-3.88E-08
URI (Δ CDF)	-1.33E-07	-1.31E-07	-1.30E-07	-1.28E-07	-1.26E-07	-1.24E-07	-1.22E-07	-1.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.70E-07	-1.70E-07	-1.70E-07	-1.70E-07	-1.70E-07	-1.60E-07	-1.60E-07	-1.60E-07


Licensee Comments:

2Q/13: Updated PRA values from 2 significant digits to 3 significant digits, Site specific Basis Document Rev 9

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s). Clinton first quarter 2012 MSPI values changed as a result of PRA model revision CL011A and associated revision of the Clinton Site Basis Document.

Mitigating Systems Performance Index, Heat Removal System

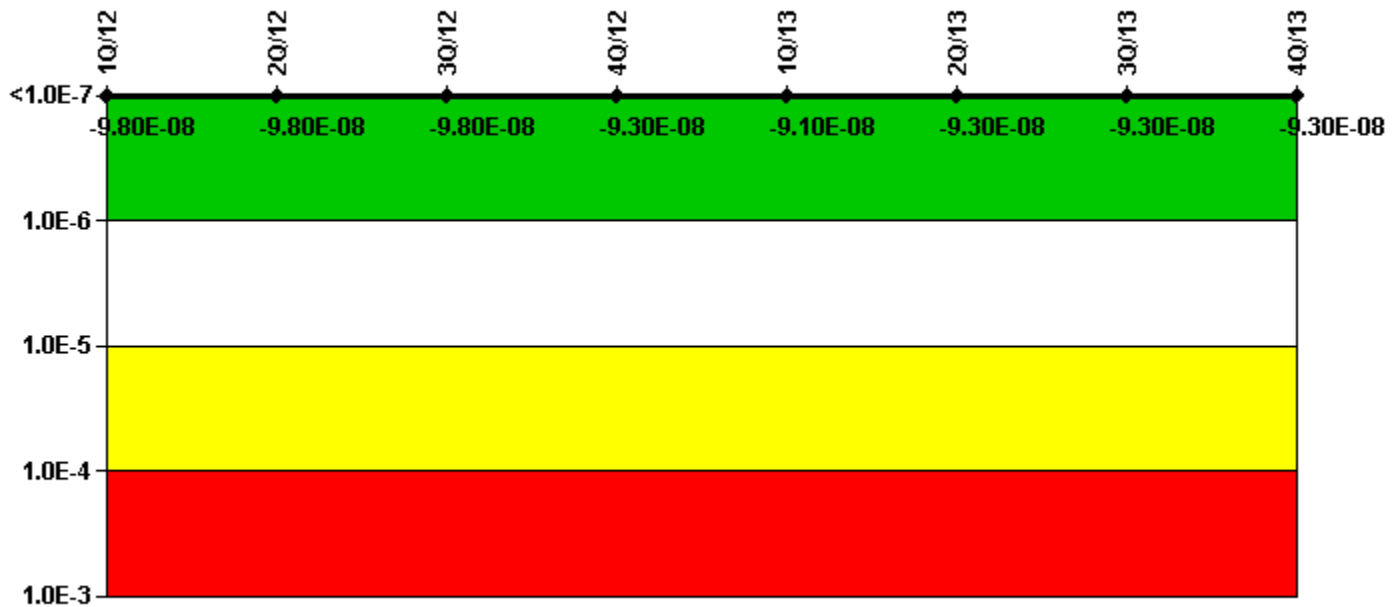

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI (Δ CDF)	-3.02E-08	-3.02E-08	-3.02E-08	-2.50E-08	-2.51E-08	-2.55E-08	-2.55E-08	-2.54E-08
URI (Δ CDF)	-6.78E-08	-6.78E-08	-6.78E-08	-6.78E-08	-6.54E-08	-6.74E-08	-6.74E-08	-6.74E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.80E-08	-9.80E-08	-9.80E-08	-9.30E-08	-9.10E-08	-9.30E-08	-9.30E-08	-9.30E-08


Licensee Comments:

2Q/13: Updated PRA values from 2 significant digits to 3 significant digits, Site specific Basis Document Rev 9. Removed MSPI monitored component 1E51F046 from the MSPI program. This component was permanently deactivated by the station. Site specific Basis Document Rev 9 and PRA model CL-MSPI-02 rev 0.

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s). Clinton first quarter 2012 MSPI values changed as a result of PRA model revision CL011A and associated revision of the Clinton Site Basis Document.

Mitigating Systems Performance Index, Residual Heat Removal System

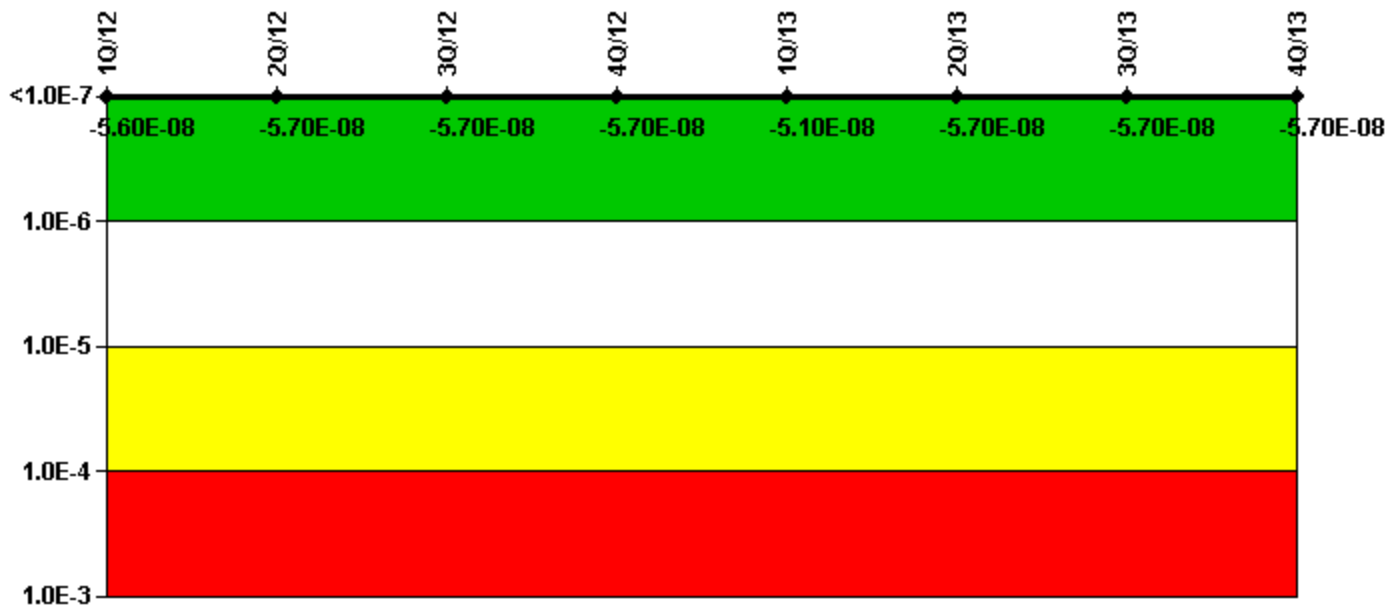

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI (Δ CDF)	-1.54E-08	-1.65E-08	-1.65E-08	-1.66E-08	-1.03E-08	-1.69E-08	-1.67E-08	-1.68E-08
URI (Δ CDF)	-4.08E-08	-4.08E-08	-4.08E-08	-4.08E-08	-4.08E-08	-4.04E-08	-4.04E-08	-4.04E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.60E-08	-5.70E-08	-5.70E-08	-5.70E-08	-5.10E-08	-5.70E-08	-5.70E-08	-5.70E-08


Licensee Comments:

2Q/13: Updated PRA values from 2 significant digits to 3 significant digits, Site specific Basis Document Rev 9

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s). Clinton first quarter 2012 MSPI values changed as a result of PRA model revision CL011A and associated revision of the Clinton Site Basis Document.

Mitigating Systems Performance Index, Cooling Water Systems

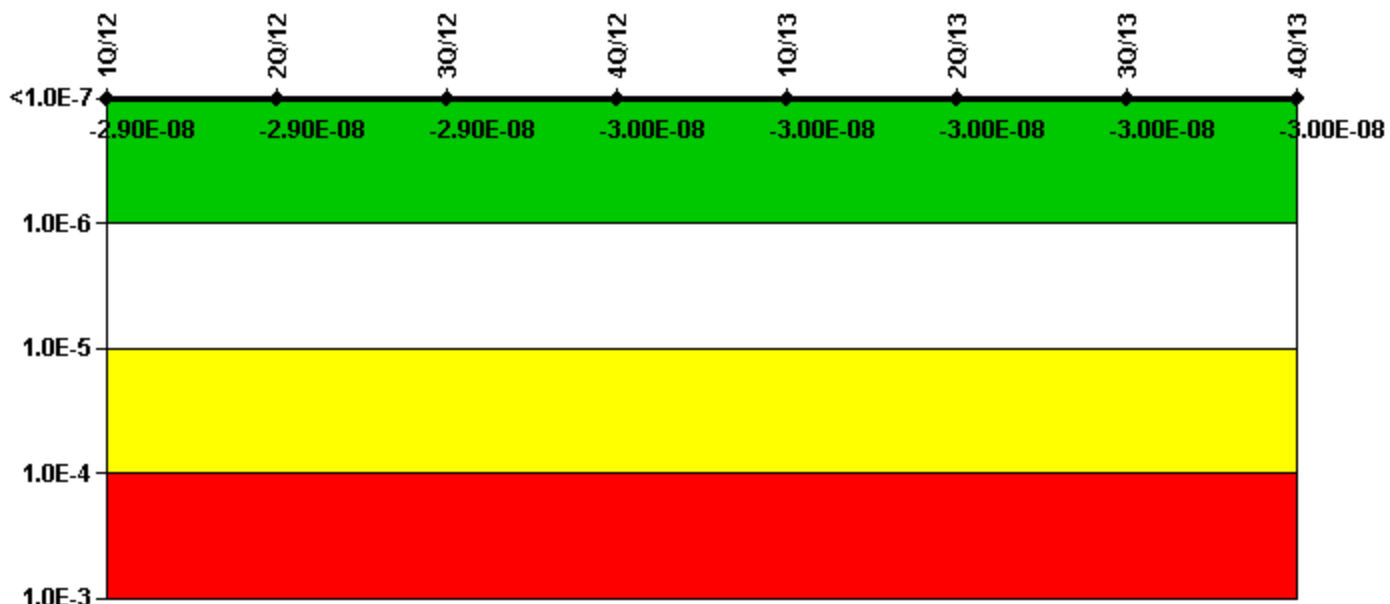

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI (Δ CDF)	7.38E-10	7.38E-10	7.37E-10	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
URI (Δ CDF)	-2.96E-08	-2.96E-08	-2.96E-08	-2.96E-08	-2.96E-08	-2.99E-08	-2.99E-08	-2.99E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.90E-08	-2.90E-08	-2.90E-08	-3.00E-08	-3.00E-08	-3.00E-08	-3.00E-08	-3.00E-08


Licensee Comments:

2Q/13: Updated PRA values from 2 significant digits to 3 significant digits, Site specific Basis Document Rev 9

2Q/12: Changed PRA Parameter(s).

1Q/12: Changed PRA Parameter(s). Clinton first quarter 2012 MSPI values changed as a result of PRA model revision CL011A and associated revision of the Clinton Site Basis Document.

Reactor Coolant System Activity

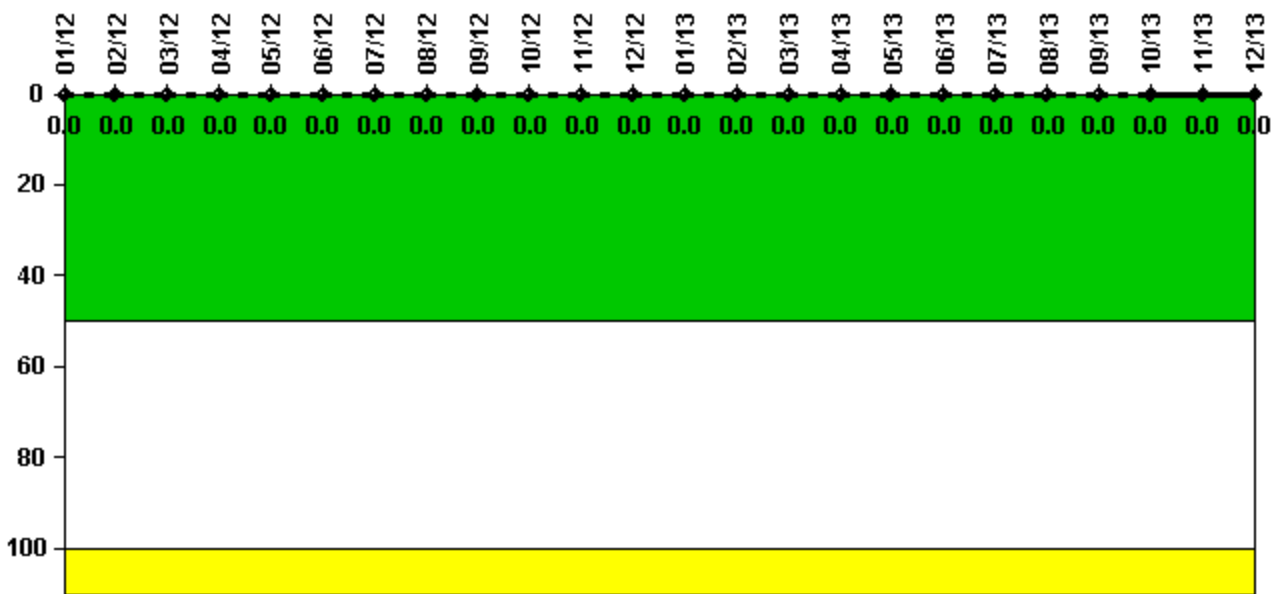


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum activity	0.000001	0.000001	0.000001	0.000002	0.000001	0.000001	0.000001	0.000001	0.000001	0.000001	0.000002	0.000002
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13
Maximum activity	0.000002	0.000002	0.000002	0.000002	0.000002	0.000001	0.000001	0.000001	0.000002	0.000001	0.000001	0.000001
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

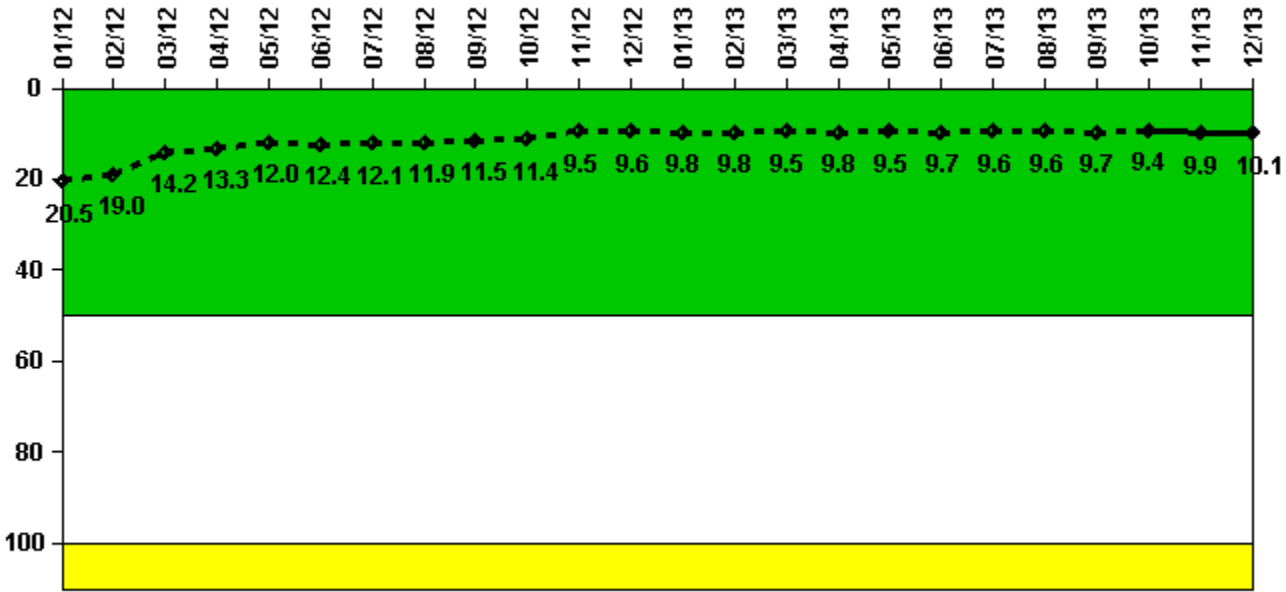


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum leakage	6.140	5.700	4.250	4.000	3.610	3.730	3.630	3.580	3.450	3.430	2.860	2.890
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	20.5	19.0	14.2	13.3	12.0	12.4	12.1	11.9	11.5	11.4	9.5	9.6
Reactor Coolant System Leakage	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13
Maximum leakage	2.940	2.940	2.860	2.930	2.840	2.910	2.870	2.870	2.920	2.830	2.960	3.040
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	9.8	9.8	9.5	9.8	9.5	9.7	9.6	9.6	9.7	9.4	9.9	10.1

Licensee Comments: none

Drill/Exercise Performance

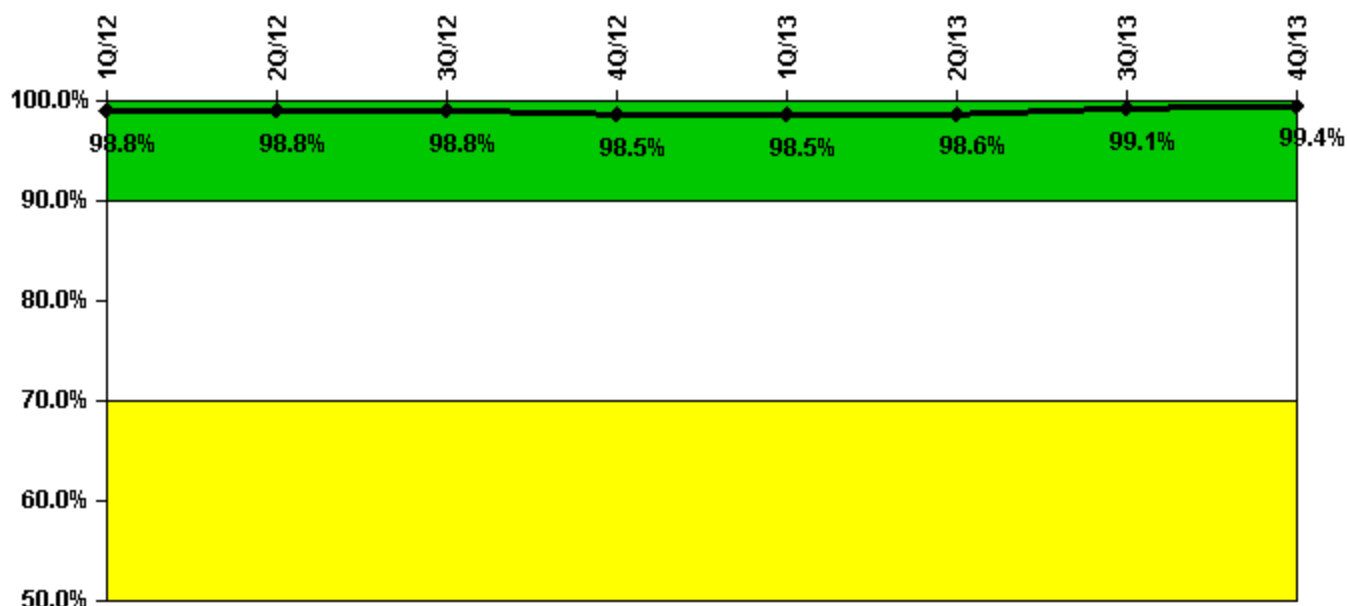


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Successful opportunities	33.0	35.0	59.0	51.0	31.0	48.0	31.0	20.0
Total opportunities	33.0	35.0	59.0	52.0	31.0	49.0	31.0	20.0
Indicator value	98.8%	98.8%	98.8%	98.5%	98.5%	98.6%	99.1%	99.4%

Licensee Comments: none

ERO Drill Participation

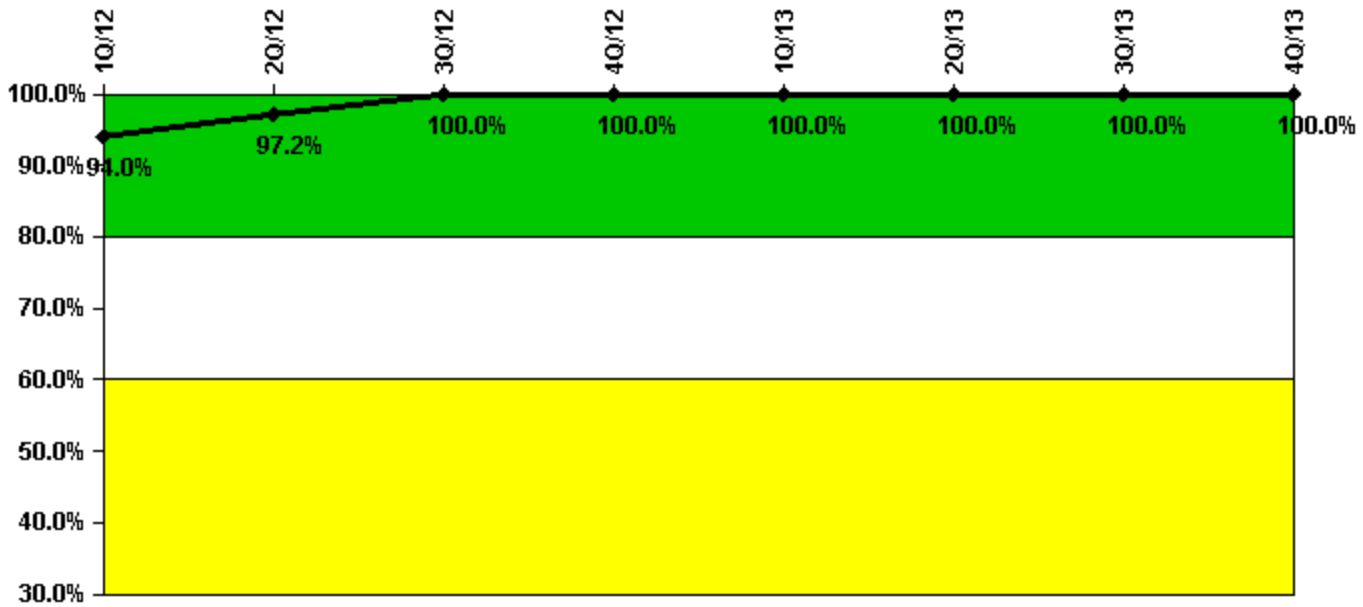


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Participating Key personnel	63.0	69.0	71.0	68.0	68.0	69.0	67.0	64.0
Total Key personnel	67.0	71.0	71.0	68.0	68.0	69.0	67.0	64.0
Indicator value	94.0%	97.2%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

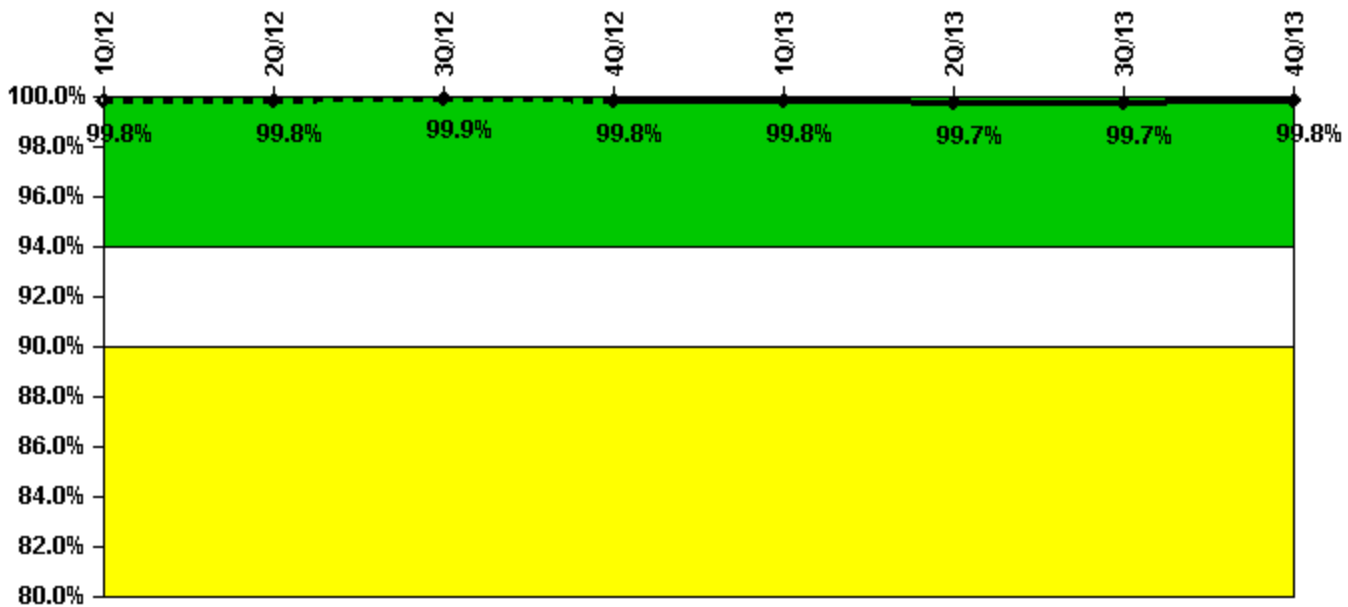


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Successful siren-tests	2595	2556	2517	2550	2556	2547	2558	2557
Total sirens-tests	2600	2560	2520	2560	2560	2560	2560	2560
Indicator value	99.8%	99.8%	99.9%	99.8%	99.8%	99.7%	99.7%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

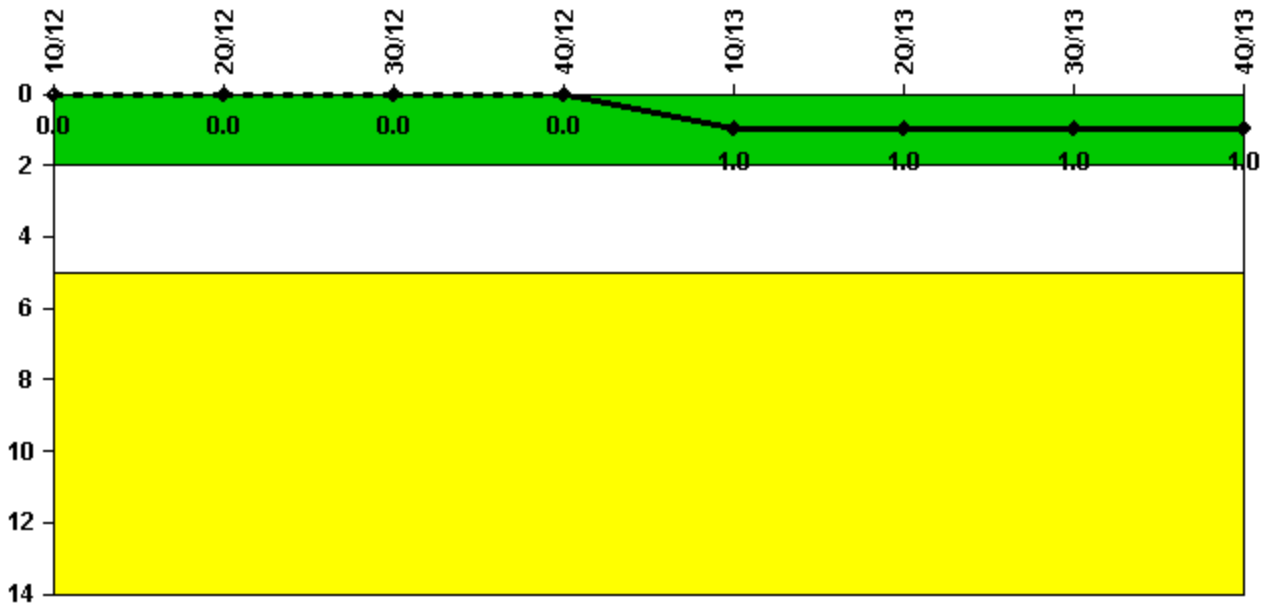

Thresholds: White > 2.0 Yellow > 5.0


Notes

Occupational Exposure Control Effectiveness	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
High radiation area occurrences	0	0	0	0	1	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	1	1	1	1

Licensee Comments:

1Q/13: The high radiation area occurrences performance indicator has been revised to add one occurrence for first quarter 2013. This change did not affect the indicator color of green.

RETS/ODCM Radiological Effluent

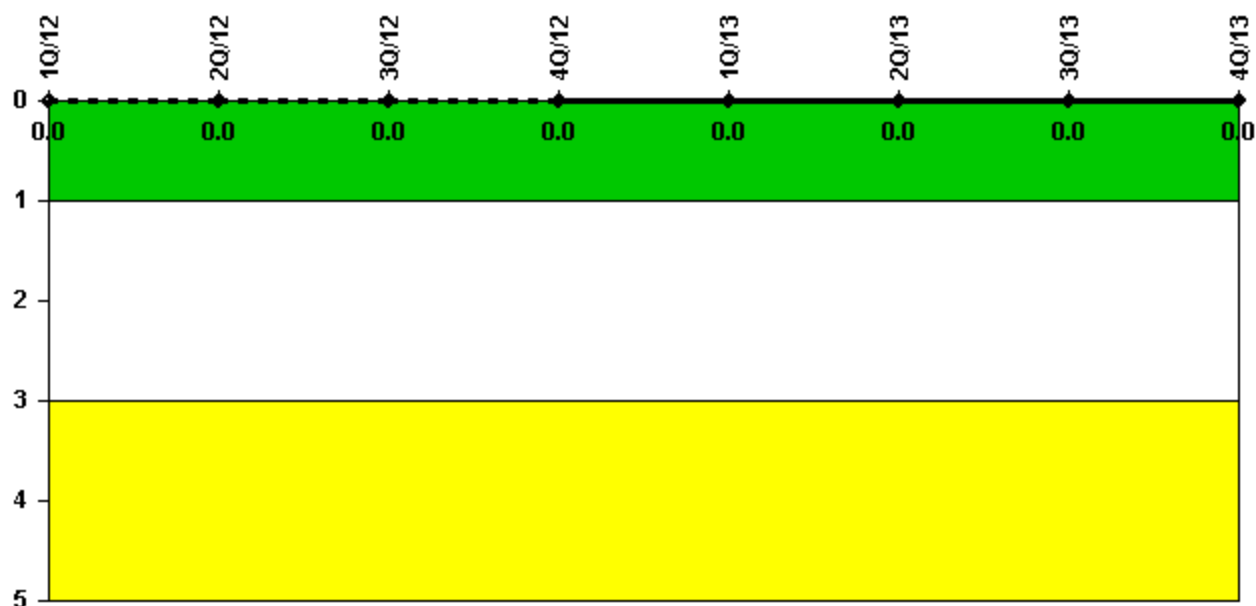

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: January 22, 2014