


## Dresden 3

### 4Q/2013 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

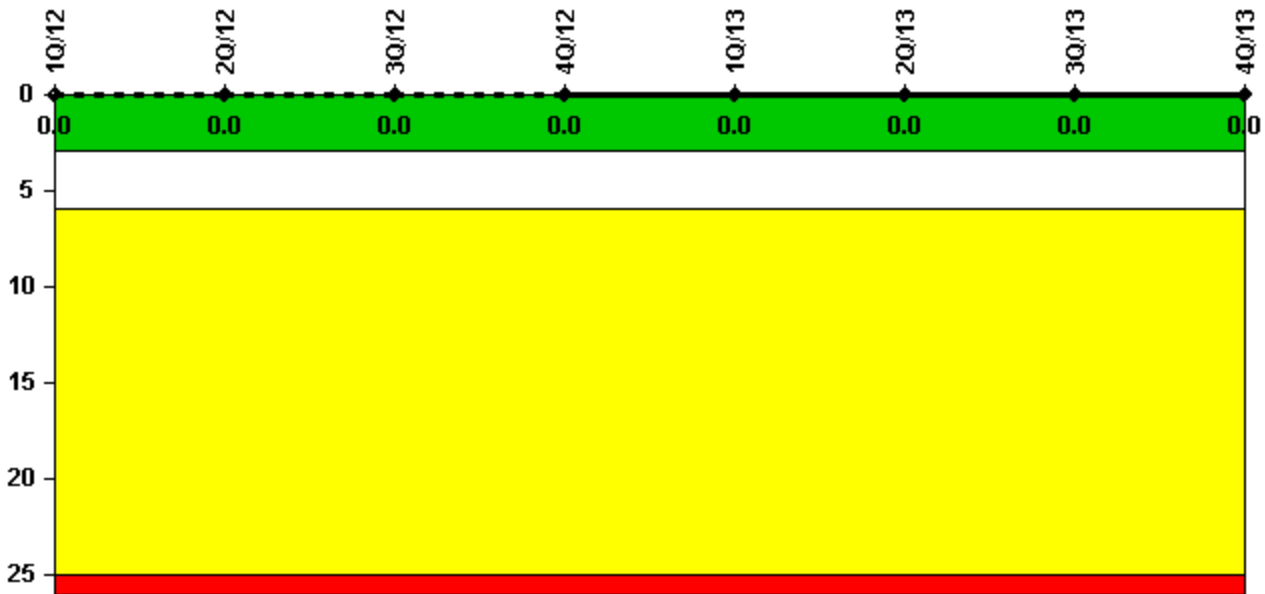


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

#### Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2183.0	2184.0	2208.0	1683.9	2159.0	2184.0	2208.0	2079.8
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

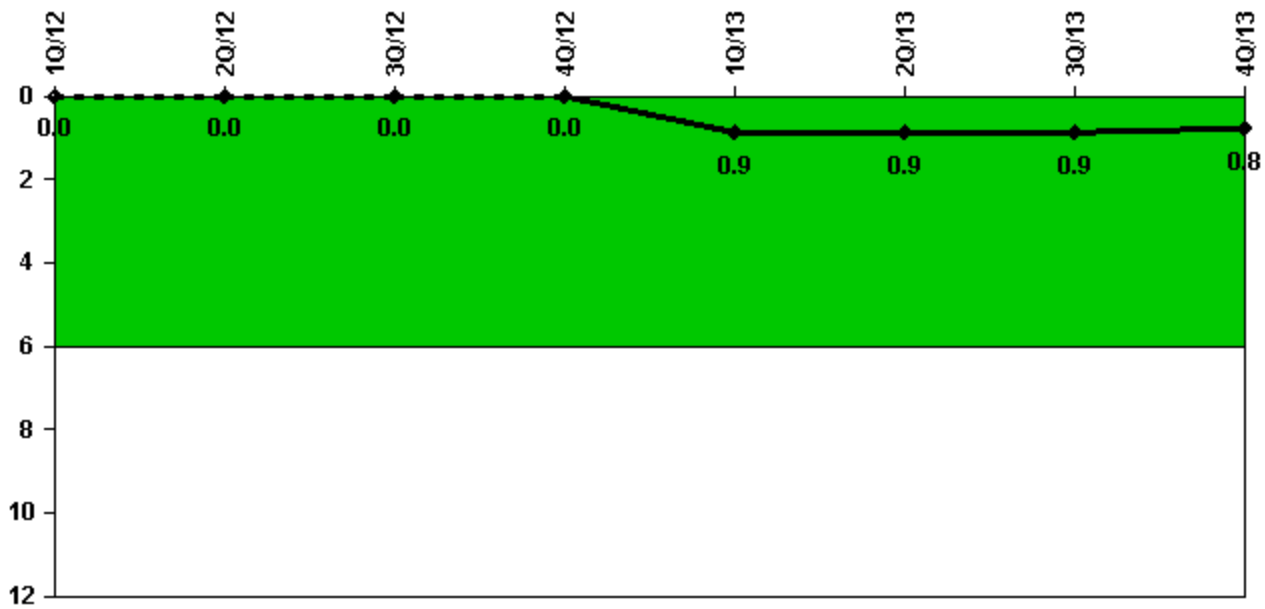


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Unplanned power changes	0	0	0	0	1.0	0	0	0
Critical hours	2183.0	2184.0	2208.0	1683.9	2159.0	2184.0	2208.0	2079.8
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.9</b>	<b>0.9</b>	<b>0.9</b>	<b>0.8</b>

Licensee Comments: none

### Unplanned Scrams with Complications

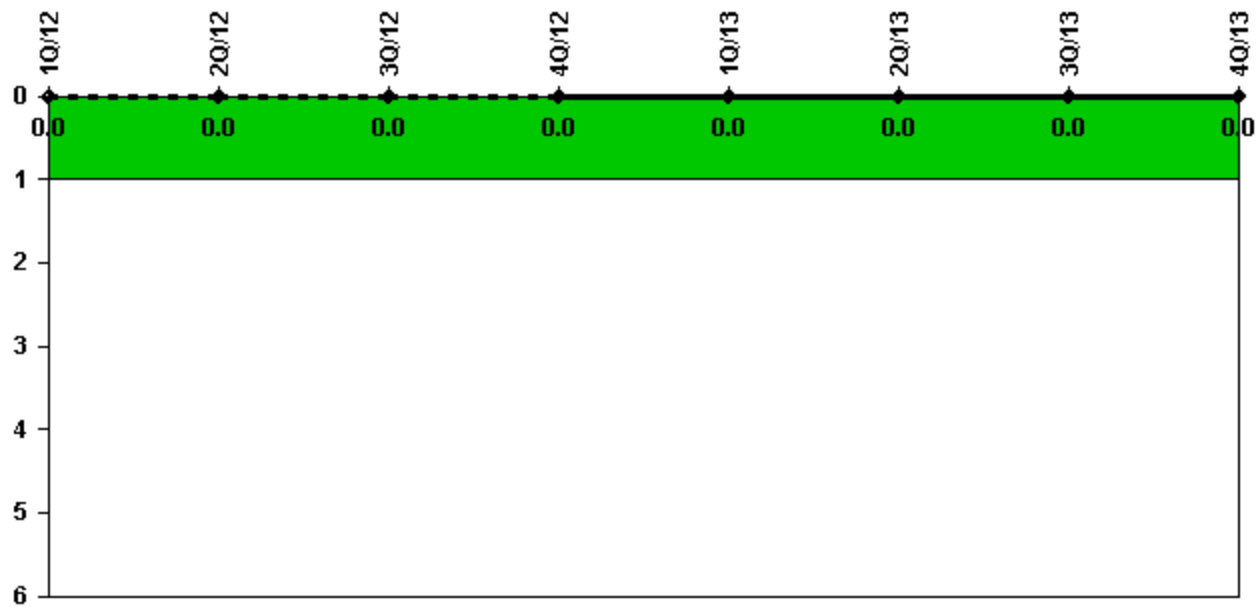


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (BWR)

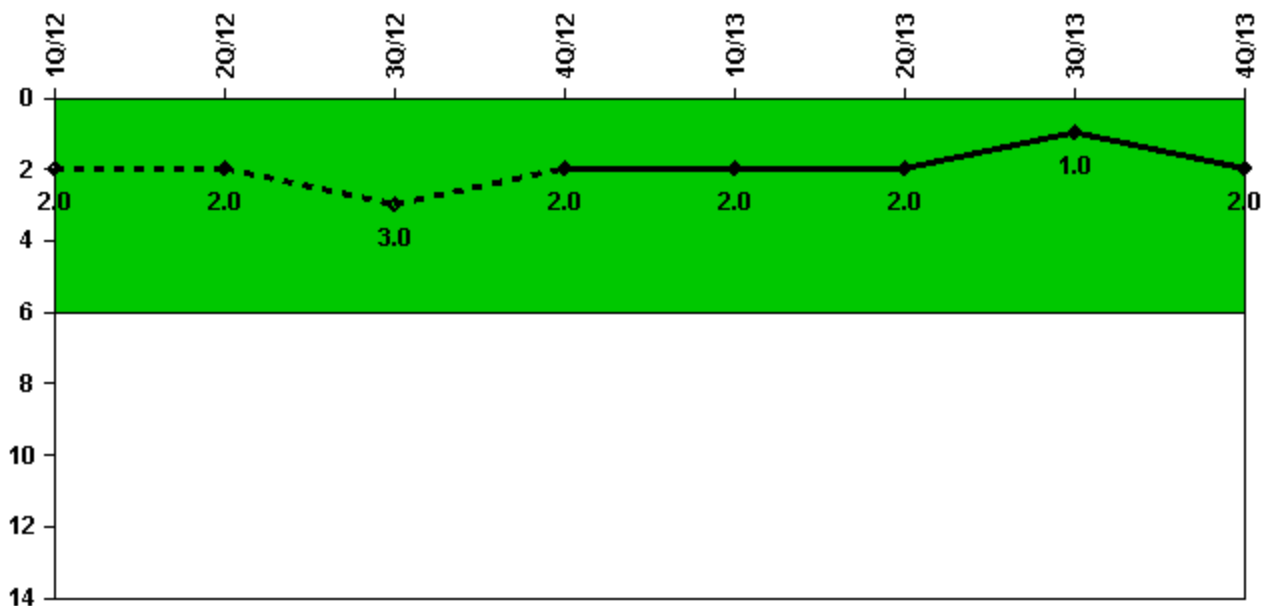

Thresholds: White > 6.0

#### Notes

Safety System Functional Failures (BWR)	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Safety System Functional Failures	0	0	2	0	0	0	1	1
<b>Indicator value</b>	<b>2</b>	<b>2</b>	<b>3</b>	<b>2</b>	<b>2</b>	<b>2</b>	<b>1</b>	<b>2</b>

Licensee Comments:


4Q/13: LER 237/2013-003-00, Secondary Containment Inoperable Due to Two Interlock Doors Being Open Simultaneously, submitted in November 2013 for Unit 2 and Unit 3 SSFF

3Q/13: Licensee Event Report 237/2013-001-00, Secondary Containment Inoperable Due to Two Interlock Doors Being Open Simultaneously, dated 8/23/13

3Q/12: SSFF value for July 2012 was changed from 0 to 1 on 10/19/13. Ref. LER 237/2012-002-00, Inlet Steam Drain Pot Drain Line Leaks Result in HPCI Inoperabilities

3Q/12: LER 249/2012-001-00, Unexpected Isolation of the Isolation Condenser Due to Test Switch Failure, dated 9/10/2012

### Mitigating Systems Performance Index, Emergency AC Power System

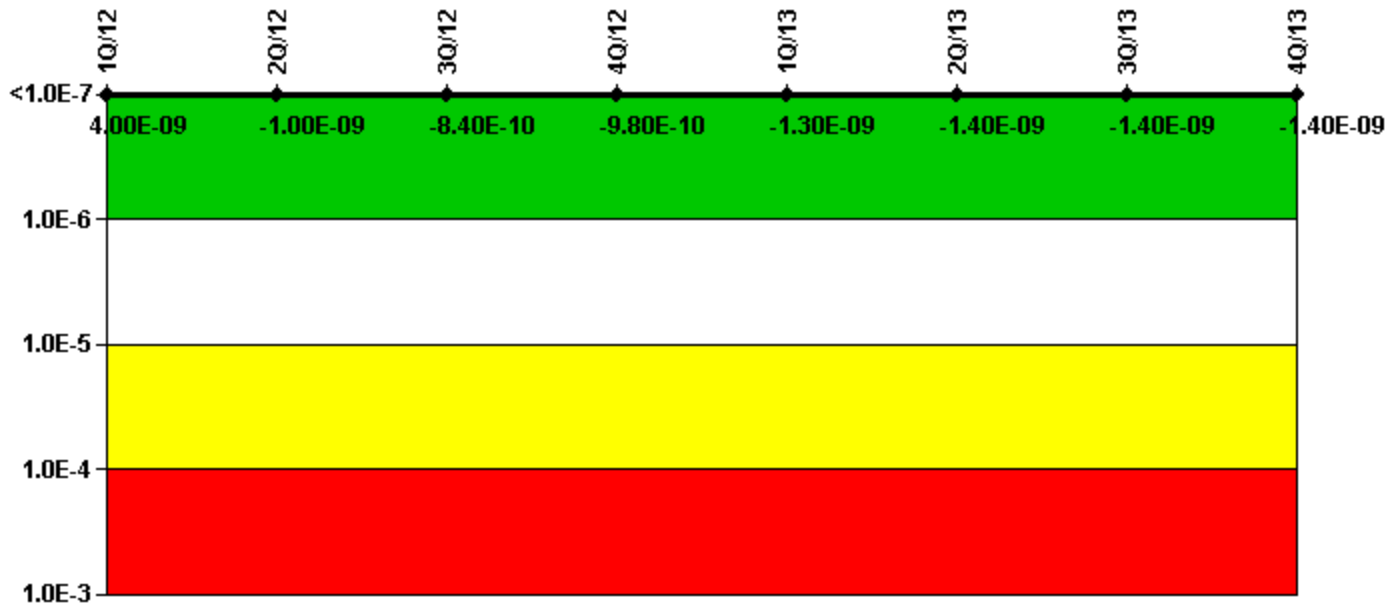


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	1.54E-09	6.07E-10	7.14E-10	5.16E-10	2.60E-10	1.22E-10	8.26E-11	-1.53E-11
URI ( $\Delta$ CDF)	2.44E-09	-1.60E-09	-1.55E-09	-1.50E-09	-1.53E-09	-1.48E-09	-1.48E-09	-1.40E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.00E-09	-1.00E-09	-8.40E-10	-9.80E-10	-1.30E-09	-1.40E-09	-1.40E-09	-1.40E-09

Licensee Comments: none

### Mitigating Systems Performance Index, High Pressure Injection System

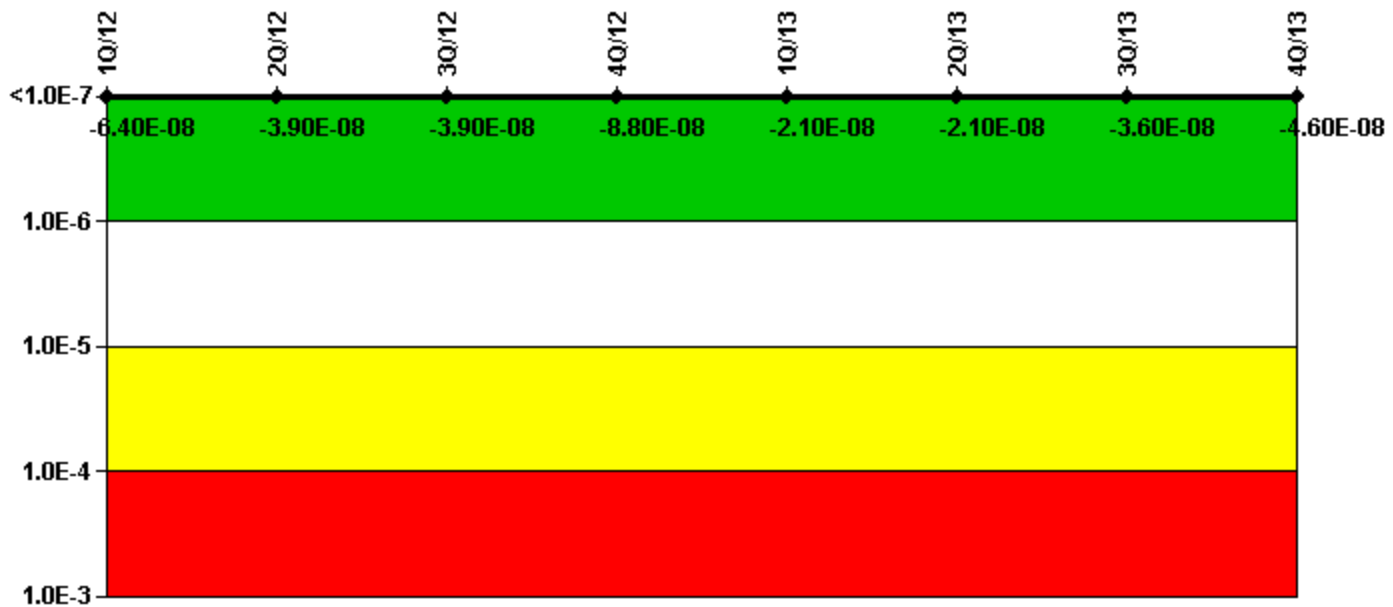


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	1.31E-09	2.62E-08	2.62E-08	-2.22E-08	4.42E-08	4.50E-08	2.93E-08	1.91E-08
URI ( $\Delta$ CDF)	-6.56E-08	-6.56E-08	-6.56E-08	-6.55E-08	-6.55E-08	-6.55E-08	-6.55E-08	-6.55E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.40E-08	-3.90E-08	-3.90E-08	-8.80E-08	-2.10E-08	-2.10E-08	-3.60E-08	-4.60E-08

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

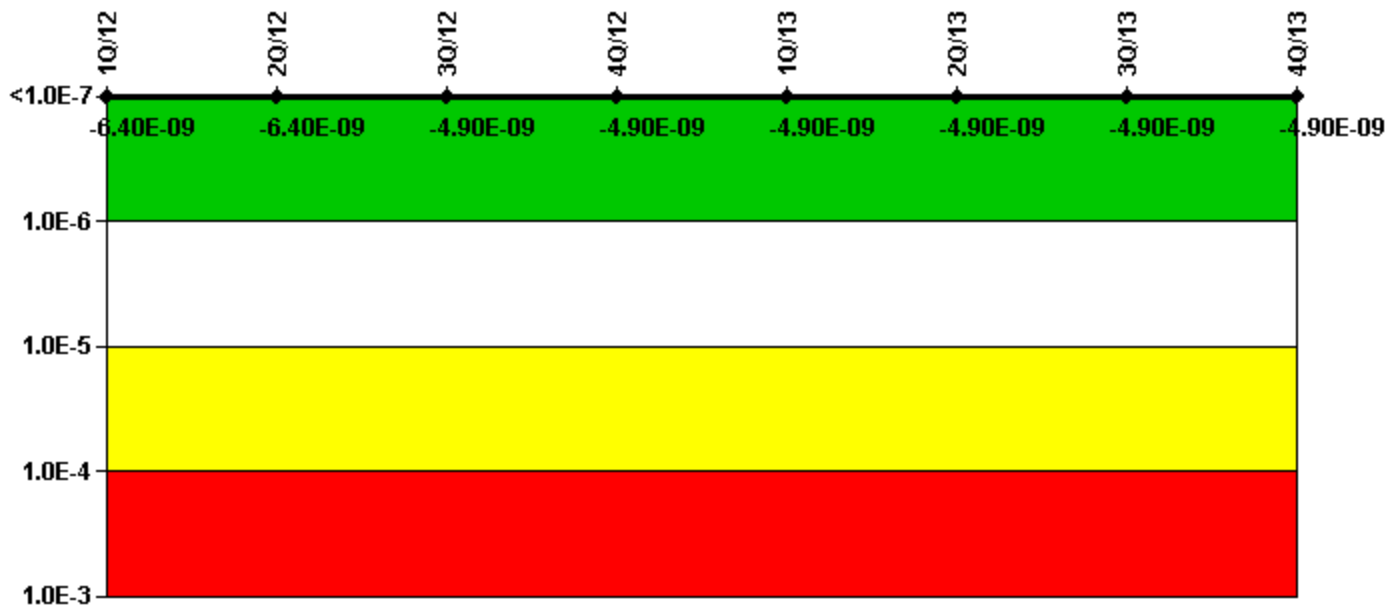


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	-6.25E-09	-6.25E-09	-4.80E-09	-4.78E-09	-4.78E-09	-4.78E-09	-4.78E-09	-4.81E-09
URI ( $\Delta$ CDF)	-1.13E-10	-1.13E-10	-1.13E-10	-9.92E-11	-9.92E-11	-9.92E-11	-9.92E-11	-9.92E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.40E-09	-6.40E-09	-4.90E-09	-4.90E-09	-4.90E-09	-4.90E-09	-4.90E-09	-4.90E-09

Licensee Comments: none

### Mitigating Systems Performance Index, Residual Heat Removal System

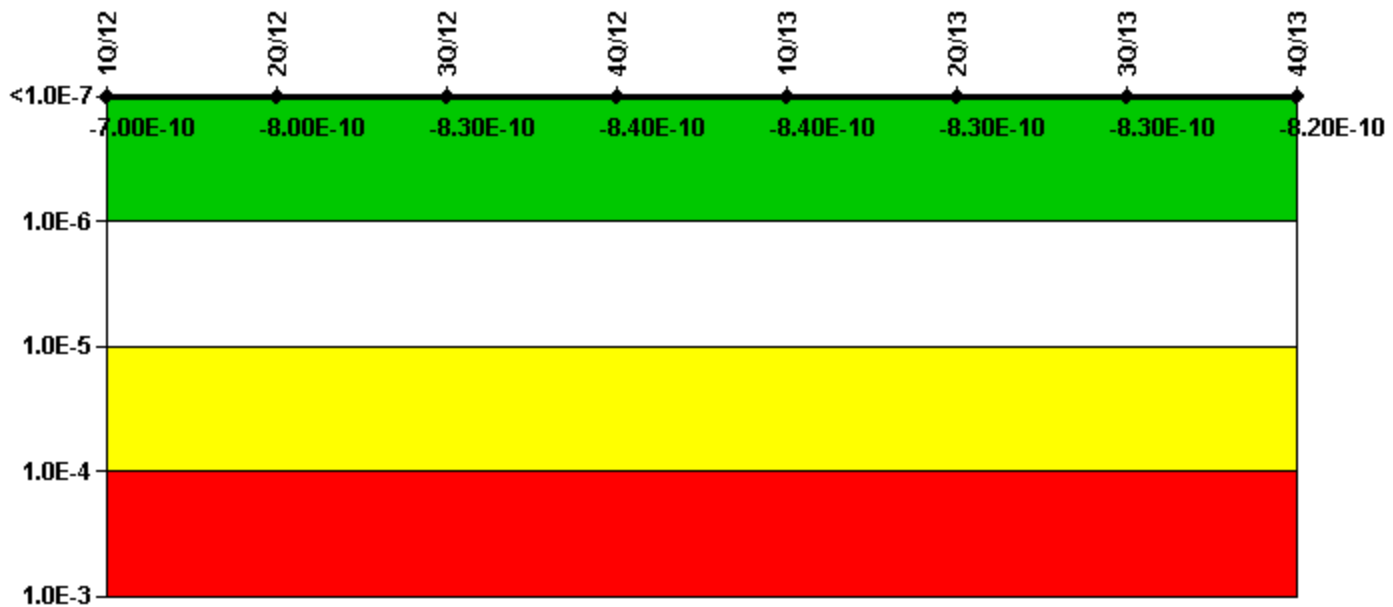

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	-2.21E-10	-3.25E-10	-3.25E-10	-3.22E-10	-3.22E-10	-3.22E-10	-3.22E-10	-3.25E-10
URI ( $\Delta$ CDF)	-4.80E-10	-4.80E-10	-5.06E-10	-5.21E-10	-5.16E-10	-5.12E-10	-5.10E-10	-4.93E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.00E-10	-8.00E-10	-8.30E-10	-8.40E-10	-8.40E-10	-8.30E-10	-8.30E-10	-8.20E-10

Licensee Comments: none



### Mitigating Systems Performance Index, Cooling Water Systems

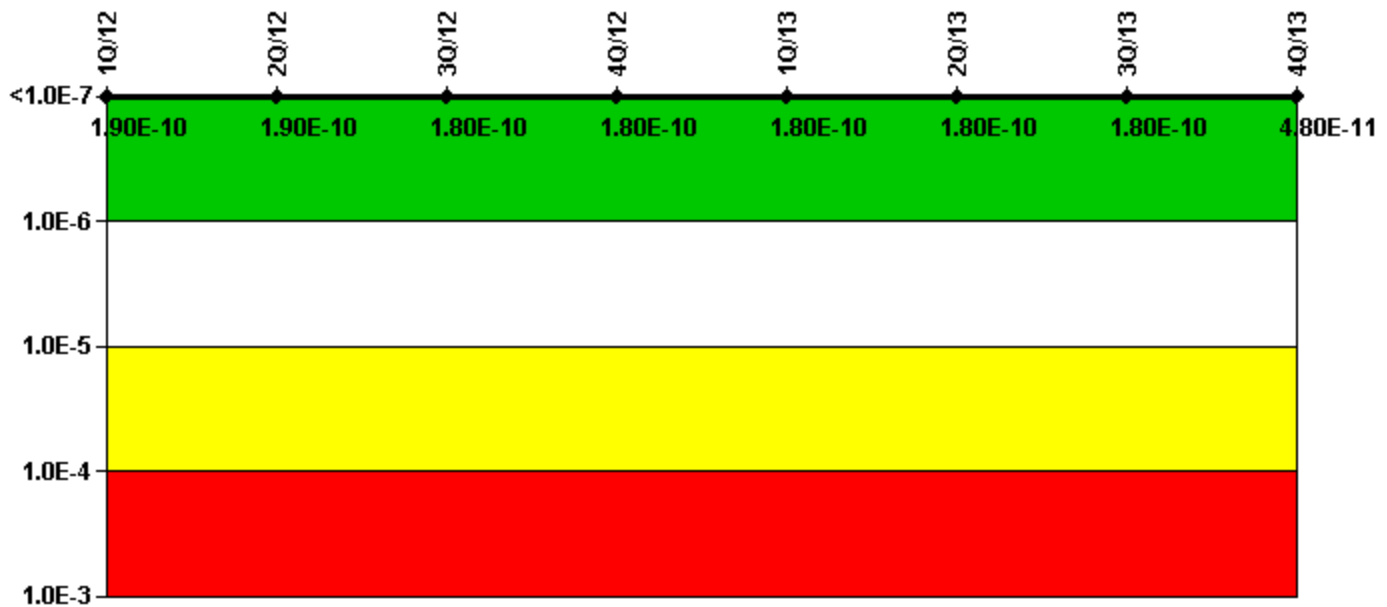


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	1.98E-10	1.98E-10	1.90E-10	1.93E-10	1.93E-10	1.93E-10	1.93E-10	5.70E-11
URI ( $\Delta$ CDF)	-9.02E-12	-9.09E-12	-9.46E-12	-9.87E-12	-9.56E-12	-8.93E-12	-8.87E-12	-8.74E-12
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.90E-10	1.90E-10	1.80E-10	1.80E-10	1.80E-10	1.80E-10	1.80E-10	4.80E-11

Licensee Comments: none

### Reactor Coolant System Activity

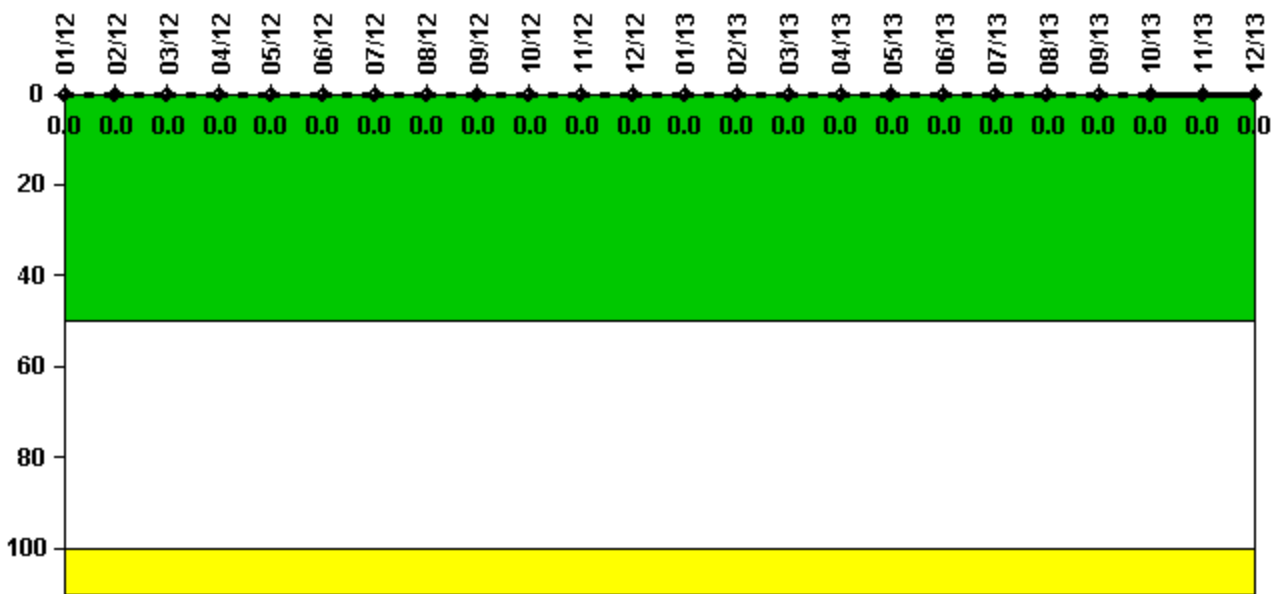

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum activity	0.000013	0.000013	0.000017	0.000015	0.000015	0.000015	0.000016	0.000019	0.000017	0.000016	0.000014	0.000005
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13
Maximum activity	0.000009	0.000005	0.000010	0.000004	0.000009	0.000012	0.000013	0.000014	0.000041	0.000015	0.000008	0.000012
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

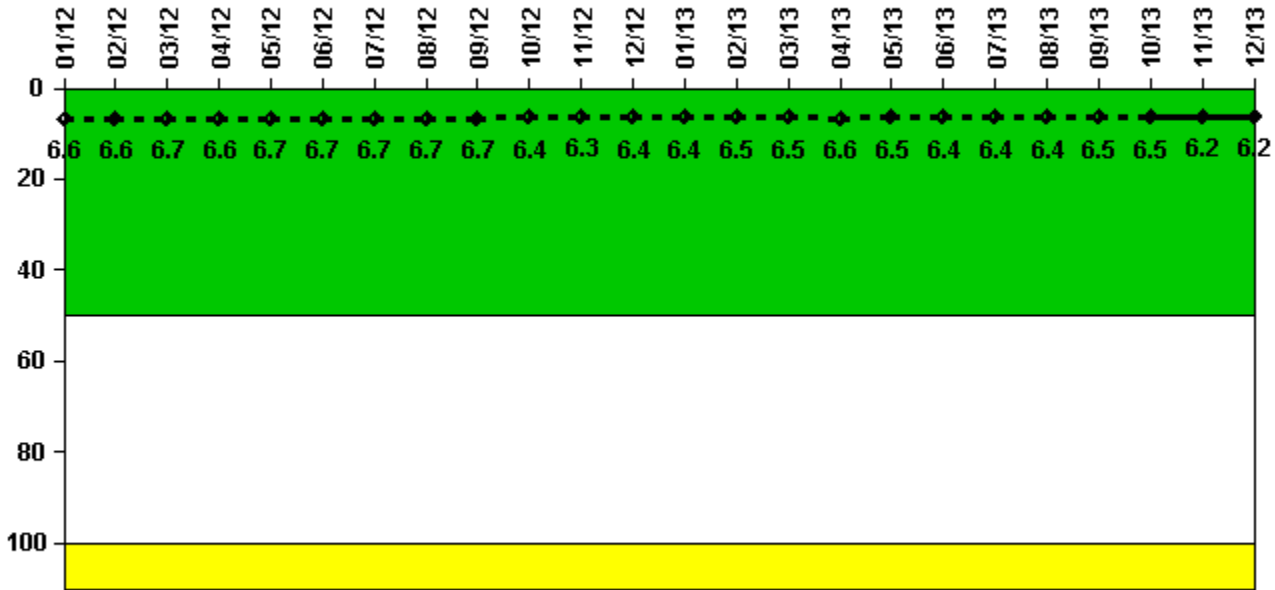

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Leakage	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum leakage	1.657	1.648	1.663	1.658	1.677	1.683	1.675	1.668	1.667	1.588	1.578	1.598
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.6	6.6	6.7	6.6	6.7	6.7	6.7	6.7	6.7	6.4	6.3	6.4

Reactor Coolant System Leakage	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13
Maximum leakage	1.607	1.635	1.633	1.655	1.635	1.610	1.605	1.608	1.613	1.617	1.562	1.562
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.4	6.5	6.5	6.6	6.5	6.4	6.4	6.4	6.5	6.5	6.2	6.2

Licensee Comments: none

### Drill/Exercise Performance

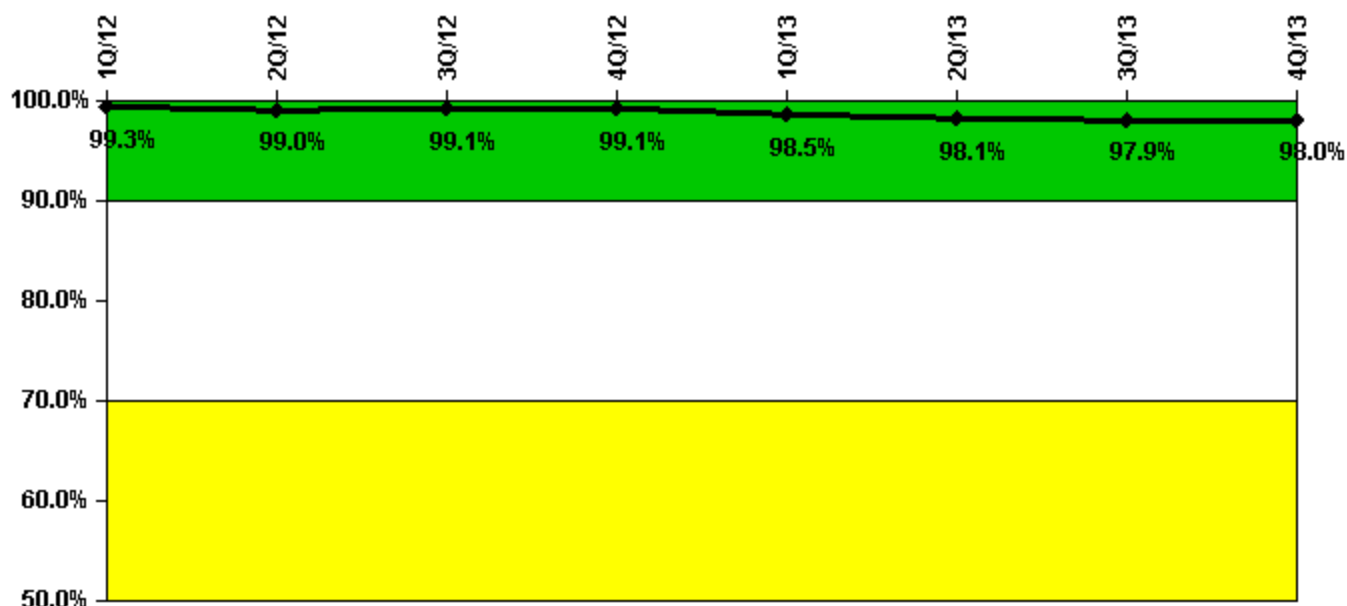


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Successful opportunities	48.0	49.0	20.0	19.0	58.0	32.0	36.0	34.0
Total opportunities	48.0	51.0	20.0	19.0	61.0	33.0	36.0	34.0
Indicator value	99.3%	99.0%	99.1%	99.1%	98.5%	98.1%	97.9%	98.0%

Licensee Comments: none

### ERO Drill Participation

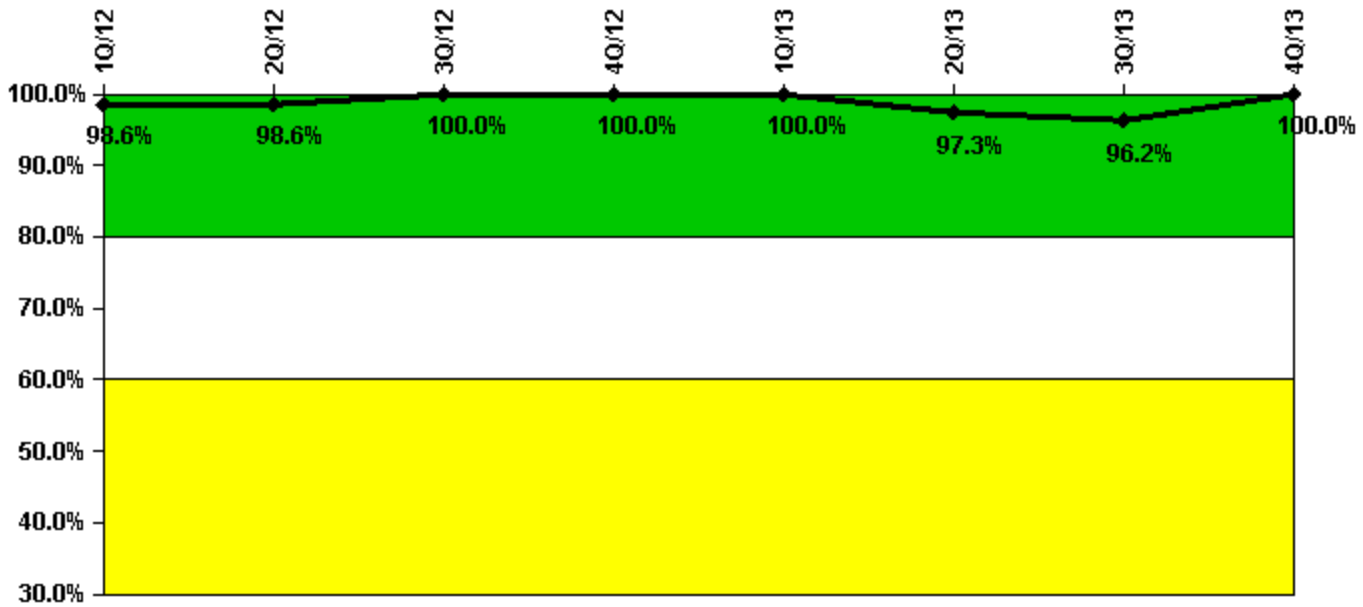


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Participating Key personnel	72.0	70.0	71.0	72.0	72.0	71.0	76.0	80.0
Total Key personnel	73.0	71.0	71.0	72.0	72.0	73.0	79.0	80.0
Indicator value	98.6%	98.6%	100.0%	100.0%	100.0%	97.3%	96.2%	100.0%

Licensee Comments: none

### Alert & Notification System

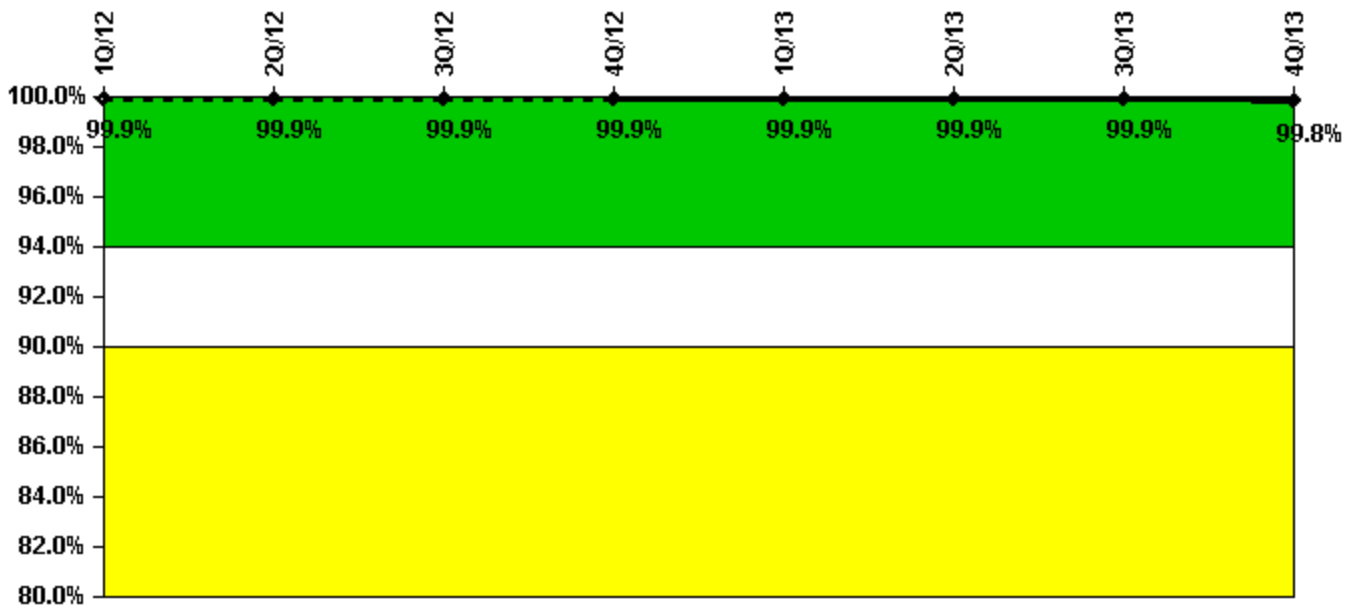


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Successful siren-tests	2989	2940	2893	2944	2942	2938	2939	2933
Total sirens-tests	2990	2944	2898	2944	2944	2944	2944	2944
Indicator value	99.9%	99.9%	99.9%	99.9%	99.9%	99.9%	99.9%	99.8%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

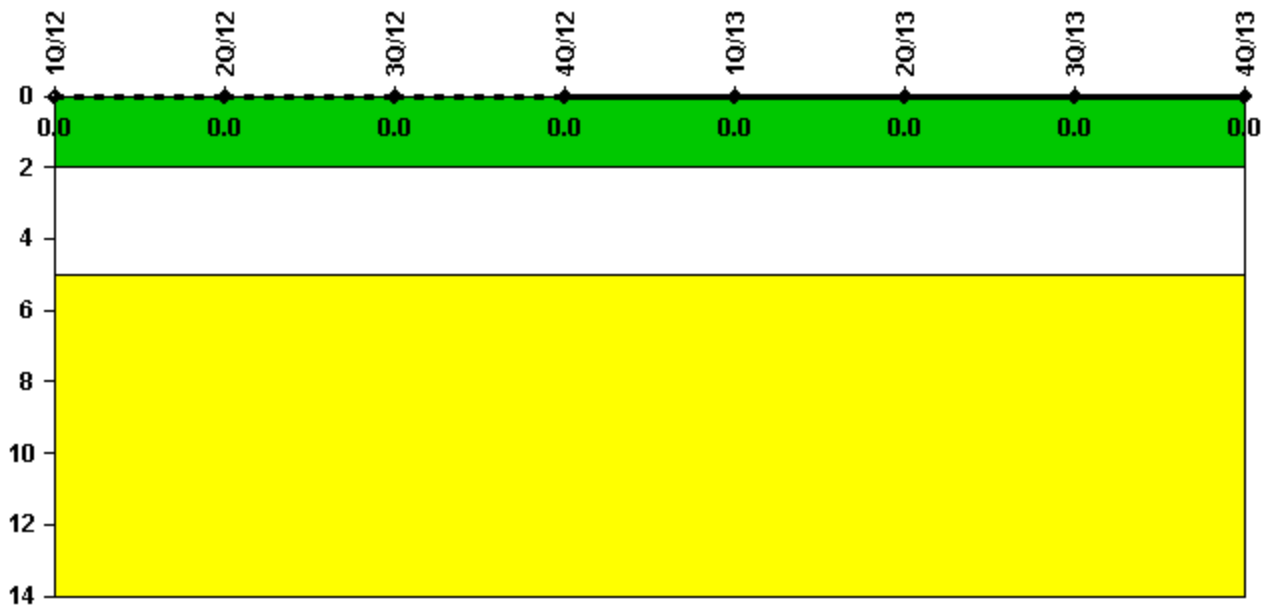


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

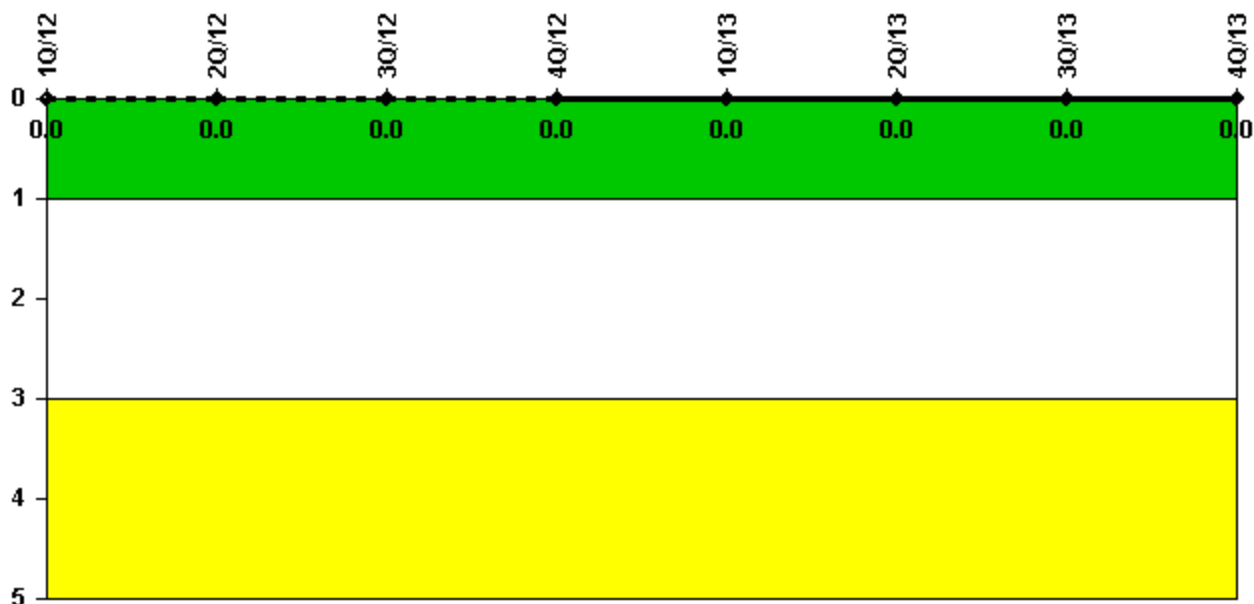

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: January 22, 2014*