


# Farley 1

## 4Q/2013 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: Unit 1 LER - 2013-002-00 1B Emergency Diesel Generator in a condition prohibited by tech specs due to an unreliable Mechanism Operated Cell (MOC) switch.

### Unplanned Scrams per 7000 Critical Hrs

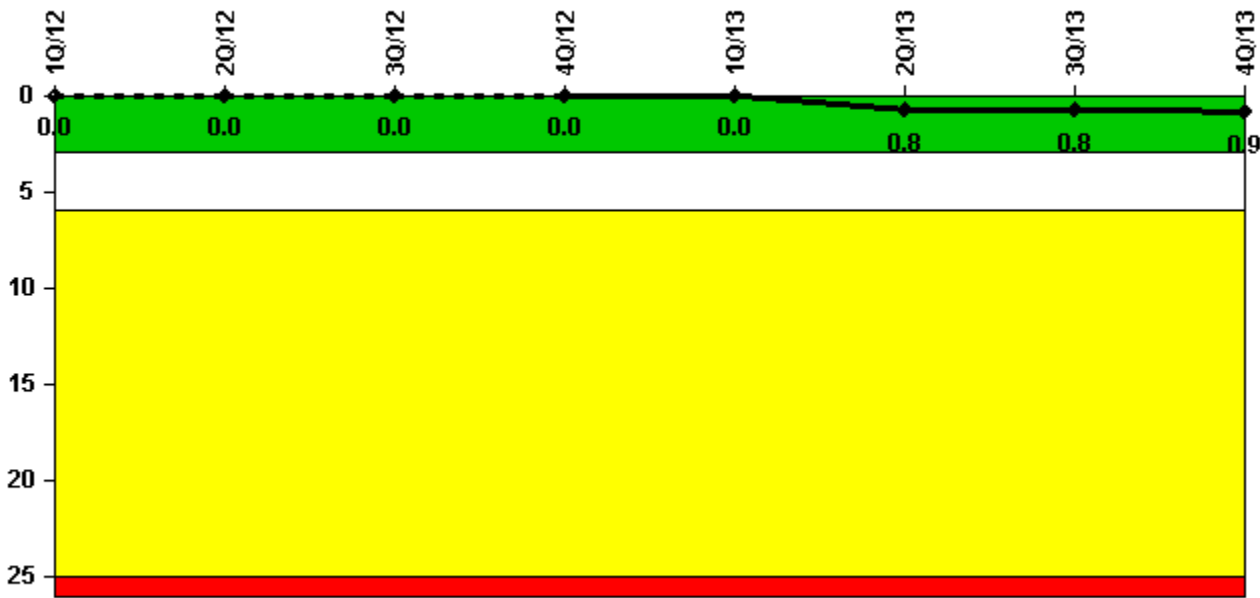


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Unplanned scrams	0	0	0	0	0	1.0	0	0
Critical hours	2093.0	1606.2	2141.1	2209.0	2159.0	2140.6	2166.8	1621.1
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.8</b>	<b>0.8</b>	<b>0.9</b>

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

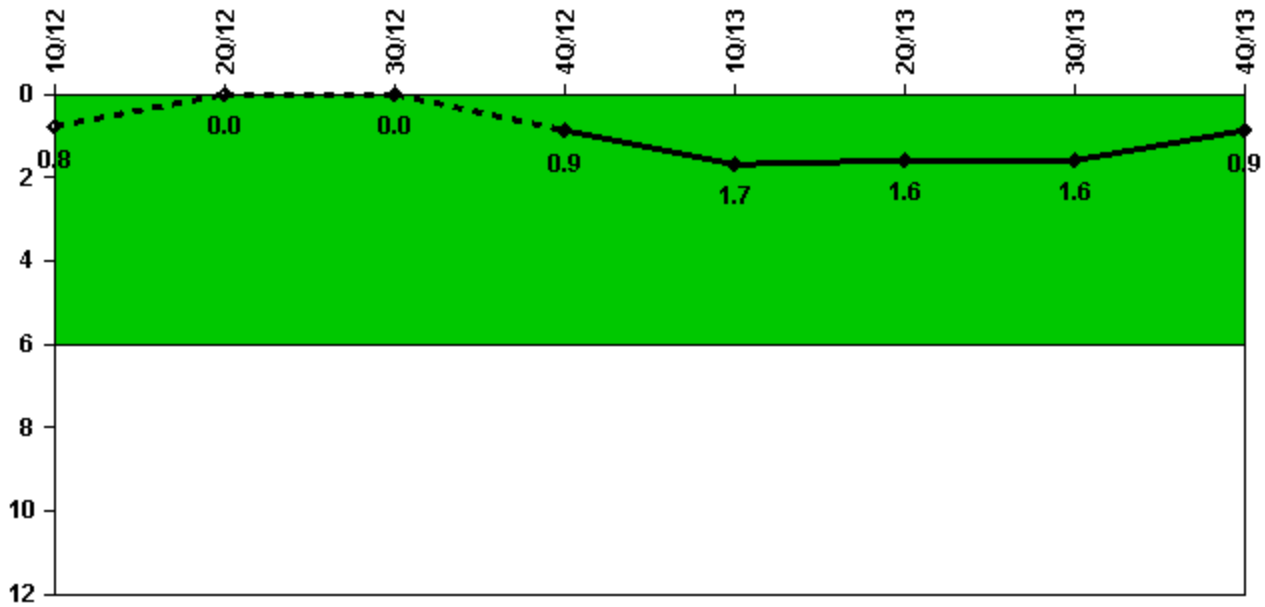


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Unplanned power changes	0	0	0	1.0	1.0	0	0	0
Critical hours	2093.0	1606.2	2141.1	2209.0	2159.0	2140.6	2166.8	1621.1
<b>Indicator value</b>	<b>0.8</b>	<b>0</b>	<b>0</b>	<b>0.9</b>	<b>1.7</b>	<b>1.6</b>	<b>1.6</b>	<b>0.9</b>

Licensee Comments: none

### Unplanned Scrams with Complications

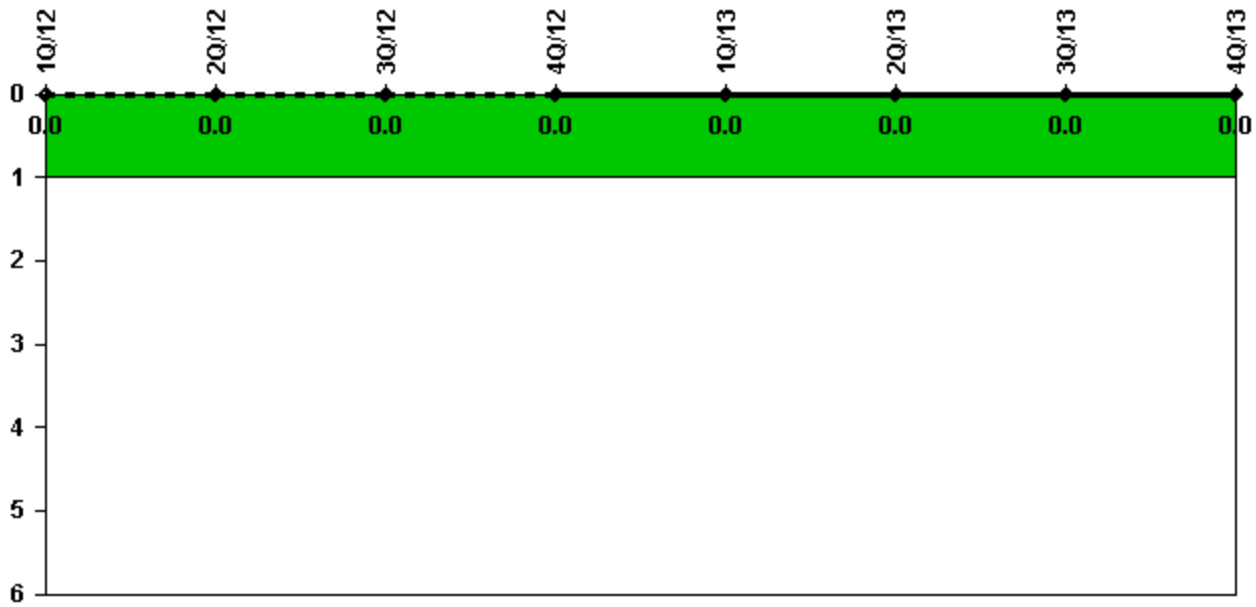


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

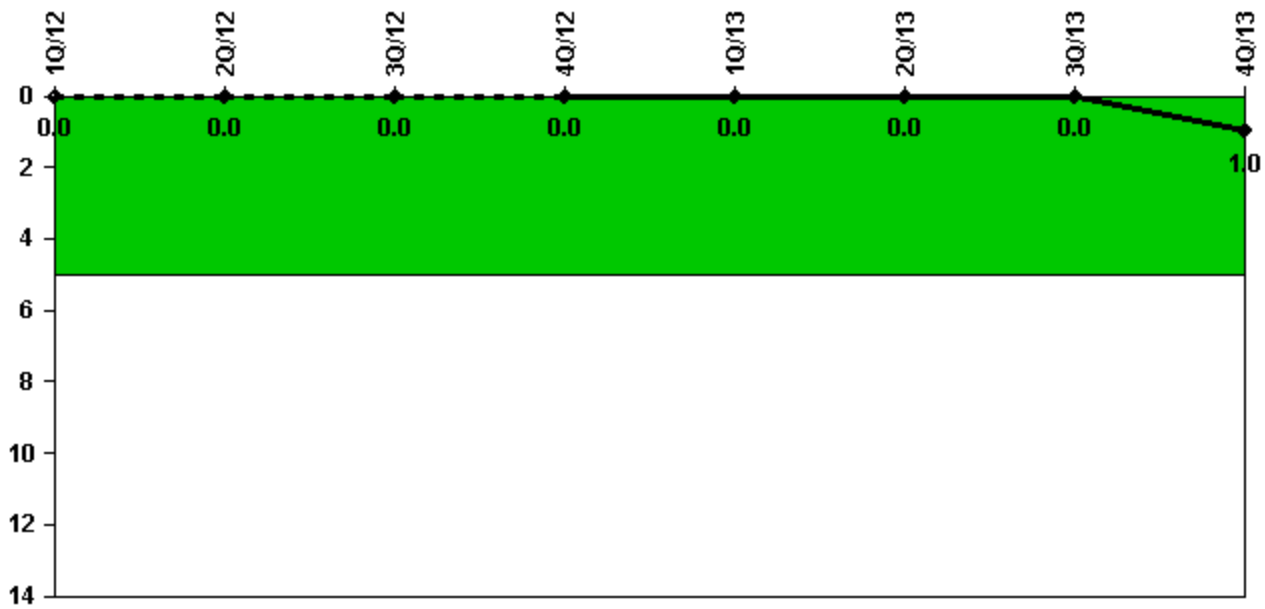


Thresholds: White > 5.0

#### Notes

Safety System Functional Failures (PWR)	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Safety System Functional Failures	0	0	0	0	0	0	0	1
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1</b>

Licensee Comments: none

### Mitigating Systems Performance Index, Emergency AC Power System

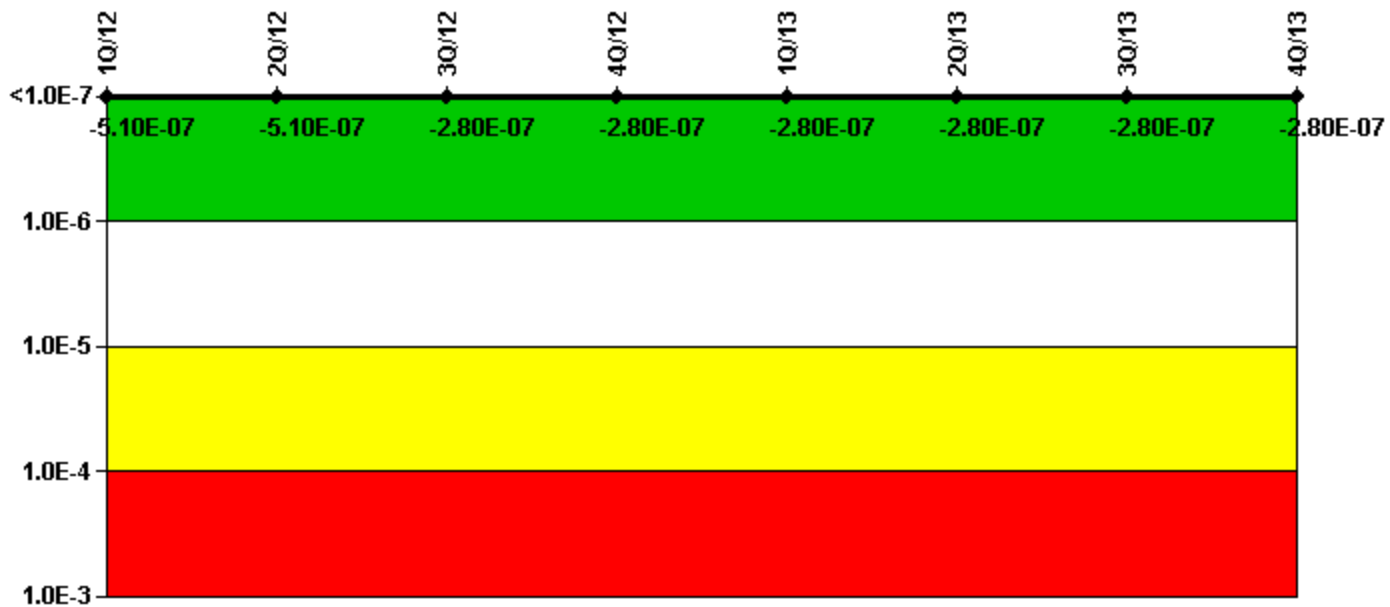


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

**Notes**

Mitigating Systems Performance Index, Emergency AC Power System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	-2.68E-08	-2.57E-08	3.51E-08	3.51E-08	3.51E-08	3.53E-08	3.55E-08	3.42E-08
URI ( $\Delta$ CDF)	-4.87E-07	-4.87E-07	-3.19E-07	-3.19E-07	-3.19E-07	-3.19E-07	-3.19E-07	-3.19E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.10E-07	-5.10E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07

Licensee Comments: none

### Mitigating Systems Performance Index, High Pressure Injection System

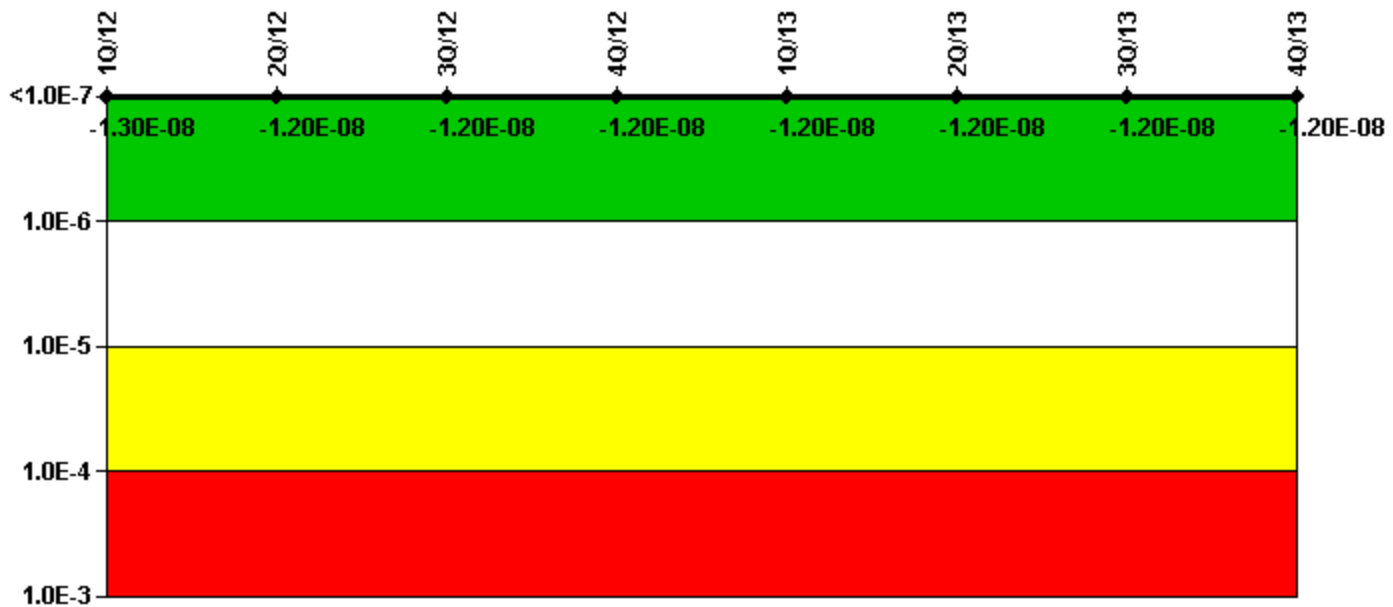


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	1.93E-11	6.68E-11	8.79E-11	9.13E-11	1.10E-10	1.64E-10	2.65E-10	2.87E-10
URI ( $\Delta$ CDF)	-1.26E-08	-1.26E-08	-1.26E-08	-1.26E-08	-1.26E-08	-1.26E-08	-1.26E-08	-1.26E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.30E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

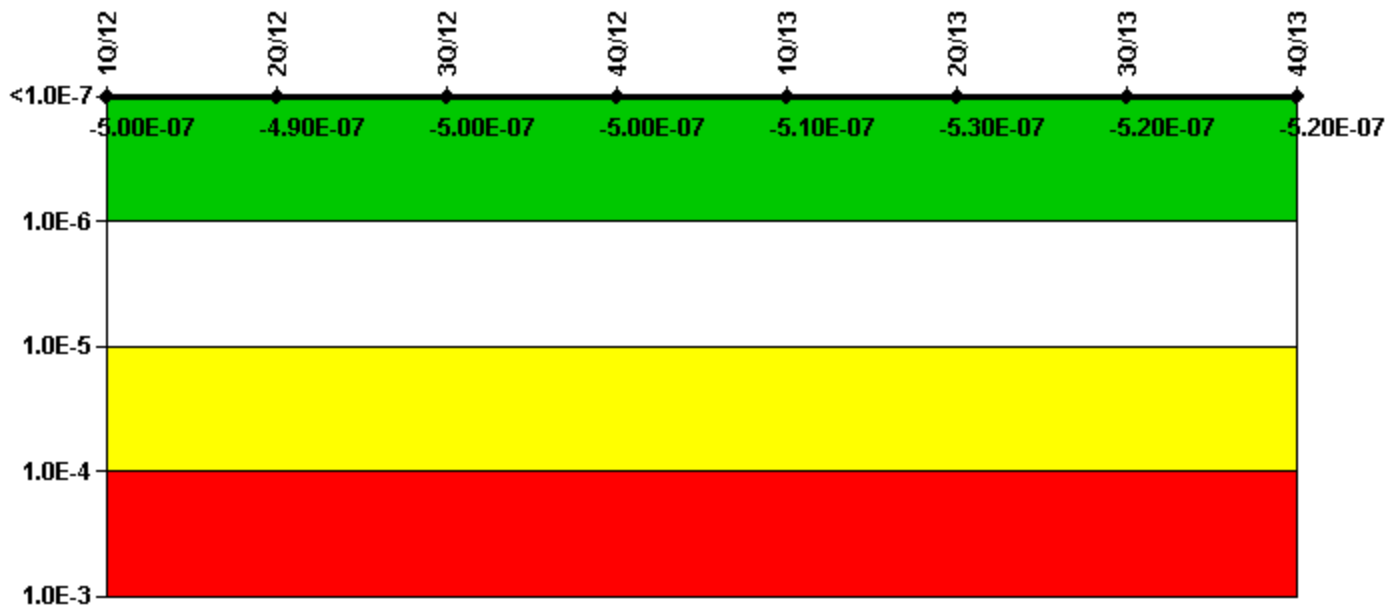


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	-9.03E-08	-8.31E-08	-8.71E-08	-8.71E-08	-9.46E-08	-1.20E-07	-1.07E-07	-1.10E-07
URI ( $\Delta$ CDF)	-4.12E-07	-4.12E-07	-4.12E-07	-4.12E-07	-4.12E-07	-4.12E-07	-4.12E-07	-4.12E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.00E-07	-4.90E-07	-5.00E-07	-5.00E-07	-5.10E-07	-5.30E-07	-5.20E-07	-5.20E-07

Licensee Comments: none

### Mitigating Systems Performance Index, Residual Heat Removal System

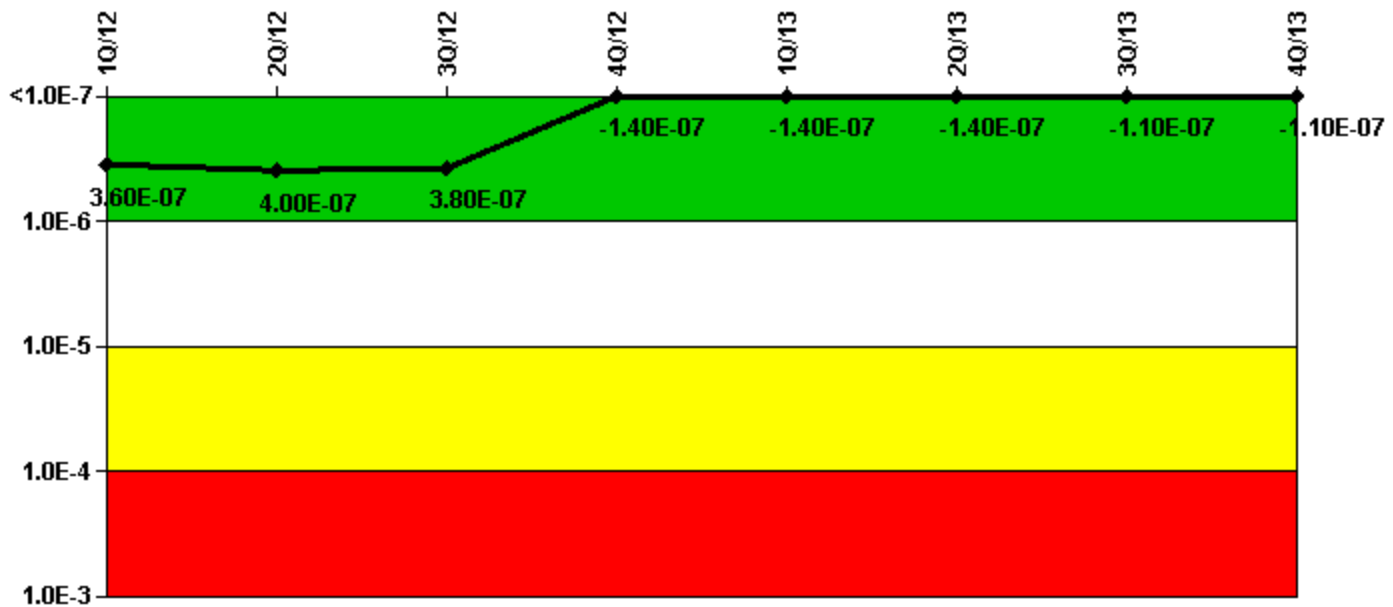

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI (ΔCDF)	1.45E-08	5.76E-08	3.56E-08	1.62E-08	1.51E-08	1.83E-08	4.06E-08	4.99E-08
URI (ΔCDF)	3.45E-07	3.45E-07	3.45E-07	-1.55E-07	-1.55E-07	-1.55E-07	-1.55E-07	-1.55E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.60E-07	4.00E-07	3.80E-07	-1.40E-07	-1.40E-07	-1.40E-07	-1.10E-07	-1.10E-07

Licensee Comments:


3Q/12: Risk Cap Invoked.

2Q/12: Risk Cap Invoked.

1Q/12: Risk Cap Invoked.



### Mitigating Systems Performance Index, Cooling Water Systems

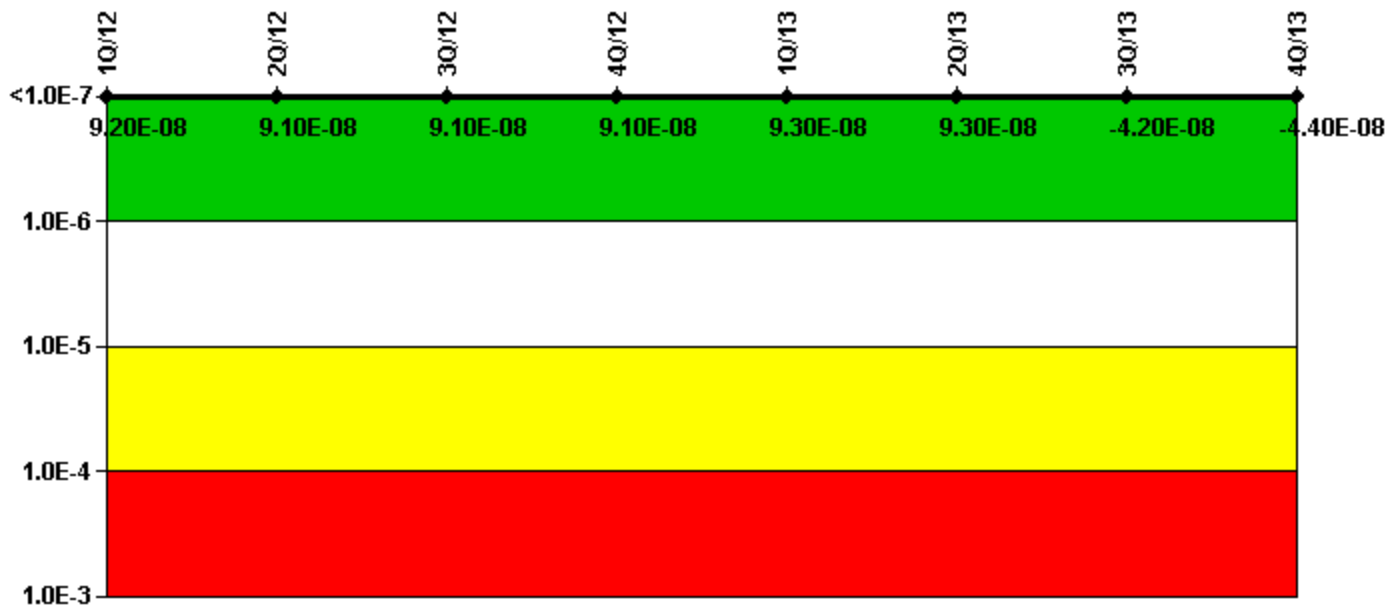


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
UAI ( $\Delta$ CDF)	2.14E-08	2.13E-08	2.11E-08	2.11E-08	2.24E-08	2.24E-08	9.32E-09	7.10E-09
URI ( $\Delta$ CDF)	7.02E-08	7.02E-08	7.02E-08	7.02E-08	7.02E-08	7.02E-08	-5.08E-08	-5.08E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	9.20E-08	9.10E-08	9.10E-08	9.10E-08	9.30E-08	9.30E-08	-4.20E-08	-4.40E-08

Licensee Comments: none

### Reactor Coolant System Activity

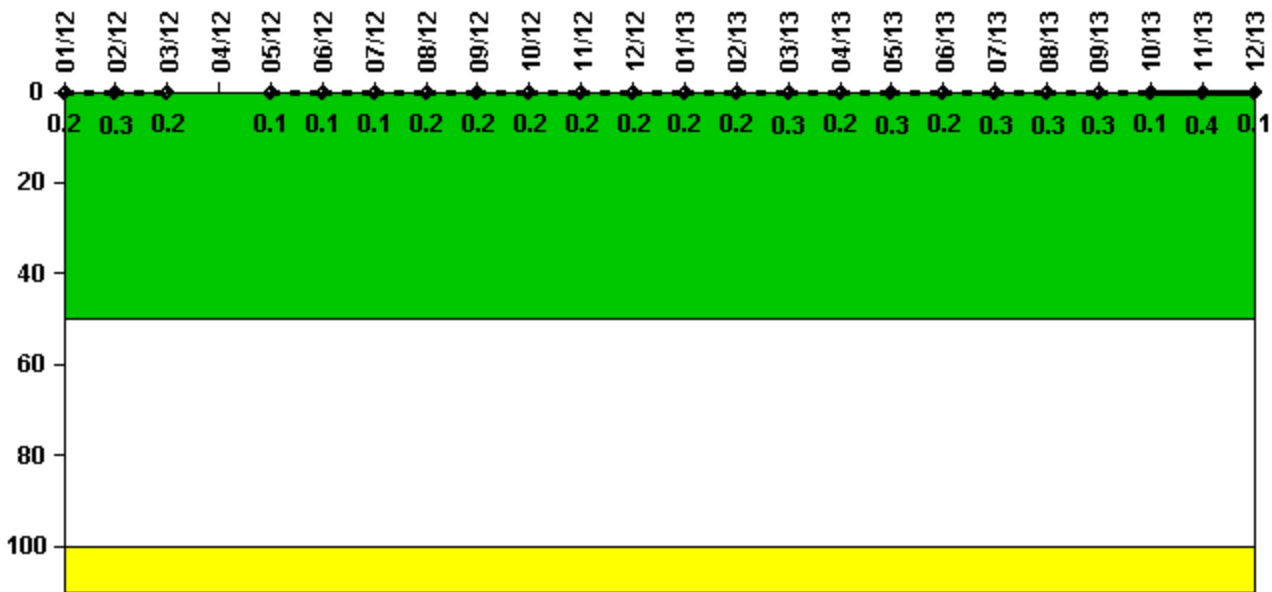

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum activity	0.001220	0.001280	0.001240	N/A	0.000614	0.000629	0.000730	0.000837	0.000819	0.000885	0.000929	0.001140
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.2	0.3	0.2	N/A	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2

Reactor Coolant System Activity	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13
Maximum activity	0.001110	0.001220	0.001260	0.001210	0.001310	0.001110	0.001300	0.001330	0.001320	0.000492	0.002170	0.000649
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.2	0.2	0.3	0.2	0.3	0.2	0.3	0.3	0.3	0.1	0.4	0.1

Licensee Comments: none

### Reactor Coolant System Leakage

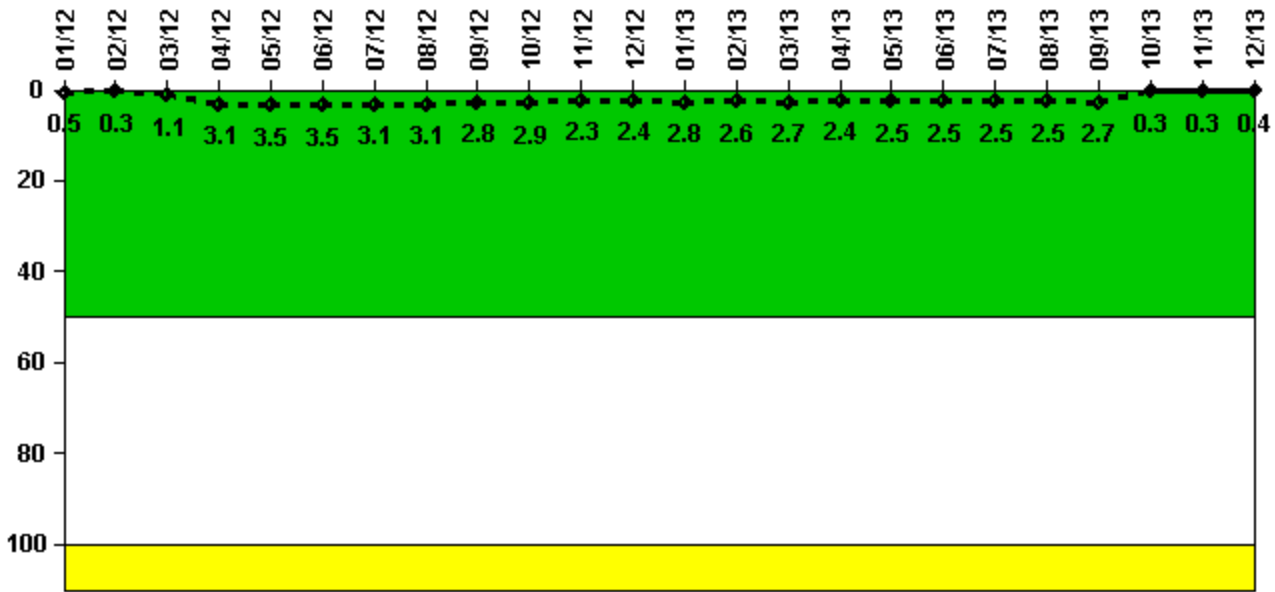

Thresholds: White > 50.0 Yellow > 100.0


#### Notes

Reactor Coolant System Leakage	1/12	2/12	3/12	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12
Maximum leakage	0.050	0.029	0.105	0.308	0.350	0.349	0.314	0.308	0.275	0.292	0.232	0.235
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.5</b>	<b>0.3</b>	<b>1.1</b>	<b>3.1</b>	<b>3.5</b>	<b>3.5</b>	<b>3.1</b>	<b>3.1</b>	<b>2.8</b>	<b>2.9</b>	<b>2.3</b>	<b>2.4</b>
Reactor Coolant System Leakage	1/13	2/13	3/13	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13
Maximum leakage	0.278	0.256	0.270	0.242	0.246	0.253	0.253	0.254	0.268	0.027	0.031	0.035
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>2.8</b>	<b>2.6</b>	<b>2.7</b>	<b>2.4</b>	<b>2.5</b>	<b>2.5</b>	<b>2.5</b>	<b>2.5</b>	<b>2.7</b>	<b>0.3</b>	<b>0.3</b>	<b>0.4</b>

Licensee Comments:

6/12: April RCS Activity data not available because of U1 Outage

### Drill/Exercise Performance

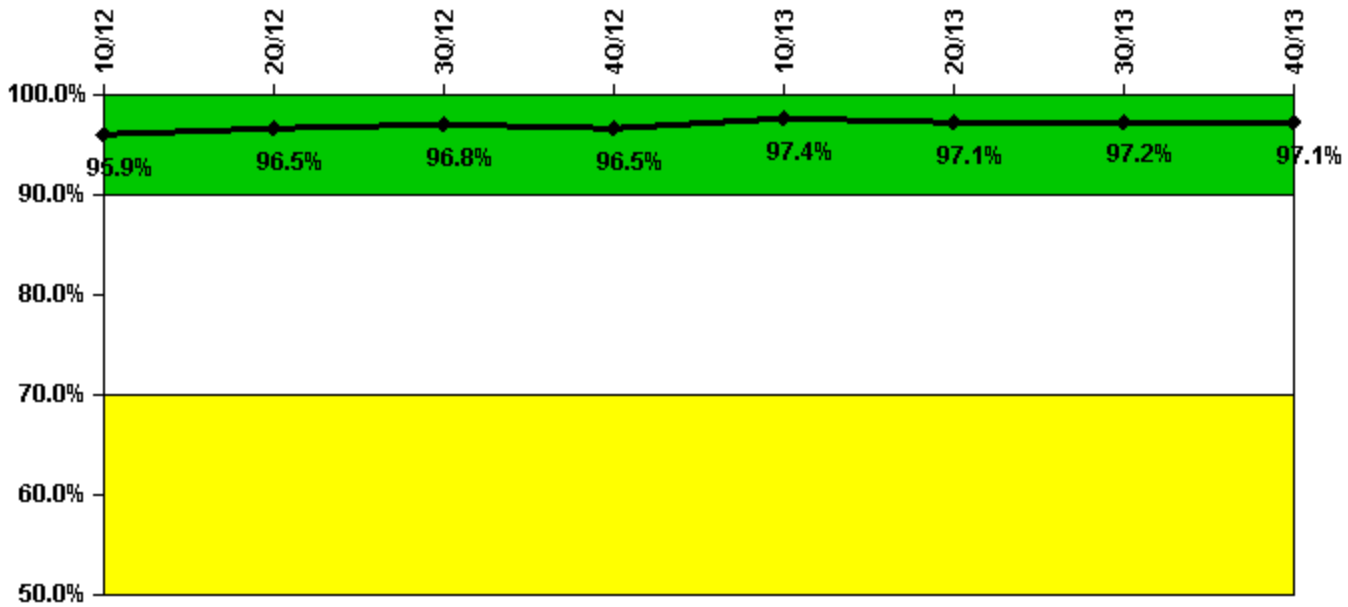

Thresholds: White < 90.0% Yellow < 70.0%


#### Notes

Drill/Exercise Performance	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Successful opportunities	39.0	14.0	62.0	45.0	40.0	47.0	37.0	18.0
Total opportunities	40.0	15.0	64.0	47.0	40.0	50.0	37.0	18.0
Indicator value	95.9%	96.5%	96.8%	96.5%	97.4%	97.1%	97.2%	97.1%

Licensee Comments:

1Q/12: Data changed due to an entry error at the site.

### ERO Drill Participation

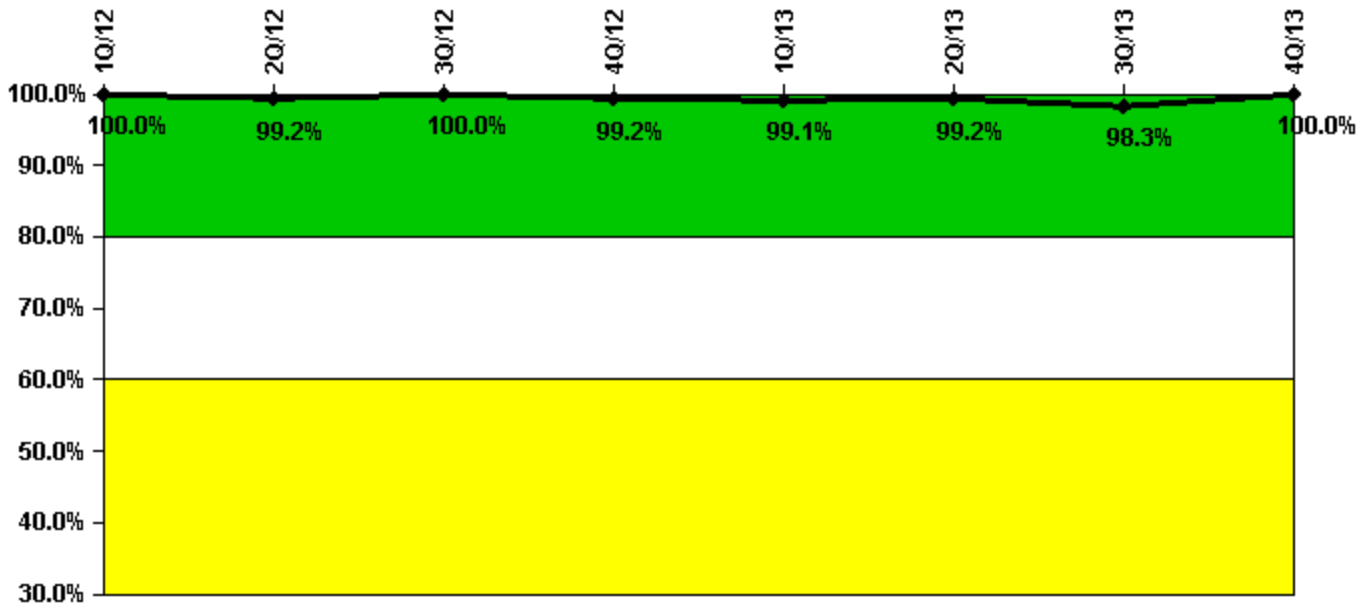


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Participating Key personnel	130.0	127.0	123.0	122.0	108.0	117.0	117.0	121.0
Total Key personnel	130.0	128.0	123.0	123.0	109.0	118.0	119.0	121.0
Indicator value	100.0%	99.2%	100.0%	99.2%	99.1%	99.2%	98.3%	100.0%

Licensee Comments: none

### Alert & Notification System

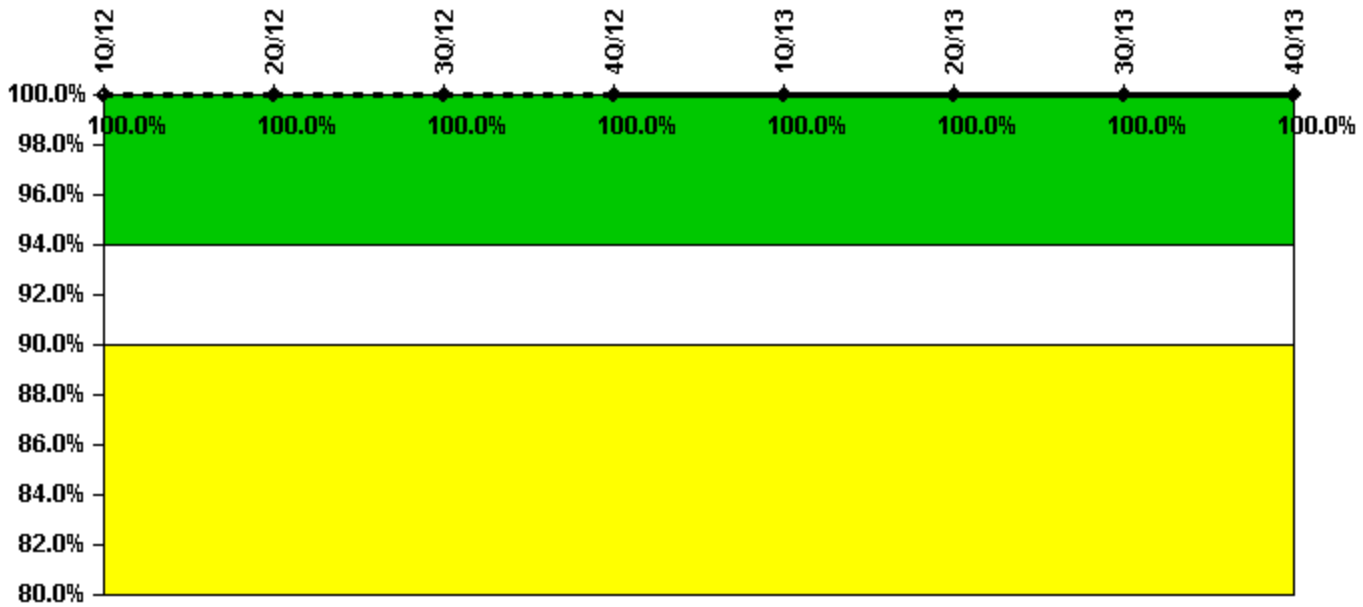


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
Successful siren-tests	42	42	39	42	42	42	42	42
Total sirens-tests	42	42	39	42	42	42	42	42
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

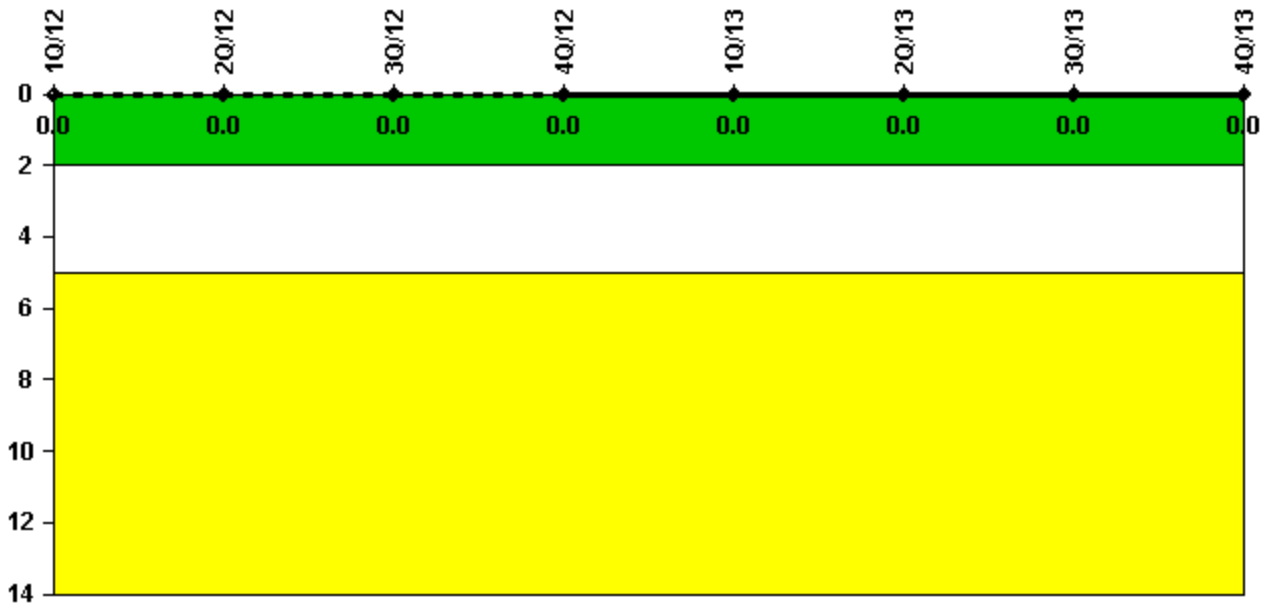


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

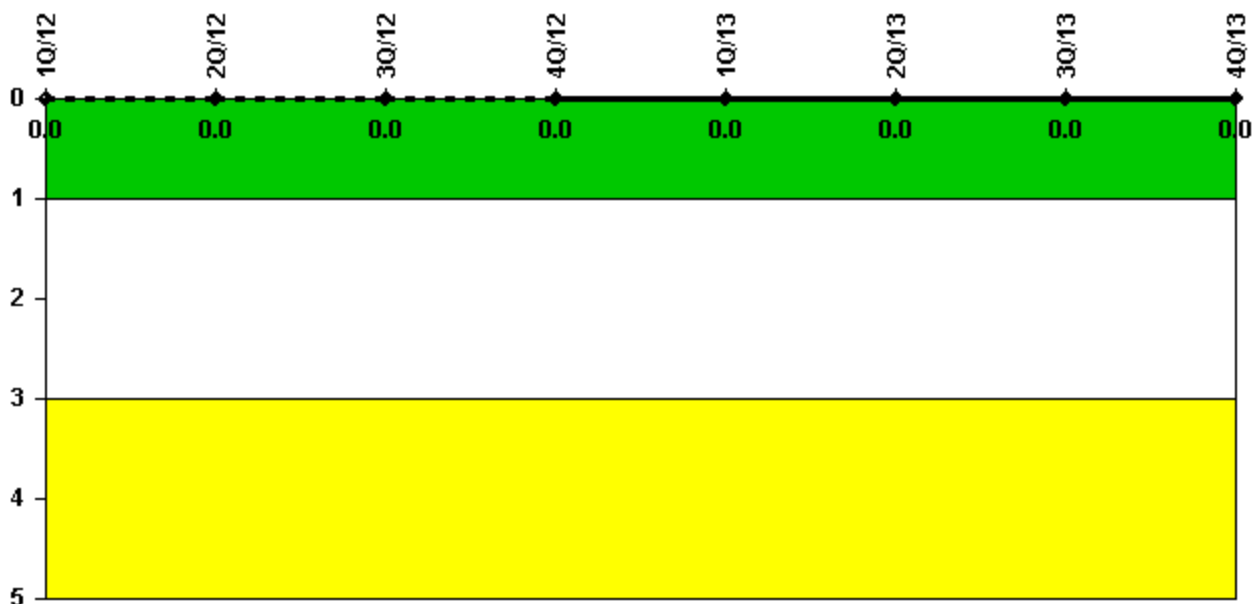

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: January 22, 2014*