


Byron 1

1Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: 1Q2014 BYRON STATION UNIT 1

Unplanned Scrams per 7000 Critical Hrs

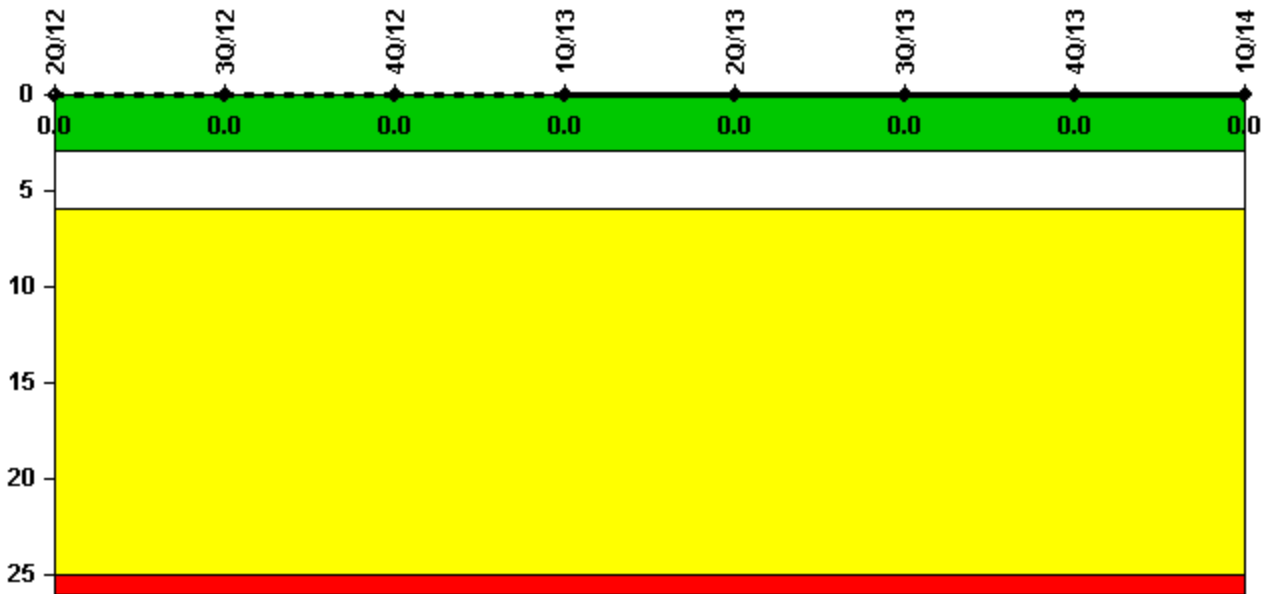


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2184.0	1704.0	2050.7	2159.0	2184.0	2208.0	2209.0	1735.7
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

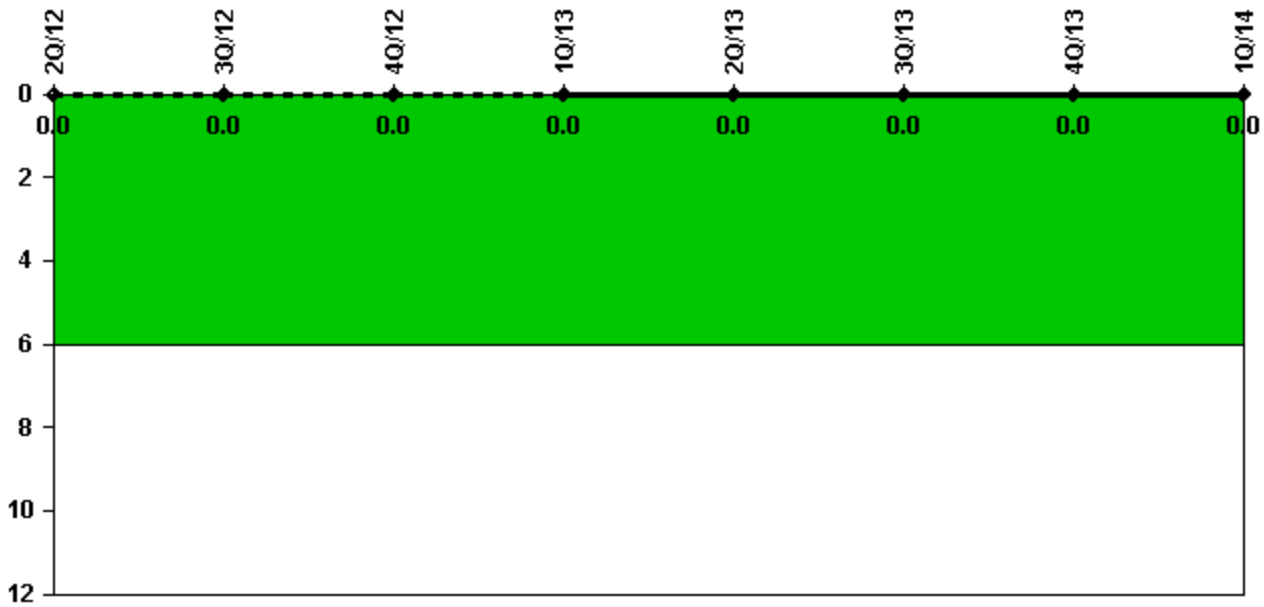


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2184.0	1704.0	2050.7	2159.0	2184.0	2208.0	2209.0	1735.7
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

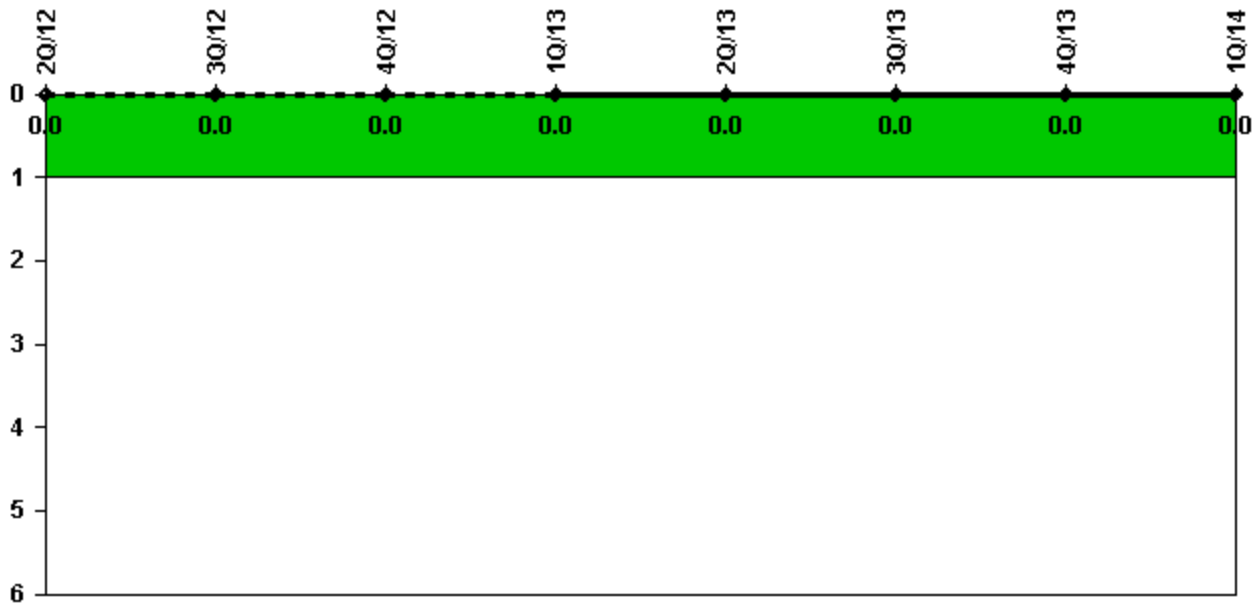


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

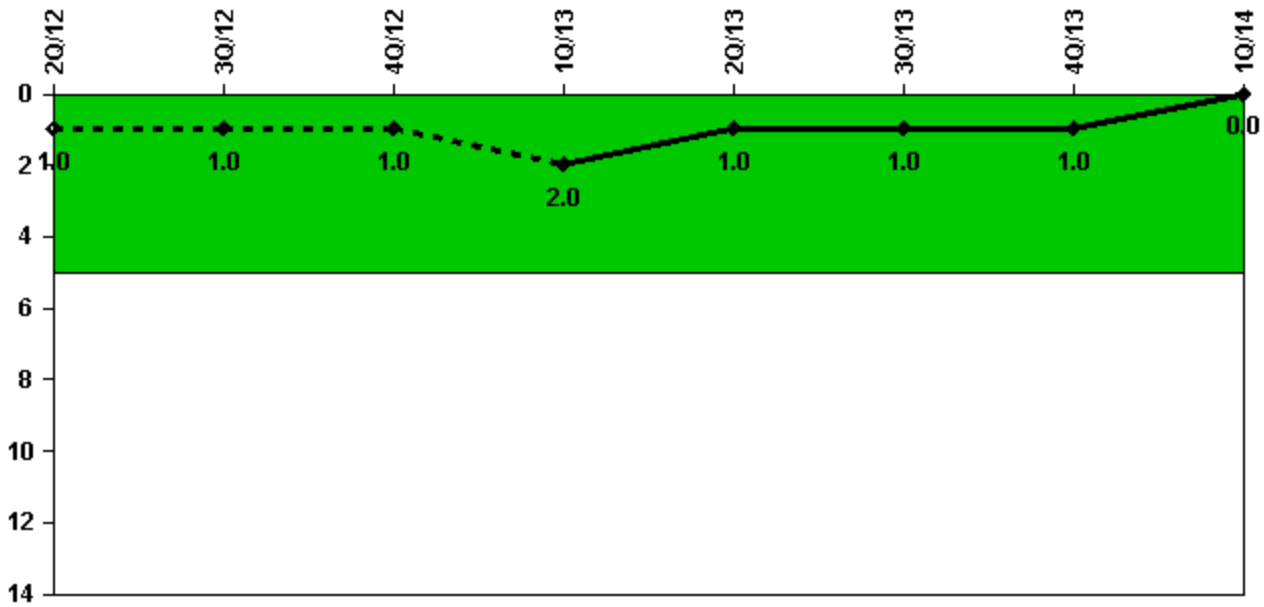

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Safety System Functional Failures	1	0	0	1	0	0	0	0
Indicator value	1	1	1	2	1	1	1	0


Licensee Comments:

1Q/13: LER 454-2012-003-01, Containment Area Radiation Monitors Inoperable for Longer than Allowed By Technical Specifications Due to Inadequate Procedure Controls

3Q/12: LER 2012-001-01 issued for U2 LOOP and Rx Trip and U1 LOOP due to SAT inverted insulators. Determined to NOT be an event or condition that could prevent fulfillment of a safety function.

2Q/12: (U2 - April) LER 2012-001-00 - No SSFF (Unit 1 - May) LER 454-2012-002: One Train of Containment Cooling System Inoperable Longer Than Allowed by Technical Specifications Due to Inadequate Work Instructions

Mitigating Systems Performance Index, Emergency AC Power System

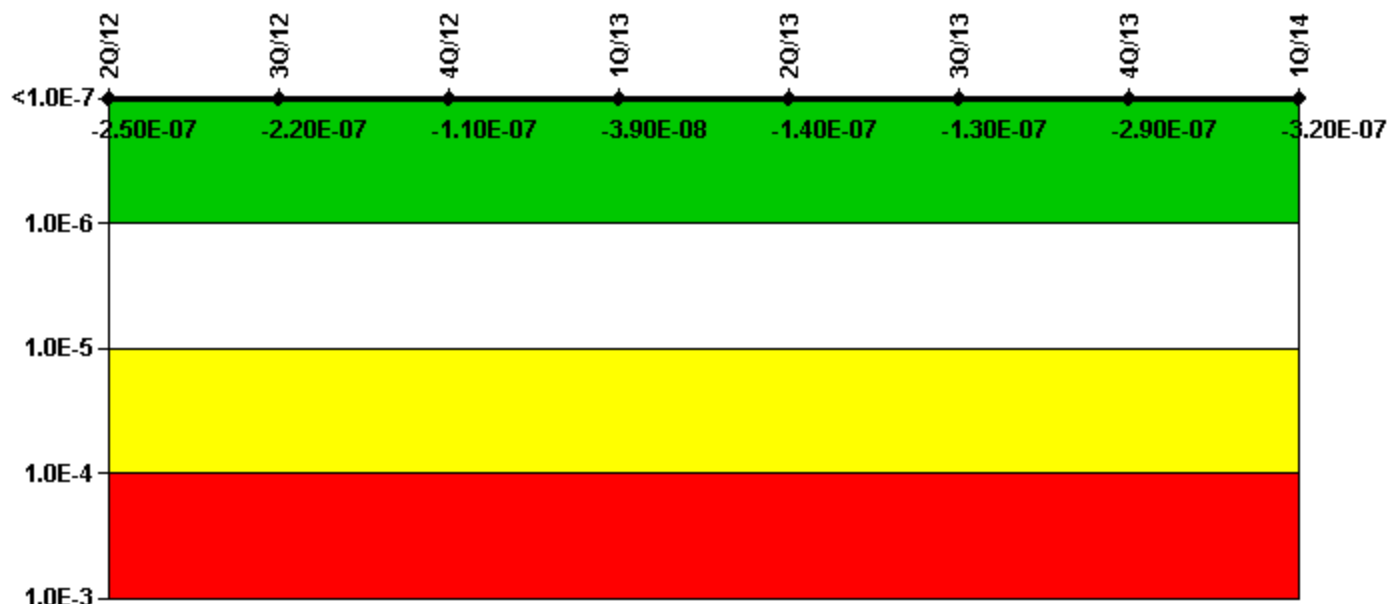

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (ΔCDF)	1.77E-08	1.65E-08	1.64E-08	7.00E-08	7.50E-08	7.68E-08	3.96E-08	4.04E-09
URI (ΔCDF)	-2.63E-07	-2.41E-07	-1.24E-07	-1.09E-07	-2.17E-07	-2.05E-07	-3.26E-07	-3.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-07	-2.20E-07	-1.10E-07	-3.90E-08	-1.40E-07	-1.30E-07	-2.90E-07	-3.20E-07

Licensee Comments:


4Q/12: Changed PRA Parameter(s).

4Q/12: Changed PRA Parameter(s).

3Q/12: Changed PRA Parameter(s).

2Q/12: Changed PRA Parameter(s). Byron PRA Model Revision No: 6BB011a approved March 29, 2012, revised Unit 1 and Unit 2 PRA inputs due to a periodic PRA model update. This included new data analysis, new HRA dependency analysis, and new pre-initiator HRA. This update also removed credit for operator action to crosstie AFW. Based on the previous change to the station operating procedures credit for opposite unit DG, CC and SX systems was removed.

Mitigating Systems Performance Index, High Pressure Injection System

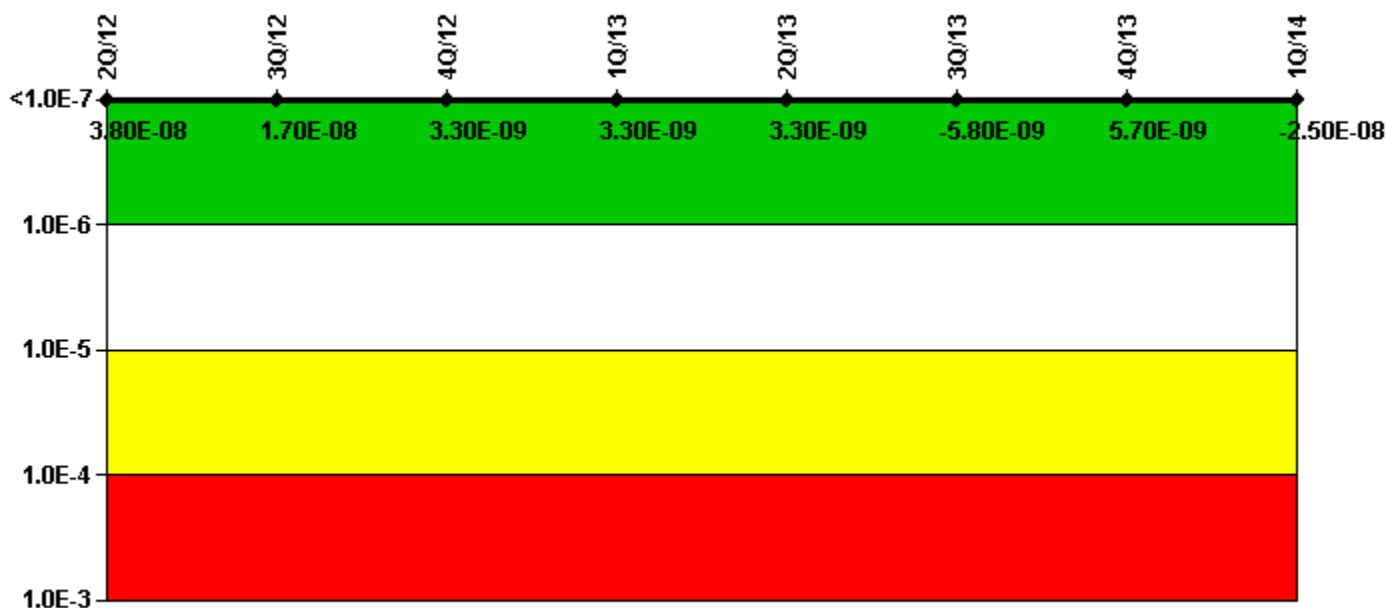

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	4.46E-08	2.36E-08	1.26E-08	1.26E-08	1.26E-08	3.49E-09	1.50E-08	-1.54E-08
URI (Δ CDF)	-6.18E-09	-6.18E-09	-9.27E-09	-9.27E-09	-9.27E-09	-9.27E-09	-9.27E-09	-9.27E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.80E-08	1.70E-08	3.30E-09	3.30E-09	3.30E-09	-5.80E-09	5.70E-09	-2.50E-08

Licensee Comments:


4Q/12: Changed PRA Parameter(s).

4Q/12: Changed PRA Parameter(s).

3Q/12: Changed PRA Parameter(s).

2Q/12: Changed PRA Parameter(s). Byron PRA Model Revision No: 6BB011a approved March 29, 2012, revised Unit 1 and Unit 2 PRA inputs due to a periodic PRA model update. This included new data analysis, new HRA dependency analysis, and new pre-initiator HRA. This update also removed credit for operator action to crosstie AFW. Based on the previous change to the station operating procedures credit for opposite unit DG, CC and SX systems was removed.

Mitigating Systems Performance Index, Heat Removal System

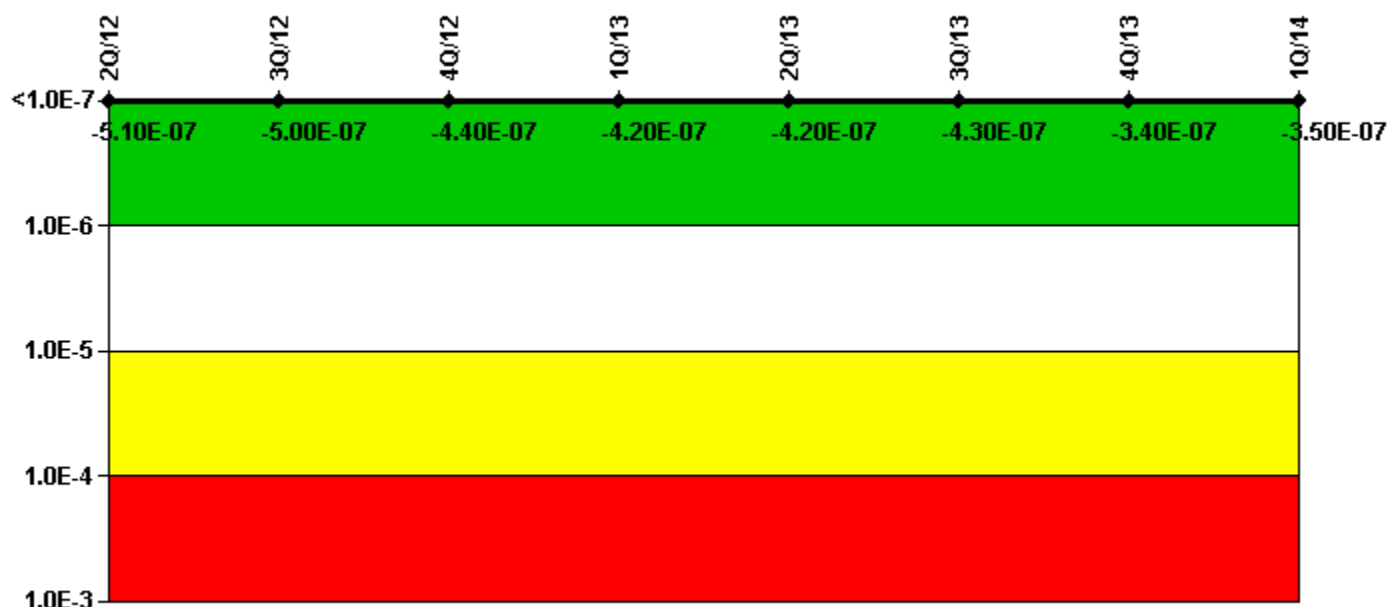

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-9.20E-08	-9.20E-08	-5.91E-08	-4.31E-08	-4.08E-08	-4.11E-08	4.25E-08	4.24E-08
URI (Δ CDF)	-4.21E-07	-4.12E-07	-3.82E-07	-3.82E-07	-3.82E-07	-3.85E-07	-3.87E-07	-3.92E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.10E-07	-5.00E-07	-4.40E-07	-4.20E-07	-4.20E-07	-4.30E-07	-3.40E-07	-3.50E-07

Licensee Comments:

1Q/13: U1-U2 Train A Cross-tie considered unavailable starting on 10/28/2011 when standing order 11-057 and 1/2BFR H.1 procedure revisions were issued to remove procedural guidance on use of the crosstie modification pending NRC approval. Reference IR#01257908.


4Q/12: Changed PRA Parameter(s).

4Q/12: Changed PRA Parameter(s).

3Q/12: Changed PRA Parameter(s).

2Q/12: Changed PRA Parameter(s). Byron PRA Model Revision No: 6BB011a approved March 29, 2012, revised Unit 1 and Unit 2 PRA inputs due to a periodic PRA model update. This included new data analysis, new HRA dependency analysis, and new pre-initiator HRA. This update also removed credit for operator action to crosstie AFW. Based on the previous change to the station operating procedures credit for opposite unit DG, CC and SX systems was removed.

Mitigating Systems Performance Index, Residual Heat Removal System

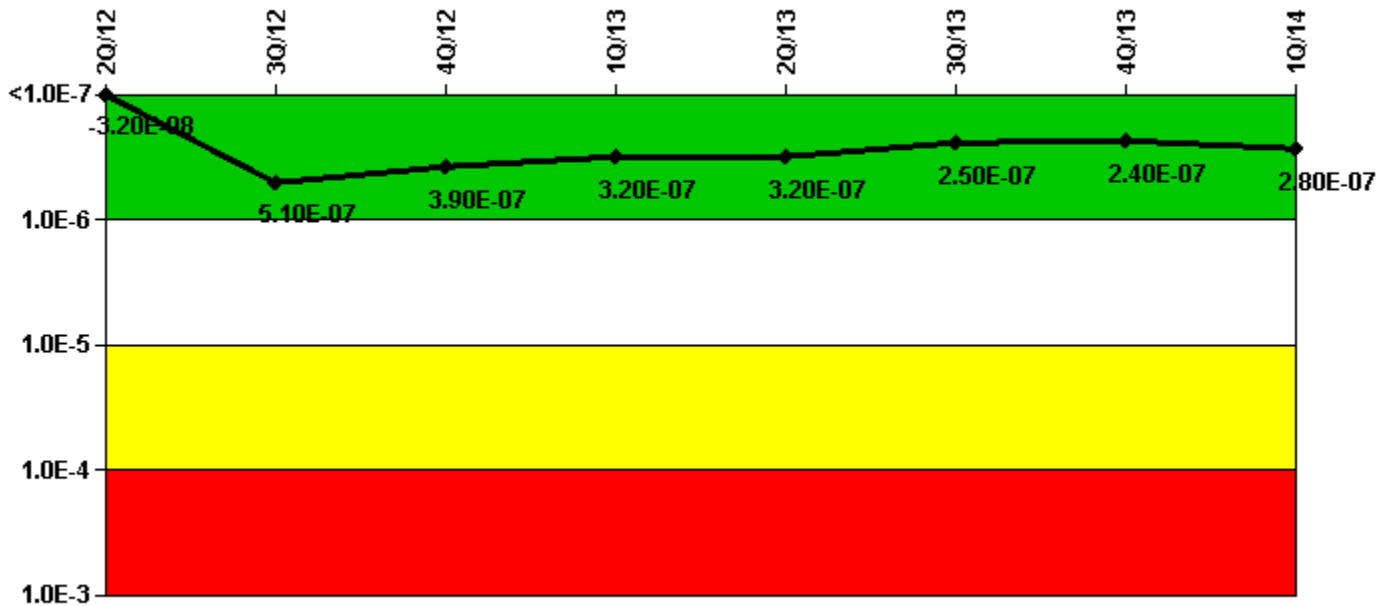

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (ΔCDF)	9.87E-08	1.86E-07	1.21E-07	5.14E-08	5.14E-08	-2.32E-08	-3.33E-08	9.21E-09
URI (ΔCDF)	-1.31E-07	3.27E-07	2.69E-07	2.69E-07	2.69E-07	2.69E-07	2.69E-07	2.69E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.20E-08	5.10E-07	3.90E-07	3.20E-07	3.20E-07	2.50E-07	2.40E-07	2.80E-07

Licensee Comments:


4Q/12: Changed PRA Parameter(s).

4Q/12: Changed PRA Parameter(s).

3Q/12: Changed PRA Parameter(s).

2Q/12: Changed PRA Parameter(s). Byron PRA Model Revision No: 6BB011a approved March 29, 2012, revised Unit 1 and Unit 2 PRA inputs due to a periodic PRA model update. This included new data analysis, new HRA dependency analysis, and new pre-initiator HRA. This update also removed credit for operator action to crosstie AFW. Based on the previous change to the station operating procedures credit for opposite unit DG, CC and SX systems was removed.

Mitigating Systems Performance Index, Cooling Water Systems

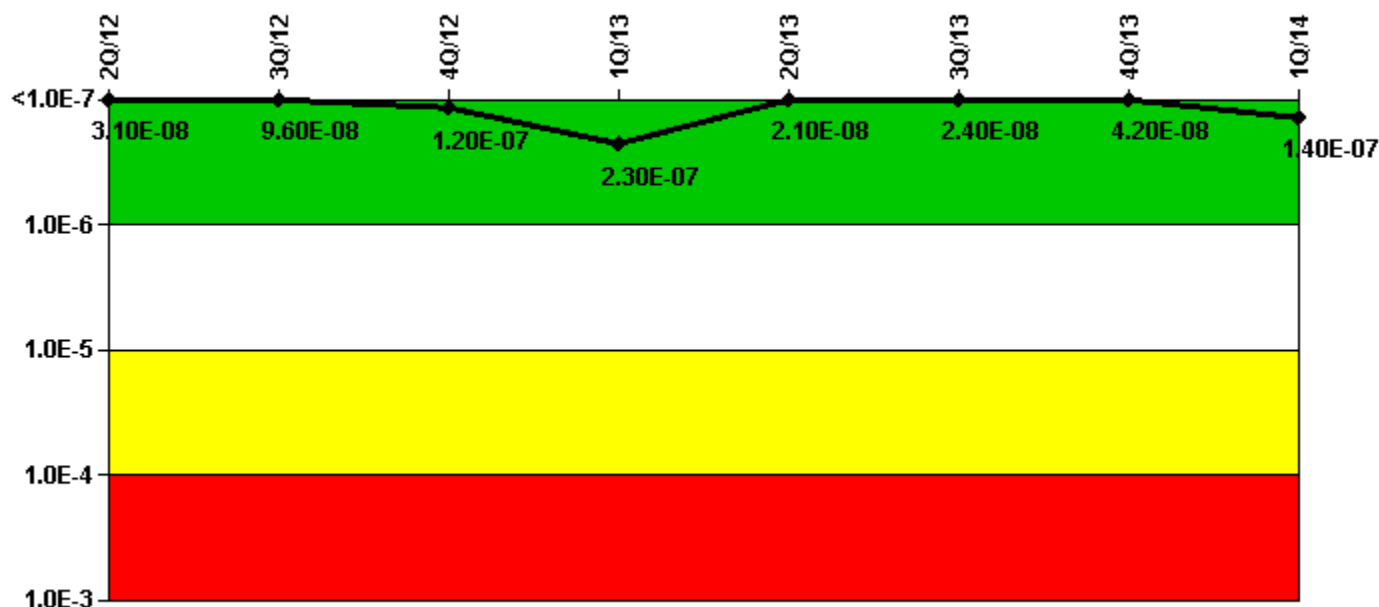

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (ΔCDF)	3.76E-07	3.01E-07	1.63E-07	2.66E-07	4.86E-08	4.56E-08	5.74E-08	1.54E-07
URI (ΔCDF)	-3.45E-07	-2.04E-07	-3.78E-08	-3.26E-08	-2.72E-08	-2.16E-08	-1.58E-08	-9.92E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.10E-08	9.60E-08	1.20E-07	2.30E-07	2.10E-08	2.40E-08	4.20E-08	1.40E-07

Licensee Comments:

2Q/13: Changed PRA Parameter(s).

1Q/13: Planned work windows

4Q/12: Changed PRA Parameter(s).


4Q/12: Changed PRA Parameter(s).

3Q/12: Changed PRA Parameter(s).

2Q/12: Changed PRA Parameter(s). Byron PRA Model Revision No: 6BB011a approved March 29, 2012, revised Unit 1 and Unit 2 PRA inputs due to a periodic PRA model update. This included new data analysis, new HRA dependency analysis, and new pre-initiator HRA. This update also removed credit for operator action to crosstie AFW. Based on the previous change to the station operating procedures credit for opposite unit DG, CC and SX systems was removed.

2Q/12: Changed PRA Parameter(s). Byron PRA Model Revision No: 6BB011a approved March 29, 2012, revised Unit 1 and Unit 2 PRA inputs due to a periodic PRA model update. This included new data analysis, new HRA dependency analysis, and new pre-initiator HRA. This update also removed credit for operator action to crosstie AFW. Based on the previous change to the station operating procedures credit for opposite unit DG, CC and SX systems was removed.

Reactor Coolant System Activity

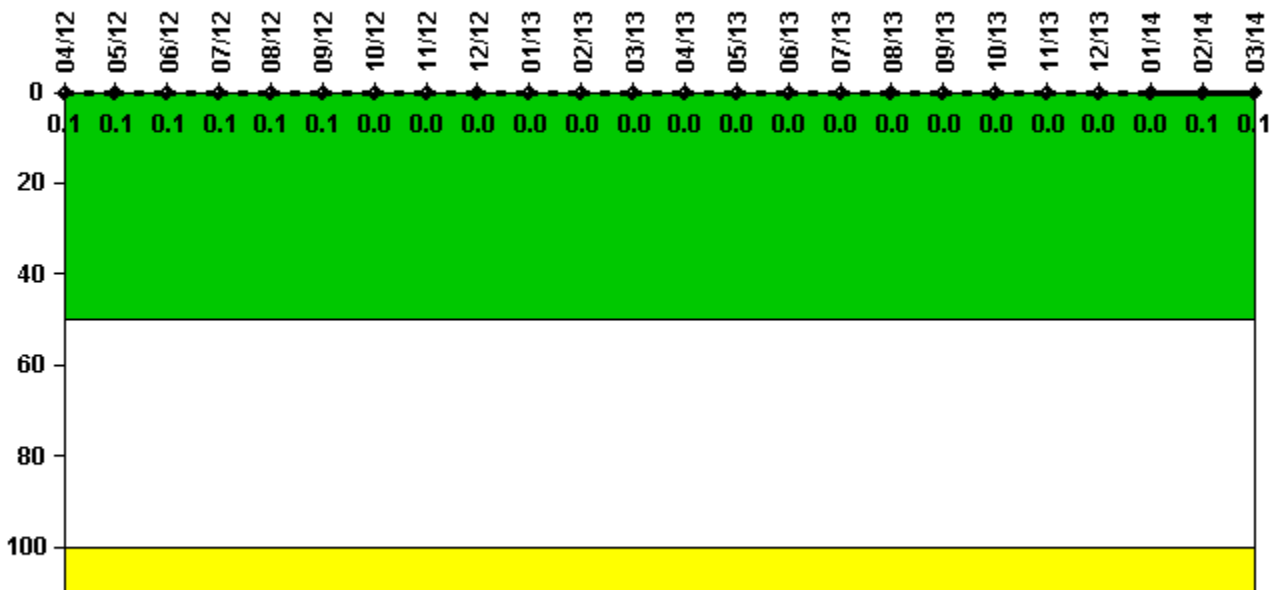

Thresholds: White > 50.0 Yellow > 100.0

Notes


--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

1Q/2014 Performance Indicators - Byron 1

Reactor Coolant System Activity	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum activity	0.000532	0.000562	0.000573	0.000595	0.000603	0.000594	0.000220	0.000238	0.000252	0.000265	0.000284	0.000300
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0	0	0	0	0	0
Reactor Coolant System Activity	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum activity	0.000307	0.000335	0.000360	0.000367	0.000392	0.000406	0.000418	0.000436	0.000453	0.000474	0.000504	0.000506
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

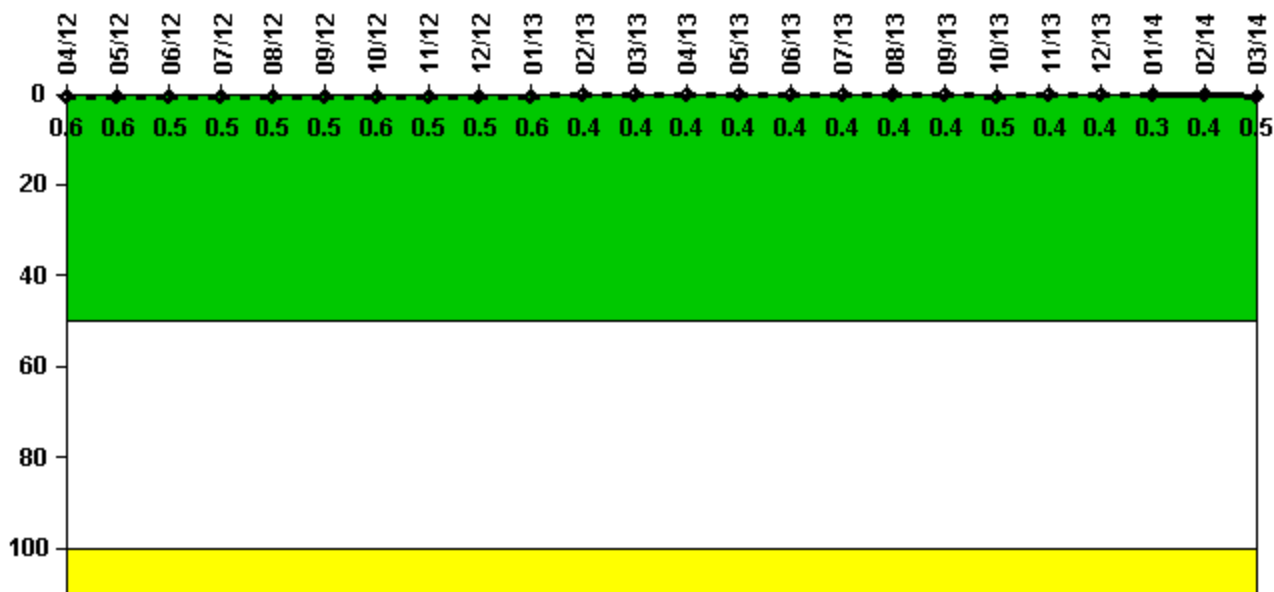


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum leakage	0.060	0.060	0.050	0.050	0.050	0.050	0.060	0.050	0.050	0.060	0.040	0.040
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.6	0.5	0.5	0.5	0.5	0.6	0.5	0.5	0.6	0.4	0.4
Reactor Coolant System Leakage	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum leakage	0.040	0.040	0.040	0.040	0.040	0.040	0.050	0.040	0.040	0.030	0.040	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.4	0.4	0.4	0.4	0.4	0.5	0.4	0.4	0.3	0.4	0.5

Licensee Comments: none

Drill/Exercise Performance

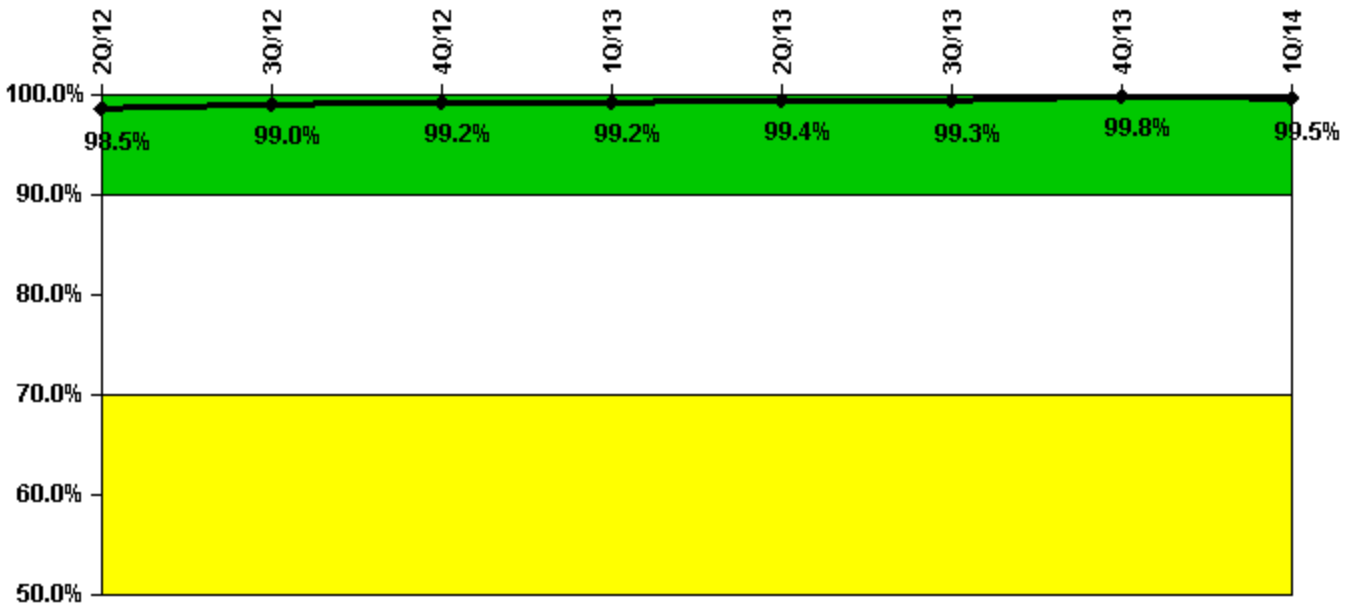


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful opportunities	126.0	24.0	3.0	104.0	12.0	55.0	32.0	62.0
Total opportunities	126.0	24.0	3.0	104.0	12.0	55.0	32.0	64.0
Indicator value	98.5%	99.0%	99.2%	99.2%	99.4%	99.3%	99.8%	99.5%

Licensee Comments: none

ERO Drill Participation

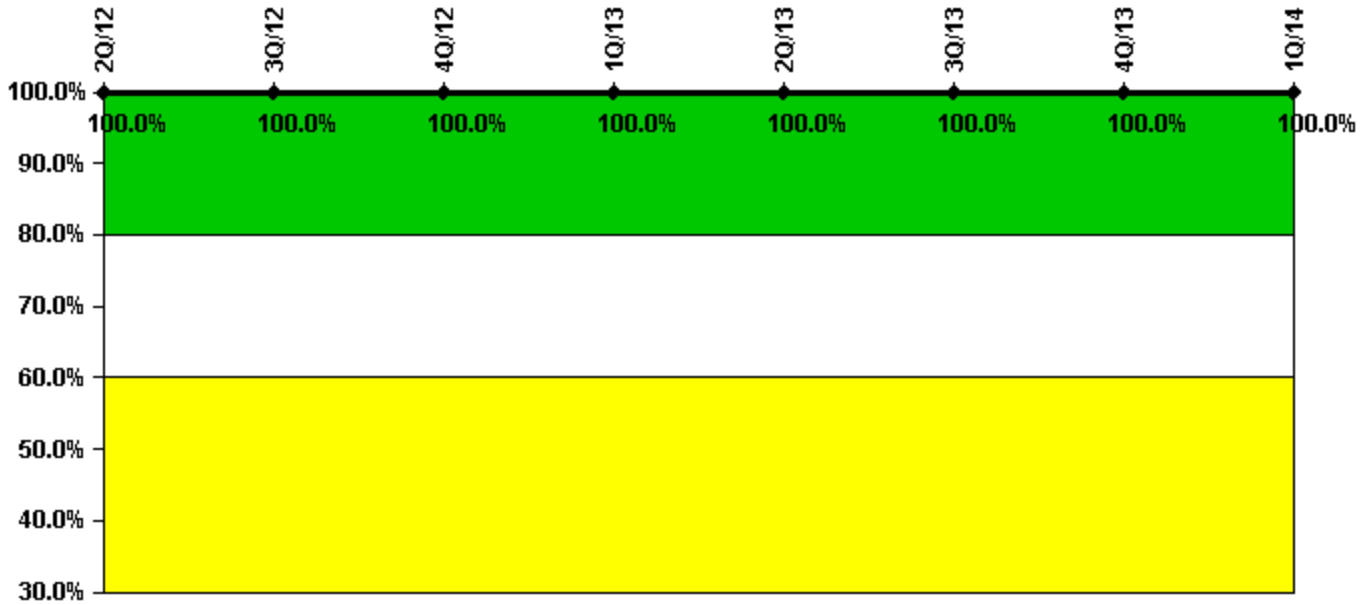


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Participating Key personnel	77.0	78.0	78.0	78.0	76.0	71.0	74.0	77.0
Total Key personnel	77.0	78.0	78.0	78.0	76.0	71.0	74.0	77.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

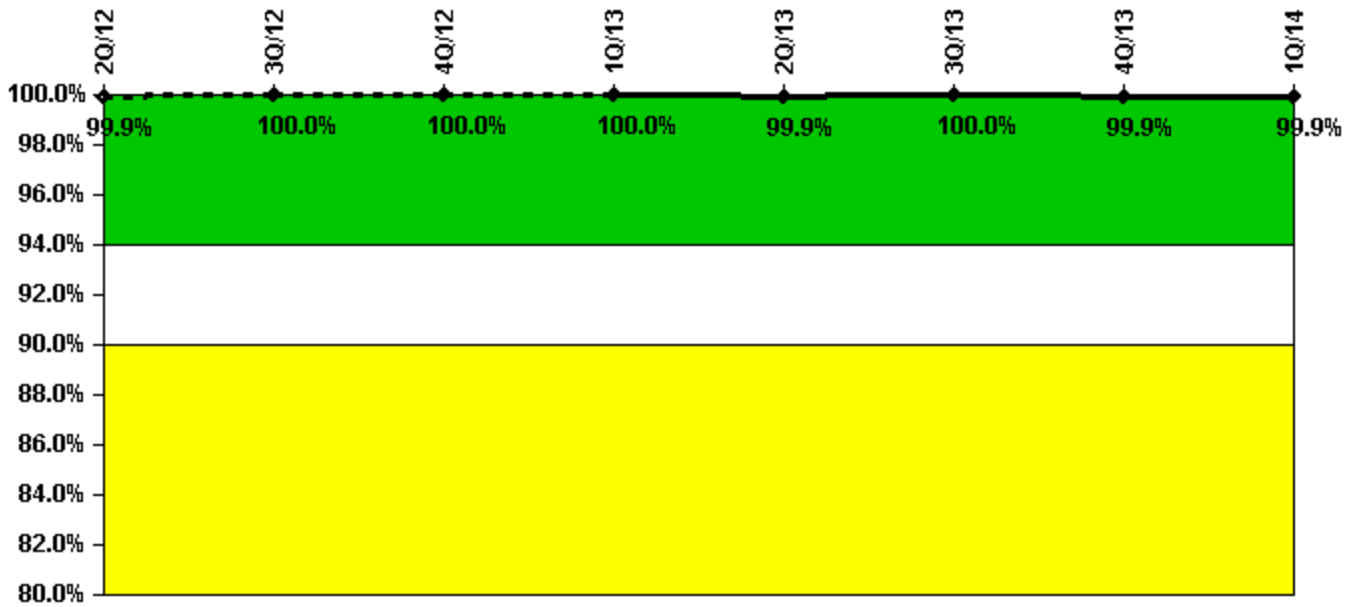


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful siren-tests	3903	3841	3904	3902	3900	3903	3900	3841
Total sirens-tests	3904	3843	3904	3904	3904	3904	3904	3843
Indicator value	99.9%	100.0%	100.0%	100.0%	99.9%	100.0%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

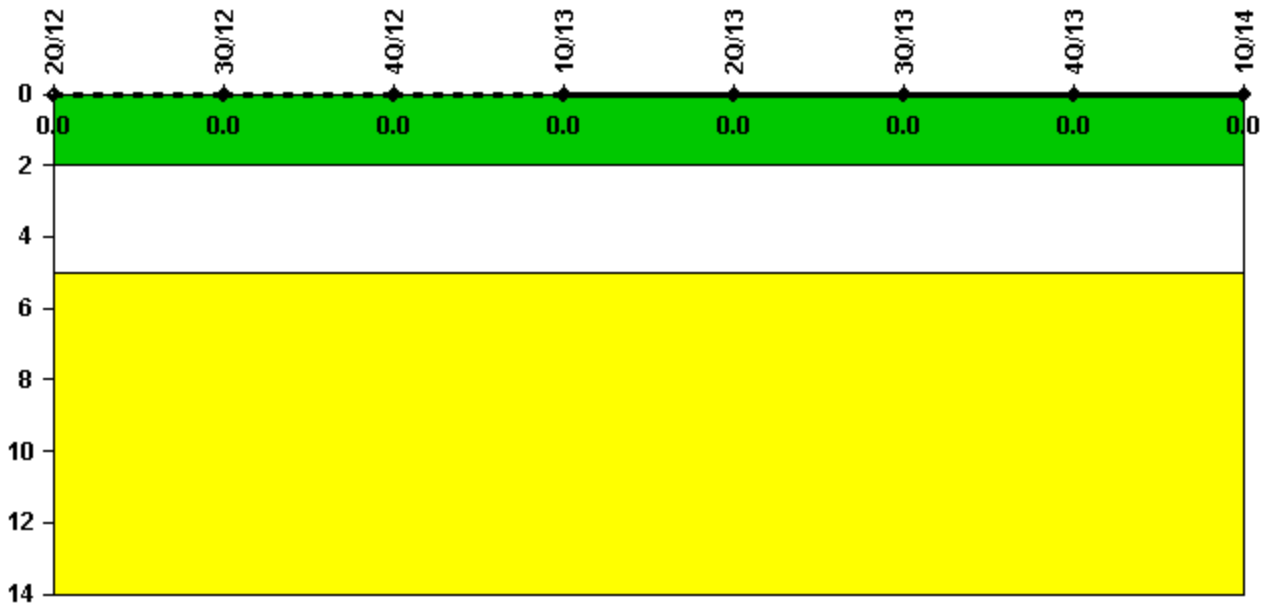


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

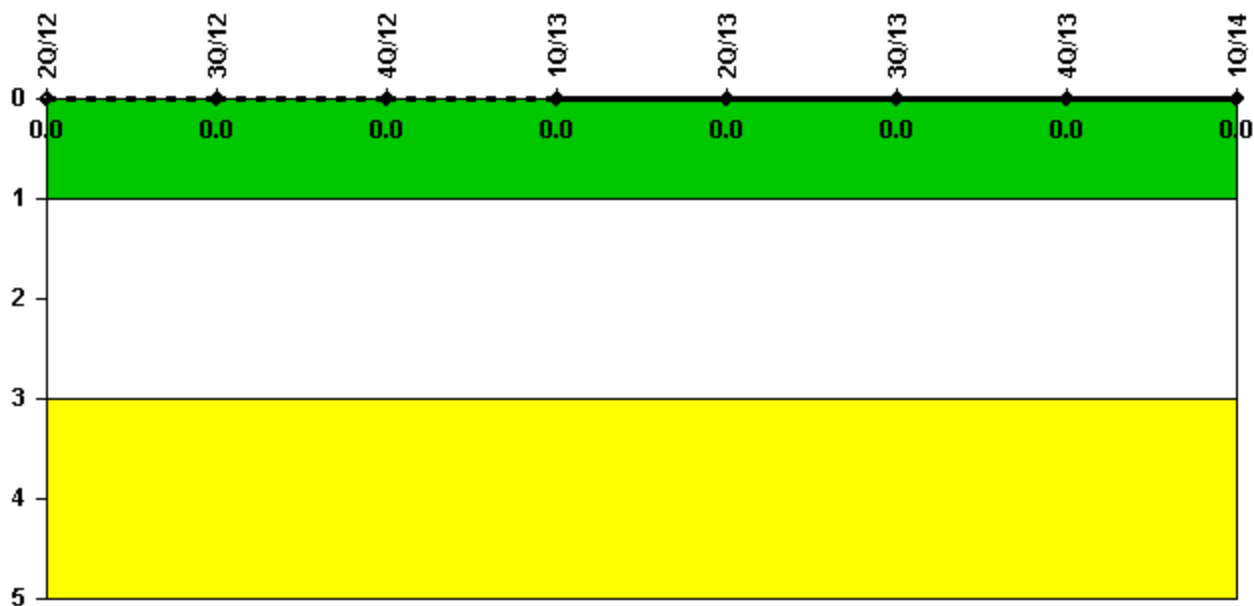

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2014