


Harris 1

1Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: Corrected data has been submitted for Drill Exercise & Event Opportunities for the month of October 2012. No color shift.

Unplanned Scrams per 7000 Critical Hrs

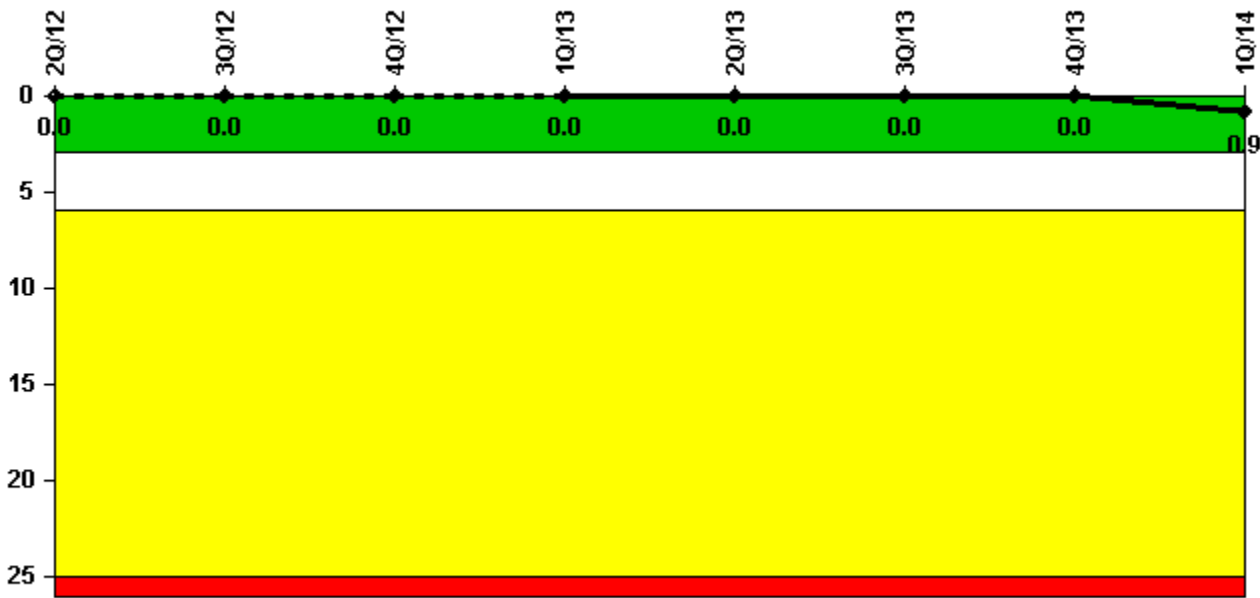

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned scrams	0	0	0	0	0	0	0	1.0
Critical hours	1072.9	2208.0	2209.0	2159.0	1656.8	2208.0	1454.1	2072.6
Indicator value	0	0	0	0	0	0	0	0.9

Licensee Comments:

2Q/12: There was a planned unit shutdown for RFO-17 starting April 21, 2012 and continuing into June 2012.

Unplanned Power Changes per 7000 Critical Hrs

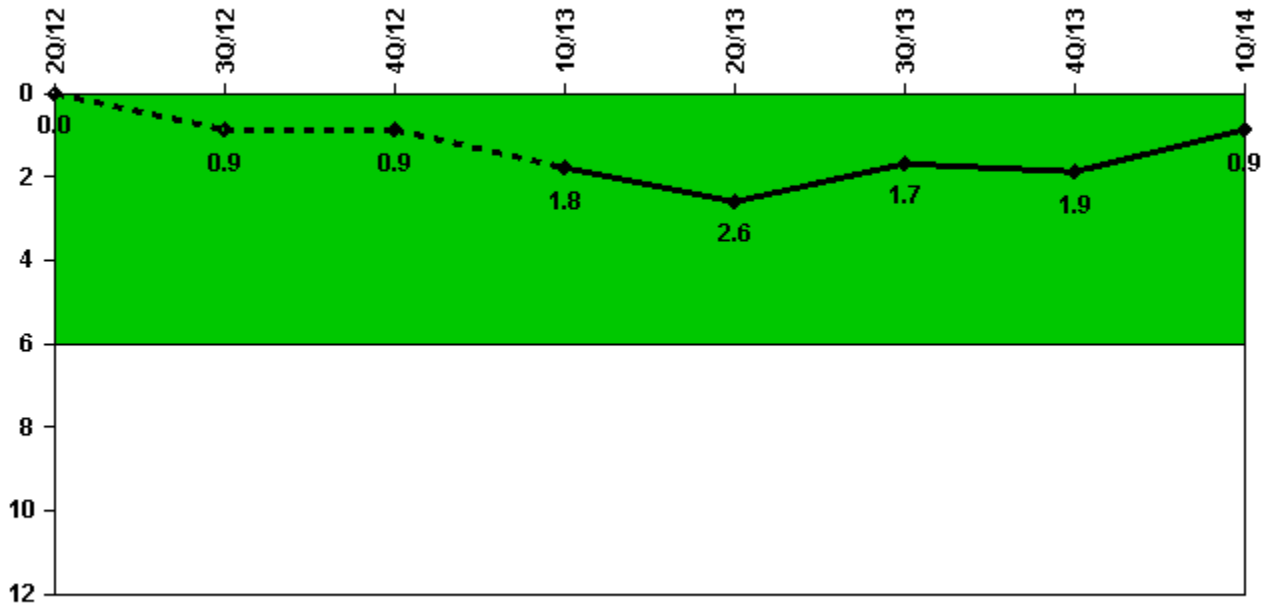

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned power changes	0	1.0	0	1.0	1.0	0	0	0
Critical hours	1072.9	2208.0	2209.0	2159.0	1656.8	2208.0	1454.1	2072.6
Indicator value	0	0.9	0.9	1.8	2.6	1.7	1.9	0.9

Licensee Comments:

2Q/12: There was a planned unit shutdown for RFO-17 starting April 21, 2012 and continuing into June 2012.

Unplanned Scrams with Complications

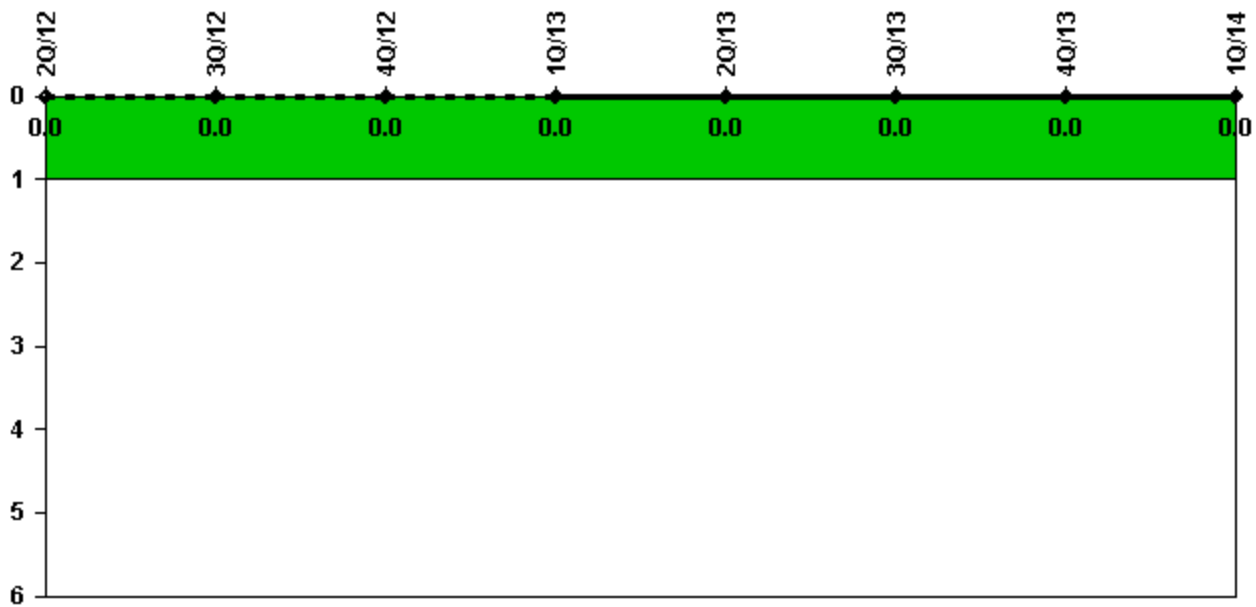

Thresholds: White > 1.0


Notes

Unplanned Scrams with Complications	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments:

2Q/12: There was a planned unit shutdown for RFO-17 starting April 21, 2012 and continuing into June 2012.

Safety System Functional Failures (PWR)

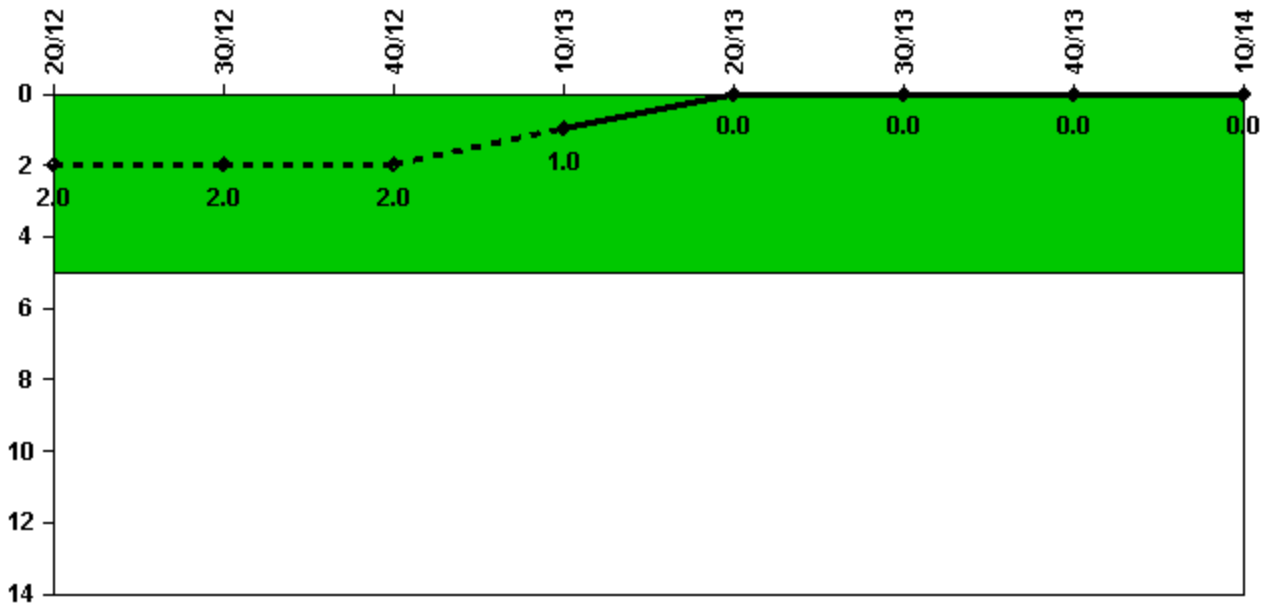

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Safety System Functional Failures	1	0	0	0	0	0	0	0
Indicator value	2	2	2	1	0	0	0	0

Licensee Comments:

2Q/12: One LER (2012-001-00) was submitted for the month of June 2012, which describes a condition where unexpected long-term corrosion of valve piston rings caused delayed closing of Main Steam Isolation Valves.

Mitigating Systems Performance Index, Emergency AC Power System

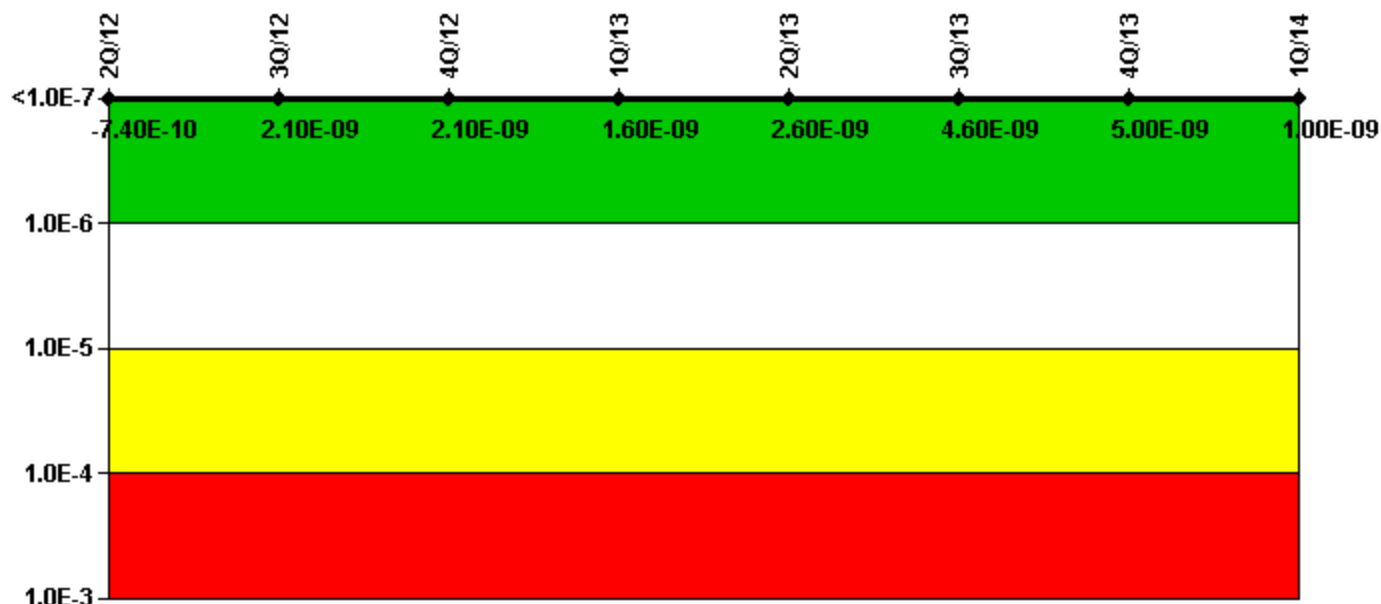


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	1.02E-08	1.27E-08	1.23E-08	1.14E-08	1.21E-08	1.37E-08	1.37E-08	1.08E-08
URI (Δ CDF)	-1.09E-08	-1.06E-08	-1.02E-08	-9.84E-09	-9.46E-09	-9.08E-09	-8.68E-09	-9.73E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.40E-10	2.10E-09	2.10E-09	1.60E-09	2.60E-09	4.60E-09	5.00E-09	1.00E-09

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

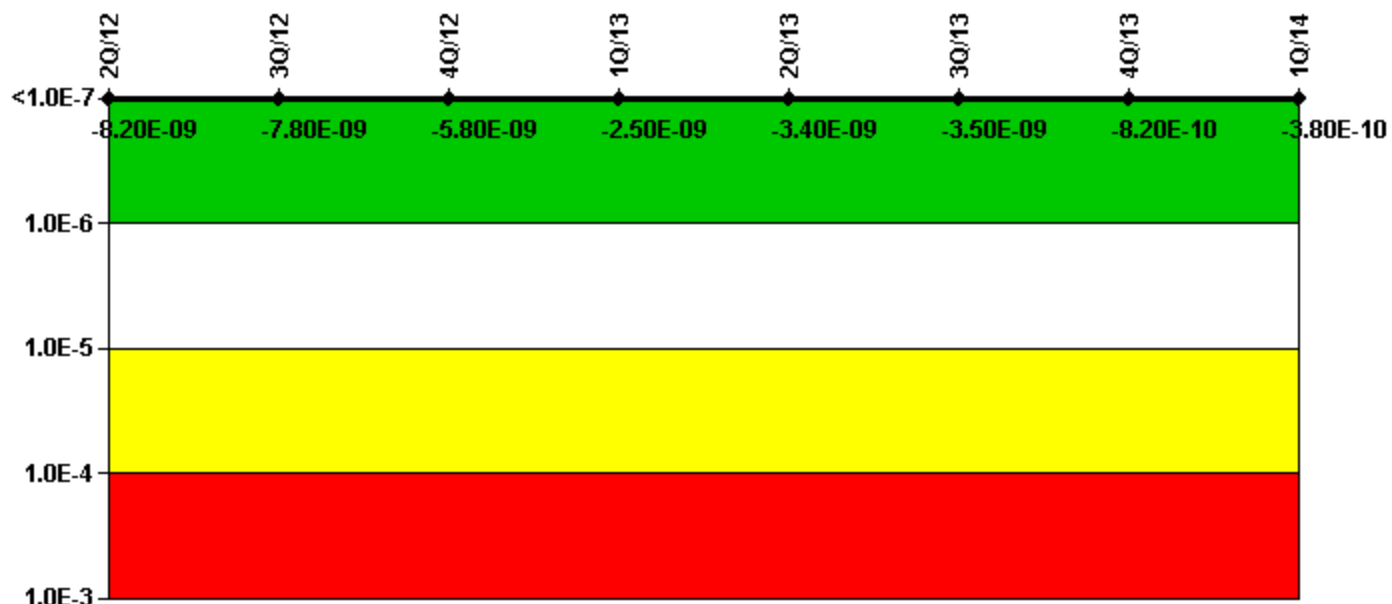


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	2.00E-09	2.28E-09	4.18E-09	7.32E-09	6.40E-09	6.14E-09	8.73E-09	9.06E-09
URI (Δ CDF)	-1.02E-08	-1.01E-08	-9.96E-09	-9.86E-09	-9.76E-09	-9.65E-09	-9.55E-09	-9.44E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.20E-09	-7.80E-09	-5.80E-09	-2.50E-09	-3.40E-09	-3.50E-09	-8.20E-10	-3.80E-10

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

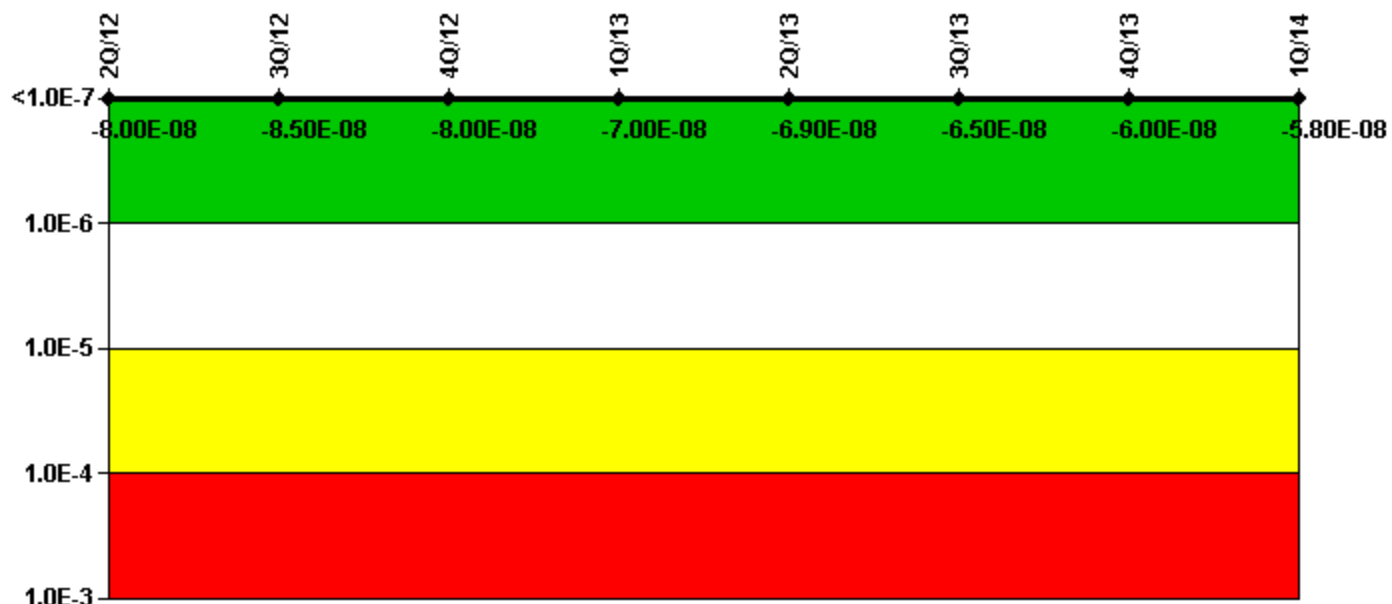


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-6.82E-09	-1.15E-08	-7.34E-09	3.36E-10	1.40E-09	4.23E-09	8.44E-09	9.14E-09
URI (Δ CDF)	-7.36E-08	-7.33E-08	-7.28E-08	-7.07E-08	-7.00E-08	-6.91E-08	-6.80E-08	-6.75E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.00E-08	-8.50E-08	-8.00E-08	-7.00E-08	-6.90E-08	-6.50E-08	-6.00E-08	-5.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

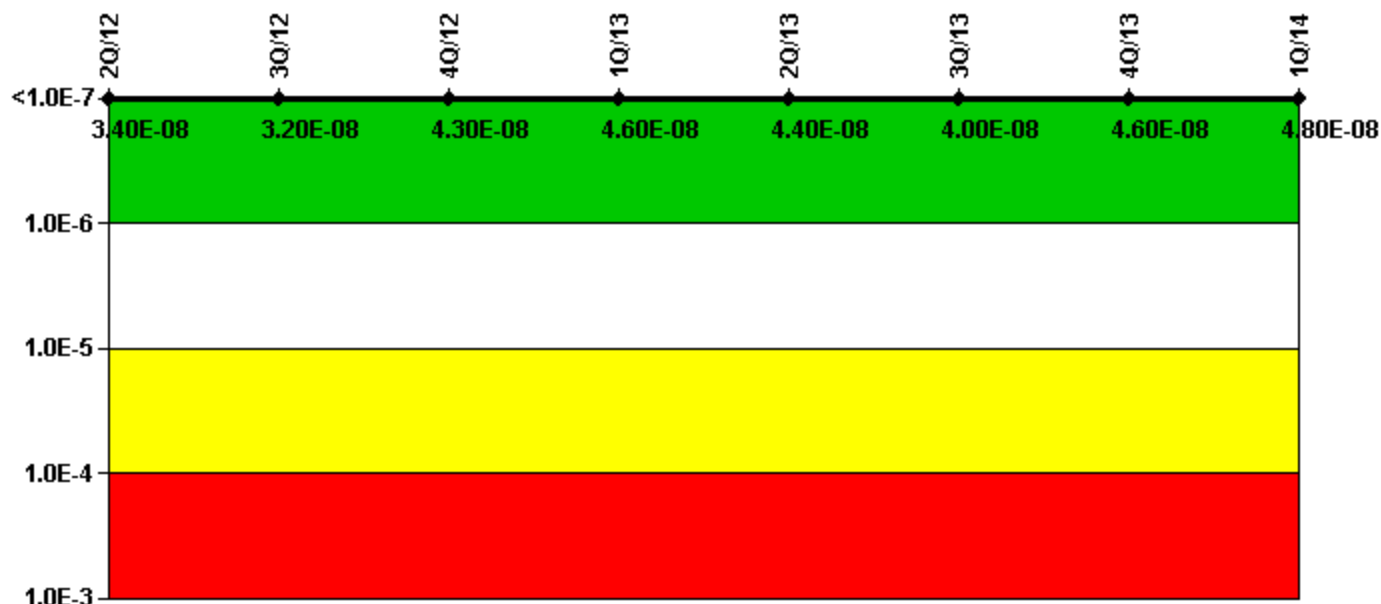


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	1.04E-08	7.45E-09	1.81E-08	2.03E-08	1.81E-08	1.30E-08	1.83E-08	1.98E-08
URI (Δ CDF)	2.37E-08	2.43E-08	2.49E-08	2.55E-08	2.62E-08	2.68E-08	2.75E-08	2.81E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.40E-08	3.20E-08	4.30E-08	4.60E-08	4.40E-08	4.00E-08	4.60E-08	4.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

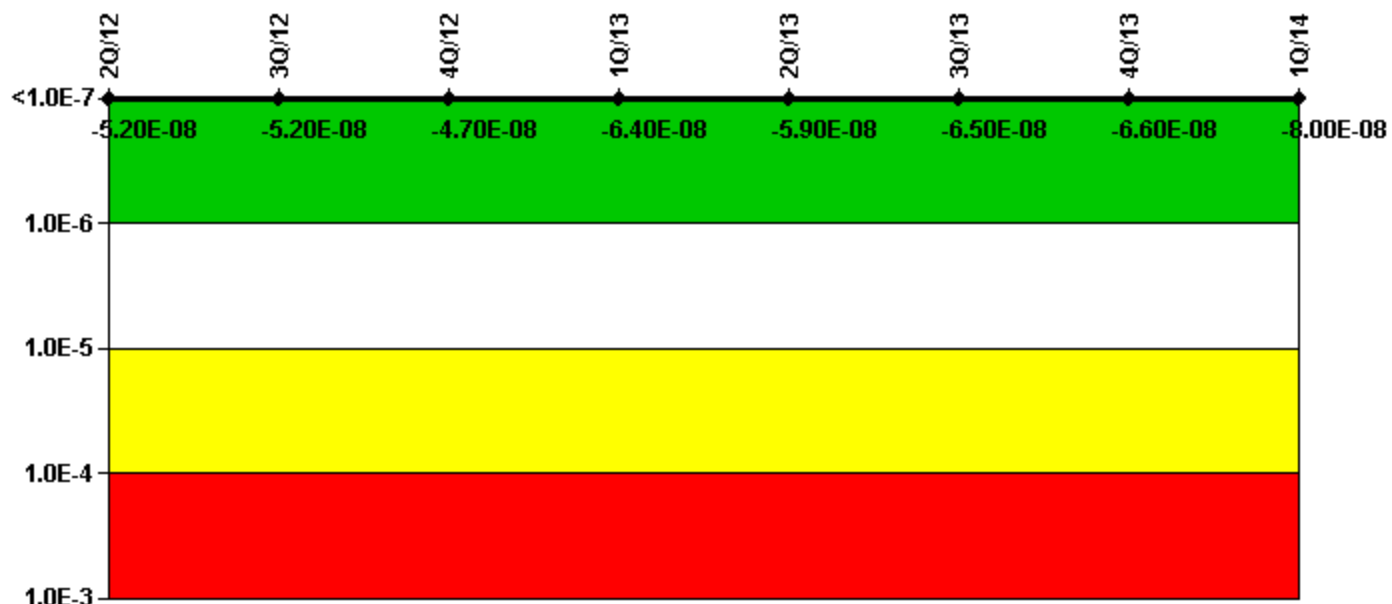


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	5.43E-08	5.38E-08	5.84E-08	4.04E-08	4.60E-08	3.88E-08	3.73E-08	2.31E-08
URI (Δ CDF)	-1.06E-07	-1.06E-07	-1.05E-07	-1.05E-07	-1.04E-07	-1.04E-07	-1.04E-07	-1.03E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.20E-08	-5.20E-08	-4.70E-08	-6.40E-08	-5.90E-08	-6.50E-08	-6.60E-08	-8.00E-08

Licensee Comments: none

Reactor Coolant System Activity

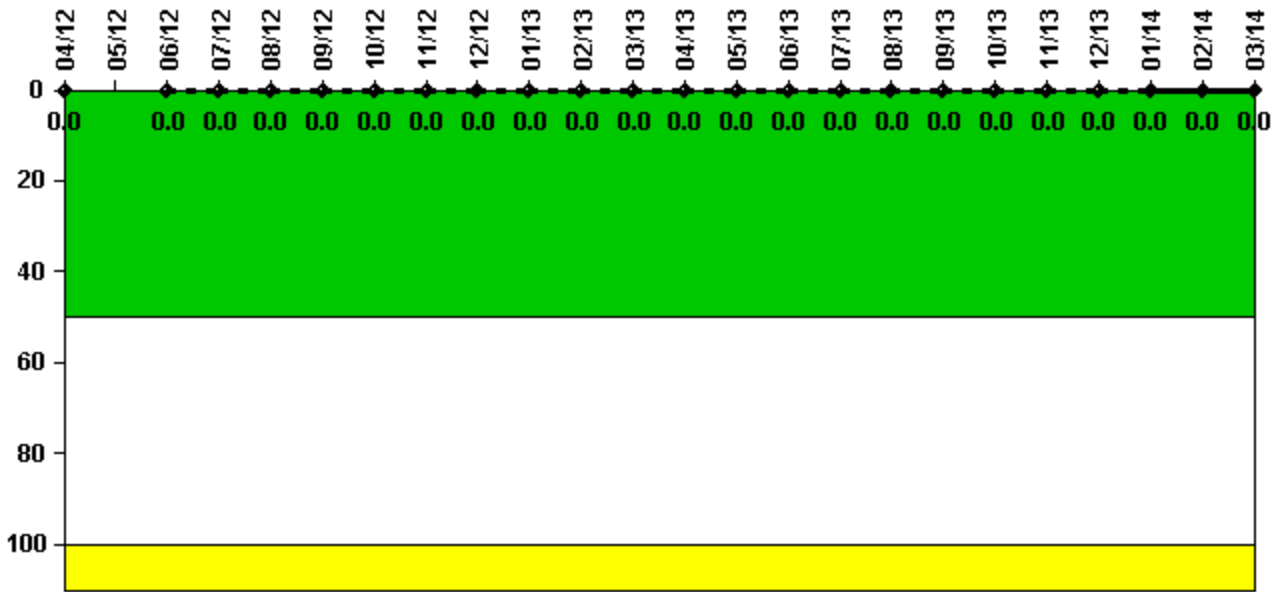

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum activity	0.000253	N/A	0.000049	0.000060	0.000347	0.000074	0.000122	0.000087	0.000146	0.000156	0.000186	0.000130
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	N/A	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum activity	0.000111	0.000111	0.000118	0.000122	0.000125	0.000143	0.000136	0.000136	0.000085	0.000131	0.000105	0.000113
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

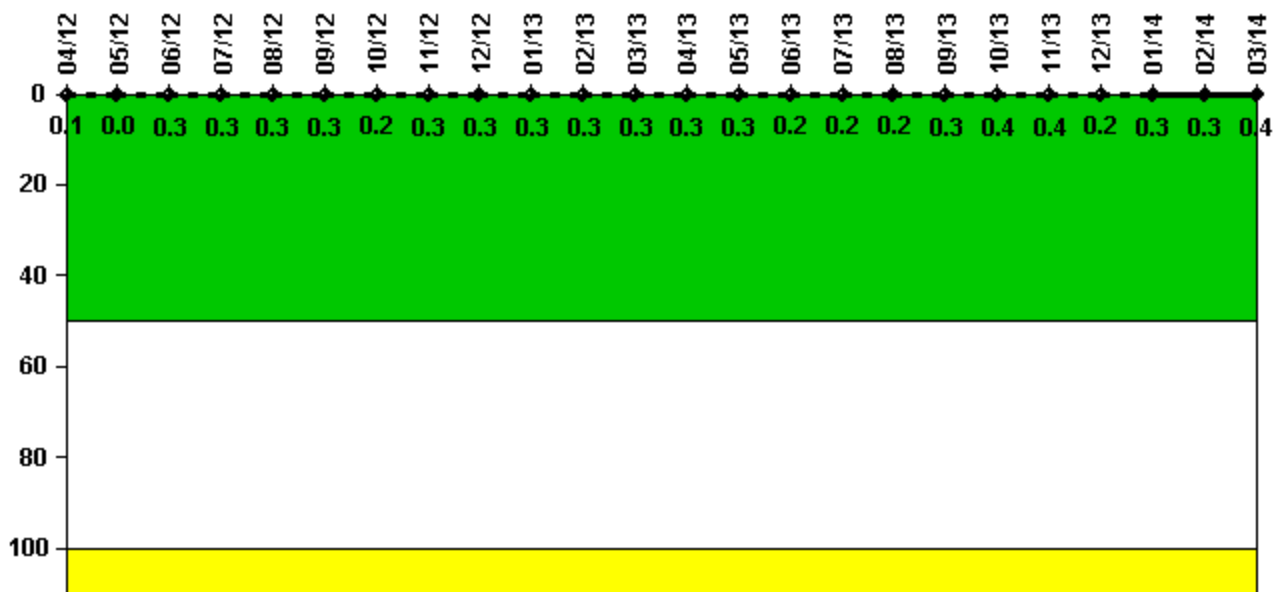


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum leakage	0.014	0	0.026	0.026	0.025	0.027	0.024	0.026	0.026	0.028	0.027	0.027
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0	0.3	0.3	0.3	0.3	0.2	0.3	0.3	0.3	0.3	0.3
Reactor Coolant System Leakage	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum leakage	0.028	0.025	0.023	0.022	0.024	0.029	0.037	0.035	0.024	0.027	0.028	0.037
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.3	0.2	0.2	0.2	0.3	0.4	0.4	0.2	0.3	0.3	0.4

Licensee Comments: none

Drill/Exercise Performance

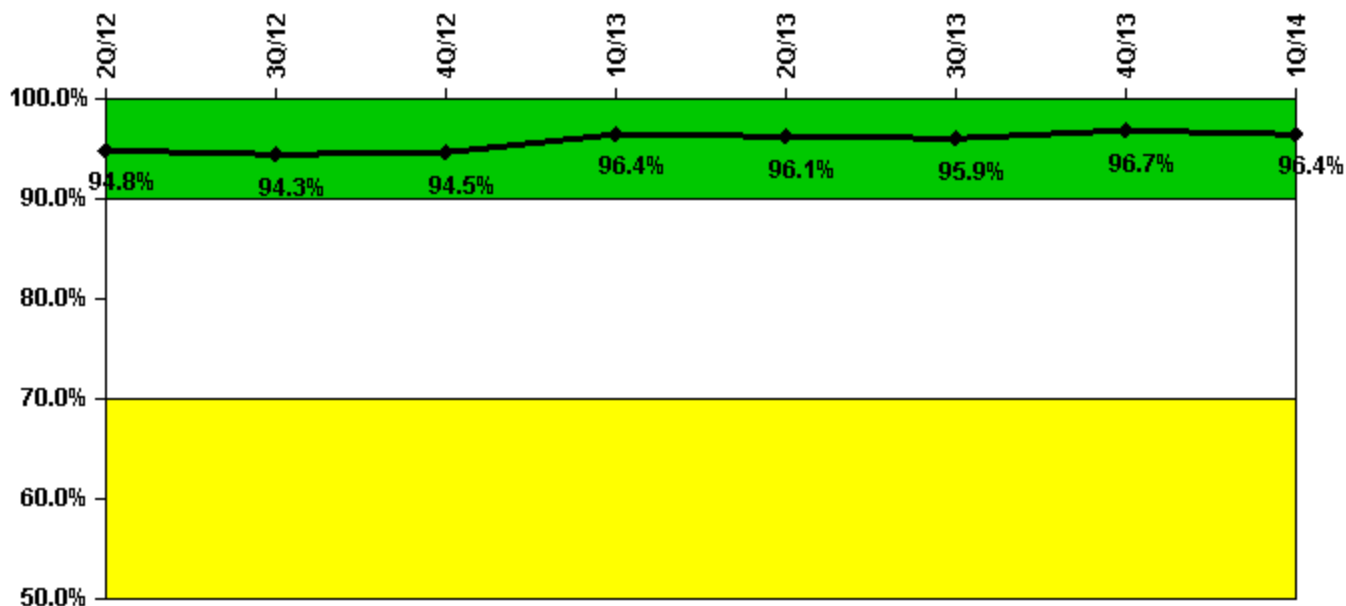


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful opportunities	2.0	43.0	16.0	45.0	9.0	13.0	22.0	40.0
Total opportunities	2.0	46.0	16.0	46.0	10.0	14.0	22.0	41.0
Indicator value	94.8%	94.3%	94.5%	96.4%	96.1%	95.9%	96.7%	96.4%

Licensee Comments: none

ERO Drill Participation

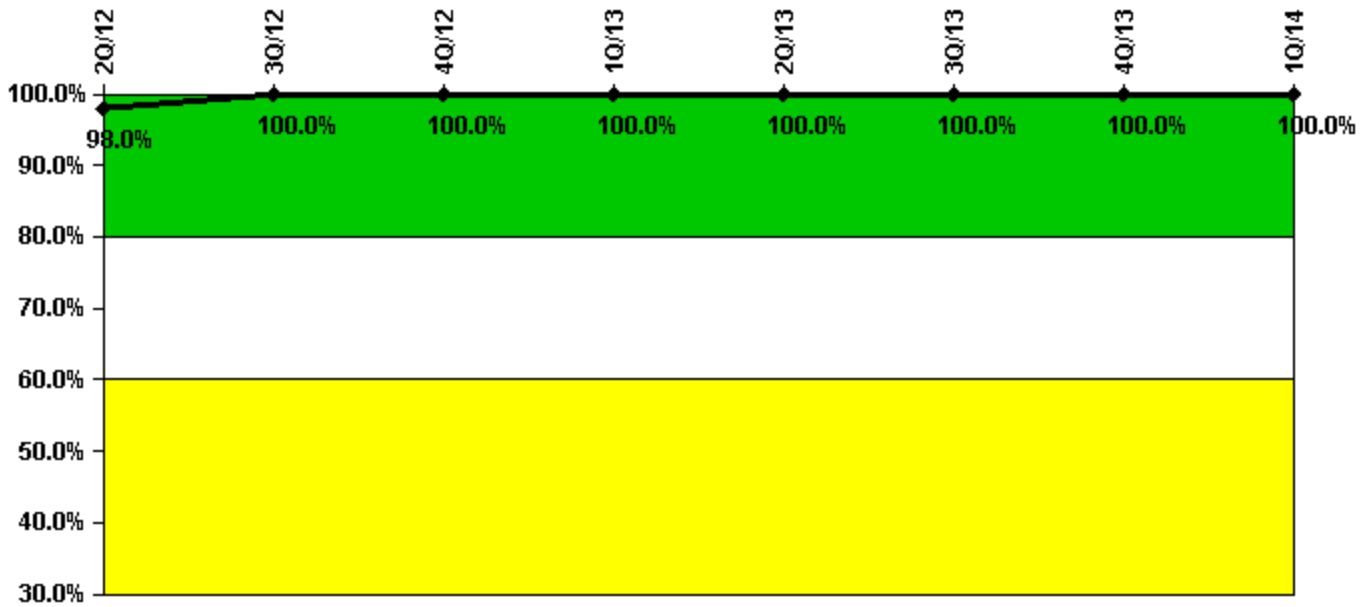


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Participating Key personnel	50.0	50.0	51.0	50.0	50.0	49.0	54.0	44.0
Total Key personnel	51.0	50.0	51.0	50.0	50.0	49.0	54.0	44.0
Indicator value	98.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

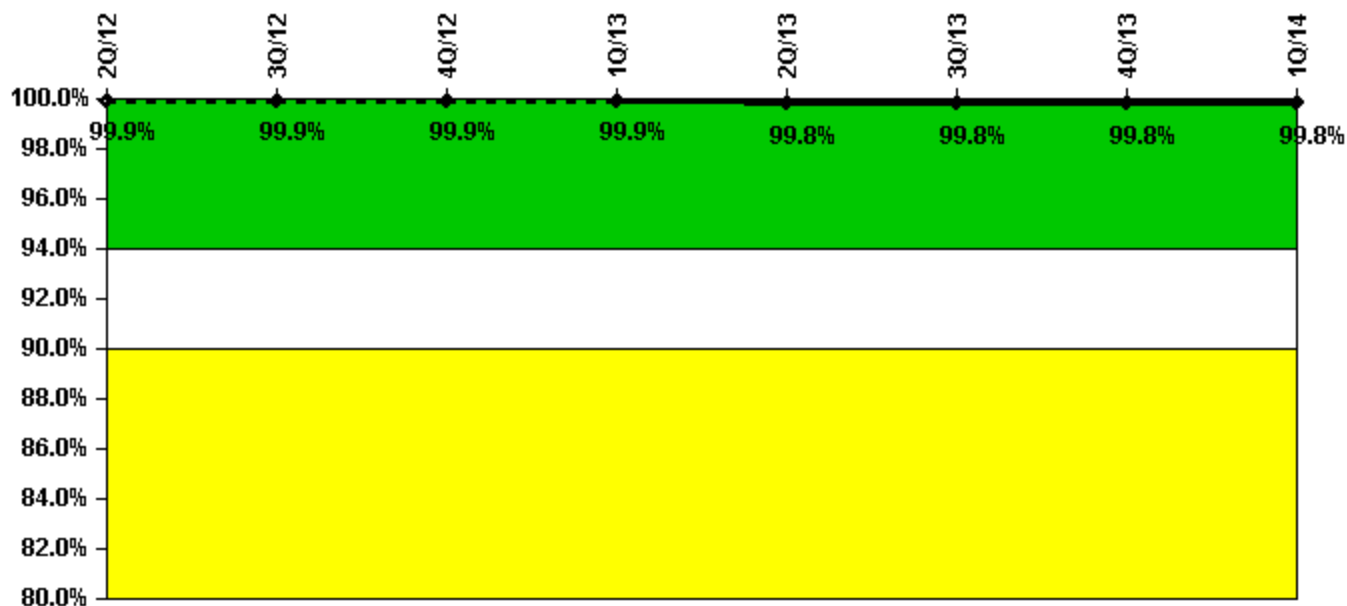


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful siren-tests	581	746	580	664	579	746	663	581
Total sirens-tests	581	747	581	664	581	747	664	581
Indicator value	99.9%	99.9%	99.9%	99.9%	99.8%	99.8%	99.8%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

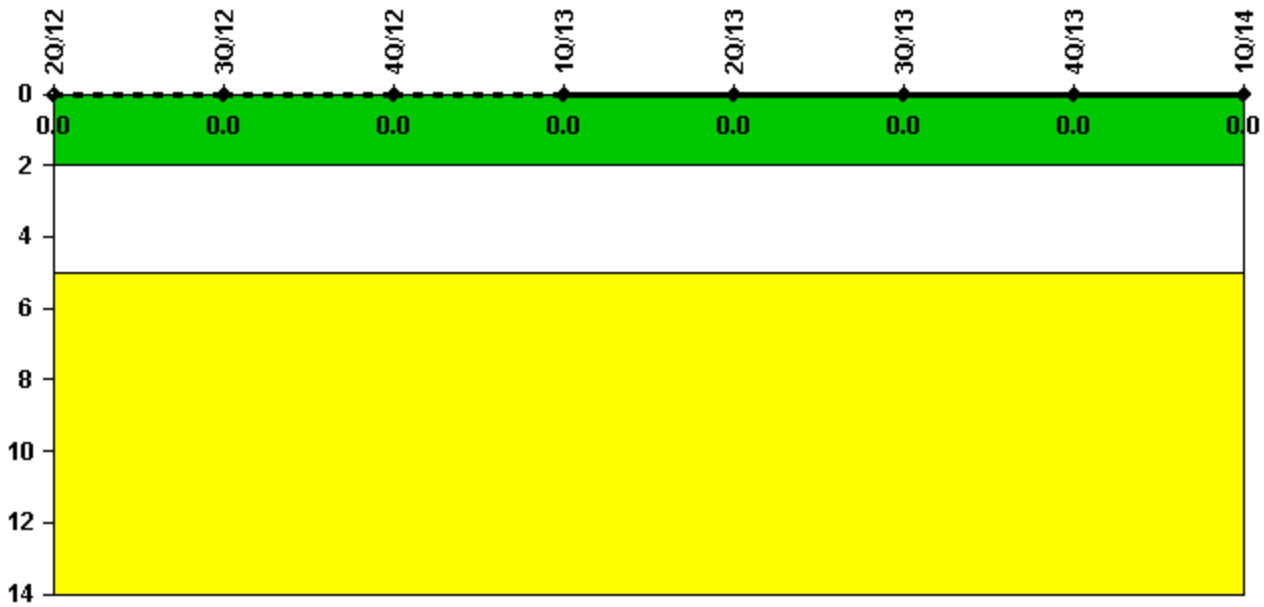


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

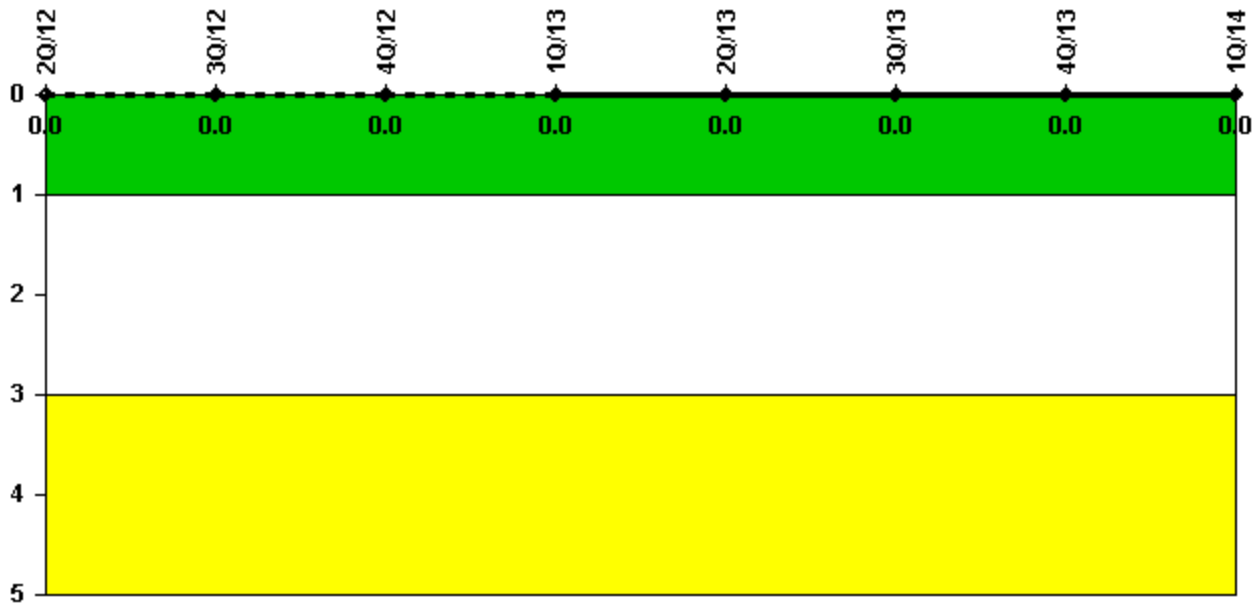

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2014