


Peach Bottom 2

1Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: Change report update applies to MS10 4Q2013 forward. This correction did not result in a threshold exceeded or change of color.

Unplanned Scrams per 7000 Critical Hrs

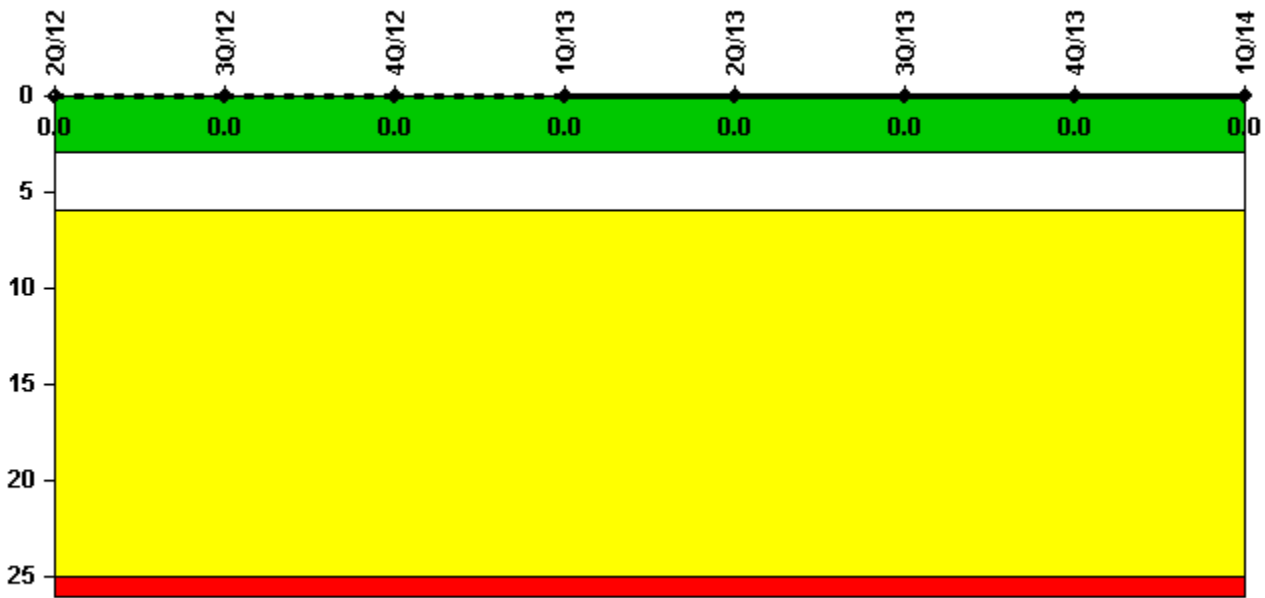


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2184.0	1701.9	1797.6	2159.0	2184.0	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

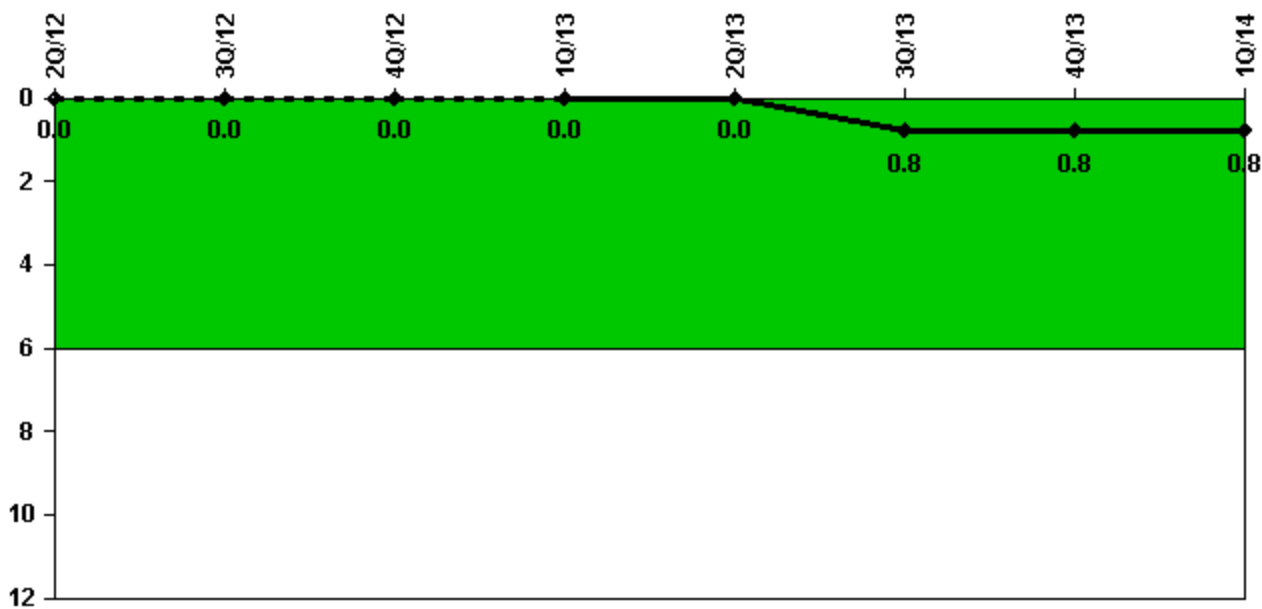


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned power changes	0	0	0	0	0	1.0	0	0
Critical hours	2184.0	1701.9	1797.6	2159.0	2184.0	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0	0.8	0.8	0.8

Licensee Comments: none

Unplanned Scrams with Complications

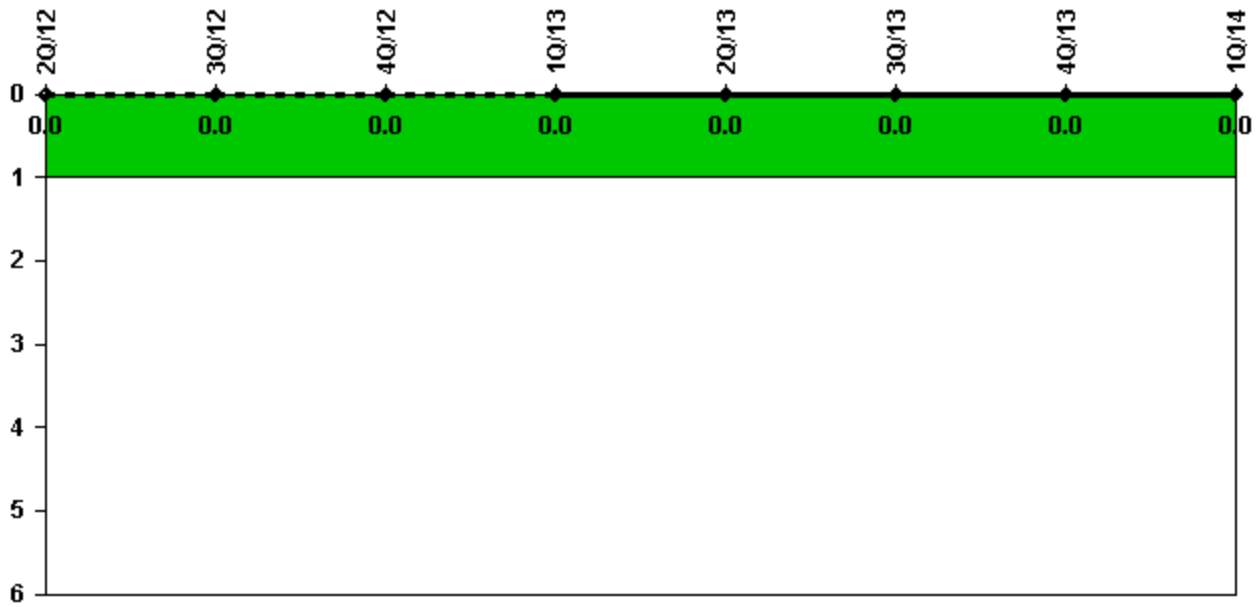


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

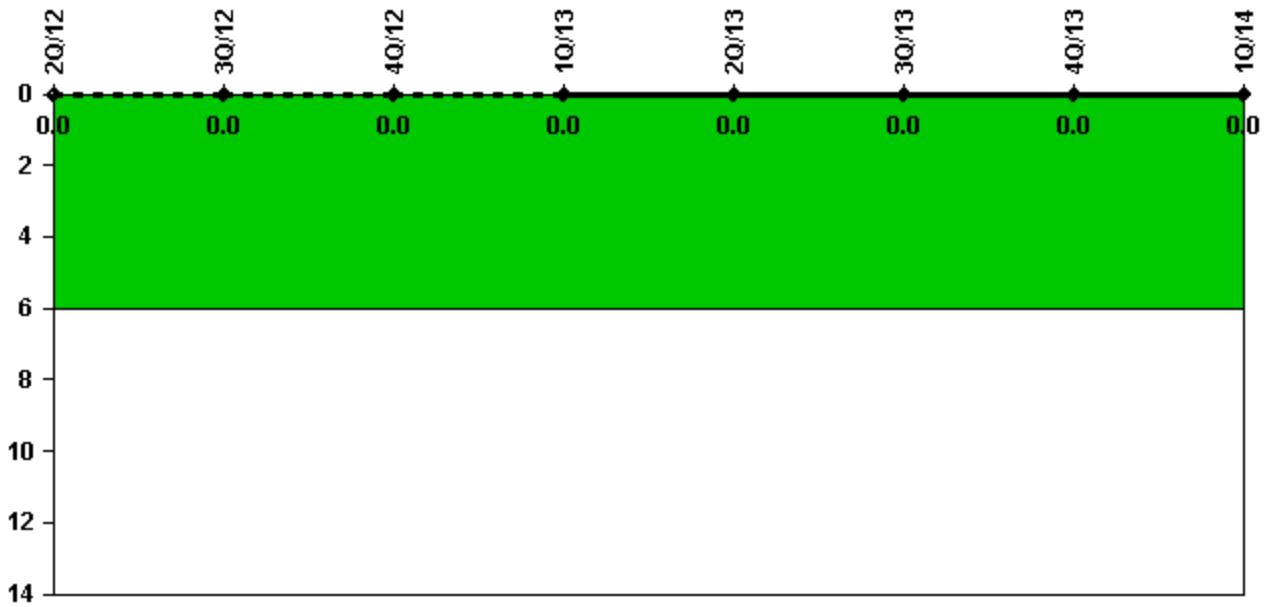


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

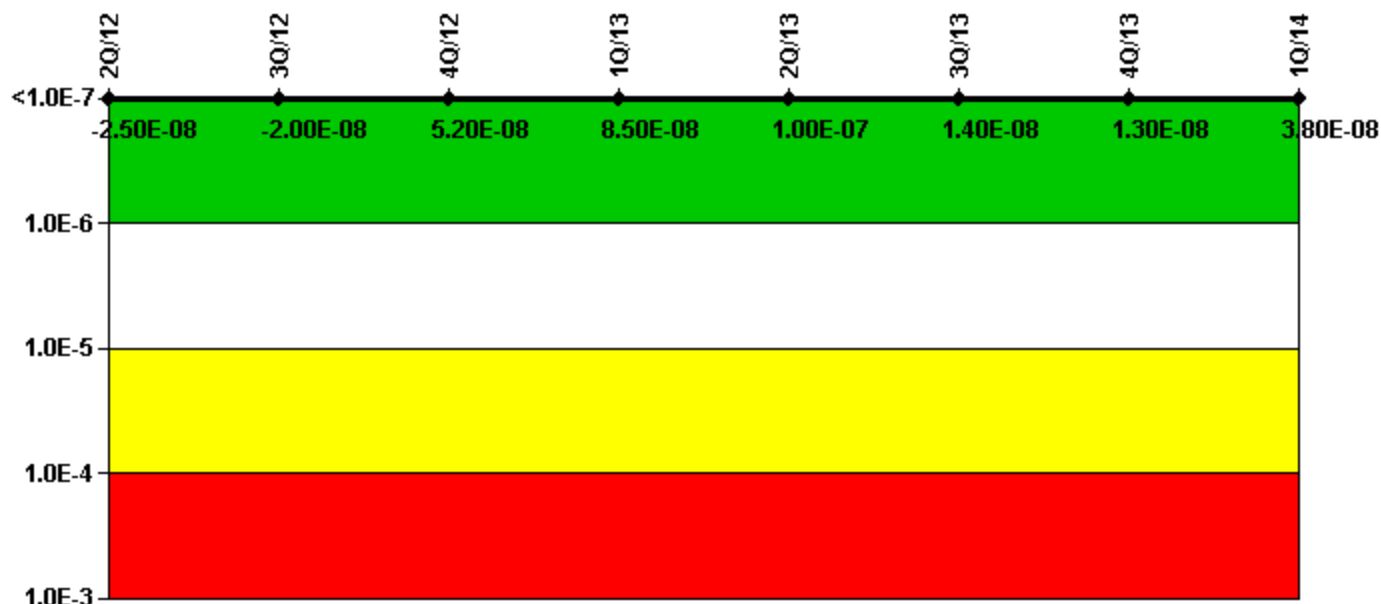

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-1.31E-09	-9.34E-11	7.10E-09	3.96E-08	5.19E-08	4.53E-08	4.38E-08	6.34E-08
URI (Δ CDF)	-2.36E-08	-1.96E-08	4.52E-08	4.57E-08	4.89E-08	-3.11E-08	-3.08E-08	-2.49E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.50E-08	-2.00E-08	5.20E-08	8.50E-08	1.00E-07	1.40E-08	1.30E-08	3.80E-08

Licensee Comments:

3Q/13: Data correction to Unit 2 E2 EDG unavailability, 3Qtr2013. There is no change in threshold color.

Mitigating Systems Performance Index, High Pressure Injection System

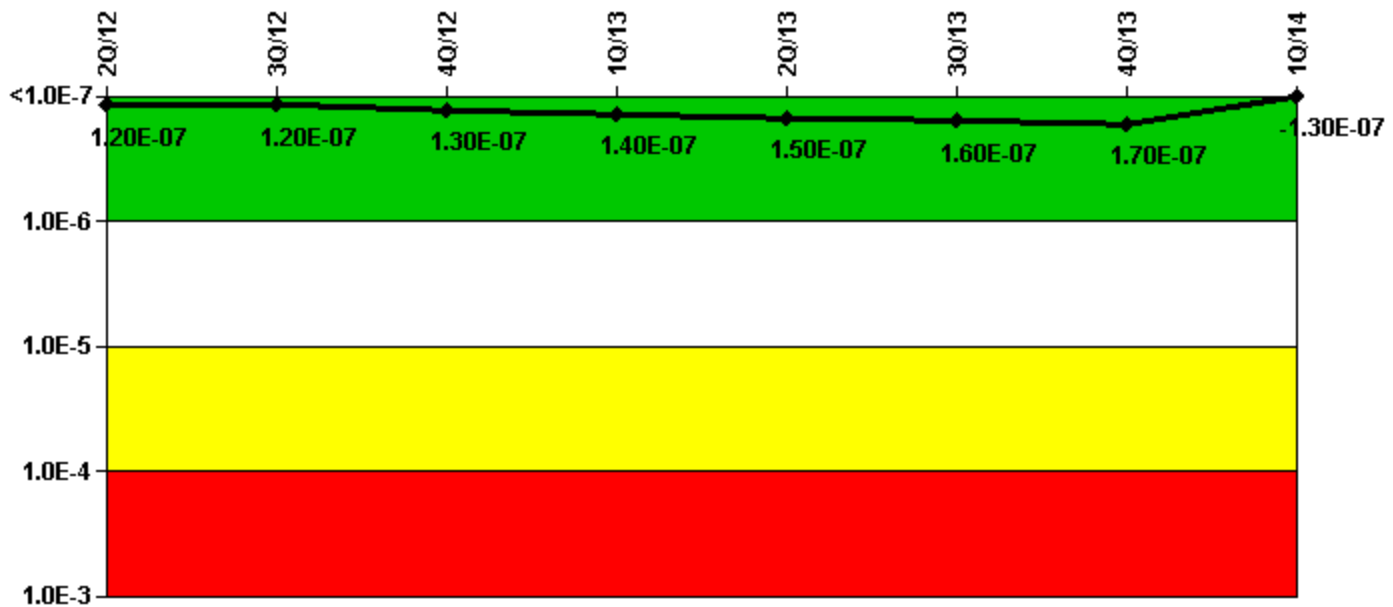

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-1.70E-08	-1.63E-08	-1.57E-08	-1.57E-08	-1.57E-08	-1.63E-08	-1.65E-08	-2.74E-08
URI (Δ CDF)	1.38E-07	1.41E-07	1.50E-07	1.60E-07	1.70E-07	1.80E-07	1.87E-07	-1.01E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.20E-07	1.20E-07	1.30E-07	1.40E-07	1.50E-07	1.60E-07	1.70E-07	-1.30E-07

Licensee Comments:

4Q/12: 1/15/2013 Changes to PBAPS MSPI Basis Document Revision 7, dated 9/10/2012 for 4thQtr2012 and forward were applied to MSPI-HPI and RH, to account for a revision to the estimated demands for HPI/RH per refueling cycle.

Mitigating Systems Performance Index, Heat Removal System

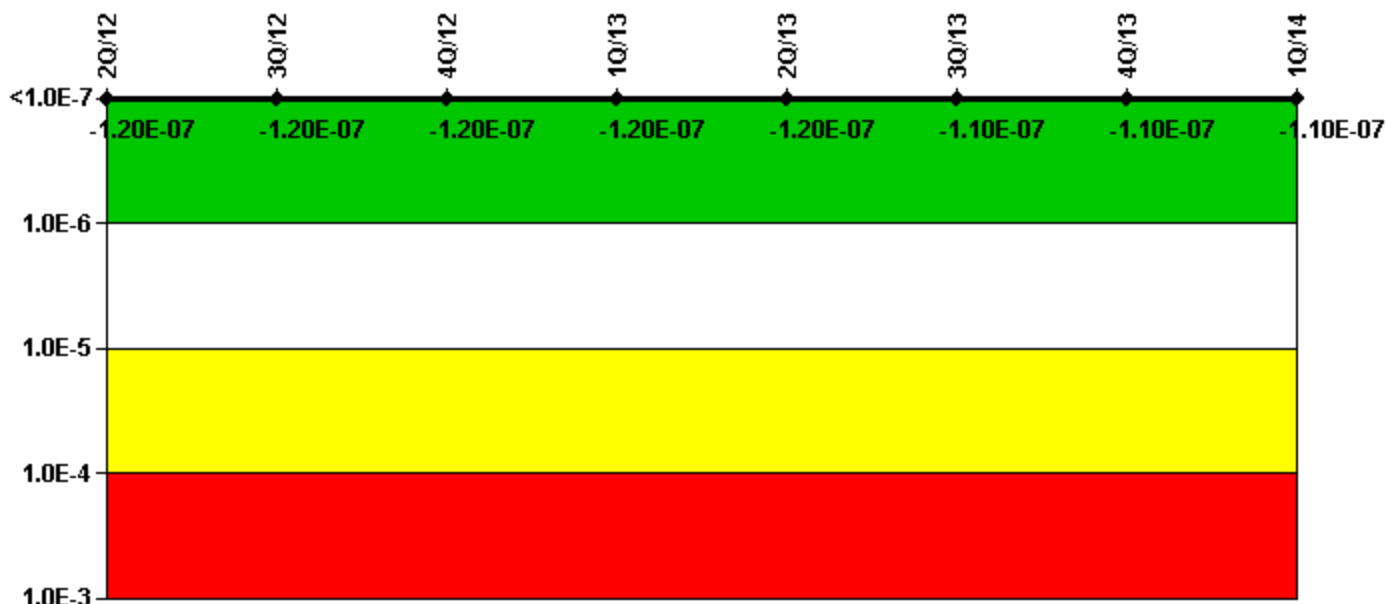

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08	-3.11E-08
URI (Δ CDF)	-9.18E-08	-9.11E-08	-8.89E-08	-8.65E-08	-8.40E-08	-8.14E-08	-7.95E-08	-7.75E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.10E-07	-1.10E-07	-1.10E-07

Licensee Comments:

4Q/12: 1/15/2013 Changes to PBAPS MSPI Basis Document Revision 7, dated 9/10/2012 for 4thQtr2012 and forward were applied to MSPI-HPI and RH, to account for a revision to the estimated demands for HPI/RH per refueling cycle.

Mitigating Systems Performance Index, Residual Heat Removal System

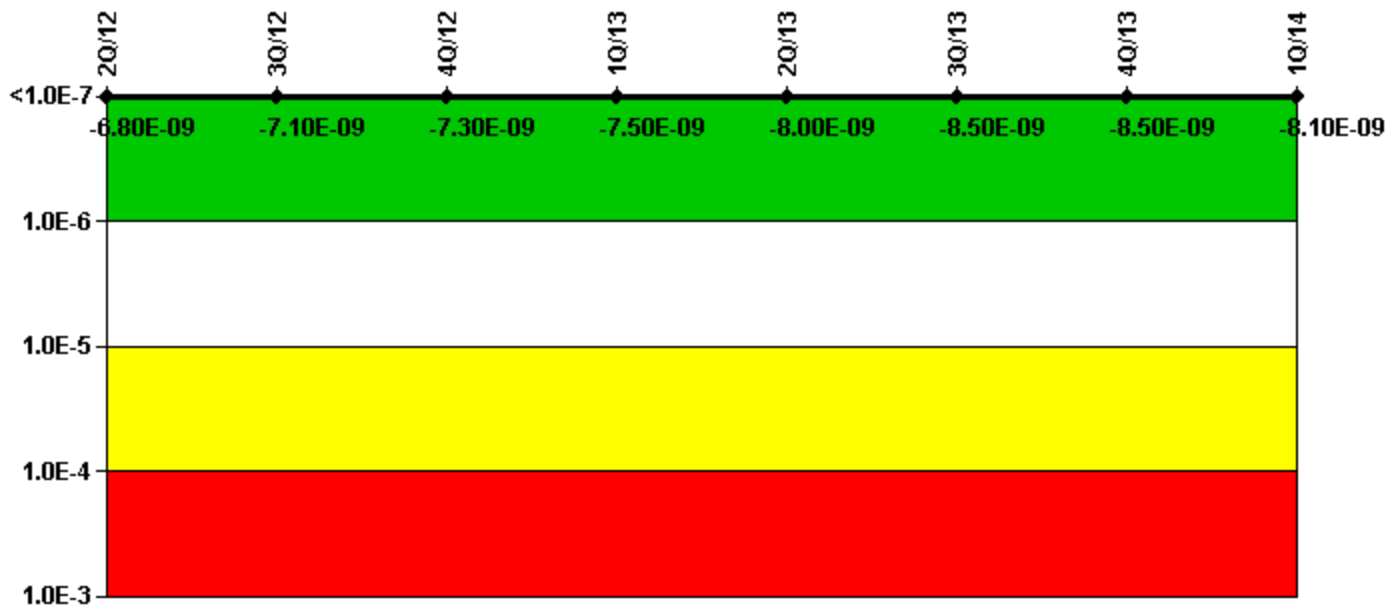


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-1.10E-10	8.40E-11	3.87E-10	6.60E-10	5.64E-10	5.02E-10	5.06E-10	9.60E-10
URI (Δ CDF)	-6.65E-09	-7.17E-09	-7.67E-09	-8.14E-09	-8.60E-09	-9.03E-09	-9.03E-09	-9.03E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.80E-09	-7.10E-09	-7.30E-09	-7.50E-09	-8.00E-09	-8.50E-09	-8.50E-09	-8.10E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

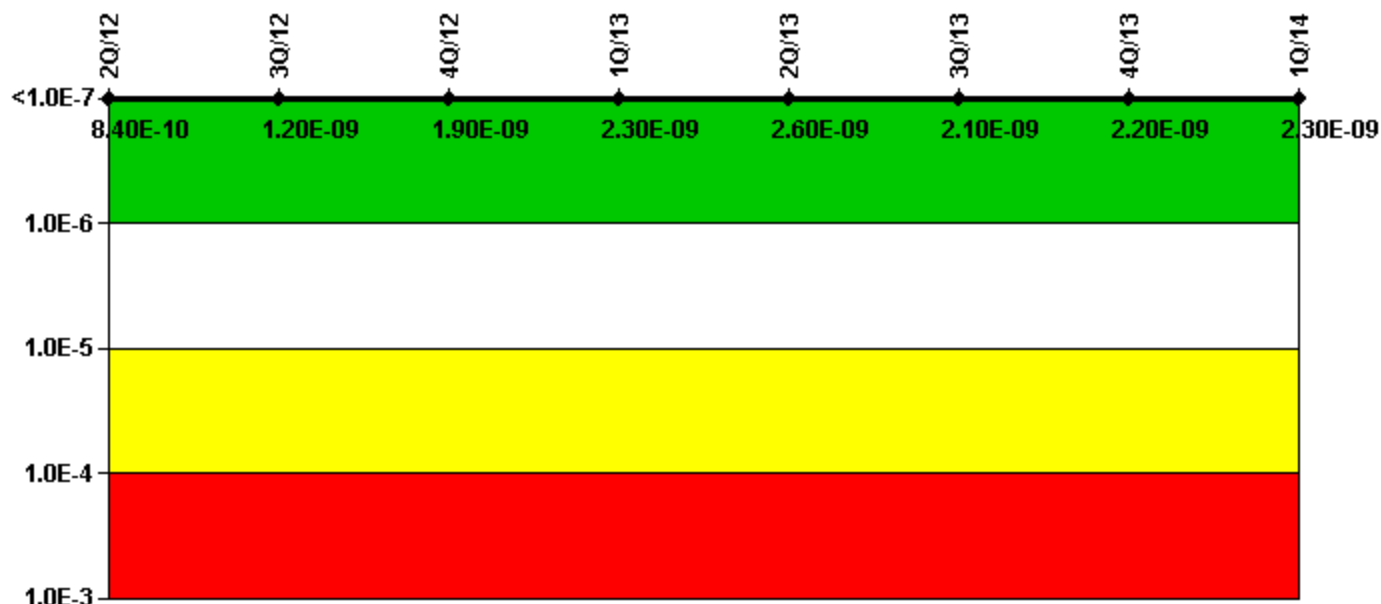

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	2.55E-09	2.93E-09	3.52E-09	3.94E-09	4.16E-09	3.68E-09	3.24E-09	3.34E-09
URI (Δ CDF)	-1.71E-09	-1.69E-09	-1.66E-09	-1.63E-09	-1.60E-09	-1.57E-09	-1.03E-09	-1.03E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.40E-10	1.20E-09	1.90E-09	2.30E-09	2.60E-09	2.10E-09	2.20E-09	2.30E-09

Licensee Comments:

4Q/13: Update applies to 4Q2013 forward. There was an MSPI Failure for 2B HPSW Motor, 2BP042-DR, cooling coil due to high moisture content on 12/09/2013. This impacted 4Q2013 and 1Q2014 data. This did not result in a color change or threshold being exceeded.

Reactor Coolant System Activity

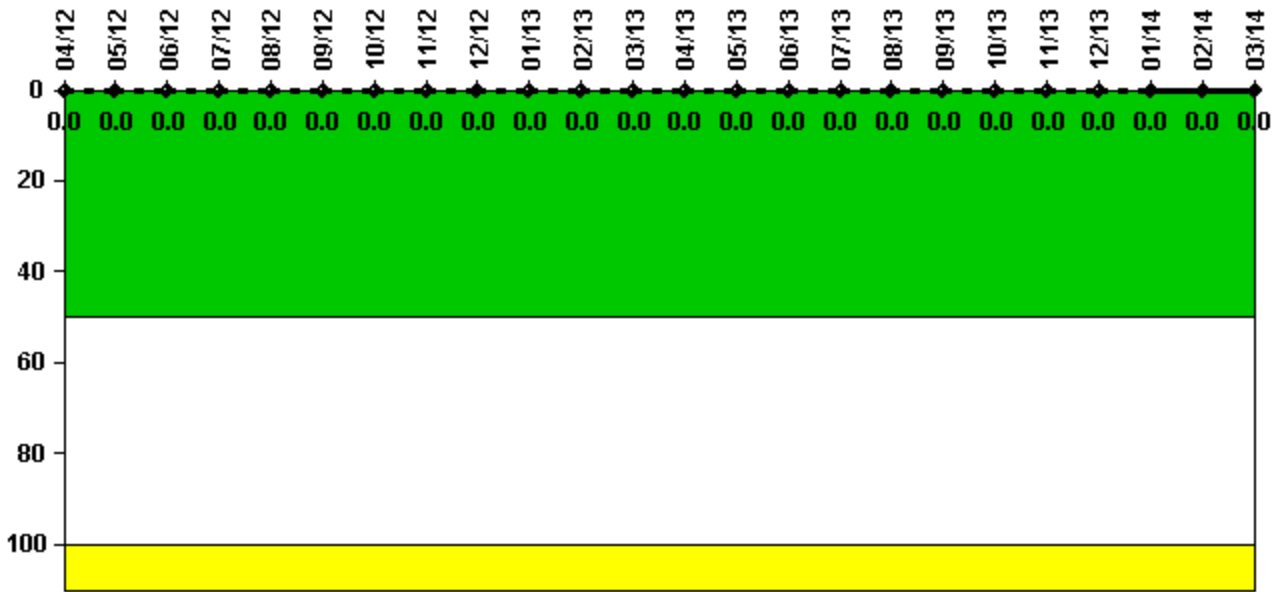


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum activity	0.000020	0.000020	0.000020	0.000024	0.000021	0.000020	0.000021	0.000017	0.000016	0.000018	0.000017	0.000020
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum activity	0.000017	0.000018	0.000019	0.000019	0.000019	0.000018	0.000018	0.000018	0.000018	0.000020	0.000019	0.000021
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

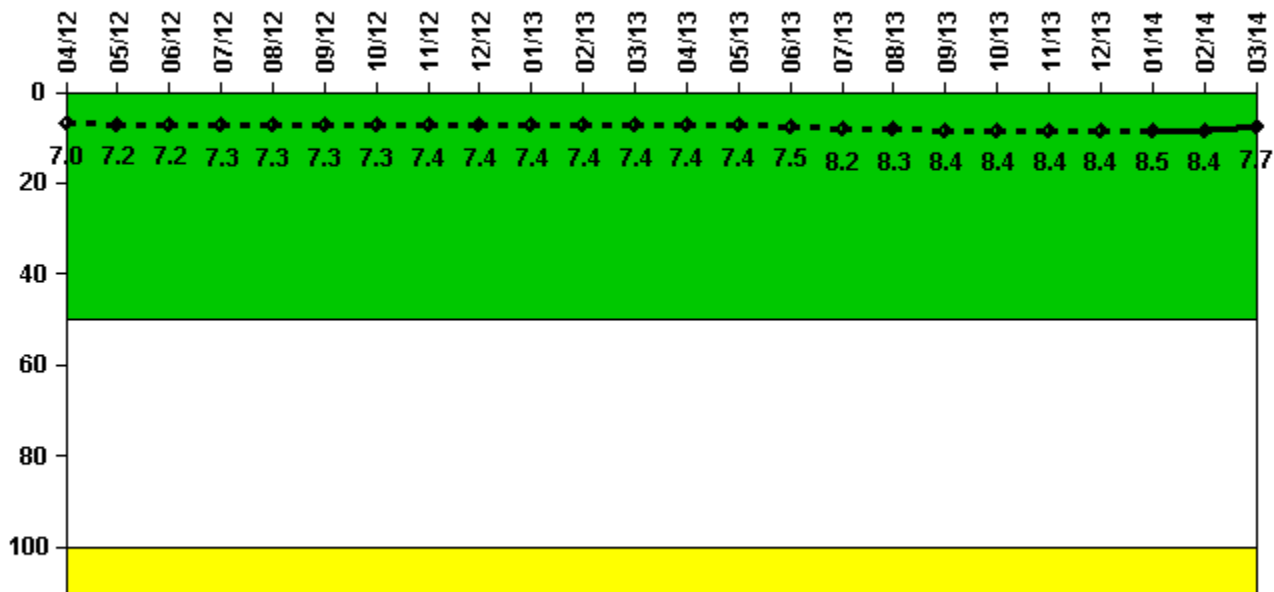


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum leakage	1.750	1.790	1.810	1.820	1.820	1.820	1.830	1.860	1.850	1.840	1.840	1.860
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.0	7.2	7.2	7.3	7.3	7.3	7.3	7.4	7.4	7.4	7.4	7.4
Reactor Coolant System Leakage	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum leakage	1.850	1.850	1.880	2.060	2.070	2.090	2.110	2.100	2.100	2.130	2.090	1.930
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.4	7.4	7.5	8.2	8.3	8.4	8.4	8.4	8.4	8.5	8.4	7.7

Licensee Comments: none

Drill/Exercise Performance

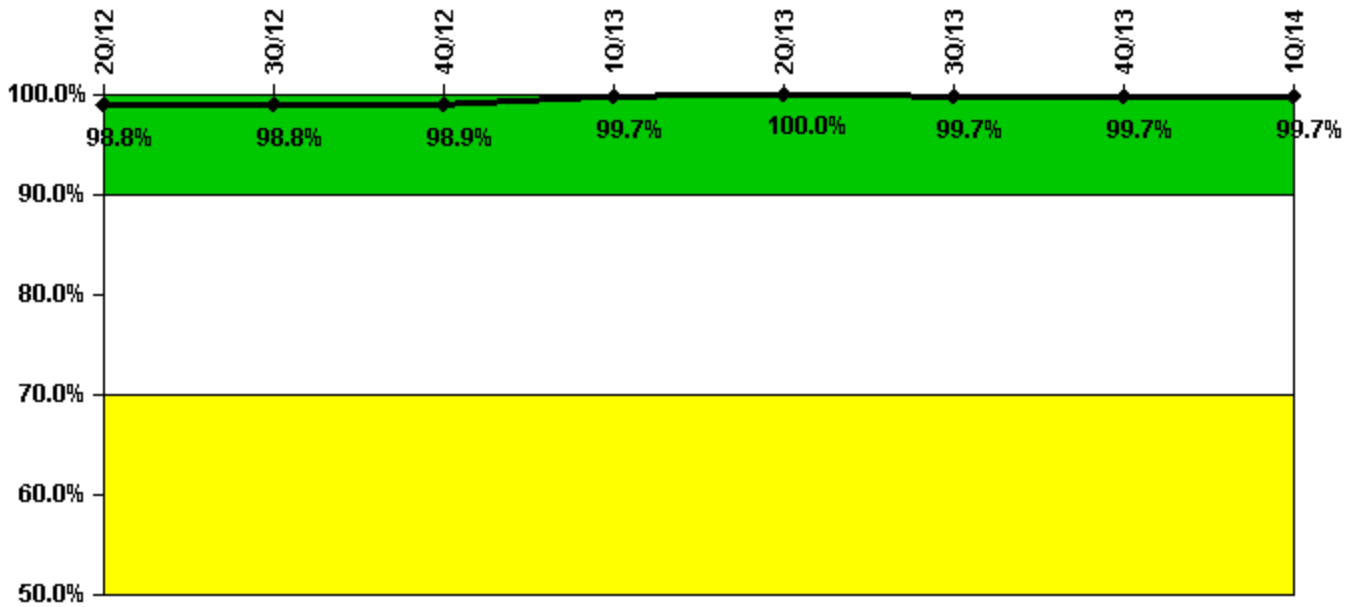


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful opportunities	32.0	15.0	57.0	81.0	71.0	9.0	27.0	106.0
Total opportunities	32.0	15.0	57.0	81.0	71.0	10.0	27.0	106.0
Indicator value	98.8%	98.8%	98.9%	99.7%	100.0%	99.7%	99.7%	99.7%

Licensee Comments: none

ERO Drill Participation

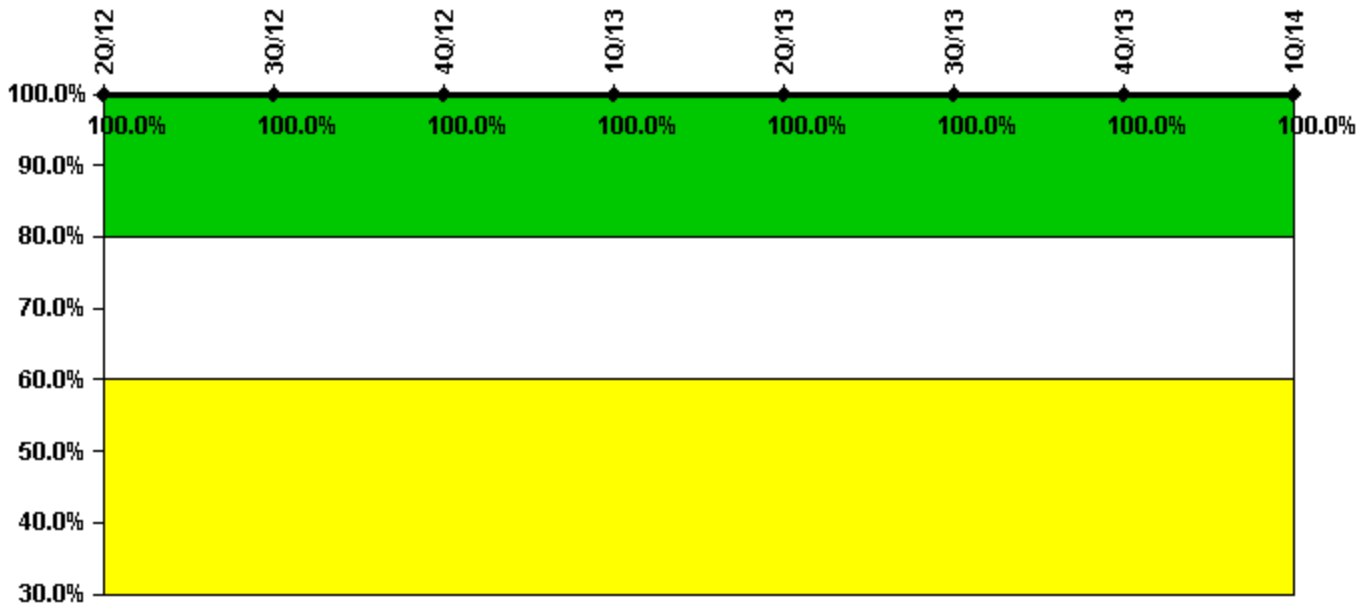


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Participating Key personnel	72.0	74.0	77.0	75.0	77.0	76.0	75.0	77.0
Total Key personnel	72.0	74.0	77.0	75.0	77.0	76.0	75.0	77.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

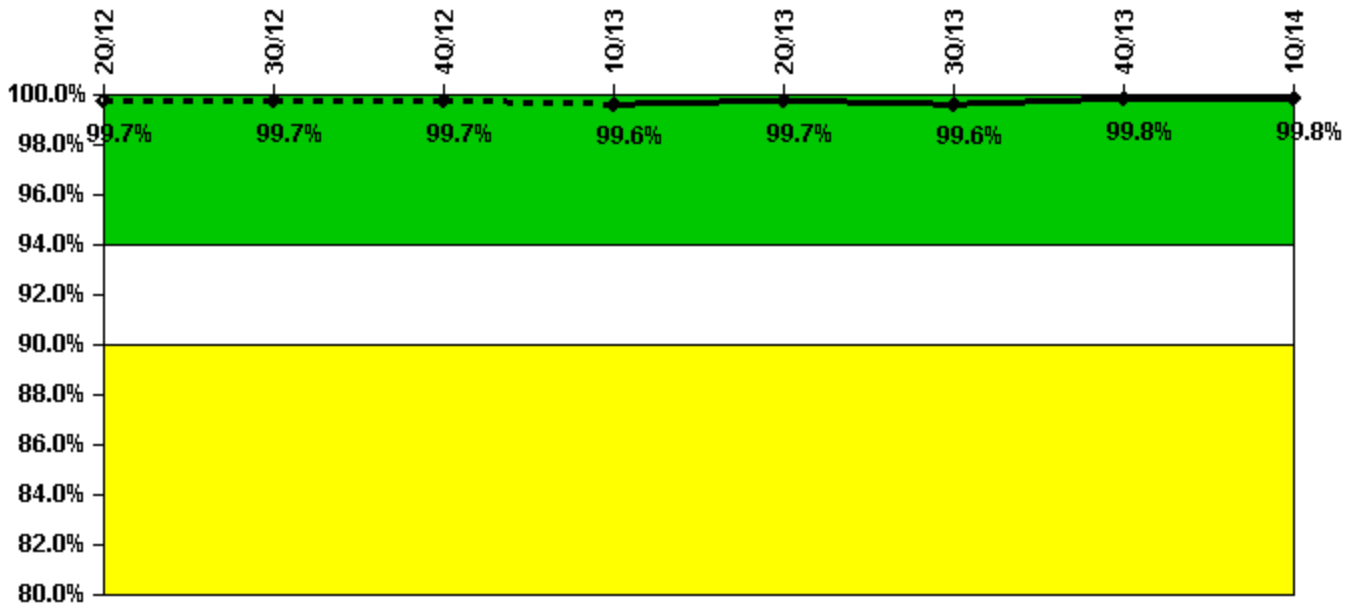


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful siren-tests	1258	1257	1249	1256	1259	1256	1261	1260
Total sirens-tests	1261	1261	1255	1261	1261	1261	1261	1261
Indicator value	99.7%	99.7%	99.7%	99.6%	99.7%	99.6%	99.8%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

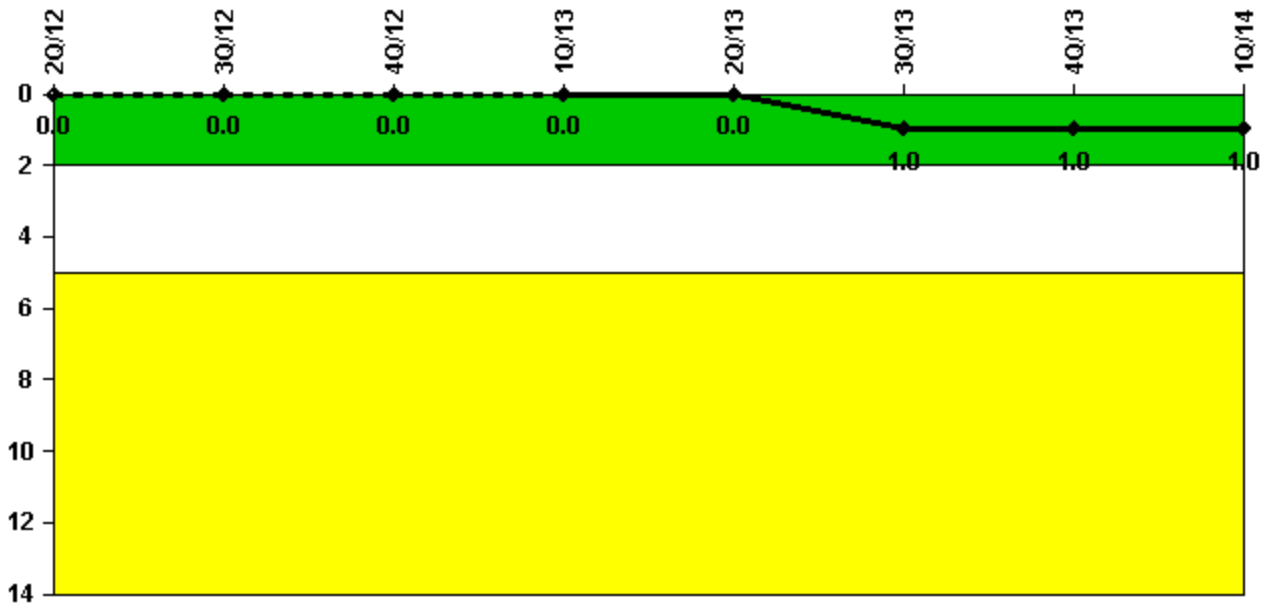


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
High radiation area occurrences	0	0	0	0	0	1	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent

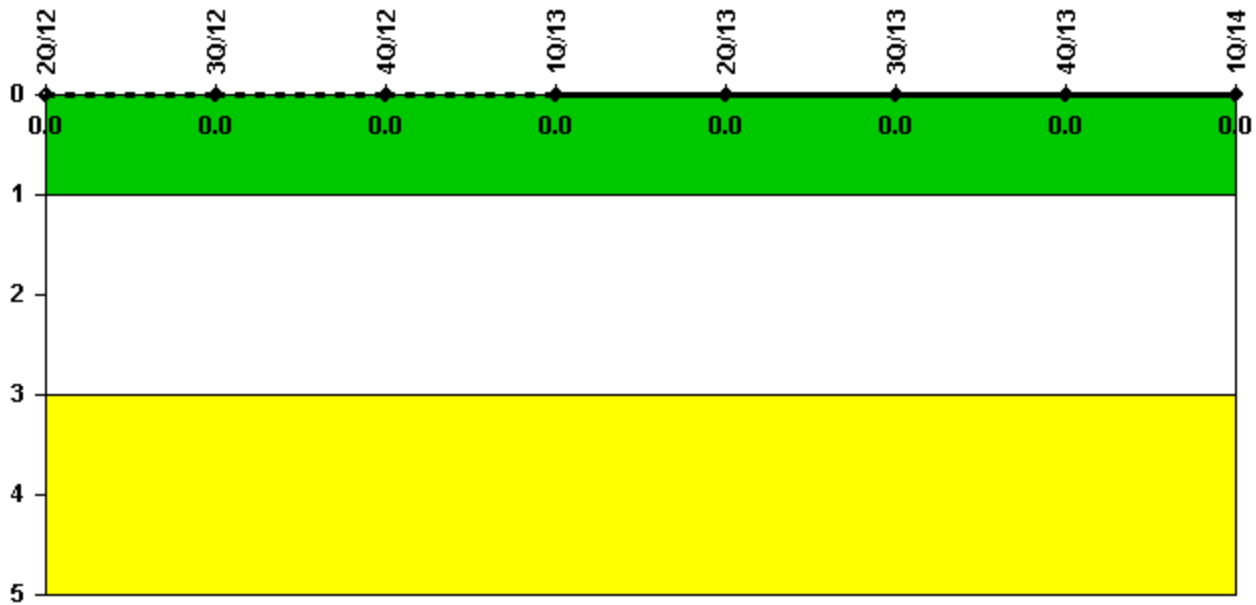

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2014